MIAMI-DADE COUNTY
DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Glasswall LLC
3550 NW 49 Street
Miami, FL 33142

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "102S" Aluminum Single Hung Window – S.M.I.

APPROVAL DOCUMENT: Drawing No. **W08-83**, titled "Series-102S Alum. Single Hung Window (S.M.I.) " sheets 1 through 9 of 9, dated 09/26/08, with revision A dated 03/18/13, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA# 08-1021.05** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**

MIAMI-DADE COUNTY APPROVED

5/8/13

Glasswall LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W08-83**, titled "Series-102S Aluminum Single Hung Window (S.M.I.)" sheets 1 through 9 of 9, dated 09/26/08, with revision A dated 03/18/13, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
   2) Water Resistance Test, per FBC, TAS 202-94
   3) Large Missile Impact Test per FBC, TAS 201-94
   4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   5) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
   6) Drop Load Test per ANSI Z97.1

   along with marked-up drawings and installation diagram of series 102S aluminum single hung windows mulled together over fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4270**, dated 09/20/04, signed and sealed by Carlos S. Rionda, P.E.
   (Submitted under previous NOA# 08-1021.05)
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
   2) Water Resistance Test, per FBC, TAS 202-94
   3) Small Missile Impact Test per FBC, TAS 201-94
   4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   5) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
   6) Drop Load Test per ANSI Z97.1

   along with marked-up drawings and installation diagram of series 102S aluminum single hung windows mulled together over fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4272**, dated 09/20/04, signed and sealed by Edmundo Largaespada, P.E.
   (Submitted under previous NOA# 08-1021.05)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
   2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
   3) Water Resistance Test, per FBC, TAS 202-94
   4) Large Missile Impact Test per FBC, TAS 201-94
   5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   6) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94

   along with marked-up drawings and installation diagram of one unit of O-O-O/X configuration aluminum fixed and single hung windows mulled together, prepared by Fenestration Testing laboratory, Inc., Test Report No. **FTL-3222**, dated 11/26/01, signed and sealed by Luis Antonio Figueredo, P.E.
   (Submitted under NOA# 02-0805.10)

Manuel Perez

Manuel Perez, P.E.
Product Control Examiner
NOA No. 13-0321.13
Expiration Date: January 28, 2014
Approval Date: May 16, 2013

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

4. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
   2) Small Missile Impact Test per FBC, TAS 201-94
   3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   along with marked-up drawings and installation diagram of Series 102 Aluminum Single Hung Windows mulled together, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-3220** and **3221**, dated 12/4/01 and 11/28/01 respectively, both signed and sealed by Luis Antonio Figueredo, P.E.
   (Submitted under NOA# 02-0805.10)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis prepared by prepared by Al-Farooq Corporation, complying with FBC 2004/2007, dated 09/29/08, signed and sealed by Humayoun Farooq, P.E.
   (Submitted under previous NOA# 08-1021.05)
2. Glazing complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **12–1231.10** issued to **Eastern Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" dated 03/28/13, expiring on 05/21/16.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC-2010, and of no financial interest, dated March 18, 2013, signed and sealed by Javad Ahmad, P.E.
2. Laboratory compliance letter issued by Fenestration Testing laboratory, Inc., for Test Reports No. **FTL-3220** and **FTL-3222**, both signed and sealed by Luis A. Figueredo, P.E.
   (Submitted under NOA# 02-0805.10)

G. OTHER

1. Notice of Acceptance No. **08-1021.05**, issued to Glasswall LLC for their Series 102S Aluminum Single Hung Window – S.M.I., approved on 01/28/09 and expiring on 01/28/14.

Manuel Perez, P.E.
Product Control Examiner
NOA No. 13-0321.13
Expiration Date: January 28, 2014
Approval Date: May 16, 2013

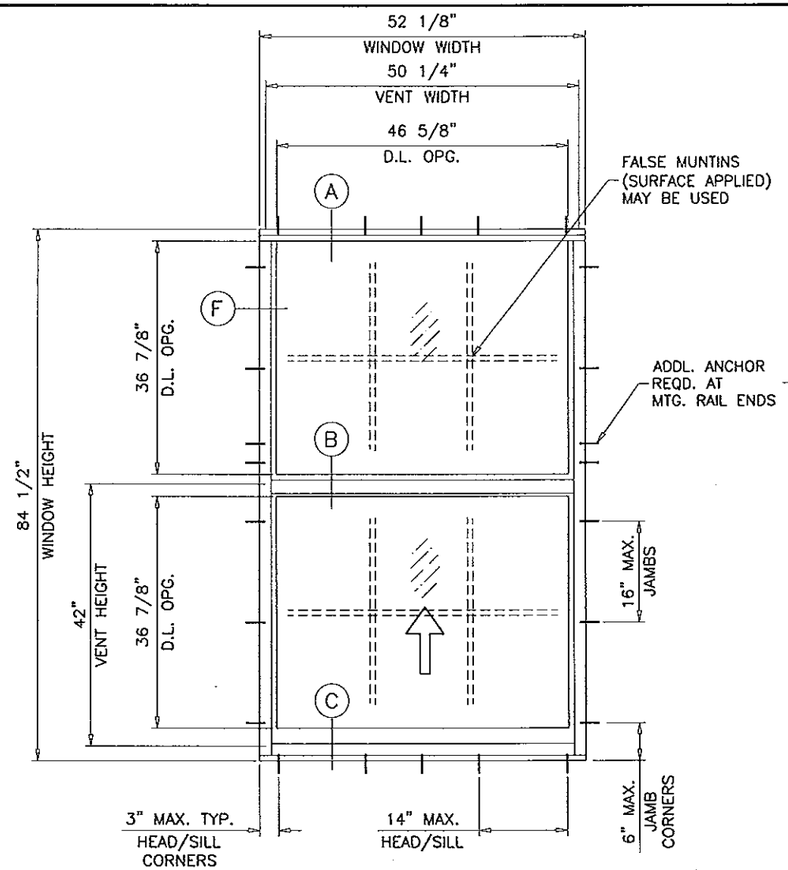

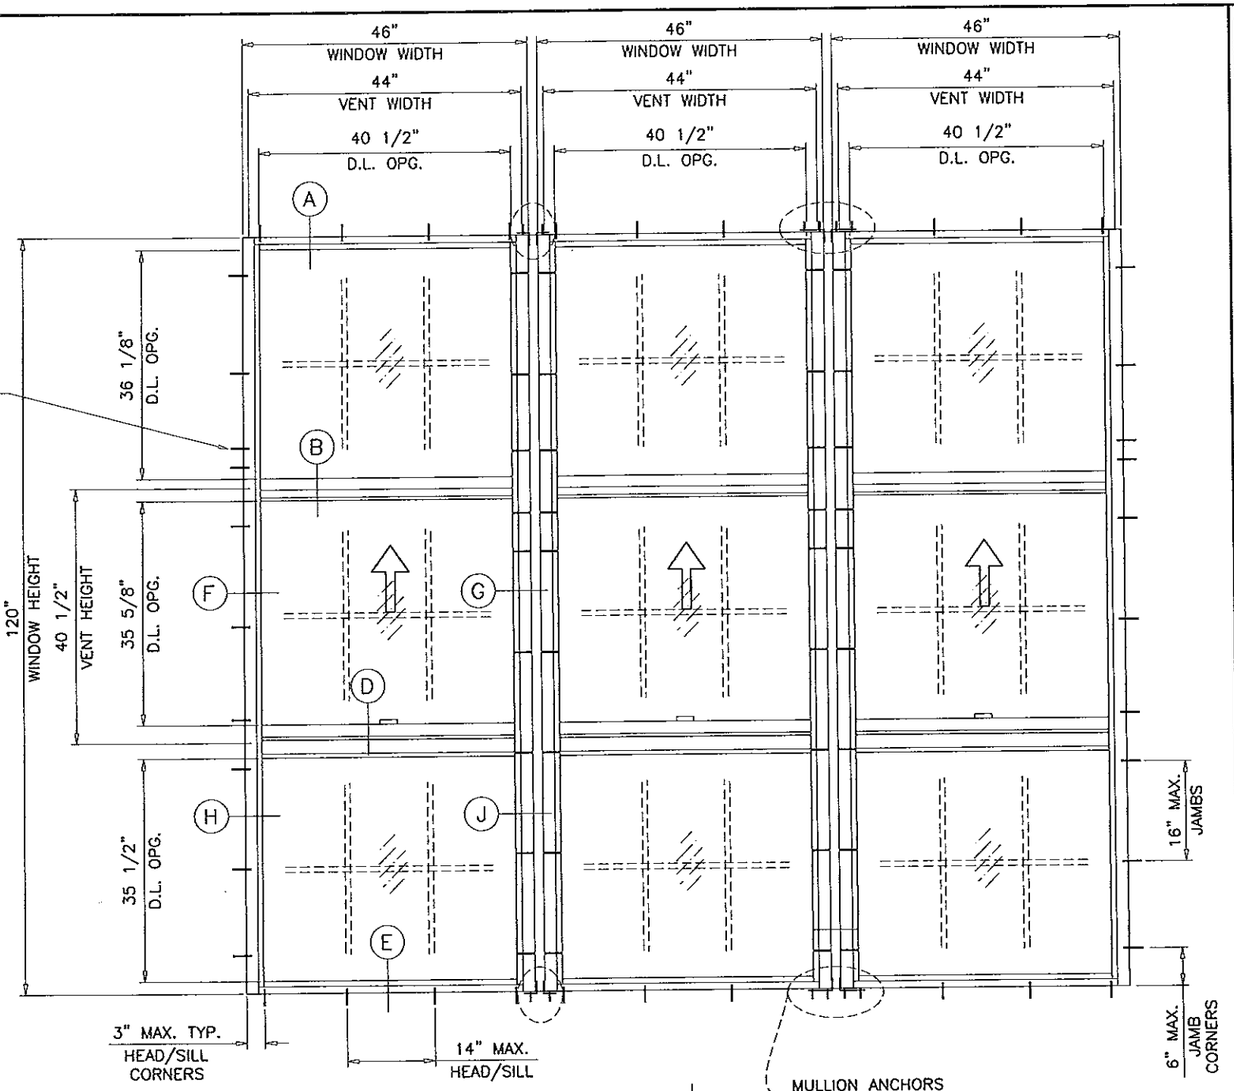

TYPICAL ELEVATIONS

TESTED UNITS

THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT. MIAMI–DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS ARE REQUIRED FOR INSTALLATIONS UPTO 30 FT. OF GRADE. SHUTTERS NOT REQUIRED FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

SERIES–102S ALUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

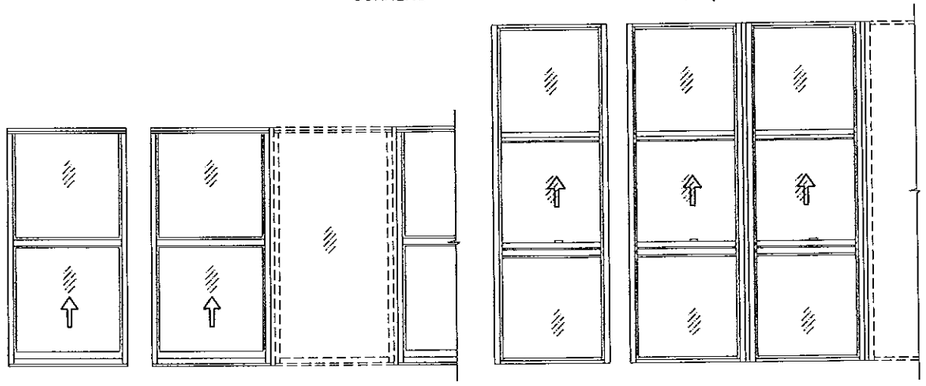

APPROVED CONFIGURATIONS

THESE WINDOWS CAN BE INSTALLED AS SINGLE UNITS OR SIDE BY SIDE COMBINATION OF TWO OR MORE UNITS USING MULLIONS IN BETWEEN.
ALSO IN COMBINATION WITH MIAMI–DADE COUNTY APPROVED SERIES 102S FIXED WINDOWS USING MULLIONS IN BETWEEN.
LOWER DESIGN PRESSURES FROM WINDOWS, MULLION OR FIX. WDW. APPROVAL WILL APPLY TO ENTIRE SYSTEM.

WINDOWS WITH GLASS TYPE 'A' COMPLIES WITH REQUIREMENTS OF ANSI Z97.1.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 22, 2014
By Maxwell Lee
Miami Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP–ANL\W08–83GWL

SERIES–102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638–5151 FAX. (305) 638–5158

revisions:

no	date	by	description
A	03.18.13		UPDATED TO 2010 FBC

date: 09–26–08
scale: 1/2"=1'–0"
dr. by: HAMID
chk. by:

drawing no.
W08–83

sheet 1 of 9

SINGLE HUNG WINDOWS			
DESIGN LOAD CAPACITY – PSF			
WINDOW DIMS.		GLASS TYPE 'A'	GLASS TYPE 'B'
WIDTH	HEIGHT	EXT. (+) INT. (–)	EXT. (+) INT. (–)
19–1/8"	26"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		110.0	100.0
52–1/4"		110.0	100.0
19–1/8"	38–3/8"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		110.0	100.0
52–1/4"		110.0	100.0
19–1/8"	50–5/8"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		110.0	100.0
52–1/4"		93.7	100.0
19–1/8"	58"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		110.0	100.0
52–1/4"		84.5	100.0
19–1/8"	63"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		102.1	100.0
52–1/4"		79.7	100.0
19–1/8"	74–1/4"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		110.0	100.0
52–1/4"		–	100.0
19–1/8"	80"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		110.0	100.0
52–1/4"		–	100.0

SINGLE HUNG WINDOWS			
DESIGN LOAD CAPACITY – PSF			
WINDOW DIMS.		GLASS TYPE 'A'	GLASS TYPE 'B'
WIDTH	HEIGHT	EXT. (+) INT. (–)	EXT. (+) INT. (–)
19–1/8"	84–1/2"	110.0	100.0
26–1/2"		110.0	100.0
32"		110.0	100.0
37"		110.0	100.0
42"		110.0	100.0
46"		–	100.0
52–1/4"		–	100.0

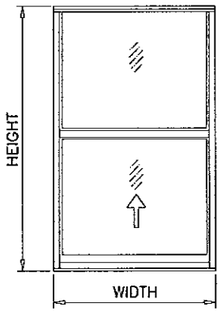

SINGLE HUNG WINDOWS

WINDOWALL BOTTOM LITE			
DESIGN LOAD CAPACITY – PSF			
WINDOW DIMS.		GLASS TYPE 'A'	GLASS TYPE 'B'
W	H	EXT. (+) INT. (–)	EXT. (+) INT. (–)
46"	40"	110.0	100.0

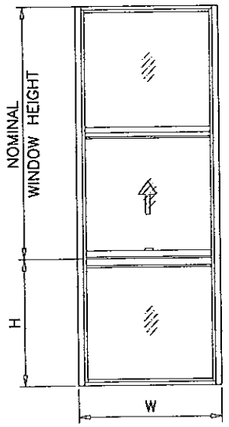

SINGLE HUNG OVER FIXED WINDOWS

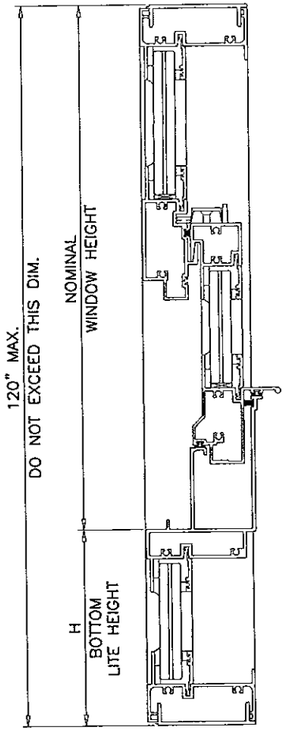

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300–04 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05–DEC–219

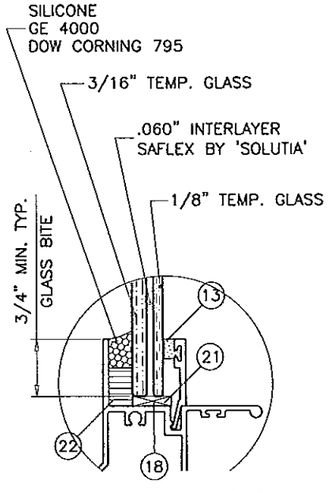

GLASS TYPE 'A'

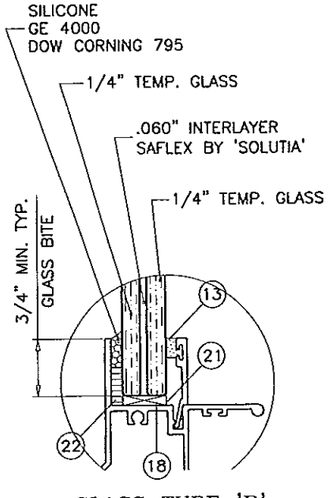

GLASS TYPE 'B'

GLAZING OPTIONS

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 13-032.13
Expiration Date Jan. 28, 2014
By Maxwell Joss
Miami Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-83GWL

SERIES-102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description
A	03.18.13		UPDATED TO 2010 FBC

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. W08-83

sheet 2 of 9

MULLION LOAD CAPACITY - PSF				
WINDOW DIMS.		MULLION W/O REINF.	MULLION W/ 1/2" X 4" STEEL BAR	MULLION W/ 3/4" X 4" STEEL BAR
WIDTH (W)	MULL SPAN	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
19-1/8"	80"	110.0	110.0	110.0
26-1/2"		110.0	110.0	110.0
32"		110.0	110.0	110.0
37"		110.0	110.0	110.0
42"		110.0	110.0	110.0
46"		110.0	110.0	110.0
52-1/4"		110.0	110.0	110.0
19-1/8"	84-5/8"	110.0	110.0	110.0
26-1/2"		110.0	110.0	110.0
32"		110.0	110.0	110.0
37"		110.0	110.0	110.0
42"		110.0	110.0	110.0
46"		106.7	110.0	110.0
52-1/4"		93.9	110.0	110.0
19-1/8"	90"	110.0	110.0	110.0
26-1/2"		110.0	110.0	110.0
32"		110.0	110.0	110.0
37"		110.0	110.0	110.0
42"		97.2	110.0	110.0
46"		88.7	110.0	110.0
52-1/4"		78.1	110.0	110.0
19-1/8"	96"	110.0	110.0	110.0
26-1/2"		110.0	110.0	110.0
32"		105.1	110.0	110.0
37"		90.9	110.0	110.0
42"		80.1	110.0	110.0
46"		73.1	110.0	110.0
52-1/4"		64.4	110.0	110.0
19-1/8"	102"	110.0	110.0	110.0
26-1/2"		105.8	110.0	110.0
32"		87.6	110.0	110.0
37"		75.8	110.0	110.0
42"		66.7	110.0	110.0
46"		60.9	110.0	110.0
52-1/4"		53.7	99.2	110.0
19-1/8"	108"	110.0	110.0	110.0
26-1/2"		89.1	110.0	110.0
32"		73.8	110.0	110.0
37"		63.8	110.0	110.0
42"		56.2	110.0	110.0
46"		51.3	100.5	110.0
52-1/4"		45.2	88.5	110.0

MULLION LOAD CAPACITY - PSF				
WINDOW DIMS.		MULLION W/O REINF.	MULLION W/ 1/2" X 4" STEEL BAR	MULLION W/ 3/4" X 4" STEEL BAR
WIDTH (W)	MULL SPAN	EXT. (+) INT. (-)	EXT. (+) INT. (-)	EXT. (+) INT. (-)
19-1/8"	114"	105.0	110.0	110.0
26-1/2"		75.8	110.0	110.0
32"		62.7	110.0	110.0
37"		54.3	110.0	110.0
42"		47.8	98.8	110.0
46"		43.7	90.2	110.0
19-1/8"	120"	90.0	110.0	110.0
26-1/2"		65.0	110.0	110.0
32"		53.8	110.0	110.0
37"		46.5	101.2	110.0
42"		41.0	89.2	110.0
46"		37.4	81.4	106.5

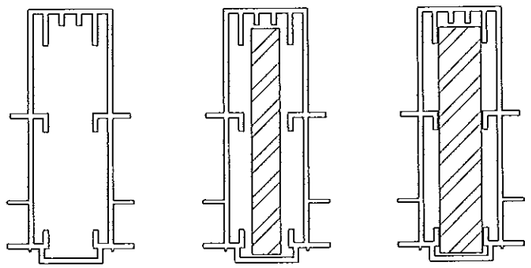

MULLION W/O REINF.

MULLION WITH 1/2" X 4" STEEL REINF.

MULLION WITH 3/4" X 4" STEEL REINF.

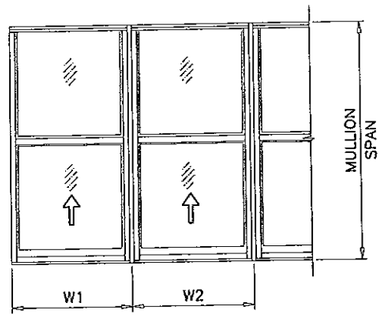

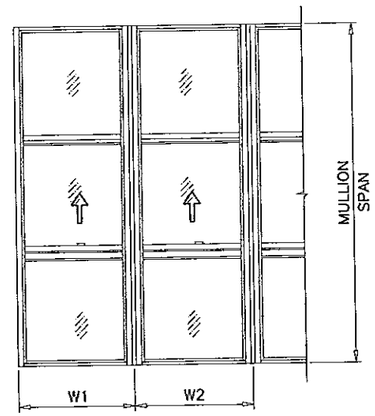

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

SEE CHARTS ON SHEET 2 FOR WINDOW CAPACITY.
SEE CHARTS ABOVE FOR WINDOW MULLION CAPACITY.
SEE CHARTS ON SHEET 4 FOR MULLION ANCHOR CAPACITY.
LOWER VALUES FROM THESE CHARTS WILL APPLY TO ENTIRE SYSTEM.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 13-0321.13
Expiration Date Jan 22, 2014
By Manuel Perez
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-83GWL

SERIES-1025 ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. W08-83

MULLION ANCHOR LOAD CAPACITY – PSF
SINGLE HUNG WINDOWS

WINDOW DIMS.		2" MIN. EDGE DIST.		3" MIN. EDGE DIST.	
		2 ANCHORS @ MULL END	4 ANCHORS @ MULL END	2 ANCHORS @ MULL END	4 ANCHORS @ MULL END
WIDTH (W)	MULL SPAN	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)
19-1/8"	50-5/8"	110.0	110.0	110.0	110.0
26-1/2"		110.0	110.0	110.0	110.0
32"		110.0	110.0	110.0	110.0
37"		110.0	110.0	110.0	110.0
42"		110.0	110.0	110.0	110.0
46"		110.0	110.0	110.0	110.0
52-1/4"		102.2	110.0	110.0	110.0
19-1/8"	63"	110.0	110.0	110.0	110.0
26-1/2"		110.0	110.0	110.0	110.0
32"		110.0	110.0	110.0	110.0
37"		101.1	110.0	110.0	110.0
42"		92.3	110.0	110.0	110.0
46"		86.4	110.0	110.0	110.0
52-1/4"		78.4	110.0	110.0	110.0
19-1/8"	74-1/4"	110.0	110.0	110.0	110.0
26-1/2"		103.9	110.0	110.0	110.0
32"		90.1	110.0	110.0	110.0
37"		81.4	110.0	110.0	110.0
42"		74.7	110.0	110.0	110.0
46"		70.1	110.0	105.1	110.0
52-1/4"		63.9	110.0	95.9	110.0
19-1/8"	80"	110.0	110.0	110.0	110.0
26-1/2"		95.0	110.0	110.0	110.0
32"		82.0	110.0	110.0	110.0
37"		73.8	110.0	110.0	110.0
42"		67.7	110.0	101.6	110.0
46"		63.6	110.0	95.5	110.0
52-1/4"		58.1	110.0	87.2	110.0
19-1/8"	84-5/8"	110.0	110.0	110.0	110.0
26-1/2"		88.8	110.0	110.0	110.0
32"		76.5	110.0	110.0	110.0
37"		68.7	110.0	103.0	110.0
42"		62.9	110.0	94.3	110.0
46"		59.1	110.0	88.7	110.0
52-1/4"		54.1	110.0	81.1	110.0

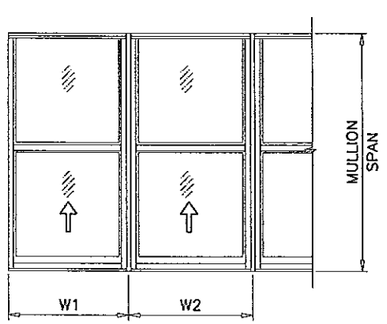

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

MULLION ANCHOR LOAD CAPACITY – PSF
SINGLE HUNG OVER FIXED WINDOW

WINDOW DIMS.		2" MIN. EDGE DIST.		3" MIN. EDGE DIST.	
		2 ANCHORS @ MULL END	4 ANCHORS @ MULL END	2 ANCHORS @ MULL END	4 ANCHORS @ MULL END
WIDTH (W)	MULL SPAN	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)
19-1/8"	80"	110.0	110.0	110.0	110.0
26-1/2"		95.0	110.0	110.0	110.0
32"		81.4	110.0	110.0	110.0
37"		72.1	110.0	108.2	110.0
42"		64.7	110.0	97.1	110.0
46"		59.8	110.0	89.7	110.0
52-1/4"		53.5	110.0	80.2	110.0
19-1/8"	84-5/8"	110.0	110.0	110.0	110.0
26-1/2"		88.8	110.0	110.0	110.0
32"		76.2	110.0	110.0	110.0
37"		67.6	110.0	101.4	110.0
42"		60.7	110.0	91.1	110.0
46"		56.1	110.0	84.2	110.0
52-1/4"		50.2	110.0	75.3	110.0
19-1/8"	90"	109.2	110.0	110.0	110.0
26-1/2"		82.6	110.0	110.0	110.0
32"		70.9	110.0	106.3	110.0
37"		62.9	110.0	94.4	110.0
42"		56.6	110.0	84.8	110.0
46"		52.3	110.0	78.5	110.0
52-1/4"		46.9	110.0	70.3	110.0
19-1/8"	96"	101.6	110.0	110.0	110.0
26-1/2"		76.6	110.0	110.0	110.0
32"		65.6	110.0	98.4	110.0
37"		58.3	110.0	87.5	110.0
42"		52.5	110.0	78.8	110.0
46"		48.6	110.0	72.9	110.0
52-1/4"		43.6	110.0	65.4	110.0
19-1/8"	102"	95.0	110.0	110.0	110.0
26-1/2"		71.4	110.0	107.1	110.0
32"		61.0	110.0	91.6	110.0
37"		54.3	110.0	81.4	110.0
42"		48.9	110.0	73.4	110.0
46"		45.3	110.0	68.0	110.0
52-1/4"		40.7	110.0	61.0	110.0
19-1/8"	108"	89.2	110.0	110.0	110.0
26-1/2"		66.9	110.0	100.4	110.0
32"		57.1	110.0	85.6	110.0
37"		50.7	110.0	76.1	110.0
42"		45.7	110.0	68.6	110.0
46"		42.4	110.0	63.6	110.0
52-1/4"		38.1	110.0	57.1	110.0

MULLION ANCHOR LOAD CAPACITY – PSF
SINGLE HUNG OVER FIXED WINDOW

WINDOW DIMS.		2" MIN. EDGE DIST.		3" MIN. EDGE DIST.	
		2 ANCHORS @ MULL END	4 ANCHORS @ MULL END	2 ANCHORS @ MULL END	4 ANCHORS @ MULL END
WIDTH (W)	MULL SPAN	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)	EXT. (+) INT. (–)
19-1/8"	114"	84.1	110.0	110.0	110.0
26-1/2"		62.9	110.0	94.4	110.0
32"		53.6	110.0	80.4	110.0
37"		47.5	110.0	71.3	110.0
42"		42.9	110.0	64.4	110.0
46"		39.8	110.0	59.7	110.0
19-1/8"	120"	79.5	110.0	110.0	110.0
26-1/2"		59.4	110.0	89.1	110.0
32"		50.5	110.0	75.7	110.0
37"		44.7	110.0	67.1	110.0
42"		40.4	110.0	60.6	110.0
46"		37.5	110.0	56.3	110.0

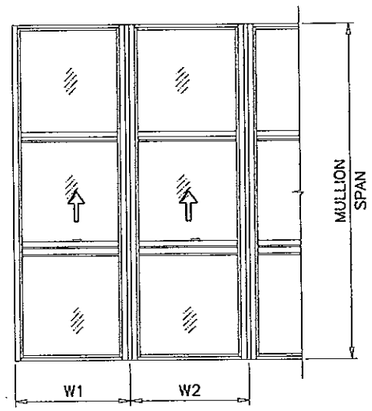

$$\text{WIDTH (W)} = \frac{W1 + W2}{2}$$

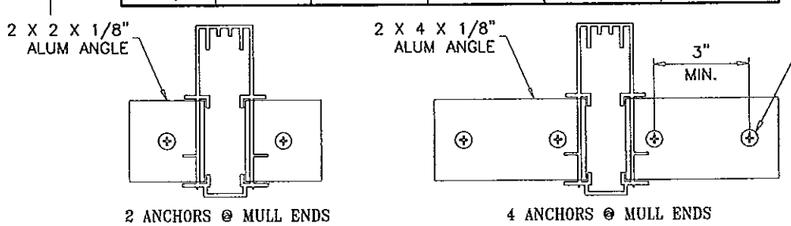

INSTALL CLIP ANGLES DIRECTLY TO CONC. WITHOUT SHIM SPACE
NOTCH WOOD BUCKS TO ACCOMMODATE CLIP ANGLES

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 28, 2014
By Miami Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-83GWL

SERIES-102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no. W08-83

sheet 4 of 9

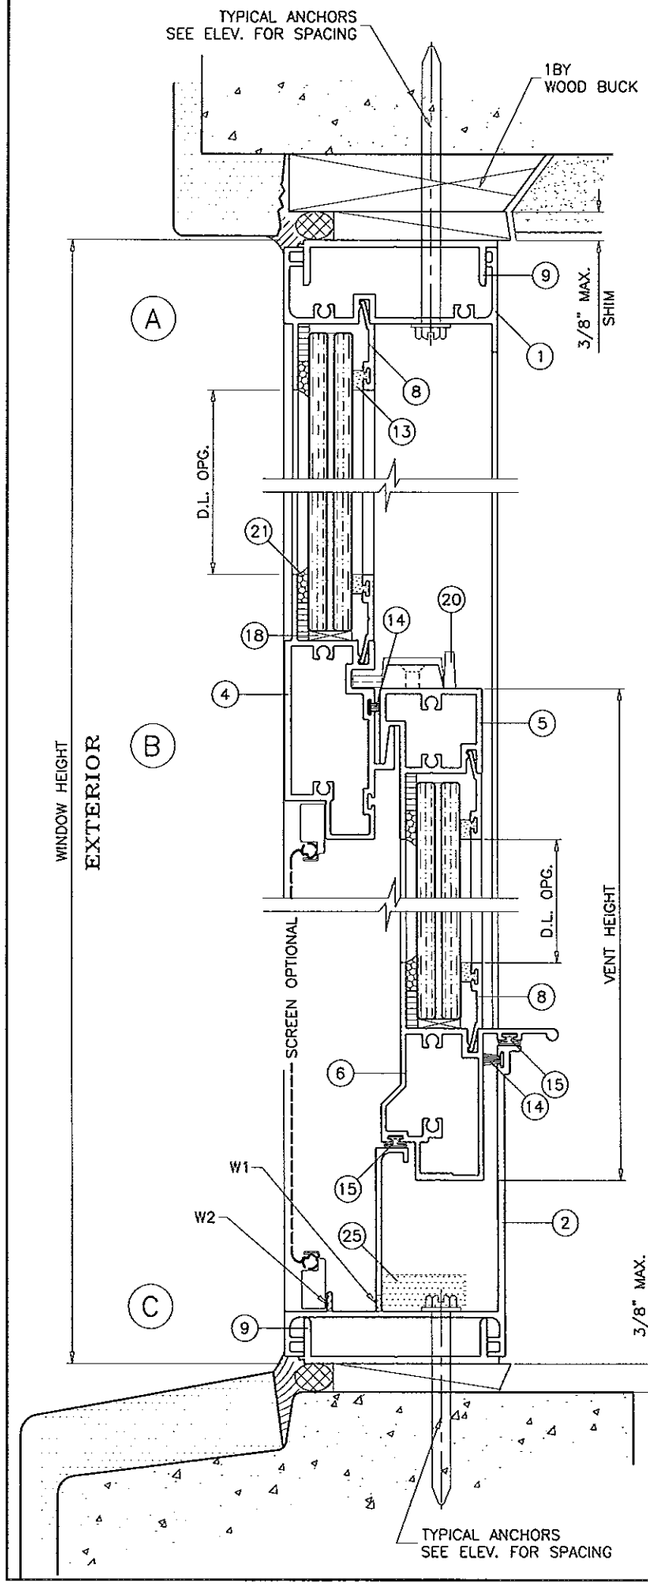

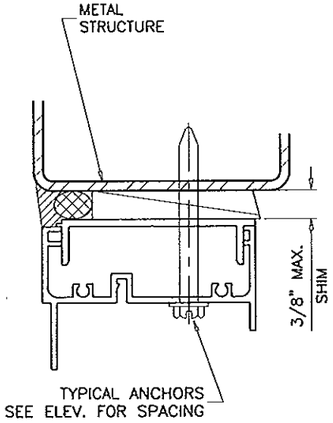

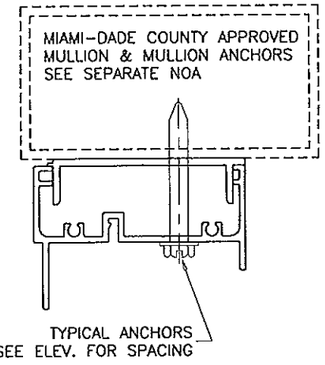

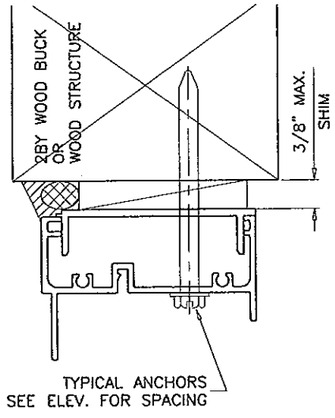

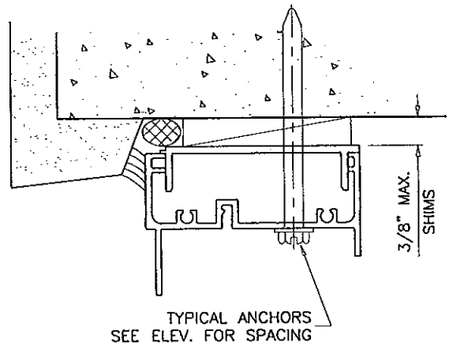

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 28, 2014
By Manuel Diaz
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-83GWL

SERIES-102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-83

sheet 5 of 9

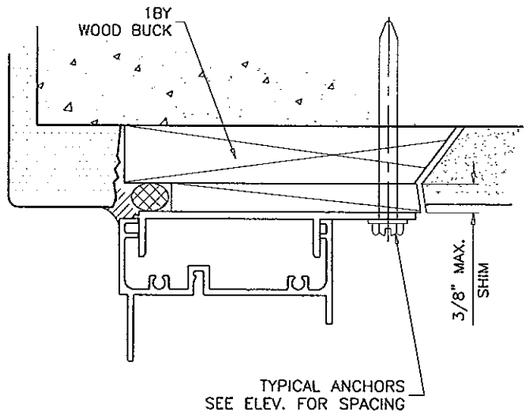

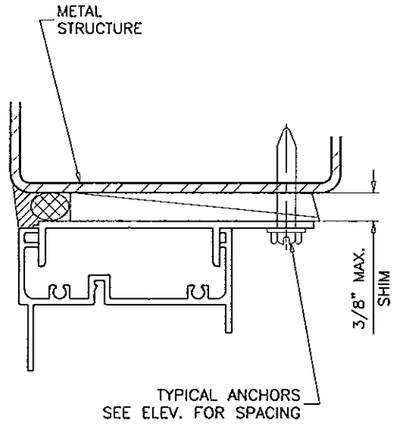

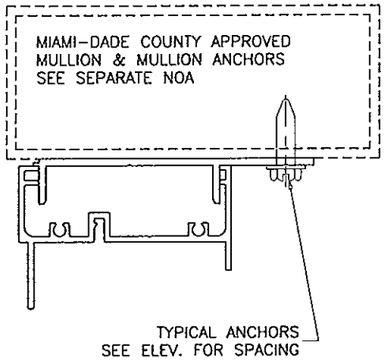

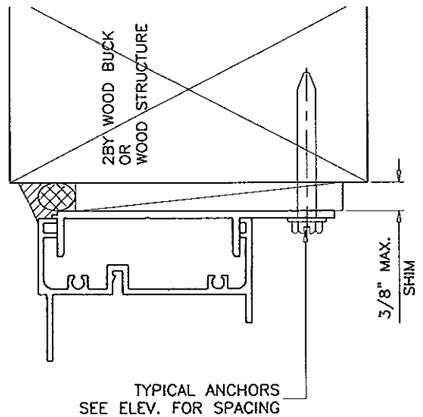

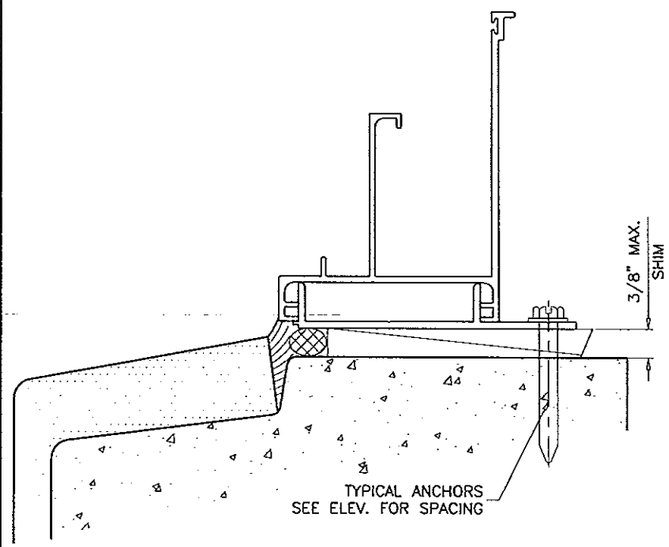

WOOD BUCKS AND METAL STRUCTURE NOT BY GLASSWALL MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" HILTI KWIK-CON II

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

1/4-20 KWIK-FLEX SELF DRILLING SCREWS

INTO METAL STRUCTURES

STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#14 SMS OR SELF DRILLING SCREWS

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
(NO SHIM SPACE)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2" OR 3" MIN. SEE CHARTS
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 1/2" MIN.

SEALANTS:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH BLACK/ALUMINUM COLORED SILICONE.

WEEPHOLES:

W1 = 1" X 1/4" WEEP SLOT AT 3" FROM EACH END
W2 = 1" LONG NOTCH AT EACH END

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3838

MAR 18 2013

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 22, 2014
By Manuel Perez
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-83GWL

SERIES-102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-83

F

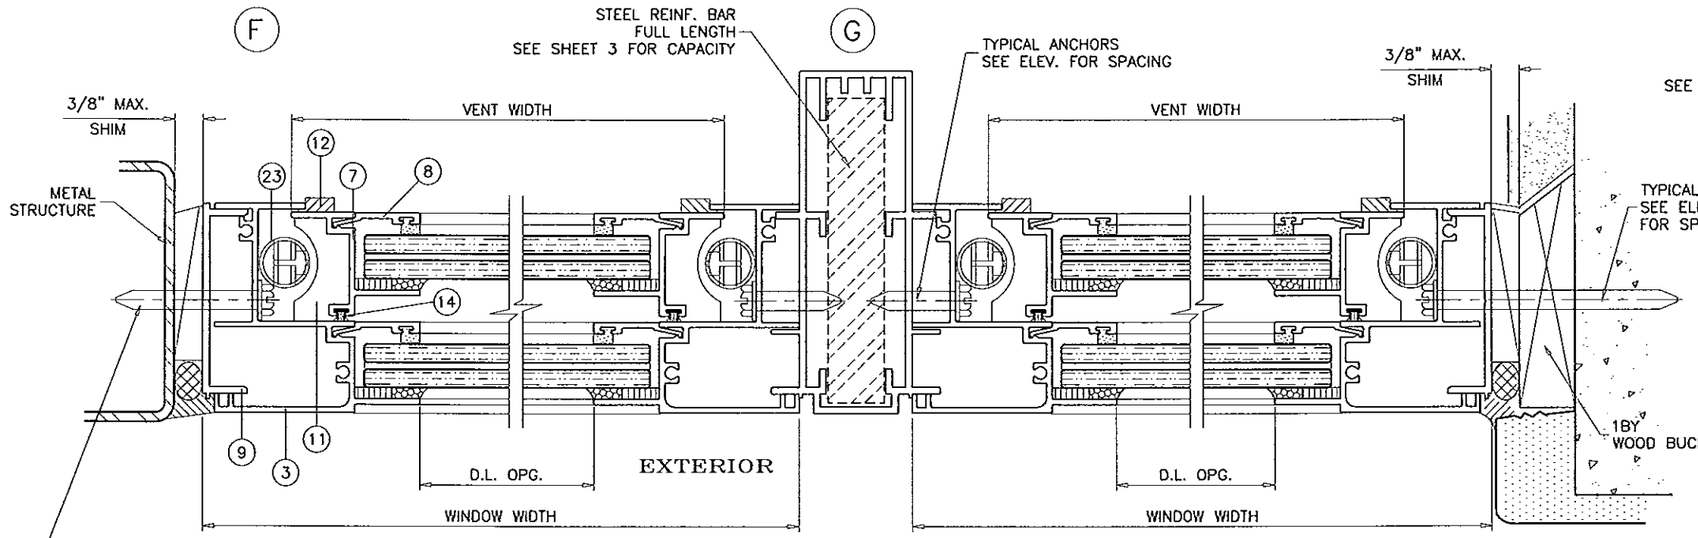

G

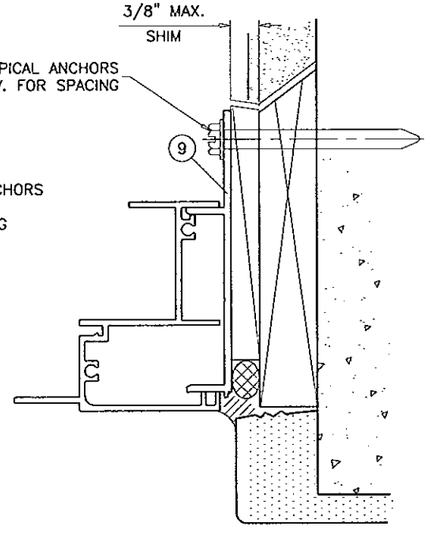

TYPICAL ANCHORS
SEE ELEV. FOR SPACING

H

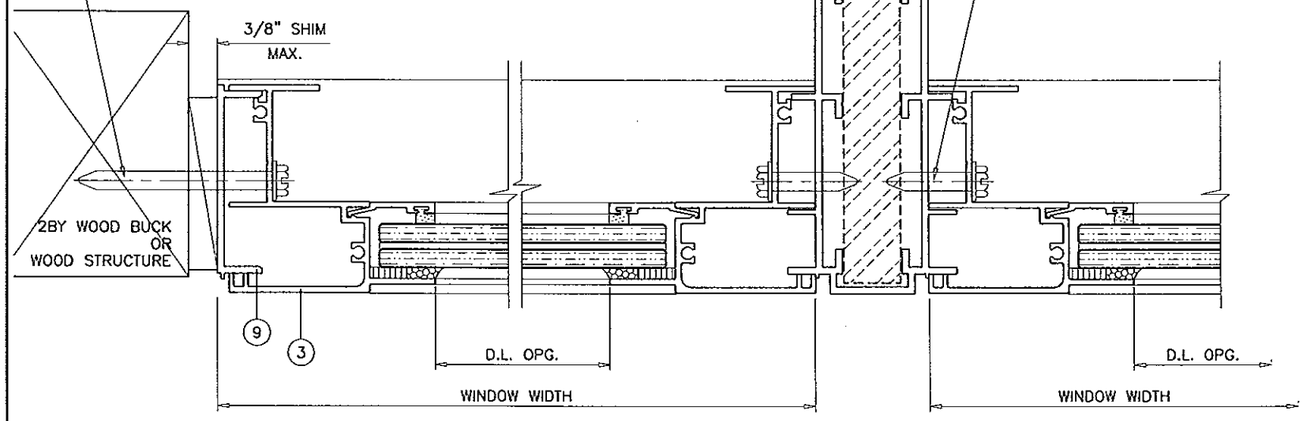

J

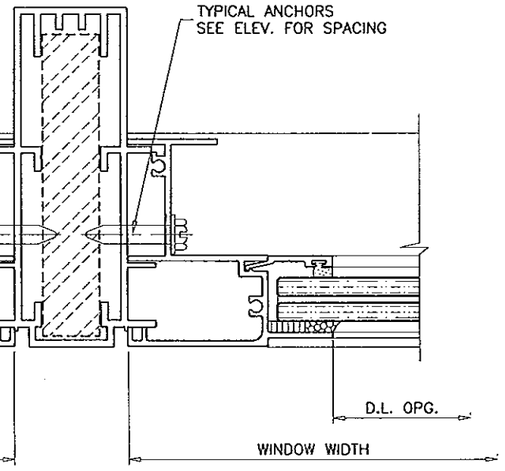

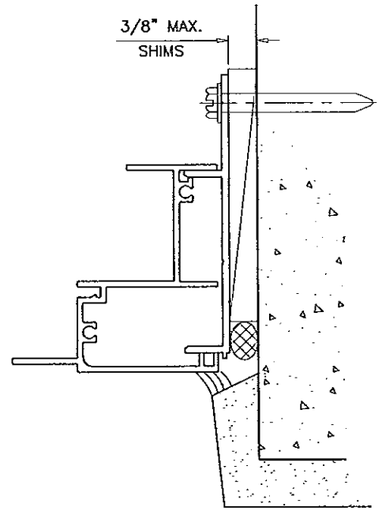

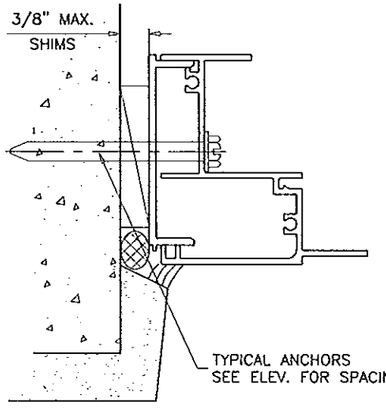

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 22, 2014
By Manuel Cruz
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-83GWL

SERIES-102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:

no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-83

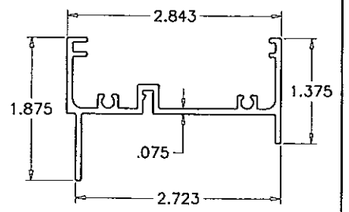

① FRAME HEAD

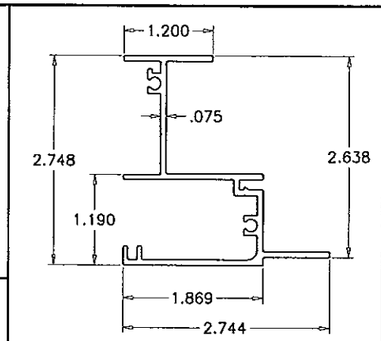

③ FRAME JAMB

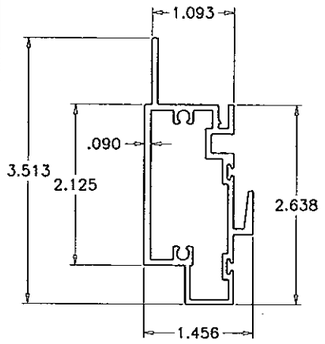

④ MEETING RAIL



⑦ VENT SIDE RAIL

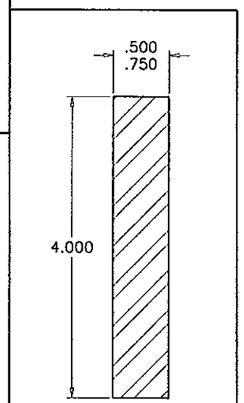

⑰ REINF. BAR



⑤ VENT TOP RAIL

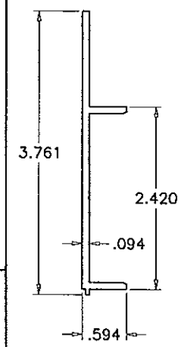

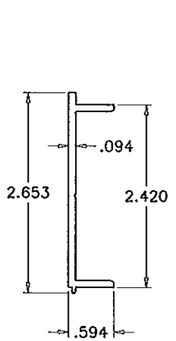

⑨ ANCHOR CLIP

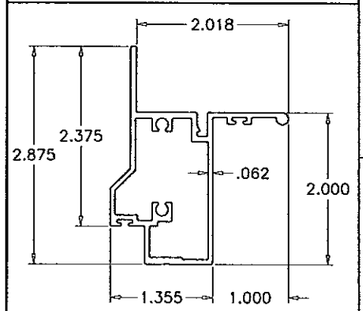

⑥ VENT BOTTOM RAIL

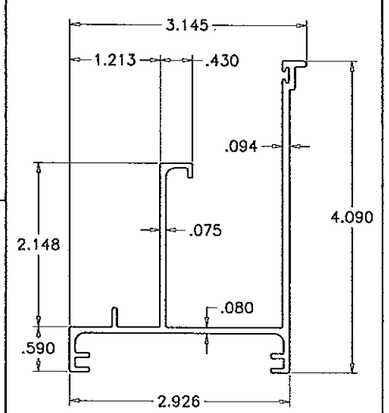

② FRAME SILL

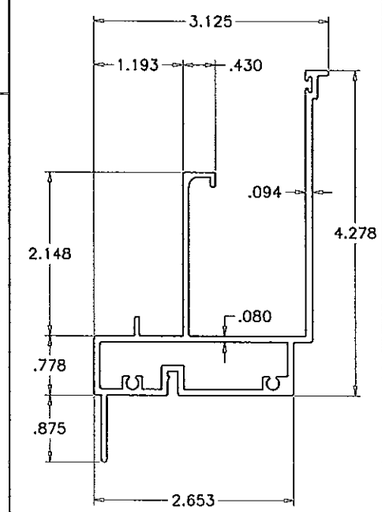

2A FRAME SILL (INTERMEDIATE)



⑧ GLAZING BEAD

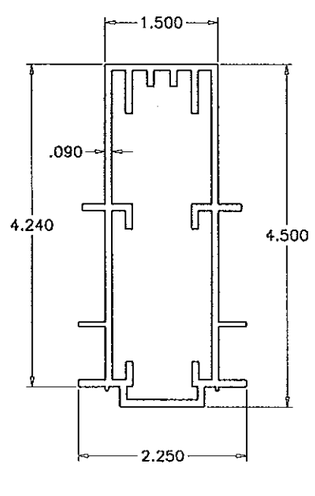

⑩ MULLION

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	102-001	1	FRAME HEAD	6005-T5	-
2	102-002	1	FRAME SILL	6005-T5	-
2A	102-012	1	FRAME SILL (INTERMEDIATE)	6005-T5	-
3	102-003	2	FRAME JAMB	6005-T5	-
4	102-004	1	FIXED MTG. RAIL	6063-T6	-
5	102-005	1	VENT TOP RAIL	6005-T5	-
6	102-006	1	VENT BOTTOM RAIL	6005-T5	-
7	102-007	2	VENT SIDE RAIL	6005-T5	-
8	102-008	AS REQD.	GLAZING BEAD	6005-T5	-
9	102-009	AS REQD.	ANCHOR CLIP	6005-T5	-
10	102-010	AS REQD.	MULLION	6005-T5	-
11	102-00A/B	2	TOP GUIDE	NYLON	M & M PLASTICS
12	102-000	4	PLASTIC GUIDE	NYLON	M & M PLASTICS
13	GW-100	AS REQD.	GLASS SPACER	VINYL	PROTOTYPE PLASTICS
14	568-61279	AS REQD.	FIN SEAL W'STRIPPING	-	PROTOTYPE PLASTICS
15	692-FP-448V-8	AS REQD.	BULB W'STRIPPING	VINYL	PROTOTYPE PLASTICS
16	-	-	-	-	-
17	-	AS REQD.	REINFORCING BAR	STEEL	-
18	-	2/ LITE	SETTING BLOCK (3/16 X 1/2 X 4" LONG)	EPDM	-
19	#10 X 1"	AS REQD.	FRAME & VENT ASSEMBLY FASTENERS	ST/ST	PH PH SMS
20	SL-106R-60	2	SURFACE MOUNT CAM LOCK @ 10" FROM ENDS	STEEL	DOOR & WINDOW HARDWARE
21	GE4000/DC795	AS REQD.	GLAZING COMPOUND	SILICONE	-
22	-	-	SPACER TAPE (3/16" X 1/2")	FOAM	CAPITAL TAPE CO.
23	-	2	ULTRA-LIFT BALANCE	-	CALDWELL
24	-	-	-	-	-
25	-	2	OPEN CELL FOAM PAD (1 X 1 X 2" LONG)	-	MERRY WEATHER

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 28, 2014
By Manuel Perez
Miami/Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-83GWL

SERIES-102S ALUM SINGLE HUNG WINDOW (S.H.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:			
no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-83

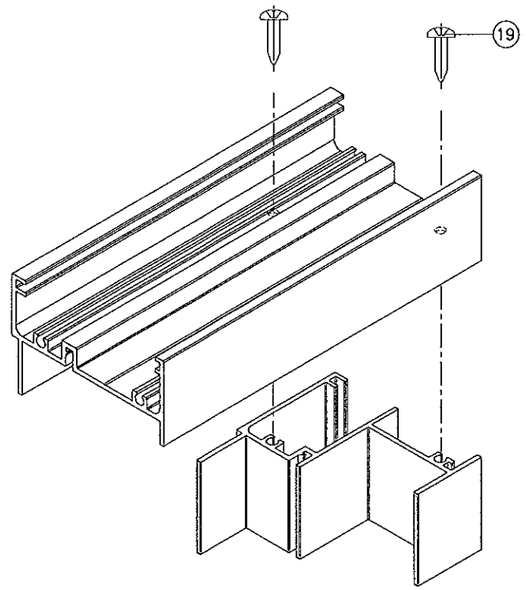

FRAME CORNERS DETAIL

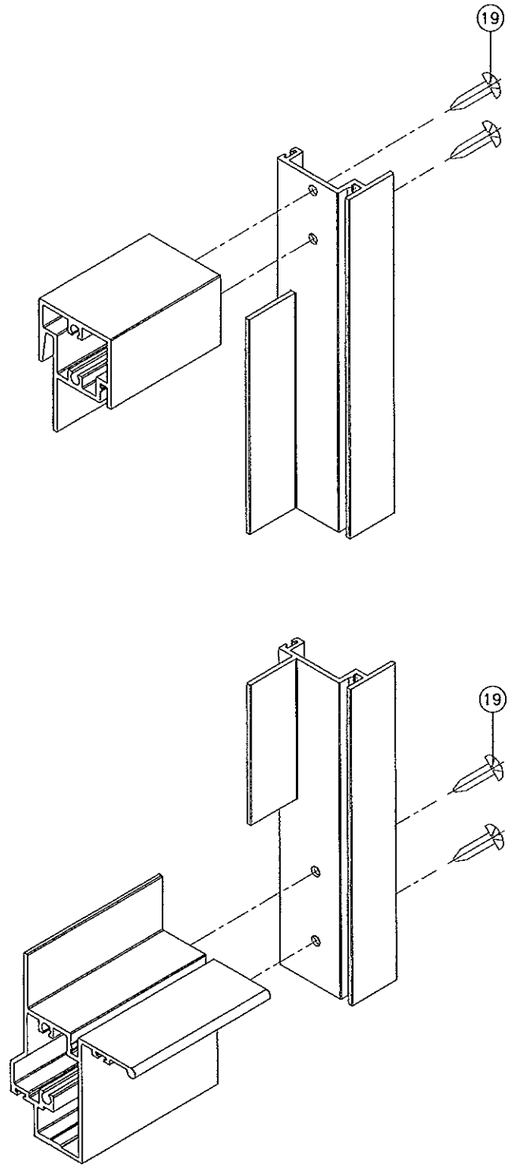

VENT CORNER DETAIL

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

MAR 18 2013

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 13-0321.13
Expiration Date Jan. 28, 2014
By Manuel Perez
Miami-Dade Product Control

SERIES-102S ALUM SINGLE HUNG WINDOW (S.M.I.)

GLASSWALL, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-83GWL

revisions:

no	date	by	description
A	03.18.13		NO CHANGE THIS SHEET

date: 09-26-08
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W08-83

sheet 9 of 9