



MIAMI-DADE COUNTY
 PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
www.miamidadecounty.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

Trulite Window & Door Solutions, LLC
 8130 NW 74th Avenue
 Medley, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1900" Aluminum Sliding Glass Door

APPROVAL DOCUMENT: Drawing No. W11-04 Rev B, titled "Series" 1900" Alum SLD. Glass Door (L.M.I.)", sheets 1 through 7 of 7, dated Jan 11, 2012, prepared by AL-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. Design Pressures for OXO and OXXO configurations are limited to +/- 80 PSF (3-1/2" sill riser is required for positive design pressure water rating).
2. Design Pressure rating for down sizes OX or XO w/ 48" Wide X 96" High or smaller (up to code limits) DP = +80/-120 PSF.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 12-0118.29 and consists of this page 1 and evidence pages E-1 & E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Ishaq I. Chanda, P.E.



NOA No. 13-0326.10
 Expiration Date: September 18, 2018
 Approval Date: June 20, 2013
 Page 1

Handwritten initials and date: 6/10/13

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS (Submitted under file # # 12-0118.29)

1. Manufacturer's die drawings and sections.
2. Drawing No. **W11-04 Rev B**, titled "Series" 1900" Alum SLD. Glass Door (L.M.I.)", sheets 1 thru 7 of 7, dated Jan 11, 2012, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
Note: This revision consists of renewal with no change from previous approval.

B. TESTS (transferred from file # 12-0118.29/#11-0325.01)

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Force Entry Resistant per FBC, TAS 202-94

Along with marked-up drawings and installation diagram of OXXO Alum Sliding Glass Doors, prepared by Fenestration Testing Laboratory Inc, Test Report No. **FTL-5508 (FTL-08009)**, dated 03/19/08, signed & sealed by Carlos S. Rionda, P. E.

2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of OX Alum Sliding Glass Doors, prepared by Fenestration Testing Laboratory Inc, Test Report No. **FTL-5727 (FTL-08138)**, dated 10/08/08, signed & sealed by Carlos S. Rionda, P. E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2007, prepared by Al-Farooq Corporation, dated 03/11/11, signed and sealed by Javad Ahmad, P.E. (transferred from file # # 11-0325.01)
2. Glazing complies w/ ASTM E-1300-02 & -04.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **12-1231.08 (#11-1102.09/ #08-0514.08)** issued to Eastman Chemical Company for "Saflex CP-saflex and Saflex HP Composite interlayer w/ PET core", expiring on 12/11/2018.


Ishaq I. Chanda, P.E.

Product Control Examiner
NOA No 13-0326.10

Expiration Date: September 18, 2018
Approval Date: June 20, 2013

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of conformance to FBC 2010 and request for renewal with no change, prepared by Al-Farooq Corporation, dated 03/09/13, signed and sealed by Javad Ahmad, P.E.
2. Statement letter of conformance to FBC 2010 and "No change except code revision notes & Company name change", prepared by Al-Farooq Corporation, dated 01/04/12, signed and sealed by Javad Ahmad, P.E. (Submitted under file # 12-0118.29)
3. Statement letter of conformance FBC 2007 and letter of no financial interest, prepared by Al-Farooq Corporation, dated 02/24/11, signed and sealed by Javad Ahmad, P.E. (Submitted under file # 11-0325.01)
4. Statement letter of compliance, part of the above referenced test reports.
5. Sales agreement between AWP, LLC (seller) and Arch Aluminum & Glass Enterprise, a Delaware Corp (purchaser) dated Jan 14, 2010, signed by Leon J. Silverstein and Wm, Robert Wright, respectively. (Submitted under file # 12-0118.29)
6. Certificate of registration of Arch Windows, LLC in State of Delaware, dated 02-03-10.
7. Certificate of registration of Arch Windows, LLC (Delaware) in State of Florida dated 02-04, 2010, managed by Arch Intermediate Holding, LLC. (Submitted under file # 12-0118.29)
8. Florida Dept of State, listing of Arch Window, LLC (Foreign Limited Liability Co.), managed by Arch Intermediate Holding, LLC, Tamarac, Fl. (Submitted under file # 12-0118.29)
9. Asset purchase agreement dated 11/01/06 among AWP, LLC (Buyer) and Yale Ogron Windows & Door Inc. (seller), signed by Leon J. Silverstein and Manny Valladares, respectively. (Submitted under file # 12-0118.29).
10. Statement letter dated March 25, 2010, issued by Arch Windows, LLC that it has purchased all assets of AWP, LLC effectively Jan 29, 2010, signed by Leon Silverstein, President/CEO (Arch Windows, LLC) (Submitted under file # 12-0118.29)

G. OTHER

1. This NOA **renews** NOA # 12-0118.29, expiring on September 18, 2018.
2. Previous NOA(s) associated with the file are NOA # 11-0325.01, 08-1028.02 & 08-0722.05
3. Test proposal dated 08/04/08 approved by BCCO.



Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No 13-0326.10
Expiration Date: September 18, 2018
Approval Date: June 20, 2013

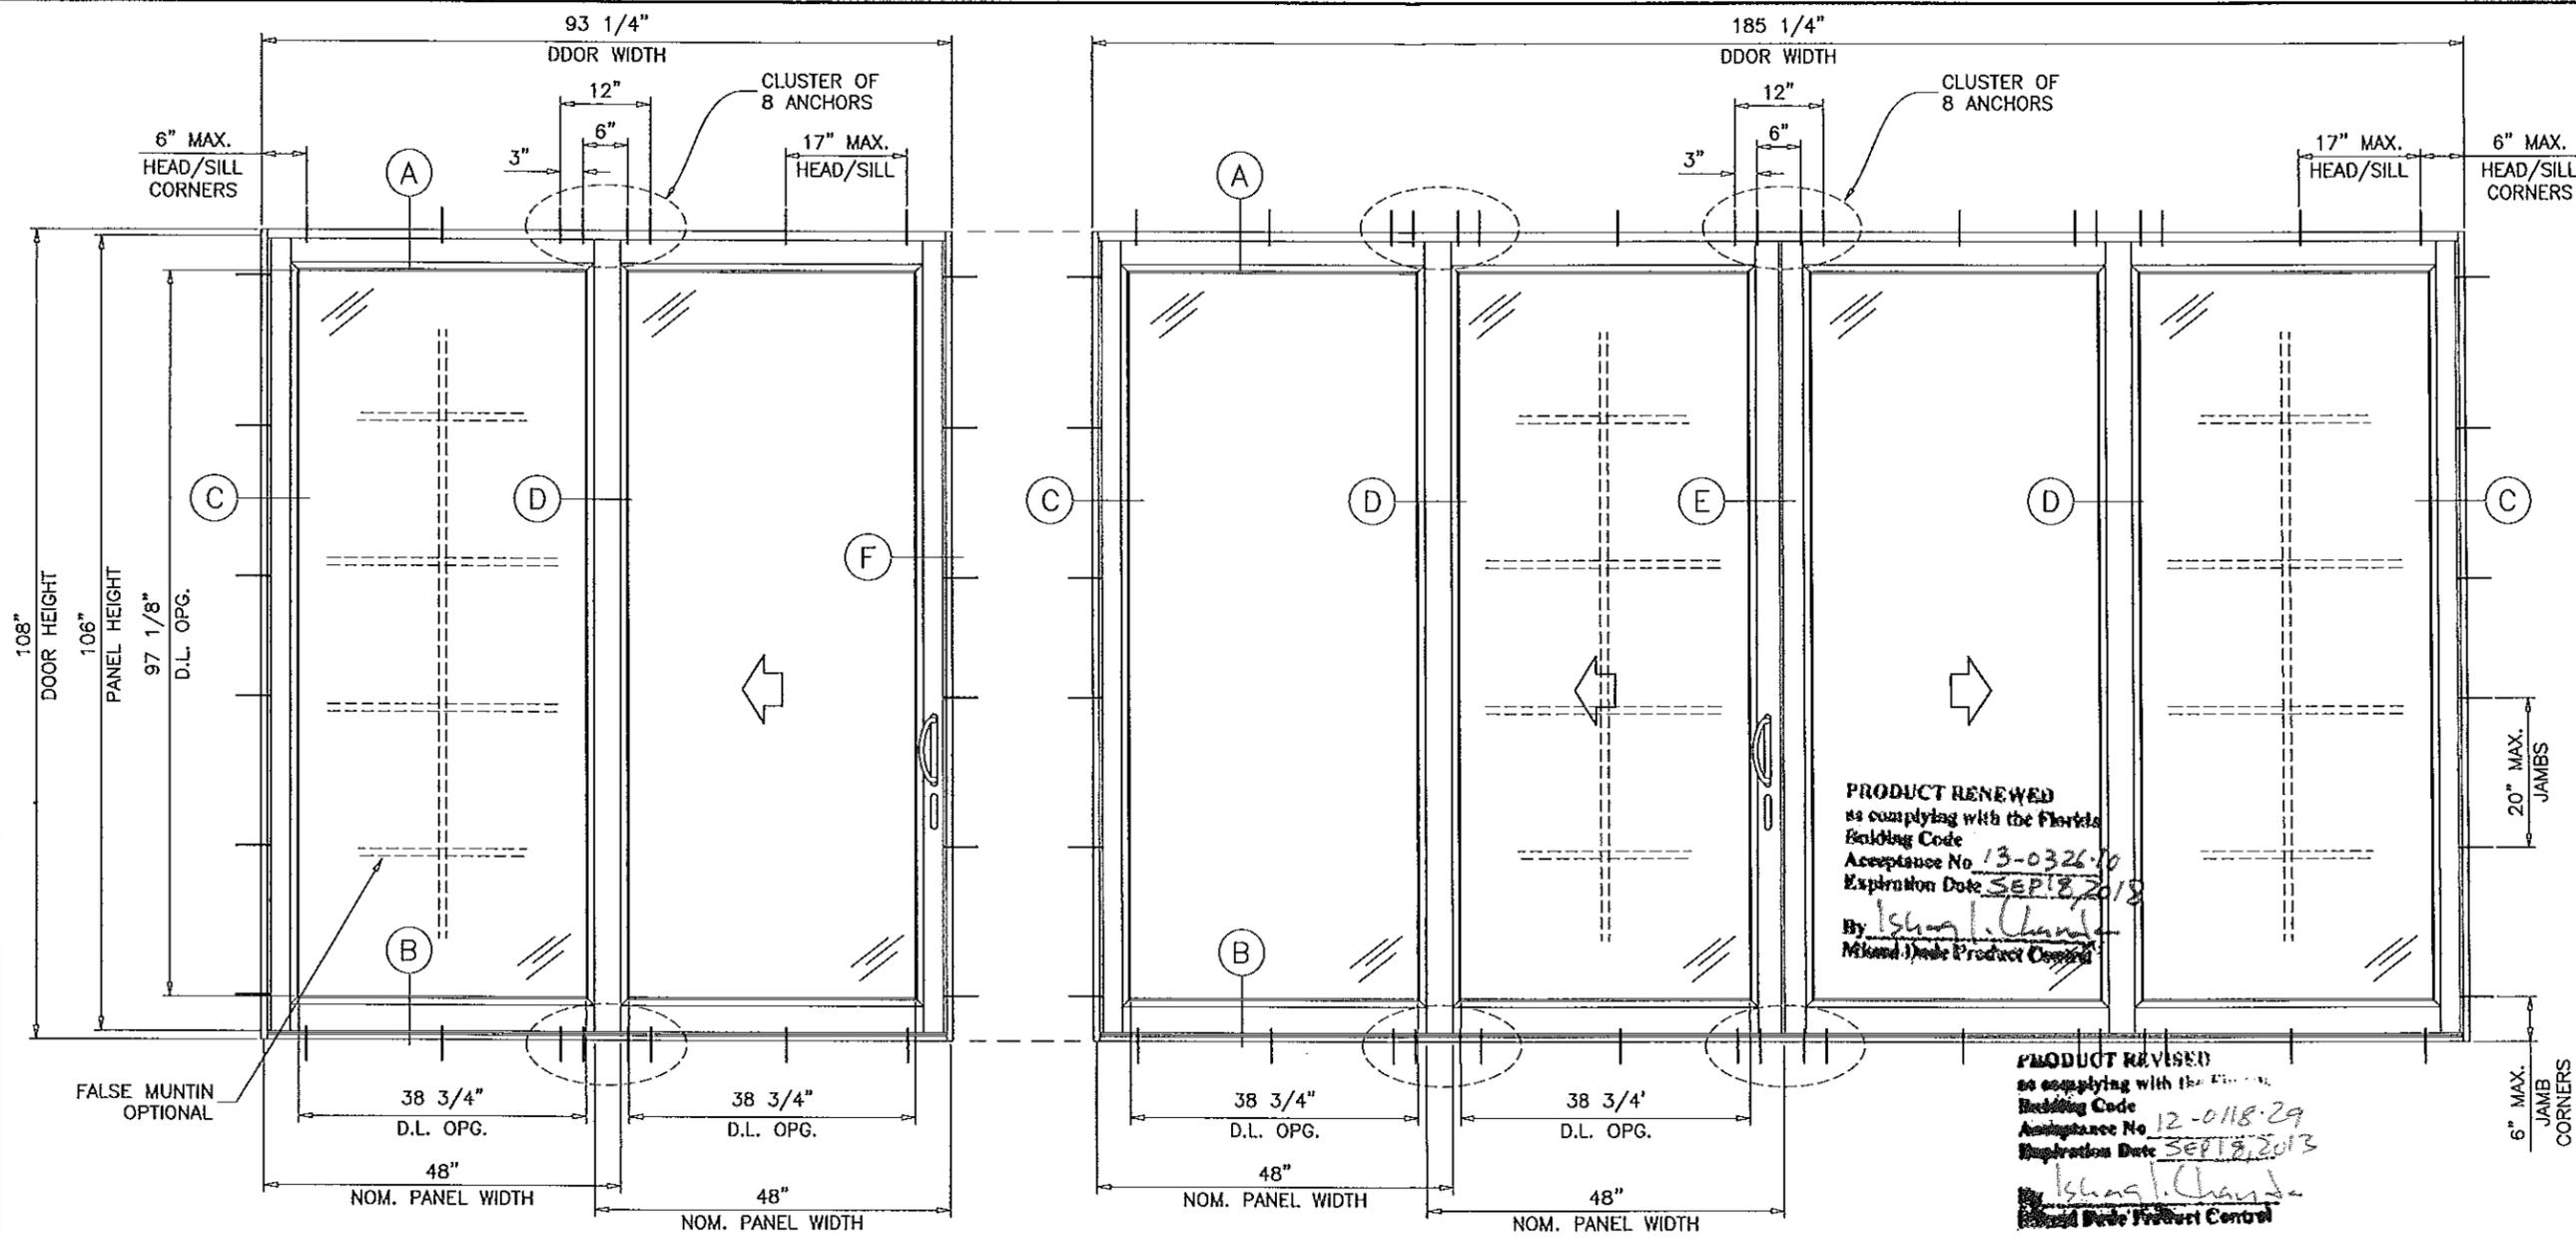

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0326-10
 Expiration Date SEP 18, 2013
 By: *Isham I. Chanda*
 Miami Dade Product Control

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0118-29
 Expiration Date SEP 18, 2013
 By: *Isham I. Chanda*
 Miami Dade Product Control

TYPICAL ELEVATIONS

DESIGN LOAD CAPACITY - PSF			
MAX. PANEL WIDTH NOMINAL INCHES	MAX. DOOR HEIGHT INCHES	XO OR OX DOORS	
		EXT. (+)	INT. (-)
49-11/16	96	80.0	120.0
48	108	80.0	80.0

DESIGN LOAD CAPACITY - PSF			
MAX. PANEL WIDTH NOMINAL INCHES	MAX. DOOR HEIGHT INCHES	OXO OR OXXO DOORS	
		EXT. (+)	INT. (-)
48	108	80.0	80.0

DAYLITE OPENINGS:
 D.L.O. HEIGHT = PANEL HEIGHT - 8.875"
 D.L.O. WIDTH = PANEL WIDTH - 9.250"

NOTE:
 GLASS CAPACITIES ON THIS SHEET ARE
 BASED ON ASTM E1300-04 (3 SEC. GUSTS)
 AND FLORIDA BUILDING COMMISSION
 DECLARATORY STATEMENT DCA05-DEC-219

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT
 AND REQUIRE NO SHUTTERS.

SERIES 1900 ALUMINUM SLIDING GLASS DOOR

DESIGN LOAD CAPACITY FOR DOORS TO BE AS PER CHARTS SHOWN.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE
 REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY
 HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO
 TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS
 EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE
 NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME
 INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE
 REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

LAMINATED GLASS
 LARGE MISSILE IMPACT

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JAN 11 2012

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W11-04AWP


SERIES 1900 ALUM. SLID. GLASS DOOR (L.M.I.)
TRULITE WINDOW & DOOR SOLUTIONS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	description
	A	05.04.11	REV. PER BNC COMMENTS
	B	12.23.11	UPDATED TO 2010 FBC, NAME REV


date: 02-17-11
 scale: 3/8"=1'-0"
 dr. by: HAMID
 chk. by:

drawing no.
W11-04


sheet 1 of 7

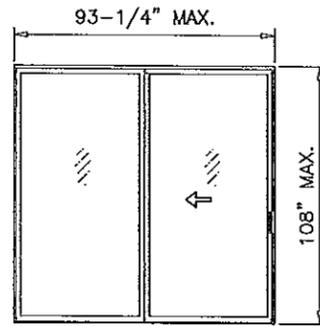

OX (SHOWN)
XO

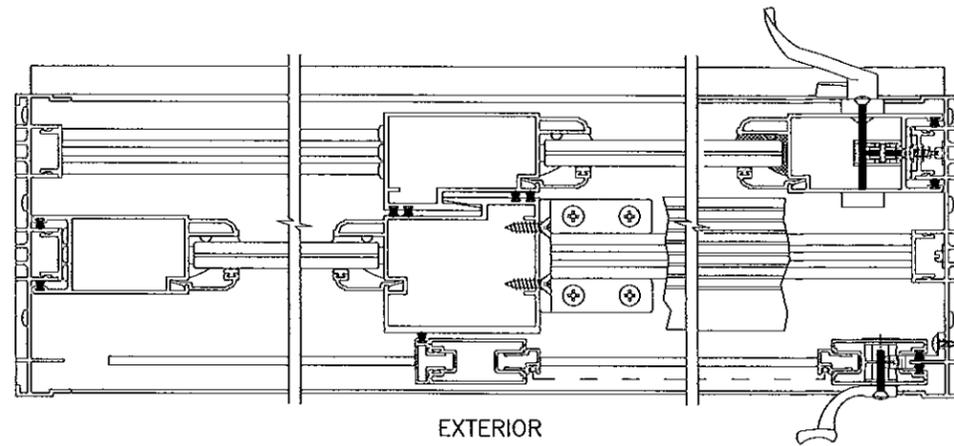

EXTERIOR

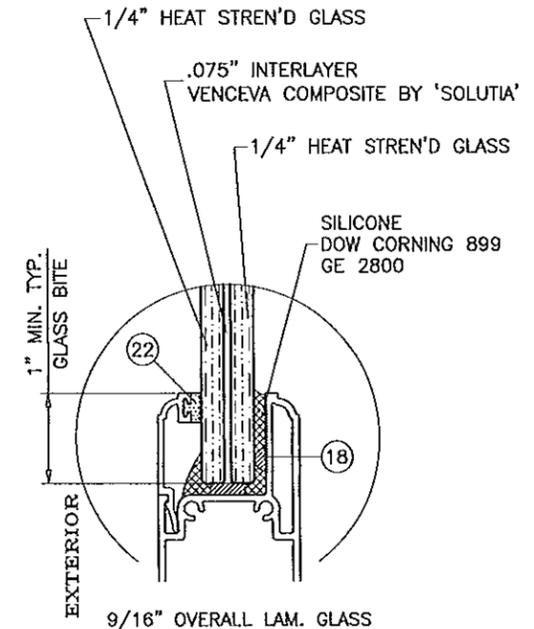


9/16" OVERALL LAM. GLASS


GLAZING DETAIL

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 13-0326-10
 Expiration Date 9/18/18
 by Shahid Chaudhry
 Licensed Design Professional


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0118-29
 Expiration Date 09/18/13
 by Shahid Chaudhry
 Licensed Design Professional

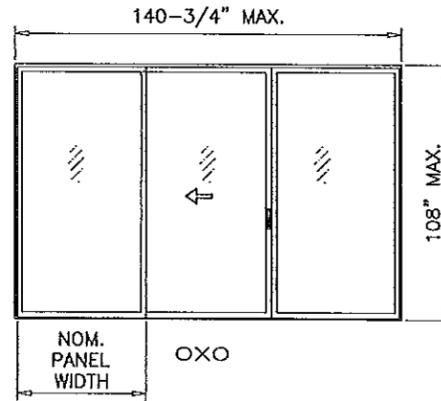


NOM. PANEL WIDTH
OXO

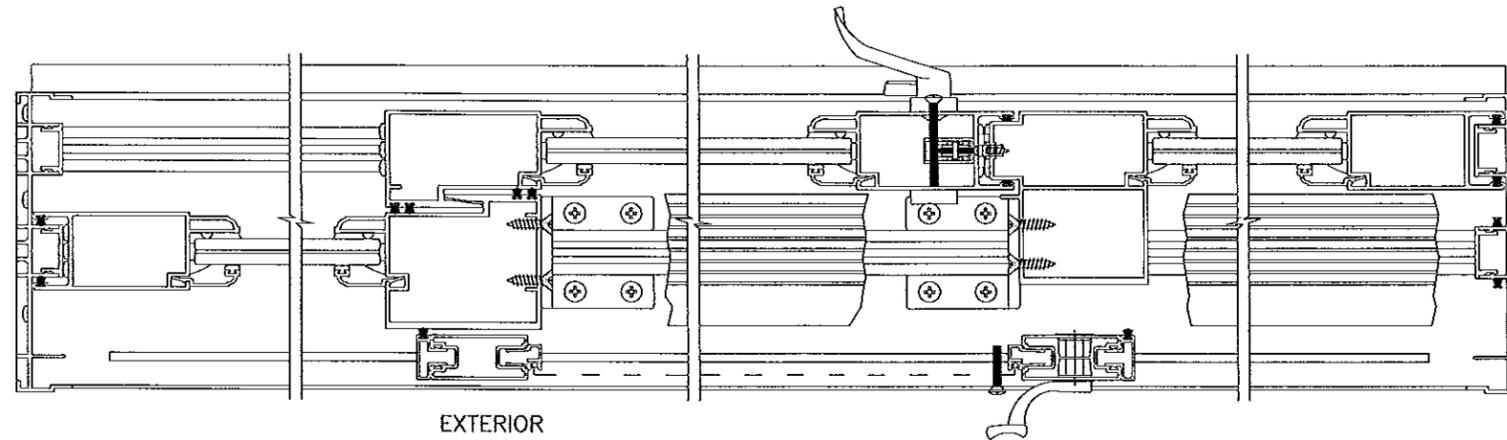

EXTERIOR

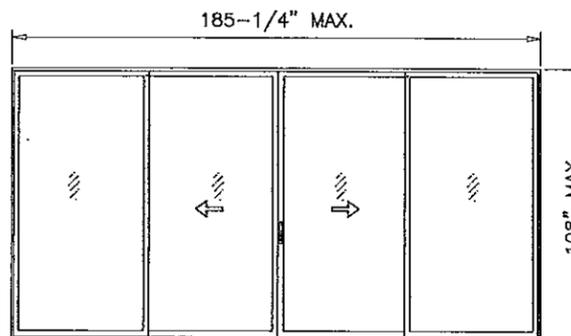

OXXO

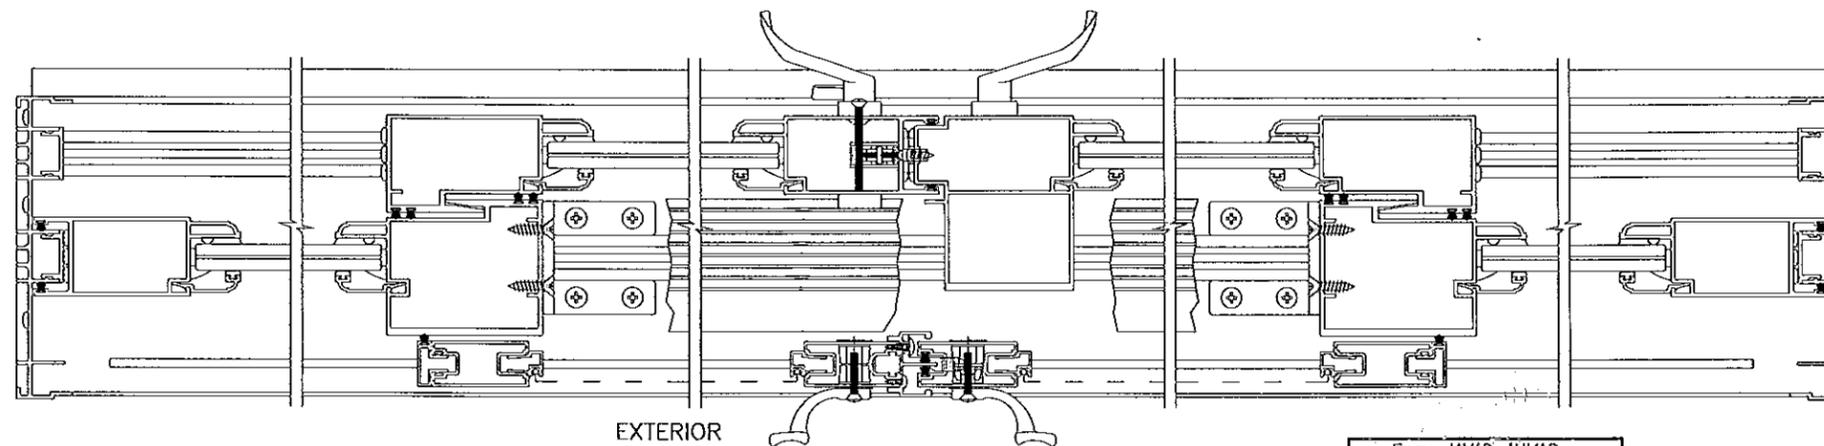

EXTERIOR

APPROVED CONFIGURATIONS

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JAN 11 2012

CONFIGURATIONS SHOWN FOR ILLUSTRATION PURPOSE
 SEE SHEETS 3 THRU 5 FOR ANCHORS AND SUBSTRATE.



af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
TRULITE WINDOW & DOOR SOLUTIONS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL (305) 887-2646 FAX (305) 883-1309


Revisions:	
no	date by description
A	05.04.11 REV. PER BNC COMMENTS
B	12.23.11 MANUF. NAME REVISED

date:	02-17-11
scale:	-
dr. by:	HAMID
chk. by:	


drawing no.	W11-04
sheet	2 of 7

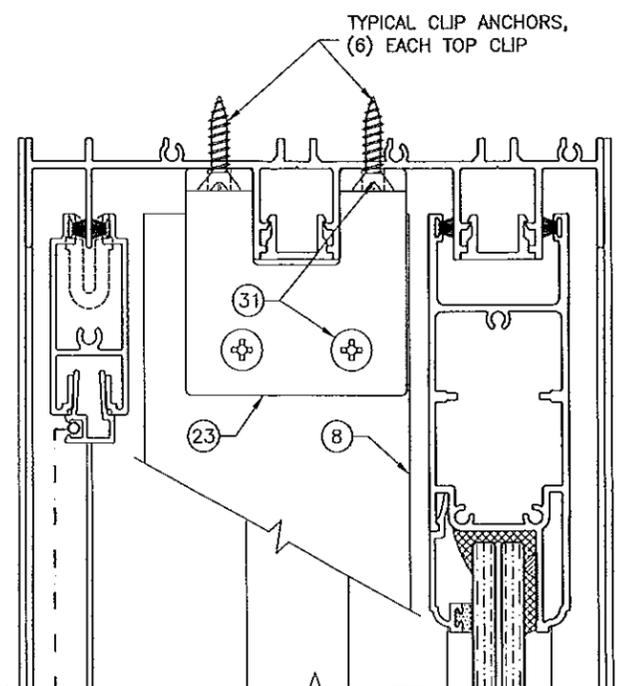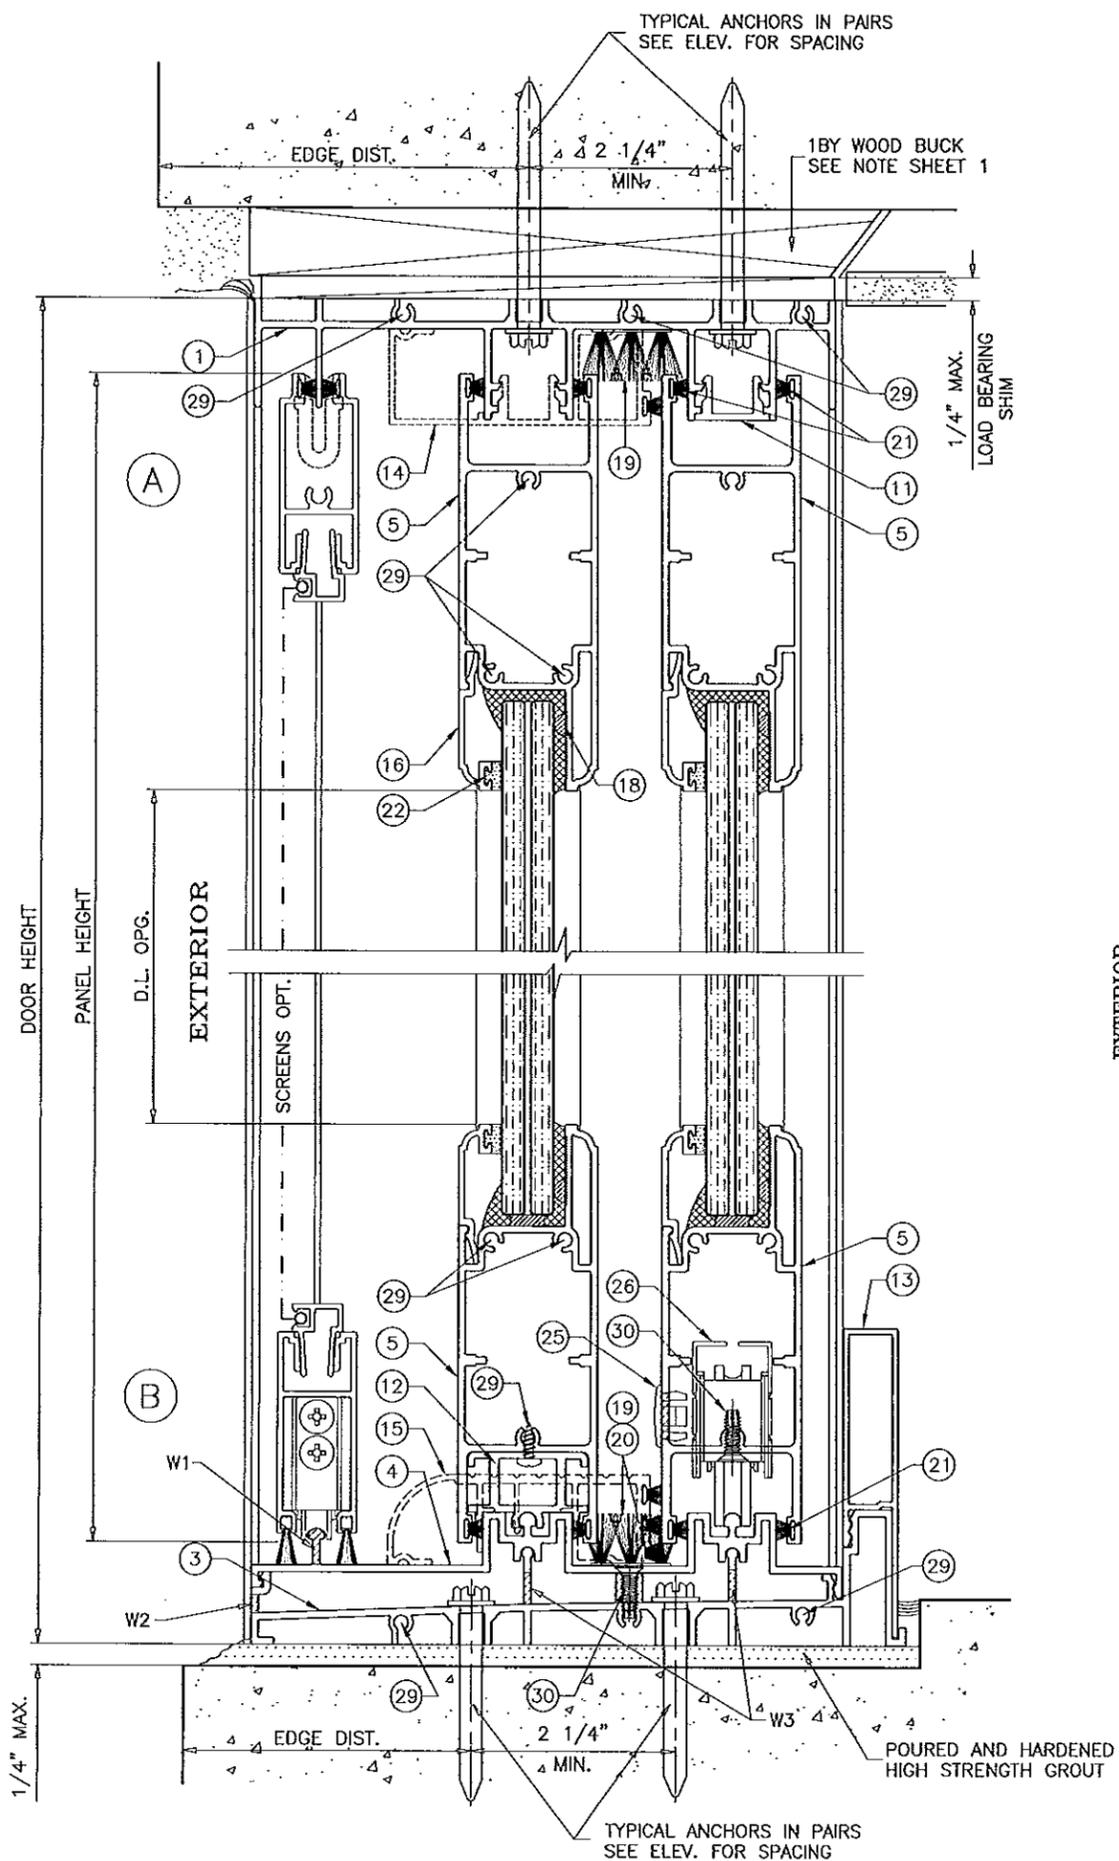


HEAD COVER REMOVED TO SHOW CLIP

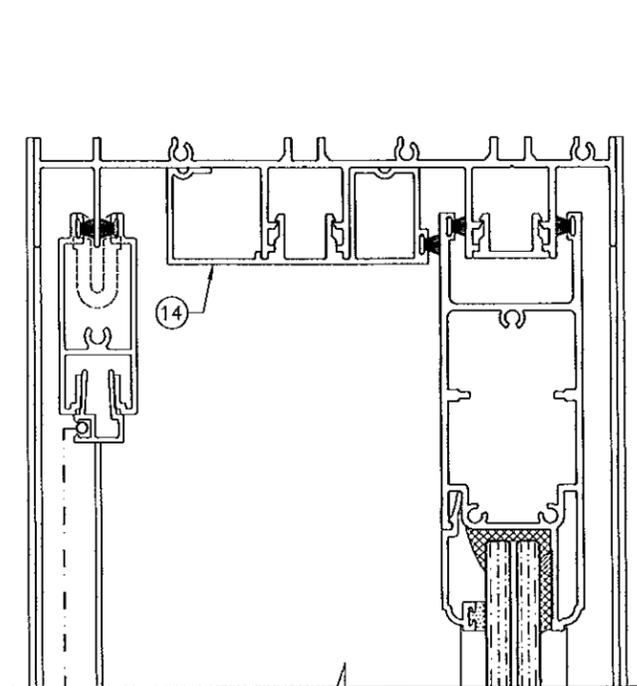

HEAD COVER BETWEEN FIX. PANELS

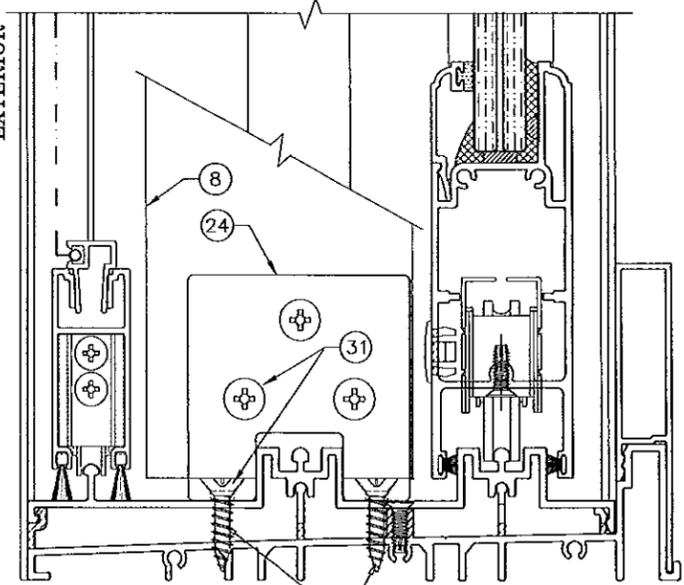

SILL COVER REMOVED TO SHOW CLIP

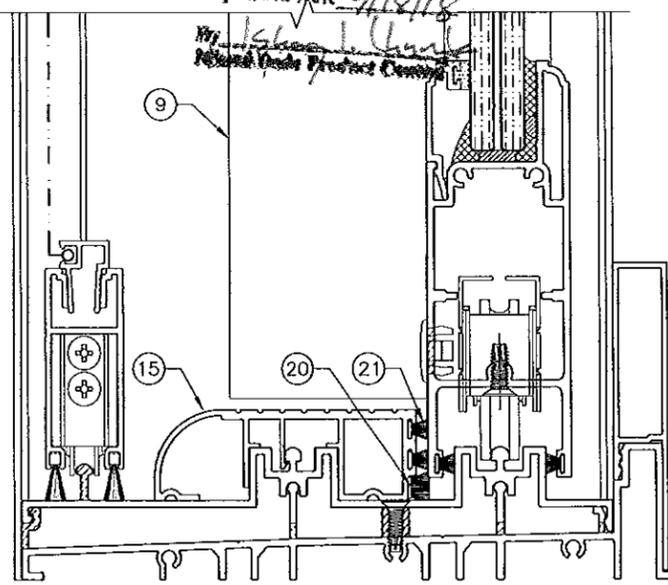

SILL COVER BETWEEN FIX. PANELS

WEEPHOLES:

- W1 = 7/8" WEEP NOTCH AT EACH END OF SCREEN TRACK
- W2 = 7/8" WEEP SLOT AT EACH END OF SILL
- W3 = 1/2" WEEP NOTCH AT SILL FLANGES AT 6" FROM PANEL ENDS AND AT MIDSPAN

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0118-29
 Expiration Date 9/18/13
 By *Shas Khan*
 Miami Dade Product Control

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0326-10
 Expiration Date 9/18/18
 By *Shas Khan*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JAN 11 2012


afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
TRULITE WINDOW & DOOR SOLUTIONS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309


NO.	DATE	BY	DESCRIPTION
A	05.04.11		REV. PER BNC COMMENTS
B	12.23.11		MANUF. NAME REVISED

date: 02-17-11
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W11-04
 sheet 3 of 7

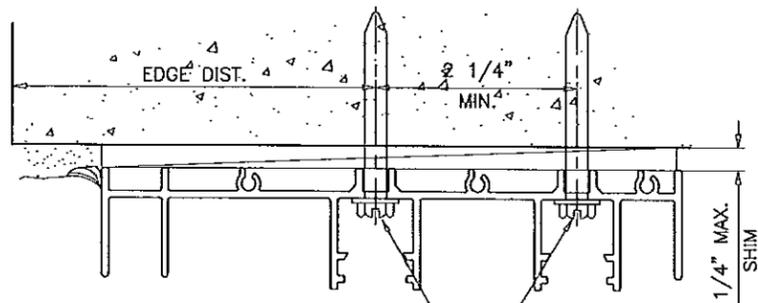


TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

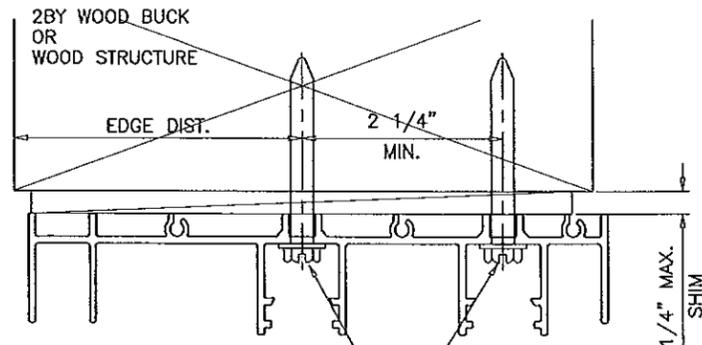

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

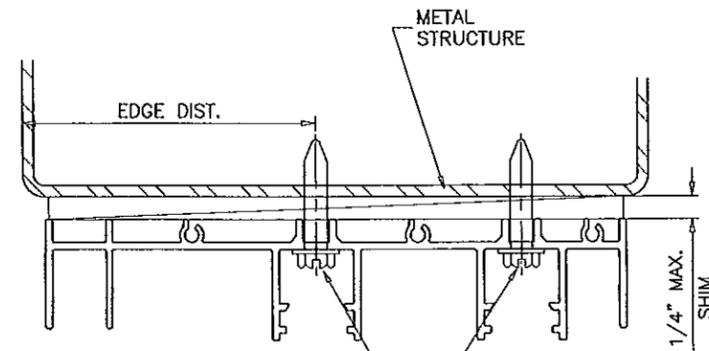

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

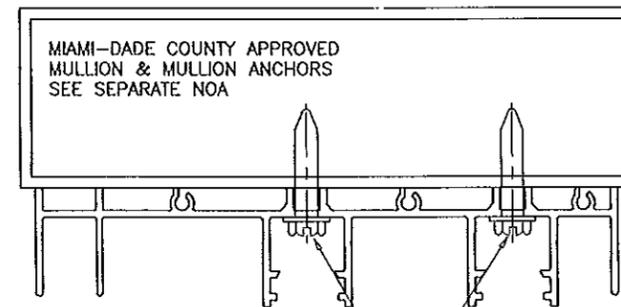

TYPICAL ANCHORS IN PAIRS
SEE ELEV. FOR SPACING

WOOD BUCKS AND METAL STRUCTURE NOT BY TRULITE
MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES

1-3/8" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY

1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY

1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")

INTO METAL STRUCTURES

STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)

ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.

INTO WOOD STRUCTURE = 1" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.

C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

MIAMI-DADE COUNTY APPROVED
MULLION & MULLION ANCHORS
SEE SEPARATE NOA

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 13-0326-10
Expiration Date 9/18/18
By *[Signature]*
Miami Dade Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0118-29
Expiration Date 9/18/13
By *[Signature]*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
JAN 11 2012




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
TRULITE WINDOW & DOOR SOLUTIONS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2846 FAX (305) 883-1309

revisions:	no	date	by	description
	A	05.04.11		NO CHANGE THIS SHEET
	B	12.23.11		MANUF. NAME REVISED

date: 02-17-11
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W11-04
sheet 4 of 7

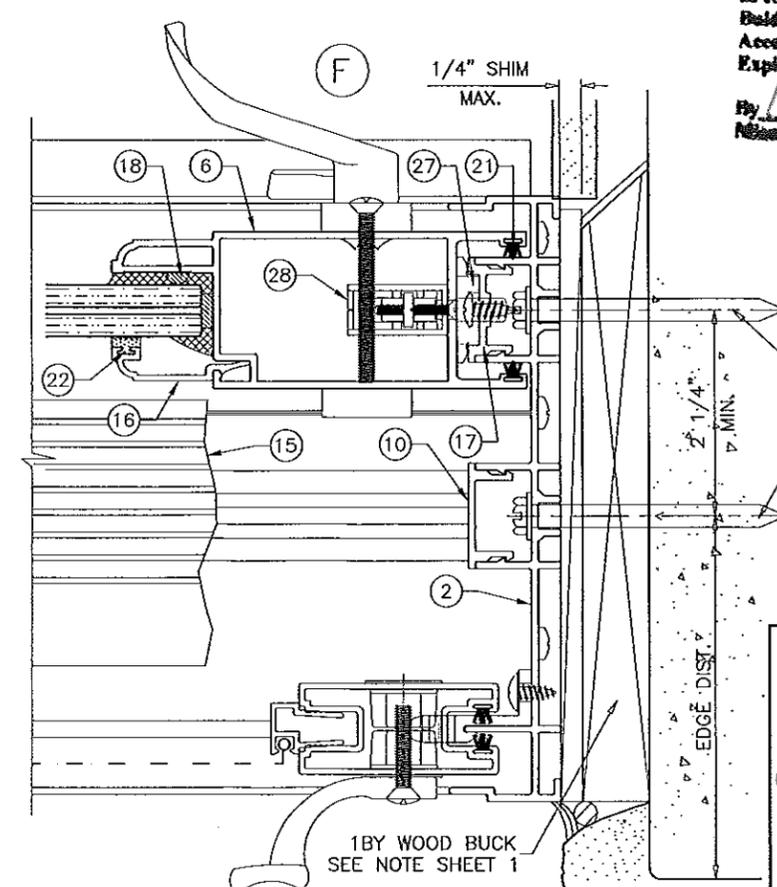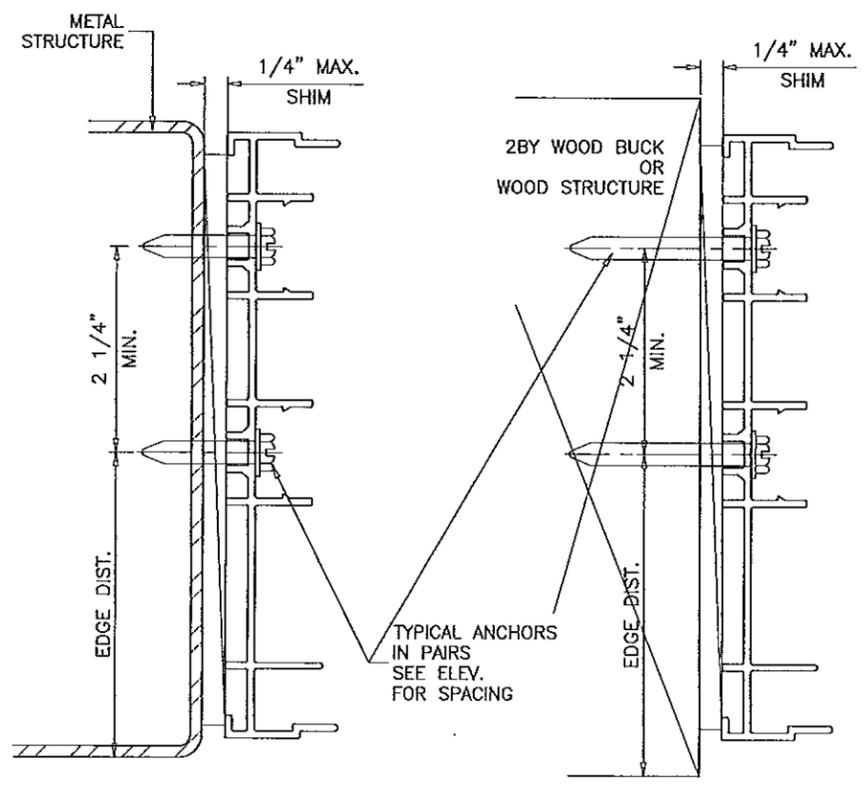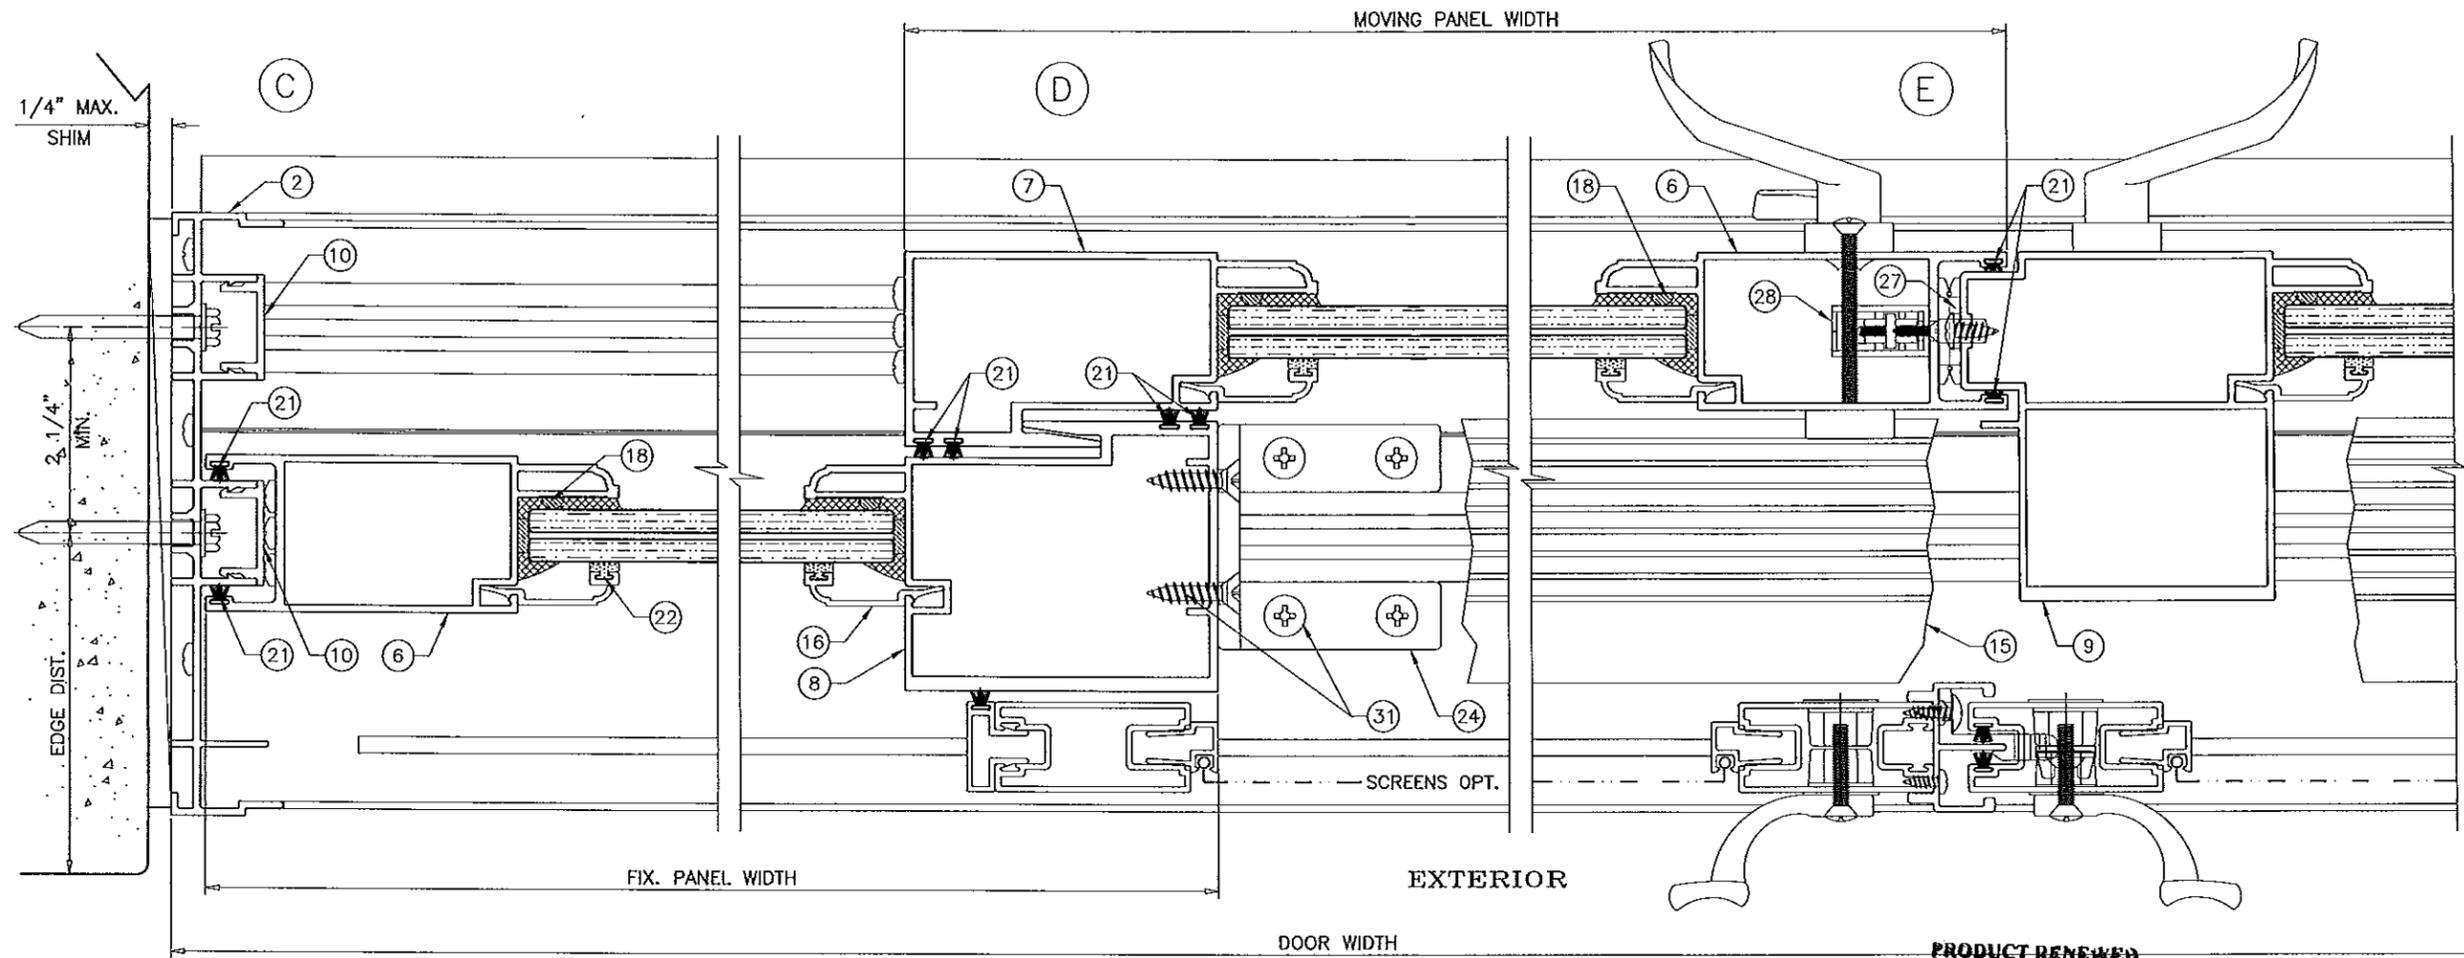

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0326-10
 Expiration Date 9/18/18
 By: *[Signature]*
 Medial Daily Product Control

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0418-29
 Expiration Date 9/18/18
 By: *[Signature]*
 Medial Daily Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JAN 11 2012

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)


TRULITE WINDOW & DOOR SOLUTIONS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:	no	date	by	description
A	05.04.11			REV. PER BNC COMMENTS
B	12.23.11			MANUF. NAME REVISED


date: 02-17-11
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W11-04


sheet 5 of 7

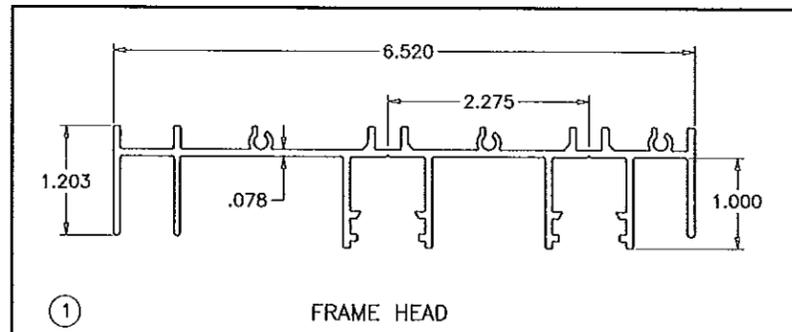


① FRAME HEAD

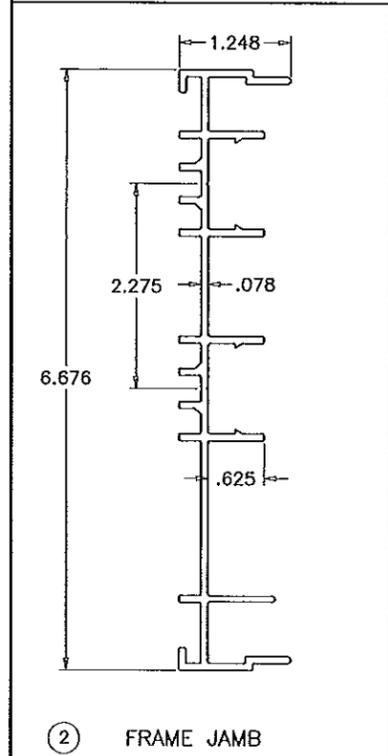


② FRAME JAMB

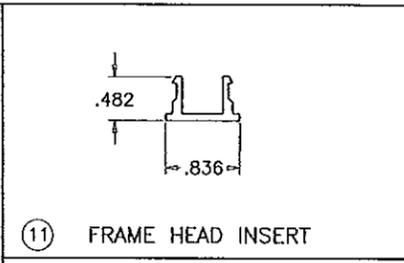


⑪ FRAME HEAD INSERT

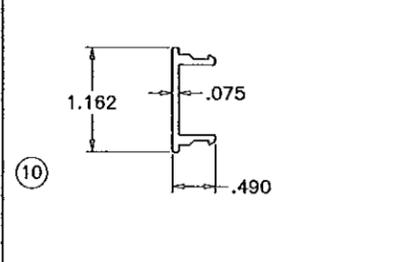


⑩ FRAME JAMB INSERT

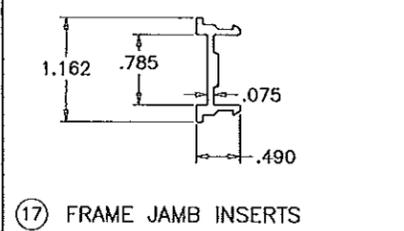


⑰ FRAME JAMB INSERTS

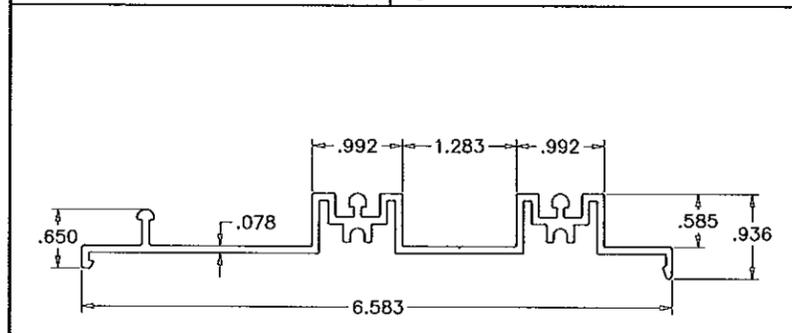


④ FRAME SUB-SILL

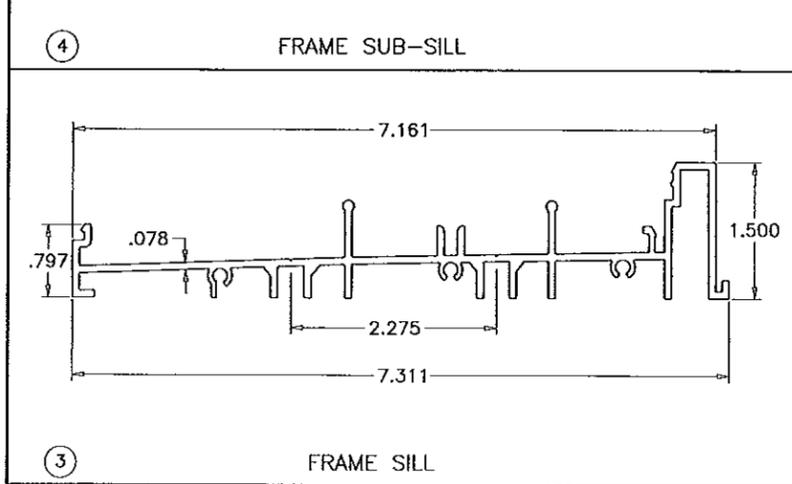


③ FRAME SILL

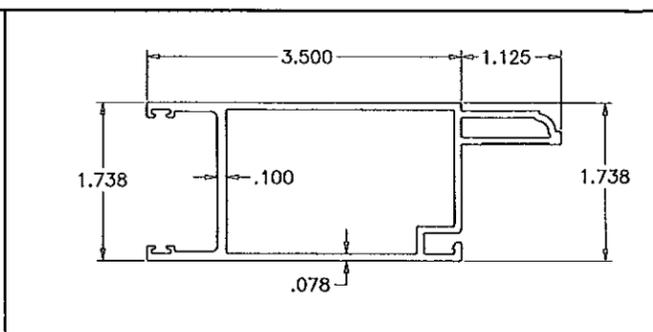


⑥ LOCK STILE

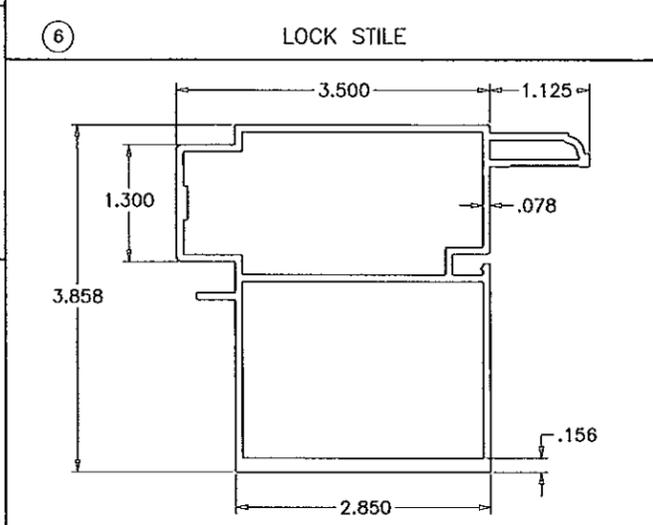


⑨ ASTRAGAL

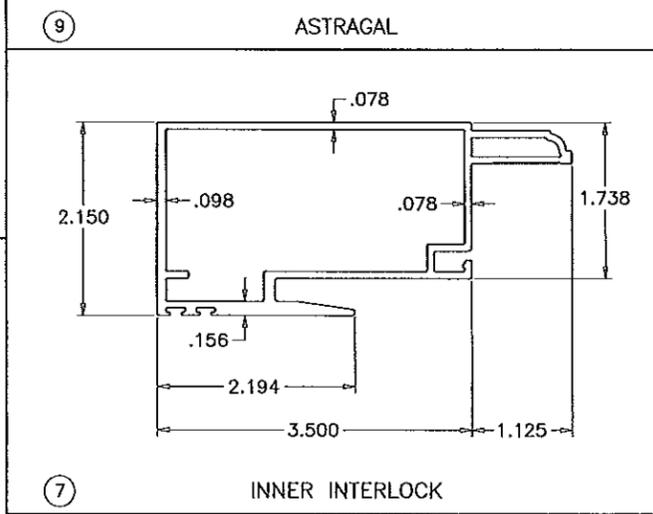


⑦ INNER INTERLOCK

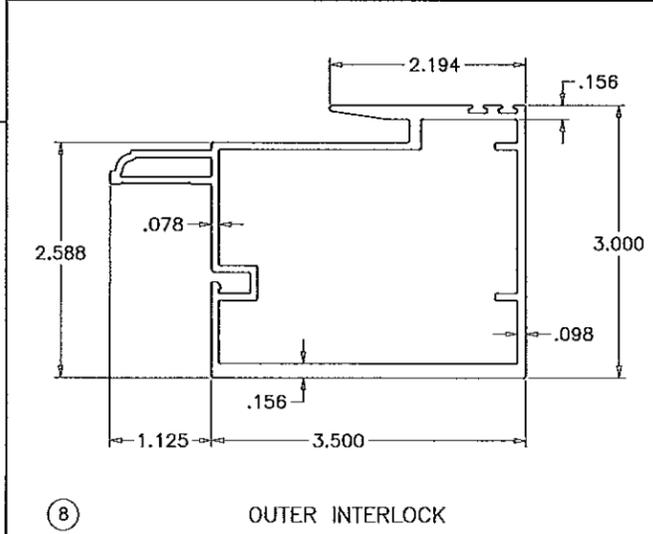


⑧ OUTER INTERLOCK

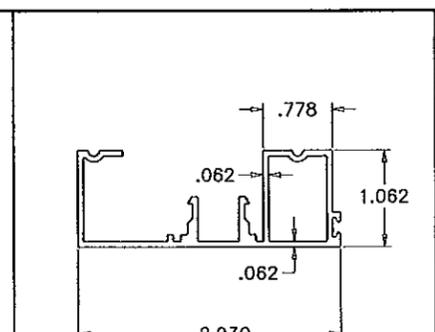


⑭ HEAD COVER

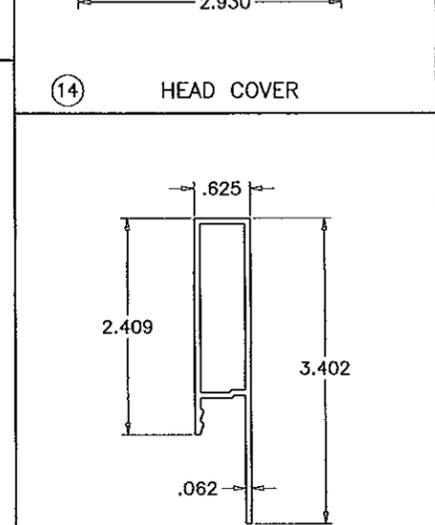


⑬ SILL RISER

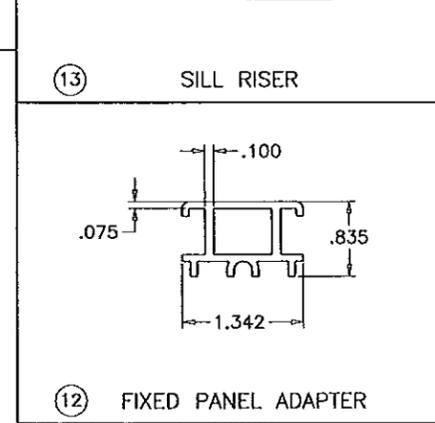


⑫ FIXED PANEL ADAPTER

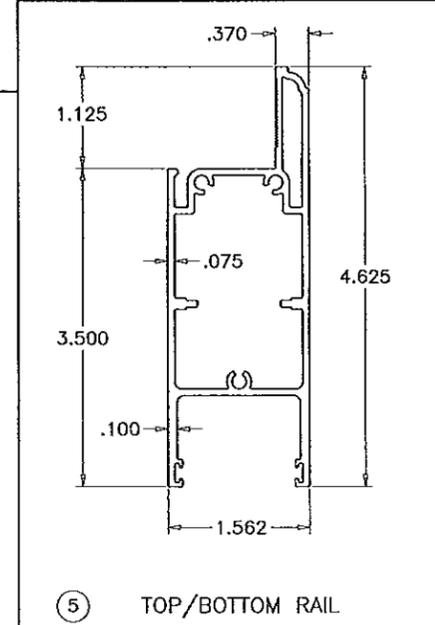


⑤ TOP/BOTTOM RAIL

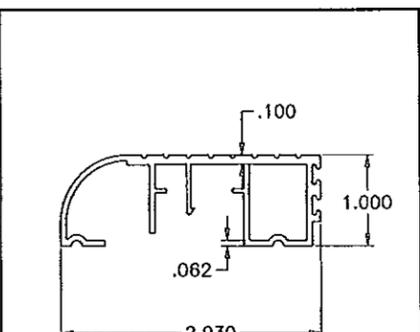


⑮ SILL COVER

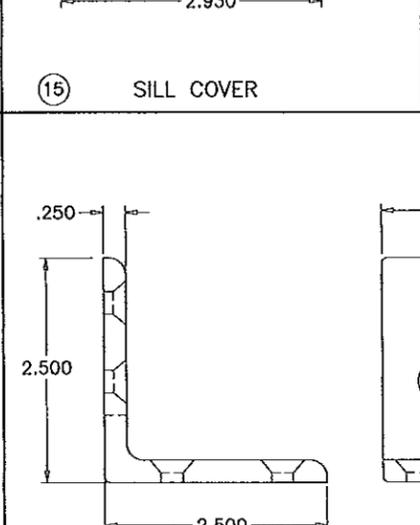

⑲ BOTTOM CLIP ANGLE

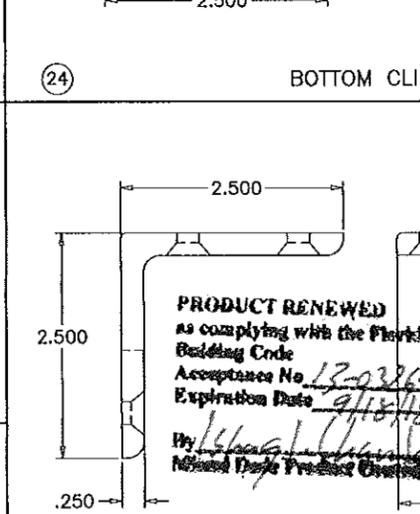

⑳ TOP CLIP ANGLE

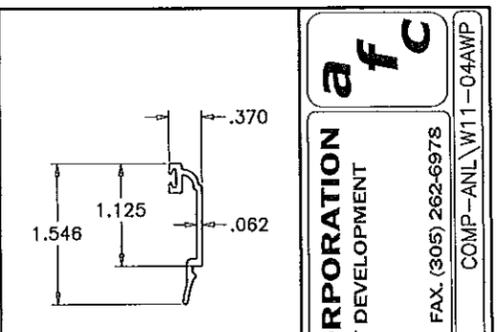

⑯ GLAZING STOP

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No. 12-0386-10
 Expiration Date 9/18/18
 Issued Under Product Control

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No. 12-0118-29
 Expiration Date 9/18/18
 Issued Under Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538

JAN 11 2012


revisions:
 no. date by description
 A 05.04.11 NO CHANGE THIS SHEET
 B 12.23.11 MANUF. NAME REVISED

date: 02-17-11
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W11-04
 sheet 6 of 7

afC
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 12335 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
TRULITE WINDOW & DOOR SOLUTIONS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

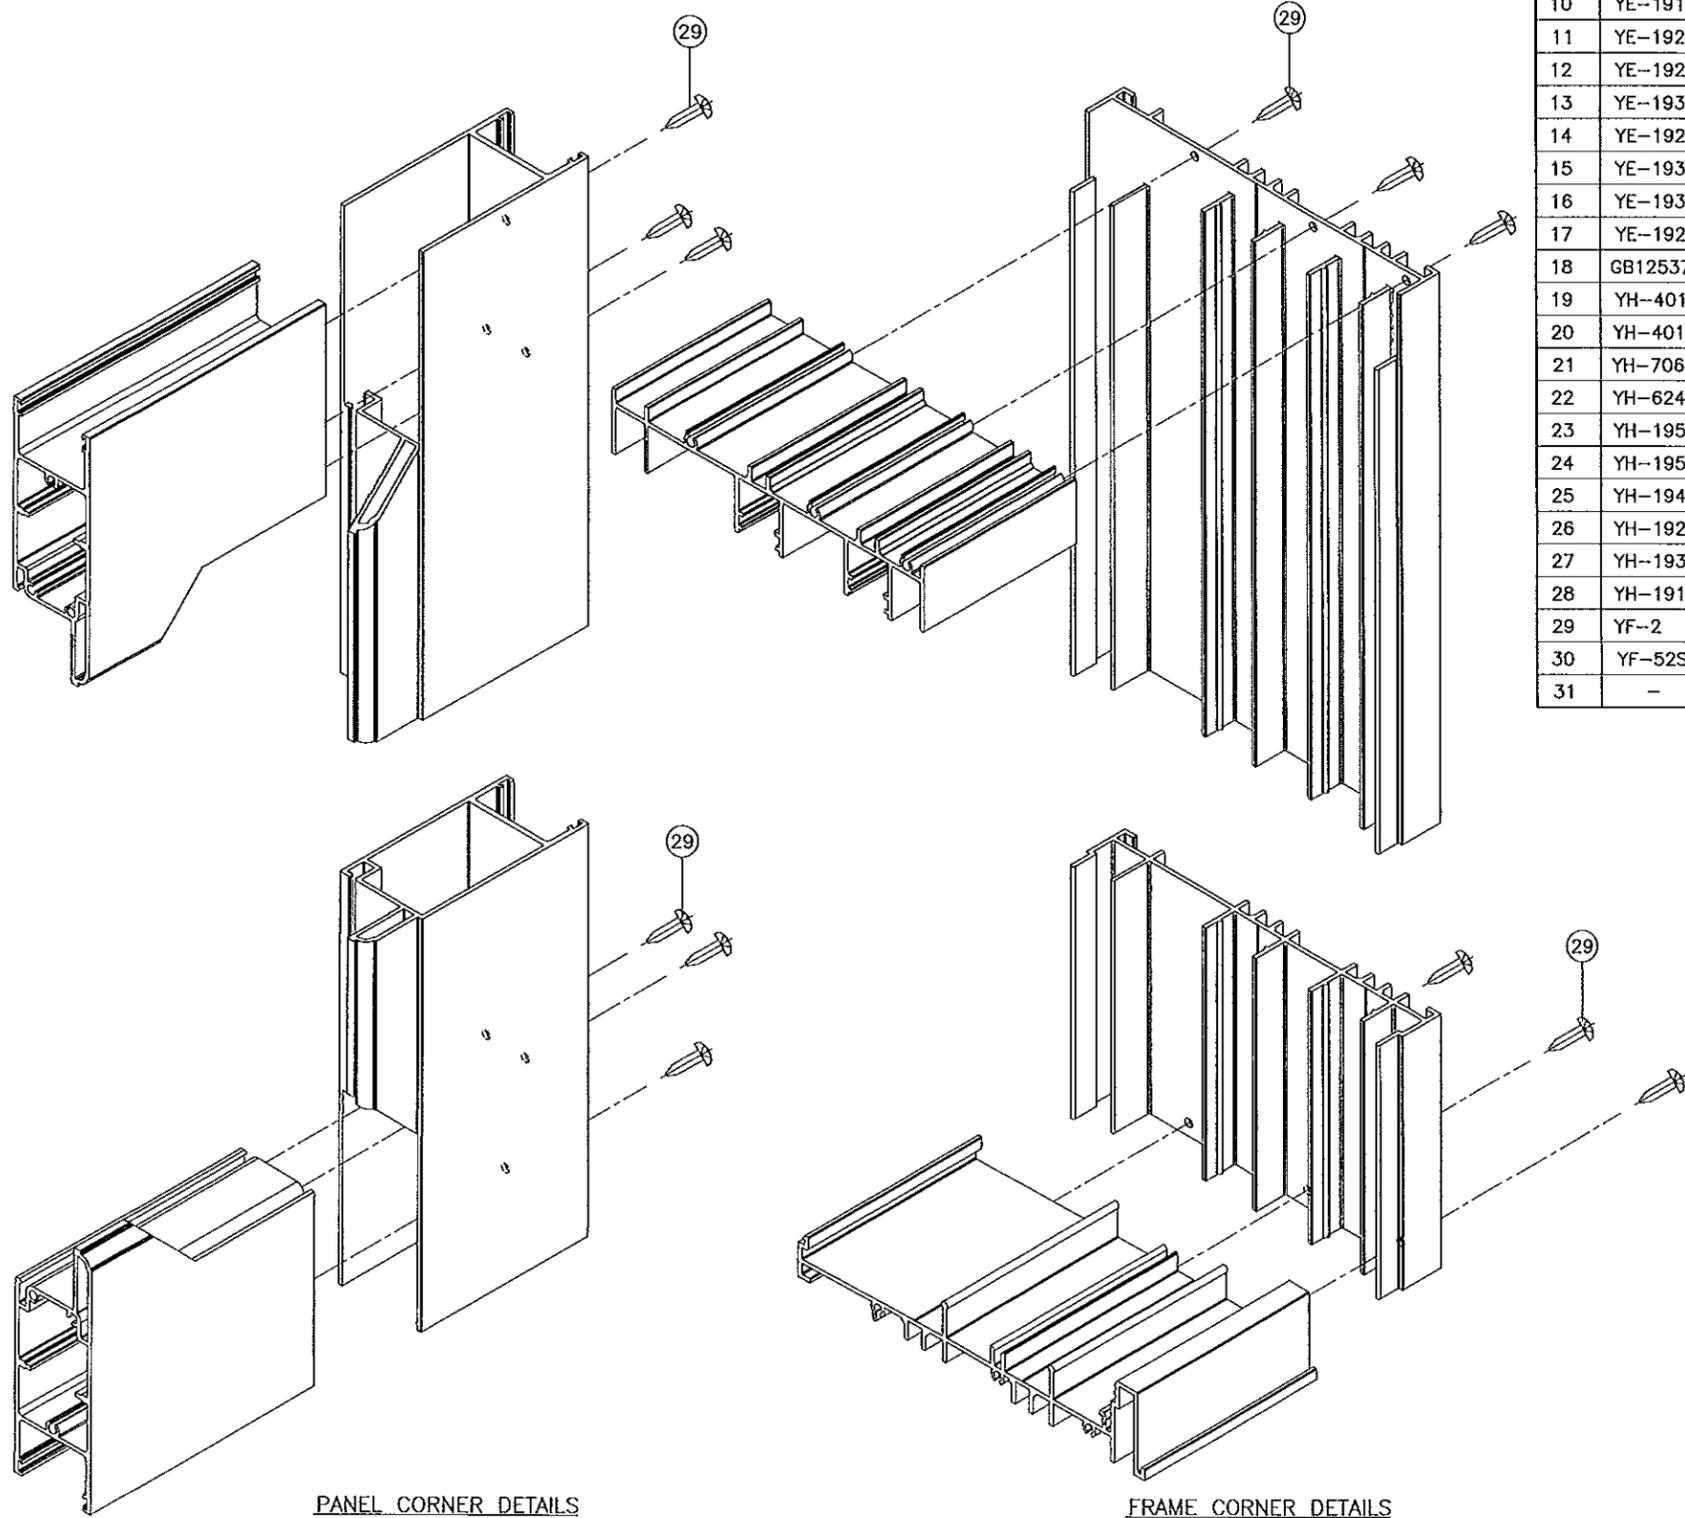

ITEM	PART No.	QUANTITY	DESCRIPTION	MATERIAL/REMARKS
1	YE-1901	1	FRAME HEAD	ALUM. (6063-T6)
2	YE-1902	2	FRAME JAMB	ALUM. (6063-T6)
3	YE-1903	1	FRAME SILL	ALUM. (6063-T6)
4	YE-1906	1	FRAME SUB SILL	ALUM. (6063-T6)
5	YE-1908	2/PANEL	PANEL TOP & BOTTOM RAIL	ALUM. (6063-T6)
6	YE-1910	AS REQ'D.	PANEL LOCK & END STILE	ALUM. (6063-T6)
7	YE-1912	AS REQ'D.	PANEL INNER (MOVING) INTERLOCK	ALUM. (6063-T6)
8	YE-1914	AS REQ'D.	PANEL OUTER (FIXED) INTERLOCK	ALUM. (6063-T6)
9	YE-1916	AS REQ'D.	PANEL ASTRAGAL	ALUM. (6063-T6)
10	YE-1918	AS REQ'D.	FRAME JAMB INSERT (FIXED SIDE)	ALUM. (6063-T6)
11	YE-1922	AS REQ'D.	FRAME HEAD INSERT	ALUM. (6063-T6)
12	YE-1924	2/PANEL	FIXED PANEL ADAPTER (2-1/2" LONG)	ALUM. (6063-T6)
13	YE-1930	1	SILL RAISER ADAPTER	ALUM. (6063-T6)
14	YE-1923	1	HEAD COVER	ALUM. (6063-T6)
15	YE-1935	1	SILL COVER	ALUM. (6063-T6)
16	YE-1936	AS REQ'D.	GLAZING STOP	ALUM. (6063-T6)
17	YE-1920	AS REQ'D.	FRAME JAMB INSERT (LOCK END)	ALUM. (6063-T6)
18	GB125375	AS REQ'D.	GLAZING SPACER AT 10" O.C.	-
19	YH-4013	AS REQ'D.	13/16 x 2-1/2" SELF ADHESIVE PAD	ULTRAFAB (P6803AFG)
20	YH-4013	AS REQ'D.	9/16 x 7/8" SELF ADHESIVE PAD	ULTRAFAB (P6803AFG)
21	YH-706	AS REQ'D.	.187" x .250" FIN SEAL WEATHERSTRIP	ULTRAFAB (W41255)
22	YH-624	AS REQ'D.	GLAZING GASKET	VINYL
23	YH-1950	1/F.PANEL	2 1/2 x 2 1/2 x 2 1/2 x 1/4" TOP ANGLE	ALUM. (6061-T6511)
24	YH-1955	1/F.PANEL	2 1/2 x 2 1/2 x 2 1/2 x 1/4" BOT. ANGLE	ALUM. (6061-T6511)
25	YH-1940	2/PANEL	WHEEL ADJUSTING SCREW HOLE PLUG	PVC
26	YH-1920	2/PANEL	1988-PRN-166-SS-125 WHEEL ASSY.	SS/DELRON
27	YH-1930	1/LOCK	"GEMINI" SERIES 2470 FLAT KEEPER	SS., BY AMESBURY
28	YH-1910	1	"GEMINI" 2468 DUAL POINT LOCK ASSY.	STEEL, BY AMESBURY
29	YF-2	AS REQ'D.	#10 x 1" PH. SMS.	CAD PLATED CRS.
30	YF-52SS	AS REQ'D.	#10-24 x 1/2" FH. UC. MS. POINT F	STAINLESS STEEL
31	-	AS REQ'D.	#14 x 1" SMS. (TYP. CLIP ANCHOR)	CAD PLATED CRS.

SEALANT:

ALL FRAME AND PANEL JOINTS AND HEADS OF ANCHOR SCREWS AT SILL TO BE SEALED WITH WHITE/ALUMINUM COLORED SILICONE.

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0326-10
 Expiration Date SEP 18, 2018
 By: Ishaq I. Chaudhry
 Island State Product Control

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0118-29
 Expiration Date SEP 18, 2013
 By: Ishaq I. Chaudhry
 Island State Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JAN 11 2012

afC

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP - ANL W11-04AWP

SERIES 1900 ALUM SLD. GLASS DOOR (L.M.I.)
TRULITE WINDOW & DOOR SOLUTIONS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

NO	DATE	DESCRIPTION
A	05.04.11	NO CHANGE THIS SHEET
B	12.23.11	MANUF. NAME REVISED

date: 02-17-11
 scale: 3/8" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W11-04

sheet 7 of 7