



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/economy

ES Windows, LLC
10653 N.E. Quaybridge Ct.
Miami, FL 33138

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "1000/1050" Aluminum Single Hung Window – L. M. I.

APPROVAL DOCUMENT: Drawing No. W03-56, titled "Series-1000/1050 Alum. Single Hung Wdw. (L.M.I)", sheets 1 through 8 of 8, dated 07/31/03, with revision H dated 12/07/11, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA# 12-0223.42 and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



MP
9/9/13

NOA No. 13-0617.27
Expiration Date: November 06, 2018
Approval Date: September 19, 2013
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 09-1008.05)
2. Drawing No. **W03-56**, titled "Series-1000/1050 Alum. Single Hung Wdw. (L.M.I)", sheets 1 through 8 of 8, dated 07/31/03, with revision **H** dated 12/07/11, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
(Submitted under previous NOA No. 12-0223.42)

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-5815** and **FTL-5337**, dated 02/13/09 and 01/25/08 respectively, both signed and sealed by Michael R. Wenzel, P.E.

(Submitted under NOA's No. 09-1008.05 and 07-0928.14)

2. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an aluminum single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No. **HETI-05-1448** and **HETI-05-1953**, dated 04/22/05 and 04/25/05 respectively, both signed and sealed by Ivonne Ghia, P.E.

(Submitted under NOA No. 05-0720.01)


Manuel Perez, P.E.
Product Control Examiner
NOA No. 13-0617.27

Expiration Date: November 06, 2018

Approval Date: September 19, 2013

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

B. TESTS (CONTINUED)

3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F 588-04/ 07 and per FBC 2411 3.2.1, TAS 202-94

along with marked-up drawings and installation diagram of an Aluminum single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-3820** and **FTL-3806**, dated 06/09/03, all signed and sealed by Joseph C. Chan, P.E.

(Submitted under NOA No. 03-0910.03)

C. CALCULATIONS

Anchor verification calculations and structural analysis, complying with **FBC-2010**, prepared by Al-Farooq Corporation, dated 12/09/11, signed and sealed by Javad Ahmad, P.E.

(Submitted under previous NOA No. 12-0223.42)

1. Glazing complies with **ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **11-0624.02** issued to **E.I. DuPont DeNemours & Co., Inc.** for their "**DuPont Sentry Glass® Interlayer**" dated 05/26/10, expiring on 01/14/17.
2. Notice of Acceptance No. **13-0129.27** issued to **E.I. DuPont DeNemours & Co., Inc.** for their "**DuPont Butacite® PVB Interlayer**" dated 04/11/13, expiring on 12/11/16.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC-2010**, and of no financial interest, dated 12/08/11 and 06/05/13, signed and sealed by Javad Ahmad, P.E.
(Submitted partially under previous NOA No. 12-0223.42)



Manuel Perez, P.E.
Product Control Examiner
NOA No. 13-0617.27

Expiration Date: November 06, 2018
Approval Date: September 19, 2013

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

2. Laboratory compliance letter for Test Reports No. **FTL-5815** and **FTL-5337**, issued by Fenestration Testing Laboratory, Inc., dated 02/13/09 and 01/25/08 respectively, all signed and sealed by Michael R. Wenzel, P.E.
(Submitted under NOA's No. 09-1008.05 and 07-0928.14)
3. Proposal No. **09-1583** issued by Product Control, dated 11/23/09, signed by Jaime D. Gascon, P.E.
(Submitted under NOA No. 09-1008.05)
4. Laboratory compliance letter for Test Reports No. **HETI-05-1448** and **HETI-05-1953**, issued by Hurricane Engineering & Testing, Inc., dated 04/22/05 and 04/25/05 respectively, both signed and sealed by Ivonne Ghia, P.E.
(Submitted under NOA No. 05-0720.01)
5. Laboratory compliance letter for Test Reports No. **FTL-3820** and **FTL-3806**, issued by Fenestration Testing Laboratory, Inc., dated 06/09/03, all signed and sealed by Joseph C. Chan, P.E.
(Submitted under NOA No. 03-0910.03)

G. OTHERS



1. Notice of Acceptance No. **12-0223.42**, issued to ES Windows, LLC, for their Series "1000/ 1050" Aluminum Single Hung Window - L.M.I., approved on 05/17/12 and expiring on 11/06/13.


Manuel Perez, P.E.
Product Control Examiner





NOA No. 13-0617.27

Expiration Date: November 06, 2018


Approval Date: September 19, 2013

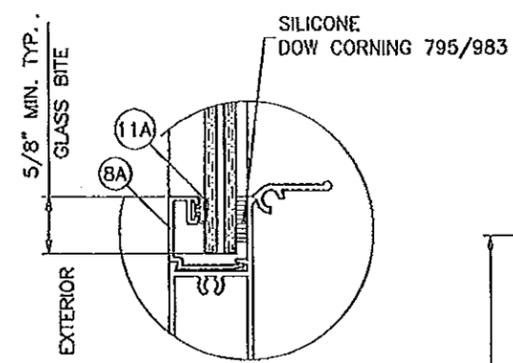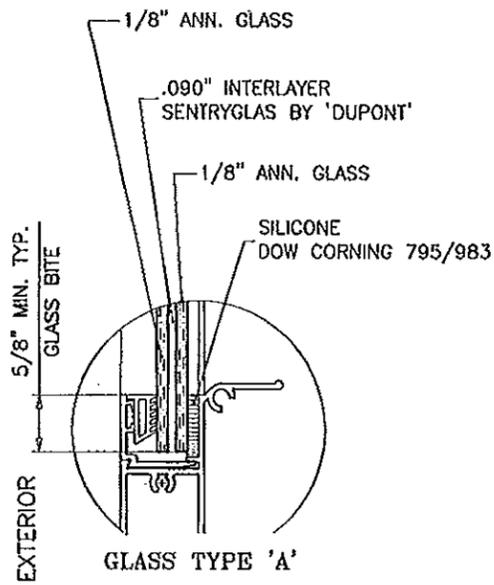


ALT. GLAZING OPTION
SQUARE GLAZING STOP CAN BE USED WITH ALL GLASS TYPES SHOWN ON THIS SHEET.

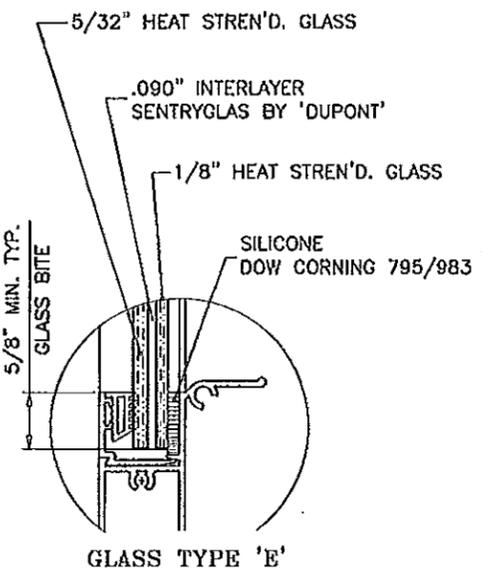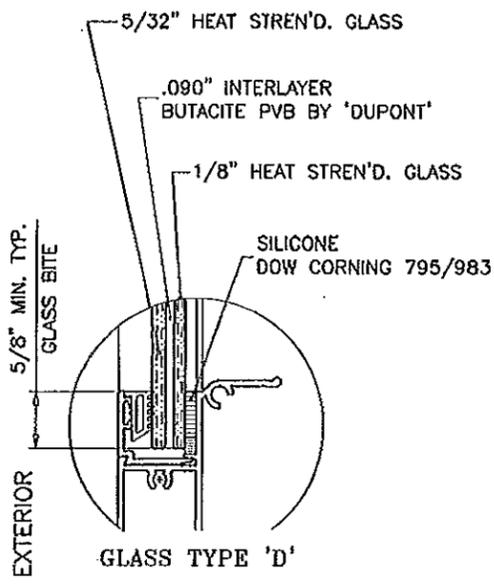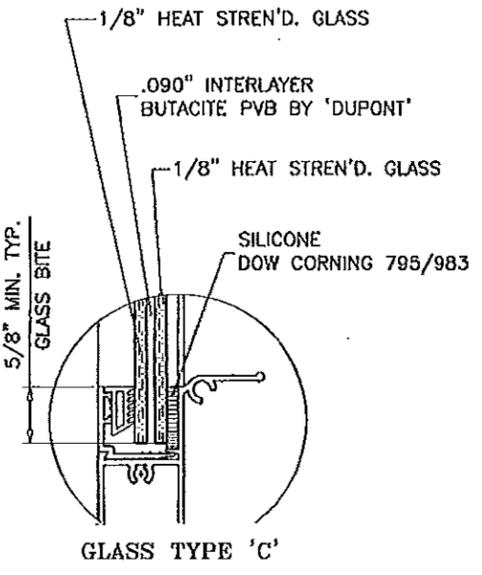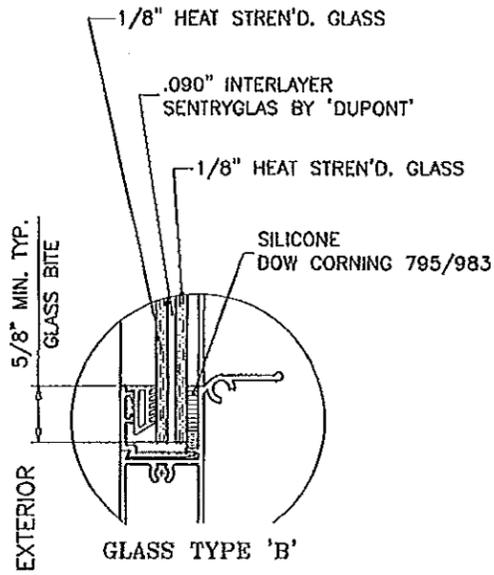

GLAZING OPTIONS

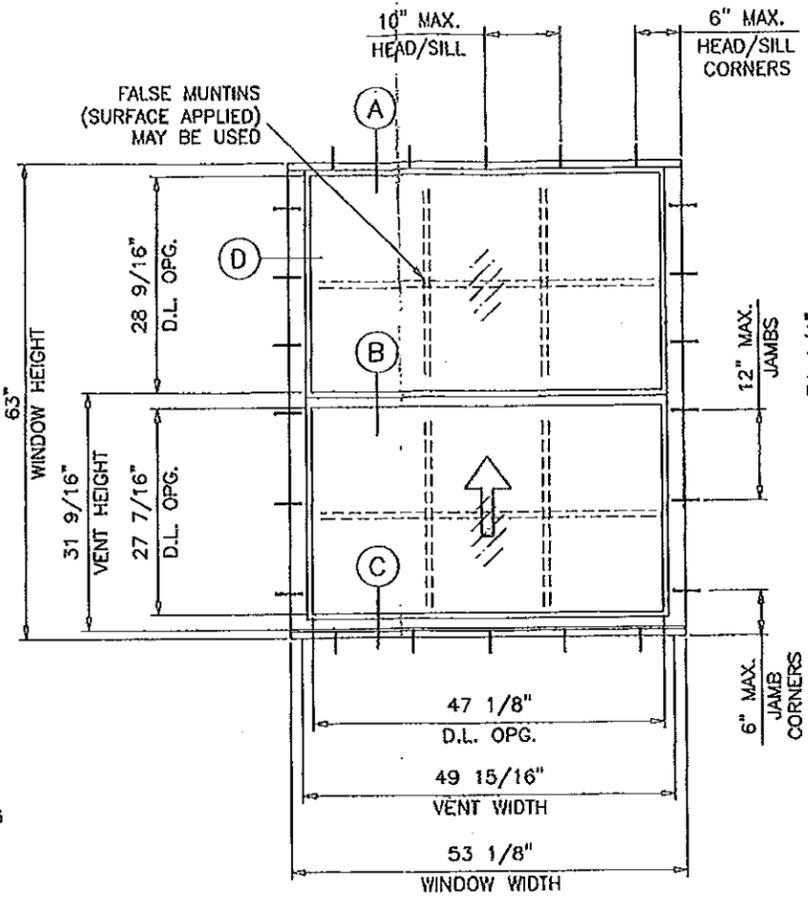

TYPICAL ELEVATION
SERIES 1000 (STD. SILL)

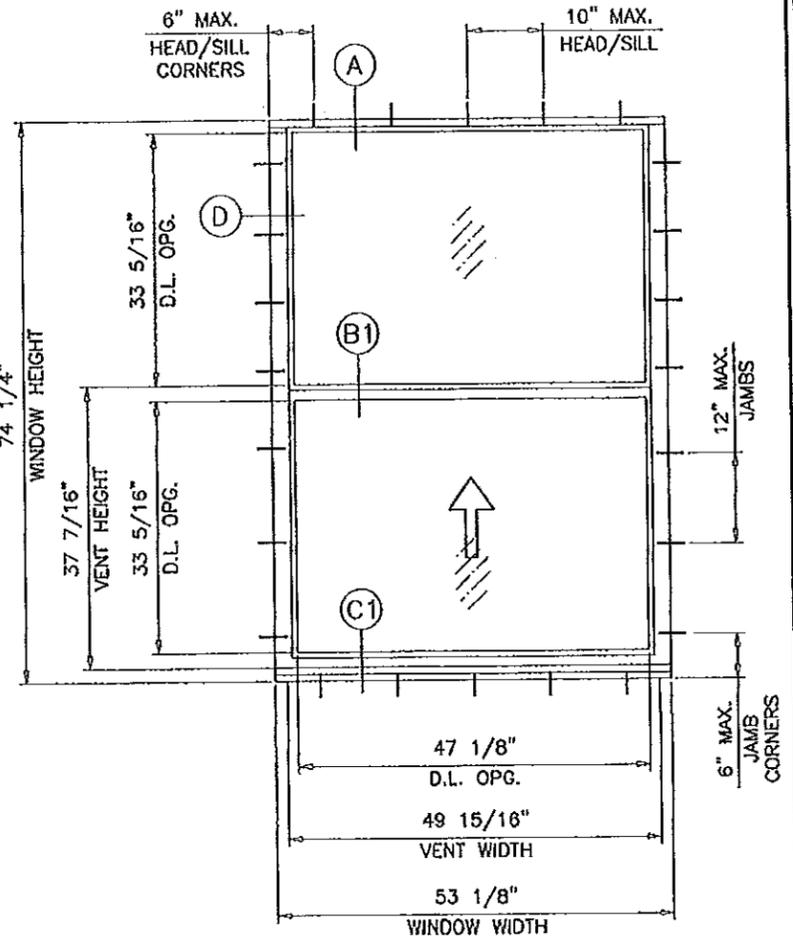

TYPICAL ELEVATION
SERIES 1000 (HI-RISE SILL)

SERIES-1000/1050 ALUMINUM SINGLE HUNG WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 2.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE SECTION 2003.8.4.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Engr. JAVAD AHMAD
C.M.A.
FLA. P.E. # 70592
C.A.N. 3538
DEC 9 2011

PRODUCT RENEWED
as complying with the Florida Building Code
Acceptance No. 13-0617.27
Expiration Date NOV 6 2018
By *Manuel Perez*
Miami Dade Product Control

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 12-0223.42
Expiration Date 11/06/2013
By *Manuel Perez*
Miami Dade Product Control

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP--ANL\W03-56ESW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 624-7775 FAX. (305) 624-7777


NO.	DATE	DESCRIPTION
E	03.03.06	NO CHANGE THIS SHEET
F	04-23.08	GENERAL REVISION
G	07.15.08	LATCH OPTION ADDED
H	12.07.11	ALT. GLAZING OPTION ADDED

date: 07-31-03
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:
drawing no. W03-56
sheet 1 of 8


EQUAL LITES WINDOWS
DESIGN LOAD CAPACITY - PSF (HI-RISE SILL)

WINDOW DIMS.		STANDARD TOP RAIL				HEAVY DUTY TOP RAIL		
		GLASS TYPE 'A'		GLASS TYPES 'B', 'C', 'D' & 'E'		GLASS TYPES 'B', 'C', 'D' & 'E'		
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
19-1/8"	26"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(3)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0	
19-1/8"	38-3/8"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(4)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0	
19-1/8"	50-5/8"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(5)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0	
19-1/8"	58"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(5)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0	
19-1/8"	63"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(6)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		70.0	80.0	80.0	90.0	80.0	90.0	
19-1/8"	68"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(6)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		-	-	-	-	80.0	90.0	
19-1/8"	74-1/4"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(7)	70.0	80.0	80.0	90.0	80.0	90.0
49"		-	-	-	-	-	80.0	90.0
53-1/8"		-	-	-	-	80.0	90.0	
19-1/8"	80"	-	-	-	-	80.0	90.0	
26-1/2"		-	-	-	-	80.0	90.0	
37"		-	-	-	-	80.0	90.0	
42"		(7)	-	-	-	-	80.0	90.0
49"		-	-	-	-	-	80.0	90.0


* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.
LIMIT EXTERIOR(+) LOADS TO 70.0 PSF FOR STD. SILL.




STD. TOP RAIL
S-1000





HEAVY DUTY TOP RAIL
S-1000

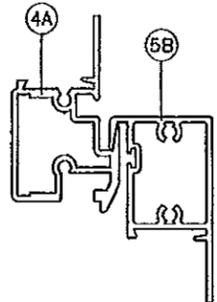

STD. TOP RAIL
S-1050

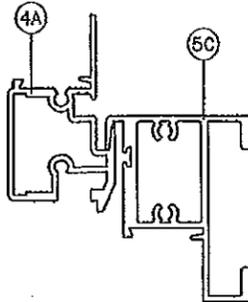

HEAVY DUTY TOP RAIL
S-1050

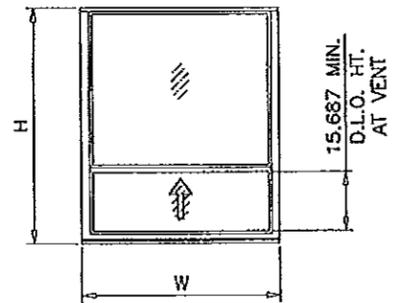

UNEQUAL LITES (ORIEL TYPES) WINDOWS
DESIGN LOAD CAPACITY - PSF (HI-RISE SILL)

WINDOW DIMS.		STANDARD TOP RAIL				HEAVY DUTY TOP RAIL		
		GLASS TYPE 'A'		GLASS TYPES 'B', 'C', 'D' & 'E'		GLASS TYPES 'B', 'C', 'D' & 'E'		
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	
19-1/8"	50-5/8"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(5)	70.0	80.0	80.0	90.0	80.0	90.0
49"		70.0	80.0	80.0	90.0	80.0	90.0	
53-1/8"		70.0	74.0	80.0	90.0	80.0	90.0	
19-1/8"	58"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(5)	70.0	80.0	80.0	90.0	80.0	90.0
49"		-	-	-	-	-	80.0	90.0
19-1/8"	63"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(6)	-	-	-	-	80.0	90.0
49"		-	-	-	-	-	80.0	90.0
19-1/8"	68"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(6)	-	-	-	-	80.0	90.0
49"		-	-	-	-	-	80.0	90.0
19-1/8"	74-1/4"	70.0	80.0	80.0	90.0	80.0	90.0	
26-1/2"		70.0	80.0	80.0	90.0	80.0	90.0	
37"		70.0	80.0	80.0	90.0	80.0	90.0	
42"		(7)	70.0	80.0	80.0	90.0	80.0	90.0
49"		-	-	-	-	-	80.0	90.0

* NO. IN PARENTHESIS INDICATE NO. OF ANCHORS PER JAMB.
LIMIT EXTERIOR(+) LOADS TO 70.0 PSF FOR STD. SILL.

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0617.27
Expiration Date 11/06/2016
By *Manuel Perez*
Miami Dade Product Control

Engr. JAYAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N.S. 3538
DEC 9 2011

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0223.42
Expiration Date 11/06/2013
By *Manuel Perez*
Miami Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-56ESW




SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 624-7775 FAX. (305) 624-7777

NO.	DATE	DESCRIPTION
E	03.03.06	NO CHANGE THIS SHEET
F	04.23.08	GENERAL REVISION
G	07.15.09	LATCH OPTION ADDED
H	12.07.11	NO CHANGE THIS SHEET

date: 07-31-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-56
sheet 2 of 8

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-04 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

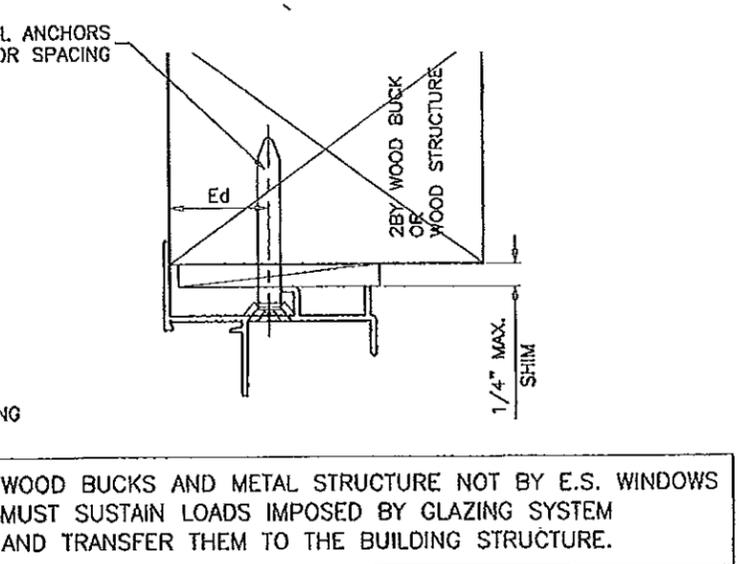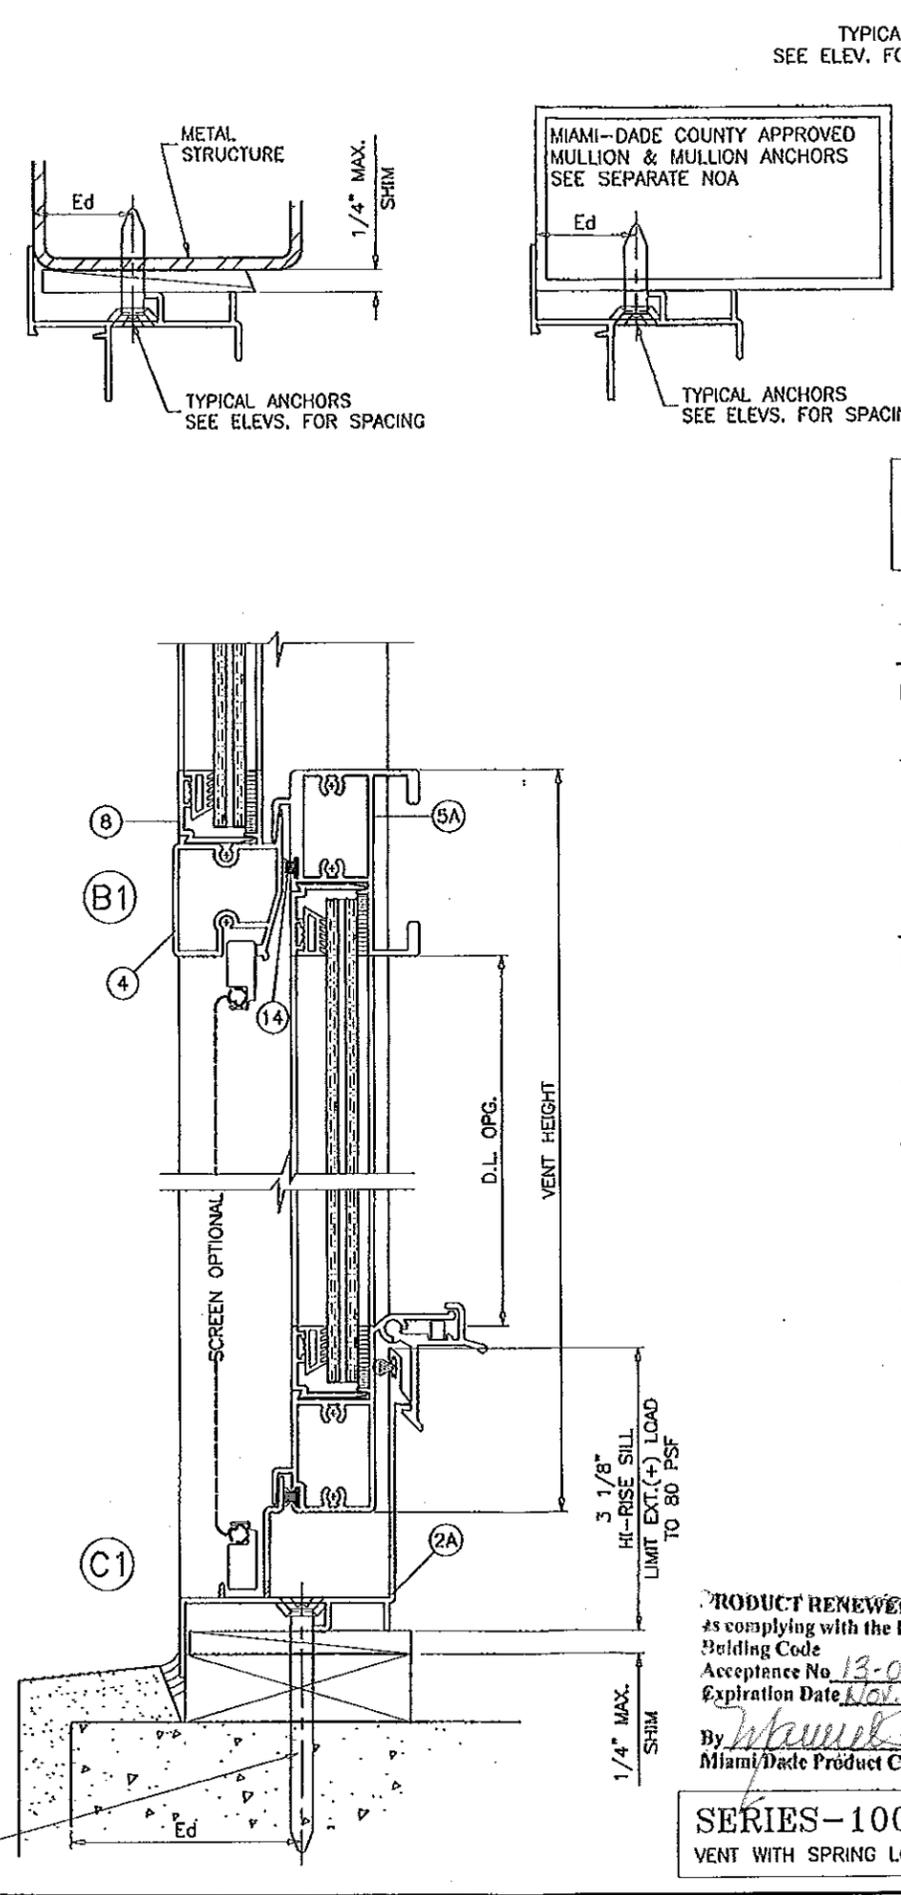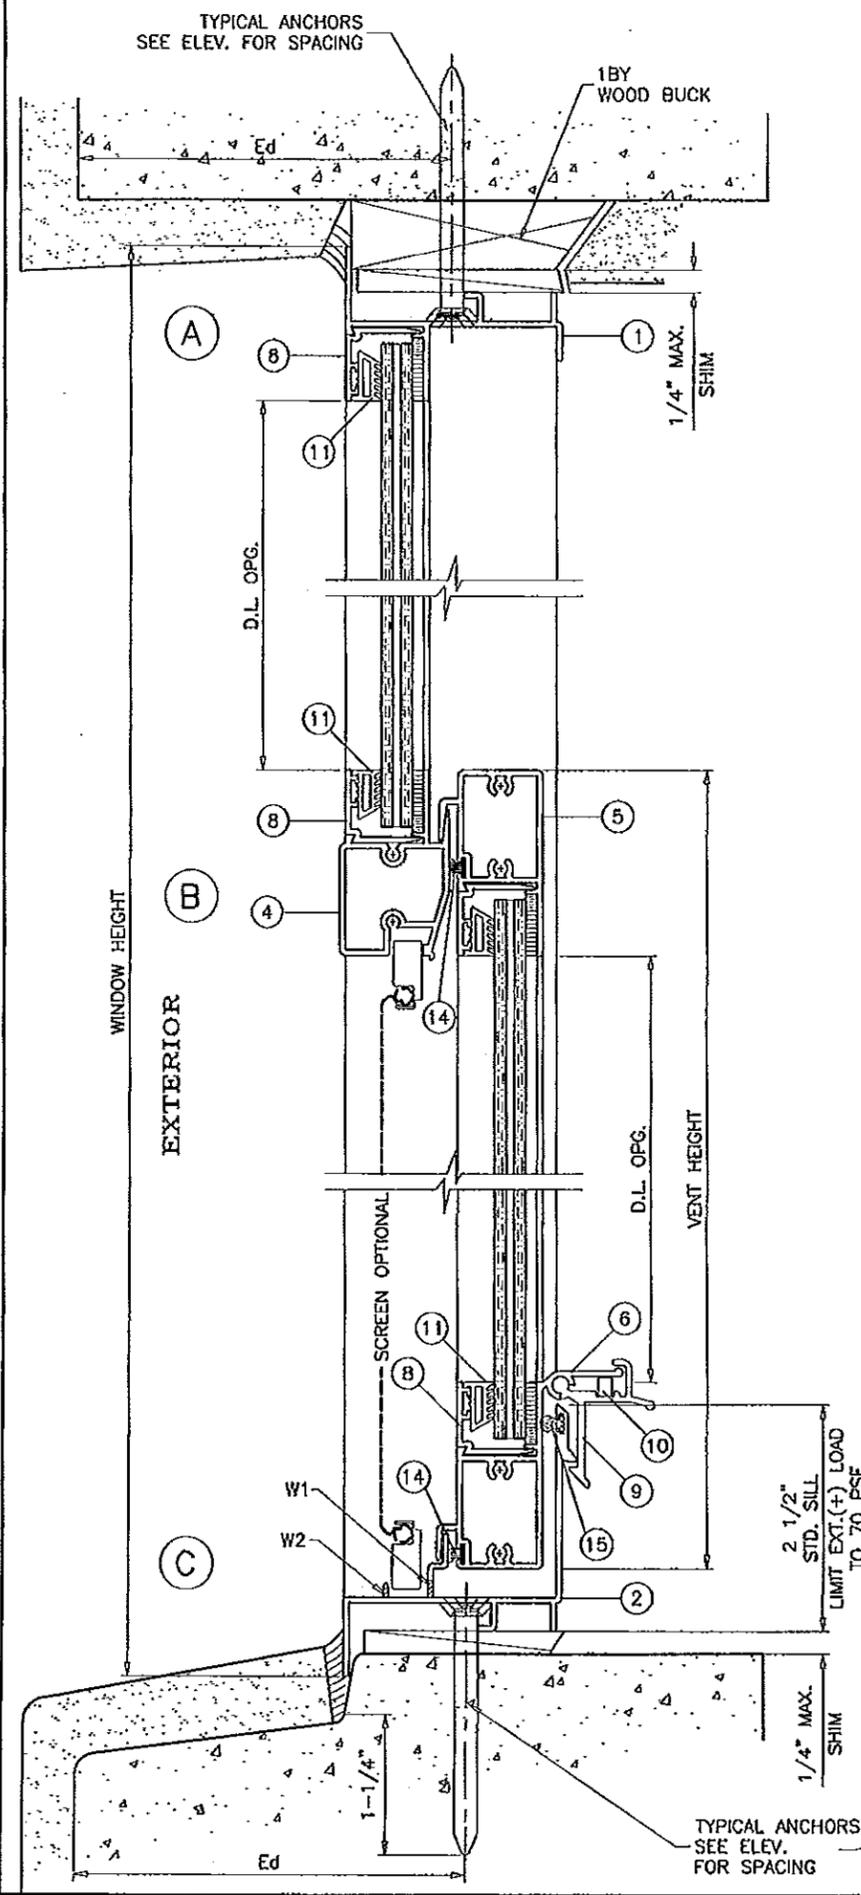

WOOD BUCKS AND METAL STRUCTURE NOT BY E.S. WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING
 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
 1-3/8" MIN. PENETRATION INTO WOOD
 THRU 1BY BUCKS INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY
 DIRECTLY INTO CONC. OR MASONRY
 1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#14 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
 INTO METAL STRUCTURES
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

Ed = ANCHOR EDGE DISTANCE
 INTO CONCRETE AND MASONRY = 1-1/2" MIN.
 INTO WOOD STRUCTURE = 1" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

SEALANT:
 ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SCHNEE MOREHEAD SEAM SEALER SM5504.

WEEPHOLES:
 W1 = 1-1/2" X 3/16" WEEPHOLES AT 4" FROM EACH END
 W2 = 1-5/16" NOTCH AT EACH END

PRODUCT RENEWED
 as complying with the Florida Building Code
 Acceptance No 13-0617-27
 Expiration Date Nov. 6, 2018
 By *Muhammad Syed*
 Miami Dade Product Control

SERIES-1000
 VENT WITH SPRING LOADED LATCHES

Engr. *YAVAD AHMAD*
 CIVIL
 FLA. PE # 70592
 C.A.M. 3538
 DEC 9 2011

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 12-0223-42
 Expiration Date 11/06/2013
 By *[Signature]*
 Miami Dade Product Control

af c

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 57 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W03-56ESW



SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
 E.S. WINDOWS, LLC
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 624-7775 FAX. (305) 624-7777

NO	DATE	DESCRIPTION	BY
E	03.03.06	NO CHANGE THIS SHEET	
F	04.23.08	GENERAL REVISION	
G	07.15.09	LATCH OPTION ADDED	
H	12.07.11	SILL W/STRIPPING REV.	

revisions:

date: 07-31-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no. **W03-56**
 sheet 3 of 8

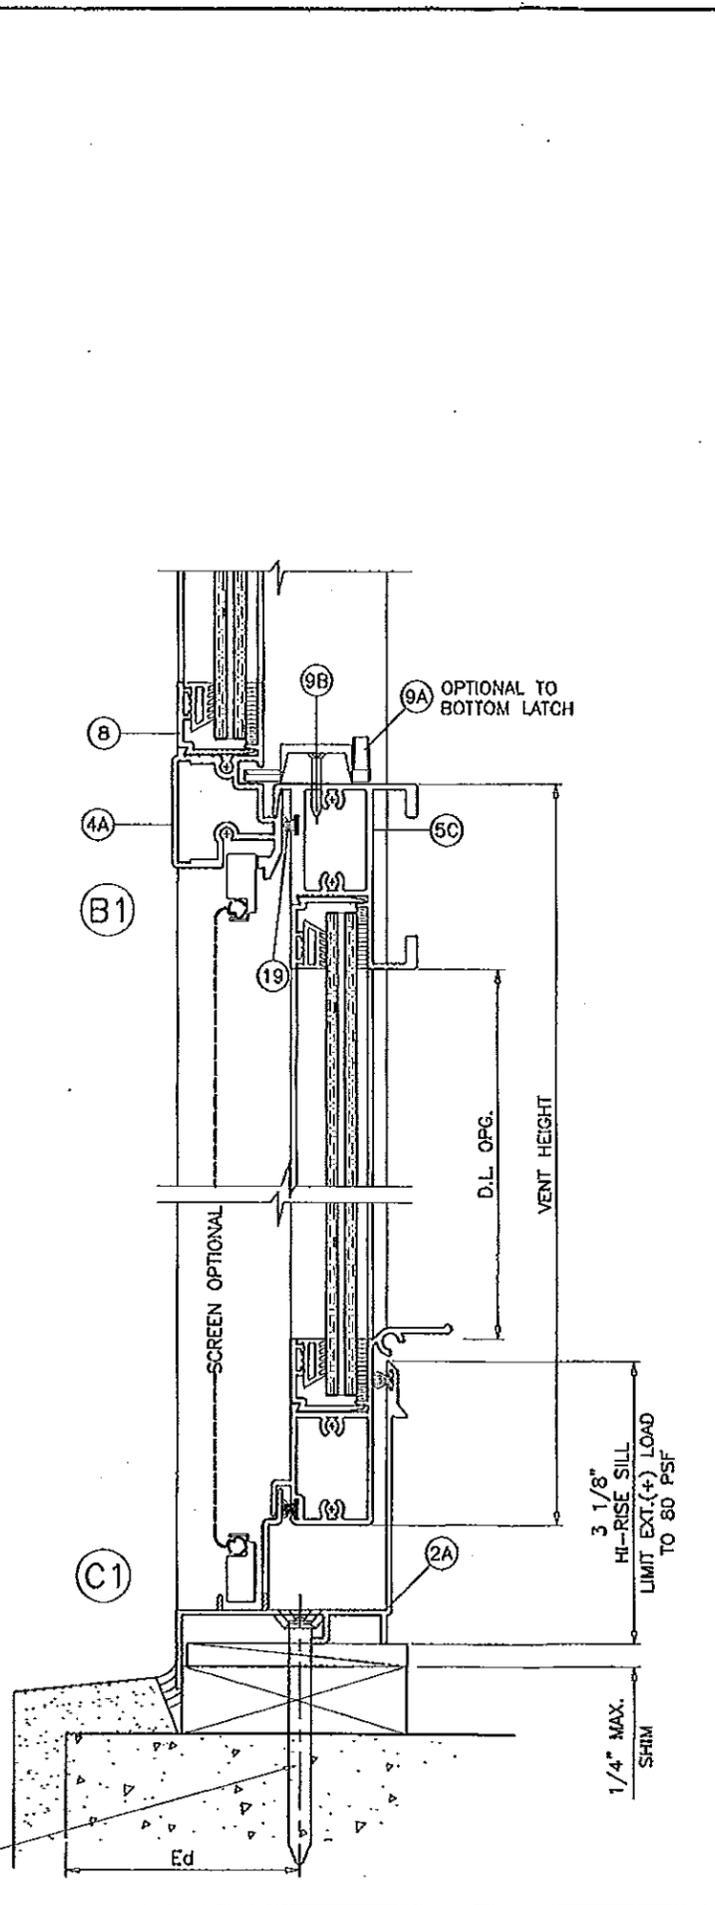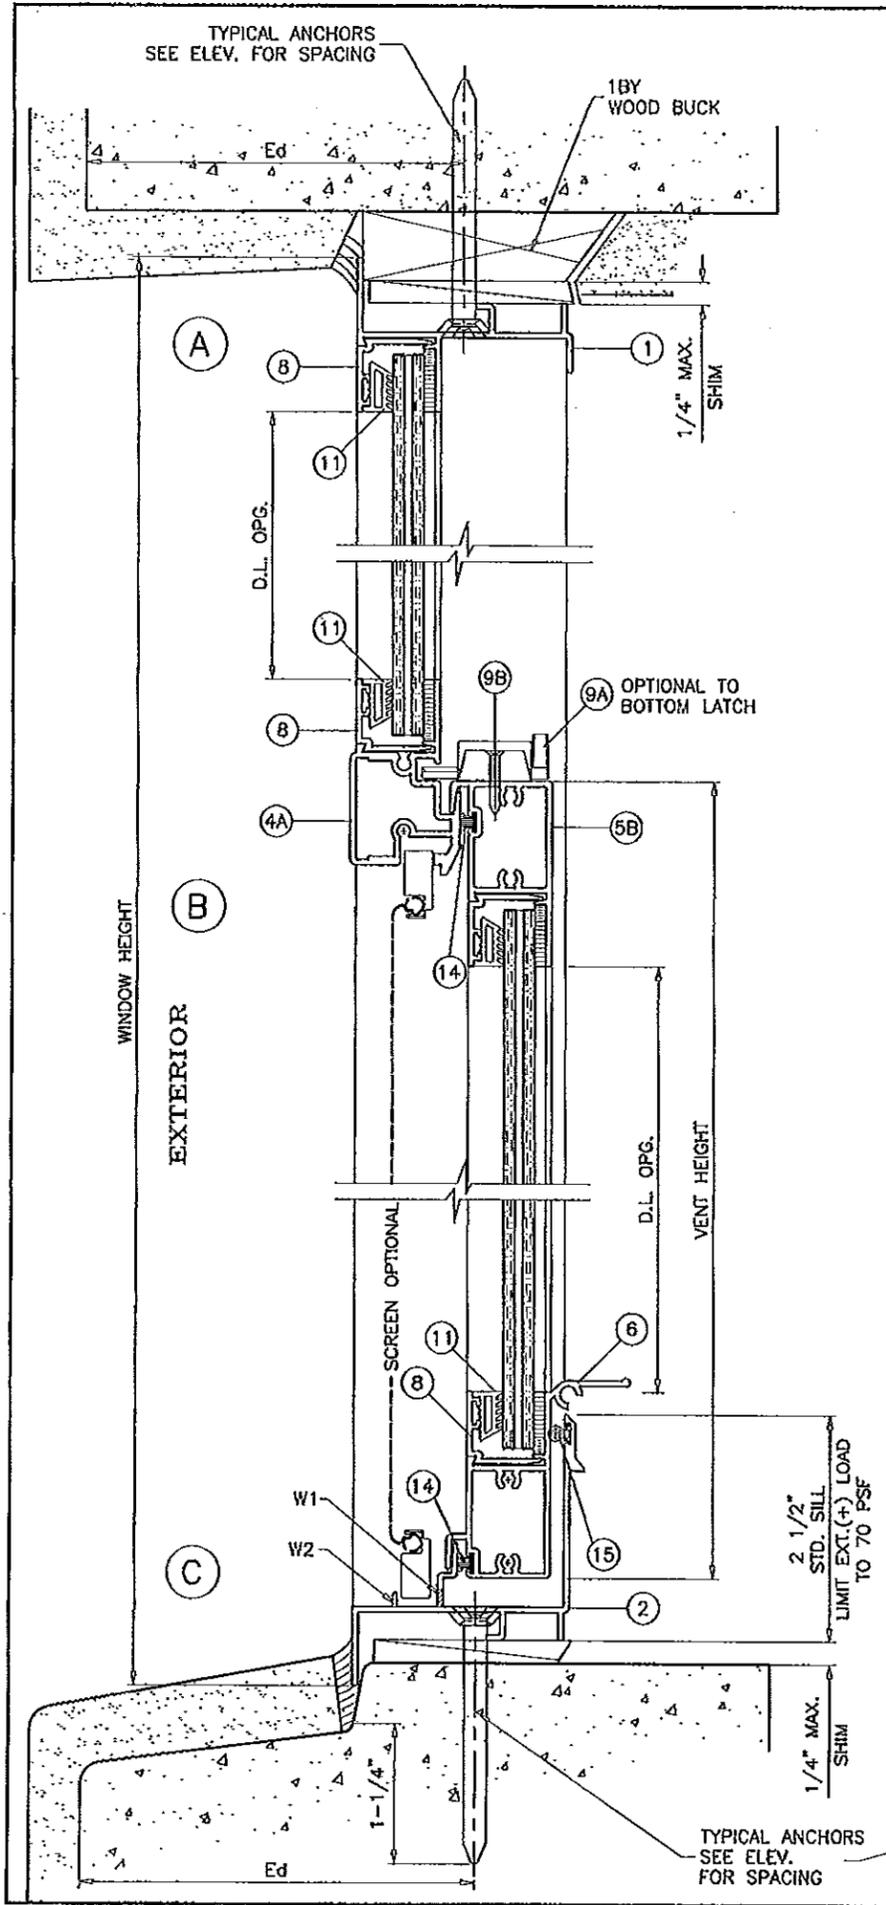

SERIES-1050
VENT WITH SWEEP LATCHES

Engr. JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
DEC 9 2011

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-0617-27
Expiration Date Nov. 6, 2018
By *Mamuel Perez*
Miami Made Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0223.42
Expiration Date 11/06/2013
By *Mamuel Perez*
Miami Made Product Control




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL W03-56ESW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL (305) 624-7775 FAX (305) 624-7777

NO.	DATE	DESCRIPTION
E	03.03.06	NO CHANGE THIS SHEET
F	04.23.08	GENERAL REVISION
G	07.15.09	LATCH OPTION ADDED
H	12.07.11	SILL W/STRIPPING REV.

date: 07-31-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W03-56
sheet 4 of 8

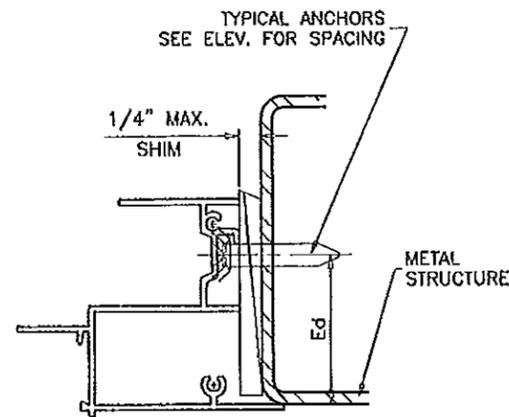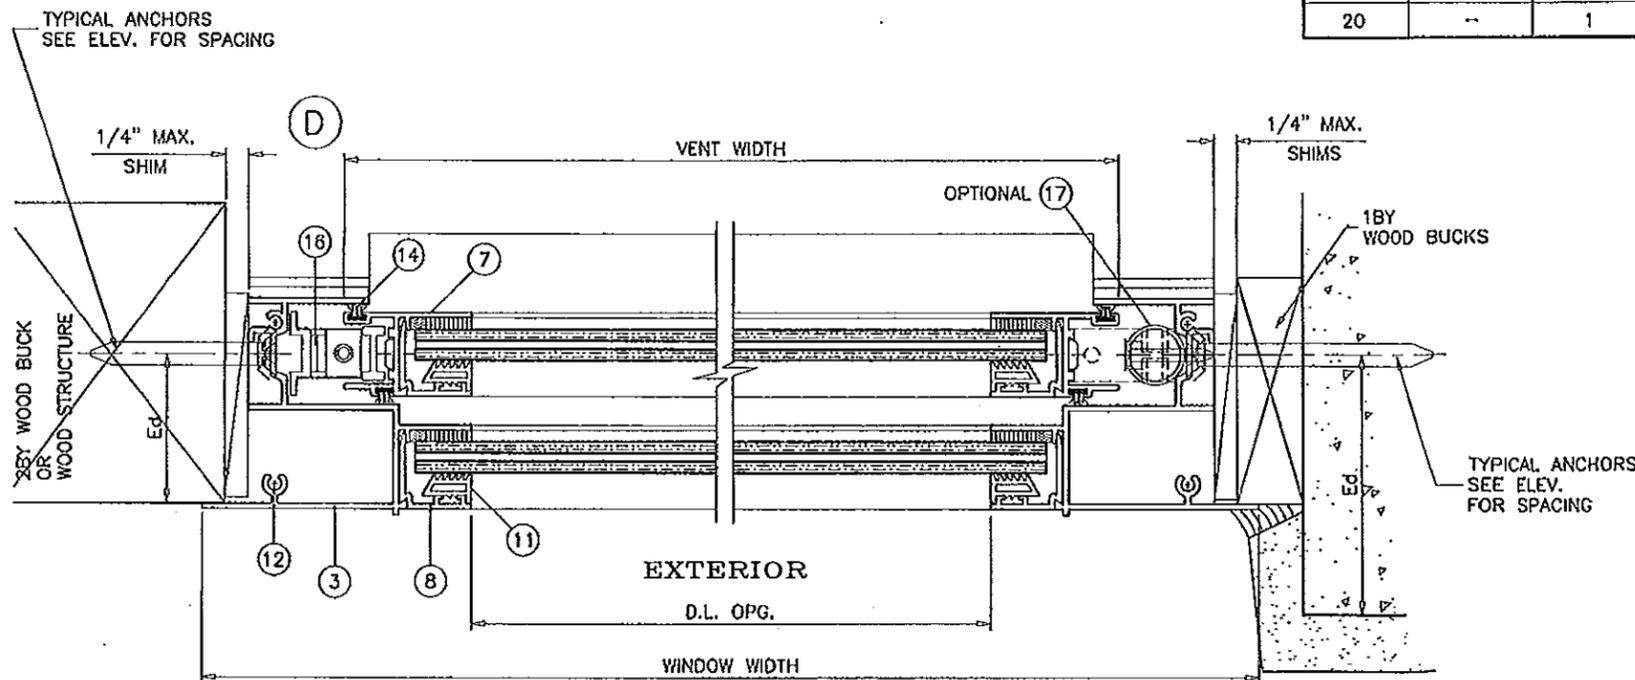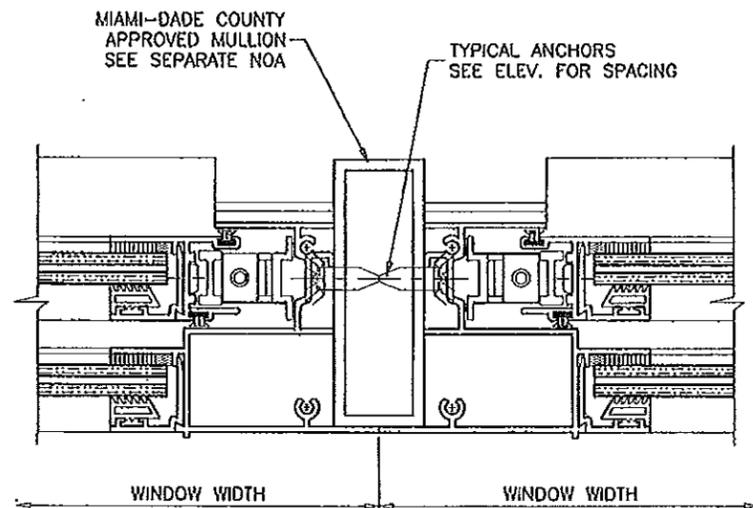

ITEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	ES1001	1	FRAME HEAD	6063-T6	-
2	ES1002	1	FRAME SILL (STD.)	6063-T6	-
2A	ES1101	1	FRAME SILL (HI-RISE)	6063-T6	-
3	ES1003	2	FRAME JAMB	6063-T6	-
4	ES1005	1	FIXED MTG. RAIL (FOR SPRING LATCH)	6063-T6	-
4A	ES1051	1	FIXED MTG. RAIL (FOR SWEEP LATCH)	6063-T6	-
5	ES1004	1	STD. VENT TOP RAIL (FOR SPRING LATCH)	6063-T6	-
5A	ES2004	1	HEAVY DUTY VENT TOP RAIL (FOR SPRING LATCH)	6063-T6	-
5B	ES1052	1	STD. VENT TOP RAIL (FOR SWEEP LATCH)	6063-T6	-
5C	ES1053	1	HEAVY DUTY VENT TOP RAIL (FOR SWEEP LATCH)	6063-T6	-
6	ES1006	1	VENT BOTTOM RAIL	6063-T6	-
7	ES1007	2	VENT SIDE RAIL	6063-T5	-
8	ES1008	AS RQD.	GLAZING BEAD	6063-T6	-
8A	ES1103	AS RQD.	SQUARE GLAZING BEAD	6063-T5	-
9	ES1009	2/VENT	SPRING LOADED VENT LATCH	6063-T5	AT 6" FROM ENDS
9A	3032	2/VENT	SWEEP LATCH	ZAMAK	AT 11" FROM ENDS
9B	#8 X 1"	2/ LATCH	LATCH INSTALLATION SCREWS	-	FH SMS
10	ES1012	1/LATCH	LATCH SPRING	ST. STEEL	-
11	ES1010	AS REQD.	GLAZING WEDGE	SOFT PVC	DUROMETER 70 SHORE 'A'
11A	27-425	AS REQD.	GLAZING GASKET	EPDM	DUROMETER 60 SHORE 'A'
12	#8 X 1"	20	FRAME & VENT ASSEMBLY SCREWS	CRS	PH SMS
13	ES1011	2/VENT	SASH CAM	CELCON	-
14	43620-187	AS REQD.	PILE W'STRIPPING WITH PLASTIC FIN	-	AMESBURY OR EQUIV.
15	Q300X190	AS REQD.	FRAME SILL W'STRIPPING	-	Q-LON2
16	-	2/ VENT	BLOCK & TACKLE BALANCE	-	SERIES 120 BY BSI
17	-	2/ VENT	SPIRAL BALANCE	-	-
18	ES1013	2	SASH STOP	-	-
19	ES1505	-	FLUSH FRAME ADAPTER	6063-T5	OPTIONAL
20	-	1	5/16" BOX SCREEN	-	OPTIONAL

SERIES-1000
SERIES-1050

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70692
C.A.N. 3538
DEC 9 2011

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No 13-0617-27
Expiration Date Nov 6, 2018
By *Mamad Saeed*
Miami/Dade Product Control


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0223.42
Expiration Date 11/06/2013
By *Mamad Saeed*
Miami/Dade Product Control

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-5100 FAX. (305) 262-6978
COMP - ANL \ W03 - 56ESW


SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.L.)
E.S. WINDOWS, LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL 33166
TEL. (305) 624-7775 FAX. (305) 624-7777

no.	date	description
E	03.03.06	FRAME ADAPTER ADDED
F	04.23.08	GENERAL REVISION
G	07.15.09	LATCH OPTION ADDED
H	12.07.11	ALT. GLAZING OPTION ADDED



date: 07-31-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:
drawing no. **W03-56**
sheet 5 of 8

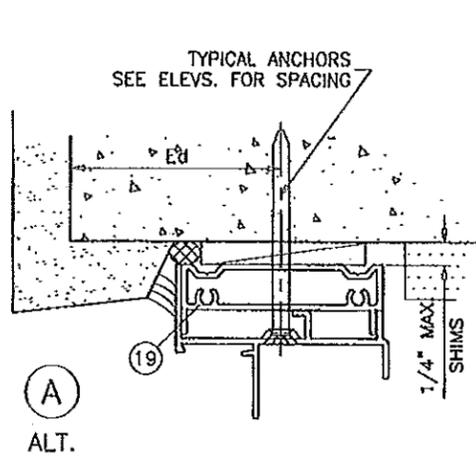


(A)
ALT.

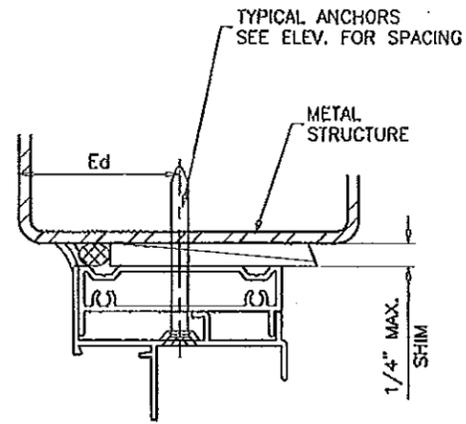

TYPICAL ANCHORS
SEE ELEV. FOR SPACING

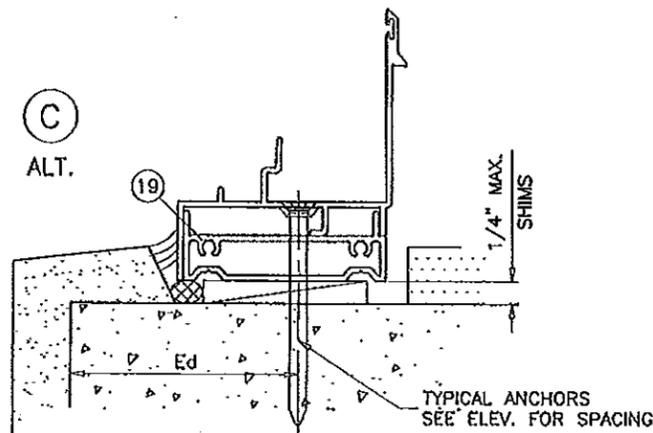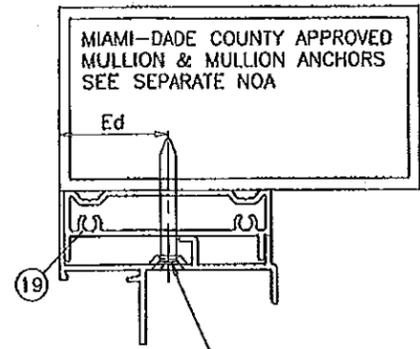

(C)
ALT.

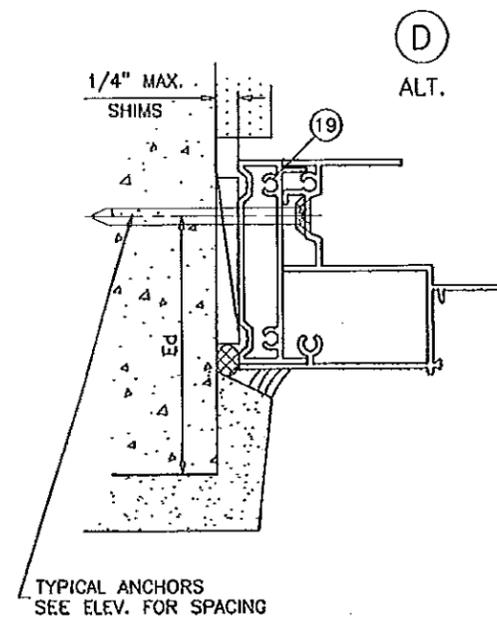

(D)
ALT.

INSTALLATION DETAILS WITH FLUSH FRAME ADAPTER

Eng. JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N.C. 3538
DEC 9 2011

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 13-067.27
Expiration Date Nov. 6, 2013
By *Manuel Perez*
Miami Dade Product Control

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 12-0223.42
Expiration Date 11/06/2013
By *Manuel Perez*
Miami Dade Product Control


afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W03-56ESW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
5220 N.W. 72 AVE. BAY #4
MIAMI, FL. 33166
TEL. (305) 624-7775 FAX. (305) 624-7777


NO	DATE	BY	DESCRIPTION
E	10.03.06		FRAME ADAPTER ADDED
F	04.23.08		GENERAL REVISION
G	07.15.09		LATCH OPTION ADDED
H	12.07.11		NO CHANGE THIS SHEET

date: 07-31-03
scale: 1/2" = 1"
dr. by: HAMID
chk. by:


drawing no.
W03-56
sheet 6 of 8

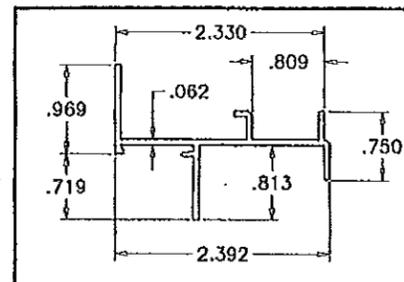


① FRAME HEAD

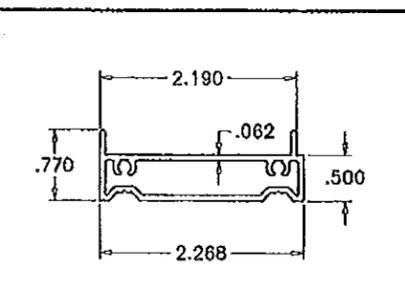


⑱ FLUSH FRAME ADAPTER

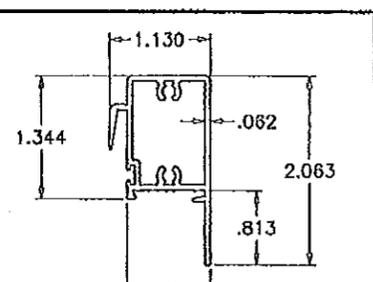


⑤ STD. VENT TOP RAIL
SERIES-1000

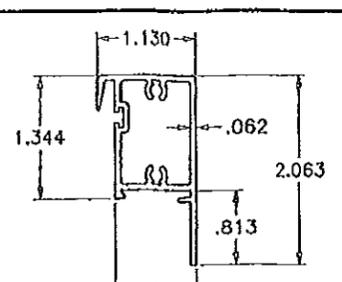


⑤B STD. VENT TOP RAIL
SERIES-1050

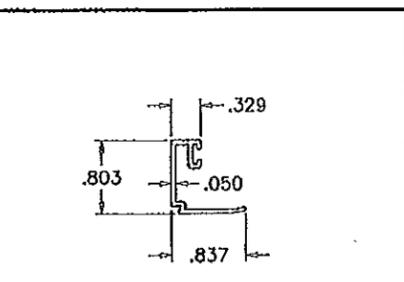


⑧A SQUARE GLAZING STOP

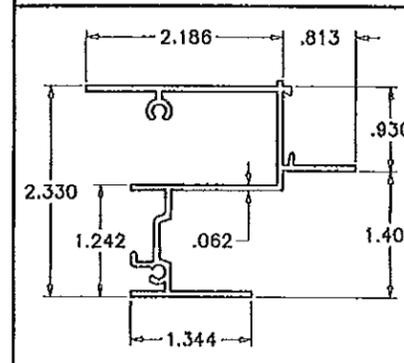


③ FRAME JAMB

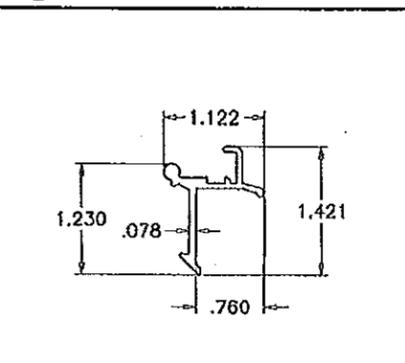


⑨ VENT LATCH

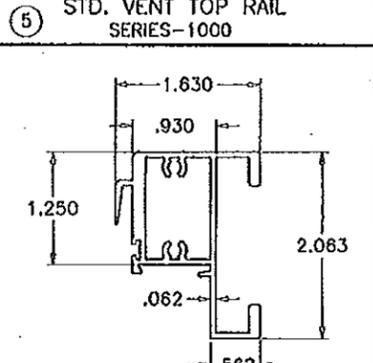


⑤A H.D. VENT TOP RAIL
SERIES-1000

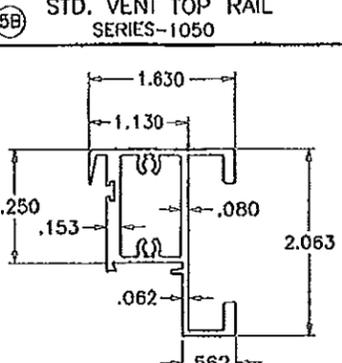


⑤B H.D. VENT TOP RAIL
SERIES-1050

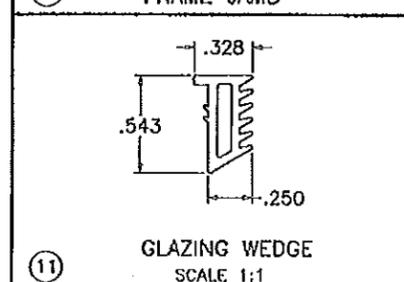


⑪ GLAZING WEDGE
SCALE 1:1

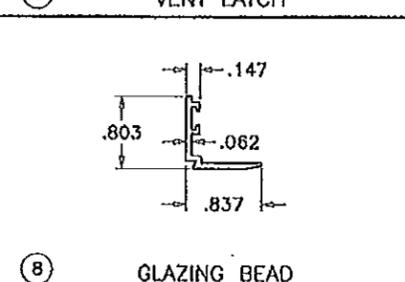


⑧ GLAZING BEAD

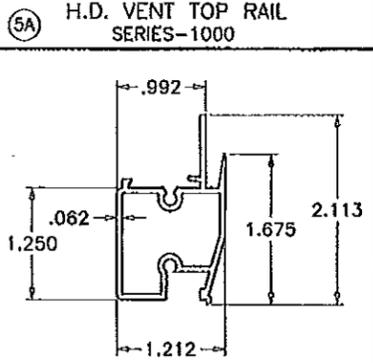


④ MEETING RAIL
SERIES-1000

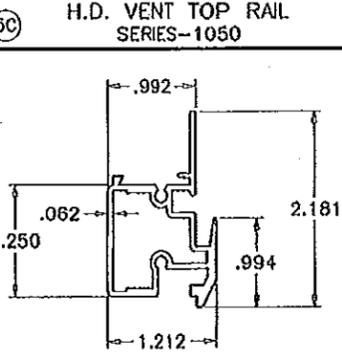


④A MEETING RAIL
SERIES-1050

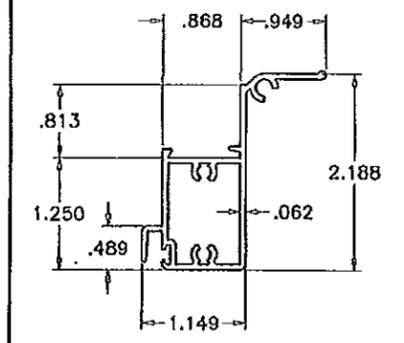


⑥ VENT BOTTOM RAIL

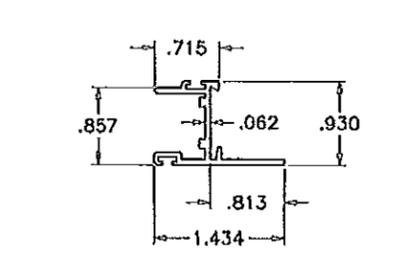

⑦ VENT SIDE RAIL

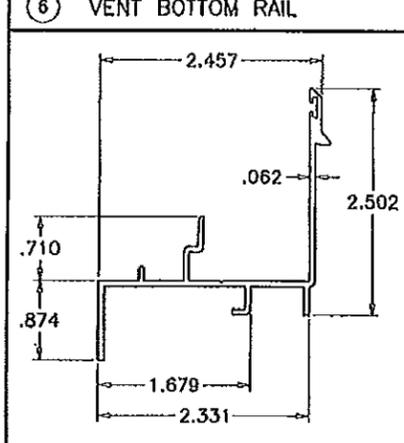

② FRAME SILL (STD.)

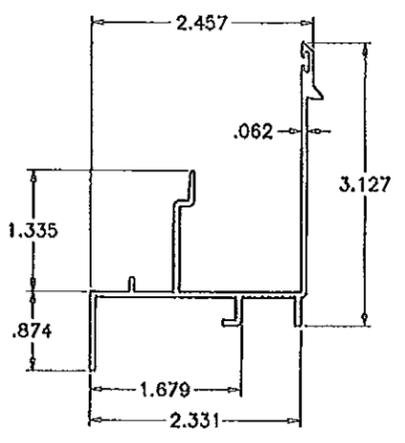

②A FRAME SILL (HI-RISE)

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W03-56ESW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL. (305) 624-7775 FAX. (305) 624-7777


no.	date	description	by
E	03.03.06	FRAME ADAPTER ADDED	
F	04.23.08	GENERAL REVISION	
G	07.15.09	LATCH OPTION ADDED	
H	12.07.11	ALT. GLAZING OPTION ADDED	

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-061727
 Expiration Date Nov 16, 2018
 By *Mameel Perez*
 Miami Dade Product Control


Engr. JAYAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. # 3538
 11/16/2011
 9 2011

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0223.42
 Expiration Date 11/26/2013
 By *Jayad Ahmad*
 Miami Dade Product Control

date: 07-31-03
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:
 drawing no.
W03-56
 sheet 7 of 8

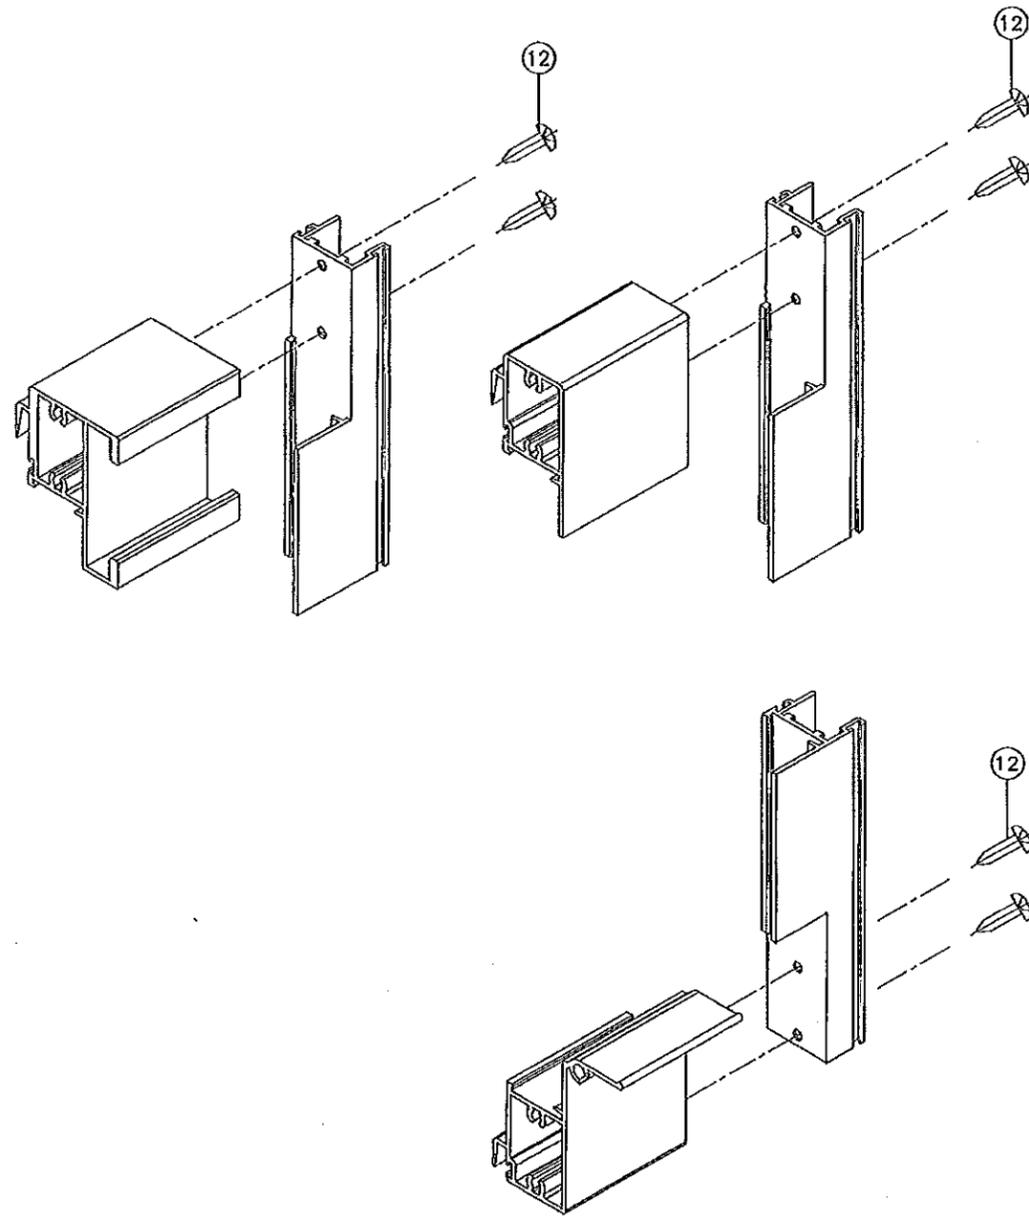


VENT CORNER DETAIL

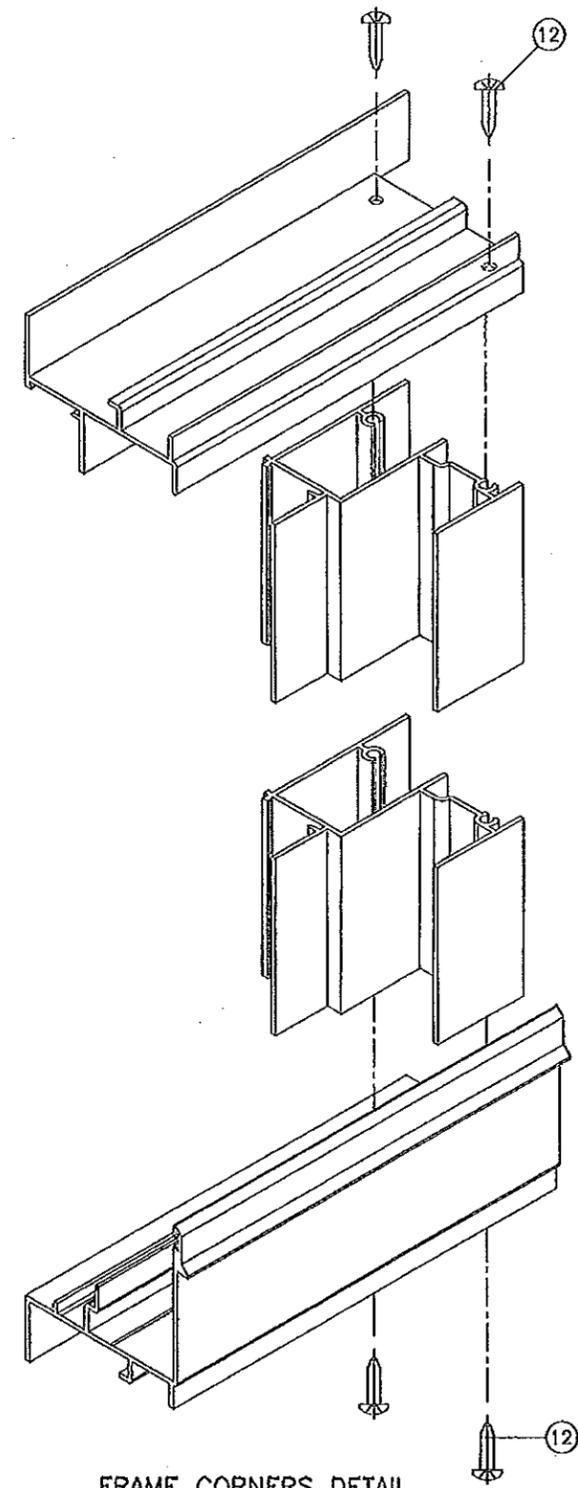

FRAME CORNERS DETAIL

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 13-0617.27
 Expiration Date Nov. 6, 2018
 By *Mamuel Cruz*
 Miami Dade Product Control



PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0223.42
 Expiration Date 11/06/2013
 By *Javad Ahmad*
 Miami Dade Product Control

DEC 9 2011

afc
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL_W03-56ESW

SERIES-1000/1050 ALUM SINGLE HUNG WDW. (L.M.I.)
E.S. WINDOWS, LLC
 5220 N.W. 72 AVE. BAY #4
 MIAMI, FL. 33166
 TEL (305) 624-7775 FAX (305) 624-7777

NO	DATE	BY	DESCRIPTION
E	03.03.06		FRAME ADAPTER ADDED
F	04.23.08		GENERAL REVISION
G	07.15.09		LATCH OPTION ADDED
H	12.07.11		NO CHANGE THIS SHEET

DATE: 07-31-03
 SCALE: 1/2" = 1"
 DR. BY: HAMID
 CHK. BY:

DRAWING NO.
W03-56

SHEET 8 OF 8