



MIAMI-DADE COUNTY
 PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Nan Ya Plastics Corporation USA
 8989 North Loop East, Suite 800
 Houston, TX 77029

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: "SPLS" Series Fiberglass Sliding Glass Doors (OXXO)-LMI

APPROVAL DOCUMENT: Drawing No. NL-008 Rev B, titled "SPLS Fiberglass Gliding", sheets 1 through 7 of 7, dated 01/23/13 and last revised on 08-06-14, prepared by manufacturer, signed and sealed by Paul E. Winter, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. Min 4" length for Stiles and top Rails and min 8" length for bottom Rails are required.
2. Glazing details and interlayer per sheet 4.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1 and E-2, as well as approval document mentioned above. The submitted documentation was reviewed by Ishaq I. Chanda, P.E.



NOA No: 13-0724.04
 Expiration Date: September 18, 2019
 Approval Date: September 18, 2014
 Page 1

9/18/14

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (submitted under file #12-0612.03/ # 08-0425.13).
2. Drawing No. NL-008 Rev B, titled "SPLS Fiberglass Gliding", sheets 1 through 7 of 7, dated 01/23/13 and last revised on 08-06-14, prepared by manufacturer, signed and sealed by Paul E. Winter, P.E.

B. TESTS

1. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 3603.2 (b) and TAS 202-94

Along with marked-up drawings and installation diagram of Fiberglass Sliding glass door (OXXO), prepared by National Certified Testing Lab, Test Report No. NCTL 210-3821-6, dated 07/06/12 and last revised on 05/08/14, signed and sealed by Gerald Ferrara, P.E.

Note: This test has been revised by an addendum letter dated 06/04/14, issued by National Certified Testing lab, signed & sealed by Gerald Ferrara, P.E.

C. CALCULATIONS


1. Anchor verification calculations and structural analysis complying per FBC 2010, dated 04/29/13 and last revised on 06/18/2014, prepared, signed and sealed by Paul E. Winter, P.E.
2. Glass complies w/ ASTM E-1300-02 & -04.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS (Original documents submitted under file #08-0425.13)

1. Test report No.ETC-05-255-16776.1, prepared by ETC Laboratories, dated 07/06/06, issued to Nan Ya Plastics Corp., for their SMC Fiberglass material / ETC05033 per ASTM D-638-03 "4500 exposed Xenon Arch" & tensile strength ASTM D-638-03 "Tensile strength", Smoke density per ASTM D2843-99, Rate of burning per ASTM D-635-98 and "Self ignition" per ASTM D1929-01, all signed and sealed by Joseph Labora Doldan, P.E.
2. Test report No.ETC-05-255-17144.0, prepared by ETC Laboratories, dated 07/03/08, issued to Nan Ya Plastics Corp., for their Rigid PVC plastic(part #ETC06024) per ASTM D1929-96 "Standard Test Method for Ignition Properties of Plastics", ASTM D2843-99 "Standard Test Method for Density of Smoke from the Burning or Decomposition of Plastics", ASTM D635-98 "Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position" and ASTM D638-03 "Standard Test Methods for Tensile Properties of Plastics" for exposed & unexposed sample per Xenon Arch after 4500 Hours, signed and sealed by Joseph Labora Doldan, P.E.



Ishaq I. Chanda, P.E.
Product Control Examiner
NOA No. 13-0724.04

Expiration Date: September 18, 2019
Approval Date: September 18, 2014

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS (continue)

3. Test report No.ETC-06-255-17412.0, prepared by ETC Laboratories, dated 04/25/06, issued to Nan Ya Plastics Corp., for their Phenolic Foam Board / ETC06013 plastic per ASTM E84-05 "*Standard Test Method for Surface Burning Characteristics of Building Materials*", signed and sealed by Joseph Labora Doldan, P.E.
4. Test report No.ETC-05-255-17412.1, prepared by ETC Laboratories, dated 04/25/06, re-issued on 06/28/06 to Nan Ya Plastics Corp., for their Phenolic Foam Board / ETC06013 plastic per ASTM E84-05 "*Standard Test Method for Surface Burning Characteristics of Building Materials*", signed and sealed by Joseph L. Doldan, P.E.
5. Test report No.ETC-05-255-17900.0, prepared by ETC Laboratories, dated 06/28/06, issued to Nan Ya Plastics Corp., for their Phenolic Foam Board / ETC06013 plastic per ASTM D1929-96 "*Standard Test Method for Ignition Properties of Plastics*", signed and sealed by Joseph L. Doldan, P.E.
6. Test report No.ETC-05-255-16776.0, prepared by ETC Laboratories, dated 01/04/06, issued to Nan Ya Plastics Corp., for their SMC / ETC05033 plastic per ASTM D1929-96 "*Standard Test Method for Ignition Properties of Plastics*", ASTM D2843-99 "*Standard Test Method for Density of Smoke from the Burning or Decomposition of Plastics*", ASTM D635-98 "*Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position*" and ASTM D638-03 "*Standard Test Methods for Tensile Properties of Plastics*", signed and sealed by Joseph Labora Doldan, P.E.
7. Test report No.ETC-05-255-16777.1, prepared by ETC Laboratories, dated 07/26/06, issued to Nan Ya Plastics Corp., for their Cellular PVC / ETC05034 plastic per ASTM D1929-96 "*Standard Test Method for Ignition Properties of Plastics*", ASTM D2843-99 "*Standard Test Method for Density of Smoke from the Burning or Decomposition of Plastics*", ASTM D635-98 "*Standard Test Method for Rate of Burning and/or Extent and Time of Burning of Self-Supporting Plastics in a Horizontal Position*" and ASTM D638-03 "*Standard Test Methods for Tensile Properties of Plastics*", signed and sealed by Joseph Labora Doldan, P.E.

F. STATEMENTS

1. Statement letter compliance to FBC 2010 and "No financial interest", dated June 30th, 2014, prepared, signed and sealed by Paul E. Winter, P.E.
2. Certificate of Authority dated May 23, 1983, to transact business, issued to Nan Ya Plastic Corporation, USA issued by the State of Texas, signed by Secretary of State.
5. Lab compliance letter as part of above test reports.

G. OTHER

1. None



Ishaq I. Chanda, P.E.

Product Control Examiner

NOA No. 13-0724.04

Expiration Date: September 18, 2019

Approval Date: September 18, 2014

NAN YA PLASTICS CORPORATION, USA

L.M. IMPACT 6'-11" SERIES

"SPLS" FIBERGLASS GLIDING

PATIO DOORS W/ SIDELITES OXXO

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN EVALUATED AND TO COMPLY WITH THE CURRENT PROVISIONS OF THE FLORIDA BUILDING CODE (FBC) STRUCTURAL REQUIREMENTS INCLUDING THE "HIGH VELOCITY HURRICANE ZONES" (HVHZ) AND IS BASED ON THE FOLLOWING TESTS:
 - TAS-202-94
 - TAS-201-94
 - TAS-203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE / MASONRY AND 2X FRAMING PER INSTALLATION ON SHEETS 3 AND 4 AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE FOUNDATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
3. PROPERLY SECURED 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD FOR THE PROJECT OF INSTALLATION.
4. THE INSTALLATION DETAILS DESCRIBED HEREIN ARE GENERIC AND MAY NOT REFLECT ACTUAL CONDITIONS FOR A SPECIFIC SITE, IF THE INSTALLATION METHODS DEVIATE FROM THESE APPROVED DETAILS:
 - A. INSIDE HVHZ: ONE TIME SITE SPECIFIC APPROVAL TO BE APPLIED AND OBTAINED FROM MIAMI DADE COUNTY PRODUCT CONTROL DIVISION.
 - B. OUTSIDE HVHZ: LICENSED ENGINEER OR ARCHITECT TO SUBMIT SITE SPECIFIC DOCUMENTS TO AUTHORITY HAVING JURISDICTION (AHJ) FOR APPROVAL.
5. ALL SETTING BLOCKS AND GASKET MATERIALS SHALL BE IN COMPLIANCE WITH SECTION 2411.3.4 OF THE FLORIDA BUILDING CODE.
6. IN NON-HVHZ AREAS WHERE WINDBORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN IMPACT PROTECTIVE SYSTEM COMPLYING WITH THE FBC REQUIREMENTS FOR WINDBORNE DEBRIS REGIONS IS NOT REQUIRED FOR THE PRODUCT(S) HEREIN.
7. FRAME AND PANEL MATERIAL:
FIBERGLASS/PVC/WOOD AND FOAM
8. GLASS MEETS THE REQUIREMENTS OF ASTM E1300 SEE GLAZING DETAIL ON SHEET 4 OF 7 AND SHALL MEET SAFETY GLAZING REQUIREMENTS PER FBC SECTION 2406.
9. DESIGNATIONS "X", "O" STAND FOR THE FOLLOWING:
X: OPERABLE
O: FIXED

INSTALLATION NOTES:

1. ONE (1) INSTALLATION ANCHOR IS REQUIRED AT EACH ANCHOR LOCATION SHOWN.
2. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION.
3. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE OF 1/4 INCH. SHIM WHERE SPACE OF 1/8 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY LOAD BEARING PLASTIC OR BETTER.
4. FOR INSTALLATION INTO WOOD FRAMING, USE #12 WOOD SCREWS OF SUFFICIENT LENGTH TO ACHIEVE 1 1/2 INCH MINIMUM EMBEDMENT.
5. FOR INSTALLATION THROUGH 1X BUCK TO CONCRETE/MASONRY, OR DIRECTLY INTO CONCRETE/MASONRY, USE 1/4 INCH I.T.W. ADVANCED THREADFORM TECHNOLOGY OF SUFFICIENT LENGTH TO ACHIEVE 1 1/4 INCH MINIMUM EMBEDMENT INTO CMU AND 1 1/2 INCH MINIMUM EMBEDMENT INTO CONCRETE.
6. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES, (INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER, SHEATHING AND SIDING).
7. INSTALL CONCRETE/MASONRY SCREWS IN ACCORDANCE WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS.
8. INSTALLATION ANCHORS AND ASSOCIATED HARDWARE MUST BE MADE OF CORROSION RESISTANT MATERIAL OR HAVE A CORROSION RESISTANT COATING.
9. FOR HOLLOW BLOCK AND GROUT FILLED BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
10. INSTALLATION ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW.
11. INSTALLATION ANCHOR CAPACITIES FOR PRODUCTS HEREIN ARE BASED ON SUBSTRATE MATERIALS WITH THE FOLLOWING PROPERTIES:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF 0.55
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 2700 PSI.
 - C. MASONRY BLOCK - MINIMUM NET COMPRESSIVE STRENGTH OF 1900 PSI.

TABLE OF CONTENTS		
SHEET	REVISION	SHEET DESCRIPTION
1	-	GENERAL AND INSTALLATION NOTES
2	-	ELEVATION & ANCHOR LAYOUT
3	-	VERTICAL SECTIONS
4	-	HORIZONTAL SECTIONS
5	-	COMPONENTS
6	-	COMPONENTS
7	-	BILL OF MATERIALS

	DESIGN PRESSURE RATING		IMPACT RATING
	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED	WHERE WATER INFILTRATION REQUIREMENT IS NOT NEEDED	
POSITIVE	+50.0 PSF	+50.0 PSF	LARGE AND SMALL MISSILE IMPACT
NEGATIVE	-50.0 PSF	-50.0 PSF	

LEGEND:

- O.A.- OVERALL
- D.L.O.- DAY LIGHT OPENING
- O.C.- ON CENTER
- TYP.- TYPICAL
- ▷ - INDICATES SPECIFIC NOTE ON SAME SHEET CORRESPONDING TO THE LETTER DESIGNATION INDICATED IN FLAG.

APPROVED BY:	DATE:
B	AS REQUESTED PER MIAMI-DADE 07/23/14
A	AS REQUESTED PER MIAMI-DADE 05/06/14
REV	DESCRIPTION DATE BY

NAN YA PLASTICS CORP., USA

8989 NORTH LOOP EAST - HOUSTON TEXAS 77029

FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES
GENERAL AND INSTALLATION NOTES


DATE: 01/23/13
DRN: JM
SCALE: N.T.S.
REV: B
SHEET: 1 of 7

PREPARED BY:
Paul E. Winter, P.E.
4762 Parkstone Drive,
Rockledge, Florida 32955
Phone 321-243-8010


PAUL E. WINTER,
Florida P.E. No. 22893

Paul E. Winter, P.E.
4762 Parkstone DR
Rockledge, Florida 32955

Approved as complying with the
Florida Building Code
Date: SEP 18, 2014
NOA# 13-0724-104
Miami Dade Product Control
By: [Signature]

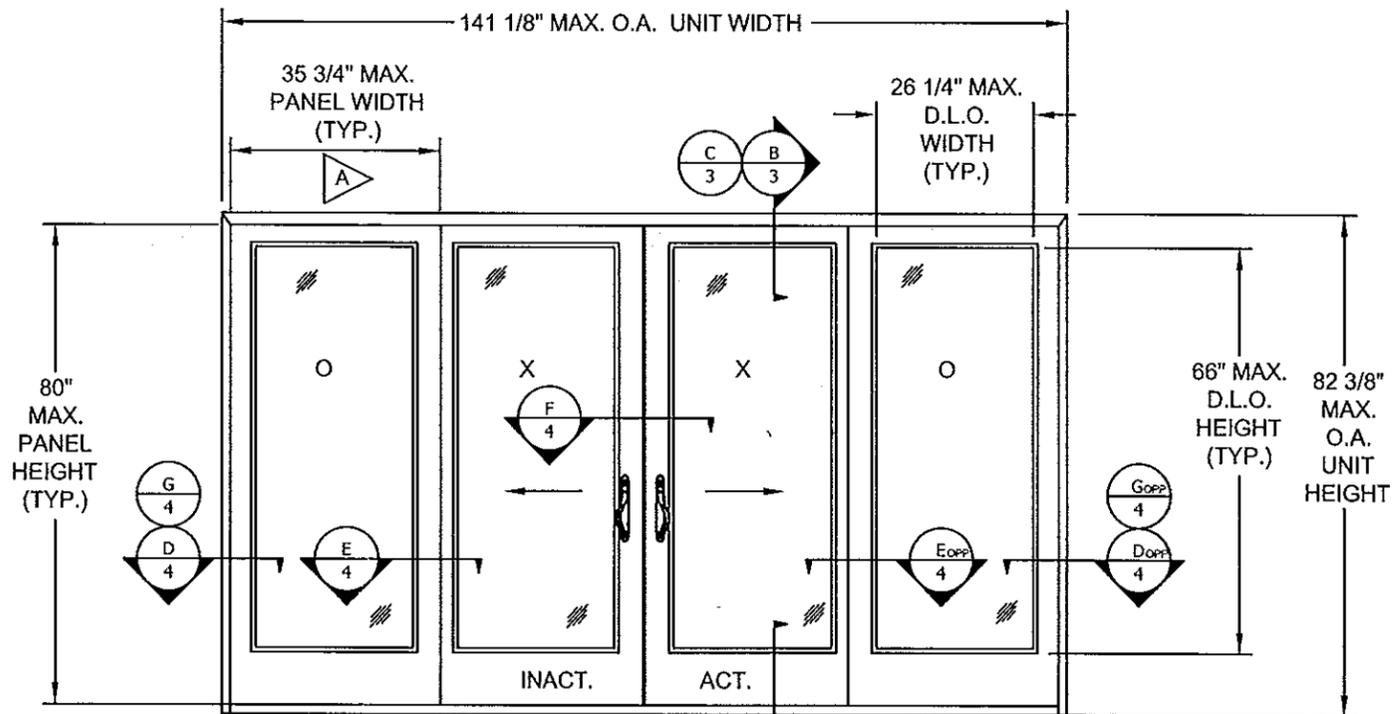

ELEVATION (OXXO)
(EXTERIOR ELEVATION)

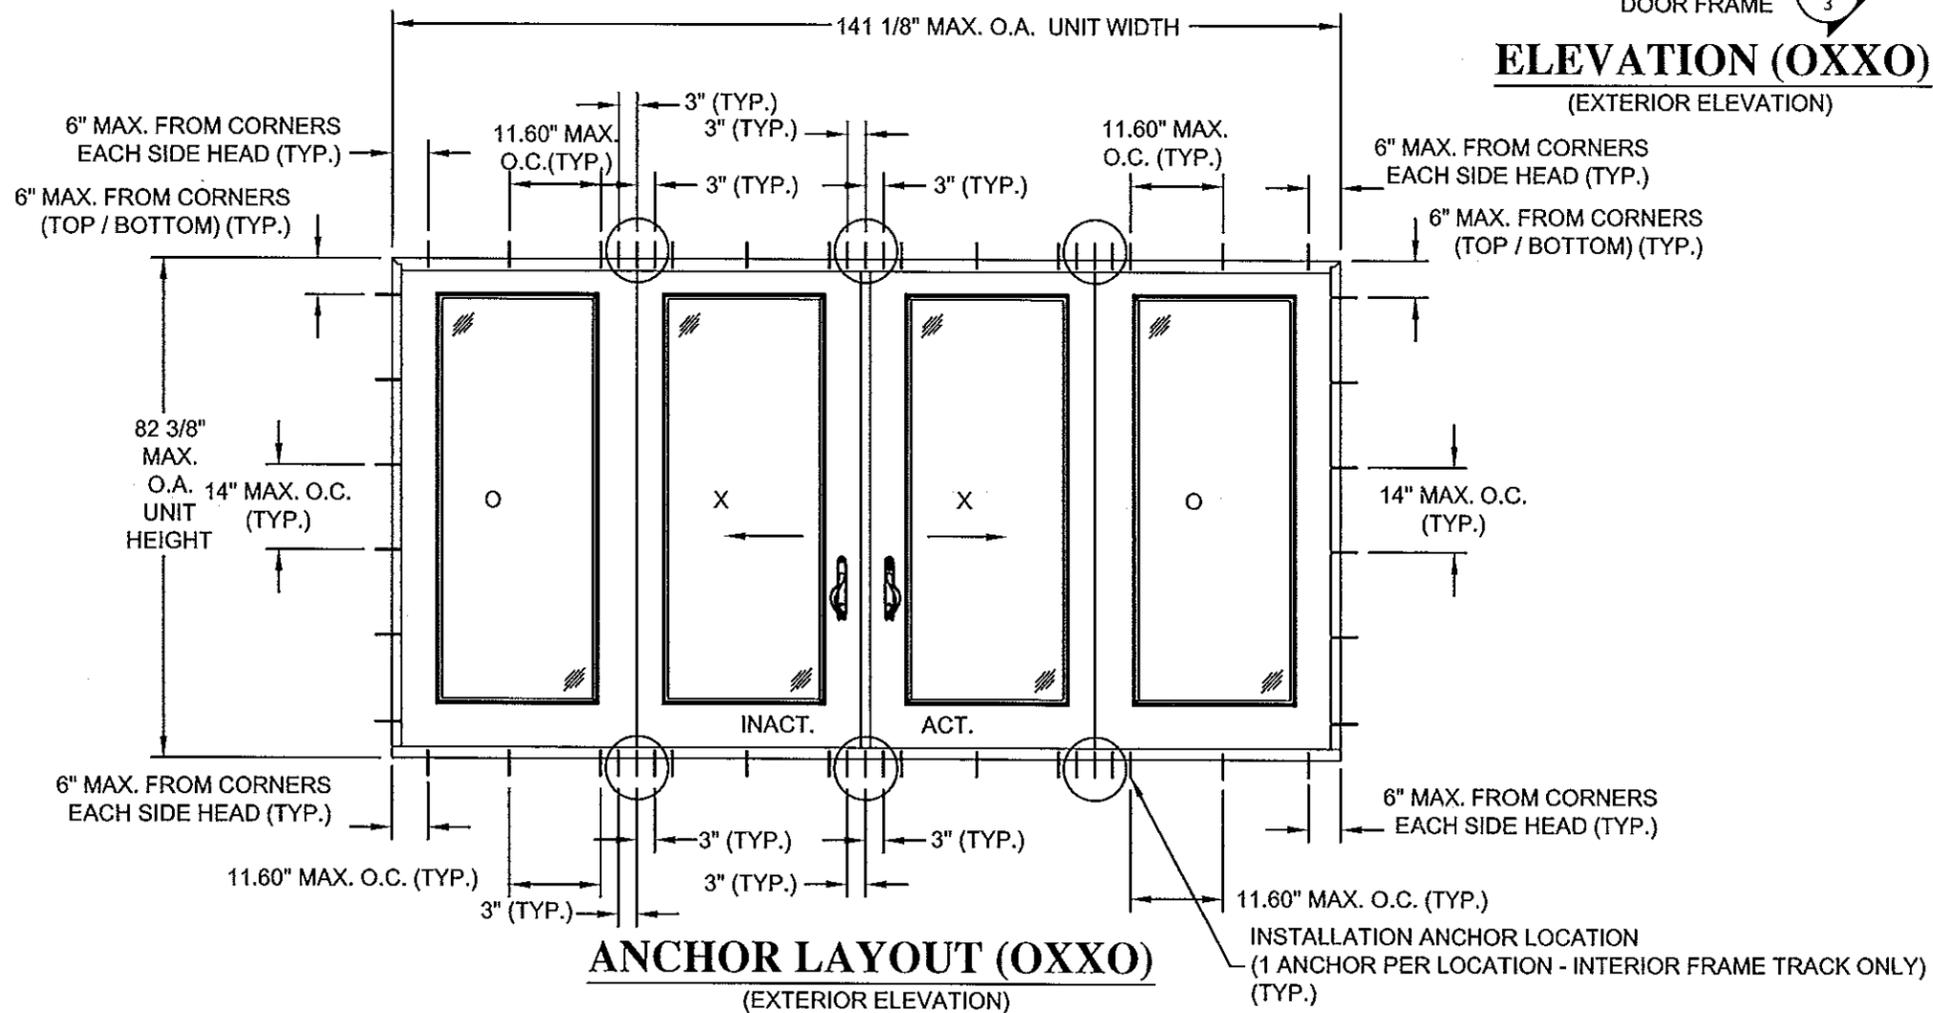

ANCHOR LAYOUT (OXXO)
(EXTERIOR ELEVATION)

INSTALLATION ANCHOR LOCATION
(1 ANCHOR PER LOCATION - INTERIOR FRAME TRACK ONLY)
(TYP.)

APPROVED BY:	DATE:
B	AS REQUESTED PER MIAMI-DADE 07/23/14 JM
A	AS REQUESTED PER MIAMI-DADE 05/06/14 JM
REV	DESCRIPTION DATE BY




NAN YA PLASTICS CORP, USA		DATE:	01/23/13
8989 NORTH LOOP EAST - HOUSTON TEXAS 77029		DWG. NO:	NL-0008
TITLE: FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES		SCALE:	N.T.S.
ELEVATION & ANCHOR LAYOUT		REV:	B
DRN:	JM	SHEET:	2 of 7
PREPARED BY:	Paul E. Winter, P.E. 4762 Parkstone Drive, Rockledge, Florida 32955 Phone 321.263.8070		

PAUL E. WINTER,
Florida-P.E. No. 22693

Paul E. Winter

Paul E. Winter, P.E.
4762 Parkstone DR.
Rockledge, Florida 32955

Approved as complying with the
Florida Building Code
Date: 9/18/14
NOA: 13-0724-04
Miami-Dade Product Control
By: *[Signature]*

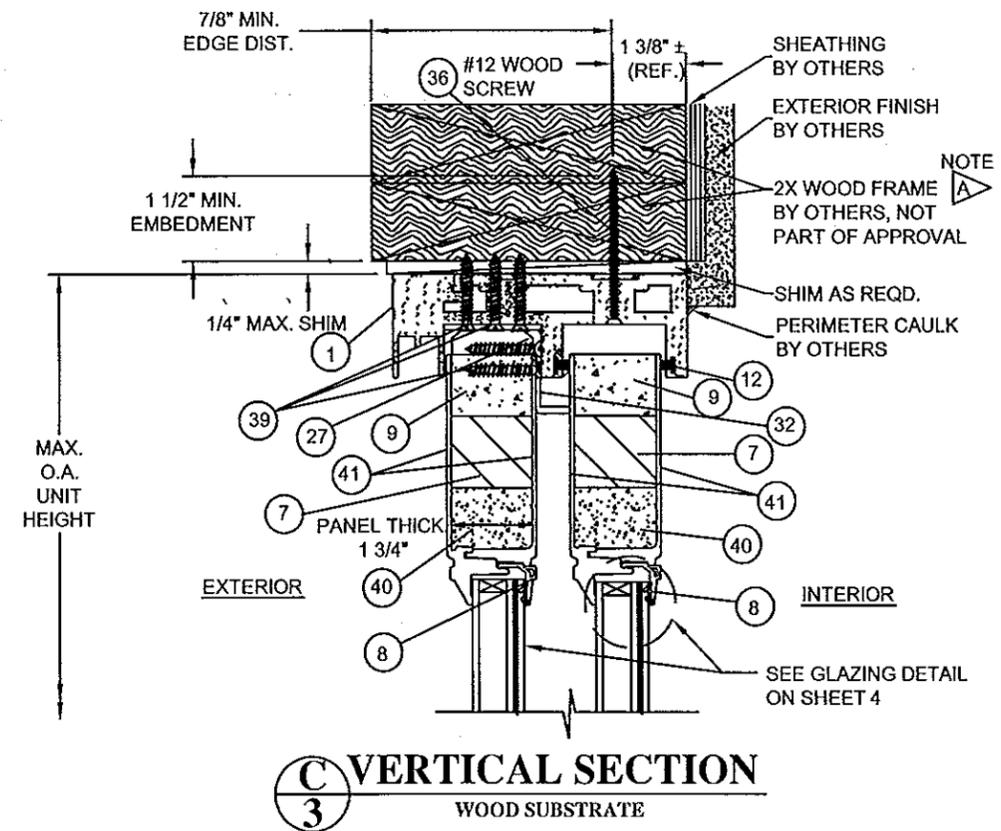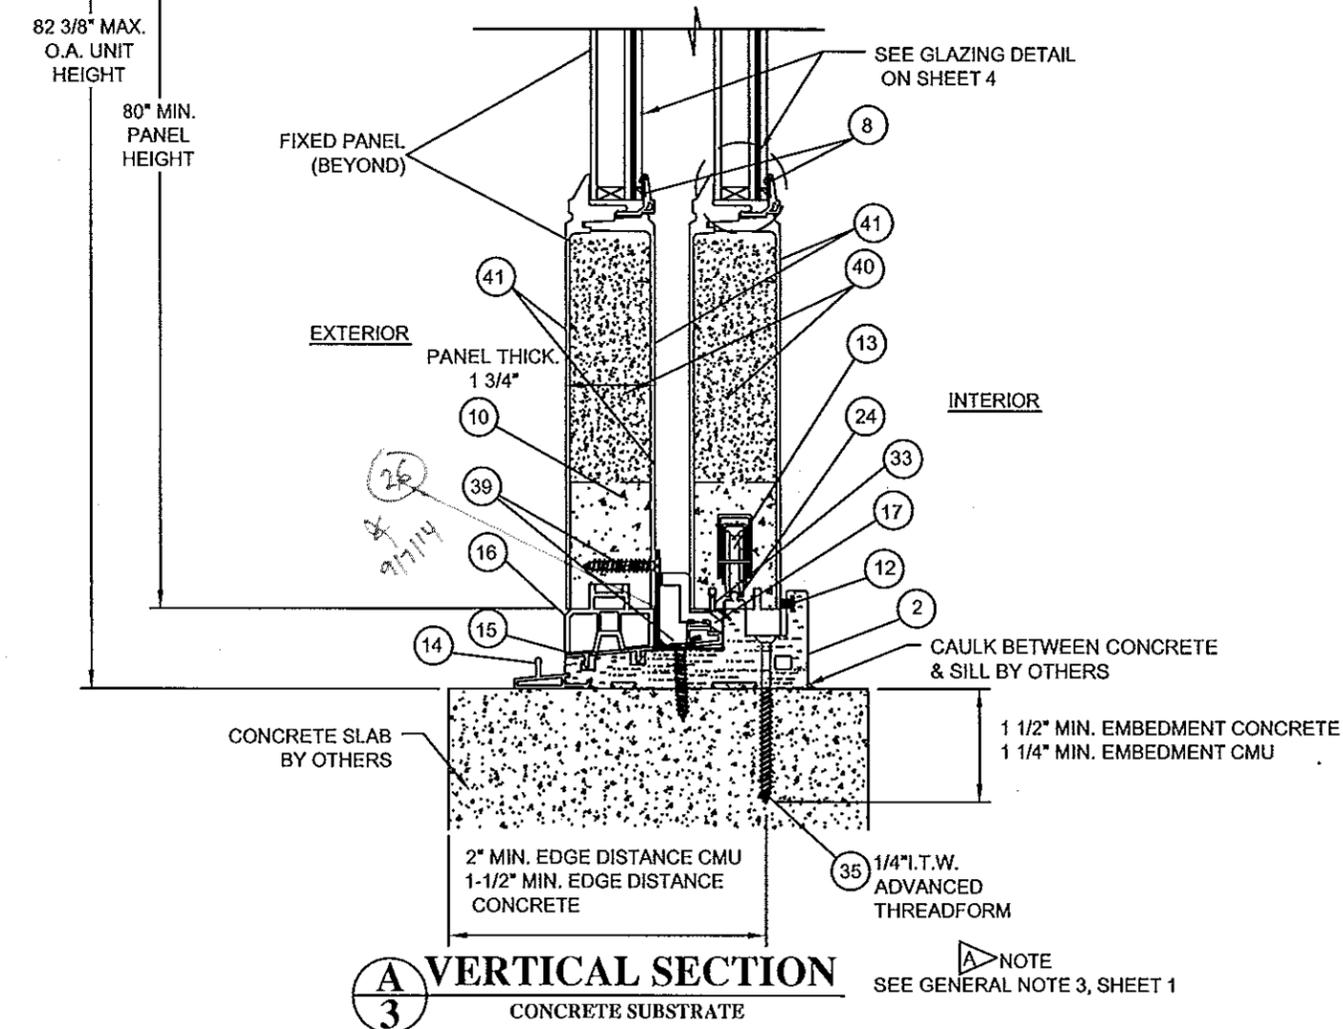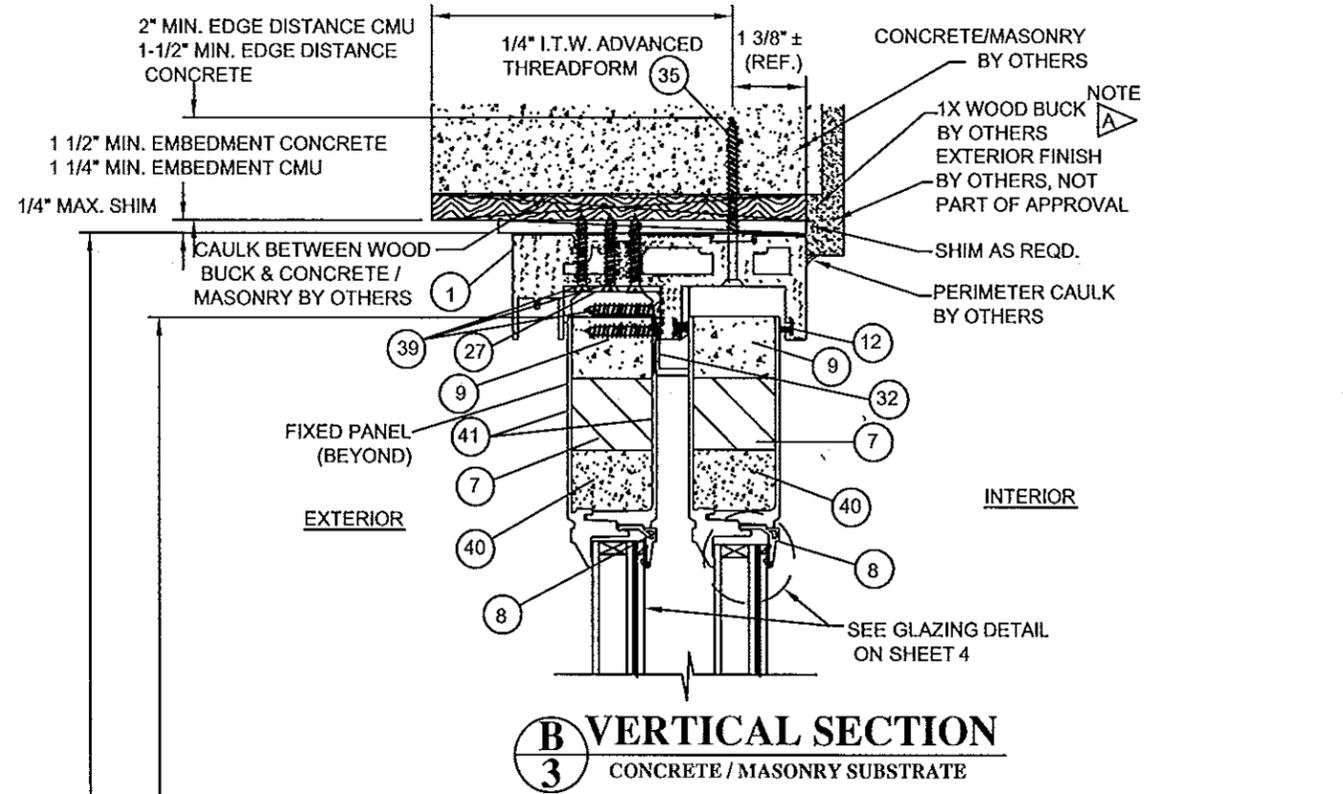

SPECIFIC NOTE:

WOOD FRAME, PROPERLY SECURED 1X WOOD BUCK AND CONCRETE SLAB MUST PROVIDE FULL SUPPORT FOR DOOR FRAME.

APPROVED BY:	DATE:
B	07/23/14
A	05/06/14
REV	DESCRIPTION
	DATE
	BY


NAN YA PLASTICS CORP, USA		8989 NORTH LOOP EAST - HOUSTON TEXAS 77029	
TITLE: FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES		VERTICAL SECTIONS	
DRN:	JM	DATE:	01/23/13
SCALE:	N.T.S.	DWG. NO.:	NL-0008
REV:	B	SHEET:	3 of 7
PREPARED BY: Paul E. Winter, P.E. 4762 Parkstone Drive, Rockledge, Florida 32955 Phone 321.243.8010			

PAUL E. WINTER,
Florida P.E. No. 22693

PAUL E. WINTER, P.E.
4762 Parkstone DR.
Rockledge, Florida 32955


Approved as complying with
Florida Building Code
Date 9/18/14
NOM 12-0724-04
Miami Dade Product Control
By [Signature]

1/4" MAX. SHIM
 MAX. O.A. UNIT WIDTH
 1 1/4" MIN. EMBEDMENT CMU
 1 1/2" MIN. EMBEDMENT CONCRETE

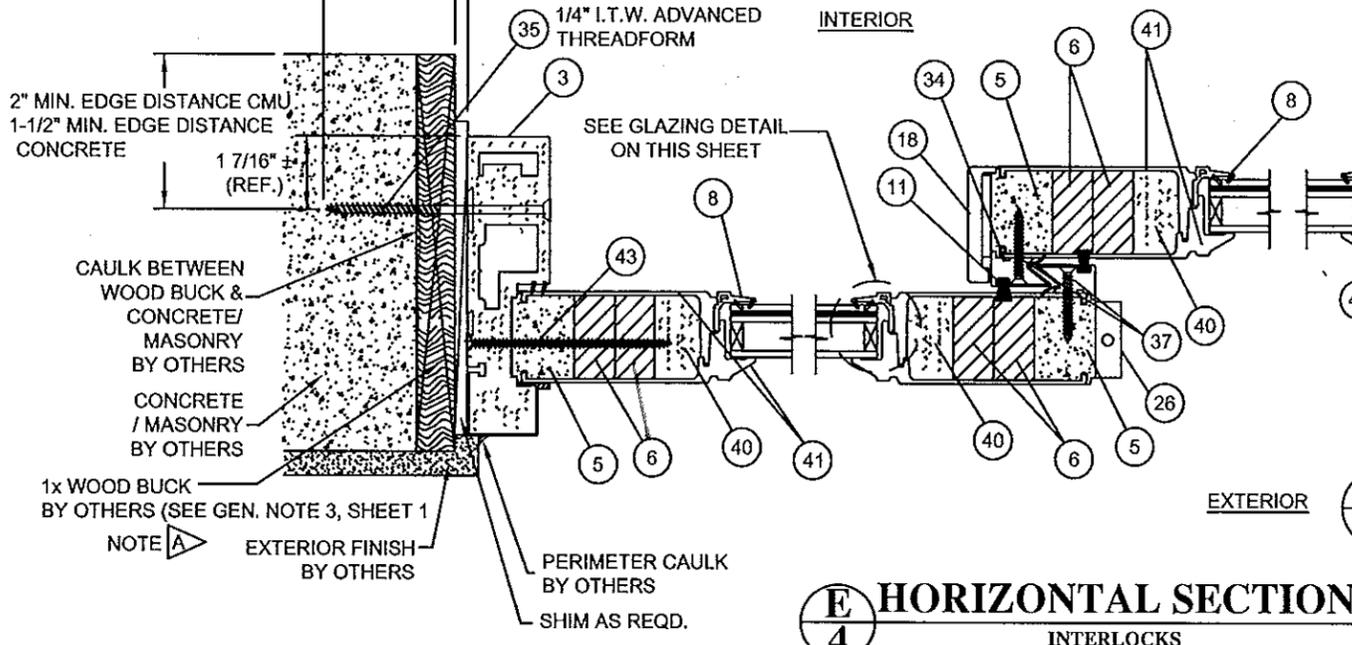


D
 4
HORIZONTAL SECTION
 CONCRETE / MASONRY SUBSTRATE

E
 4
HORIZONTAL SECTION
 INTERLOCKS

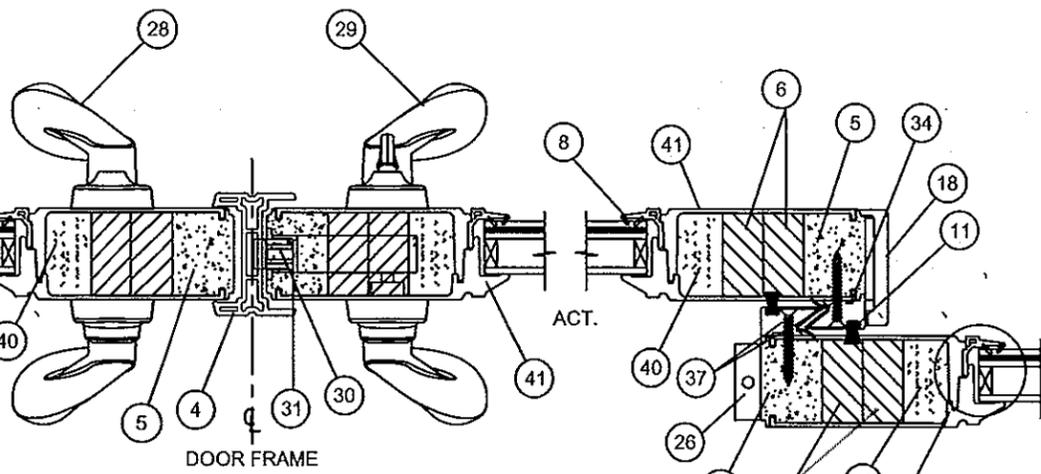


F
 4
HORIZONTAL SECTION
 ASTRAGAL

E
 4
HORIZONTAL SECTION
 INTERLOCKS (OPPOSITE)

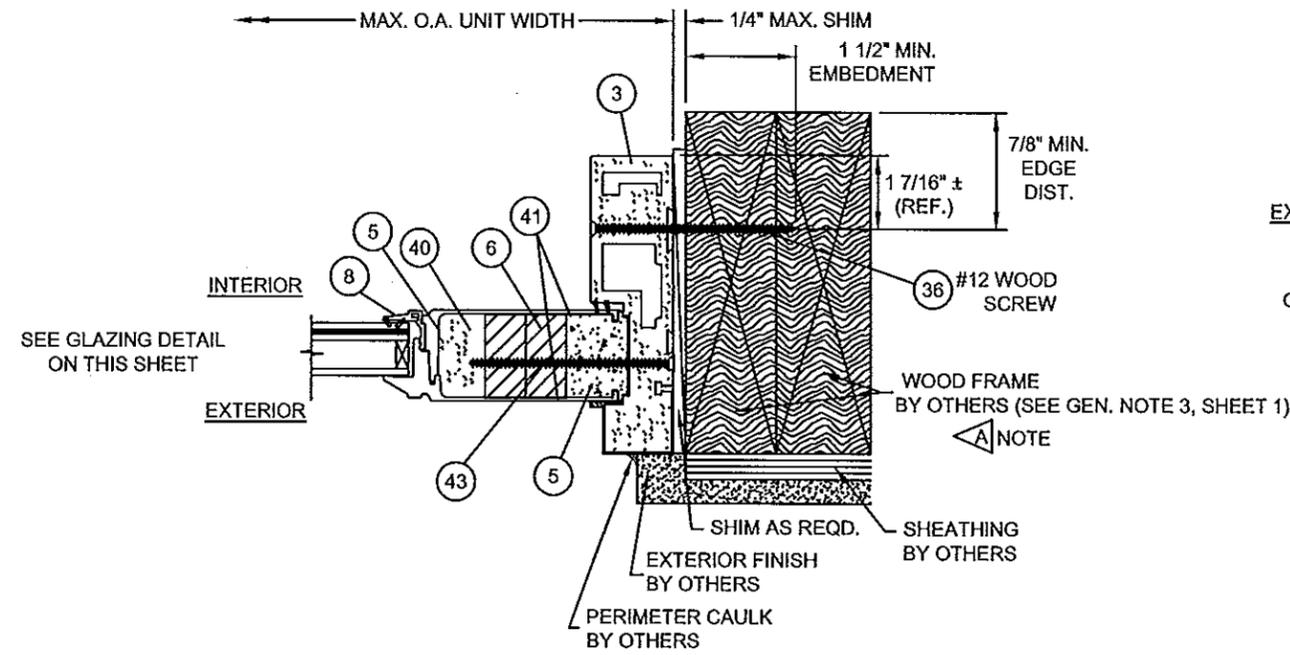

G
 4
HORIZONTAL SECTION
 WOOD SUBSTRATE

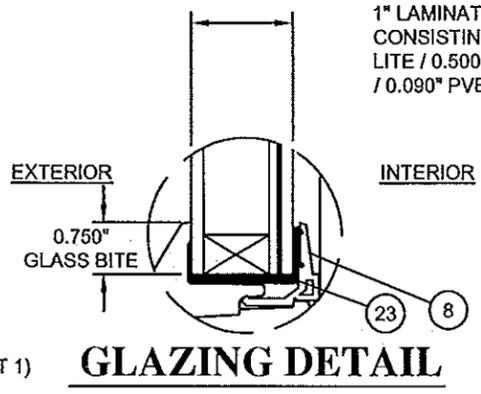

GLAZING DETAIL

1" LAMINATED INSULATED UNIT BY CARDINAL GLASS
 CONSISTING OF 1/8" TEMPERED GLASS OUTBOARD
 LITE / 0.500" ALUMINUM SPACER BAR / 1/8" ANNEALED GLASS
 / 0.090" PVB BY DUPONT / 1/8" ANNEALED GLASS


SPECIFIC NOTE:
 A WOOD FRAME AND 1X WOOD BUCK MUST PROVIDE
 FULL SUPPORT FOR DOOR FRAME.

APPROVED BY:	DATE:
B	AS REQUESTED PER MIAMI-DADE 07/23/14, PW
A	AS REQUESTED PER MIAMI-DADE 05/06/14, JM
REV	DESCRIPTION
NAN YA PLASTICS CORP, USA 8989 NORTH LOOP EAST - HOUSTON TEXAS 77029 TITLE: FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES HORIZONTAL SECTIONS PREPARED BY: PORN: JM DATE: 01/23/13 SCALE: N.T.S. DWG. NO: NL-0008 REV: N.T.S. SHEET: 4 of 7 Paul E. Winter, P.E. 4762 Parkstone Drive, Rockledge, Florida 32955 Phone 321.263.8010	

PAUL E. WINTER,
 Florida P.E. No. 22693

 Paul E. Winter, P.E.
 4762 Parkstone Dr.
 Rockledge, Florida 32955

Approved as complying with
 Florida Building Code
 Date: 9/16/14
 NOM: 13-0124-04
 Miami Code Enforcement
 By:

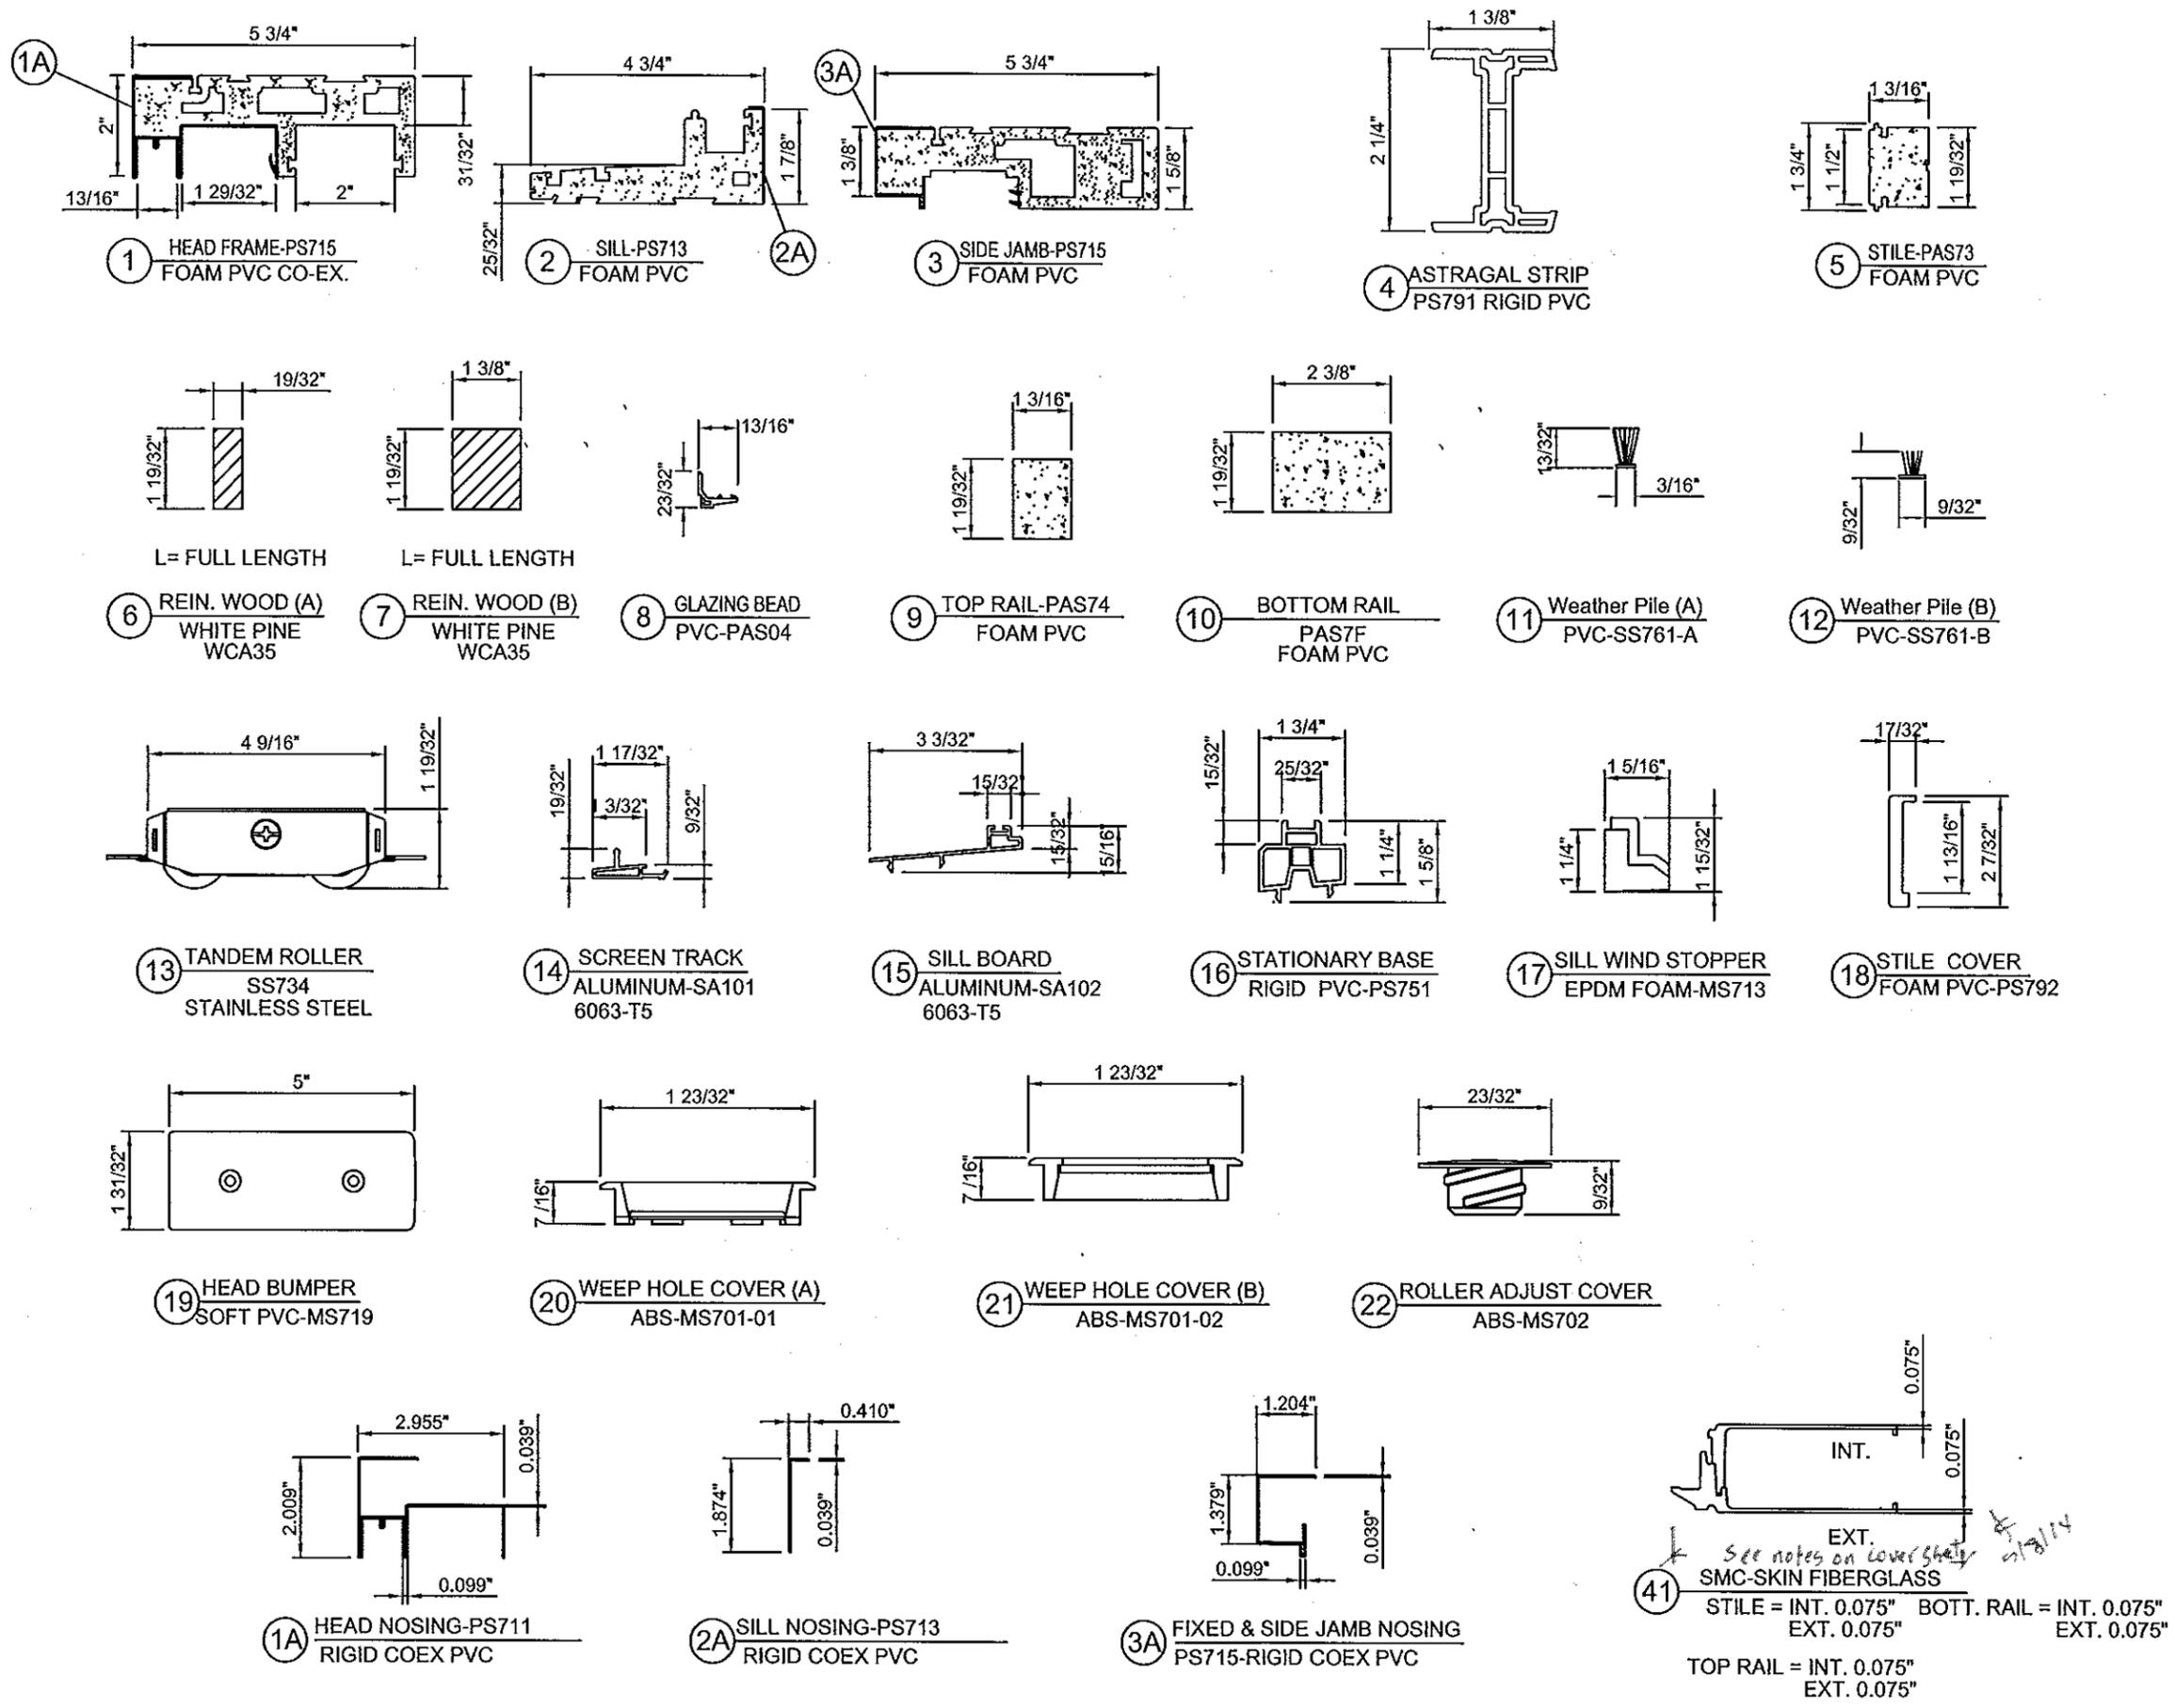

APPROVED BY:	DATE:
B	AS REQUESTED PER MIAMI-DADE 07/23/14 PW
A	AS REQUESTED PER MIAMI-DADE 05/06/14 JM
REV	DESCRIPTION
5 of 7	DATE BY

NAN YA PLASTICS CORP, USA
 8989 NORTH LOOP EAST - HOUSTON TEXAS 77029
 TITLE: FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES COMPONENTS


PREPARED BY: Paul E. Winter, P.E.
 4762 Parkstone Drive,
 Rockledge, Florida 32955
 Phone 321.243.8010

DATE: 01/23/13
 DWG. NO: NL-0008
 SCALE: N.T.S.
 SHEET: 5 of 7


PAUL E. WINTER,
 Florida P.E. No. 22693

Paul E. Winter, P.E.
 4762 Parkstone DR,
 Rockledge, Florida 32955


Approved as complying with Florida Building Code
 Date: 9/18/14
 NOA: 23-0724700
 Miami Dade Product Control
 By: [Signature]




24 SILL TRACK
NYB-R-TDAS
STAINLESS STEEL

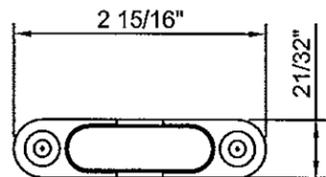


25 ANTI-LIFT BLOCK
DIE CASTING-SS716




26 BOTTOM BRACKET
STAINLESS STEEL
SS723




27 TOP BRACKET
STAINLESS STEEL
SS724




28 HANDLE SETS(A)
DIE CASTING
SS725 (A)




29 HANDLE SETS(B)
DIE CASTING
SS725 (B)




30 LOCK KEEPER
DIE CASTING-SS732
MICOTA TECH CO. TLD

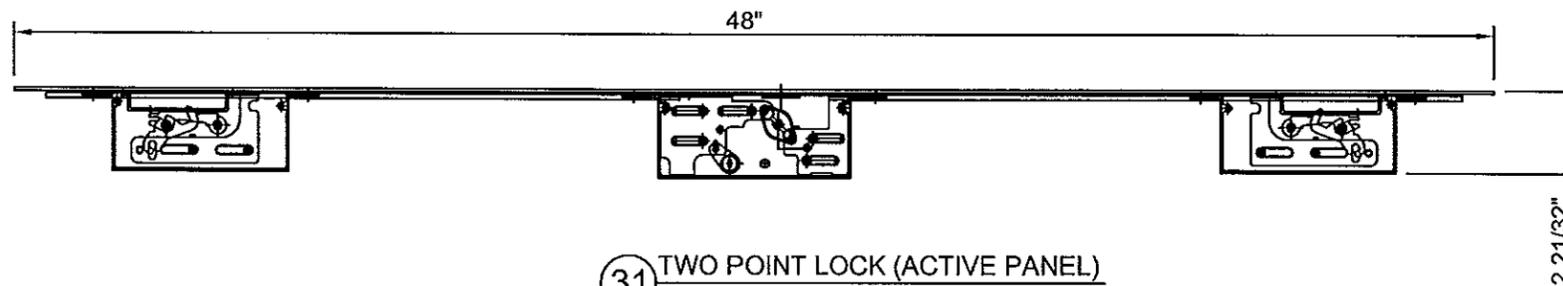


31 TWO POINT LOCK (ACTIVE PANEL)
STAINLESS STEEL-SS721
JAM YUAN ENTERPRISE CO. TLD



32 TOP WIND STOPPER
EPDM FOAM-MS712



33 WEATHERSTRIP
SOFT PVC-PS045

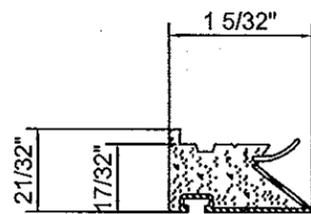

34 INTERLOCK STRIP
FOAM PVC-PS746

REV	DESCRIPTION	DATE
B	AS REQUESTED PER MIAMI-DADE	07/23/14 PW
A	AS REQUESTED PER MIAMI-DADE	05/06/14 JM

NAN YA PLASTICS CORP, USA
8989 NORTH LOOP EAST - HOUSTON TEXAS 77029

TITLE: FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES COMPONENTS

PREPARED BY: Paul E. Winter, P.E.
4762 Parkstone Drive,
Rockledge, Florida 32955
Phone 321.243.8010

DATE: 01/23/13
DRN: JM
SCALE: N.T.S.
DWG. NO: NL-0008
REV: B
SHEET: 6 of 7

PAUL E. WINTER,
Florida P.E. No. 22693

Paul E. Winter

PAUL E. WINTER, P.E.
4762 Parkstone DR,
Rockledge, Florida 32955

Approved as complying with
Florida Building Code
Date: 9/15/14
NOA# 13-0724-04
Miami Dade Product Control
By: *Isaac J. Lopez*

1	PS711	HEAD FRAME	FY MIN. = 6019 PSI	FOAM PVC CO-EX	1	NAN YA PLASTICS
1A	PS711	HEAD FRAME NOSING		RIGID PVC	1	NAN YA PLASTICS
2	PS713	SILL	FY MIN. = 6019 PSI	FOAM PVC CO-EX	1	NAN YA PLASTICS
2A	PS713	SILL NOSING		RIGID PVC	1	
3	PS715	SIDE JAMB	FY MIN. = 6019 PSI	FOAM PVC CO-EX	2	NAN YA PLASTICS
3A	PS715	SIDE JAMB NOSING		RIGID PVC	2	NAN YA PLASTICS
4	PS791	ASTRAGAL STRIP	FY MIN. = 6019 PSI	RIGID PVC	1	NAN YA PLASTICS
5	PAS73	STILE		FOAM PVC	8	NAN YA PLASTICS
6	WCA35	REINFORCED WOOD (A)		WHITE PINE	16	DENG XAV
7	WCA35	REINFORCED WOOD (B)		WHITE PINE	4	DENG XAV
8	PAS04	GLAZING BEAD	FY MIN. = 6019 PSI	PVC	16	NAN YA PLASTICS
9	PAS74	TOP RAIL	FY MIN. = 6019 PSI	FOAM PVC	4	NAN YA PLASTICS
10	PAS7F	BOTTOM RAIL	FY MIN. = 6019 PSI	FOAM PVC	4	NAN YA PLASTICS
11	SS761-A	WEATHER PILE (A)		PVC	4	TIN FU YI
12	SS761-B	WEATHER PILE (B)		PVC	3	TIN FU YI
13	SS734	TENDEM ROLLER ASSEMBLY		STAINLESS STEEL	4	MICOTA
14	SA101	SCREEN TRACK		ALUMINUM 6063-T5	1	TA WEI ALUM. PROD. CO. LTD
15	SA102	SILL BOARD		ALUMINUM 6063-T5	1	TA WEI ALUM. PROD. CO. LTD
16	PS751	STATIONARY BASE	FY MIN. = 6019 PSI	RIGID PVC	2	NAN YA PLASTICS
17	MS713	SILL WIND STOPPER		EPDM FOAM	1	NAN YA PLASTICS
18	PS792	STILE COVER		FOAM PVC	1	NAN YA PLASTICS
19	MS719	HEAD BUMPER		SOFT PVC	1	NAN YA PLASTICS
20	MS701-01	WEEP HOLE COVER (A)		ABS	2	NAN YA PLASTICS
21	MS701-02	WEEP HOLE COVER (B)		ABS	2	NAN YA PLASTICS
22	MS702	ROLLER ADJUST COVER		ABS	4	NAN YA PLASTICS
23	PURCHASE	DOW CORNING 995		STRUCTURAL SEALANT	AS REQD	DOW CORNING
24	NYB-R-TDAS	SILL TRACK COVER		STAINLESS STEEL	1	PURCHASE
25	SS716	ANTI-LIFT BLOCK		DIE CASTING	2	JIU-CHUAN LOCK CO., LTD
26	SS723	BOTTOM BRACKET		STAINLESS STEEL	2	JIU-CHUAN LOCK CO., LTD
27	SS724	TOP BRACKET		STAINLESS STEEL	2	JIU-CHUAN LOCK CO., LTD
28	SS725 (A)	HANDLE SETS (A)		DIE CASTING	1	MICOTA TECH CO., LTD
29	SS725 (B)	HANDLE SET (B)		DIE CASTING	1	MICOTA TECH CO., LTD
30	SS732	LOCK KEEPER		DIE CASTING	1	MICOTA TECH CO., LTD
31	SS721	MULTI-POINT LOCK		STAINLESS STEEL	1	JIU-CHUAN LOCK CO., LTD
32	MS712	TOP WIND STOPPER		EPDM FOAM	1	NAN YA PLASTICS
33	PS045	WEATHERSTRIP		SOFT PVC	AS REQ'D	NAN YA PLASTICS
34	PS746	INTERLOCK STRIP		FOAM PVC	4	NAN YA PLASTICS
35	PURCHASE	1/4" I.T.W. ADVANCED T.T. (INSTALLATION ANCHOR)		CARBON STEEL	AS REQ'D	ELCO
36	PURCHASE	#12 WOOD SCREW (INSTALLATION ANCHOR)		CARBON STEEL	AS REQ'D	JOHN CHEN SCREW CO. LTD
37	PURCHASE	#10 X 1" PHILLIPS FLAT HEAD		STAINLESS STEEL	AS REQ'D	JOHN CHEN SCREW CO. LTD
38	PURCHASE	#10 X 1" ROUND HEAD S.M.S.		STAINLESS STEEL	AS REQ'D	JOHN CHEN SCREW CO. LTD
39	PURCHASE	#10 X 1 1/2" PHILLIPS FLAT HEAD S.M.S.		CARBON STEEL	AS REQ'D	JOHN CHEN SCREW CO. LTD
40	PHENO	PU FOAM PHENOLIC FOAM		PU/ PHENOLIC	AS REQ'D	DENG XAV
41	INP40	SMC SKIN FY= 11,000 PSI MIN. tmin= 0.075"		FIBERGLASS	AS REQ'D	NAN YA PLASTICS
42	PURCHASE	1" O.A. I.G. -1/8" TEMP.- AIR- 5 /16" ANN. LAM. -090 PVB-DUPONT		GLASS	AS REQ'D	PURCHASE
43	PURCHASE	#10 X 3" PHILLIPS FLAT HEAD S.M.S.		CARBON STEEL	AS REQ'D	JOHN CHEN SCREW CO. LTD

APPROVED BY:		DATE:	
B	AS REQUESTED PER MIAMI-DADE	07/23/14	PW
A	AS REQUESTED PER MIAMI-DADE	05/06/14	JM
REV	DESCRIPTION		DATE
<p>NAN YA PLASTICS CORP, USA</p> <p>8989 NORTH LOOP EAST - HOUSTON TEXAS 77029</p> <p>TITLE: FIBERGLASS GLIDING FRENCH PATIO DOOR W/ SIDELITES BILL OF MATERIALS</p> <p>PREPARED BY: Paul E. Winter, P.E. 4762 Parkstone Drive. Rockledge, Florida 32955 Phone 321.243.8910</p> <p>DATE: 01/23/13 DWS. NO: NL-0008 SCALE: N.T.S. SHEET: 7 of 7</p>			
<p>PAUL E. WINTER, Florida P.E. No. 22593</p> <p>Paul E. Winter, P.E. 4762 Parkstone DR. Rockledge, Florida 32955</p>			
<p>Approved as complying with Florida Building Code SEP 12 2014 NOV 13 2014 By: [Signature]</p>			