



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**Amarr Garage Doors**  
**125 Carriage Court**  
**Winston-Salem, NC 27105**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Model 950 Heritage & 655 Oak Summit 1000, 2000 Steel Sectional Garage Door up to 9'-0" Wide with Impact Windows (DP +45.3, -51.2 PSF)**

**APPROVAL DOCUMENT:** Drawing No. **IRC-9509-169-15-G**, titled "Model 950 Heritage & Model 655 Oak Summit, (24 GA) 1000, 2000, Short, Long, Flush and Oak Summit Panels", sheets 1 through 3 of 3, dated 03/12/2013, prepared by Amarr Garage Doors, signed and sealed by Tomas L. Shelmerdine, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** A permanent label with the manufacturer's name or logo, 3800 Greenway Circle, Lawrence, Kansas, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above. The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*[Handwritten Signature]*  
10/03/2013

NOA No 13-0813.23  
Expiration Date: October 10, 2018  
Approval Date: October 10, 2013  
Page 1

Amarr Garage Doors

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **IRC-9509-169-15-G**, titled "Model 950 Heritage & Model 655 Oak Summit, (24 GA) 1000, 2000, Short, Long, Flush and Oak Summit Panels", sheets 1 through 3 of 3, dated 03/12/2013, prepared by Amarr Garage Doors, signed and sealed by Thomas L. Shelmerdine, P.E.

**B. TESTS**

1. Addendum to Test Report No. **ATLNC 0318.01-13**, prepared by American Test Lab, Inc., dated 07/16/2013, signed and sealed by David W. Johnson, P.E.
2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
4) Tensile Test per ASTM E8  
5) Forced Entry Resistance Test per FBC, TAS 202-94  
along with marked-up drawings and installation diagram of 9' x 7' 24 ga steel garage door Model 950, prepared by American Test Lab, Inc., Test Report No. **ATLNC 0318.01-13**, dated 05/01/2013, signed and sealed by David W. Johnson, P.E.
3. Test report on Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments per ASTM D1654 & ASTM B117, prepared by Architectural Testing, Inc., Test Report No. **C5463.01-106-18**, dated 04/03/2013, signed and sealed by Gary T. Hartman, P.E. "*Submitted under NOA # 13-0503.07*"

**C. CALCULATIONS**

1. Anchor calculations prepared by Structural Solutions, P.A., dated 07/17/2013, signed and sealed by Thomas L. Shelmerdine, P.E.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **12-1231.10** issued to **Eastman Chemical Company (MA)** for their "**Saflex Clear and Color Glass Interlayers**" approved on 03/28/2013, expiring on 05/21/2016.

**F. STATEMENTS**

1. Statement letter of code conformance to 2010 FBC and no financial interest issued by Structural Solutions, PA., dated 07/17/2013, signed and sealed by Tomas L. Shelmerdine, P.E.

  
10/03/2013

Carlos M. Utrera, P.E.

Product Control Examiner


NOA No 13-0813.23

Expiration Date: October 10, 2018



Approval Date: October 10, 2013

**SPECIFICATIONS AND NOTES**

1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +203.9 LBS/FT & -230.4 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. (.0216) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. DOORS UP TO 7'0" HIGH CONSIST OF (4) SECTIONS AS SHOWN. USE (2) 3" 20 GA STRUTS PER SECTION
6. DOORS OVER (4) SECTIONS REFER TO TABLES 1 AND 2 ON PAGE 3.
7. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.
8. THIS APPROVAL REQUIRES THE MANUFACTURER TO DO TESTING OF ALL COILS USED TO FABRICATE DOOR PANELS UNDER THIS NOTICE OF ACCEPTANCE. A MINIMUM OF 2 SPECIMENS SHALL BE CUT FROM EACH COIL AND TENSILE TESTED ACCORDING TO ASTM E-8 BY A DADE COUNTY APPROVED LAB SELECTED AND PAID BY THE MANUFACTURER. EVERY 3 MONTHS, 4 TIMES A YEAR, THE MANUFACTURER SHALL MAIL TO THIS OFFICE: A COPY OF THE TEST REPORTS WITH CONFIRMATION THAT THE SPECIMENS WERE SELECTED FROM COILS AT THE MANUFACTURER PRODUCTION FACILITIES. AND A NOTARIZED STATEMENT FROM THE MANUFACTURER THAT ONLY COILS WITH YIELD STRENGTH OF 32,000 PSI OR MORE SHALL BE USED TO MAKE DOOR PANELS FOR DADE COUNTY UNDER THIS NOTICE OF ACCEPTANCE.

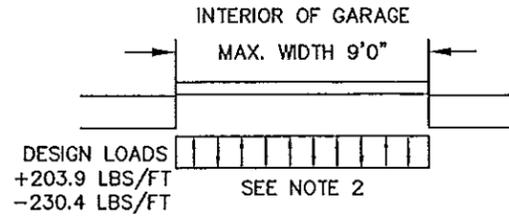


OPTIONAL SHORT PANEL GLAZED SECTION STRUT AND STILE LAYOUTS  
N.T.S.

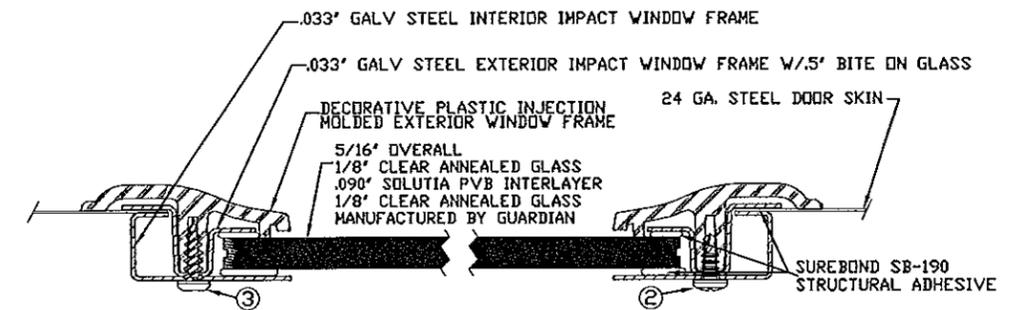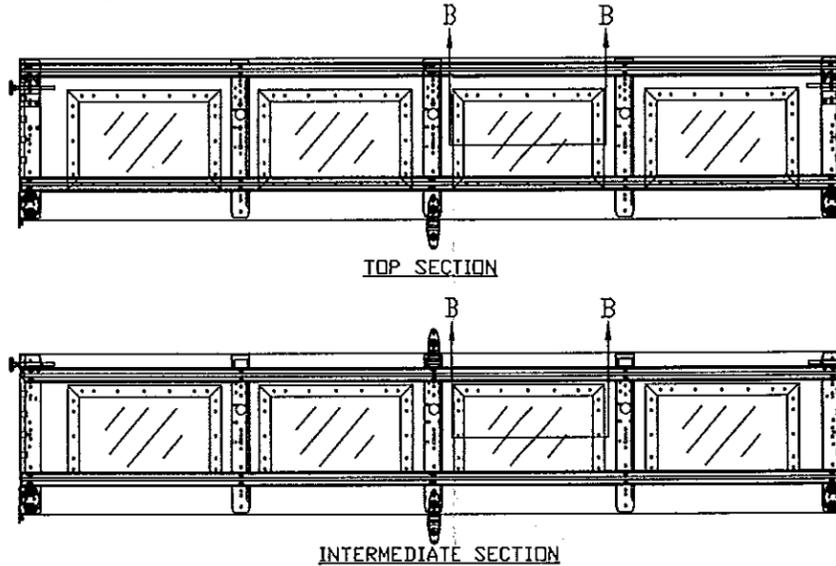


2. 3/16" X 1/2" SCREW - USED TO FASTEN THE STEEL EXTERIOR IMPACT WINDOW FRAME TO THE STEEL INTERIOR IMPACT WINDOW FRAME.
3. 11/64" X 1/2" SCREW - USED TO FASTEN DECORATIVE PLASTIC MOLDED WINDOW FRAME TO THE ASSEMBLY

SECTION B-B IMPACT WINDOW DETAIL  
N.T.S.

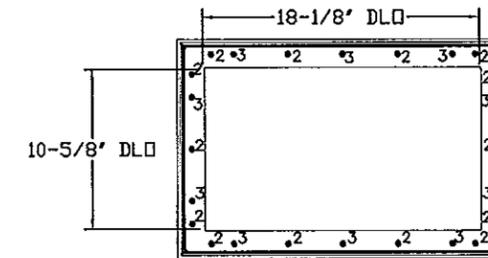

IMPACT GLAZING FASTENER DETAIL  
N.T.S.  
GLAZING MEETS ASTM E1300-04

Approved as complying with the Florida Building Code  
Date 10/10/2013  
NOA# 13-0813-23  
Miami Dade Product Control  
By *[Signature]*

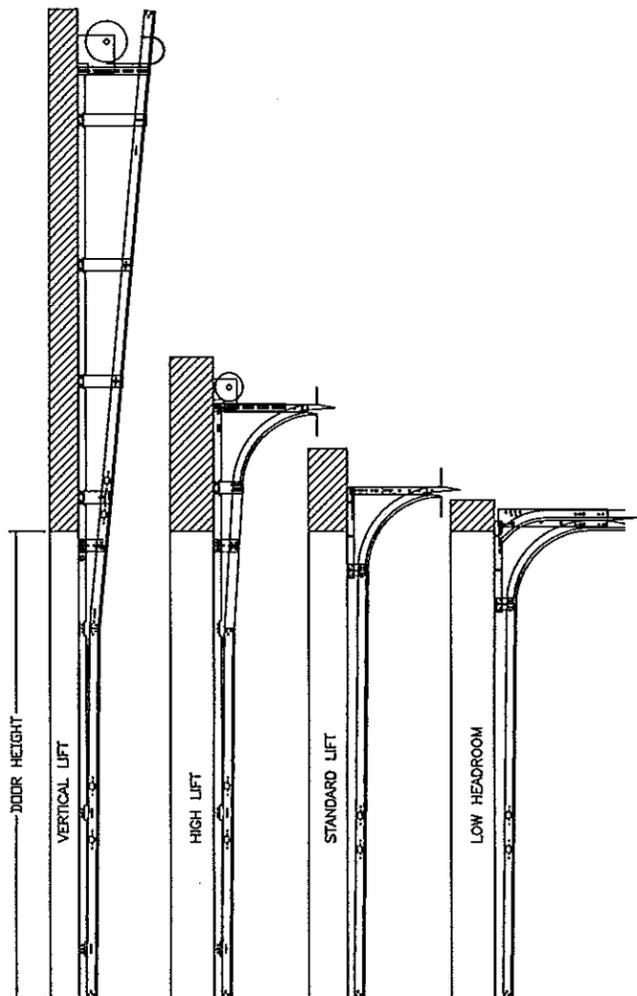


AVAILABLE TRACK CONFIGURATIONS  
N.T.S.


**WOOD JAMB ATTACHMENT TO STRUCTURE**

- 2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE  
5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS THEN 24" O.C. (1 1/2" EMBEDMENT)
- 2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE  
HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)  
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 20" O.C. (1 1/4" EMBEDMENT)  
ITW/RANSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)
- 2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK  
SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART) AT 16" O.C. (1 1/2" EMBEDMENT)  
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART) AT 16" O.C. (1 1/4" EMBEDMENT)
- 2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)  
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 24" O.C. (1 1/4" EMBEDMENT) (OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)


- \*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
- \*PREPARATION OF WOOD JAMBS BY OTHERS

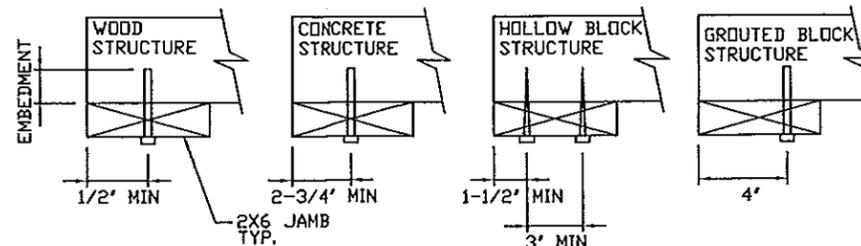


| REV  | DESCRIPTION OF REVISIONS         | DATE          | BY                |
|--|----------------------------------|---------------|-------------------|
|  |                                  |               |                   |
|  | MAX SIZE 9' x 14'                |               |                   |
|  | DESIGN LOADS +45.3 PSF -51.2 PSF |               |                   |
|  | LARGE MISSILE IMPACT RESISTANCE  |               |                   |
|  |                                  |               |                   |
|  |                                  |               |                   |
| 165 CARRIAGE COURT WINSTON-SALEM, NC. 27105 WWW.AMARR.COM<br>MODEL 950 HERITAGE (24 GA) 1000, 2000<br>MODEL 655 OAK SUMMIT (24 GA) 1000, 2000<br>SHORT, LONG, FLUSH, AND OAK SUMMIT PANELS |                                  |               |                   |
| SIZE   | DRAWN BY RLR                     | DATE 03/12/13 | DRAWING NUMBER    |
| B  | CHECKED BY                       | DATE          | IRC-9509-169-15-G |
|  |                                  |               | SHEET 2 OF 3      |

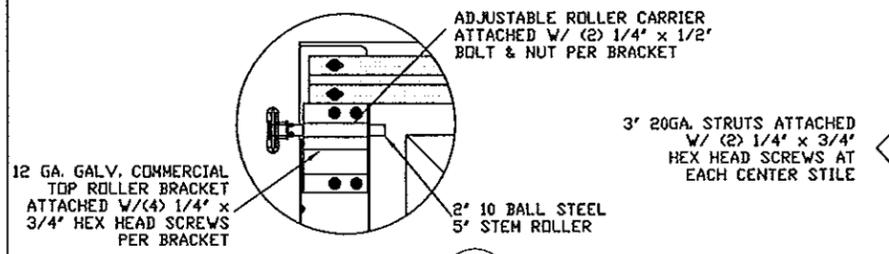


TYPICAL TOP FIXTURES  
N.T.S.

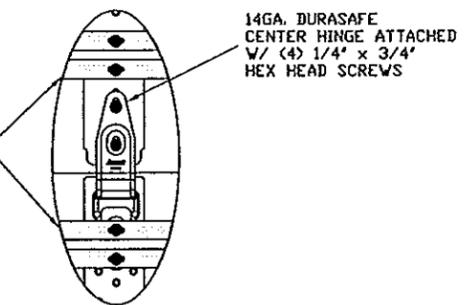


TYPICAL DURASAFE CENTER HINGE  
N.T.S.

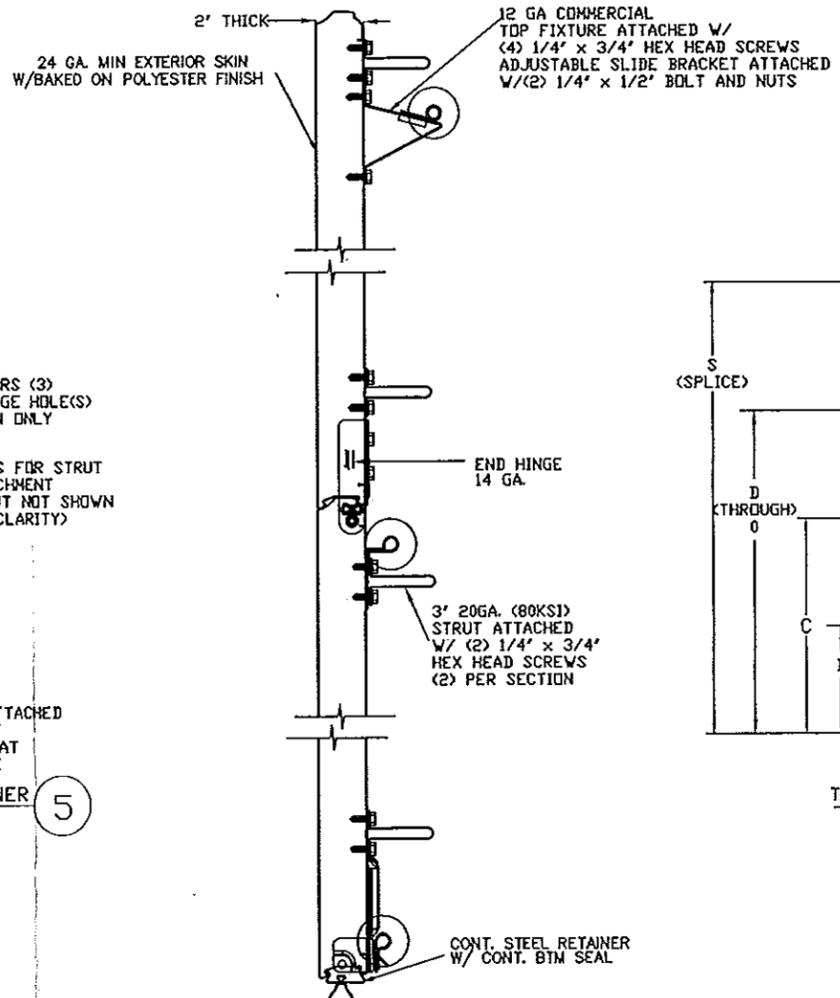


SECTION A-A (SIDE VIEW)  
N.T.S.

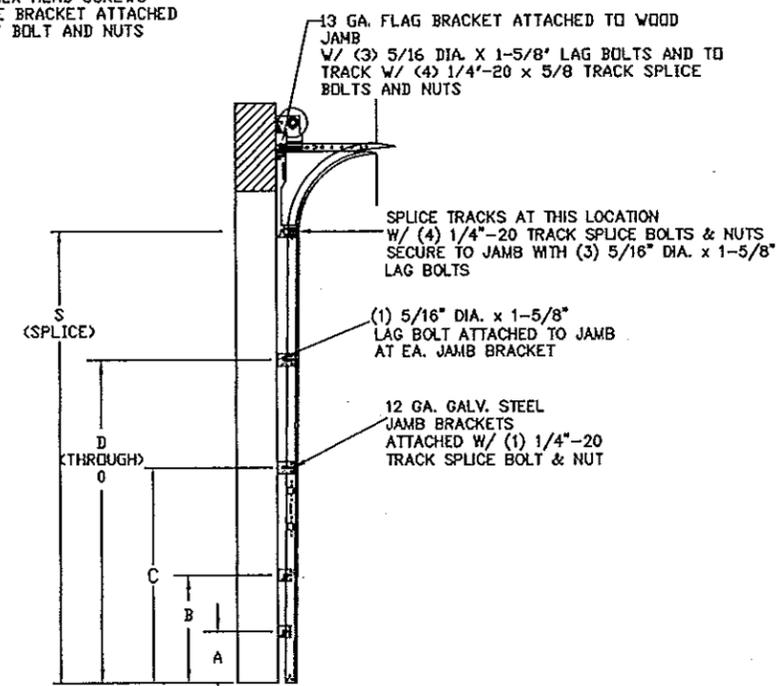


SEE (TABLE 3) ON PAGE 3 FOR JAMB BRACKET SPACING  
TRACK CONFIGURATION FOR 6'6\"/>

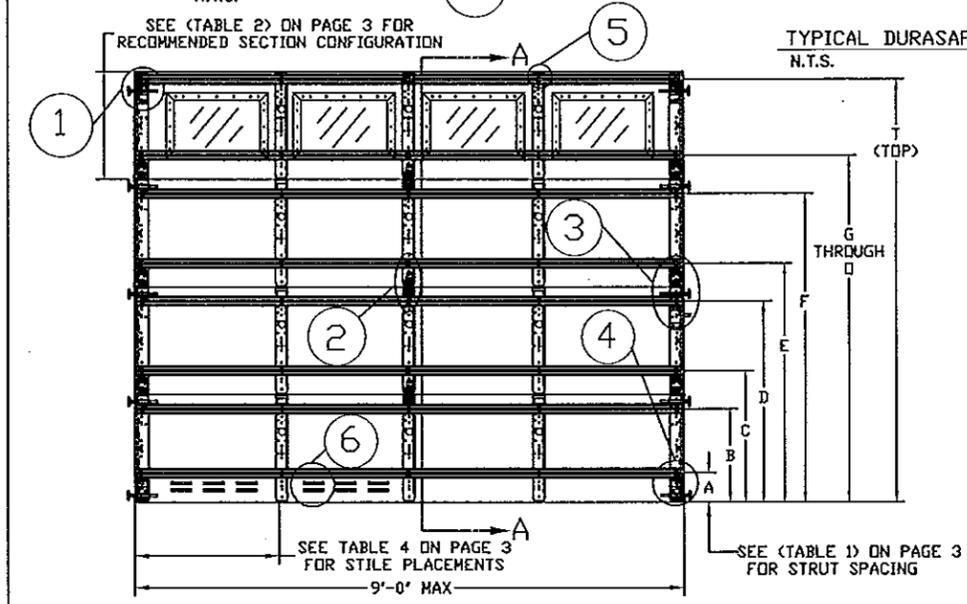


INSIDE ELEVATION  
N.T.S.

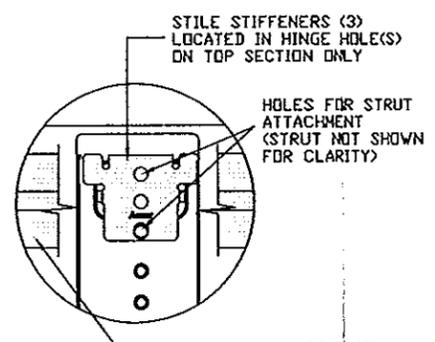

TYPICAL STILE STIFFENER  
N.T.S.

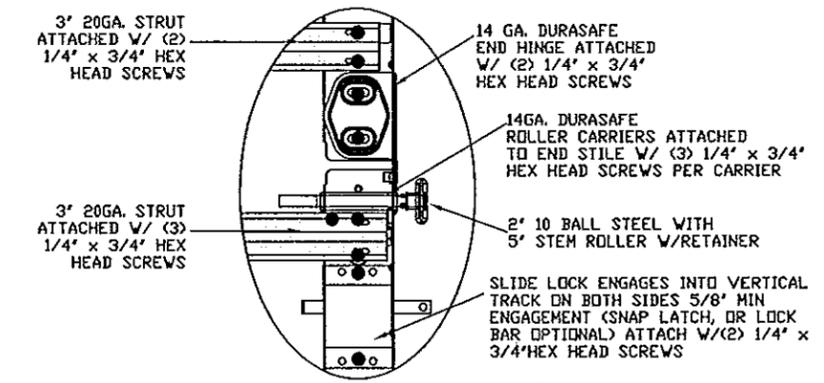


TYPICAL DURASAFE END HINGE  
N.T.S.

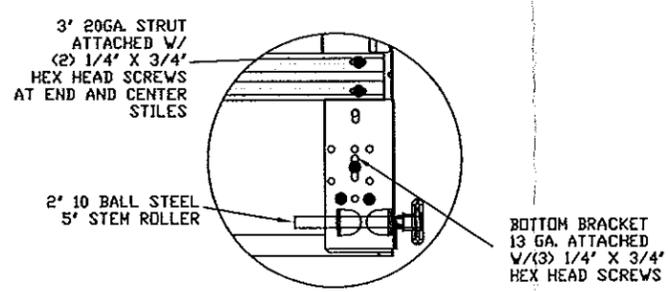

TYPICAL BOTTOM BRACKET  
N.T.S.

# LARGE MISSILE IMPACT RESISTANCE

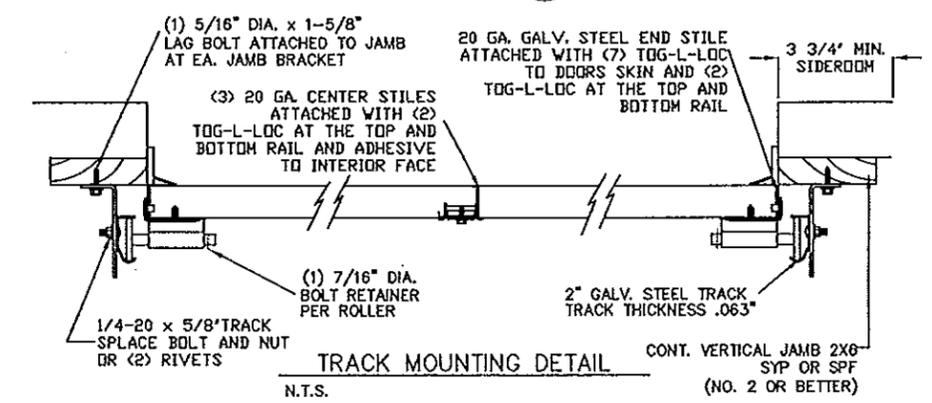

TRACK MOUNTING DETAIL  
N.T.S.



OPTIONAL VENT DETAIL  
N.T.S.

| REV | DESCRIPTION OF REVISIONS         | DATE | BY |
|-----|----------------------------------|------|----|
|     |                                  |      |    |
|     | MAX SIZE 9' x 14'                |      |    |
|     | DESIGN LOADS +45.3 PSF -51.2 PSF |      |    |
|     | LARGE MISSILE IMPACT RESISTANCE  |      |    |

Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412)

dba Structural Solutions of North Carolina, Inc. 5921-G W. Friendly Ave., Greensboro, NC 27410

|   |            |     |                   |
|---|------------|-----|-------------------|
| <b>Amarr</b>  |            |     |                   |
| 165 CARRIAGE COURT WINSTON-SALEM, NC. 27105 WWW.AMARR.COM   |            |     |                   |
| MODEL 950 HERITAGE (24 GA) 1000, 2000<br>MODEL 656 OAK SUMMIT (24 GA) 1000, 2000<br>SHORT, LONG, FLUSH, AND OAK SUMMIT PANELS |            |     |                   |
| SIZE  | DRAWN BY   | RJR | DATE 03/12/13     |
| B   | CHECKED BY |     | DATE              |
| DRAWING NUMBER  |            |     | IRC-9509-169-15-G |
| SHEET 1 OF 3  |            |     |                   |

Approved as complying with the Florida Building Code  
Date 10/10/2013  
NOA# 13-0813-23  
Miami Dade Product Control  
By *[Signature]*

**TABLE 1**

| DOOR HEIGHT | STRUT SPACING (BASED ON RECOMMENDED SECTION CONFIGURATION) |     |         |     |         |     |         |     |         |      |          |      |          |      |          | TOP      |
|-------------|--|-----|---------|-----|---------|-----|---------|-----|---------|------|----------|------|----------|------|----------|----------|
|             | A  | B   | C       | D   | E       | F   | G       | H   | I       | J    | K        | L    | M        | N    | O        | T        |
| 6' 6"       | 5 1/2"   | 18" | 25 3/8" | 36" | 43 3/8" | 54" | 61 3/8" |     |         |      |          |      |          |      |          | 76 1/4"  |
| 7'          | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" |     |         |      |          |      |          |      |          | 82 1/4"  |
| 7' 6"       | 5 1/2"   | 15" | 22 3/8" | 33" | 40 3/8" | 51" | 58 3/8" | 69" | 76 3/8" |      |          |      |          |      |          | 88 1/4"  |
| 8'          | 5 1/2"   | 18" | 25 3/8" | 36" | 43 3/8" | 54" | 61 3/8" | 72" | 79 3/8" |      |          |      |          |      |          | 94 1/4"  |
| 8' 6"       | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 78" | 85 3/8" |      |          |      |          |      |          | 100 1/4" |
| 9'          | 5 1/2"   | 15" | 22 3/8" | 33" | 40 3/8" | 51" | 58 3/8" | 69" | 76 3/8" | 87"  | 94 3/8"  |      |          |      |          | 106 1/4" |
| 9' 6"       | 5 1/2"   | 18" | 25 3/8" | 36" | 43 3/8" | 54" | 61 3/8" | 72" | 79 3/8" | 90"  | 97 3/8"  |      |          |      |          | 112 1/4" |
| 10'         | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 78" | 85 3/8" | 96"  | 103 3/8" |      |          |      |          | 118 1/4" |
| 10' 6"      | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 81" | 88 3/8" | 102" | 109 3/8" |      |          |      |          | 124 1/4" |
| 11'         | 5 1/2"   | 18" | 25 3/8" | 36" | 43 3/8" | 54" | 61 3/8" | 72" | 79 3/8" | 90"  | 97 3/8"  | 108" | 115 3/8" |      |          | 130 1/4" |
| 11' 6"      | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 78" | 85 3/8" | 96"  | 103 3/8" | 114" | 121 3/8" |      |          | 136 1/4" |
| 12'         | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 81" | 88 3/8" | 102" | 109 3/8" | 120" | 127 3/8" |      |          | 142 1/4" |
| 12' 6"      | 5 1/2"   | 18" | 25 3/8" | 36" | 43 3/8" | 54" | 61 3/8" | 72" | 79 3/8" | 90"  | 97 3/8"  | 108" | 115 3/8" | 126" | 133 3/8" | 148 1/4" |
| 13'         | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 78" | 85 3/8" | 96"  | 103 3/8" | 114" | 121 3/8" | 132" | 139 3/8" | 154 1/4" |
| 13' 6"      | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 81" | 88 3/8" | 102" | 109 3/8" | 120" | 127 3/8" | 138" | 145 3/8" | 160 1/4" |
| 14'         | 5 1/2"   | 18" | 25 3/8" | 39" | 46 3/8" | 60" | 67 3/8" | 81" | 88 3/8" | 102" | 109 3/8" | 123" | 130 3/8" | 144" | 151 3/8" | 166 1/4" |

**TABLE 4**

| Section Width (ft) | Panel Type | Center Stile Location (Measured from Left Edge) |          |          |
|--------------------|------------|---|----------|----------|
|                    |            | 1st (in)  | 2st (in) | 3rd (in) |
| 8' 0"              | Short      | 24.812  | 48.000   | 71.188   |
| 8' 0"              | Long       | 24.000  | 48.000   | 72.000   |
| 8' 0"              | Bead       | 24.625  | 48.000   | 71.375   |
| 8' 2"              | Short      | 24.316  | 49.000   | 73.684   |
| 8' 2"              | Long       | 24.500  | 49.000   | 73.500   |
| 8' 2"              | Bead       | 25.125  | 49.000   | 72.875   |
| 8' 4"              | Short      | 24.580  | 50.000   | 75.420   |
| 8' 4"              | Long       | 25.000  | 50.000   | 75.000   |
| 8' 4"              | Bead       | 25.625  | 50.000   | 74.375   |
| 8' 6"              | Short      | 26.029  | 51.000   | 75.971   |
| 8' 6"              | Long       | 25.500  | 51.000   | 76.500   |
| 8' 6"              | Bead       | 26.125  | 51.000   | 75.875   |
| 8' 8"              | Short      | 26.659  | 52.000   | 77.341   |
| 8' 8"              | Long       | 26.000  | 52.000   | 78.000   |
| 8' 8"              | Bead       | 26.625  | 52.000   | 77.375   |
| 8' 10"             | Short      | 27.034  | 53.000   | 78.966   |
| 8' 10"             | Long       | 26.500  | 53.000   | 79.500   |
| 8' 10"             | Bead       | 27.125  | 53.000   | 78.875   |
| 9' 0"              | Short      | 27.596  | 54.000   | 80.404   |
| 9' 0"              | Long       | 27.000  | 54.000   | 81.000   |
| 9' 0"              | Bead       | 27.625  | 54.000   | 80.375   |

**TABLE 2**

| DOOR HEIGHT | SECTION HEIGHTS |     |     |     |     |     |     |     |
|-------------|-----------------|-----|-----|-----|-----|-----|-----|-----|
|             | Btm             | #2  | #3  | #4  | #5  | #6  | #7  | #8  |
| 14' 0"      | 21"             | 21" | 21" | 21" | 21" | 21" | 21" | 21" |
| 13' 6"      | 21"             | 21" | 21" | 21" | 21" | 18" | 18" | 21" |
| 13' 0"      | 21"             | 21" | 21" | 18" | 18" | 18" | 18" | 21" |
| 12' 6"      | 21"             | 18" | 18" | 18" | 18" | 18" | 18" | 21" |
| 12' 0"      | 21"             | 21" | 21" | 21" | 21" | 18" | 21" |     |
| 11' 6"      | 21"             | 21" | 21" | 18" | 18" | 18" | 21" |     |
| 11' 0"      | 21"             | 18" | 18" | 18" | 18" | 18" | 21" |     |
| 10' 6"      | 21"             | 21" | 21" | 21" | 21" | 21" |     |     |
| 10' 0"      | 21"             | 21" | 21" | 18" | 18" | 21" |     |     |
| 9' 6"       | 21"             | 18" | 18" | 18" | 18" | 21" |     |     |
| 9' 0"       | 18"             | 18" | 18" | 18" | 18" |     |     |     |
| 8' 6"       | 21"             | 21" | 21" | 18" | 21" |     |     |     |
| 8' 0"       | 21"             | 18" | 18" | 18" | 21" |     |     |     |
| 7' 6"       | 18"             | 18" | 18" | 18" | 18" |     |     |     |
| 7' 0"       | 21"             | 21" | 21" | 21" |     |     |     |     |
| 6' 6"       | 21"             | 18" | 18" | 21" |     |     |     |     |

**TABLE 3**

| DOOR HEIGHT | TRACK ATTACHMENT |     |     |     |     |      |      |      | SPLICE |
|-------------|------------------|-----|-----|-----|-----|------|------|------|--------|
|             | A                | B   | C   | D   | E   | F    | G    | H    | S      |
| 6' 6"       | 10"              | 21" | 39" | 57" |     |      |      |      | 70"    |
| 7'          | 10"              | 21" | 42" | 63" |     |      |      |      | 76"    |
| 7' 6"       | 10"              | 18" | 36" | 54" | 72" |      |      |      | 82"    |
| 8'          | 10"              | 21" | 39" | 57" | 75" |      |      |      | 88"    |
| 8' 6"       | 10"              | 21" | 42" | 63" | 81" |      |      |      | 94"    |
| 9'          | 10"              | 18" | 36" | 54" | 72" | 90"  |      |      | 100"   |
| 9' 6"       | 10"              | 21" | 39" | 57" | 75" | 93"  |      |      | 106"   |
| 10'         | 10"              | 21" | 42" | 63" | 81" | 99"  |      |      | 112"   |
| 10' 6"      | 10"              | 21" | 42" | 63" | 84" | 105" |      |      | 118"   |
| 11'         | 10"              | 21" | 39" | 57" | 75" | 93"  | 111" |      | 124"   |
| 11' 6"      | 10"              | 21" | 42" | 63" | 81" | 99"  | 117" |      | 130"   |
| 12'         | 10"              | 21" | 42" | 63" | 84" | 105" | 123" |      | 136"   |
| 12' 6"      | 10"              | 21" | 39" | 57" | 75" | 93"  | 111" | 129" | 142"   |
| 13'         | 10"              | 21" | 42" | 63" | 81" | 99"  | 117" | 135" | 148"   |
| 13' 6"      | 10"              | 21" | 42" | 63" | 84" | 105" | 123" | 141" | 154"   |
| 14'         | 10"              | 21" | 42" | 63" | 84" | 105" | 126" | 147" | 160"   |

ALL TRACK ATTACHMENT SPACING +/- 1" ALLOWED WITH SYP OR SPF NO.2 OR BETTER ONLY

Approved as complying with the Florida Building Code  
 Date 10/10/2013  
 NOA# 13-0813.23  
 Miami Dade Product Control  
 By *[Signature]*


| REV | DESCRIPTION OF REVISIONS | DATE | BY |
|-----|--------------------------|------|----|
|     |                          |      |    |

MAX SIZE 9' x 14'

DESIGN LOADS +45.3 PSF -51.2 PSF

LARGE MISSILE IMPACT RESISTANCE

Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412)

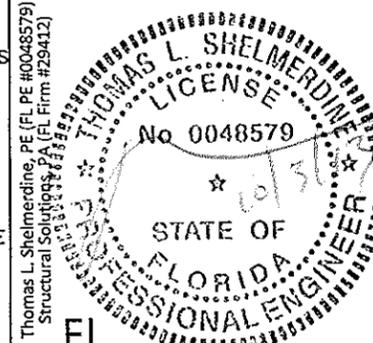

Amarr

165 CARRIAGE COURT WINSTON-SALEM, NC. 27105 WWW.AMARR.COM

MODEL 950 HERITAGE (24 GA) 1000, 2000  
 MODEL 655 OAK SUMMIT (24 GA) 1000, 2000  
 SHORT, LONG, FLUSH, AND OAK SUMMIT PANELS

|      |            |     |      |          |                   |
|------|------------|-----|------|----------|-------------------|
| SIZE | DRAWN BY   | RLR | DATE | 03/12/13 | DRAWING NUMBER    |
| B    | CHECKED BY |     | DATE |          | IRC-9509-169-15-G |

SHEET 3 OF 3

dba Structural Solutions of North Carolina, Inc. 5921-G W. Friendly Ave., Greensboro, NC 27410