



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY, FLORIDA  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

Pella Corporation  
102 Main Street  
Pella, IA 50219

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** Series "10 Vinyl 1/2" Flange" White PVC Single Hung Window - N.I.

**APPROVAL DOCUMENT:** Drawing No. 1840, titled "10 Series Vinyl Non-Impact Single Hung Window", sheets 01 through 04 of 04, dated 10/10/12 with the latest revision dated 01/10/13, prepared by W. W. Schaefer Engineering & Consulting, P. A., signed and sealed by Warren W. Schaefer, P. E., bearing the Miami-Dade County Product Control Section Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING:** None.

**LIMITATION:** The maximum anchor spacing at the Head and Sill shall NOT to exceed 12-inch on center if the design pressure is greater 50 psf.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA No. 12-1108.02 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



*J. Gascon  
6/14/14*

NOA No. 14-0428.07  
Expiration Date: January 31, 2018  
Approval Date: June 12, 2014  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under previous NOA No. 12-1108.02)*
2. Drawing No. 1840, titled "10 Series Vinyl Non-Impact Single Hung Window", sheets 01 through 04 of 04, dated 10/10/12 with the latest revision dated 01/10/13, prepared by W. W. Schaefer Engineering & Consulting, P. A., signed and sealed by Warren W. Schaefer, P. E.  
*(Submitted under previous NOA No. 12-1108.02)*

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per ASTM E 283-04 (12) and per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per ASTM E 330-02 (10) and per FBC, TAS 202-94
  - 3) Water Resistance Test, per ASTM E 547-00 (09), per ASTM E 331-00 (09) and per FBC, TAS 202-94
  - 4) Forced Entry Test, per ASTM E 588-07, Type "A", Type "D", Grade "10" and per FBC 2411.3.2.1, TAS 202-94along with marked-up drawings and installation diagram of single hung, prepared by National Certified Testing Laboratories, Inc., Test Reports No.'s NCTL-110-15216-1, NCTL-110-15215-1, NCTL-110-15212-1, NCTL-110-15211-1, NCTL-110-15198-1, NCTL-110-15195-1, NCTL-110-15196-1, NCTL-110-15198-1, NCTL-110-15197-1 and NCTL-110-15194-1, dated 10/28/12, all signed and sealed by Harold E. Rupp, P. E.  
*(Submitted under previous NOA No. 12-1108.02)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with **FBC-2010**, prepared by W. W. Schaefer Engineering & Consulting, P. A., dated 10/23/12, signed and sealed by Warren W. Schaefer, P.E.  
*(Submitted under previous NOA No. 12-1108.02)*
2. Glazing complies with **ASTM E1300-04/ 09**

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 14-0428.07  
Expiration Date: January 31, 2018  
Approval Date: June 12, 2014

Pella Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**E. STATEMENTS**

1. Statement letter of conformance and complying with **FBC 5<sup>th</sup> Edition (2014)**, issued by W. W. Schaefer Engineering & Consulting, P.A., dated 04/15/14, signed and sealed by Warren W. Schaefer, P. E.
2. Statement letter of conformance and complying with **FBC-2010 and ANSI/ AAMA/ NWWDA 101/ I.S.2-97**, issued by W. W. Schaefer Engineering & Consulting, P.A., dated 10/15/12, signed and sealed by Warren W. Schaefer, P. E.  
*(Submitted under previous NOA No. 12-1108.02)*
3. Statement letter of no financial interest and independence, issued by W. W. Schaefer Engineering & Consulting, P.A., dated 10/15/12, signed and sealed by Warren W. Schaefer, P. E.  
*(Submitted under previous NOA No. 12-1108.02)*
4. Laboratory compliance letter for Test Reports No.'s **NCTL-110-15216-1, NCTL-110-15215-1, NCTL-110-15212-1, NCTL-110-15211-1, NCTL-110-15198-1, NCTL-110-15195-1, NCTL-110-15196-1, NCTL-110-15198-1, NCTL-110-15197-1** and **NCTL-110-15194-1**, issued by National Certified Testing Laboratories, Inc., dated 10/28/12, all signed and sealed by Harold E. Rupp, P. E.  
*(Submitted under previous NOA No. 12-1108.02)*

**F. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **11-0830.09** issued to Mikron Industries, Inc. for **"White Rigid PVC Exterior Extrusions for Windows and Doors"** dated 10/06/11, expiring on 12/26/16.

**G. OTHERS**

1. Notice of Acceptance No. **12-1108.02**, issued to Pella Corporation for their Series **"10 Vinyl ½" Flange White PVC Single Hung Window - N.I."**, approved on 01/31/13 and expiring on 01/31/18.



Jaime D. Gascon, P. E.  
Product Control Section Supervisor  
NOA No. 14-0428.07  
Expiration Date: January 31, 2018  
Approval Date: June 12, 2014

**ALLOWABLE SINGLE WINDOW SIZE/PRESSURE TABLE**

(WITH REINFORCEMENT CONDITION 1 & GLASS OPTION 1)				(WITH REINFORCEMENT CONDITION 2 & GLASS OPTION 1)				(WITH REINFORCEMENT CONDITION 1 OR 2 & GLASS OPTION 2)				
MAXIMUM FRAME HEIGHT (IN.)	MAXIMUM FRAME WIDTH (IN.)	ALLOWABLE PRESSURE (PSF)		MAXIMUM FRAME HEIGHT (IN.)	MAXIMUM FRAME WIDTH (IN.)	ALLOWABLE PRESSURE (PSF)		MAXIMUM FRAME HEIGHT (IN.)	MAXIMUM FRAME WIDTH (IN.)	ALLOWABLE PRESSURE (PSF)		
		POS.	NEG.			POS.	NEG.			POS.	NEG.	
90	54	45.0	45.0	90	40	35.0	35.0	62	36	55.0	55.0	
	52	46.7	46.7		36	40.0	40.0		30	60.0	66.0	
	48	50.6	50.6		30	48.0	48.0		26	60.0	76.2	
	42	57.9	57.9		26	55.4	55.4		24	60.0	82.5	
	36	65.0	67.5		22	60.0	65.5		56	36	60.0	60.9
	30	65.0	81.0		18	60.0	80.0			30	60.0	73.1
73	54	45.0	45.0	73	40	35.0	35.0	50	36	60.0	68.2	
	52	46.7	46.7		36	40.0	40.0		30	60.0	81.8	
	48	50.6	50.6		30	48.0	48.0	43	36	60.0	79.3	
	42	57.9	57.9		26	55.4	55.4		56	40	45.6	45.6
	36	65.0	67.5		22	60.0	65.5	36		60.0	60.9	
	30	65.0	81.0		18	60.0	80.0	30		60.0	73.1	
68	54	48.3	48.3	68	40	37.6	37.6	50		40	51.1	51.1
	52	50.2	50.2		36	42.9	42.9		36	60.0	81.8	
	48	54.3	54.3		30	51.5	51.5	43	40	59.4	59.4	
	42	62.1	62.1		26	59.5	59.5		36	60.0	79.3	
	36	65.0	72.5		22	60.0	70.3	37	40	60.0	69.1	
	32	65.0	81.5		19	60.0	81.4		31	40	60.0	82.4
62	54	53.0	53.0	62	40	41.2	41.2	56	40	59.4	59.4	
	52	55.0	55.0		36	55.0	55.0		36	60.0	79.3	
	48	59.6	59.6		26	60.0	76.2		50	40	59.4	59.4
	42	65.0	68.1		24	60.0	82.5			36	60.0	81.8
	36	65.0	79.5		40	45.6	45.6		43	40	59.4	59.4
56	54	58.7	58.7	56	40	45.6	45.6	50		40	59.4	59.4
	52	60.9	60.9		36	60.0	60.9		36	60.0	79.3	
	48	65.0	66.0		30	60.0	73.1	43	40	59.4	59.4	
	42	65.0	75.4		27	60.0	81.2		36	60.0	79.3	
50	54	65.0	65.7	50	40	51.1	51.1	43	40	59.4	59.4	
	52	65.0	68.2		36	60.0	68.2		36	60.0	79.3	
	48	65.0	73.9		30	60.0	81.8		37	40	60.0	69.1
43	44	65.0	80.6	37	40	60.0	69.1	31		40	60.0	82.4
	54	65.0	76.4		31	40	60.0		82.4	41	54	65.0
52	65.0	79.3										
41	54	65.0	80.1									

- SEE SECTIONS FOR REINFORCEMENT CONDITIONS.
- SEE GLAZING DETAILS FOR GLASS OPTIONS.
- ALLOWABLE PRESSURES ON WINDOWS WITH FRAME HEIGHT BETWEEN 73" & 90" SHALL BE GOVERNED BY THE PRESSURES SHOWN FOR A 90" FRAME HEIGHT.
- CONDITIONS OUTSIDE THOSE SHOWN IN THIS TABLE SHALL BE EVALUATED UNDER A SEPARATE CERTIFICATION BY A FLORIDA LICENSED ENGINEER.
- DIMENSIONS SHOWN ARE +/-1/2".

- SEE SECTIONS FOR REINFORCEMENT CONDITIONS.
- SEE GLAZING DETAILS FOR GLASS OPTIONS.
- CONDITIONS OUTSIDE THOSE SHOWN IN THIS TABLE SHALL BE EVALUATED UNDER A SEPARATE CERTIFICATION BY A FLORIDA LICENSED ENGINEER.
- DIMENSIONS SHOWN ARE +/-1/2".
- WHEN REINFORCEMENT CONDITION 1 IS USED WITH WINDOWS IN THIS TABLE, ALLOWABLE POSITIVE PRESSURE MAY BE INCREASED TO 65.0 PSF IN ALL PLACES WHERE 60.0 PSF IS SHOWN.

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

**FRAME ANCHOR REQUIREMENTS TABLE**

(1) FRAME & INSTALLATION CLIP SCREWS			
OPENING TYPE (SUBSTRATE)	FRAME TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
(2) MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 10 SMS OR WOOD SCREW	1 1/4"	3/4"
MIN. 18 GA. 33 KSI METAL STUD	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK A36 STEEL	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. C-90 CMU OR 2500 PSI CONCRETE	(3) 1/4" CONCRETE SCREW	1 1/4"	2"

(1) SCREWS SHALL BE PAN HEAD OR HEX HEAD SCREW.  
 (2) MIN. 2X4 BUCKS REQUIRED AT HEAD & SIDES; MIN. 2X6 BUCKS REQUIRED AT SILL (SILL BUCK MAY BE RIPPED DOWN TO AS LITTLE AS 4" PROVING CLIP SCREW EDGE DISTANCE IS SATISFIED. BUCKS MAY BE TAPERED OR NOTCHED AT THEIR INTERIOR SIDE IF REQUIRED TO ALLOW INTERIOR DRYWALL, PANELING OR CASING TO BUTT AGAINST THE WINDOW FRAME EDGE.  
 (3) CONCRETE SCREWS SHALL BE ELCO ULTRACONS (C.S.), ELCO CRETE-FLEX (S.S.), ITW RAMSET/RED HEAD TAPCONS (C.S. OR S.S.) OR HILTI KWIK-CON II (C.S OR S.S.).

**GENERAL NOTES:**

- THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
- OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, FORCED ENTRY & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOL TAS-202 FOR NON-IMPACT WINDOWS.
- THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HMHZ).
- THESE WINDOWS ARE NON-IMPACT RATED & MUST BE SHUTTERED WITH A FLORIDA CODE APPROVED SHUTTER WHERE REQUIRED BY CODE.
- ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
- DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF Kd = 0.85 MAY BE APPLIED PER THE ASCE-7 STANDARD.
- NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR WOOD SCREW ANALYSIS ONLY.
- MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.

**CORNER CONSTRUCTION:**

FRAME: MEMBERS ARE MITERED & FULLY WELDED.  
 SASH: MEMBERS ARE MITERED & FULLY WELDED.


LOCK QUANTITY REQUIREMENTS	
FRAME WIDTH	QUANTITY PER PANEL
OVER 36"	2
36" & LESS	1

PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. **14-0428.07**  
 Expiration Date **01/31/2018**  
 By *[Signature]*  
 Miami Dade Product Control

Approved as complying with the Florida Building Code  
 Date **01/31/2013**  
 NOA# **12-1108.02**  
 Miami Dade Product Control  
 By *[Signature]*



DRAWN BY: W.R.M.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 10/10/12
DATE	BY
REVISION DESCRIPTION	NO.
10 SERIES VINYL NON-IMPACT SINGLE HUNG WINDOW MANUFACTURER PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	
CERTIFICATION JAN 10 2013 WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1840	REV.
SHEET NO. 1 OF 4	

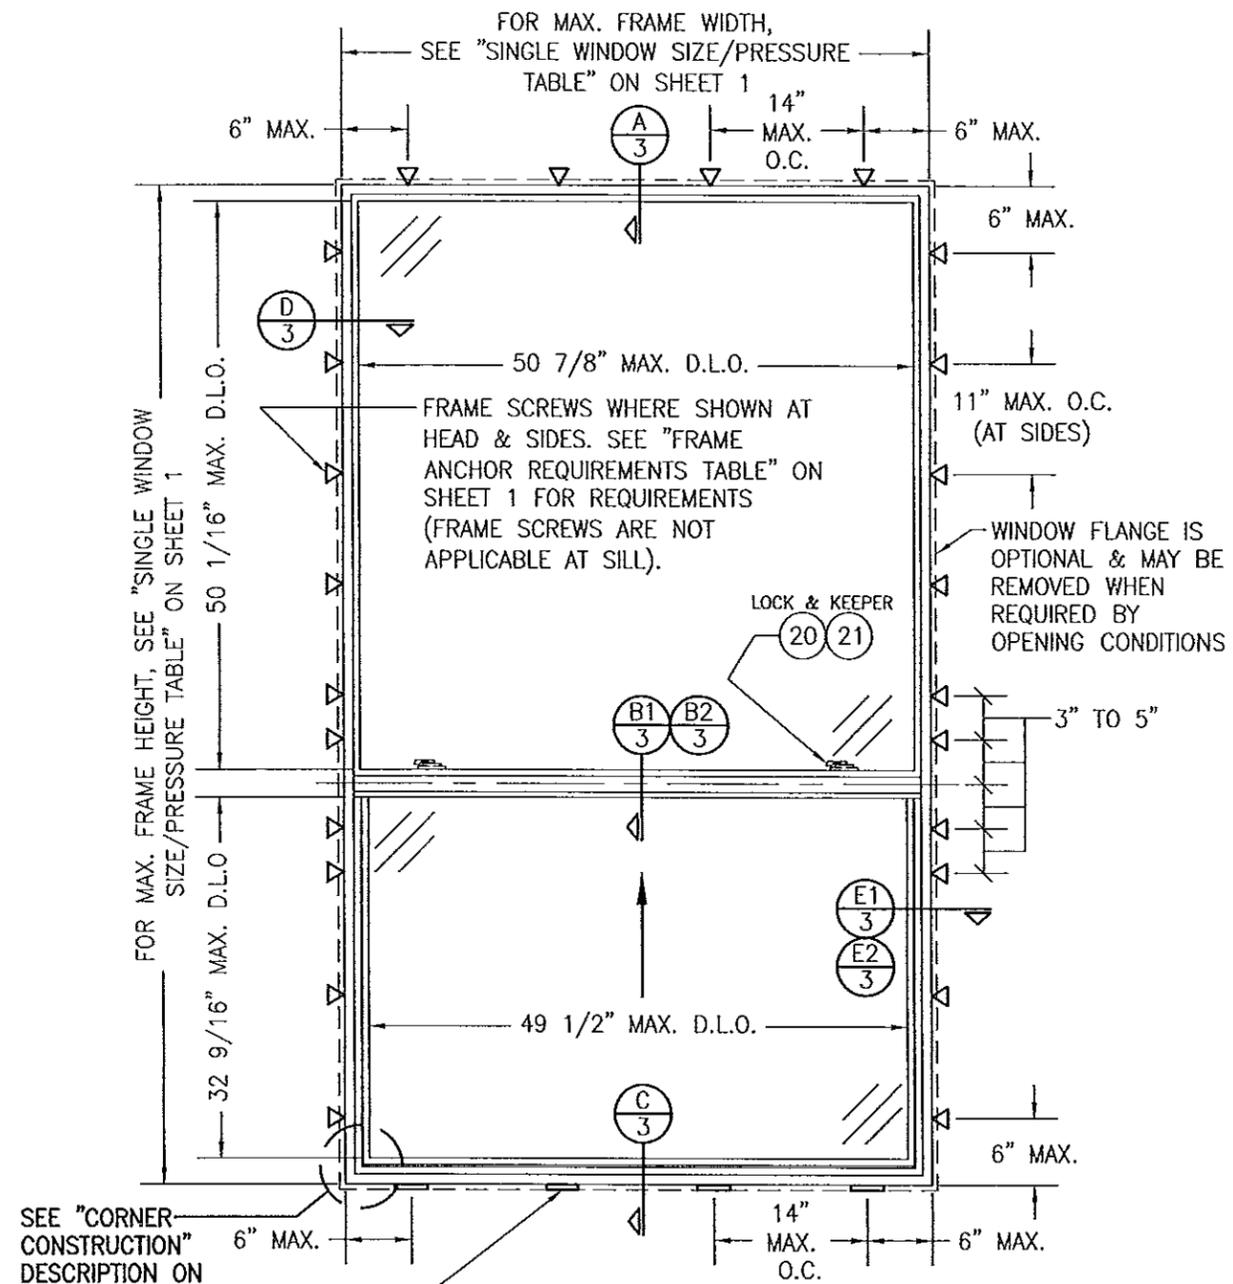


SEE "CORNER CONSTRUCTION" DESCRIPTION ON SHEET 1

INSTALLATION CLIPS WHERE SHOWN AT SILL. SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON SHEET 1 FOR REQUIREMENTS (INSTALLATION CLIPS ARE NOT APPLICABLE AT HEAD & SIDES).


**EXTERIOR ELEVATION:**  
**SINGLE WINDOW**  
SCALE: 3/4" = 1'-0"

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. **14-0A28.07**  
Expiration Date **01/31/2018**  
By *[Signature]*  
Miami Dads Product Control

Approved as complying with the Florida Building Code  
Date **01/31/2013**  
NOA# **12-1108.02**  
Miami Dads Product Control  
By *[Signature]*

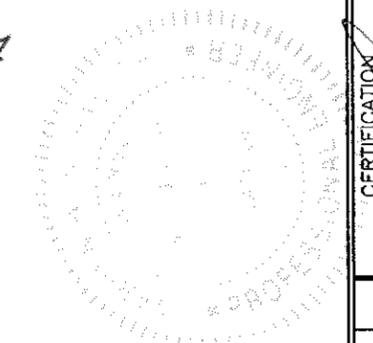

DRAWN BY: W.R.M.		CHECKED BY: W.W.S.	
PLOT: 1-16		DATE: 10/10/12	
NO.	REVISION DESCRIPTION	BY	DATE
DRAWING TITLE <b>10 SERIES VINYL NON-IMPACT SINGLE HUNG WINDOW</b>			
CONSULTANTS <b>W. W. SCHAEFER ENGINEERING &amp; CONSULTING, P.A. (CA 6809)</b> 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		MANUFACTURER <b>PELLA CORPORATION</b> 102 MAIN STREET PELLA, IA 50219 641-621-1000	
CERTIFICATION <b>JAN 10 2013</b> WARREN W. SCHAEFER, P.E. P.E. NO. 44135		DRAWING NO. <b>1840</b>	
SHEET NO. <b>2</b>		REV. <b>OF 4</b>	

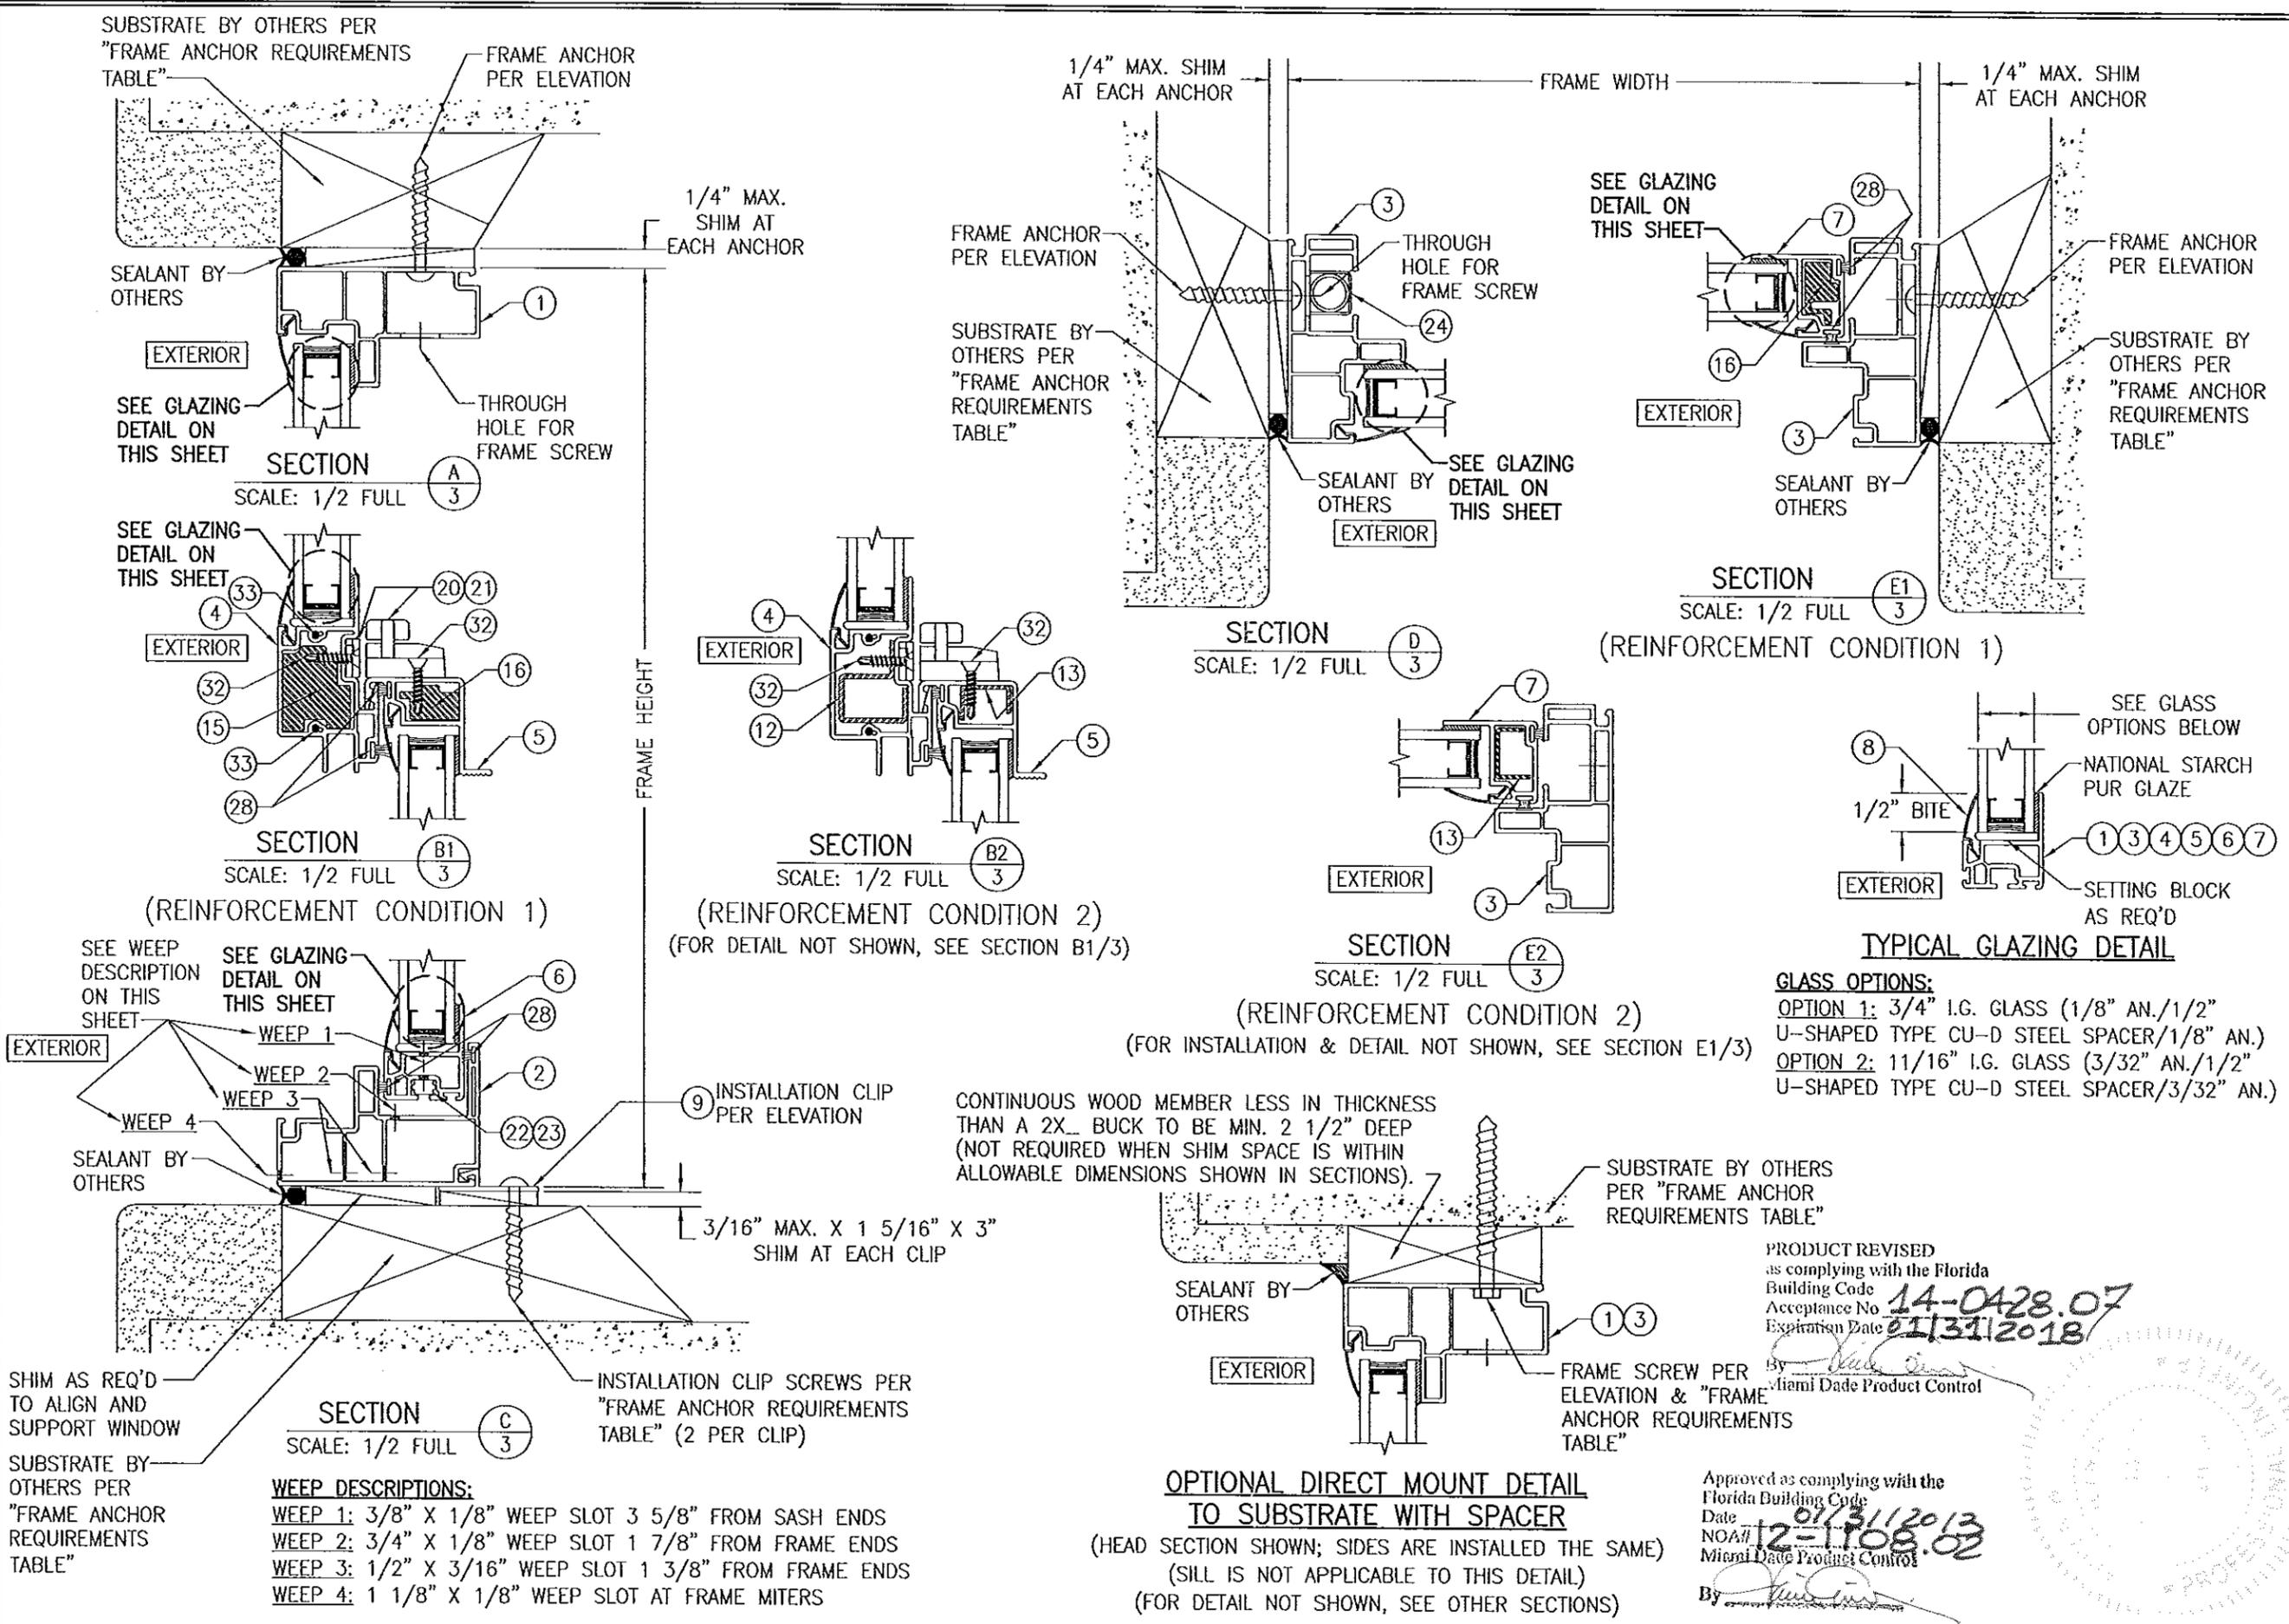

DRAWN BY: W.R.U.		CHECKED BY: W.W.S.	
PLOT: 1=2		DATE: 10/10/12	
NO.	REVISION	DESCRIPTION	DATE
DRAWING TITLE: 10 SERIES VINYL NON-IMPACT SINGLE HUNG WINDOW			
CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424		MANUFACTURER: PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000	
CERTIFICATION: JAN 10 2013 WARREN W. SCHAEFER, P.E. P.E. NO. 44135		DRAWING NO. 1840 SHEET NO. 3 OF 4	


**GLASS OPTIONS:**  
 OPTION 1: 3/4" I.G. GLASS (1/8" AN./1/2" U-SHAPED TYPE CU-D STEEL SPACER/1/8" AN.)  
 OPTION 2: 11/16" I.G. GLASS (3/32" AN./1/2" U-SHAPED TYPE CU-D STEEL SPACER/3/32" AN.)

PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No. 14-0428.07  
 Expiration Date 21/31/2018  
 By: [Signature]  
 Miami Dade Product Control

Approved as complying with the Florida Building Code  
 Date: 01/31/2013  
 NOA# 12-1108.02  
 Miami Dade Product Control  
 By: [Signature]


ITEM #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS		
1	HEAD FRAME	(*) VINYL
2	SILL FRAME	(*) VINYL
3	JAMB FRAME	(*) VINYL
4	FIXED CHECK-RAIL	(*) VINYL
5	ACTIVE SASH CHECK-RAIL	(*) VINYL
6	ACTIVE SASH BOTTOM RAIL	(*) VINYL
7	ACTIVE SASH STILE	(*) VINYL
8	GLAZING BEAD	(*) VINYL
9	INSTALLATION CLIP	(*) VINYL
12	FIXED CHECK-RAIL REINFORCEMENT (REINFORCEMENT CONDITION 2)	ASTM A653-05A TYPE A GALVANIZED STEEL
13	ACTIVE SASH CHECK-RAIL & STILE REINFORCEMENT (REINFORCEMENT CONDITION 2)	ASTM A653-05A TYPE A GALVANIZED STEEL
15	FIXED CHECK-RAIL REINFORCEMENT (REINFORCEMENT CONDITION 1)	6061-T6 ALUMINUM
16	ACTIVE SASH CHECK-RAIL & STILE REINFORCEMENT (REINFORCEMENT CONDITION 1)	6061-T6 ALUMINUM
HARDWARE		
20	SASH LOCK	PELLA V615002 DIE CAST ZINC
21	SASH LOCK KEEPER	PELLA V700123 DIE CAST ZINC
22	PIVOT BAR (1 PER EACH BOTTOM CORNER)	PELLA V615605 DIE CAST ZINC
23	TILT LATCH (1 PER EACH BOTTOM CORNER)	(*) PELLA V782401 RIGID VINYL
24	SASH BALANCE	PELLA V78243
SEALS & SEALANTS		
28	PILE WEATHERSTRIP	AMESBURY V420628
FASTENERS		
32	NO. 6 X 3/4 ZINC PLATED TEK SCREW	2 PER EACH SASH LOCK & SASH LOCK KEEPER INTO RAIL REINFORCEMENT
33	NO. 6 X 1 5/8" BUGLE HEAD COURSE THREAD 18-8 S.S. SCREW	2 PER EACH FIXED CHECK-RAIL END

(\*) WHITE RIGID PVC EXTERIOR EXTRUSIONS FOR WINDOWS AND DOORS BY MIKRON INDUSTRIES, INC. PER AAMA CERTIFIED PVC EXTRUSION LISTING, MIAMI-DADE COUNTY PRODUCT CONTROL APPROVAL AND FBC 2010

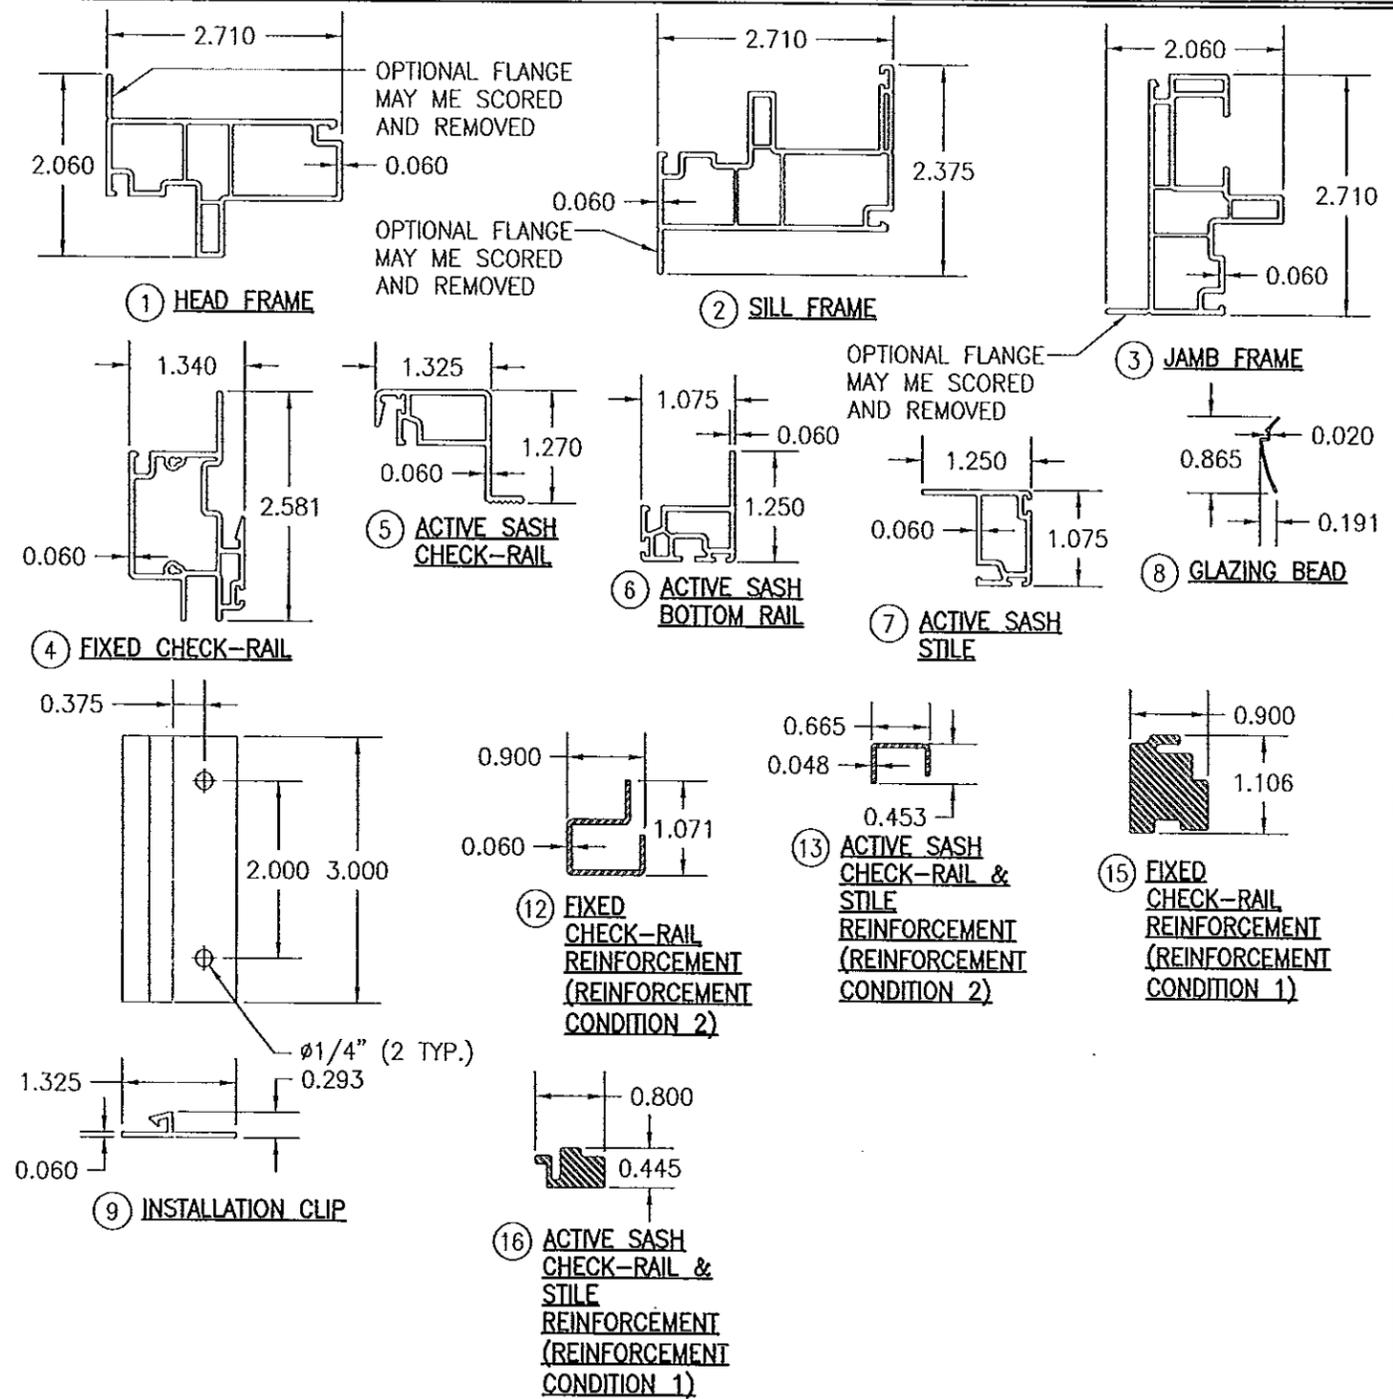

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 14-0428.07  
 Expiration Date 01/31/2018  
 By *[Signature]*  
 Miami Dade Product Control

Approved as complying with the  
 Florida Building Code  
 Date 01/31/2013  
 NOA# 12-110810  
 Miami Dade Product Control  
 By *[Signature]*

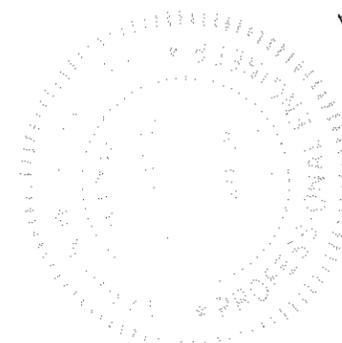

DRAWN BY: W.R.W.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 10/10/12
DATE	BY
REVISION DESCRIPTION	NO.
DRAWING TITLE 10 SERIES VINYL NON-IMPACT SINGLE HUNG WINDOW	
MANUFACTURER PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	
CERTIFICATION JAN 10 2013 WARREN W. SCHAEFER, P.E. P.E. NO. 44135	
DRAWING NO. 1840	REV.
SHEET NO. 4 OF 4	