



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/economy

Pella Corporation
102 Main Street
Pella, IA 50219

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "10 Vinyl 1/2" Flange" White PVC Horizontal Sliding Window - N.I.

APPROVAL DOCUMENT: Drawing No. 1839, titled "10 Series Vinyl Non-Impact Sliding Glass Window", sheets 01 through 04 of 04, dated 10/10/12 with the latest revision dated 01/16/13, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P. E., bearing the Miami-Dade County Product Control Section Revision stamp with the Notice of Acceptance number and Expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 12-1108.03 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jaime D. Gascon, P. E.**



J. Gascon
6/17/14

NOA No. 14-0428.08
Expiration Date: January 31, 2018
Approval Date: June 26, 2014
Page 1

Pella Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 12-1108.03)
2. Drawing No. 1839, titled "10 Series Vinyl Non-Impact Sliding Glass Window", sheets 01 through 04 of 04, dated 10/10/12 with the latest revision dated 01/16/13, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P. E.
(Submitted under previous NOA No. 12-1108.03)

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per ASTM E 283-04 (12) and per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per ASTM E 330-02 (10) and per FBC, TAS 202-94
 - 3) Water Resistance Test, per ASTM E 547-00 (09), per ASTM E 331-00 (09) and per FBC, TAS 202-94
 - 4) Forced Entry Test, per ASTM E 588-07, Type "A", Type "D", Grade "10" and per FBC 2411.3.2.1, TAS 202-94along with marked-up drawings and installation diagram of horizontal sliding window, prepared by National Certified Testing Laboratories, Inc., Test Reports No.'s NCTL-110-15220-1, NCTL-110-15221-1, NCTL-110-15222-1, and NCTL-110-15219-1, dated 10/28/12, signed and sealed by Harold E. Rupp, P. E.
(Submitted under previous NOA No. 12-1108.03)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC, prepared by W. W. Schaefer Engineering & Consulting, P.A., dated 10/23/12, signed and sealed by Warren W. Schaefer, P. E.
(Submitted under previous NOA No. 12-1108.03)
2. Glazing complies with ASTM E1300-04

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. 12-1017.02, issued to **Quanex Building Products, Inc.** for "White Rigid PVC Exterior Extrusions for Windows and Doors" dated 02/07/13, expiring on 12/26/16.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 14-0428.08
Expiration Date: January 31, 2018
Approval Date: June 26, 2014

Pella Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS


1. Statement letter of conformance and complying with **FBC 5th Edition (2014)**, issued by W. W. Schaefer Engineering & Consulting, P.A., dated 04/15/14, signed and sealed by Warren W. Schaefer, P. E.
2. Statement letter of conformance to **ANSI/ AAMA/ NWWDA 101/ I.S.2-97** and complying with **FBC-2010**, issued by W. W. Schaefer Engineering & Consulting, P. A., dated 10/15/12, signed and sealed by Warren W. Schaefer, P. E.
(Submitted under previous NOA No. 12-1108.03)
3. Statement letter of no financial interest and independence, issued by W. W. Schaefer Engineering & Consulting, P. A., dated 10/15/12, signed and sealed by Warren W. Schaefer, P. E.
(Submitted under previous NOA No. 12-1108.03)
4. Laboratory compliance letters for Test Reports No.'s **NCTL-110-15220-1, NCTL-110-15221-1, NCTL-110-15222-1 and NCTL-110-15219-1**, all issued by National Certified Testing Laboratories, Inc., dated 10/28/12, signed and sealed by Harold E. Rupp, P. E.
(Submitted under previous NOA No. 12-1108.03)

G. OTHERS

1. Notice of Acceptance No. **12-1108.03**, issued to Pella Corporation for their Series **"10 Vinyl 1/2" Flange White PVC Horizontal Sliding Window - N. I."**, approved on 01/31/13 and expiring on 01/31/18.



Jaime D. Gascon, P. E.
Product Control Section Supervisor
NOA No. 14-0428.08
Expiration Date: January 31, 2018
Approval Date: June 26, 2014

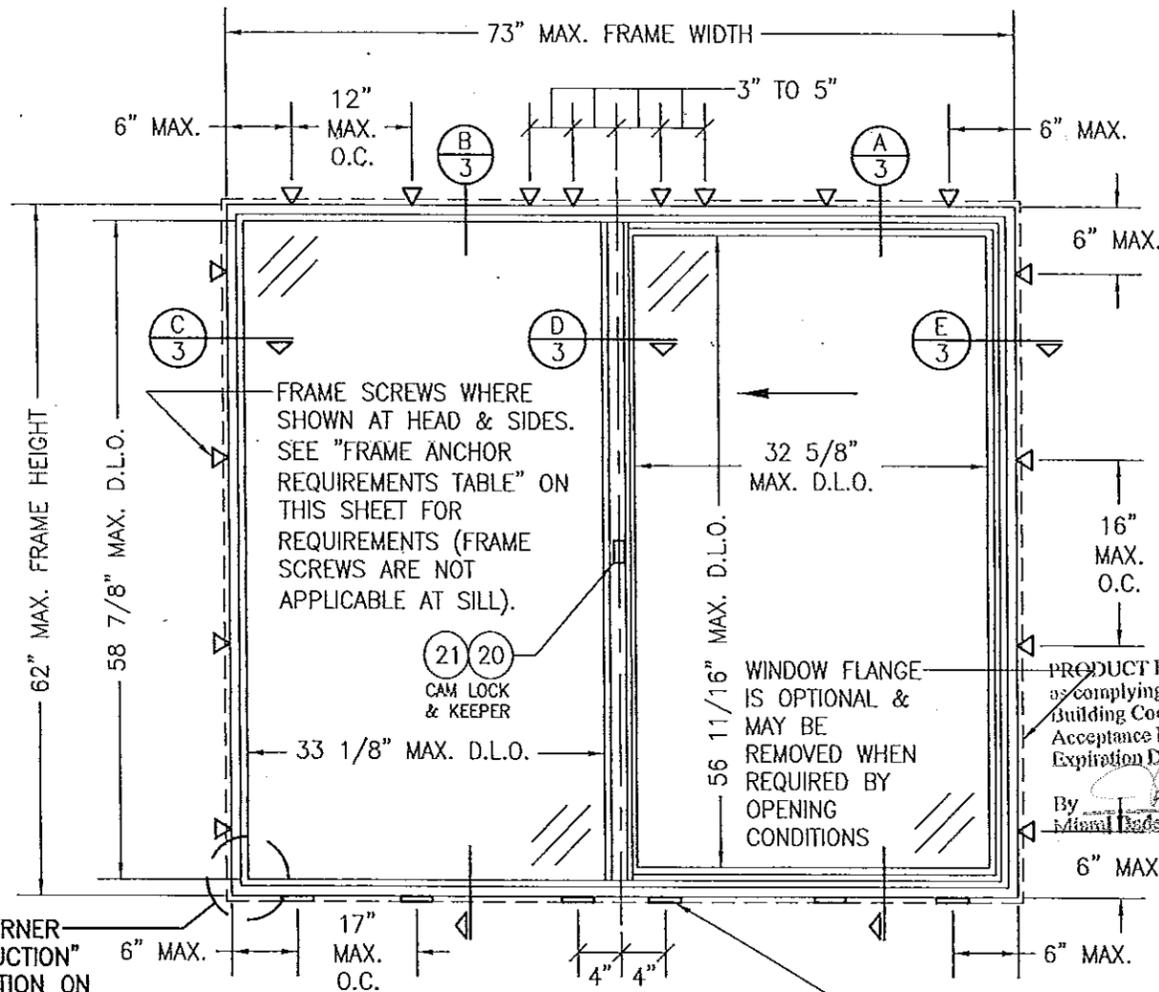

EXTERIOR ELEVATION:
"XO" WINDOW
 SCALE: 3/4" = 1'-0"
 ("OX" ALSO APPLIES)

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. **14-0428.08**
 Expiration Date **01/31/2018**
 By *[Signature]*
 Miami Base Product Control

SEE "CORNER
 CONSTRUCTION"
 DESCRIPTION ON
 THIS SHEET

INSTALLATION CLIPS WHERE
 SHOWN AT SILL. SEE "FRAME
 ANCHOR REQUIREMENTS TABLE"
 ON THIS SHEET FOR
 REQUIREMENTS (INSTALLATION
 CLIPS ARE NOT APPLICABLE AT
 HEAD & SIDES).

CORNER CONSTRUCTION:

FRAME: MEMBERS ARE MITERED & FULLY WELDED.
 SASH: MEMBERS ARE MITERED & FULLY WELDED.

FRAME ANCHOR REQUIREMENTS TABLE

(1) FRAME & INSTALLATION CLIP SCREWS

OPENING TYPE (SUBSTRATE)	FRAME TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
(2) MIN. 2X WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 10 SMS OR WOOD SCREW	1 1/4"	3/4"
MIN. 18 GA. 33 KSI METAL STUD	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK A36 STEEL	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 10 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. C-90 CMU OR 2500 PSI CONCRETE	(3) 1/4" CONCRETE SCREW	1 1/4"	2"

- SCREWS SHALL BE PAN HEAD OR HEX HEAD SCREW.
- MIN. 2X4 BUCKS REQUIRED AT HEAD & SIDES; MIN. 2X6 BUCKS REQUIRED AT SILL (SILL BUCK MAY BE RIPPED DOWN TO AS LITTLE AS 4" PROVING CLIP SCREW EDGE DISTANCE IS SATISFIED. BUCKS MAY BE TAPERED OR NOTCHED AT THEIR INTERIOR SIDE IF REQUIRED TO ALLOW INTERIOR DRYWALL, PANELING OR CASING TO BUTT AGAINST THE WINDOW FRAME EDGE.
- CONCRETE SCREWS SHALL BE ELCO ULTRACONS (C.S.), ELCO CRETE-FLEX (S.S.), ITW RAMSET/RED HEAD TAPCONS (C.S. OR S.S.) OR HILTI KWIK-CON II (C.S OR S.S.).

GENERAL NOTES:


- THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
- OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
- ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
- THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, FORCED ENTRY & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOL TAS-202 FOR NON-IMPACT WINDOWS.
- THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
- THESE WINDOWS ARE NON-IMPACT RATED & MUST BE SHUTTERED WITH A FLORIDA CODE APPROVED SHUTTER WHERE REQUIRED BY CODE.
- ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
- DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF $K_d = 0.85$ MAY BE APPLIED PER THE ASCE-7 STANDARD.
- NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR $C_d = 1.6$ WAS USED FOR WOOD SCREW ANALYSIS ONLY.
- MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.

ALLOWABLE "XO" WINDOW SIZE VS. PRESSURE TABLE

MAXIMUM FRAME WIDTH (IN.)	MAXIMUM FRAME HEIGHT (IN.)	ALLOWABLE PRESSURE (PSF)				MAXIMUM FRAME WIDTH (IN.)	MAXIMUM FRAME HEIGHT (IN.)	ALLOWABLE PRESSURE (PSF)			
		GLASS OPTION 1		GLASS OPTION 2				GLASS OPTION 1		GLASS OPTION 2	
		POS.	NEG.	POS.	NEG.			POS.	NEG.	POS.	NEG.
73	62	30.0	30.0	N/A	N/A	50	62	38.7	38.7	38.7	38.7
	60	30.4	30.4	N/A	N/A		60	39.0	39.0	39.0	39.0
	54	32.0	32.0	N/A	N/A		54	40.0	40.2	40.0	40.2
	50	35.0	35.0	35.0	35.0		50	40.0	43.3	40.0	43.3
	44	40.0	40.0	40.0	40.0		44	40.0	47.7	40.0	47.7
	37	40.0	46.2	40.0	46.2		37	40.0	51.6	40.0	51.6
	31	40.0	55.1	40.0	55.1		31	40.0	57.3	40.0	57.3
66	25	40.0	68.4	40.0	68.4	48	25	40.0	68.4	40.0	68.4
	62	31.9	31.9	N/A	N/A		62	39.9	39.9	39.9	39.9
	60	32.3	32.3	N/A	N/A		60	40.0	40.2	40.0	40.2
	54	33.7	33.7	33.7	33.7		54	40.0	41.4	40.0	41.4
	50	36.7	36.7	36.7	36.7		50	40.0	44.5	40.0	44.5
	44	40.0	41.4	40.0	41.4		44	40.0	49.0	40.0	49.0
	37	40.0	46.7	40.0	46.7		37	40.0	52.7	40.0	52.7
60	31	40.0	55.1	40.0	55.1	42	31	40.0	58.1	40.0	58.1
	25	40.0	68.4	40.0	68.4		25	40.0	68.5	40.0	68.5
	62	34.0	34.0	N/A	N/A		62	40.0	44.3	40.0	44.3
	60	34.3	34.3	34.3	34.3		60	40.0	44.6	40.0	44.6
	54	35.7	35.7	35.7	35.7		54	40.0	45.7	40.0	45.7
	50	38.6	38.6	38.6	38.6		50	40.0	48.9	40.0	48.9
	44	40.0	43.2	40.0	43.2		44	40.0	53.4	40.0	53.4
54	37	40.0	47.9	40.0	47.9	36	37	40.0	56.8	40.0	56.8
	31	40.0	55.2	40.0	55.2		31	40.0	61.5	40.0	61.5
	25	40.0	68.4	40.0	68.4		25	40.0	70.2	40.0	70.2
	62	36.6	36.6	36.6	36.6		62	40.0	50.2	40.0	50.2
	60	36.9	36.9	36.9	36.9		60	40.0	50.5	40.0	50.5
	54	38.2	38.2	38.2	38.2		54	40.0	51.5	40.0	51.5
	50	40.0	41.2	40.0	41.2		50	40.0	55.0	40.0	55.0

- SEE GLAZING DETAILS FOR GLASS OPTIONS.
- "N/A" DESIGNATES A SIZE NOT APPLICABLE TO THAT GLASS OPTION.
- CONDITIONS OUTSIDE THOSE SHOWN IN THIS TABLE SHALL BE EVALUATED UNDER A SEPARATE CERTIFICATION BY A FLORIDA LICENSED ENGINEER.
- DIMENSIONS SHOWN ARE +/- 1/2".

Approved as complying with the
 Florida Building Code
 Date **12-11-13/08.03**
 NOA# **12-0113108.03**
 Miami Base Product Control
 By *[Signature]*

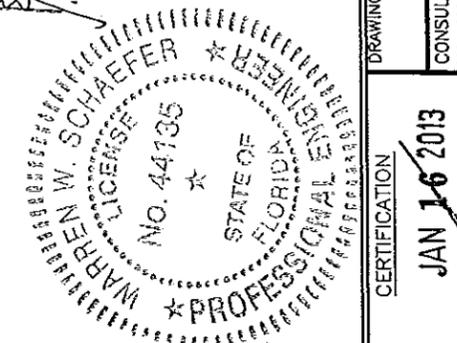


DRAWN BY: W.R.M.	CHECKED BY: W.W.S.
DATE: 10/10/12	DATE: 10/10/12
PLOT: 1=16	DATE: 10/10/12
NO.	REVISION DESCRIPTION
BY	
DATE	
NO.	
DRAWING TITLE 10 SERIES VINYL NON-IMPACT SLIDING GLASS WINDOW	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)	MANUFACTURER Pella
7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000
CERTIFICATION JAN 16 2013	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1839	REV.
SHEET NO. 1	OF 4

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

ALLOWABLE "XOX" WINDOW SIZE VS. PRESSURE TABLE

MAXIMUM FRAME WIDTH (IN.)	MAXIMUM FRAME HEIGHT (IN.)	ALLOWABLE PRESSURE (PSF)			
		GLASS OPTION 1		GLASS OPTION 2	
		POS.	NEG.	POS.	NEG.
110	62	30.0	30.0	N/A	N/A
	54	34.4	34.4	N/A	N/A
	50	35.0	37.2	N/A	N/A
	44	35.0	40.9	N/A	N/A
	37	35.0	44.7	N/A	N/A
	31	35.0	50.5	35.0	50.5
	25	35.0	61.8	35.0	61.8
105	62	30.6	30.6	N/A	N/A
	54	35.0	36.1	N/A	N/A
	50	35.0	39.0	N/A	N/A
	44	35.0	41.9	N/A	N/A
	37	35.0	45.6	N/A	N/A
	31	35.0	51.0	35.0	51.0
97	62	31.8	31.8	N/A	N/A
	54	35.0	39.1	N/A	N/A
	50	35.0	42.1	N/A	N/A
	44	35.0	44.0	N/A	N/A
	37	35.0	47.4	35.0	47.4
	31	35.0	52.3	35.0	52.3
	25	35.0	61.9	35.0	61.9
85	62	34.3	34.3	N/A	N/A
	54	35.0	41.8	N/A	N/A
	50	35.0	46.2	N/A	N/A
	44	35.0	47.9	N/A	N/A
	37	35.0	51.0	35.0	51.0
	31	35.0	55.3	35.0	55.3
	25	35.0	63.2	35.0	63.2
73	62	35.0	37.8	N/A	N/A
	54	35.0	45.6	N/A	N/A
	50	35.0	50.8	N/A	N/A
	44	35.0	53.4	35.0	53.4
	37	35.0	56.2	35.0	56.2
	31	35.0	60.0	35.0	60.0
	25	35.0	66.7	35.0	66.7
61	62	35.0	42.9	N/A	N/A
	54	35.0	51.2	35.0	51.2
	50	35.0	56.7	35.0	56.7
	44	35.0	61.3	35.0	61.3
	37	35.0	63.8	35.0	63.8
	31	35.0	67.2	35.0	67.2
	25	35.0	70.0	35.0	70.0
50	62	35.0	50.0	35.0	50.0
	54	35.0	59.2	35.0	59.2
	44	35.0	65.2	35.0	65.2

- SEE GLAZING DETAILS FOR GLASS OPTIONS.
- "N/A" DESIGNATES A SIZE NOT APPLICABLE TO THAT GLASS OPTION.
- CONDITIONS OUTSIDE THOSE SHOWN IN THIS TABLE SHALL BE EVALUATED UNDER A SEPARATE CERTIFICATION BY A FLORIDA LICENSED ENGINEER.
- DIMENSIONS SHOWN ARE +/- 1/2".

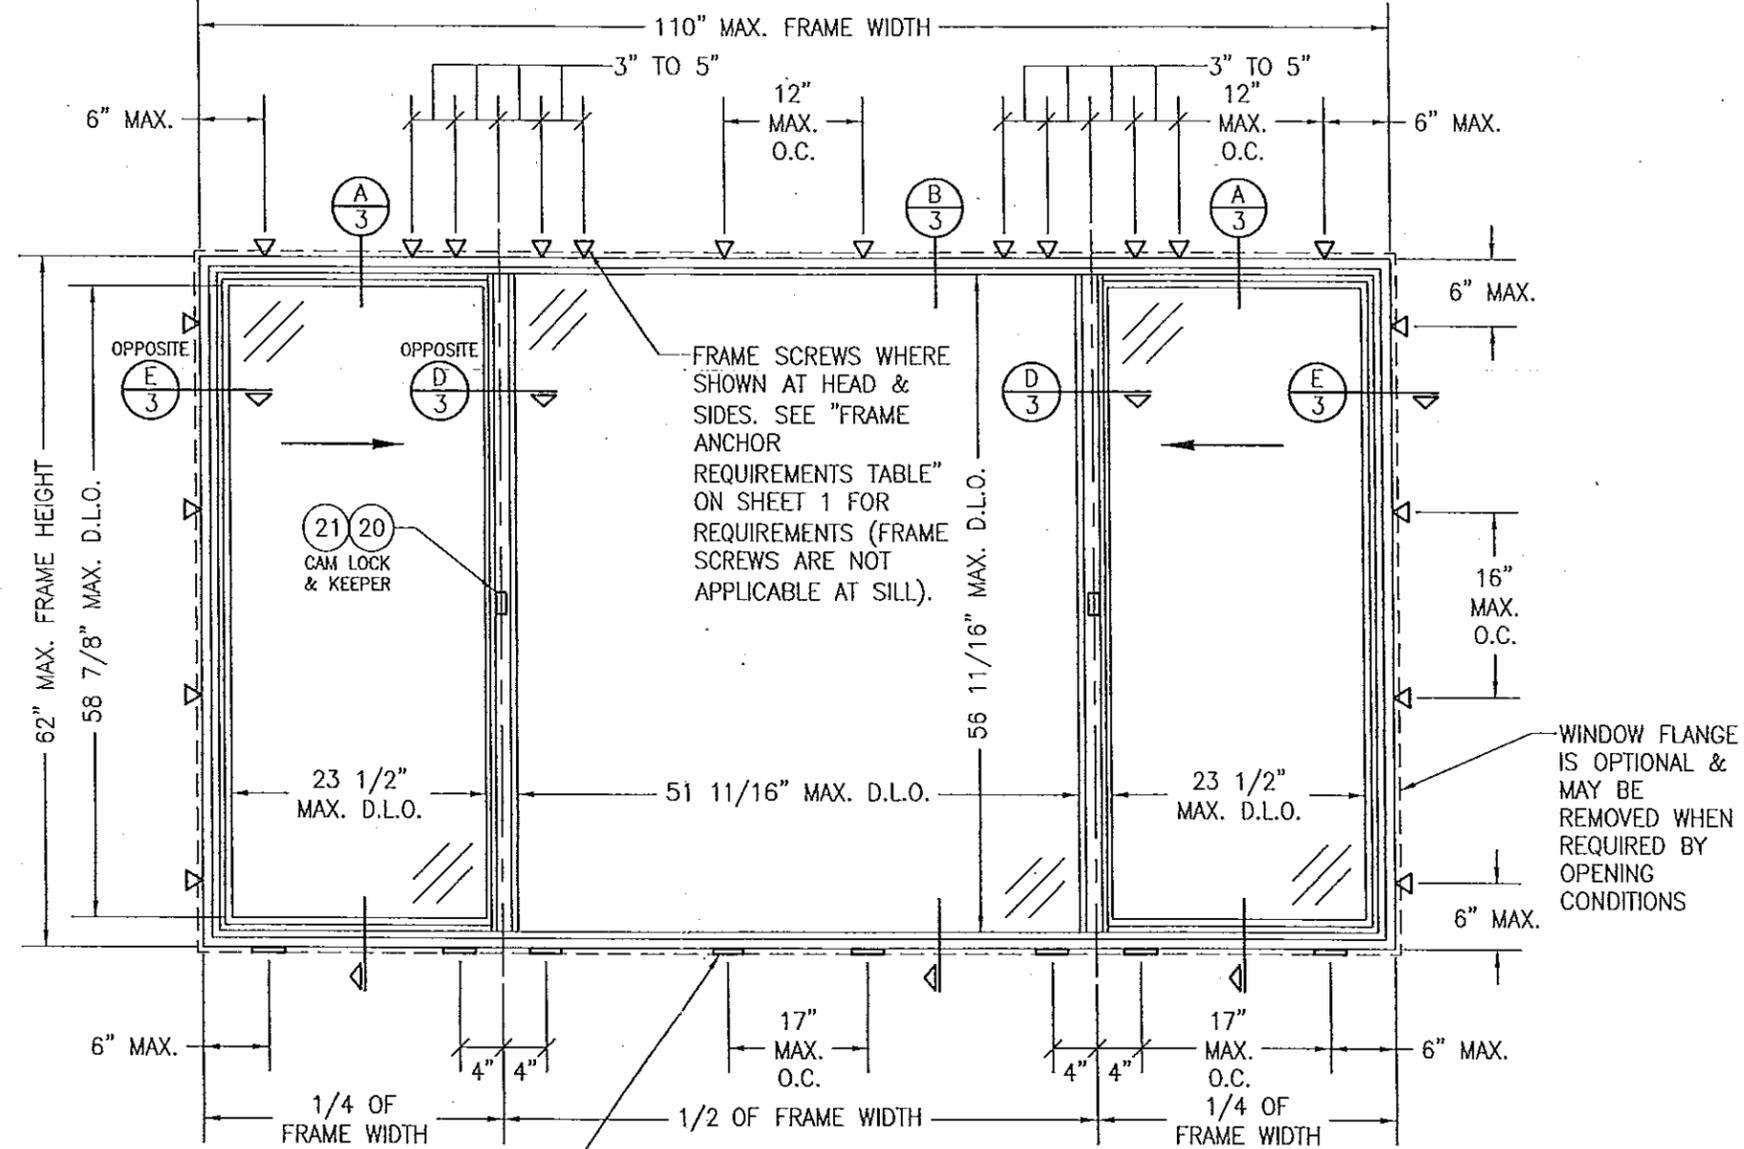

INSTALLATION CLIPS WHERE SHOWN AT SILL. SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON SHEET 1 FOR REQUIREMENTS (INSTALLATION CLIPS ARE NOT APPLICABLE AT HEAD & SIDES).

EXTERIOR ELEVATION:
"XOX" WINDOW
SCALE: 3/4" = 1'-0"

PRODUCT REVISED as complying with the Florida Building Code
Acceptance No. 14-0428.08
Expiration Date 2/31/2018

By *[Signature]*
Miami Dade Product Control


Approved as complying with the Florida Building Code
Date 01/31/2013
NOA# 12-1108.03
Miami Dade Product Control

By *[Signature]*



DRAWN BY: W.R.M.	CHECKED BY: W.W.S.
PLOT: 1-16	DATE: 10/10/12
DATE	BY
REVISION DESCRIPTION	
NO.	
DRAWING TITLE 10 SERIES VINYL NON-IMPACT SLIDING GLASS WINDOW	
MANUFACTURER PELLA CORPORATION 102 MAIN STREET PELLA, IA 50219 641-621-1000	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	
CERTIFICATION JAN 16 2013	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1839	REV.
SHEET NO. 2 OF 4	


SUBSTRATE BY OTHERS PER "FRAME ANCHOR REQUIREMENTS TABLE"

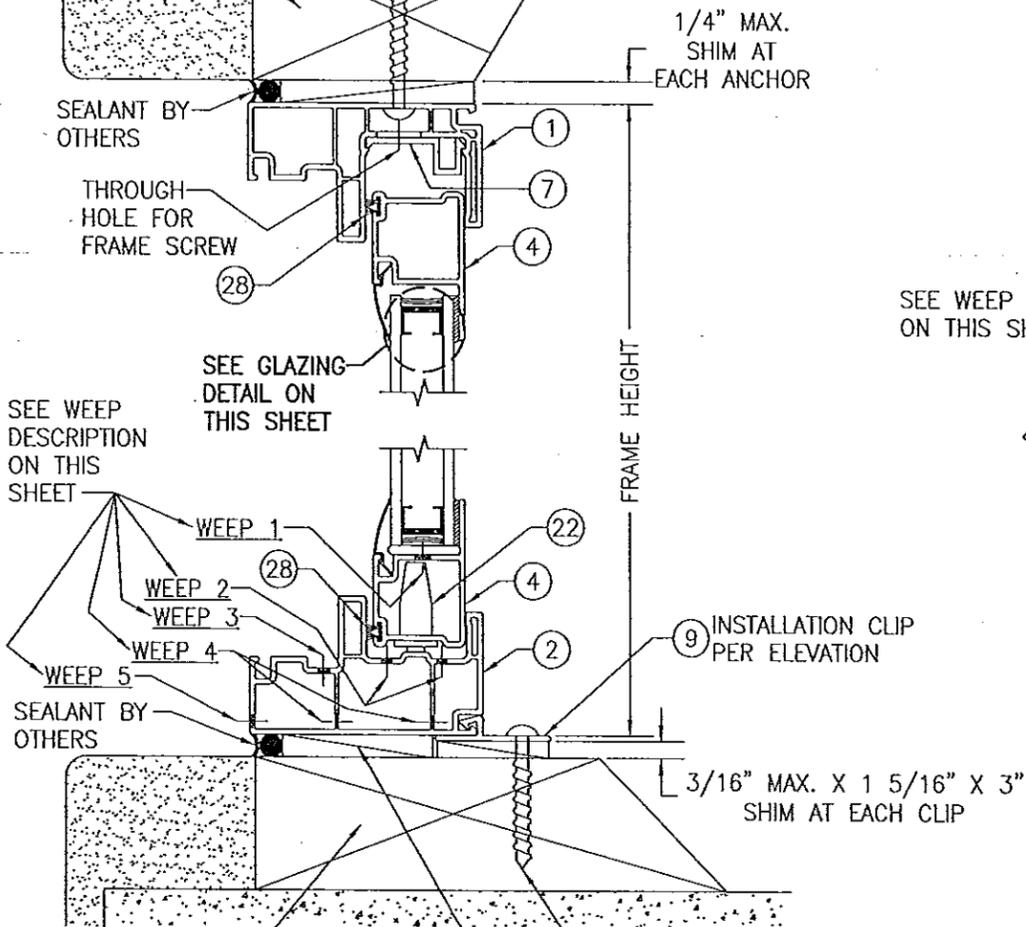

SECTION A
SCALE: 1/2 FULL

WEEP DESCRIPTIONS:

- WEEP 1: 5/8" X 1/8" WEEP SLOT 3 5/8" FROM SASH ENDS
- WEEP 2: 5/8" X 1/8" WEEP SLOT 3" FROM FRAME ENDS
- WEEP 3: 5/8" X 1/8" WEEP SLOT 2 7/8" FROM FIXED SASH FRAME END & 3 5/8" FROM CENTERLINE OF FIXED SASH FRAME
- WEEP 4: 1" X 0.145" WEEP SLOT FROM FRAME ENDS
- WEEP 5: 1.145" X 0.145" WEEP SLOT AT FRAME MITERS

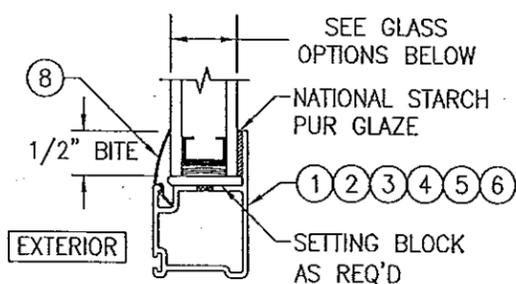


TYPICAL GLAZING DETAIL

GLASS OPTIONS:


- OPTION 1: 3/4" I.G. GLASS (1/8" AN./1/2" U-SHAPED TYPE CU-D STEEL SPACER/1/8" AN.)
- OPTION 2: 11/16" I.G. GLASS (3/32" AN./1/2" U-SHAPED TYPE CU-D STEEL SPACER/3/32" AN.)

SUBSTRATE BY OTHERS PER "FRAME ANCHOR REQUIREMENTS TABLE"

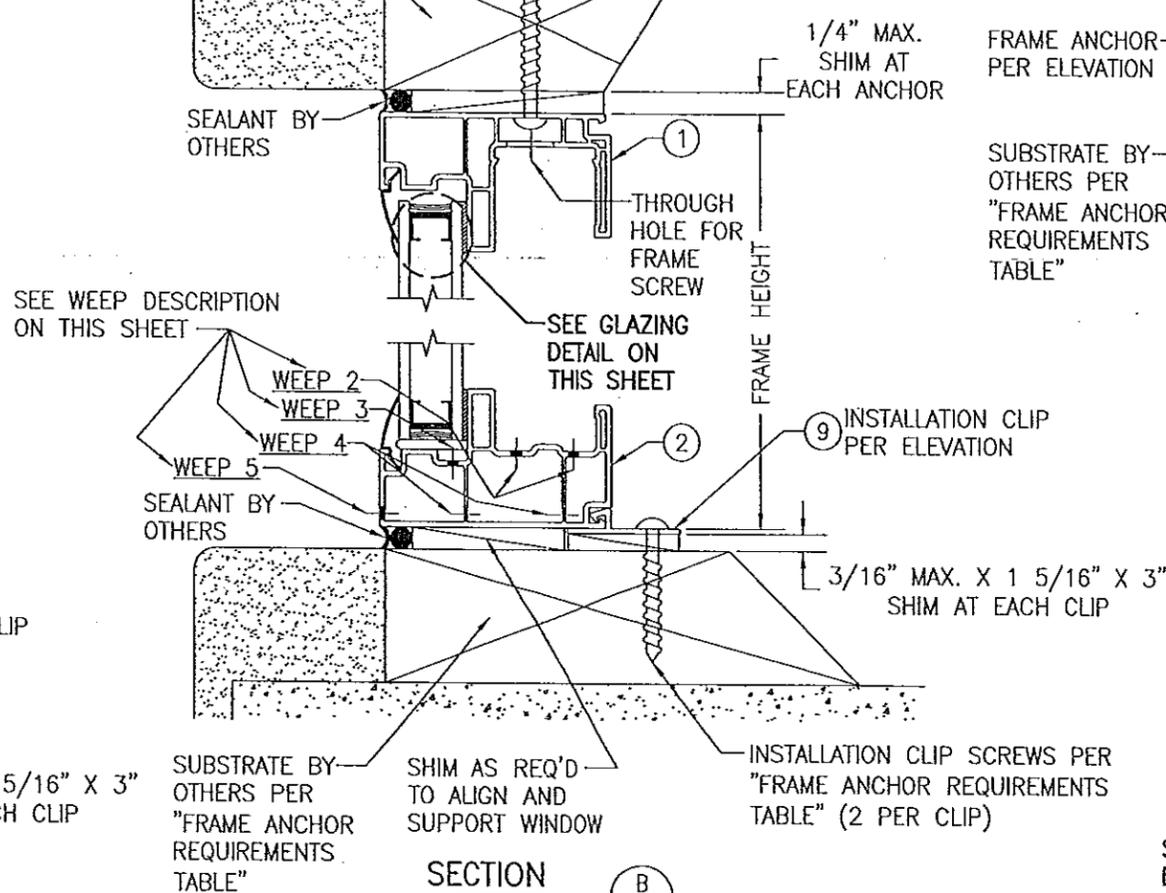


SECTION B
SCALE: 1/2 FULL


1/4" MAX. SHIM AT EACH ANCHOR

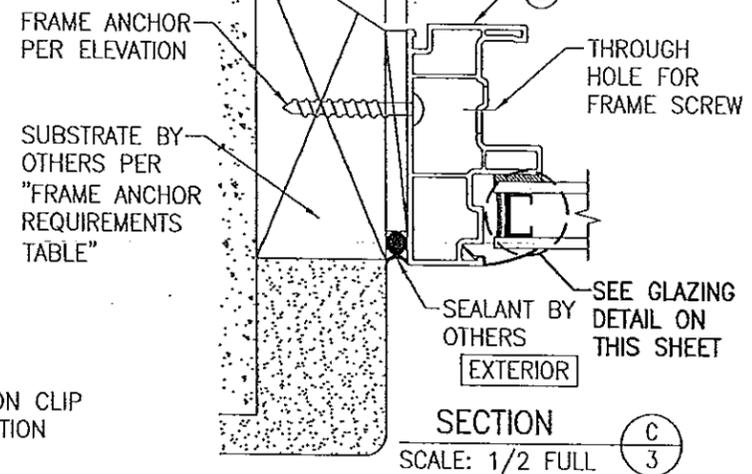

SECTION C
SCALE: 1/2 FULL

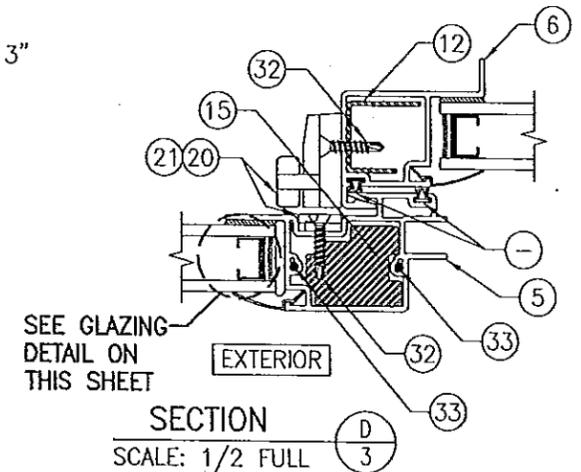

SECTION D
SCALE: 1/2 FULL

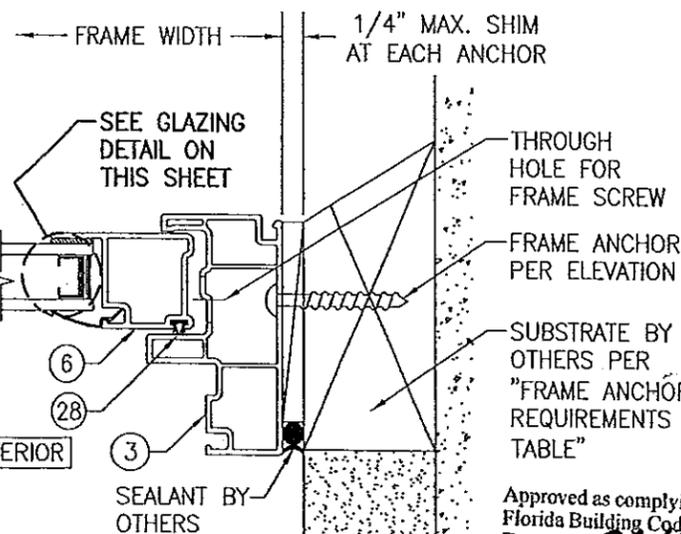

SECTION E
SCALE: 1/2 FULL

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 14-0428.08
 Expiration Date 01/31/2018
 By [Signature]
 Miami Dade Product Control



Approved as complying with the Florida Building Code
 Date 01/31/2013
 NOA# 12-1108.03
 Miami Dade Product Control
 By [Signature]

DRAWN BY: W.R.W.	CHECKED BY: W.W.S.
PLOT: 1=2	DATE: 10/10/12
NO.:	REVISION DESCRIPTION
DATE	BY
NO.	DESCRIPTION
DRAWING TITLE 10 SERIES VINYL NON-IMPACT SLIDING GLASS WINDOW	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH, 33418 PALM BEACH GARDENS, FL PHONE: 561-744-3424	
DRAWING NO. 1839	
SHEET NO. 3 OF 4	
CERTIFICATION JAN 16 2013 WARREN W. SCHAEFER, P.E. P.E. NO. 44135	

PELLA CORPORATION
 102 MAIN STREET
 PELLA, IA 50219
 641-621-1000




MANUFACTURER
 PELLA CORPORATION
 102 MAIN STREET
 PELLA, IA 50219
 641-621-1000

ITEM #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS		
1	HEAD FRAME	(*) VINYL
2	SILL FRAME	(*) VINYL
3	JAMB FRAME	(*) VINYL
4	TOP & BOTTOM RAIL & JAMB STILE	(*) VINYL
5	FIXED PANEL INTERLOCK STILE	(*) VINYL
6	ACTIVE PANEL INTERLOCK STILE	(*) VINYL
7	ANTI-LIFT BRACKET	(*) VINYL
8	GLAZING BEAD	(*) VINYL
9	INSTALLATION CLIP	(*) VINYL
12	ACTIVE PANEL INTERLOCK STILE REINFORCEMENT	ASTM A653-05A TYPE A GALVANIZED STEEL
15	FIXED PANEL INTERLOCK STILE REINFORCEMENT	6061-T6 ALUMINUM
HARDWARE		
20	CAM LOCK	PELLA V615002 DIE CAST ZINC
21	CAM LOCK KEEPER	PELLA V700123 DIE CAST ZINC
22	ROLLER HOUSING WITH WHEEL	PELLA 801999
SEALS & SEALANTS		
28	PILE WEATHERSTRIP	AMESBURY V420628
FASTENERS		
32	NO. 6 X 3/4 ZINC PLATED TEK SCREW	2 PER EACH CAM LOCK & CAM LOCK KEEPER INTO STILE REINFORCEMENT
33	NO. 6 X 1 5/8" BUGLE HEAD COURSE THREAD 18-8 S.S. SCREW	2 PER EACH FIXED PANEL INTERLOCK STILE END


(*) WHITE RIGID PVC EXTERIOR EXTRUSIONS FOR WINDOWS AND DOORS BY MIKRON INDUSTRIES, INC. PER AAMA CERTIFIED PVC EXTRUSION LISTING, MIAMI-DADE COUNTY PRODUCT CONTROL APPROVAL AND FBC 2010

CONTINUOUS WOOD MEMBER LESS IN THICKNESS THAN A 2X BUCK TO BE MIN. 2 1/2" DEEP (NOT REQUIRED WHEN SHIM SPACE IS WITHIN ALLOWABLE DIMENSIONS SHOWN IN SECTIONS).

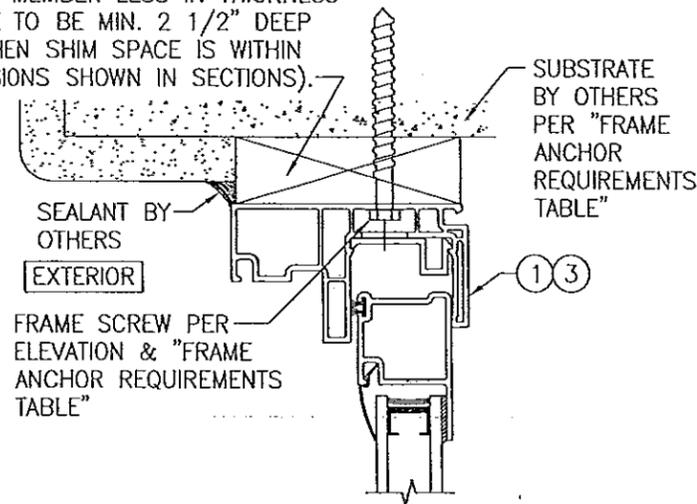

OPTIONAL DIRECT MOUNT DETAIL TO SUBSTRATE WITH SPACER
 (HEAD SECTION SHOWN; SIDES ARE INSTALLED THE SAME)
 (SILL IS NOT APPLICABLE TO THIS DETAIL)
 (FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

PRODUCT REVISION as complying with the Florida Building Code
 Acceptance No. 14-0428.08
 Expiration Date 01/31/2018
 By: [Signature]
 Miami Dade Product Control

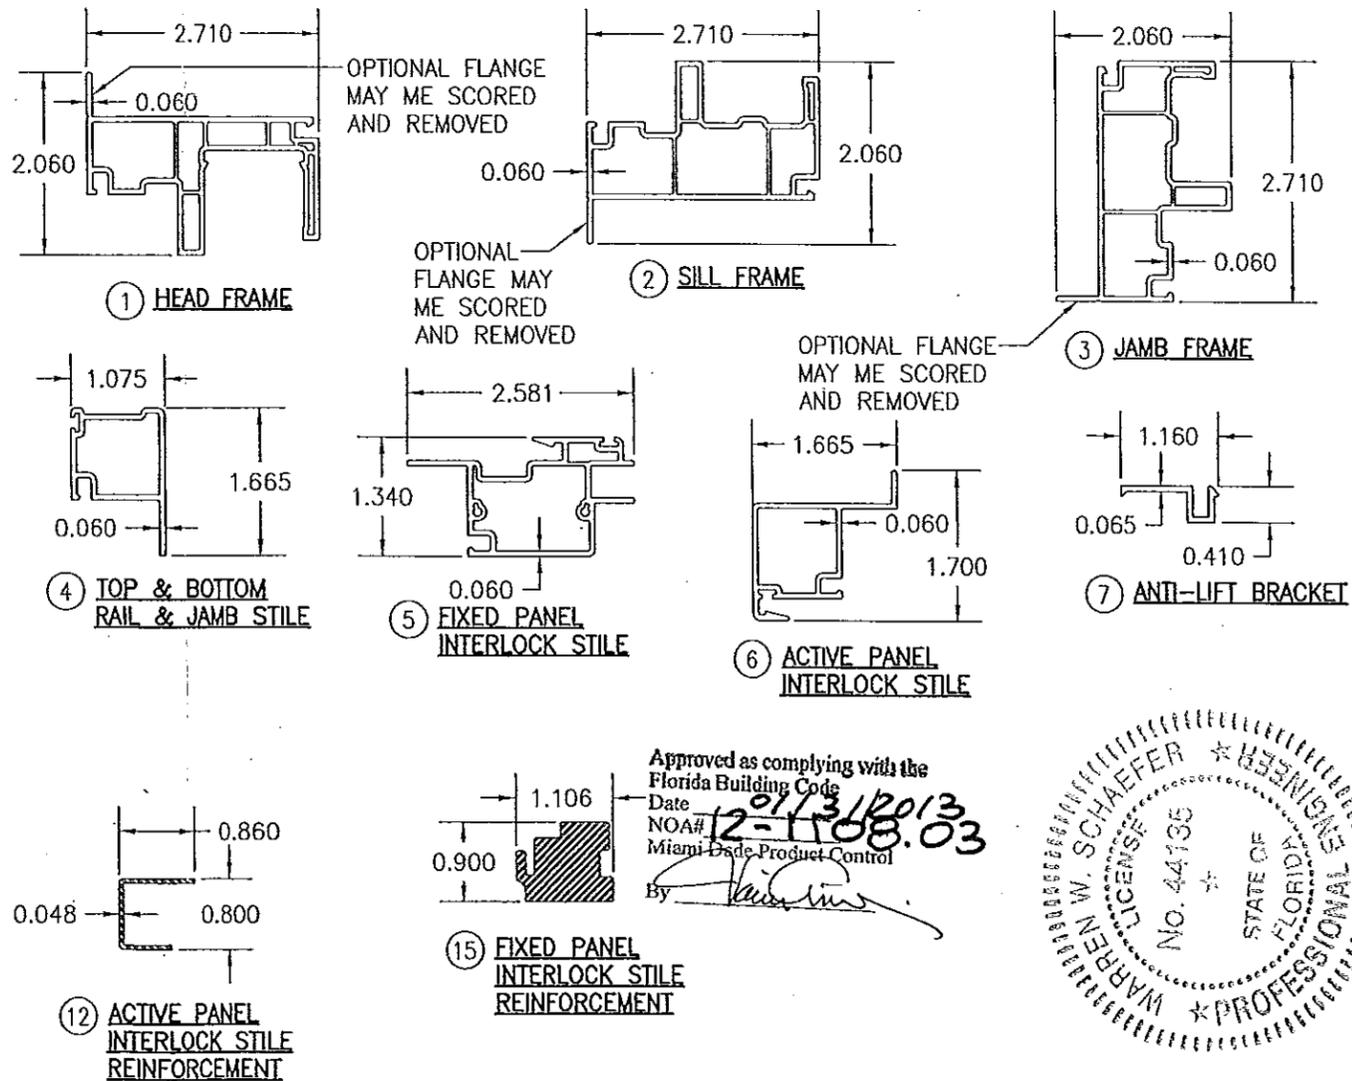

Approved as complying with the Florida Building Code
 Date 12-11-08.03
 NOA# 12-11-08.03
 Miami Dade Product Control
 By: [Signature]



DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-2	DATE: 10/10/12
DATE	
BY	
REVISION DESCRIPTION	
NO.	

DRAWING TITLE: 10 SERIES VINYL NON-IMPACT SLIDING GLASS WINDOW

MANUFACTURER: PELLA CORPORATION
 102 MAIN STREET
 PELLA, IA 50219
 641-621-1000

CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)
 7480 150TH COURT NORTH
 PALM BEACH GARDENS, FL 33418
 PHONE: 561-744-3424

CERTIFICATION: JAN 16 2013
 WARREN W. SCHAEFER, P.E.
 P.E. NO. 44135

DRAWING NO. 1839
 SHEET NO. 4 OF 4