



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**NOTICE OF ACCEPTANCE (NOA)**

**Peeetz Windows and Doors, Inc.**  
15951 SW 41 Street, Suite 150  
Weston, FL 33331

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Weight & Chain Balance" Wood Single & Double Hung Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. 1507 titled "Wood Double & Single Hung Impact Window with Weight & Chain Balance System" sheets 1 through 6 of 6, dated 12/06/06, with revision A1 dated 10/20/11, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA# 11-1109.03 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



*Handwritten signature and date: MP 7/16/14*

NOA No. 14-0429.14  
Expiration Date: July 05, 2017  
Approval Date: July 24, 2014  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **1507** titled "Wood Double & Single Hung Impact Window with Weight & Chain Balance System" sheets 1 through 6 of 6, dated 12/06/06, with revision A1 dated 10/20/11, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.  
*(Submitted under previous NOA No. 11-1109.03)*

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94along with marked-up drawings and installation diagram of a wood double & single hung window with weight & chain system, marked-up by Hurricane Test Laboratory, LLC Test Report No. **HTL-0284-1110-06**, dated 12/11/06-01/25/07, signed and sealed by Vinu J. Abraham, P.E.  
*(Submitted under NOA No. 07-0403.10)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2007 and 2010, dated 01/29/07, revised and updated on 10/14/11, prepared by W.W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.  
*(Submitted under previous NOA No. 11-1109.03)*
2. Glazing complies with ASTM E1300-04.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)



---

Manuel Perez, P.E.

Product Control Examiner

NOA No. 14-0429.14

Expiration Date: July 05, 2017

Approval Date: July 24, 2014

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **12-1231.08** issued to **Eastman Chemical Company (MA)** for their "**Saflex CP – Saflex and Saflex HP Composite Glass Interlayers with PET Core**" dated 03/28/13, expiring on 12/11/18.

**F. STATEMENTS**

1. Statement letter of conformance, complying with **FBC -2010** and **FBC - 5<sup>th</sup> Edition (2014)**, dated 04/10/14, prepared by **W. W. Schaefer Engineering & Consulting, P.A.**, signed and sealed by **Warren W. Schaefer, P.E.**
2. Statement letter of no financial interest, dated 10/19/11, prepared by **W. W. Schaefer Engineering & Consulting, P.A.**, signed and sealed by **Warren W. Schaefer, P.E.**  
*(Submitted under previous NOA No. 11-1109.03)*
3. Laboratory compliance letter for Test Report No. **HTL-0284-1110-06**, issued by **Hurricane Test Laboratory, LLC**, dated March 27, 2007, signed and sealed by **Vinu J. Abraham, P.E.**  
*(Submitted under NOA No. 07-0403.10)*

**G. OTHERS**

1. Notice of Acceptance No. **11-1109.03** issued to **Peetz Windows and Doors, Inc.** for their Series "**Weight & Chain Balance**" **Wood Single & Double Hung Windows – L.M.I.**, approved on 02/16/12 and expiring on 07/05/17.



Manuel Perez, P.E.

Product Control Examiner

NOA No. 14-0429.14

Expiration Date: July 05, 2017

Approval Date: July 24, 2014

**GENERAL NOTES:**

1. THESE WINDOW SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR WATER, AIR, IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT WINDOWS.
5. THESE WINDOW SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE WINDOWS.
7. ALL ANCHORS SECURING WINDOW FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
8. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF  $K_d = 0.85$  MAY BE APPLIED PER THE ASCE-7 STANDARD.
9. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR  $C_d = 1.6$  WAS USED FOR WOOD SCREW ANALYSIS ONLY.
10. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20.
11. ALL WOOD MEMBERS OF WINDOWS THAT MAY POSSIBLY COME INTO CONTACT WITH MASONRY OR CONCRETE SUBSTRATES, ARE SUBJECT TO MOISTURE &/OR ARE SUBJECT TO THE OUTSIDE ENVIRONMENT SHALL BE OF AN APPROVED DURABLE SPECIES OR BE TREATED IN AN APPROVED METHOD WITH AN APPROVED PRESERVATIVE PER FBC SECTION 2326.

**CORNER CONSTRUCTION:**

**FRAME CORNERS:**

COPEd, BUTTED, JOINED WITH 6 NO. 14 X 3" SCREWS, AND GLUED WITH BINDAN D4 OR EQUIVALENT

**SASH CORNERS:**

MULTI-FORKED, BUTTED, & GLUED WITH BINDAN D4 OR EQUIVALENT


ALLOWABLE DESIGN PRESSURE  
+/- 75 PSF

**FRAME ANCHOR REQUIREMENTS TABLE**

| OPENING TYPE (SUBSTRATE)                          | FRAME/CLIP TO OPENING FASTENER TYPE | MINIMUM EMBED | MINIMUM EDGE DIST. |
|---|-------------------------------------|---------------|--------------------|
| <b>FRAME SHEAR SCREWS</b>                         |                                     |               |                    |
| MIN. 2X6 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55) | NO. 14 SMS OR WOOD SCREW            | 1 1/4"        | 3/4"               |
| MIN. 18 GA. 33 KSI METAL STUD                     | 1/4-14 SELF TAP/DRILLING SCREW      | FULL          | 1/2"               |
| MIN. 1/8" THK A36 STEEL                           | 1/4-14 SELF TAP/DRILLING SCREW      | FULL          | 1/2"               |
| MIN. 1/8" THK 6063-T5 ALUM.                       | 1/4-14 SELF TAP/DRILLING SCREW      | FULL          | 1/2"               |
| (2) MIN. C-90 CMU                                 | (1) 1/4" CONCRETE SCREW             | 1 1/4"        | 2 1/2"             |
| MIN. 2500 PSI CONCRETE                            | (1) 1/4" CONCRETE SCREW             | 1 1/2"        | 2 1/2"             |
| <b>FRAME MOUNTING CLIP</b>                        |                                     |               |                    |
| MIN. 2X6 WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55) | NO. 8 X 1 1/2" SMS                  | 1 3/8"        | 1/2"               |
| MIN. 1/8" THK A36 STEEL                           | NO. 8-18 SELF TAP/DRILLING SCREW    | FULL          | 1/2"               |
| MIN. 1/8" THK 6063-T5 ALUM.                       | NO. 8-18 SELF TAP/DRILLING SCREW    | FULL          | 1/2"               |

- (1) CONCRETE SCREWS SHALL BE ELCO ULTRACONS, ELCO CRETE-FLEX, ITW RAMSET/RED HEAD TAPCONS OR HILTI KWIK-CON II (HARDENED STEEL OR S.S.).
- (2) CMU IS APPLICABLE AT SIDES ONLY.

FRAME SCREW SPACING:  
12" MAX. O.C. WHEN WINDOW FRAME WIDTH IS GREATER THAN 52".  
15" MAX. O.C. WHEN WINDOW FRAME WIDTH IS 52" OR LESS.  
CLIP SPACING:  
15" MAX. O.C. FOR ALL WINDOW SIZES

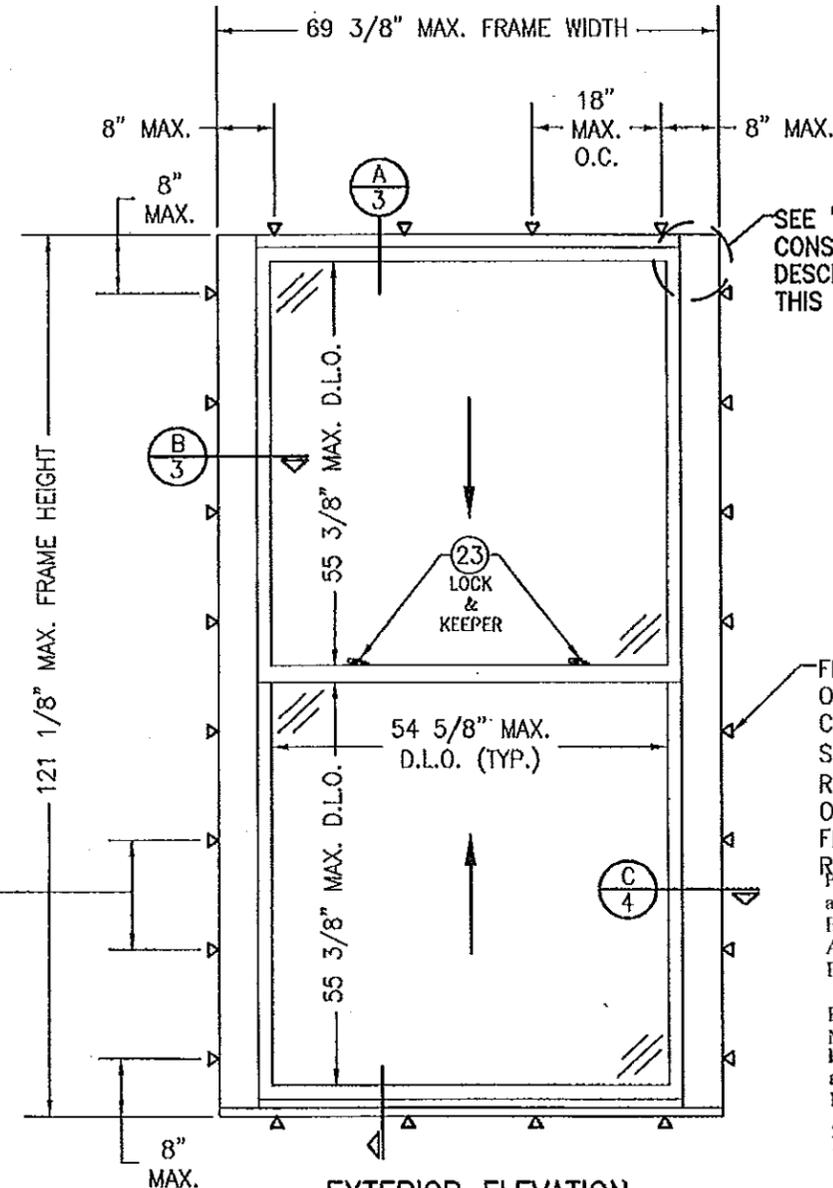

**EXTERIOR ELEVATION  
(SINGLE WINDOW)**

SCALE: 1/2"=1'-0"

(DOUBLE HUNG WINDOW SHOWN. SINGLE HUNG IS IDENTICAL EXCEPT THE TOP SASH IS FIXED)

THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

|           |           |                   |          |
|-----------|-----------|-------------------|----------|
| DRAWN BY: | W.R.M.    | CHECKED BY:       | W.W.S.   |
| PLOT:     | 1-24      | DATE:             | 12/08/08 |
| NO.       | REVISION  | DESCRIPTION       | DATE     |
| A1        | UPDATE TO | CURRENT STANDARDS | 10/20/11 |

SEE "CORNER CONSTRUCTION" DESCRIPTION ON THIS SHEET

FRAME SHEAR SCREW OR FRAME MOUNTING CLIP WHERE SHOWN. SEE "FRAME ANCHOR REQUIREMENTS TABLE" ON THIS SHEET FOR FRAME & CLIP SCREW REQUIREMENTS.

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 14-0429.14  
Expiration Date July 5, 2017

By *Manuel Perez*  
Miami Dade Product Control  
PRODUCT REVISED as complying with the Florida Building Code

Acceptance No. 11-1109.03  
Expiration Date July 5, 2017

By *Manuel Perez*  
Miami Dade Product Control




DRAWING TITLE: WOOD DOUBLE & SINGLE HUNG IMPACT WINDOW WITH WEIGHT & CHAIN BALANCE SYSTEM  
MANUFACTURER: PEITZ WINDOWS & DOORS  
15951 S.W. 41ST STREET, SUITE 150  
WESTON, FL 33331  
954-659-3887

CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)  
7490 150TH COURT NORTH  
PALM BEACH GARDENS, FL 33418  
PHONE: 561-744-3424

CERTIFICATION: OCT 20 2011  
WARREN W. SCHAEFER, P.E.  
P.E. NO. 44135


|             |      |
|-------------|------|
| DRAWING NO. | REV. |
| 1507        | A    |
| SHEET NO.   |      |
| 1 OF 6      |      |

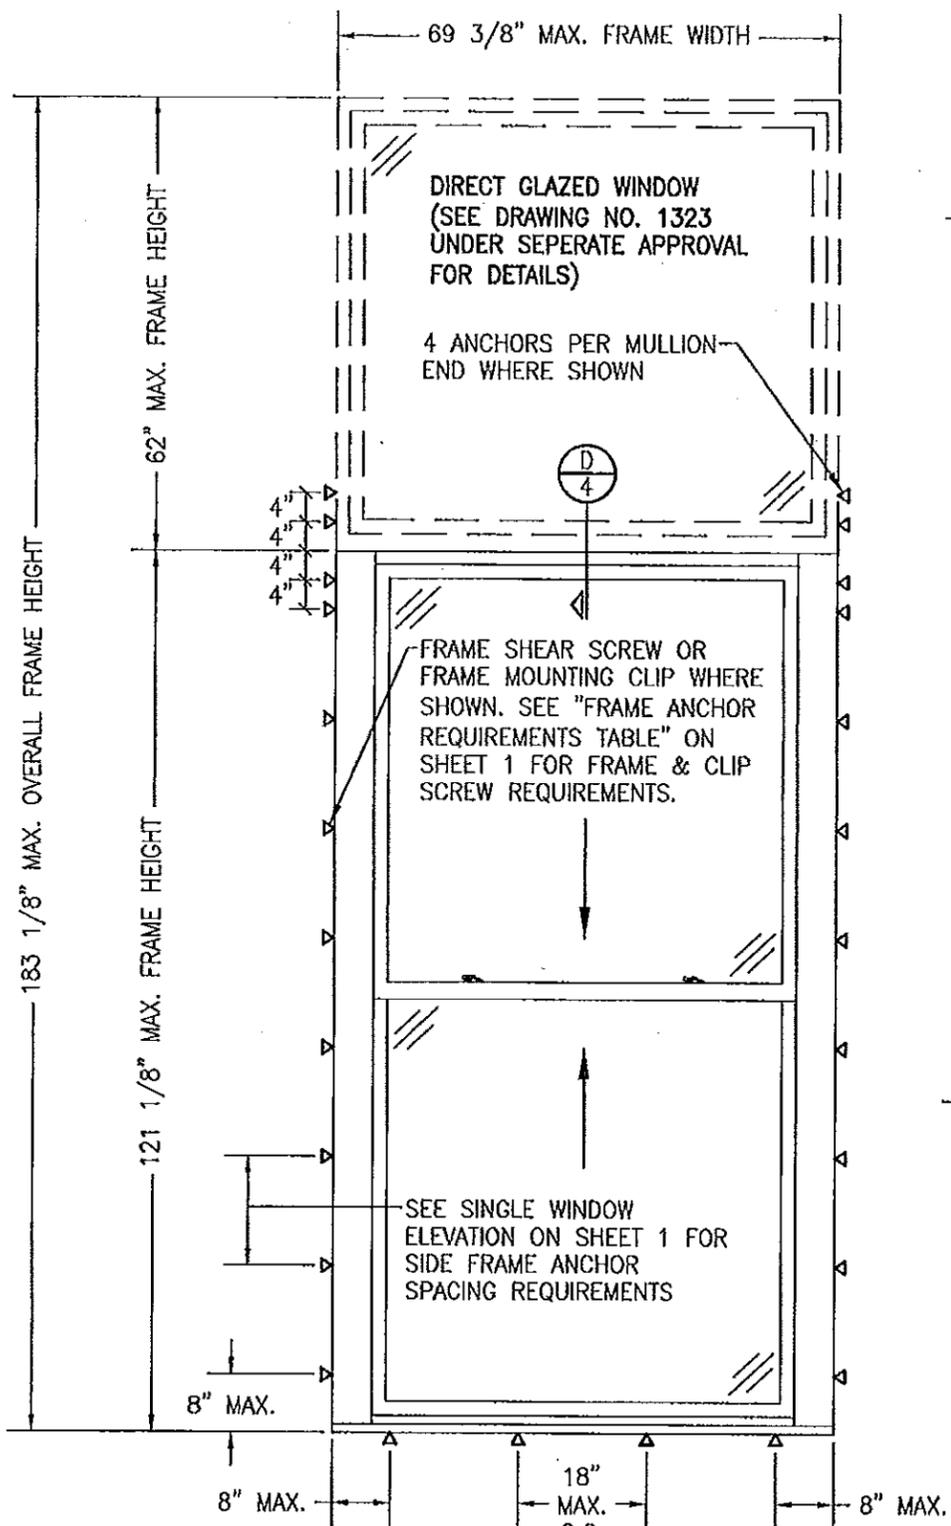

**EXTERIOR ELEVATION  
(SINGLE WINDOW WITH TRANSOM)**

SCALE: 1/2"=1'-0"

FOR ALL DETAIL NOT SHOWN, SEE SINGLE WINDOW ELEVATION.

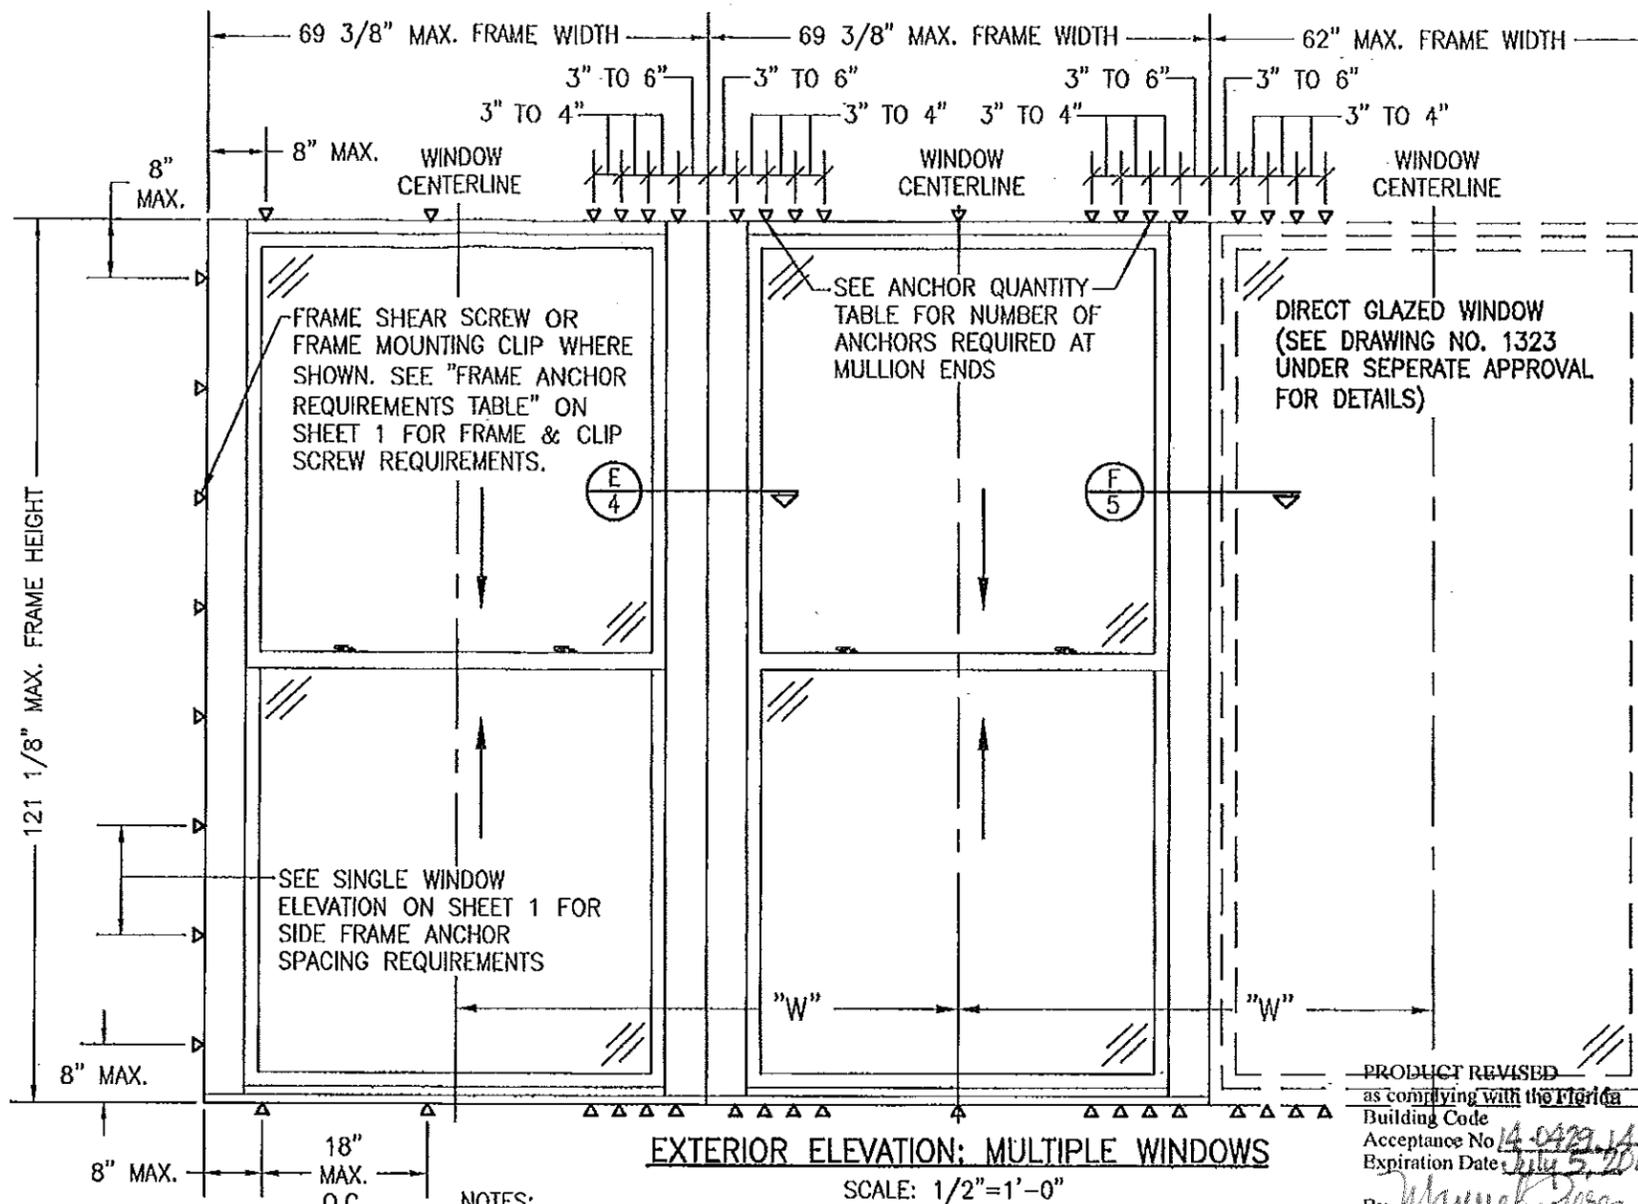

**EXTERIOR ELEVATION; MULTIPLE WINDOWS**

SCALE: 1/2"=1'-0"

**NOTES:**


1. FOR ALL DETAIL NOT SHOWN, SEE SINGLE WINDOW ELEVATION.
2. ANY COMBINATION OF FIXED & OPERABLE WINDOWS MAY BE USED.
3. NUMBER OF WINDOWS IN ONE OPENING IS NOT RESTRICTED PROVIDING THE SUPPORT ALL LOADS TRANSFERED FROM THE WINDOWS & THEIR MULLIONS.

DOUBLE HUNG WINDOWS SHOWN. SINGLE HUNGS ARE THE SAME EXCEPT TOP SASH IS FIXED.


| MAX. WINDOW FRAME HEIGHT | MAX. DISTANCE "W" | QUANTITY OF ANCHORS PER MULLION END REQUIRED |                |
|--------------------------|-------------------|--|----------------|
|                          |                   | FRAME SCREWS                                 | MOUNTING CLIPS |
| 121"                     | 69"               | 8  | 6              |
| 121"                     | 54"               | 6  | 6              |
| 121"                     | 36"               | 4  | 4              |
| 96"                      | 69"               | 6  | 6              |
| 96"                      | 46"               | 4  | 4              |
| 84"                      | 69"               | 6  | 4              |
| 84"                      | 52"               | 4  | 4              |
| 72"                      | 69"               | 6  | 4              |
| 72"                      | 61"               | 4  | 4              |

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 14-0429-14 Expiration Date: July 5, 2017  
By *Manuel Perez*  
Miami Dade Product Control


PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 11-1109-03 Expiration Date: July 5, 2017  
By *Manuel Perez*  
Miami Dade Product Control

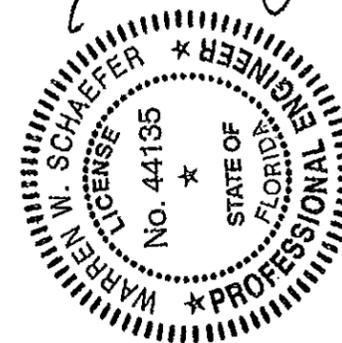

|  |   |
|--|---|
| DRAWN BY:<br>W.R.M.  | CHECKED BY:<br>W.W.S.   |
| PLOT:<br>1-24  | DATE:<br>12/08/06   |
| DATE   | BY  |
| REVISION DESCRIPTION   | NO.   |
| DRAWING TITLE<br><b>WOOD DOUBLE &amp; SINGLE HUNG IMPACT WINDOW WITH WEIGHT &amp; CHAIN BALANCE SYSTEM</b> |   |
| CONSULTANTS<br><b>W. W. SCHAEFER ENGINEERING &amp; CONSULTING, P.A. (CA 6809)</b>                          | MANUFACTURER<br><b>PEETZ WINDOWS &amp; DOORS</b>                      |
| 7480 150TH COURT NORTH<br>PALM BEACH GARDENS, FL 33418<br>PHONE: 561-744-3424                              | 15951 S.W. 41ST STREET, SUITE 150<br>WESTON, FL 33331<br>954-659-3887 |
| CERTIFICATION<br><b>OCT 20 2011</b><br>WARREN W. SCHAEFER, P.E.<br>P.E. NO. 44135                          | DRAWING NO. 1507<br>SHEET NO. 2 OF 6                                  |

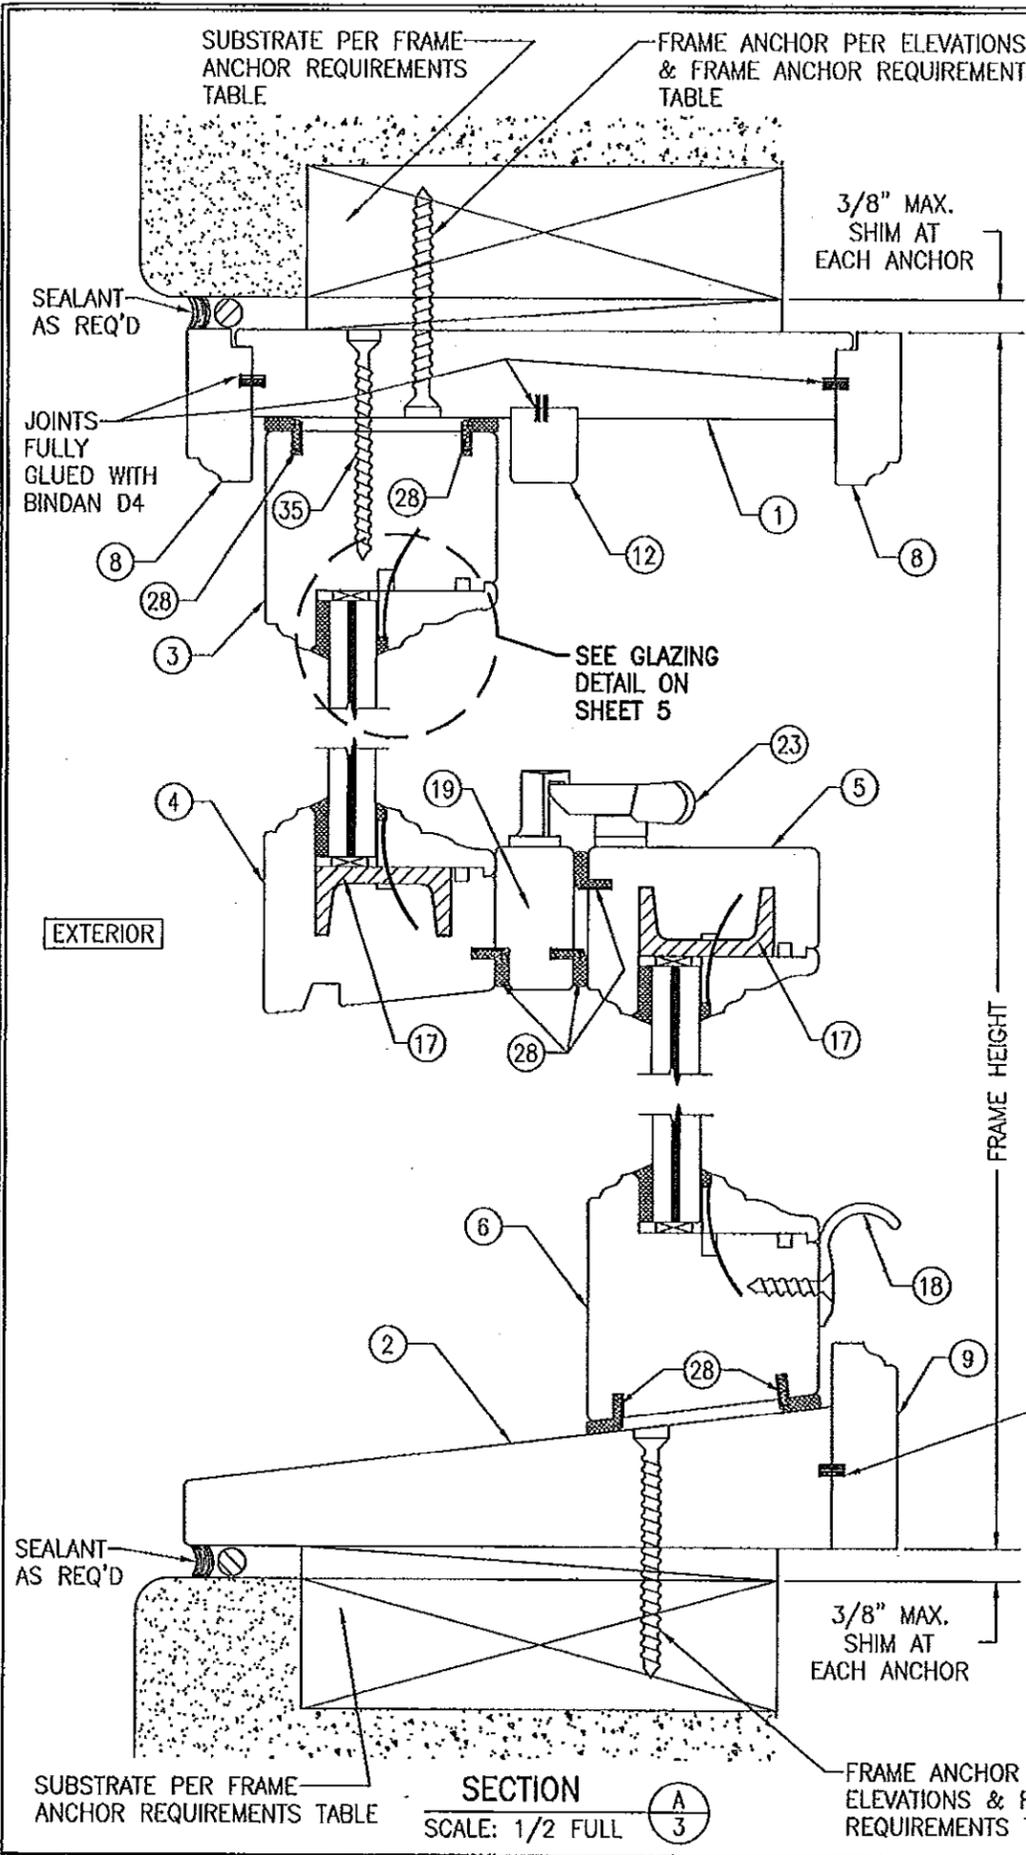


SECTION A  
SCALE: 1/2 FULL

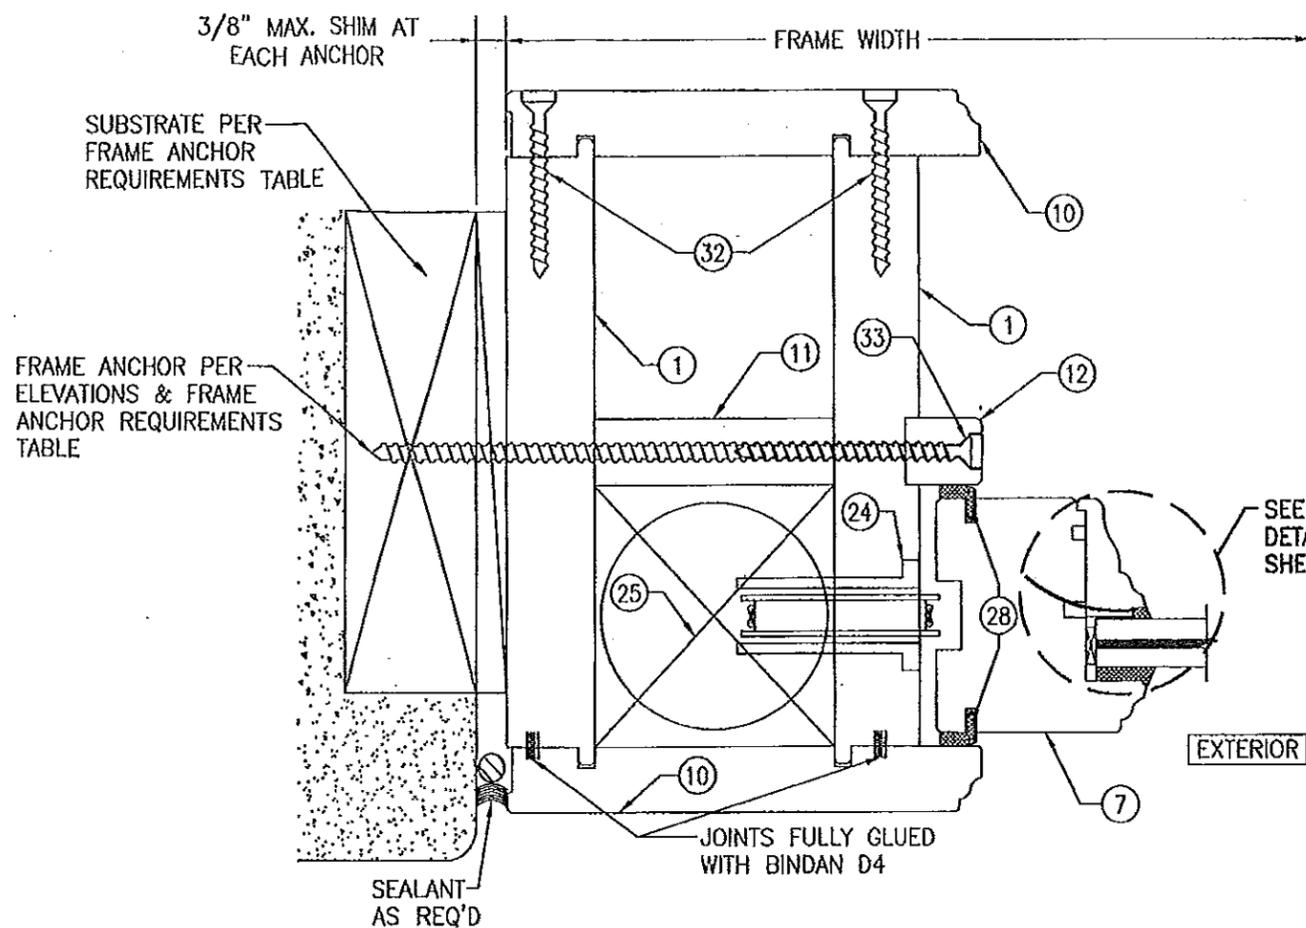

SECTION B  
SCALE: 1/2 FULL


GLUE NOTE: ALL SURFACES SPECIFIED AS GLUED SHALL INCLUDE THE FULL CONTACT SURFACE AREA AND THUS BE FULLY LAMINATED

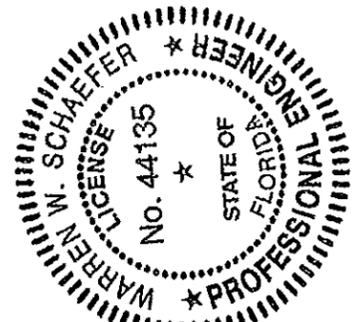

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 14-0429.14  
Expiration Date July 5, 2017  
By Manuel Perez  
Miami Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 11-1109.03  
Expiration Date July 5, 2017  
By Manuel Perez  
Miami Dade Product Control

|   |   |
|---|---|
| DRAWN BY:<br>W.R.L.   | CHECKED BY:<br>W.W.S.   |
| PLOT:<br>1-2  | DATE:<br>12/06/06   |
| DATE  |   |
| BY  |   |
| REVISION DESCRIPTION  |   |
| NO.   |   |
| DRAWING TITLE: WOOD DOUBLE & SINGLE HUNG IMPACT WINDOW WITH WEIGHT & CHAIN BALANCE SYSTEM |   |
| MANUFACTURER:   | PEETZ WINDOWS & DOORS   |
| CONSULTANTS:  | 15951 S.W. 41ST STREET; SUITE 150<br>WESTON, FL 33331<br>954-659-3887 |
| CERTIFICATION:  | OCT 20 2011   |
| DRAWING NO.:  | 1507  |
| REV.:   | A   |
| SHEET NO.:  | 3 OF 6  |

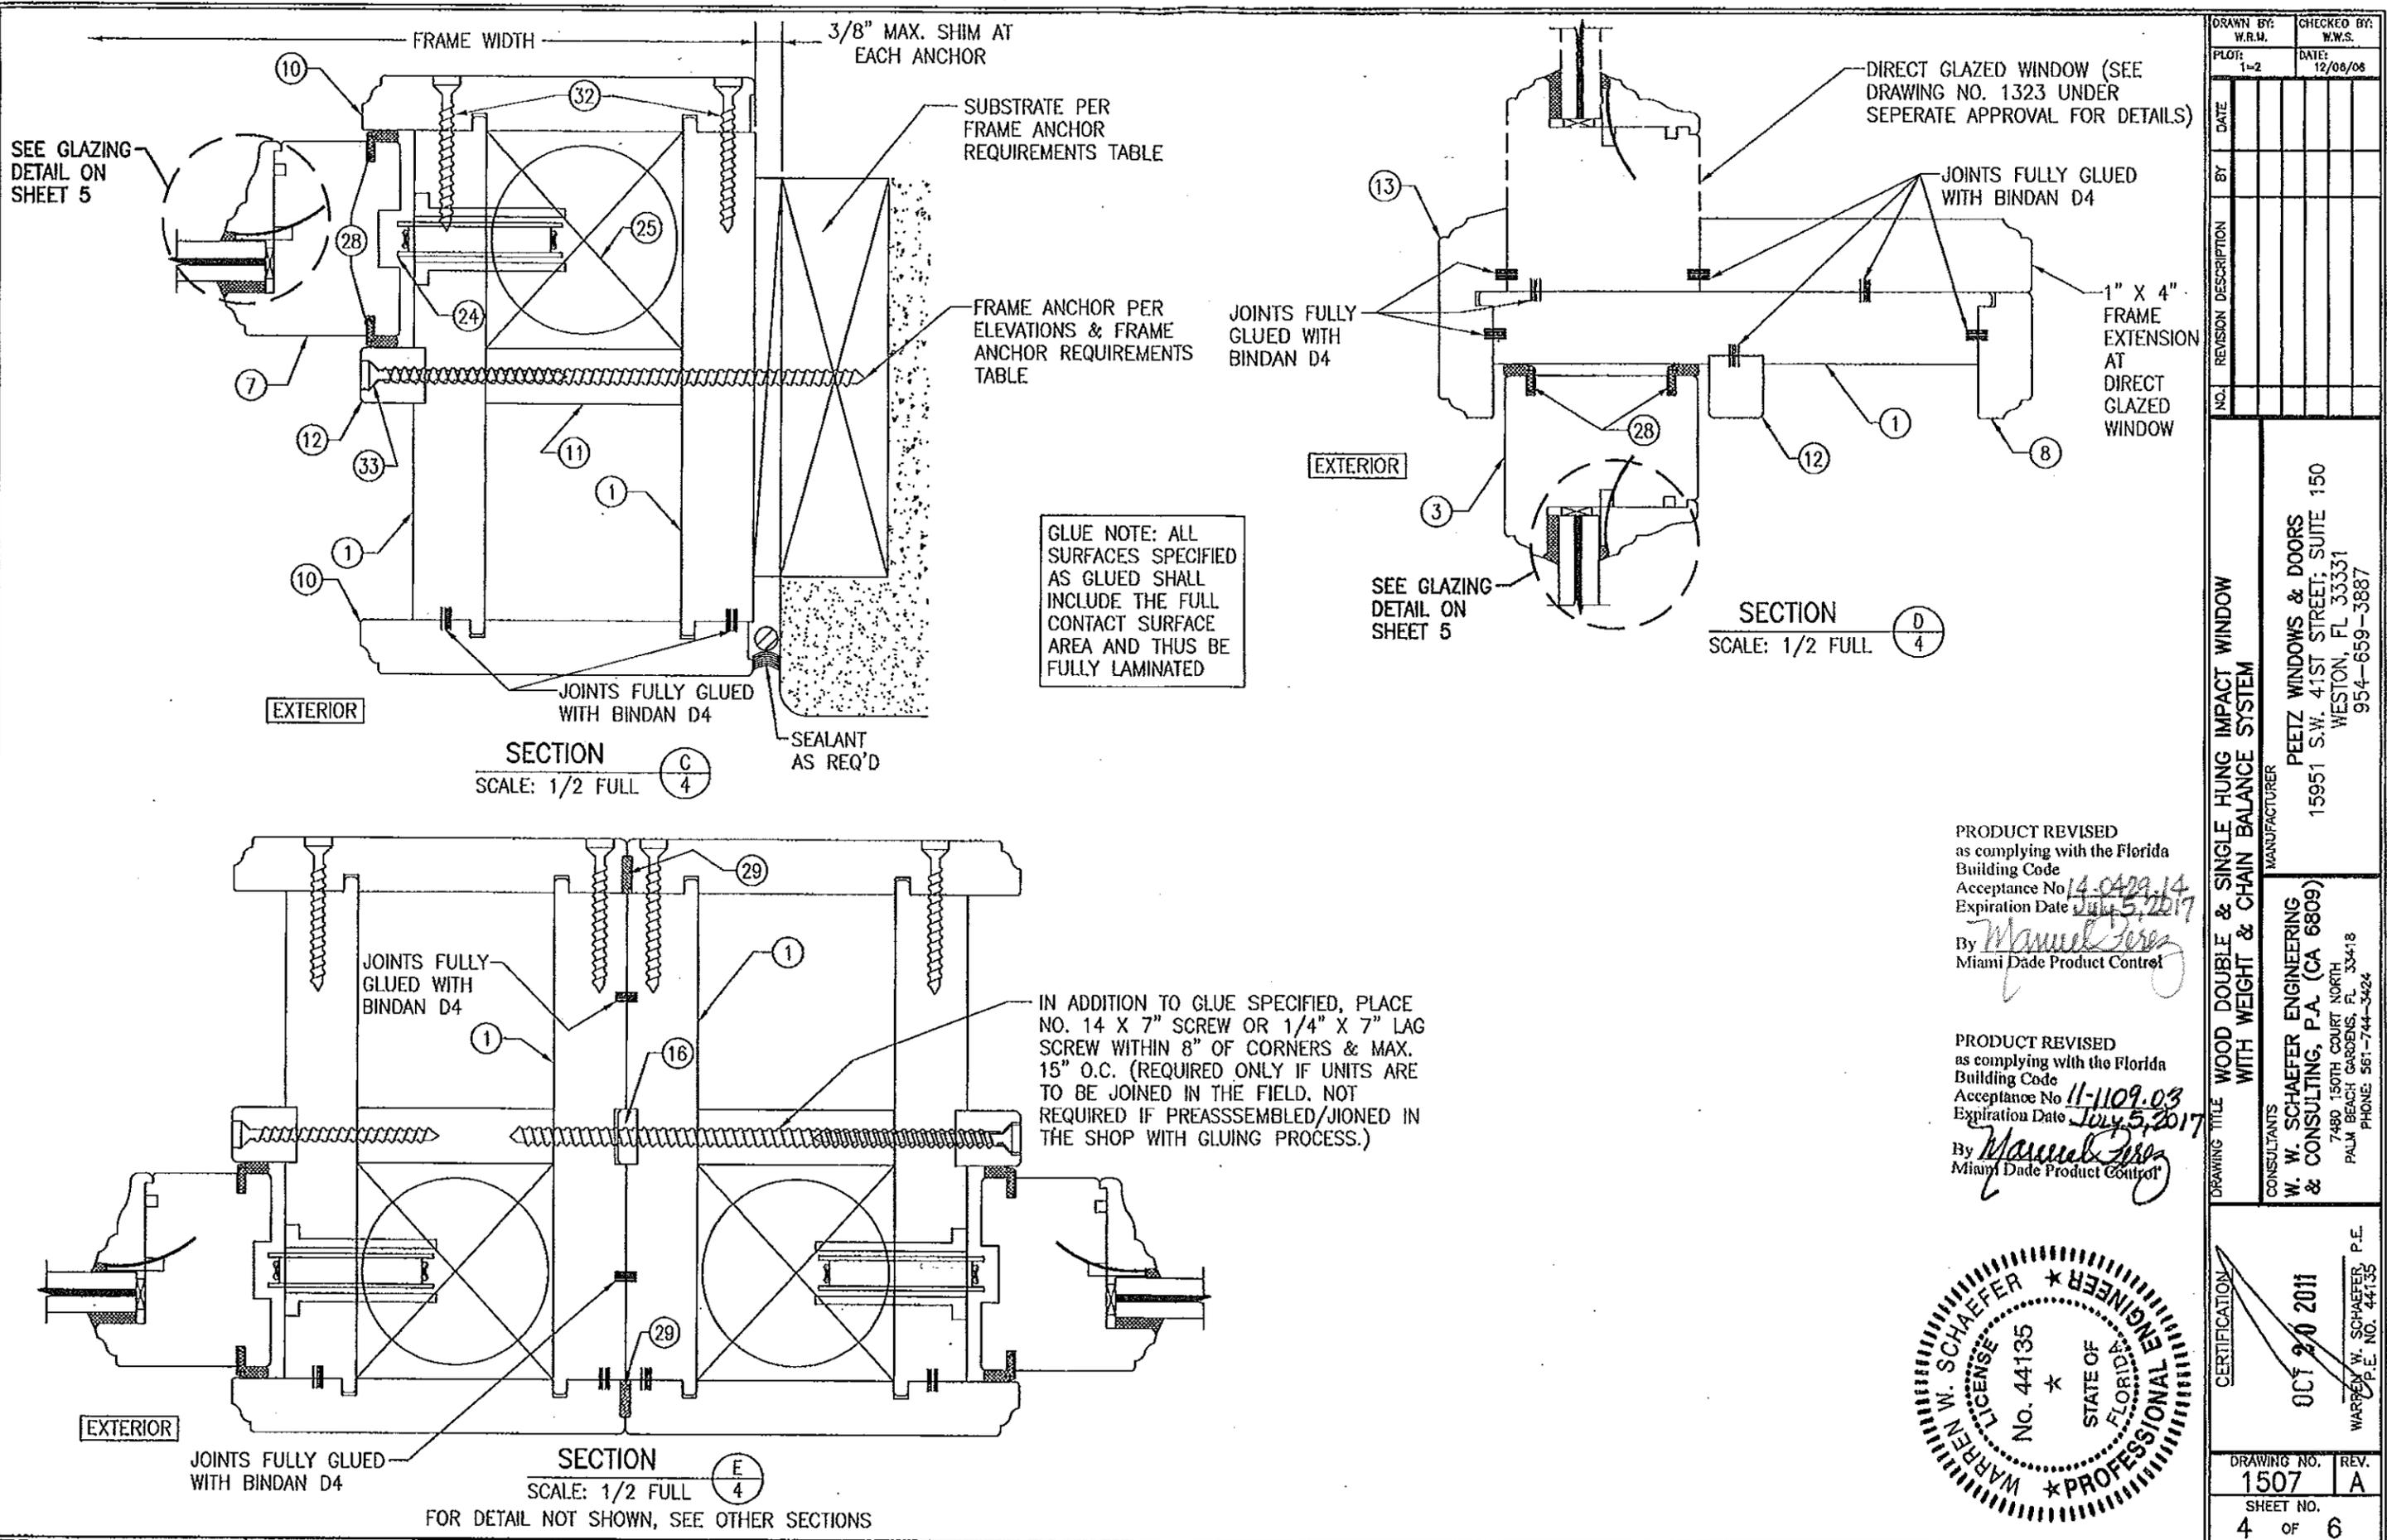

|                      |        |             |          |
|----------------------|--------|-------------|----------|
| DRAWN BY:            | W.R.M. | CHECKED BY: | W.W.S.   |
| PLOT:                | 1-2    | DATE:       | 12/08/08 |
| DATE                 |        |             |          |
| BY                   |        |             |          |
| REVISION DESCRIPTION |        |             |          |
| NO.                  |        |             |          |

MANUFACTURER  
**PEETZ WINDOWS & DOORS**  
 15951 S.W. 41ST STREET, SUITE 150  
 WESTON, FL 33331  
 954-659-3887


CONSULTANTS  
**W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)**  
 7480 150TH COURT NORTH  
 PALM BEACH GARDENS, FL 33418  
 PHONE 561-744-3424

CERTIFICATION  
 OCT 20 2011  
 WARREN W. SCHAEFER, P.E.  
 P.E. NO. 44135

|             |      |
|-------------|------|
| DRAWING NO. | REV. |
| 1507        | A    |
| SHEET NO.   | OF   |
| 4           | 6    |

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 14-0029.14  
 Expiration Date July 5, 2017  
 By *Manuel Perez*  
 Miami Dade Product Control




PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 11-1109.03  
 Expiration Date July 5, 2017  
 By *Manuel Perez*  
 Miami Dade Product Control

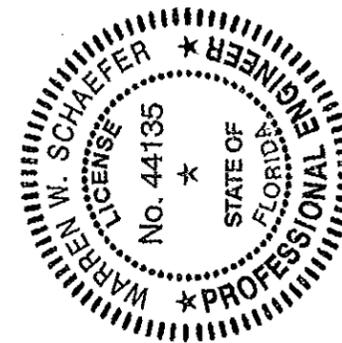



| ITEM #           | ITEM DESCRIPTION                         | MANUFACTURER/NOTES  |
|------------------|--|---|
| PARTS            |  |   |
| 1                | HEAD/SIDE JAMB                           | MAHOGANY  |
| 2                | SILL                                     | MAHOGANY  |
| 3                | TOP RAIL OF TOP SASH                     | MAHOGANY  |
| 4                | BOTTOM RAIL OF TOP SASH                  | MAHOGANY  |
| 5                | TOP RAIL OF BOTTOM SASH                  | MAHOGANY  |
| 6                | BOTTOM RAIL OF BOTTOM SASH               | MAHOGANY  |
| 7                | FIXED STILE                              | MAHOGANY  |
| 8                | HEAD JAMB CAP                            | MAHOGANY  |
| 9                | SILL JAMB CAP                            | MAHOGANY  |
| 10               | JAMB COVER                               | MAHOGANY  |
| 11               | JAMB SPACER                              | MAHOGANY  |
| 12               | TRACK GUIDE                              | MAHOGANY  |
| 13               | JAMB TO DIRECT GLAZED WINDOW COVER       | MAHOGANY  |
| 14               | NON I.G. GLASS GLAZING STOP              | MAHOGANY  |
| 15               | I.G. GLASS GLAZING STOP                  | MAHOGANY  |
| 16               | JAMB FILLER                              | MAHOGANY  |
| 17               | STILE REINFORCEMENT                      | A36 STEEL   |
| 18               | SASH LIFT                                | BY BRONZE CRAFT   |
| 19               | ASTRAGAL                                 | MAHOGANY  |
| 20               | INSTALLATION CLIP                        | GALVANIZED 34.1 KSI STEEL OR S.S.   |
| HARDWARE         |  |   |
| 23               | SASH LOCK                                | BY BRONZE CRAFT   |
| 24               | SASH PULLY                               | BY BRONZE CRAFT   |
| 25               | COUNTER WEIGHT                           | LEAD  |
| SEALS & SEALANTS |  |   |
| 28               | COMPRESSION SEAL                         | SCHLEGEL  |
| 29               | PRECOMPRESSED TAPE                       | -   |
| FASTENERS        |  |   |
| 32               | NO. 8 X 2" WOOD SCREW                    | WITHIN 1" OF CORNERS & 10" MAX. O.C.  |
| 33               | NO. 7 X 2 3/4" WOOD SCREW                | WITHIN 1 1/2" OF CORNERS & 12" MAX. O.C.                                    |
| 34               | OPTIONAL 18 GA. X 1 1/4 GALV CURVED NAIL | WITHIN 10" OF CORNERS & 20" MAX. O.C.                                       |
| 35               | NO. 8 X 2 1/2" SMS SCREW                 | 4 PER TOP SASH EQUALLY SPACED<br>(ONLY REQUIRED WITH SINGLE HUNG CONDITION) |

NOTE: WOOD USED IN TESTING WAS MAHOGANY WITH A SPECIFIC GRAVITY OF  $G = 0.67$  AND A MODULUS OF ELASTICITY OF  $E = 1,700,000$  PSI. OTHER WOOD SPECIES APPLICABLE FOR USE WITH THIS PRODUCT ARE THOSE WITH A SPECIFIC GRAVITY OF 0.67 AND MODULUS OF ELASTICITY OF 1,700,000 PSI OR GREATER. ALL WOOD IS MINIMUM GRADE 2 MILLED BY PEETZ WINDOWS & DOORS TO SELECT.

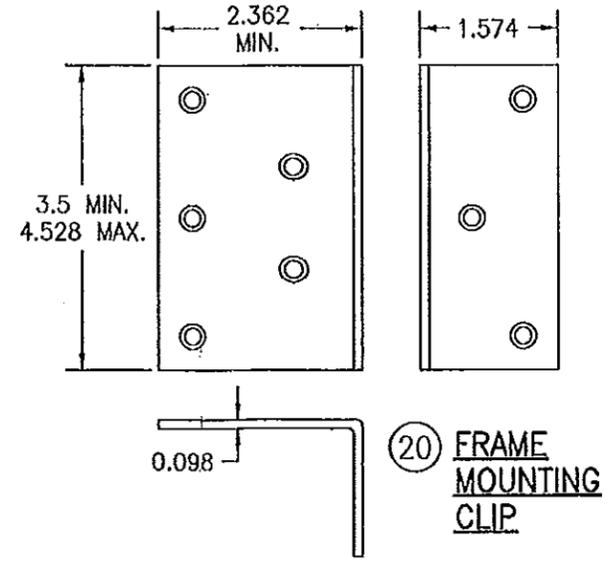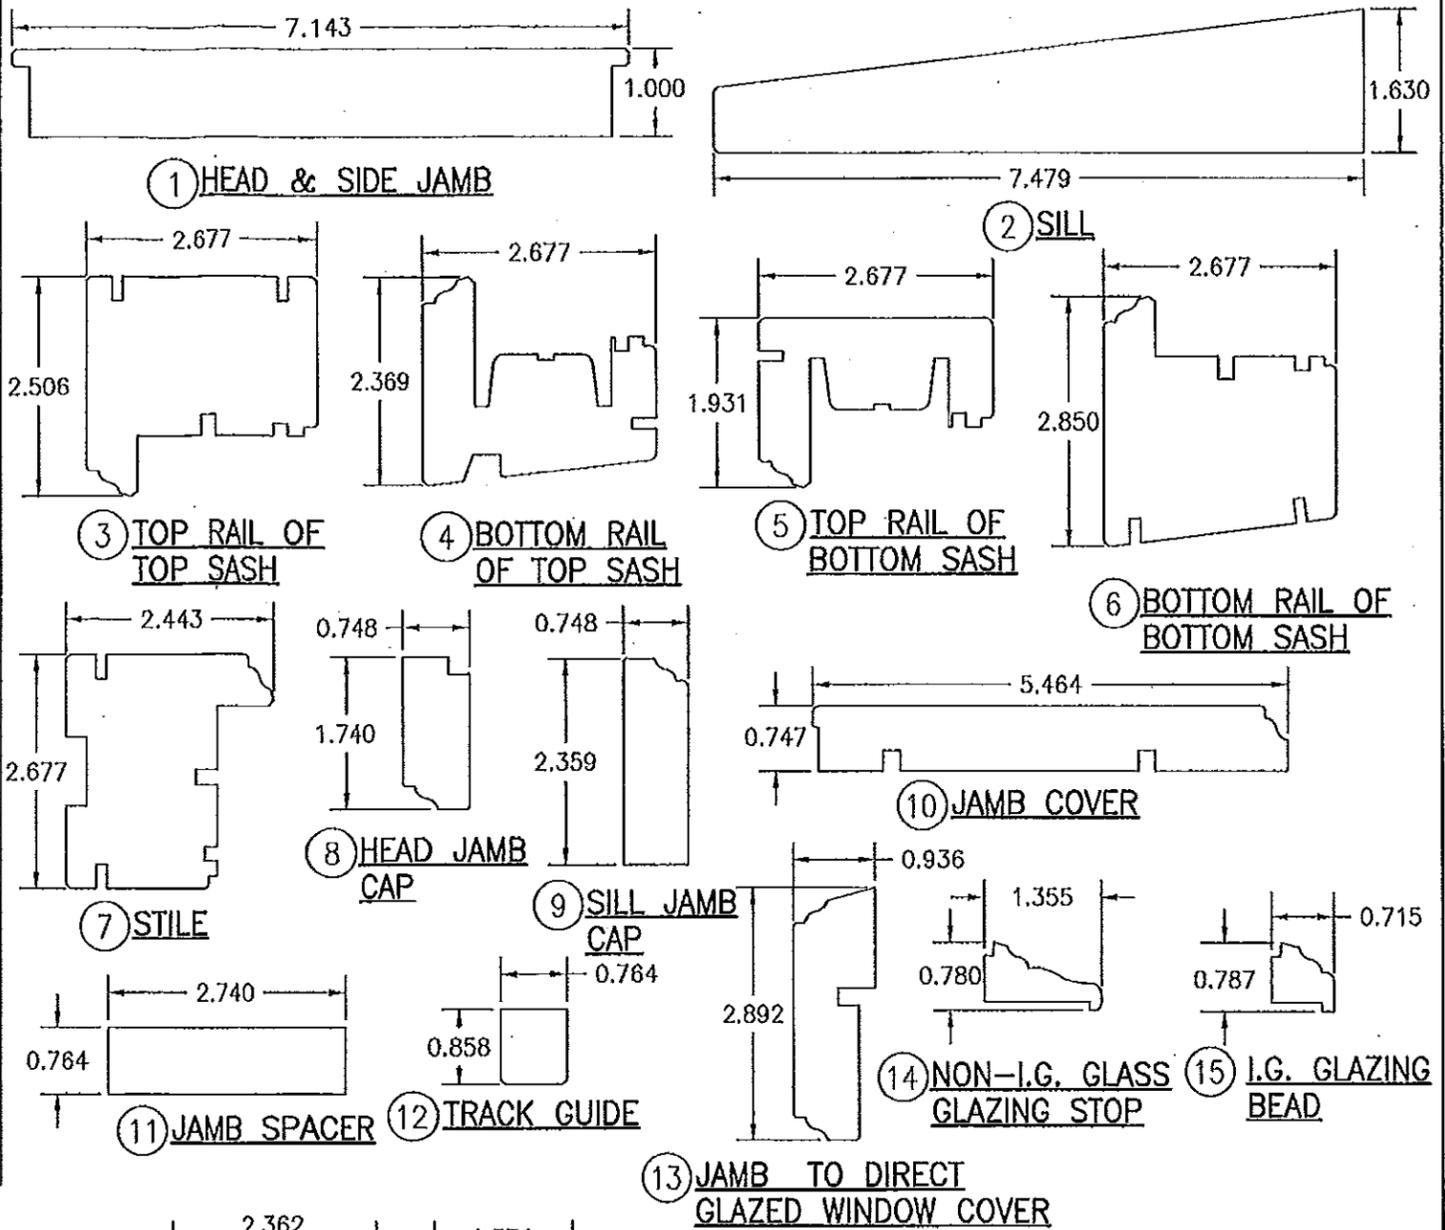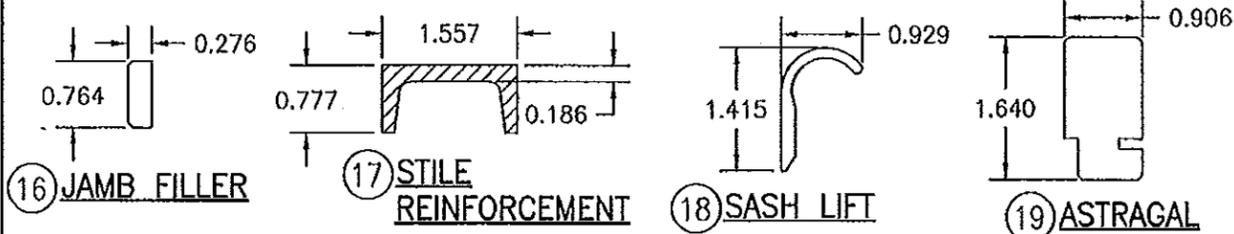

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 14-0679.14 Expiration Date July 5, 2017  
By *Manuel Perez* Miami Dade Product Control

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 11-1109.03 Expiration Date July 5, 2017  
By *Manuel Perez* Miami Dade Product Control



|                      |                       |
|----------------------|-----------------------|
| DRAWN BY:<br>W.R.M.  | CHECKED BY:<br>W.W.S. |
| PLOT:<br>1-2         | DATE:<br>12/06/06     |
| DATE                 |                       |
| BY                   |                       |
| REVISION DESCRIPTION |                       |
| NO.                  |                       |

DRAWING TITLE: WOOD DOUBLE & SINGLE HUNG IMPACT WINDOW WITH WEIGHT & CHAIN BALANCE SYSTEM

MANUFACTURER: PEETZ WINDOWS & DOORS  
15951 S.W. 41ST STREET, SUITE 150  
WESTON, FL 33331  
954-659-3887

CONSULTANTS: W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)  
7480 150TH COURT NORTH  
PALM BEACH GARDENS, FL 33418  
PHONE: 561-744-3424

CERTIFICATION: *WRS* 021 20 2011  
WARREN W. SCHAEFER, P.E.  
P.E. NO. 44135

DRAWING NO. 1507  
REV. A  
SHEET NO. 6 OF 6