



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**Gopi Glass Sales & Services Corp.**

7450 NW 41<sup>st</sup> Street  
Miami, FL 33166

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** Series "5000 Narrow Stile" Outswing Aluminum Storefront Door, w/wo Transom – N.I.

**APPROVAL DOCUMENT:** Drawing No. W98-23, titled "S-5000 Narrow Stile Entrance Door (NI)", sheets 1 through 7 of 7, dated 03/12/98, with revision J dated 06/23/14, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING:** None.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA# 11-0705.03 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



*Handwritten signature and date: 10/3/14*

NOA No. 14-0728.05  
Expiration Date: September 14, 2016  
Approval Date: October 09, 2014  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.
2. Drawing No. **W98-23**, titled "S- 5000 Narrow Stile Entrance Door (NI)", sheets 1 through 7 of 7, dated 03-12-98, with revision I dated 02/24/12, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

**B. TESTS**

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94(Not conducted)  
4) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94  
along with marked-up drawings and installation diagram of aluminum outswing doors w/ transom, prepared by Hurricane Engineering & Testing, Inc, Test Report No. **HETI-07-4153** dated 06/11/07, signed and sealed by Rafael L. Droz-Seda, P.E.  
*(Submitted under previous NOA No. 10-0107.06)*
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94  
2) Uniform Static Air Pressure Test, Loading per TAS 202-94  
3) Water Resistance Test, per FBC, TAS 202-94(Not conducted)  
4) Forced Entry Test per FBC.  
along with installation diagram of an aluminum outswing doors w/transom, prepared Hurricane Engineering & Testing Inc, Test Report No. **HETI-97-1123** dated 11/28/97, signed and sealed by Hector M. Medina, P.E. (Note: Original test conducted per SFBC, PA 202-94 now termed as FBC, 202-94)  
*(Submitted under previous NOA No. 07-0717.02)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with **FBC 5<sup>th</sup> Edition (2014)**, dated June 19, 2014, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with **ASTM E1300-09**.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. None.

  
Manuel Perez, P.E.  
Product Control Examiner  
NOA No. 14-0728.05

Expiration Date: September 14, 2016  
Approval Date: October 09, 2014

Gopi Glass Sales & Services Corp.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS**

1. Statement letter of conformance, complying with **FBC-5<sup>th</sup> Edition (2014)**, and of no financial interest, dated June 19, 2014, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Laboratory compliance letter for Test Report No. **HETI-97-1123**, issued by Hurricane Engineering & Testing, Inc., dated 10/05/98, signed and sealed by Hector M. Medina, P.E.  
*(Submitted under previous NOA No.07-0717.02)*
3. Test report No. **HETI-11-M110** dated 08/13/11, per ASTM C 661 for PVC and EPDM gasket, issued by Hurricane Engineering & Testing Inc.  
*(Submitted under previous NOA No.11-0705.03)*

**G. OTHERS**


1. Notice of Acceptance No. **12-0315.07**, issued to Gopi Glass Sales & Services Corp. for their Series "S-5000 Narrow Stile" Outswing Aluminum Storefront Door, w&w/o Transom – N.I., approved on 04/26/12 and expiring on 09/14/16.

  
Manuel Perez, P.E.  
Product Control Examiner


NOA No. 14-0728.05

Expiration Date: September 14, 2016


Approval Date: October 09, 2014

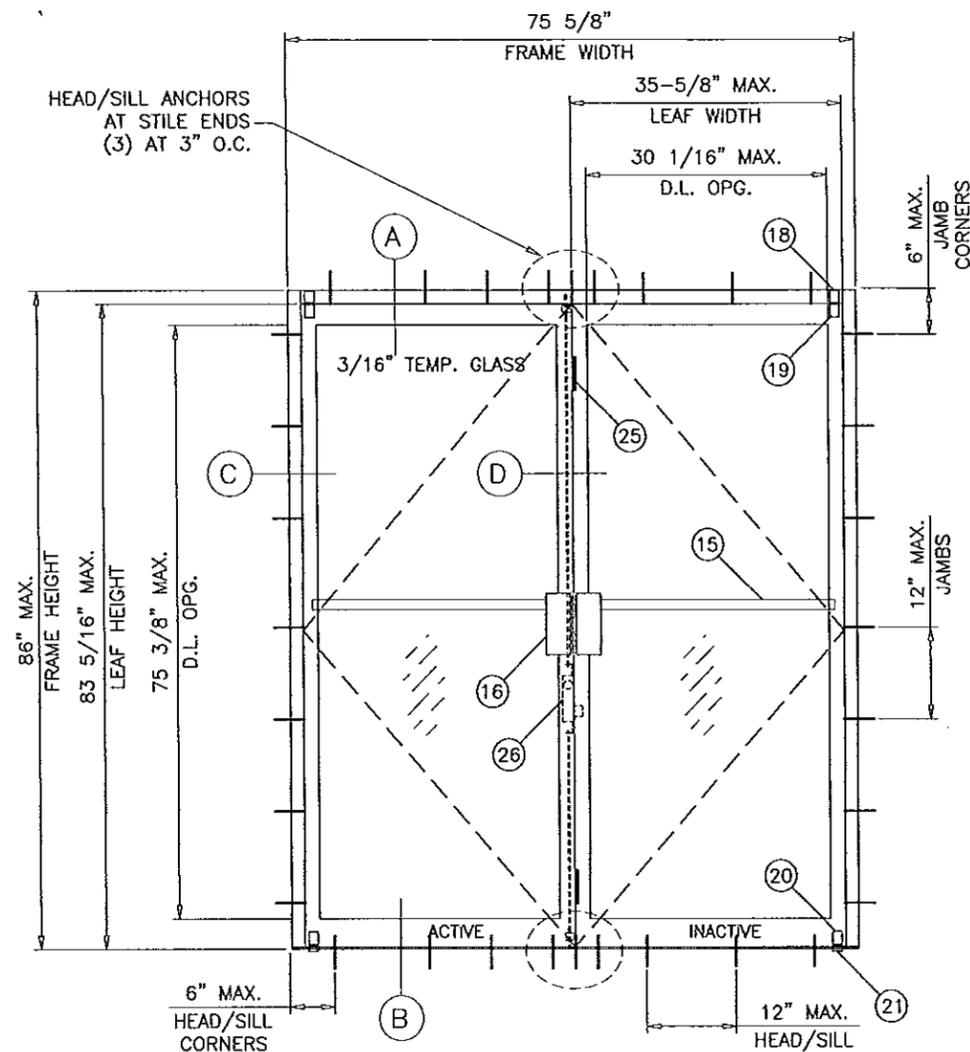

TYPICAL ELEVATION  
( XX )

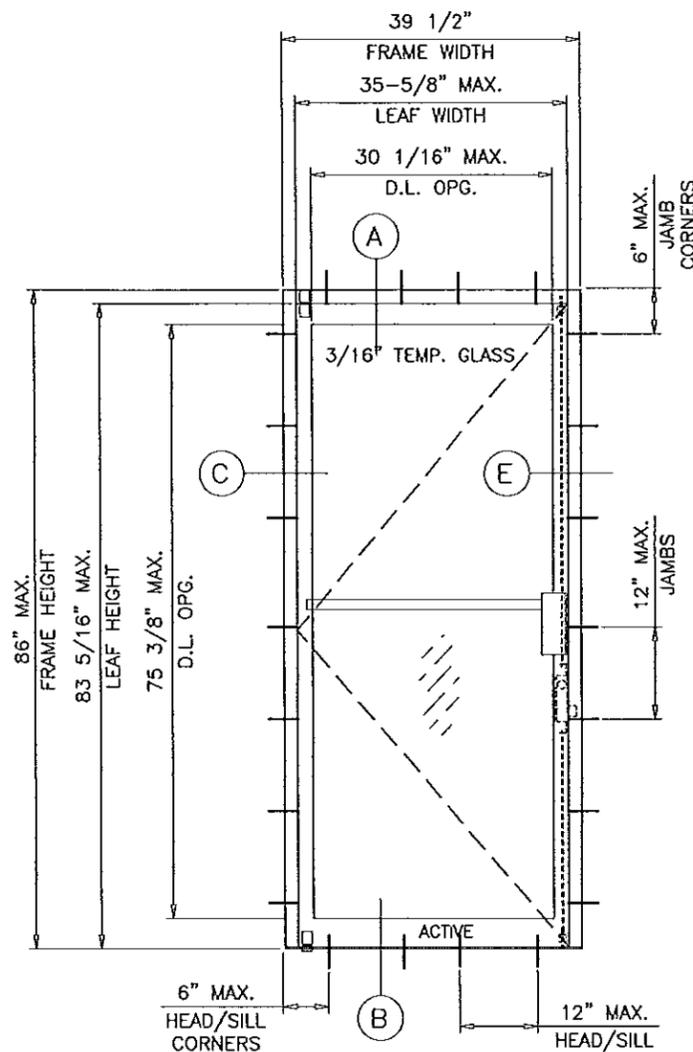

TYPICAL ELEVATION  
( X )

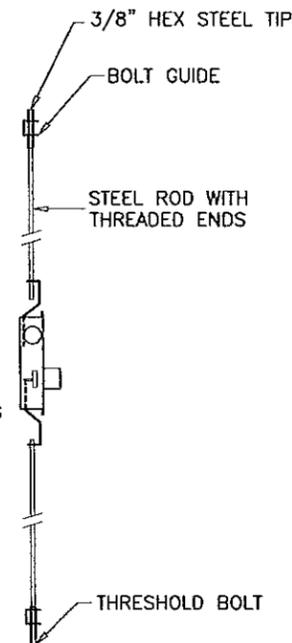

**LOCKS:**

**INACTIVE LEAF:**

CONCEALED FLUSH BOLTS AT 12" FROM TOP AND BOTTOM OF LEAF.

MATERIAL: DIE CAST ZAMAK BODY AND LEVER WITH 1/4" DIA. THREADED STEEL EXTENSION AND 9/16" DIA. NYLON TIP.

**ACTIVE LEAF:**

3 POINT LOCK SYSTEM USING ADAMS RITE M1805S, DEAD BOLT WITH #4015 THROW BOLT OPERATED BY DEAD LOCK AND ENGAGING FRAME HEAD AT TOP AND THRESHOLD AT BOTTOM.

**NOTE:**

DOORS MAY BE INSTALLED USING 1-3/4" X 4" (SERIES 4000) OR 1-3/4" X 4-1/2" (SERIES 4500) FRAMING SYSTEM. DETAILS SHOW 4000 SYSTEM FRAMES SEE SHEET 5 FOR EXTRUSION DETAILS OF 4500 FRAMING SYSTEM. FOR SINGLE O/X OR DOUBLE O/XX (DOORS WITH TRANSOM) SEE SHEET 7. LOWER DESIGN PRESSURE OF DOORS OR HORIZONTAL TRANSOM SHALL CONTROL.

DOORS NOT RATED FOR IMPACT.  
INSTALLATION OF THIS PRODUCT IN THE HVHZ AREA REQUIRES THE USE OF APPROVED SHUTTERS OR EXTERNAL PROTECTION DEVICES COMPLYING WITH HVHZ REQUIREMENTS.  
INSTALLATION OF THIS SYSTEM OUTSIDE THE HVHZ AREA SHALL MEET THE APPLICABLE REQUIREMENTS FOR WIND BORNE DEBRIS PROTECTION.

DOORS WITH 3/16" TEMPERED GLASS			
NOMINAL DIMS.		DESIGN LOAD - PSF	
LEAF HEIGHT	LEAF WIDTH	EXT.(+)	INT.(-)
6/8	2/6	79.4	92.0
	3/0	66.2	76.7
7/0	2/6	75.6	87.6
	3/0	63.0	73.0

NOTE:  
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

DOORS NOT APPROVED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS REQUIRED.

NOMINAL WIDTH	FRAME WIDTH	LEAF WIDTH
2/6	33-1/2"	31-5/8" ( X )
3/0	39-1/2"	35-5/8" ( X )
5/0	63-5/8"	31-5/8" ( XX )
6/0	75-5/8"	35-5/8" ( XX )

NOMINAL HEIGHT	FRAME HEIGHT	LEAF HEIGHT
6/8	82"	79-5/16"
7/0	86"	83-5/16"

D.L.O. HEIGHT = LEAF HEIGHT - 8 IN.  
D.L.O. WIDTH = LEAF WIDTH - 5.25 IN.

**SERIES-5000 ENTRANCE DOOR  
NARROW STILE OUT-SWING TYPE**

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538  
JUN 26 2014

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 14-0128-05  
Expiration Date Sept 14, 2016  
By *Mamuel Torres*  
Miami Dade Product Control


**afC**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W98-23GG

S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
**GOPI GLASS CORPORATION**  
7450 N.W. 41 STREET  
MIAMI, FL. 33166  
TEL (305) 592-2009 FAX (305) 477-0992


no	date	description	by
F	10.14.09	UPDATED FOR 2007 FBC	
G	06.02.11	GENERAL REVISION	
H	08.04.11	REV. PER BNC COMMENTS	
I	02.24.12	UPDATED TO 2010 FBC	
J	06.23.14	UPDATED TO 2014 FBC	

date: 03-12-98  
scale: 1/2" = 1'-0"  
dr. by: HAMID  
chk. by:

drawing no.  
**W98-23**  
sheet 1 of 7

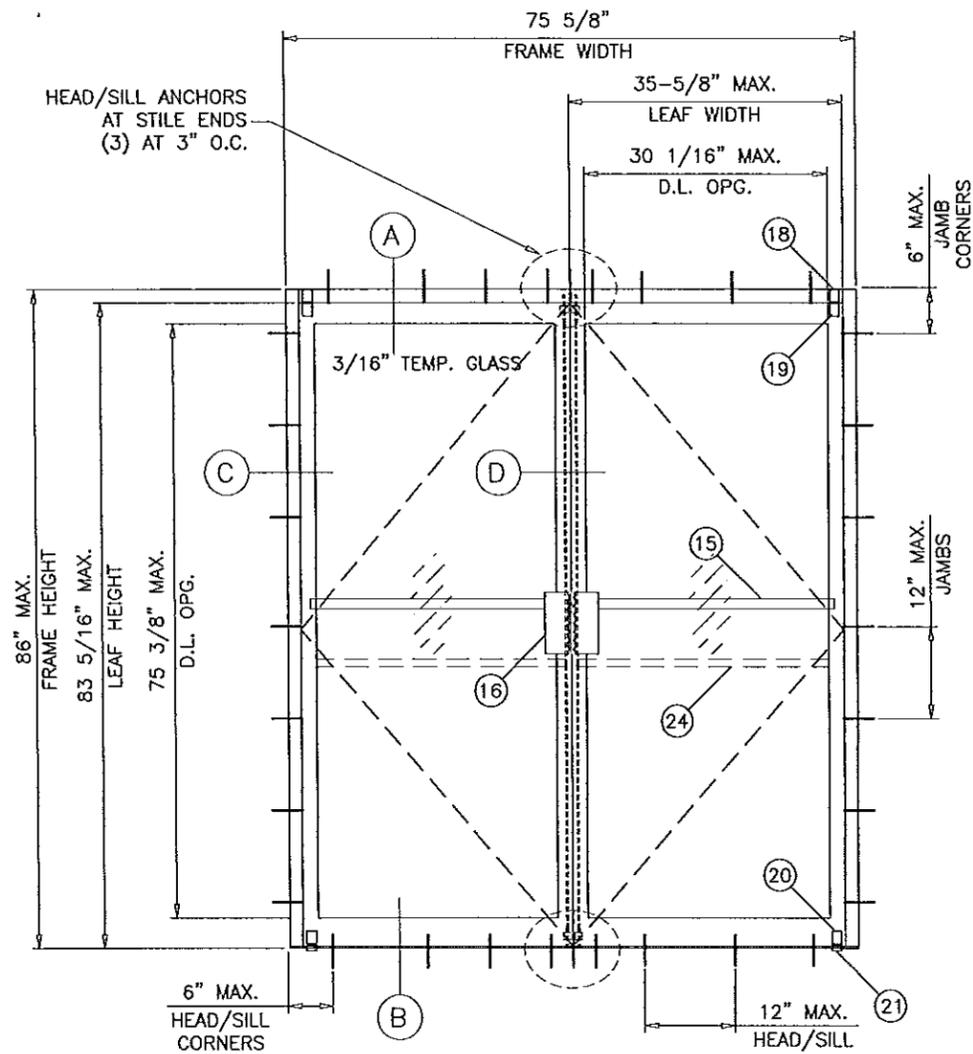

TYPICAL ELEVATION  
( XX )  
OUT-SWING W/ JACKSON PANIC EXIT

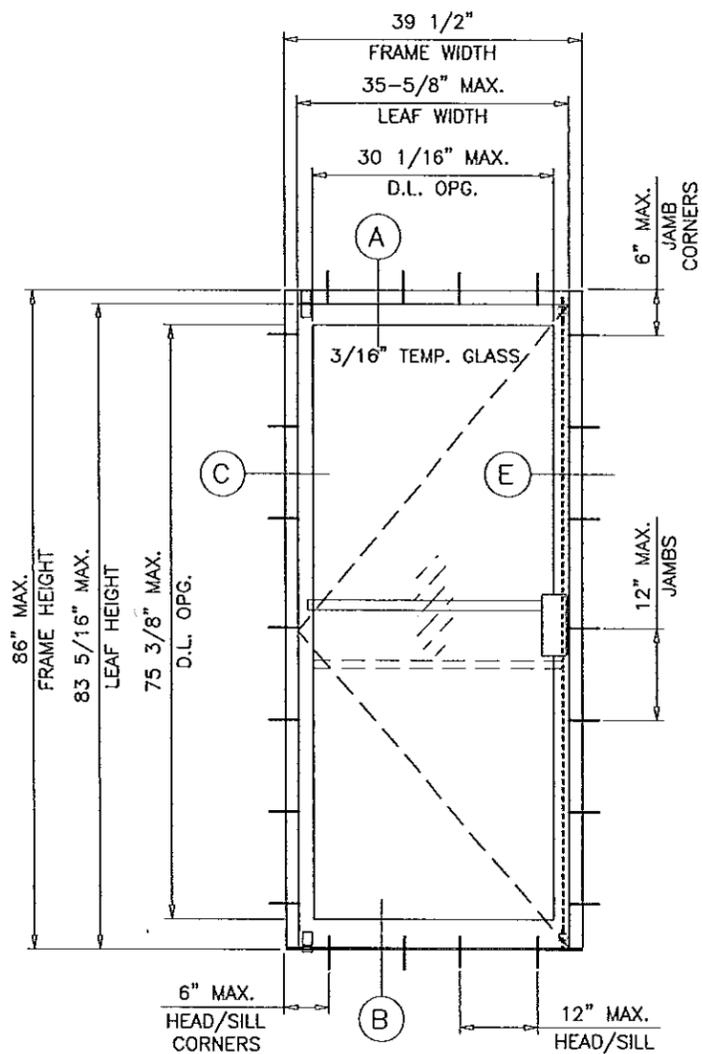

TYPICAL ELEVATION  
( X )  
OUT-SWING W/ JACKSON PANIC EXIT

**LOCKS:**

**ACTIVE/INACTIVE LEAF:**

2 POINT LOCK PANIC HARDWARE MODEL 1085 BY JACKSON EXIT DEVICE WITH PANIC BAR LOCATED AT 36" FROM FLOOR EACH DOOR LEAF.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538

JUN 26 2014

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 14-0728.05  
Expiration Date: SEPT 14, 2016

By: *Manuel J...*  
Miami Dade Product Control

no	date	by	description
F	10.14.09		UPDATED FOR 2007 FBC
G	06.02.11		GENERAL REVISION
H	08.04.11		REV. PER BNC COMMENTS
I	02.24.12		NO CHANGE THIS SHEET
J	06.23.14		NO CHANGE THIS SHEET





date: 03-12-98  
scale: 1/2"=1'-0"  
dr. by: HAMID  
chk. by:

drawing no.  
W98-23

sheet 2 of 7

S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
GOPI GLASS CORPORATION  
7450 N.W. 41 STREET  
MIAMI, FL. 33166  
TEL. (305) 592-2009 FAX. (305) 477-0992

**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL\W98-23GG

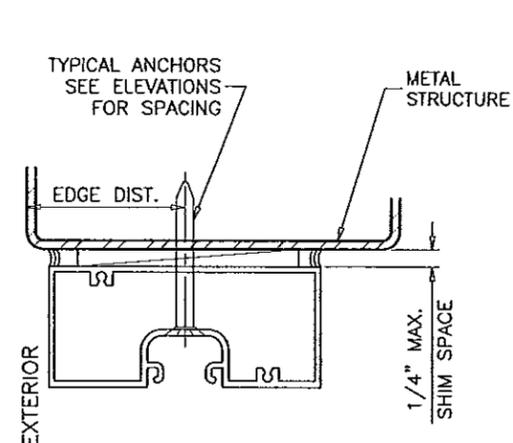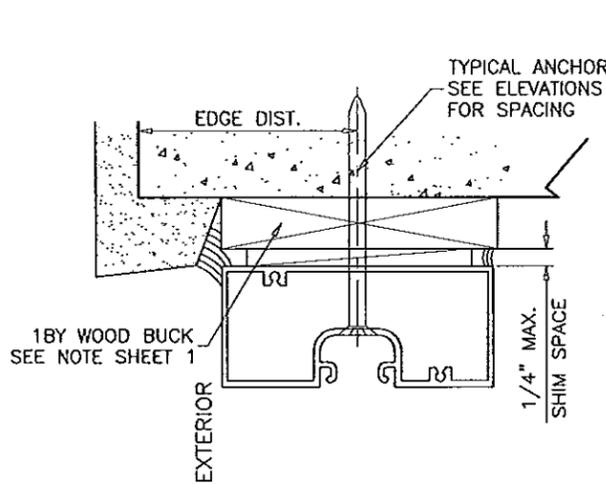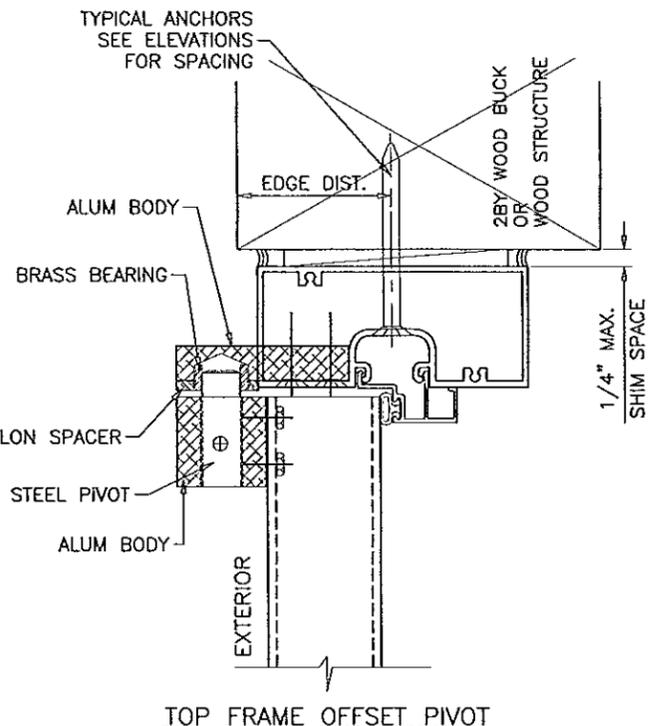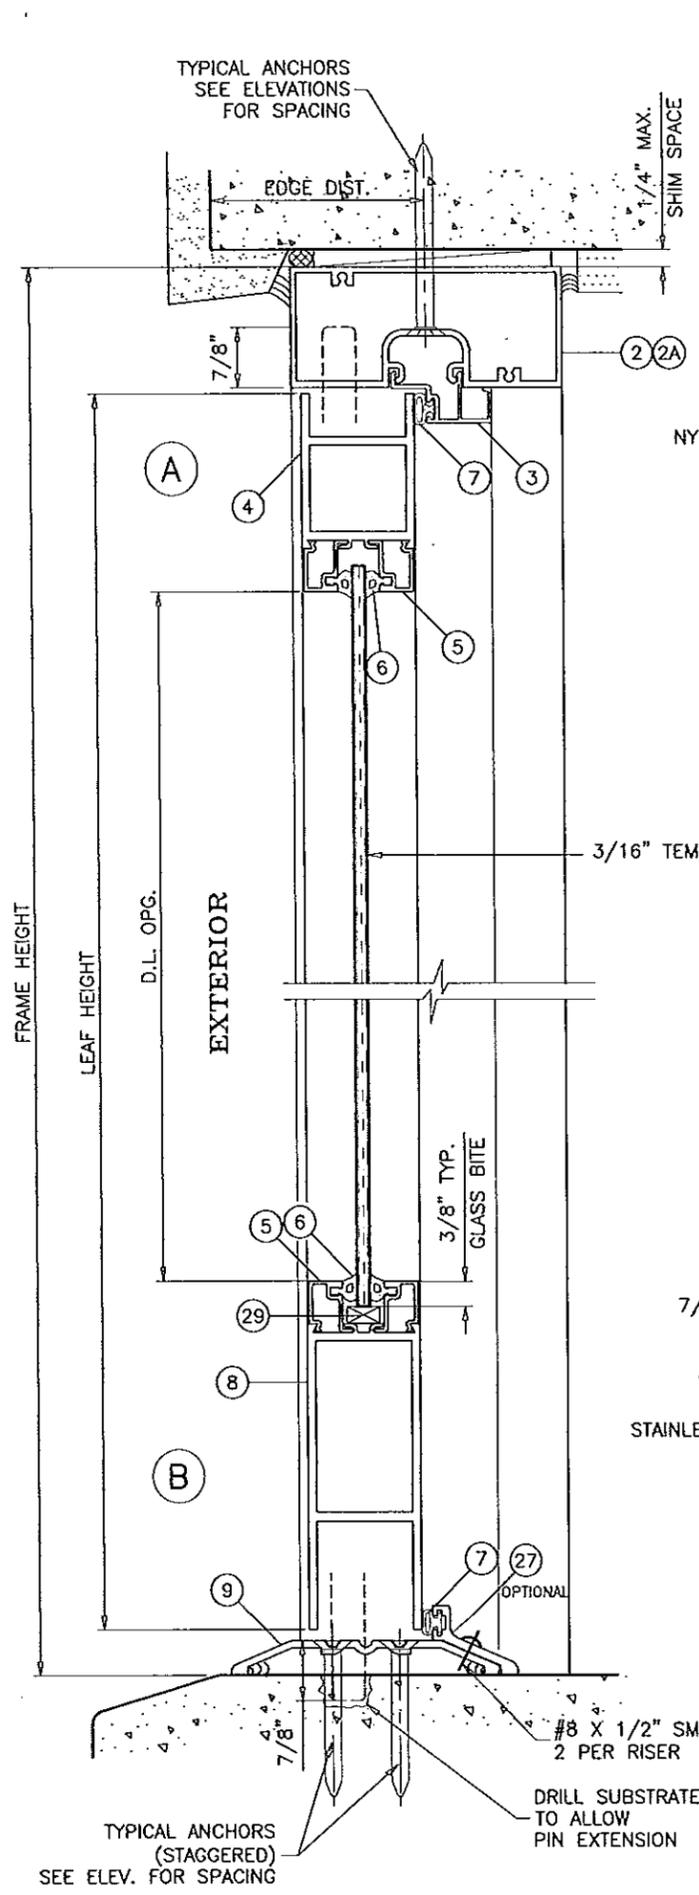

WOOD BUCKS AND METAL STRUCTURE NOT BY GOPI GLASS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.


**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING  
**1/4" DIA. ULTRACON BY 'ELCO'** (Fu=177 KSI, Fy=155 KSI)  
 INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
 1-1/2" MIN. PENETRATION INTO WOOD  
 THRU 1BY BUCKS INTO CONC. OR MASONRY  
 1-3/4" MIN. EMBED INTO CONC. OR MASONRY  
 DIRECTLY INTO CONC. OR MASONRY  
 1-3/4" MIN. EMBED INTO CONC. OR MASONRY

**#14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)  
 INTO MIAMI-DADE COUNTY APPROVED MULLIONS (1/8" THK. MIN.)  
 INTO METAL STRUCTURES  
 STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)  
 ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**TYPICAL EDGE DISTANCE**  
 INTO CONCRETE AND MASONRY = 2-1/2" MIN.  
 INTO WOOD STRUCTURE = 1" MIN.  
 INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.  
 C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

**SEALANTS:**  
 FRAME AND PANEL CORNERS, INSTALLATION SCREWS AND ALL METAL PARTS CONNECTIONS SEALED WITH CAULK.

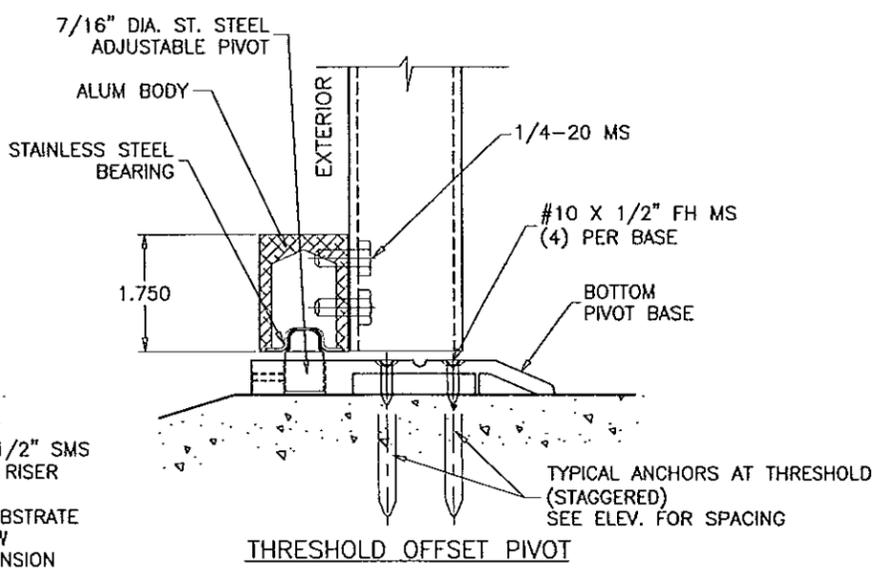

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
 JUN 26 2014

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 14-0728.05  
 Expiration Date SEP 14, 2016  
 By: *Manuel Perez*  
 Miami Dade Product Control


**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 1235 S.W. 87 AVE  
 MIAMI, FLORIDA 33174  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP -ANL W98-2366

S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
**GOPI GLASS CORPORATION**  
 7450 N.W. 41 STREET  
 MIAMI, FL. 33166  
 TEL. (305) 592-2009 FAX. (305) 477-0992

no	date	by	description
F	10.14.09		UPDATED FOR 2007 FBC
G	06.02.11		GENERAL REVISION
H	08.04.11		REV. PER BNC COMMENTS
I	02.24.12		NO CHANGE THIS SHEET
J	06.23.14		UPDATED TO 2014 FBC


date: 03-12-98  
 scale: 3/8" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W98-23**  
 sheet 3 of 7

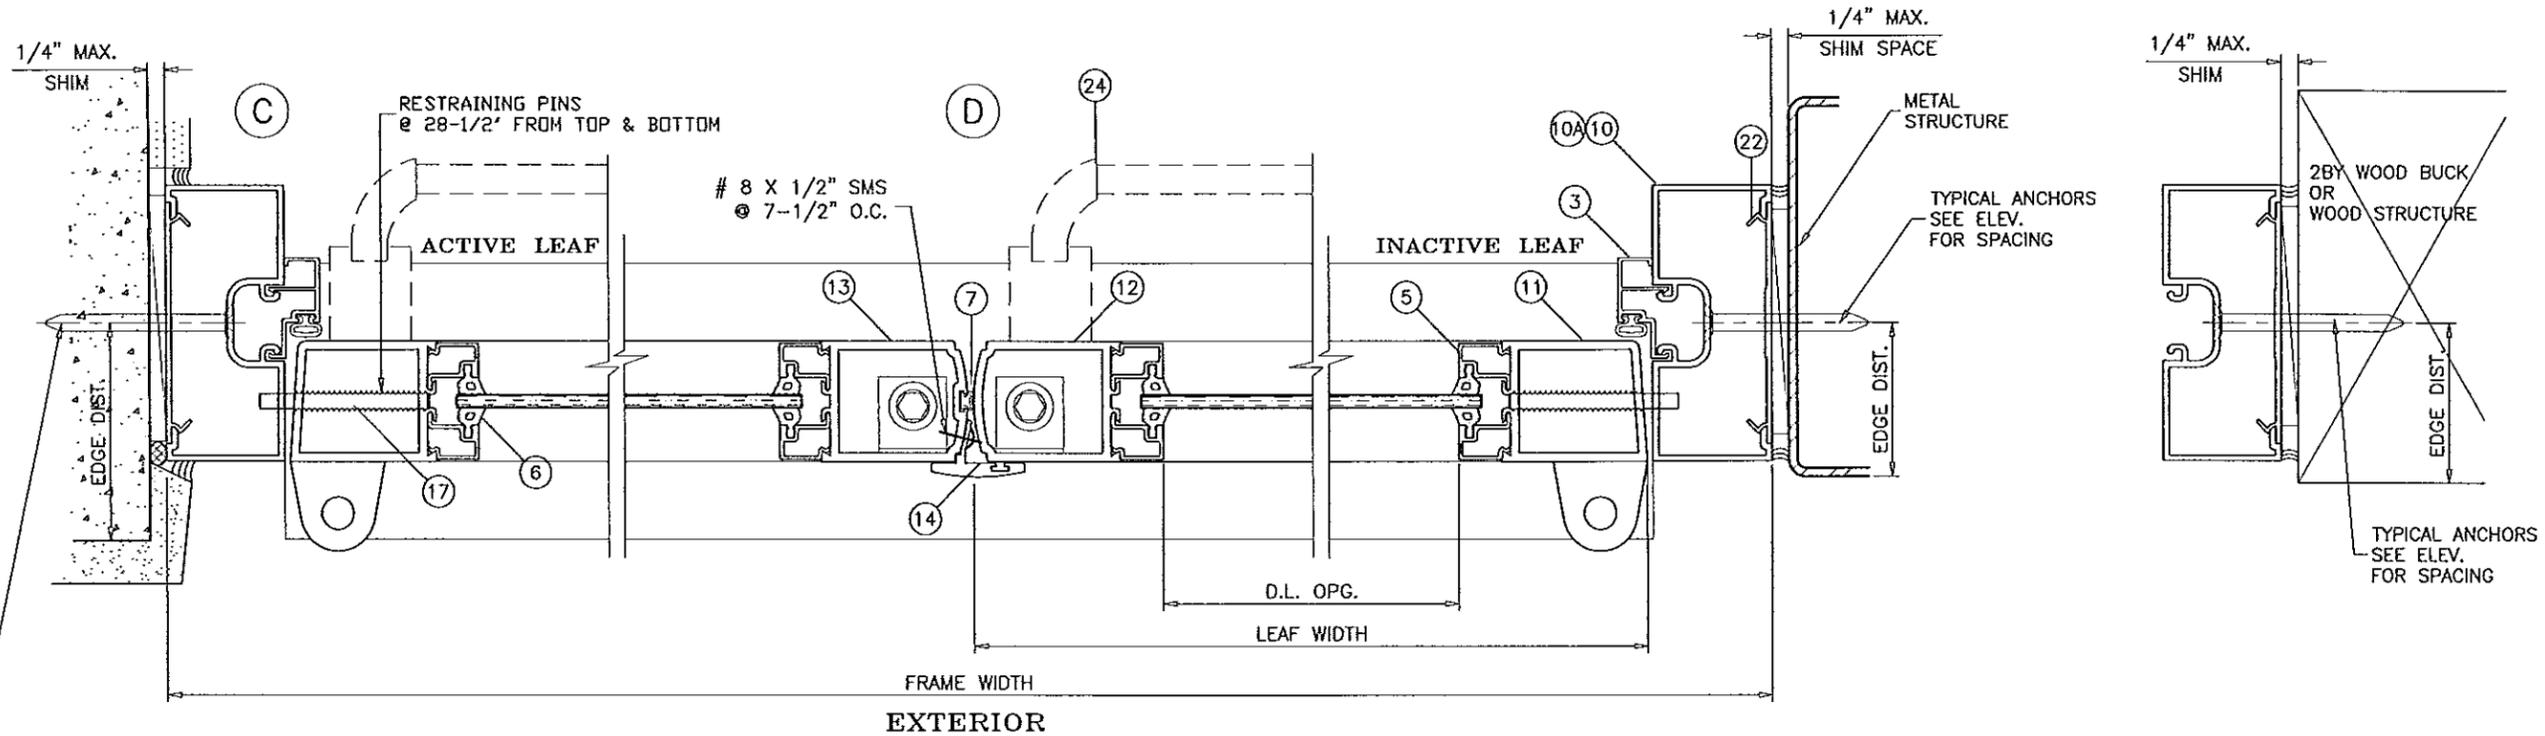

EXTERIOR

TYPICAL ANCHORS  
SEE ELEV.  
FOR SPACING

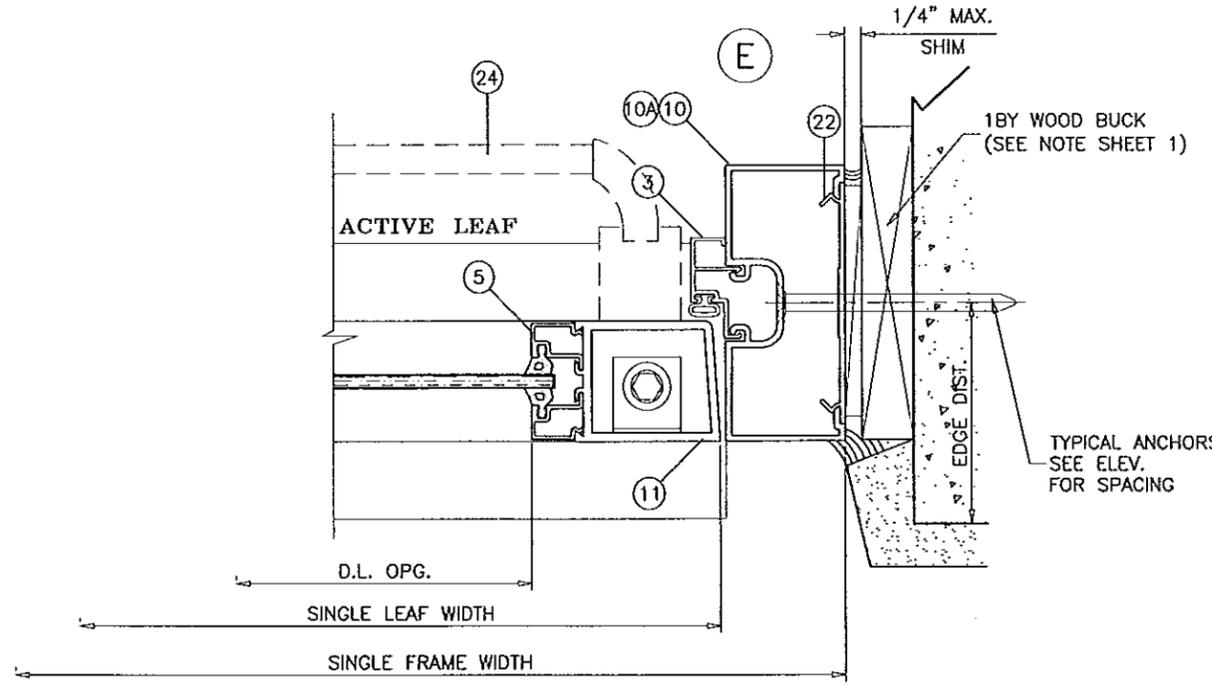

Engr: JAVAD AHMAD  
CML  
FLA. PE # 70592  
C.A.N. 3538

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 14-0728.05  
Expiration Date Sept. 14, 2016  
By *Manuel Jerez*  
Miami Dade Product Control

JUN 26 2014

**afc**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978  
COMP-ANL \ W98-23GG

S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
**GOPI GLASS CORPORATION**  
7450 N.W. 41 STREET  
MIAMI, FL. 33166  
TEL. (305) 592-2009 FAX. (305) 477-0992

revisions:


no	date	by	description
F	10.14.09		UPDATED FOR 2007 FBC
G	06.02.11		GENERAL REVISION
H	08.04.11		REV. PER BNC COMMENTS
I	02.24.12		NO CHANGE THIS SHEET
J	06.23.14		NO CHANGE THIS SHEET

date: 03-12-98  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W98-23**


sheet 4 of 7

SERIES 4000 FRAME

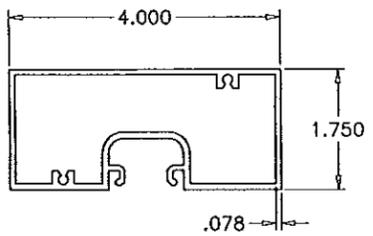


4" FRAME HEAD  
5007  
6063-T6

SERIES 4500 FRAME

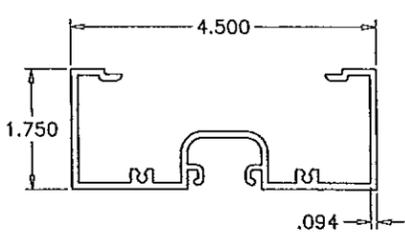


4-1/2" FRAME HEAD  
5502  
6063-T5


SERIES 5000 DOOR

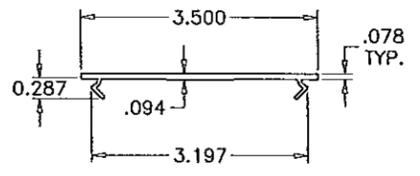


ANCHOR PLATE  
5009  
6063-T6

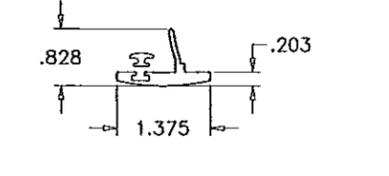


ASTRAGAL  
20271  
6063-T5

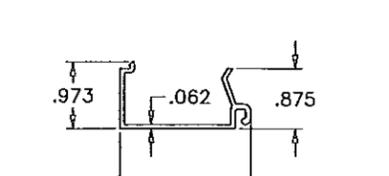


TRANSOM GLASS STOP  
5504  
6063-T5

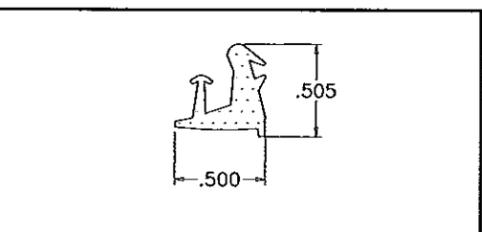


GLAZING GASKET  
SCALE 1:1  
HARDNESS = 71±5 SHORE A  
TENSILE STRENGTH = 1429 PSI  
ELONGATION AT BREAK = 295%  
TEAR STRENGTH = 221 PPI  
SPECIFIC GRAVITY = 1.21

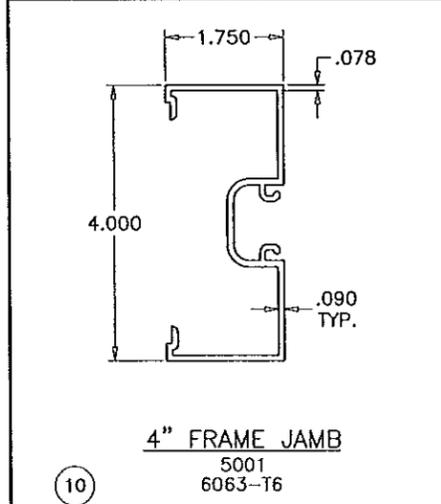


4" FRAME JAMB  
5001  
6063-T6

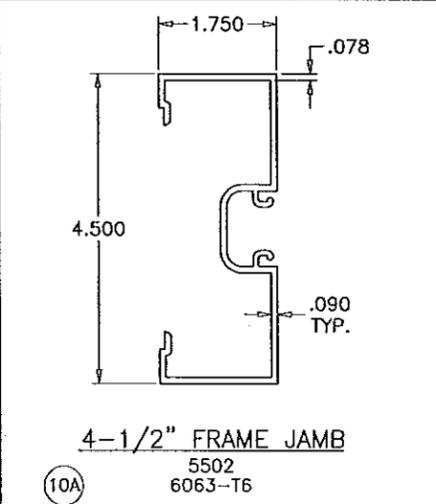


4-1/2" FRAME JAMB  
5502  
6063-T6

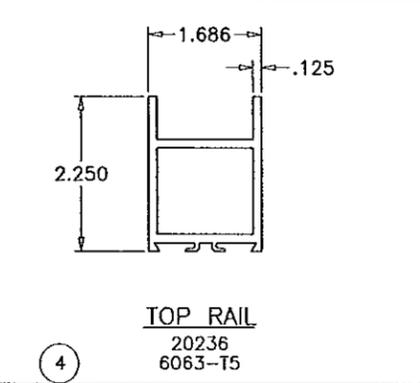


TOP RAIL  
20236  
6063-T5

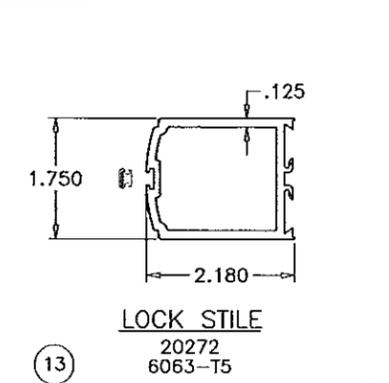


LOCK STILE  
20272  
6063-T5

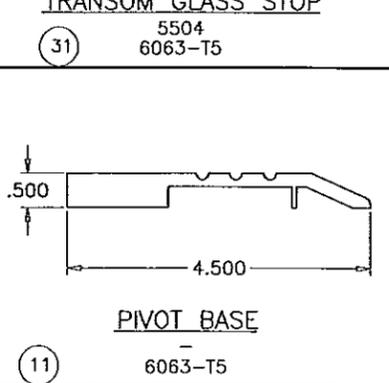


PIVOT BASE  
6063-T5

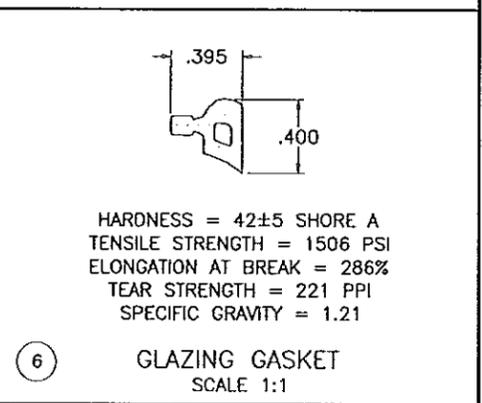


GLAZING GASKET  
SCALE 1:1  
HARDNESS = 42±5 SHORE A  
TENSILE STRENGTH = 1506 PSI  
ELONGATION AT BREAK = 286%  
TEAR STRENGTH = 221 PPI  
SPECIFIC GRAVITY = 1.21

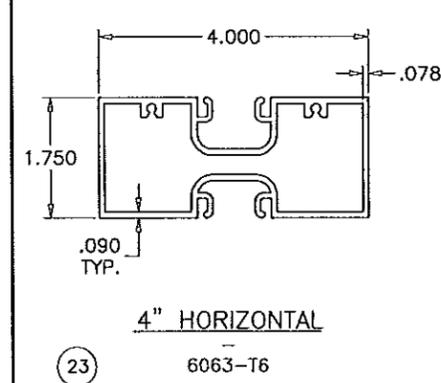


4" HORIZONTAL  
6063-T6

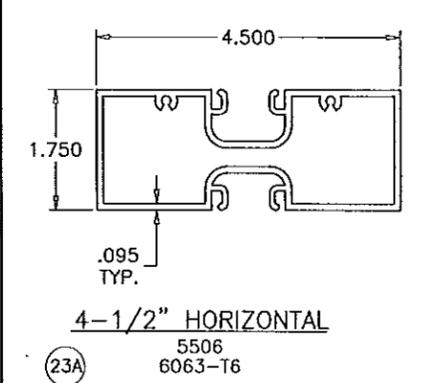


4-1/2" HORIZONTAL  
5506  
6063-T6

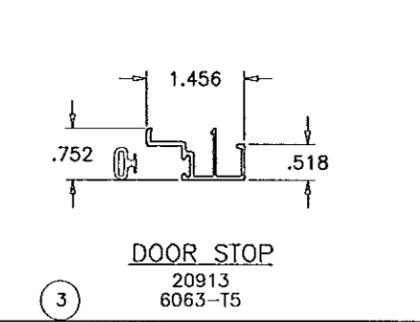


DOOR STOP  
20913  
6063-T5

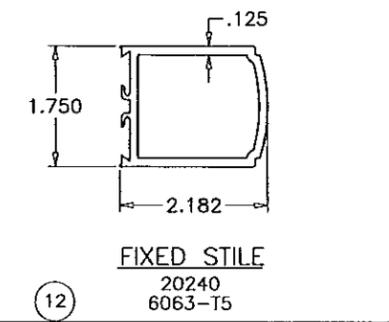


FIXED STILE  
20240  
6063-T5

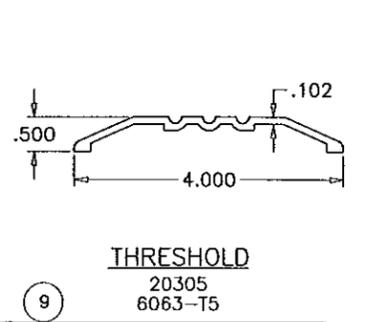


THRESHOLD  
20305  
6063-T5

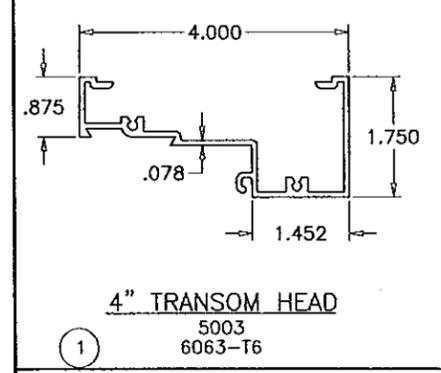


4" TRANSOM HEAD  
5003  
6063-T6

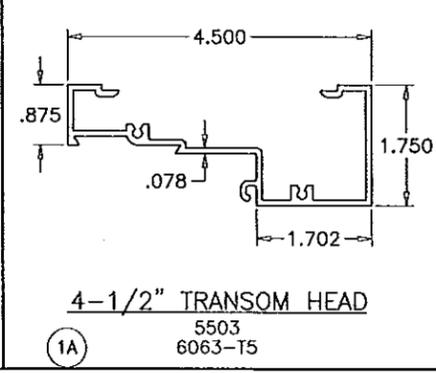

4-1/2" TRANSOM HEAD  
5503  
6063-T5

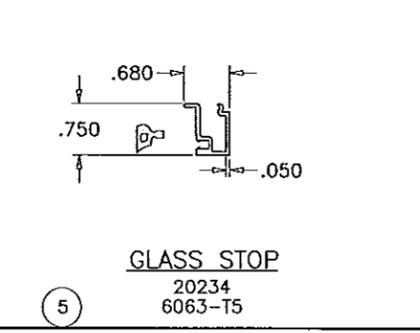


GLASS STOP  
20234  
6063-T5

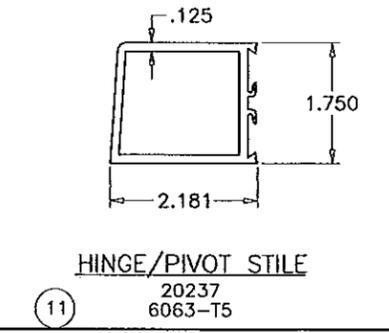


HINGE/PIVOT STILE  
20237  
6063-T5



BOTTOM RAIL  
20238  
6063-T5

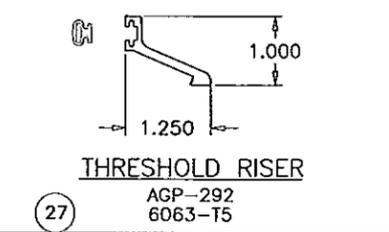

THRESHOLD RISER  
AGP-292  
6063-T5

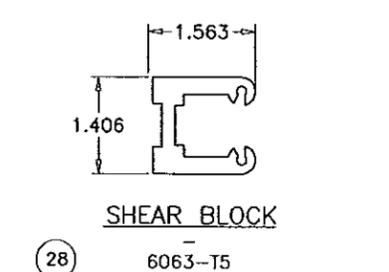

SHEAR BLOCK  
6063-T5

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538  
JUN 26 2014

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 14-0728.05  
Expiration Date Sept 14, 2016  
By: *Manuel Perez*  
Miami Dade Product Control


**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W98-23GG

S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
**GOPI GLASS CORPORATION**  
7450 N.W. 41 STREET  
MIAMI, FL. 33166  
TEL. (305) 592-2009 FAX. (305) 477-0992


no	date	by	description
F	10.14.09		UPDATED FOR 2007 FBC
G	06.02.11		GENERAL REVISION
H	08.04.11		REV. PER BNC COMMENTS
I	02.24.12		UPDATED TO 2010 FBC
J	06.23.14		NO CHANGE THIS SHEET

date: 03-12-98  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:


drawing no.  
**W98-23**  
sheet 5 of 7

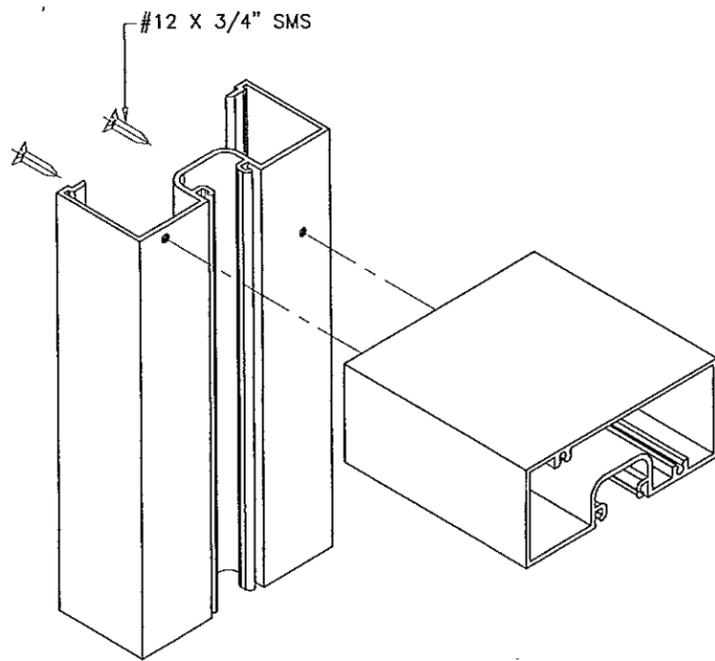


FRAME UPPER CORNER

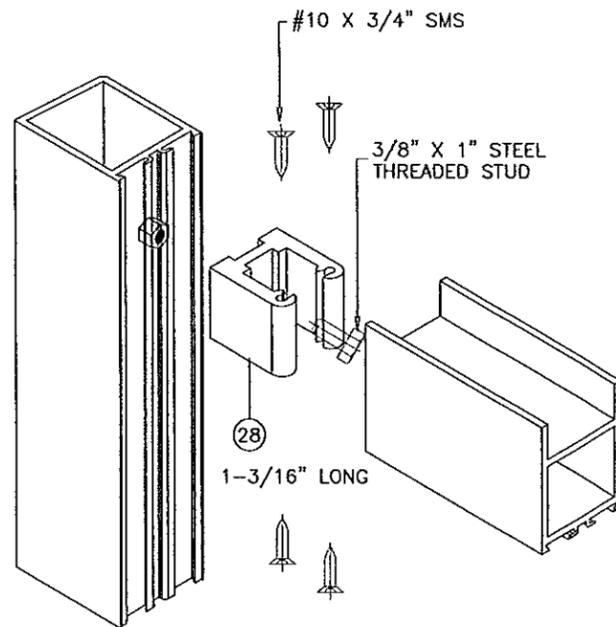

DOOR LEAF UPPER CORNER

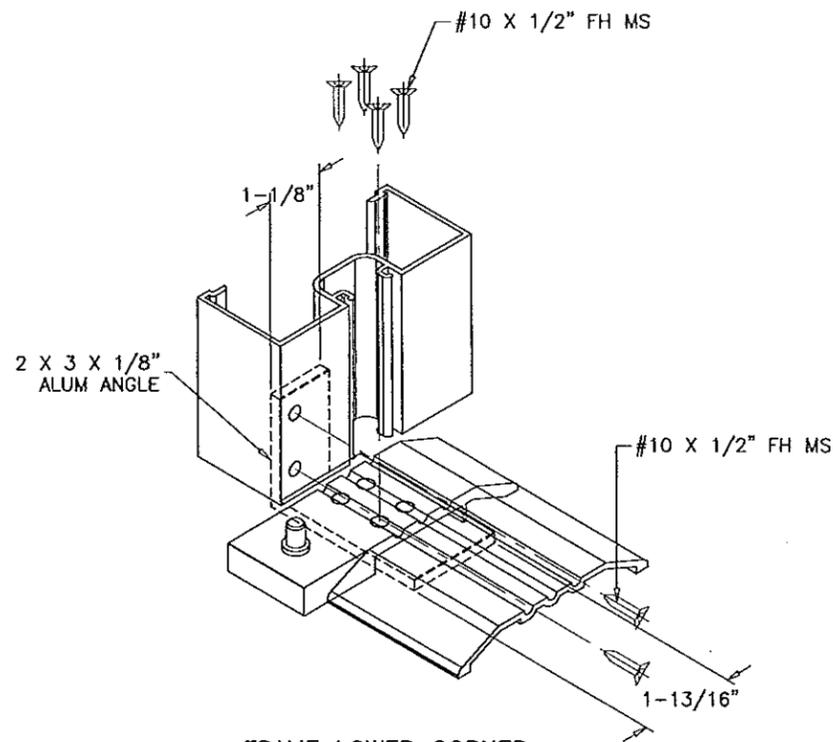

FRAME LOWER CORNER

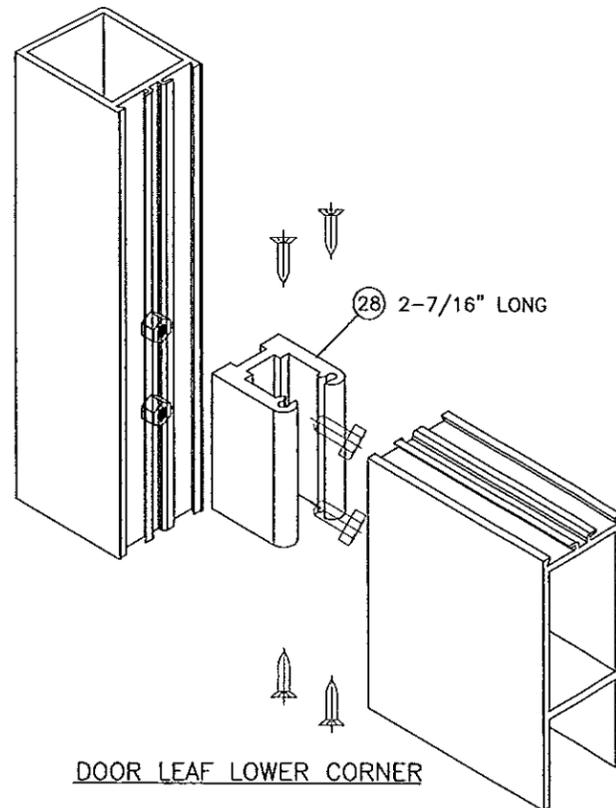

DOOR LEAF LOWER CORNER

ITEM #	PART #	REQD.	DESCRIPTION	REMARKS
1	5003	AS REQD.	4" TRANSOM HEAD	6063-T6
1A	5503	AS REQD.	4-1/2" TRANSOM HEAD	6063-T6
2	5007	1	4" FRAME HEAD	6063-T6
2A	5502	1	4-1/2" FRAME HEAD	6063-T6
3	20913	AS REQD.	DOOR STOP	6063-T6
4	20236	1/ LEAF	TOP RAIL	6063-T6
5	20234	AS REQD.	GLASS STOP	6063-T6
6	46812	AS REQD.	GLAZING GASKET	NEOPRENE
7	-	AS REQD.	BULB WEATHERSTRIPPING	SOFT PVC
8	20238	1/ LEAF	BOTTOM RAIL	6063-T5
9	20305	1	THRESHOLD	6063-T5
10	5001	2	4" OPEN BACK JAMB	6063-T6
10A	5501	2	4-1/2" OPEN BACK JAMB	6063-T6
11	20237	AS REQD.	HINGE OR PIVOT STILE	-
12	20240	1/ LEAF	FIX STILE (INACTIVE PANEL)	6063-T5
13	20272	1/ LEAF	LOCK STILE (ACTIVE PANEL)	6063-T5
14	20271	1/ DOOR	ASTRAGAL FOR XX ONLY	6063-T5
15	10741	-	PUSH BAR (OPTIONAL)	6063-T5
16	AGP-123	AS REQD.	HANDLE	6063-T5
17	14234	2/ LEAF	RESTRAINING PINS (2-1/2" X 1/4")	STEEL
18	30708	1/ LEAF	TOP FRAME OFFSET PIVOT	-
19	30709	1/ LEAF	TOP DOOR OFFSET PIVOT	-
20	30710	1/ LEAF	BOTTOM DOOR OFFSET PIVOT	-
21	30711	1/ LEAF	THRESHOLD OFFSET PIVOT	-
22	5009	AS REQD.	ANCHOR PLATE, 3" LONG AT ANCHORS	6063-T6
23	-	AS REQD.	4" HORIZONTAL	6063-T5
23A	5506	AS REQD.	4-1/2" HORIZONTAL	6063-T5
24	1085	-	JACKSON PANIC DEVICE	SEE SHEET 2
25	-	2/ LEAF	FLUSH BOLT (INACTIVE LEAF ONLY)	SEE SHEET 1
26	-	1/ LEAF	THREE POINT LOCK (ACTIVE LEAF ONLY)	SEE SHEET 1
27	AGP-292	1/ DOOR	THRESHOLD RISER	6063-T5
28	-	-	SHEAR BLOCK	6063-T5
29	-	2/ LITE	SETTING BLOCK, DUROMETER 80±5 SHORE A	EPDM
30	-	AS REQD.	GLAZING GASKET	NEOPRENE
31	5504	AS REQD.	TRANSOM GLASS STOP	6063-T5
32	-	2/ LITE	SETTING BLOCK, DUROMETER 87±5 SHORE A	EPDM

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538

**JUN 26 2014**

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 14-0728-05  
Expiration Date Sept. 19, 2016

By: *Manuel Perez*  
Miami Dade Product Control



**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6978


S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
**GOPI GLASS CORPORATION**  
7450 N.W. 41 STREET  
MIAMI, FL. 33166  
TEL. (305) 592-2009 FAX. (305) 477-0992

no	date	description	by
F	10.14.09	UPDATED FOR 2007 FBC	
G	06.02.11	GENERAL REVISION	
H	08.04.11	REV. PER BNC COMMENTS	
I	02.24.12	UPDATED TO 2010 FBC	
J	06.23.14	NO CHANGE THIS SHEET	

date: 03-12-98  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:


drawing no.  
**W98-23**  
sheet 6 of 7

COMP-ANL\W98-23GG



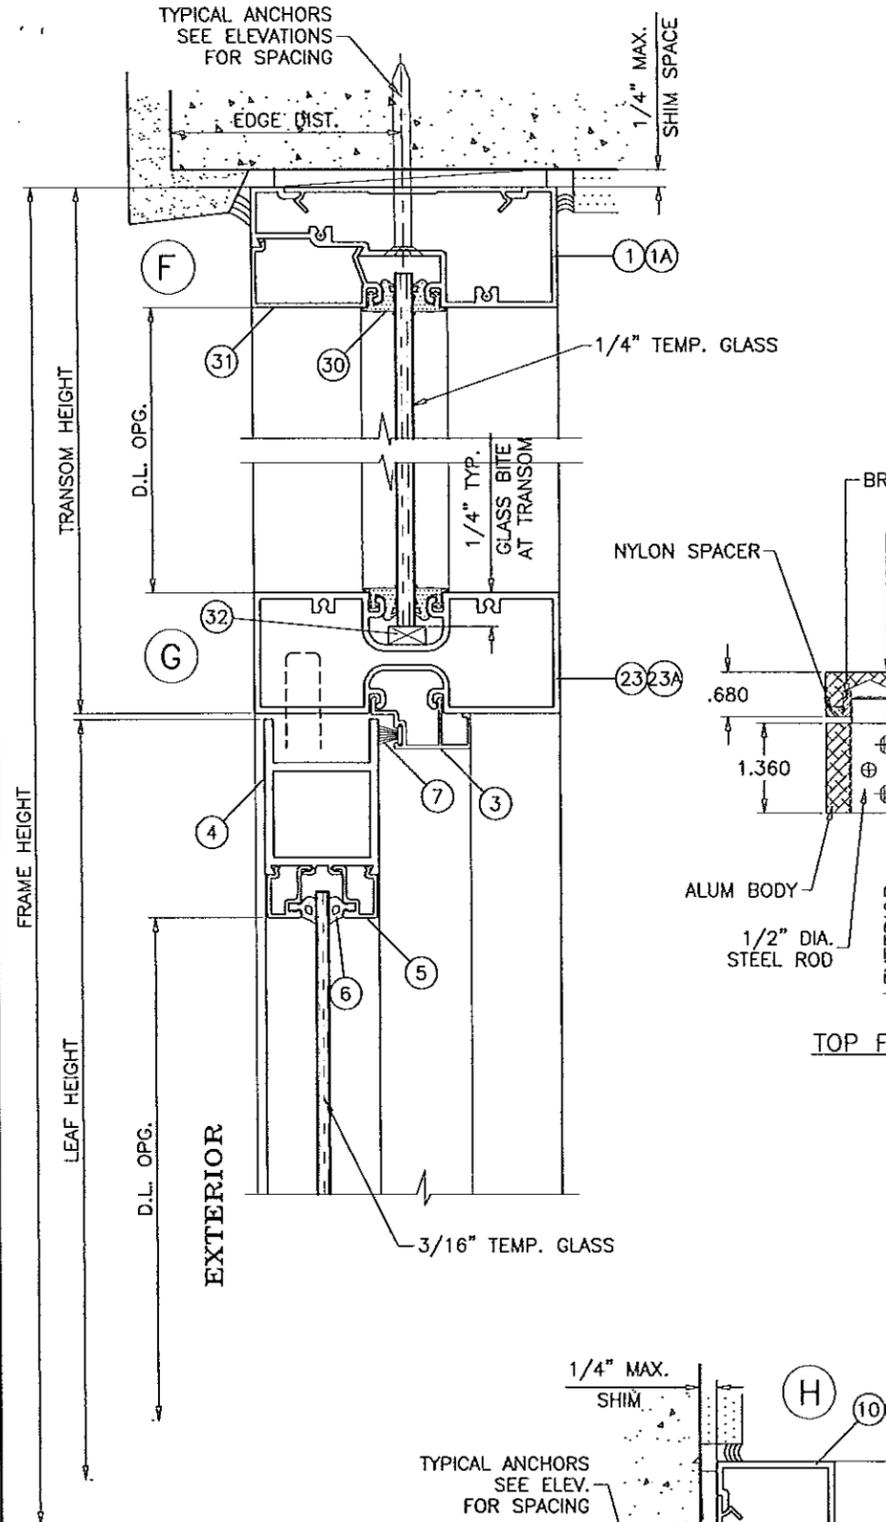


HORIZONTAL TRANSOM LOAD CAPACITY-PSF						
DOOR WIDTH INCHES	TRANSOM HEIGHT INCHES	MAX. DOOR HEIGHT INCHES	4" HORIZONTAL		4-1/2" HORIZONTAL	
			EXT. (+)	INT. (-)	EXT. (+)	INT. (-)
75-1/2	12	84	73.0 (6)	73.0 (8)		
	24		66.0 (6)	73.0 (8)		
	36		59.0 (8)	73.0 (8)		

NUMBER IN PARENTHESIS INDICATE NUMBER OF ANCHORS AT TRANSOM ENDS FOR INSTALLATIONS INTO BLOCK WALL

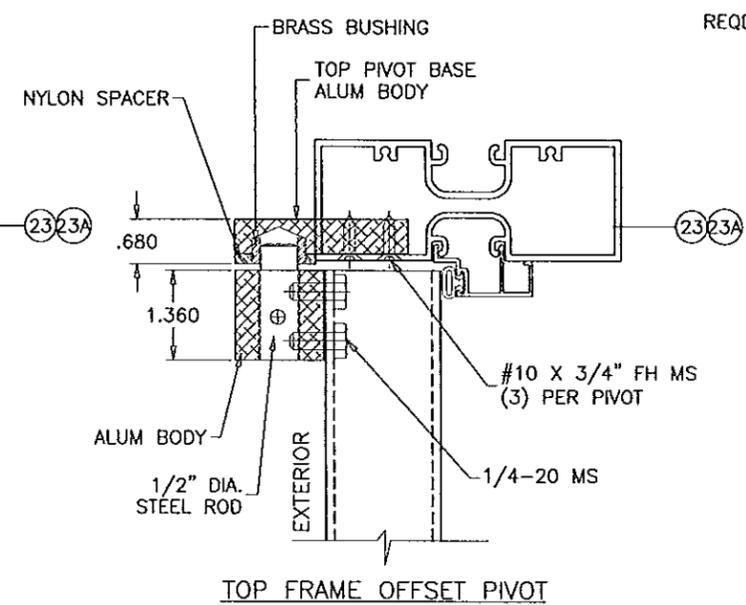

6 OR 8 ANCHORS REQD. FOR INSTALLATIONS INTO BLOCK WALL SEE CHART ABOVE

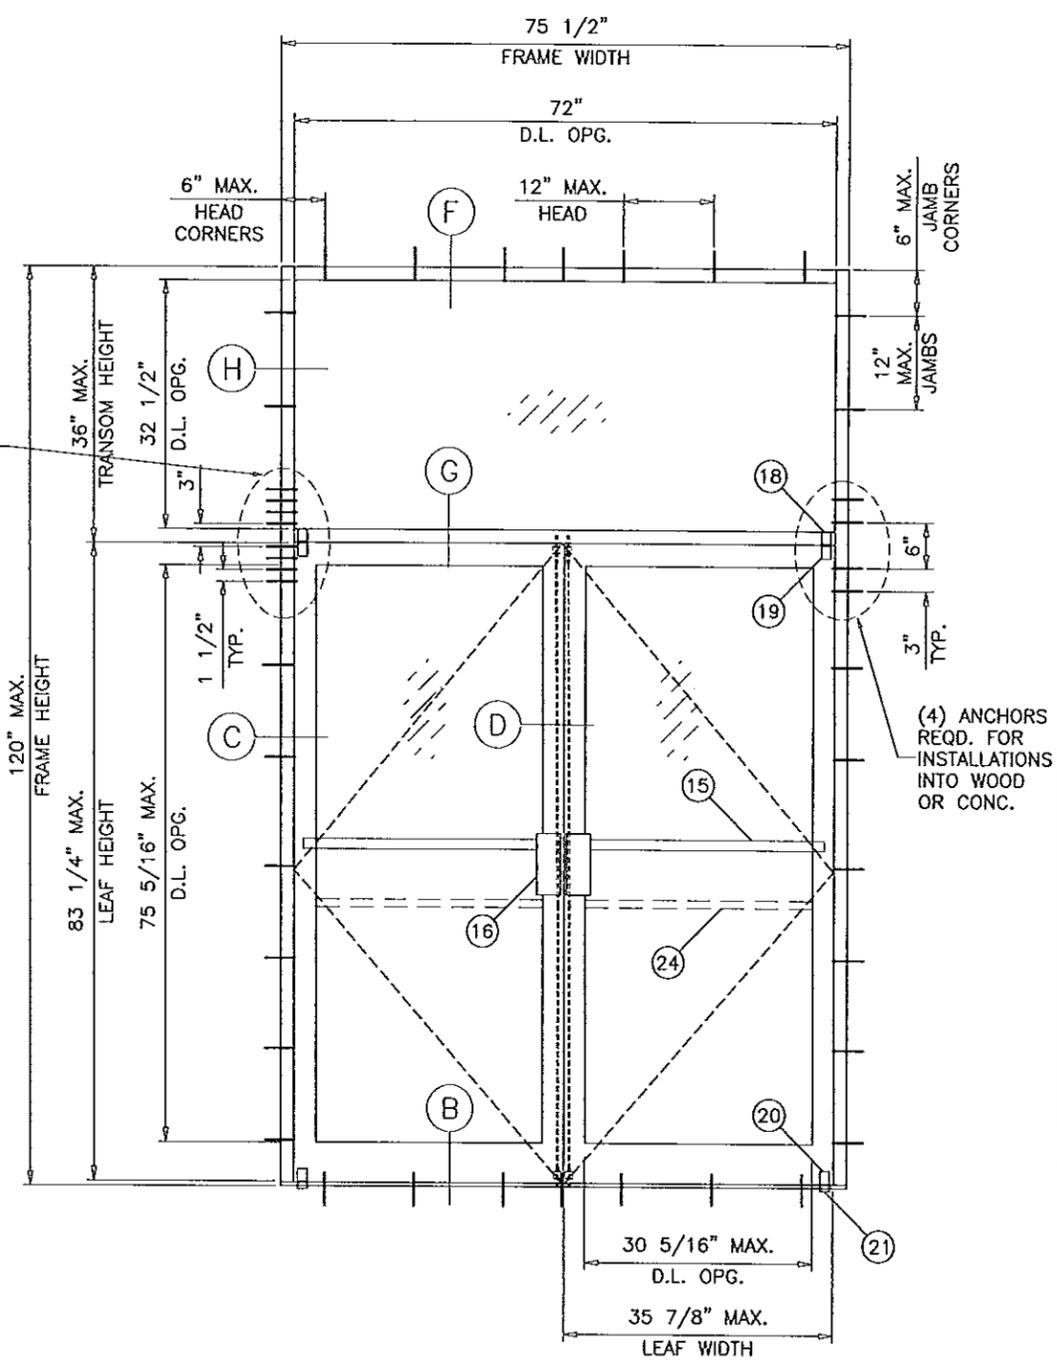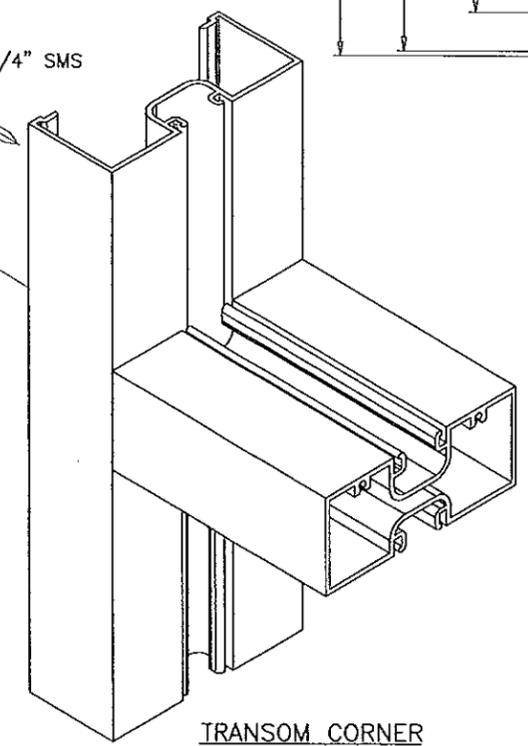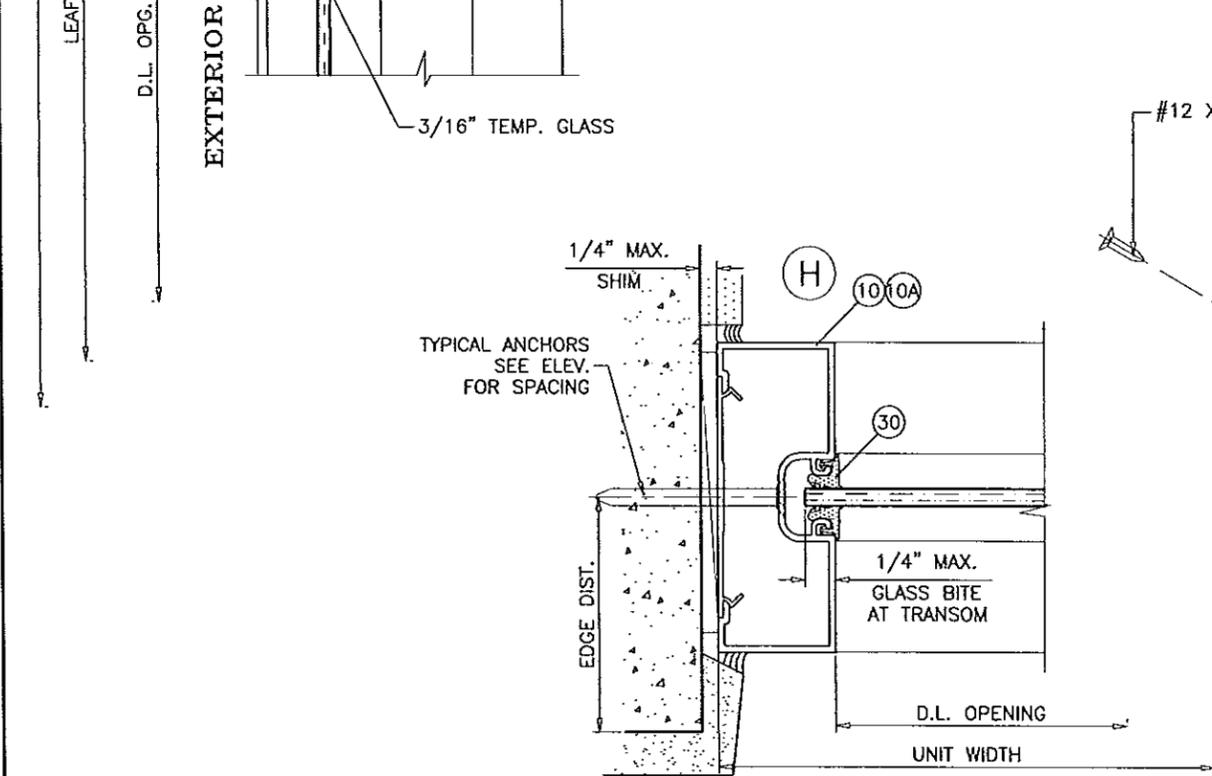

(4) ANCHORS REQD. FOR INSTALLATIONS INTO WOOD OR CONC.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 3538

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 14-0728.05  
Expiration Date ~~Sept. 14, 2016~~  
By *Manuel P...*  
Miami Dade Product Control

JUN 26 2014

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
1235 S.W. 87 AVE  
MIAMI, FLORIDA 33174  
TEL. (305) 264-8100 FAX. (305) 262-6975  
COMP-ANL\W98-23GG

S-5000 NARROW STILE ENTRANCE DOOR (N.I.)  
**GOPI GLASS CORPORATION**  
7450 N.W. 41 STREET  
MIAMI, FL. 33166  
TEL. (305) 592-2009 FAX. (305) 477-0992

no	date	description	by
F	10.14.09	UPDATED FOR 2007 FBC	
G	06.02.11	GENERAL REVISION	
H	08.04.11	REV. PER BNC COMMENTS	
I	02.24.12	NO CHANGE THIS SHEET	
J	06.23.14	UPDATED TO 2014 FBC	

date: 03-12-98  
scale: 3/8" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W98-23**  
sheet 7 of 7