MIAMI-DADE COUNTY
DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

CGI Windows & Doors
10100 NW 25th Street
Miami, FL 33172

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "360" Aluminum Single Hung Window – S.M.I.

APPROVAL DOCUMENT: Drawing No. **W08-93**, titled Series "360" Alum Single Hung Wdw. (S.M.I.)", sheets 1 through 10 of 10, dated 11/21/08, with revision E dated 08/06/14, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami–Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews NOA# 12-0221.13** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**

MIAMI-DADE COUNTY APPROVED

10/9/14

NOA No. 14-0822.10
Expiration Date: May 05, 2020
Approval Date: October 16, 2014

CGI Windows & Doors

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **W08–93**, titled Series "360" Alum Single Hung Wdw. (S.M.I.)", sheets 1 through 10 of 10, dated 11/21/08, with revision E dated 08/06/14, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
   2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
   3) Water Resistance Test, per FBC, TAS 202-94
   4) Large Missile Impact Test per FBC, TAS 201-94
   5) Small Missile Impact Test per FBC, TAS 201-94
   6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   7) Forced Entry Test, Type "A-A" vertical sliding window, Grade 10, per FBC 2411 3.2.1, TAS 202-94, per ASTM F 588–04, AAMA 1302.5–04 and CAWM 301–04

   along with marked-up drawings and installation diagram of aluminum single hung windows, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0080-0402-08, specimens 1, 2, 3** and **4**, dated 04/03/08-07/22/08, signed and sealed by Vinu J. Abraham, P.E.
   (Submitted under NOA No. 08-1208.05)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
   2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
   3) Water Resistance Test, per FBC, TAS 202-94
   4) Small Missile Impact Test per FBC, TAS 201-94
   5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   6) Forced Entry Test, Type "A-A" vertical sliding window, Grade 10, per FBC 2411 3.2.1, TAS 202-94, per ASTM F 588–04, AAMA 1302.5–04 and CAWM 301–04

   along with marked-up drawings and installation diagram of aluminum single hung windows, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0080-0323-04, specimens 1, 2, 3, 4, 5, 6, 7** and **9**, dated 03/29/04-04/02/04, signed and sealed by Vinu J. Abraham, P.E.
   (Submitted under NOA No. 05-0215.02)

Manuel Perez, P.E.
Product Control Examiner
NOA No. 14-0822.10
Expiration Date: May 05, 2020
Approval Date: October 16, 2014

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Statement letter of conformance, complying with **FBC-5th Edition (2014)**, and of no financial interest, dated July 28, 2014, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with **ASTM E1300-09.**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **13–0129.27** issued to **E.I. DuPont DeNemours & Co., Inc.** for their **"DuPont Butacite® PVB Interlayer"** dated 04/11/13, expiring on 12/11/16.
2. Notice of Acceptance No. **14–0423.15** issued to **Eastman Chemical Company (MA)** for their **"Saflex CP – Saflex and Saflex HP Composite Glass Interlayers with PET Core"** dated 06/19/14, expiring on 12/11/18.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC-5th Edition (2014)**, and of no financial interest, dated July 28, 2014, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.
2. Laboratory compliance letters for Test Report No. **HTL-0080-0402-08, specimens 1, 2, 3** and **4**, issued by Hurricane Test Laboratory, Inc., dated 07/22/08, signed and sealed by Vinu J. Abraham, P.E.
   (Submitted under NOA No. 08-1208.05)
3. Laboratory compliance letters for Test Report No. **HTL-0080-0323-04, specimens 1, 2, 3, 4, 5, 6, 7** and **9**, issued by Hurricane Test Laboratory, Inc., dated 04/02/04, signed and sealed by Vinu J. Abraham, P.E.
   (Submitted under NOA No. 05-0215.02)

G. OTHERS

1. Notice of Acceptance No. **12–0221.13**, issued to CGI Windows & Doors for their Series "360" Aluminum Single Hung Window – S.M.I., approved on 05/03/12 and expiring on 05/05/15.

Manuel Perez, P.E.
Product Control Examiner
NOA No. 14-0822.10
Expiration Date: May 05, 2020
Approval Date: October 16, 2014

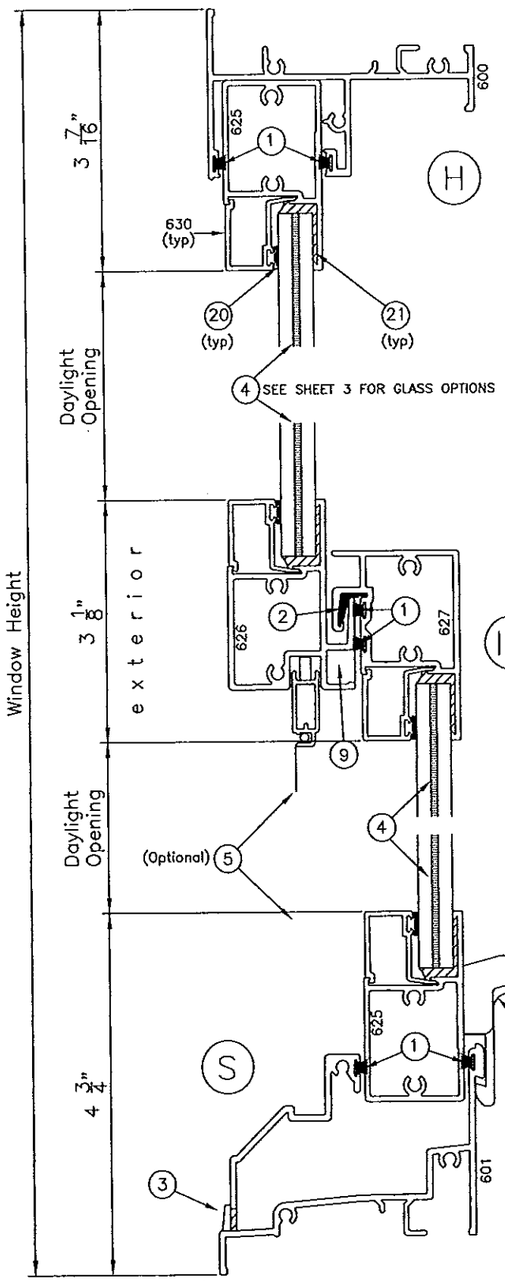

Standard 12 Psf Sill

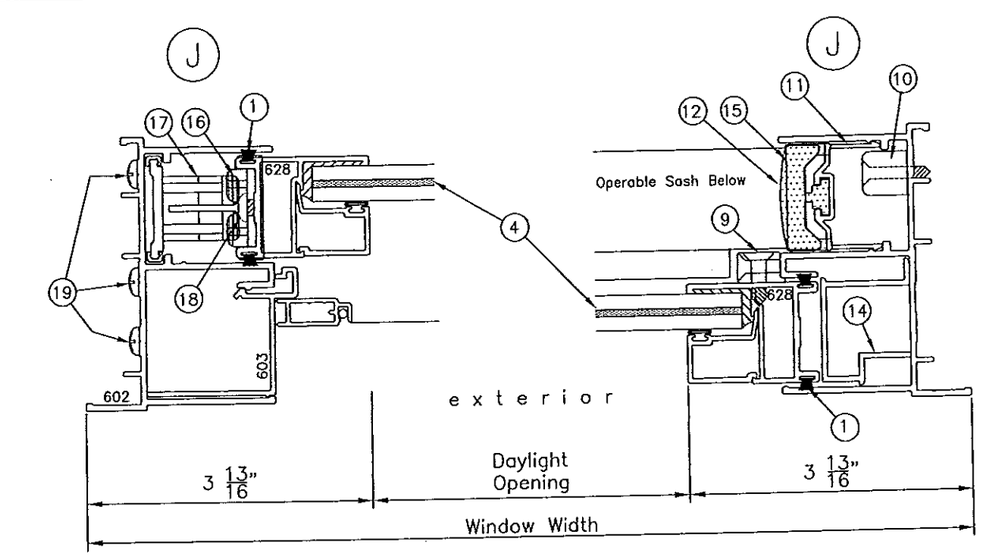



Glazing at Glass Type "6"

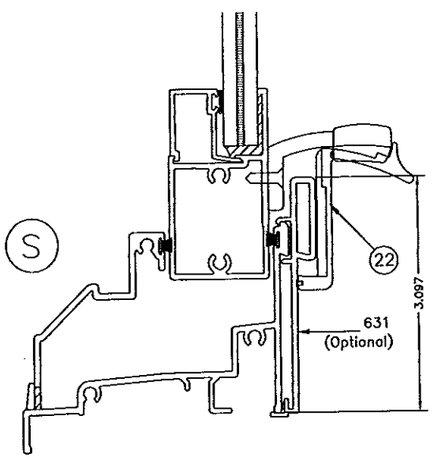

Optional 15 PSF Water Bar Adaptor

Can not be used with lock type ⑥

INSTRUCTIONS FOR USING CAPACITY CHARTS:

STEP 1 DETERMINE THE REQUIRED DESIGN PRESSURES FOR A GIVEN WINDOW OPENING.

STEP 2 DETERMINE THE CAPACITY OF THE WINDOW SIZE/CONFIGURATION/GLASS TYPE FROM CHARTS ON SHEETS 3 AND 4.

STEP 3 DETERMINE THE ANCHOR CAPACITY FROM SHEET 7 FOR SINGLE OPENINGS, APPLICABLE TO ANCHORS TYPE A, B OR C SHOWN ON SHEETS 5 AND 6.

STEP 4 IF ALUMINUM BUCKS ARE USED, VERIFY THE BUCK INSTALLATION CAPACITY FROM SHEET 9.

STEP 5 FOR UNCLIPPED MULLED WINDOWS DETERMINE MULLION/MULLION ANCHORS CAPACITY FOR 1X4 TUBE MULLION FROM CHARTS ON SHEET 8.

STEP 6 IF ALUMINUM BUCKS ARE USED DETERMINE BUCK ANCHORING REQUIREMENTS FROM CHARTS ON SHEET 10.

THE LOWEST SELECTED VALUE APPLY TO THE INSTALLATION AND MUST EQUAL OR EXCEED THE REQUIRED DESIGN PRESSURES OBTAINED FROM STEP 1.

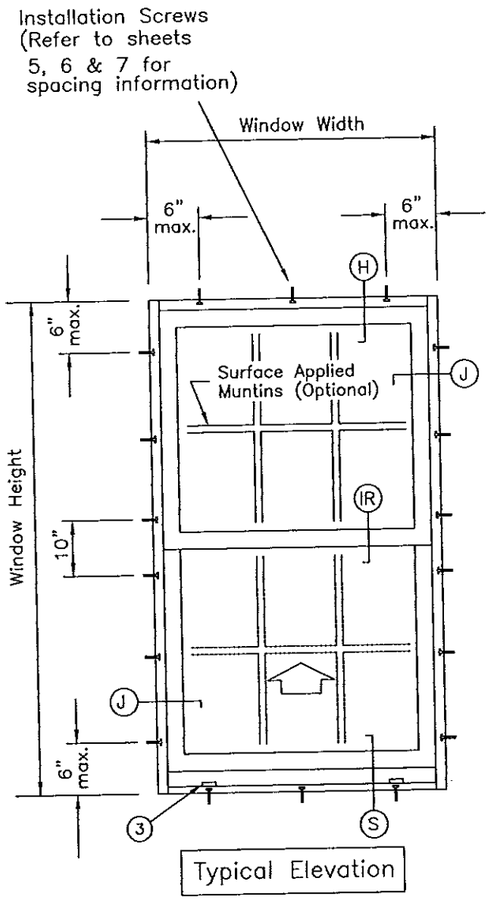

Typical Elevation

SERIES '360' ALUMINUM SINGLE HUNG WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER MIAMI-DADE COUNTY APPROVED WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN.
LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE.

THESE WINDOWS ARE RATED FOR SMALL MISSILE IMPACT.
MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE.
SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 14-0822.10
Expiration Date May 2, 2020
By Manuel Perez
Miami-Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

OCT 09 2014

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:			
no	date	by	description
D	01.03.12		UPDATED TO 2010 FBC
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: -
dr. by: -
chk. by:

drawing no. W08-93

sheet 1 of 10

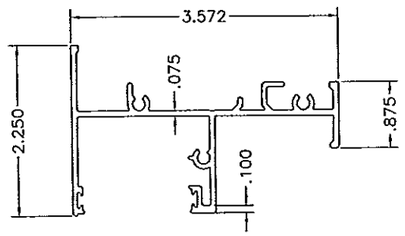

600–Frame Head
6063–T6

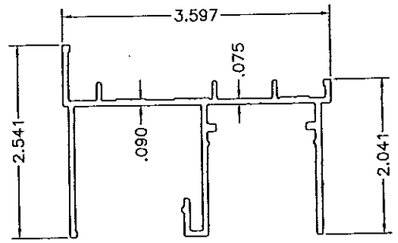

602–Frame Jamb
6063–T6



625–Horiz. Rail
6063–T6



626–Fixed Intlck.
6063–T6

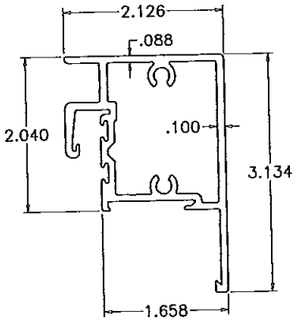

627–Moving Intlck.
6063–T6

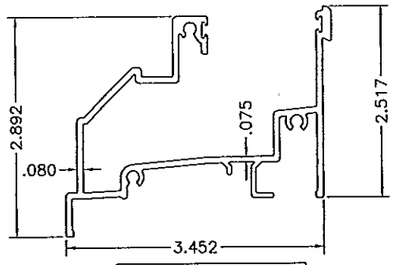

601–Frame Sill
6063–T6



628–Side Rail
6063–T6



629–Glzg. Bead
6063–T6
For Glass Type 6



630–Glzg. Bead
6063–T6
For Glass Type 5

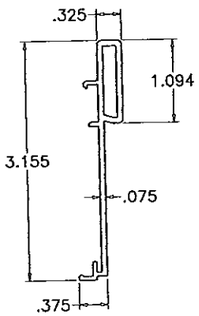

631–Waterbar
6063–T5

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER	REMARKS
1	W23201NG	AS REQD.	WOOL PILE WITH CENTER SOFT FIN (GRAY)	PILE	ULTRAFAB/SCHLEGEL	
2	CGI–612P	AS REQD.	PLASTIC BUMPER GUIDE	PVC	PROTOTYPE PLASTIC EXTRUSIONS	CONTINUOUS AT INTERLOCK
3	#146–4	2	WEEP HOLE COVER	NYLON	BUILDERS PLASTIC COMPANY	
4	N/A	AS REQD.	GLAZING	GLASS	VARIES	
5	N/A	1	COMPLETE SCREEN	ALUM/MESH		
6	CGI–615C & 616C	1 OR 2	COMBINATION EGRESS LOCK AND LIFT/PULL ATTACHED W/(2) #8 X 5/8" FH SMS	ZINC	CUSTOM CASTING	1 @ WDWS. 28" WIDE & SMALLER 2 @ WDWS. OVER 28" WIDE
9	CGI–614C	2	TIE DOWN BLOCK	ZINC	CUSTOM CASTING	
10	VARIES	2	BALANCES (B&T OR SPIRAL)	VARIES	VARIES	BOTH BALANCES CAN BE USED
11	CGI–617P	2	BALANCE COVER	PVC	PROTOTYPE PLASTIC EXTRUSIONS	LOCATED AT TOP HALF OF EACH JAMB
12	CGI–618P	2	VENT STOP	PVC	PROTOTYPE PLASTIC EXTRUSIONS	LOCATED AT TOP OF JAMBS
14	CGI–613P	2	FIXED VENT SHIM	PVC	PROTOTYPE PLASTIC EXTRUSIONS	LOCATED AT TOP OF FIXED VENT
15	CGI–619P	2	TOP GUIDE AT OPERABLE VENT	NYLON	CUSTOM CASTING	
16	CGI–622N	2	BOTTOM GUIDE/CLIP AT OPERABLE VENT	NYLON	CUSTOM CASTING	
17	CGI–620C & 621N	2	CARRIER SYSTEM	ZINC	CUSTOM CASTING	OPTIONAL – BALANCE ATTACHES TO IT
18	N/A	16	VENT ASSEMBLY SCREWS	S/S	VARIES	#10 X 1 1/4" PH SMS (2 PER CORNER)
19	N/A	12	FRAME ASSEMBLY SCREWS	S/S	VARIES	#10 X 1 1/4" PH SMS (2 PER CORNER)
20	CGI–382V	AS REQD.	VINYL BULB	PVC	PROTOTYPE PLASTIC EXTRUSIONS	
21	VARIES	AS REQD.	STUCTURAL SILICONE	SILICONE	3 SILICONES	GE–1200, GE–2000, & DOW 995
22	CGI–632	1 OR 2	COMBINATION EGRESS WB LOCK & LIFT/PULL ATTACHED W/(2) #8 X 5/8" FH SMS	ZINC	CUSTOM CASTING (FOR USE WITH WATERBAR)	1 @ WDWS. 28" WIDE & SMALLER 2 @ WDWS. OVER 28" WIDE
23	–	2/ LITE	SETTING BLOCKS	EPDM	–	DUROMETER 85±5 SHORE A

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0822.10
Expiration Date May 5, 2020
By Manuel Perez
Miami-Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

OCT 09 2014

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX. (305) 262-6978
COMP–ANL\W08–93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL (305) 593–6590 FAX. (305) 593–6592

revisions:

no	date	by	description
D	01.03.12		NO CHANGE THIS SHEET
E	08.06.14		UPDATED TO 2014 FBC

date: 11–21–08
scale: –
dr. by: –
chk. by:

drawing no.
W08–93

sheet 2 of 10

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05--DEC-219

EQUAL LITES WINDOWS					
DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE '5'		GLASS TYPE '6'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	48"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	200.0	100.0	200.0
48"		100.0	200.0	100.0	200.0
54"		100.0	171.4	100.0	171.4
24"	60"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	200.0	100.0	200.0
48"		100.0	174.5	100.0	174.5
54"		100.0	147.7	100.0	147.7
24"	72"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	200.0	100.0	200.0
48"		100.0	160.0	100.0	160.0
54"		100.0	133.3	100.0	133.3
24"	84"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	195.9	100.0	195.9
48"		100.0	152.4	100.0	152.4
54"		100.0	124.7	100.0	124.7
24"	96"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	195.9	100.0	195.9
48"		100.0	150.0	100.0	150.0
54"		100.0	120.0	100.0	120.0
24"	108"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	195.9	100.0	195.9
48"		100.0	150.0	100.0	150.0
24"	120"	100.0	200.0	100.0	200.0
30"		100.0	200.0	100.0	200.0
32"		100.0	200.0	100.0	200.0
36"		100.0	200.0	100.0	200.0
42"		100.0	195.9	100.0	195.9

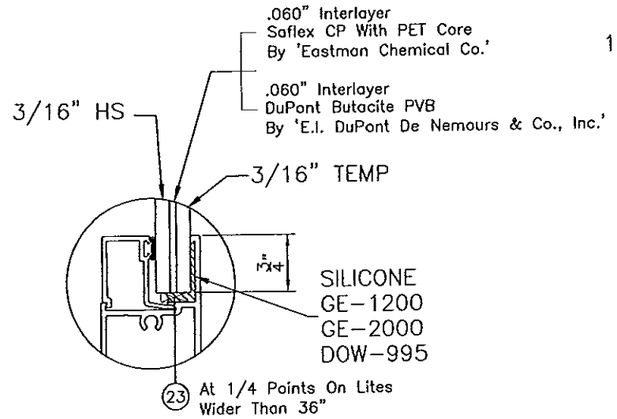

Glass Type "5"

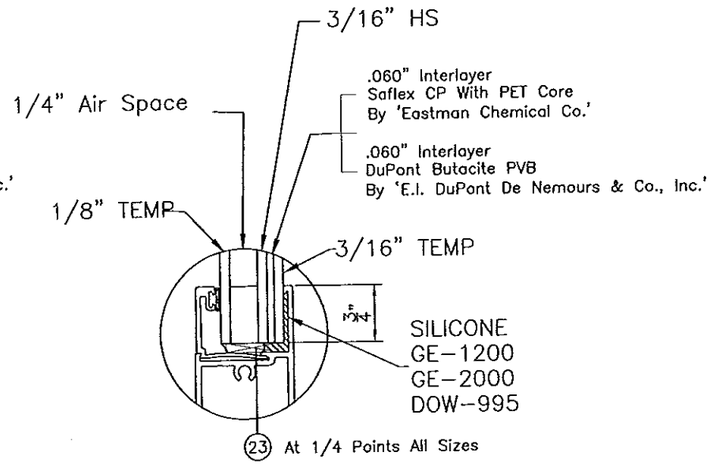

Glass Type "6"

AIR SPACE CONSISTING OF:
SPACER:
METAL SPACER AROUND
THE PERIMETER OF THE GLASS.

EQUAL LITES WINDOWS					
DESIGN LOAD CAPACITY - PSF					
WINDOW DIMS.		GLASS TYPE '5'		GLASS TYPE '6'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	100.0	200.0	100.0	200.0
26-1/2"		100.0	200.0	100.0	200.0
37"		100.0	200.0	100.0	200.0
53-1/8"		100.0	200.0	100.0	200.0
19-1/8"	38-3/8"	100.0	200.0	100.0	200.0
26-1/2"		100.0	200.0	100.0	200.0
37"		100.0	200.0	100.0	200.0
53-1/8"		100.0	200.0	100.0	200.0
19-1/8"	50-5/8"	100.0	200.0	100.0	200.0
26-1/2"		100.0	200.0	100.0	200.0
37"		100.0	200.0	100.0	200.0
53-1/8"		100.0	168.7	100.0	168.7
19-1/8"	63"	100.0	200.0	100.0	200.0
26-1/2"		100.0	200.0	100.0	200.0
37"		100.0	200.0	100.0	200.0
53-1/8"		100.0	146.8	100.0	146.8
19-1/8"	72"	100.0	200.0	100.0	200.0
26-1/2"		100.0	200.0	100.0	200.0
37"		100.0	200.0	100.0	200.0
53-1/8"		100.0	136.7	100.0	136.7
19-1/8"	76"	100.0	200.0	100.0	200.0
26-1/2"		100.0	200.0	100.0	200.0
37"		100.0	200.0	100.0	200.0
53-1/8"		100.0	133.3	100.0	133.3

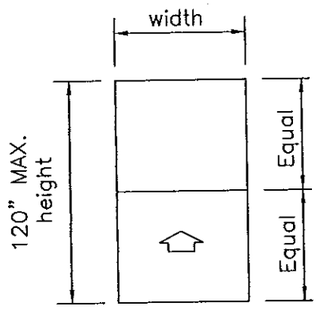

Equal Lite Window

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0822.10
Expiration Date May 5,2020
By Manuel Diaz
Miami-Dade Product Control

All values shown are Design PSF (Pounds per Square Foot)

VALUES FOR EXTERIOR LOADS(+) SHOWN ARE
FOR SILL WITH WATERBAR ADAPTER
FOR WINDOWS WITHOUT WATERBAR ADAPTER
LIMIT EXTERIOR(+) LOADS TO 80.0 PSF

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
OCT 09 2014

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:			
no	date	by	description
D	01.03.12		UPDATED TO 2010 FBC
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: -
dr. by: -
chk. by:

drawing no.
W08-93

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

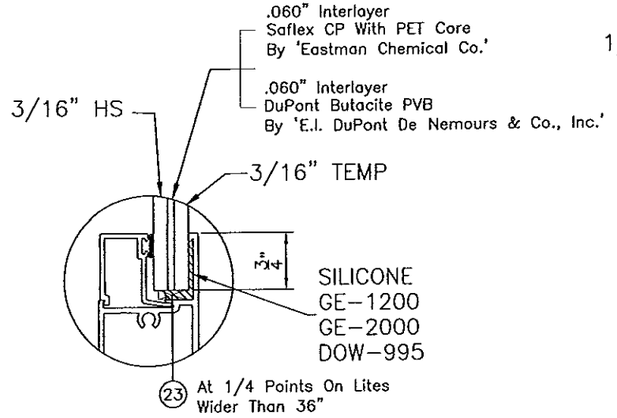

Glass Type "5"

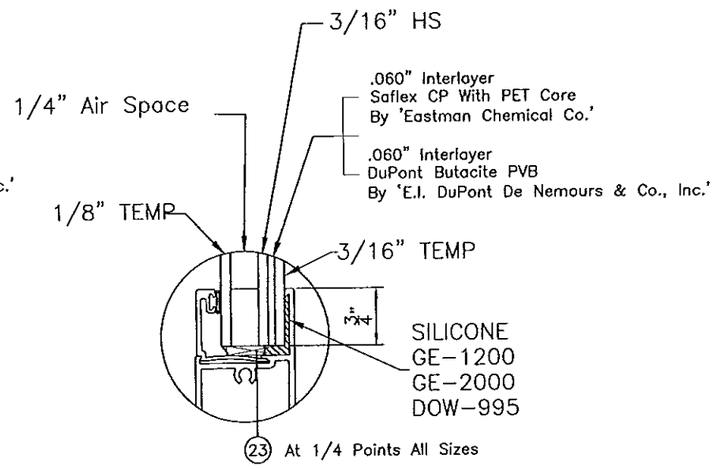

Glass Type "6"

AIR SPACE CONSISTING OF:
SPACER:
METAL SPACER AROUND
THE PERIMETER OF THE GLASS.

UNEQUAL LITES WINDOWS (ORIEL)
DESIGN LOAD CAPACITY - PSF

WINDOW DIMS.		TOP VENT	GLASS TYPE '5'		GLASS TYPE '6'	
WIDTH	HEIGHT	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	96" (MAX.)	48"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0
32"			100.0	200.0	100.0	200.0
36"			100.0	200.0	100.0	200.0
42"			100.0	195.9	100.0	195.9
48"			100.0	150.0	100.0	150.0
54"			100.0	120.0	100.0	120.0
24"	108" (MAX.)	54"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0
32"			100.0	200.0	100.0	200.0
36"			100.0	200.0	100.0	200.0
42"			100.0	195.9	100.0	195.9
48"			100.0	150.0	100.0	150.0
24"	120" (MAX.)	60"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0
32"			100.0	200.0	100.0	200.0
36"			100.0	200.0	100.0	200.0
42"			100.0	195.9	100.0	195.9
24"	120" (MAX.)	66"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0
32"			100.0	200.0	100.0	200.0
36"			100.0	200.0	100.0	200.0
24"	120" (MAX.)	72"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0
32"			100.0	200.0	100.0	200.0
36"			100.0	200.0	100.0	200.0
24"	120" (MAX.)	78"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0
24"	120" (MAX.)	84"	100.0	200.0	100.0	200.0
30"			100.0	200.0	100.0	200.0

UNEQUAL LITES WINDOWS (ORIEL)
DESIGN LOAD CAPACITY - PSF

WINDOW DIMS.		TOP VENT	GLASS TYPE '5'		GLASS TYPE '6'	
WIDTH	HEIGHT	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	96" (MAX.)	48"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0
37"			100.0	200.0	100.0	200.0
53-1/8"			100.0	123.6	100.0	123.6
19-1/8"	108" (MAX.)	54"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0
37"			100.0	200.0	100.0	200.0
19-1/8"	120" (MAX.)	60"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0
37"			100.0	200.0	100.0	200.0
19-1/8"	120" (MAX.)	66"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0
37"			100.0	200.0	100.0	200.0
19-1/8"	120" (MAX.)	72"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0
19-1/8"	120" (MAX.)	78"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0
19-1/8"	120" (MAX.)	84"	100.0	200.0	100.0	200.0
26-1/2"			100.0	200.0	100.0	200.0

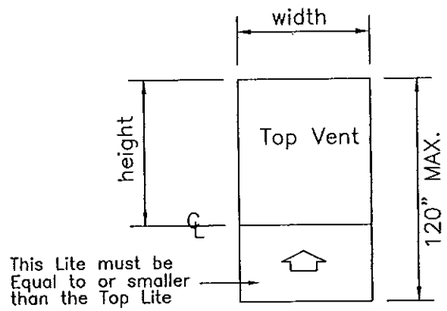

Unequal Lite Window

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0822.10
Expiration Date May 5 2020
By Manuel Perez
Miami-Dade Product Control

All values shown are Design PSF (Pounds per Square Foot)

VALUES FOR EXTERIOR LOADS(+) SHOWN ARE
FOR SILL WITH WATERBAR ADAPTER
FOR WINDOWS WITHOUT WATERBAR ADAPTER
LIMIT EXTERIOR(+) LOADS TO 80.0 PSF

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
OCT 09 2014

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-93CGI

SERIES '360' ALUM. SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:

no	date	by	description
D	01.03.12		UPDATED TO 2010 FBC
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: -
dr. by: -
chk. by:

drawing no.
W08-93

sheet 4 of 10

Installation Type "A"

w/ 1 x 4 Beveled P.T. Wood Buck

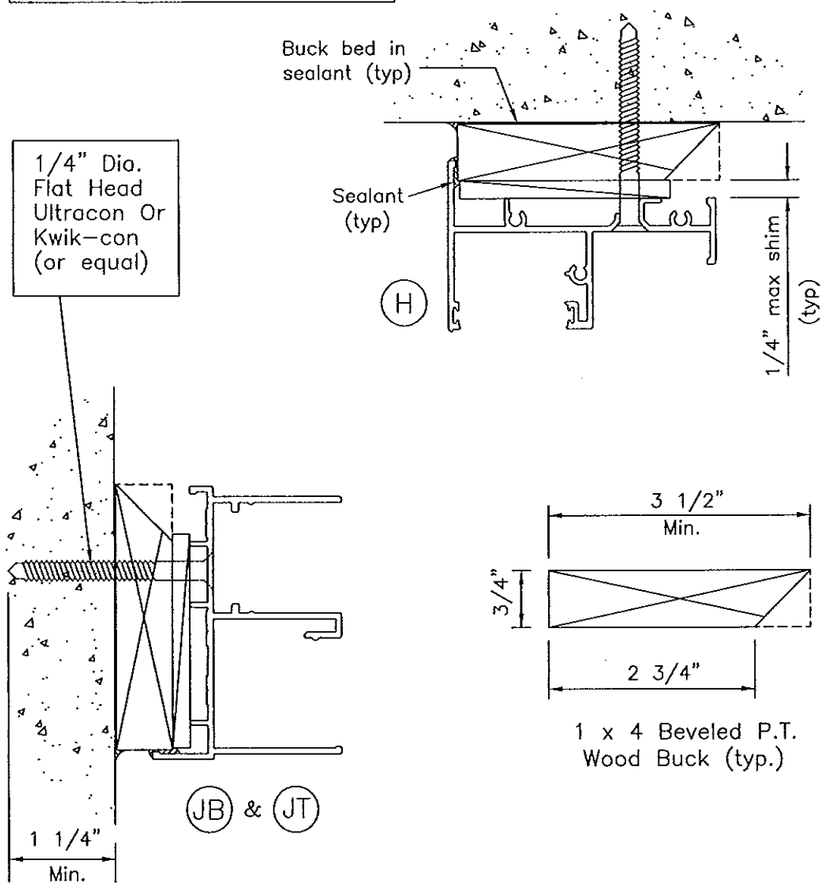

1 x 4 Beveled P.T. Wood Buck (typ.)

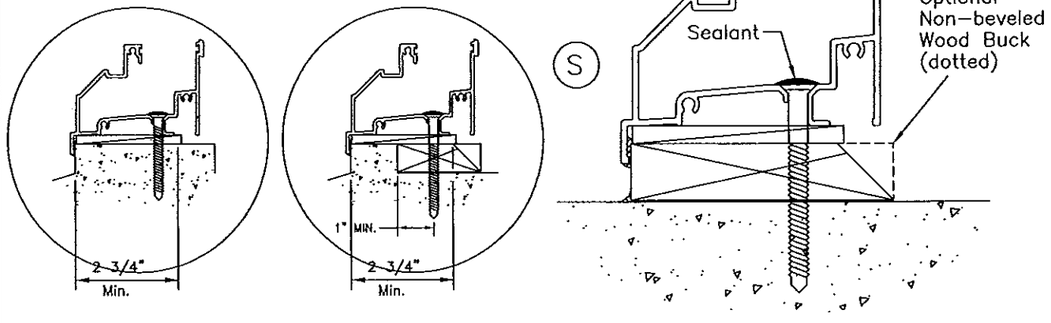

Optional Pre–Cast Sill

IMPORTANT NOTE:

Wood Bucks must sustain loads imposed by glazing system and transfer them to the building structure.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

1/4" DIA. HILTI KWIK–CON II (Fu=163 KSI, Fy=157 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1–1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1–1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONCRETE OR FILLED BLOCKS
1–3/4" MIN. EMBED INTO CONCRETE OR FILLED BLOCK

1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)

INTO MIAMI–DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")

INTO METAL STRUCTURES
STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063–T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2–1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C–90 FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Values for Installation Type "A" apply to the following installation types, with maximum shim space 1/4":

1– Using 1by P.T. wood bucks, min. 3/4" thick,

2– Directly into masonry, without the use of wood bucks.

3– Directly into a steel or aluminum structure Min. 1/8" thick and using #14 Teks or Self drilling screws. Structure must be designed by others to sustain the loads imposed by the window.

PRODUCT REVISED
as complying with the Florida
Building Code 14-0822.10
Acceptance No
Expiration Date May 5 2020
By Manuel Perez
Miami-Dade Product Control

Engr: JAVAD AHMAD
CMIL
FLA. PE # 70592
C.A.N. 3538

OCT 09 2014

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP–ANL\W08–93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593–6590 FAX. (305) 593–6592

revisions:			
no	date	by	description
D	01.03.12		NO CHANGE THIS SHEET
E	08.06.14		UPDATED TO 2014 FBC

date: 11–21–08
scale: –
dr. by: –
chk. by:

drawing no.
W08–93

Installation Type "B"

w/ 2 x 4 Beveled P.T. Wood Buck

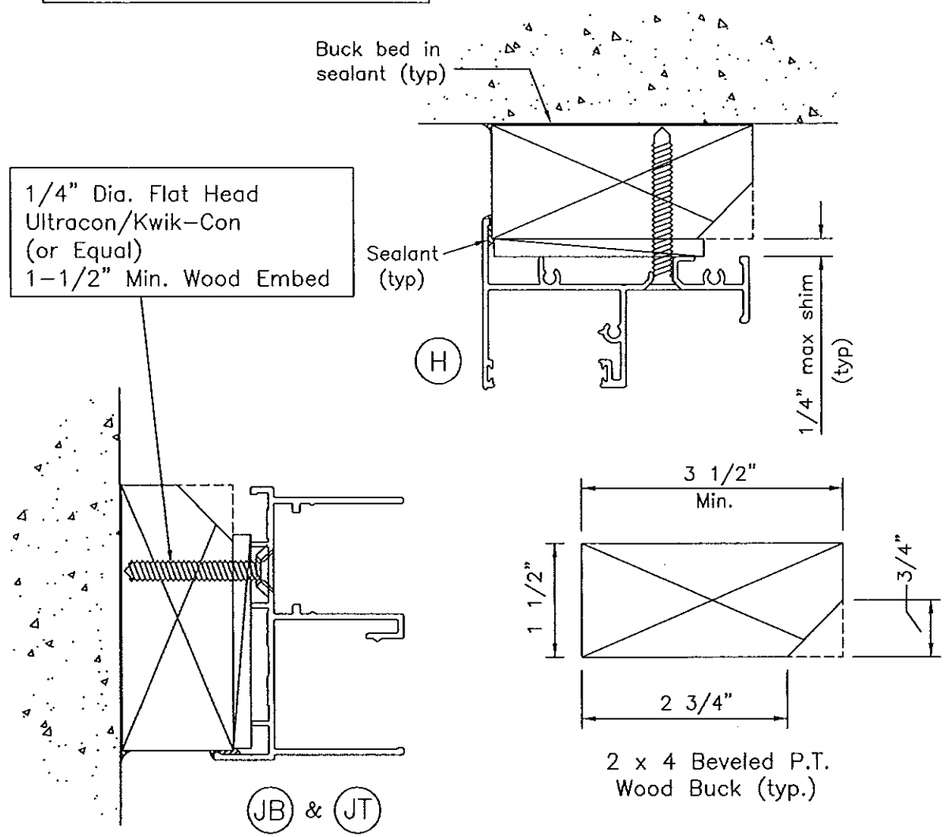

2 x 4 Beveled P.T. Wood Buck (typ.)

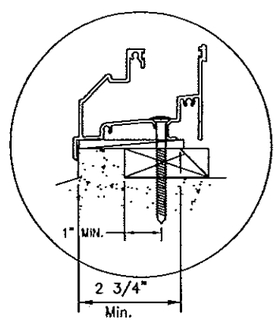

Optional Pre-Cast Sill

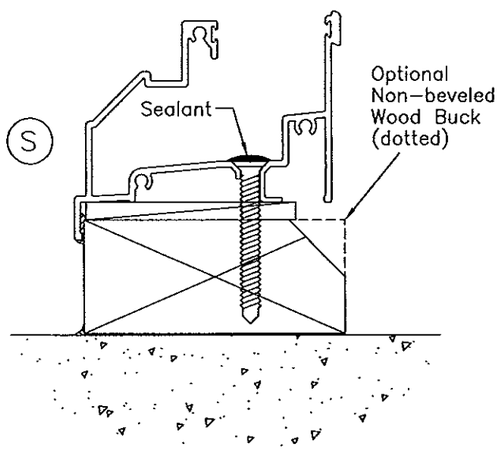

Installation Type "C"

based on wood penetration only using 1 x 4 or 2 x 4 wood bucks

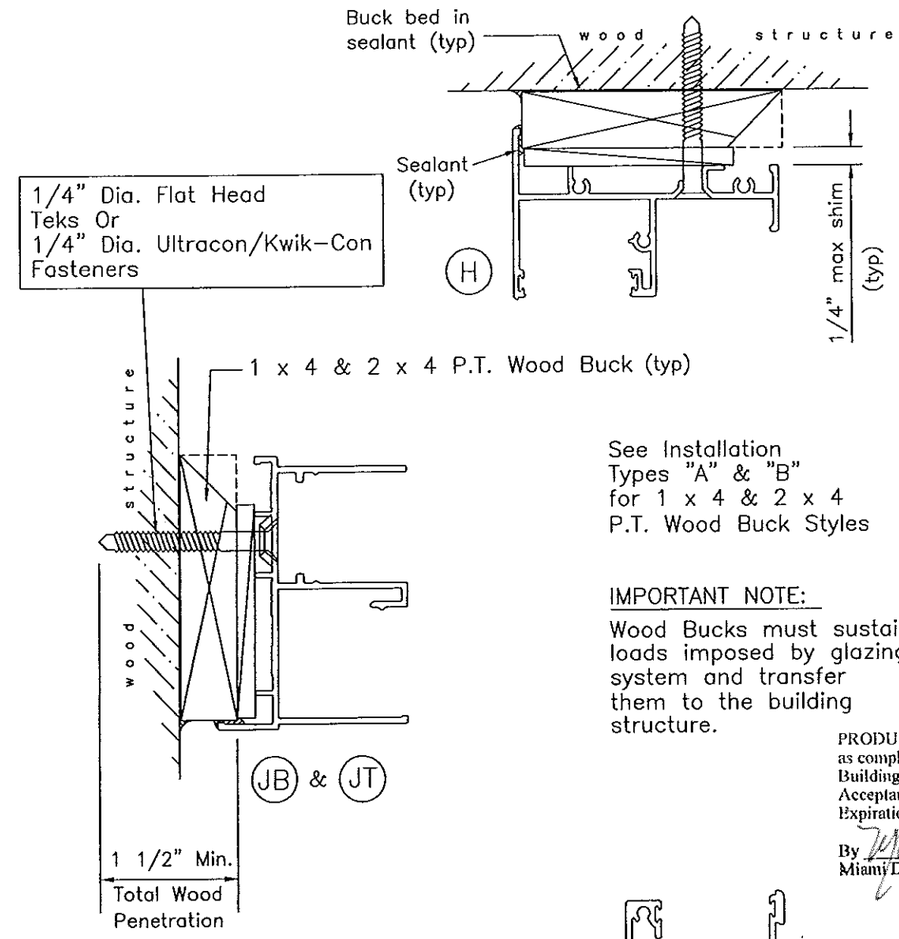

See Installation Types "A" & "B" for 1 x 4 & 2 x 4 P.T. Wood Buck Styles

IMPORTANT NOTE:

Wood Bucks must sustain loads imposed by glazing system and transfer them to the building structure.

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 14-0822.10
Expiration Date May 5.2020
By Manuel Perez
Miami-Dade Product Control

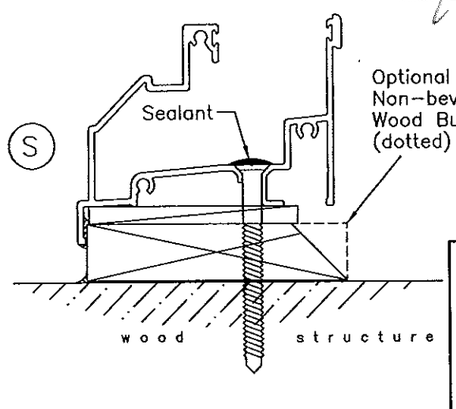

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
OCT 09 2014

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:			
no	date	by	description
D	01.03.12		NO CHANGE THIS SHEET
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: -
dr. by: -
chk. by:

drawing no. W08-93

sheet 6 of 10

ANCHORS				
DESIGN LOAD CAPACITY – PSF				
WINDOW DIMS.		NO. OF ANCHORS	STD. HOLE PATTERN W/O ADDL. ANCHOR	STD. HOLE PATTERN WITH ADDL. ANCHOR
WIDTH	HEIGHT	AT JAMB	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)
24"	48"	4	200.0	200.0
30"			200.0	200.0
32"			200.0	200.0
36"			200.0	200.0
42"			200.0	200.0
48"			175.7	200.0
54"			147.2	200.0
24"	60"	4	200.0	200.0
30"			193.7	200.0
32"			185.5	200.0
36"			170.9	200.0
42"			152.9	191.2
48"			138.4	173.0
54"			126.3	157.9
24"	72"	6	200.0	200.0
30"			200.0	200.0
32"			200.0	200.0
36"			200.0	200.0
42"			181.6	200.0
48"			145.3	192.6
54"			117.2	175.7
24"	84"	6	200.0	200.0
30"			189.5	200.0
32"			180.3	200.0
36"			165.1	192.6
42"			147.7	173.0
48"			134.5	157.9
54"			112.9	145.3
24"	96"	6	194.6	200.0
30"			161.4	188.3
32"			153.2	178.8
36"			139.7	163.0
42"			124.5	145.3
48"			113.5	132.4
54"			104.8	122.2
24"	108"	8	200.0	200.0
30"			187.5	200.0
32"			177.7	199.9
36"			161.4	181.6
42"			143.1	161.0
48"			129.7	145.9
24"	120"	8	200.0	200.0
30"			166.0	186.8
32"			157.2	176.8
36"			142.4	160.2
42"			125.8	141.5

ANCHORS				
DESIGN LOAD CAPACITY – PSF				
WINDOW DIMS.		NO. OF ANCHORS	STD. HOLE PATTERN W/O ADDL. ANCHOR	STD. HOLE PATTERN WITH ADDL. ANCHOR
WIDTH	HEIGHT	AT JAMB	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)
19–1/8"	26"	4	200.0	200.0
26–1/2"			200.0	200.0
37"			200.0	200.0
53–1/8"			200.0	200.0
19–1/8"	38–3/8"	4	200.0	200.0
26–1/2"			200.0	200.0
37"			200.0	200.0
53–1/8"			176.9	200.0
19–1/8"	50–5/8"	4	200.0	200.0
26–1/2"			200.0	200.0
37"			200.0	200.0
53–1/8"			145.6	196.3
19–1/8"	63"	4	200.0	200.0
26–1/2"			198.4	200.0
37"			157.4	196.7
53–1/8"			120.5	150.7
19–1/8"	72"	6	200.0	200.0
26–1/2"			200.0	200.0
37"			198.1	200.0
53–1/8"			120.6	178.7
19–1/8"	76"	6	200.0	200.0
26–1/2"			200.0	200.0
37"			184.4	200.0
53–1/8"			118.2	166.9

LOADS APPLY TO INSTALLATION TYPES A, B & C AND INTO ALUMINUM BUCKS FOR ALUMINUM BUCK INSTALLATION SEE SHEETS 9 AND 10.

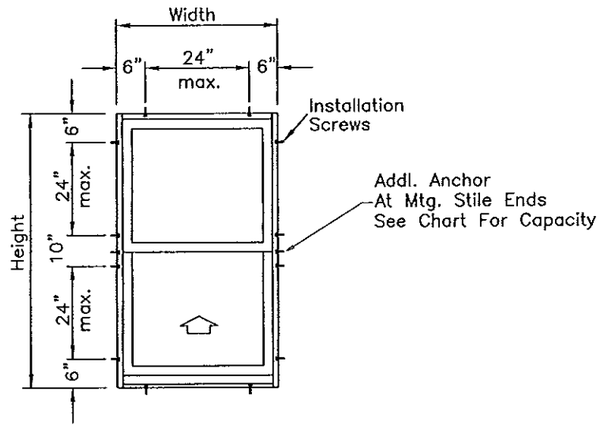

CGI Standard Hole Pattern

Refer to sheets 5 & 6 of 10 for description of installation types A – B – C

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

OCT 09 2014

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0822.10
Expiration Date May 5, 2020
By Manuel Perez
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL (305) 593-6590 FAX. (305) 593-6592

revisions:			
no	date	by	description
D	01.03.12		CHART REV.
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: –
dr. by: –
chk. by:

drowing no.
W08-93

sheet 7 of 10

Vertical Mullion Performance

$$\text{Tributary Width} = \frac{W1 + W2}{2}$$

For Window Performance, refer to sheets 3 or 4

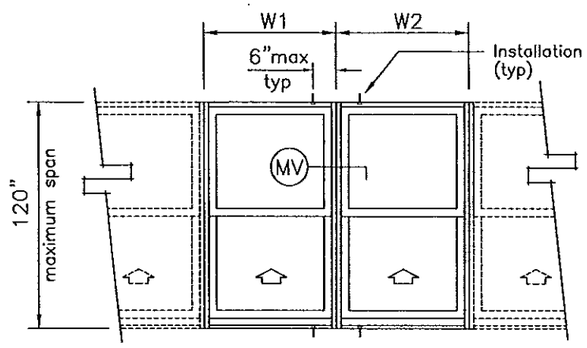

Multiple Opening
(2 or more windows)
w/ 1 screw on each side of mullion
Standard Installation

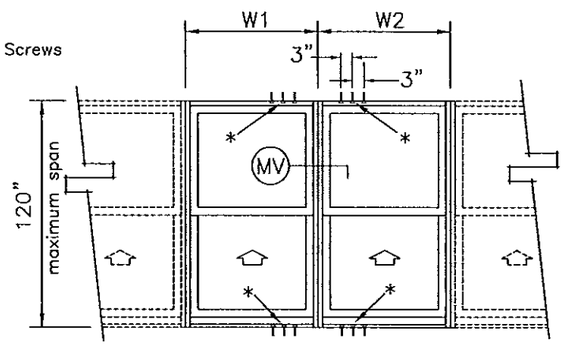

Multiple Opening
(2 or more windows)
w/ 2 or 3 screws on each side of mullion
High Load Installation

(* = additional holes to be drilled by installer)

Horizontal Mullion Performance

For Window Performance, refer to sheets 3 or 4

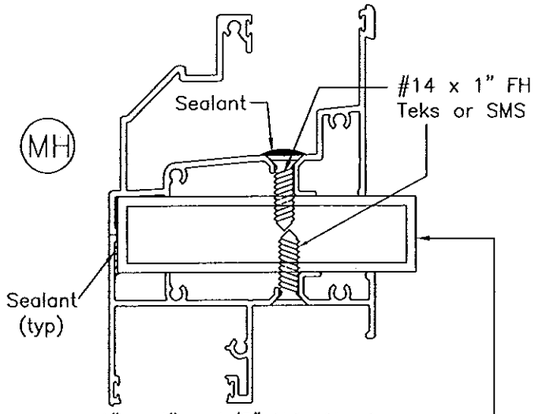

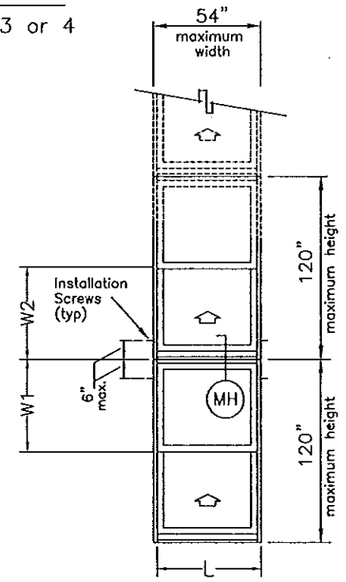

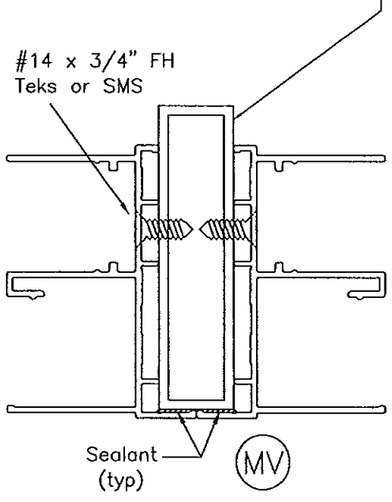

MULLION DESIGN LOAD CAPACITY – PSF				
WINDOW DIMS.		ONE ANCHOR EACH SIDE	TWO ANCHORS EACH SIDE	THREE ANCHORS EACH SIDE
WIDTH	HEIGHT	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)
24"	48"	150.0	200.0	200.0
30"		130.9	200.0	200.0
32"		126.6	200.0	200.0
36"		120.0	200.0	200.0
42"		114.5	200.0	200.0
48"		112.5	200.0	200.0
54"		112.5	200.0	200.0
24"	60"	112.5	200.0	200.0
30"		96.0	192.0	200.0
32"		92.0	184.1	200.0
36"		85.7	171.4	200.0
42"		79.1	158.2	200.0
48"		75.0	150.0	200.0
54"		72.7	145.5	200.0
24"	72"	90.0	180.0	200.0
30"		75.8	151.6	200.0
32"		72.3	144.6	200.0
36"		66.7	133.3	200.0
42"		60.5	121.0	181.5
48"		56.3	112.5	168.8
54"		53.3	106.7	160.0
24"	84"	75.0	150.0	200.0
30"		62.6	125.2	172.5
32"		59.6	119.1	162.9
36"		54.5	109.1	147.1
42"		49.0	98.0	129.7
48"		45.0	90.0	117.4
54"		42.1	84.2	108.4

MULLION DESIGN LOAD CAPACITY – PSF				
WINDOW DIMS.		ONE ANCHOR EACH SIDE	TWO ANCHORS EACH SIDE	THREE ANCHORS EACH SIDE
WIDTH	HEIGHT	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)
24"	96"	64.3	128.6	140.7
30"		53.3	106.7	114.1
32"		50.6	101.2	107.6
36"		46.2	92.3	96.8
42"		41.1	82.3	84.8
48"		37.5	75.0	76.1
54"		34.8	69.6	69.6
24"	108"	56.3	98.3	98.3
30"		46.5	79.5	79.5
32"		44.0	74.9	74.9
36"		40.0	67.2	67.2
42"		35.5	58.5	58.5
48"		32.1	52.2	52.2
24"	120"	50.0	71.4	71.4
30"		41.1	57.6	57.6
32"		38.9	54.2	54.2
36"		35.3	48.5	48.5
42"		31.2	42.2	42.2

MULLION DESIGN LOAD CAPACITY – PSF				
WINDOW DIMS.		ONE ANCHOR EACH SIDE	TWO ANCHORS EACH SIDE	THREE ANCHORS EACH SIDE
WIDTH	HEIGHT	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)	EXT.(+) & INT.(–)
53-1/8"	26"	200.0	200.0	200.0
19-1/8"	38-3/8"	200.0	200.0	200.0
26-1/2"		194.6	200.0	200.0
37"		176.2	200.0	200.0
53-1/8"		176.0	200.0	200.0
19-1/8"	50-5/8"	165.0	200.0	200.0
26-1/2"		130.9	200.0	200.0
37"		109.0	200.0	200.0
53-1/8"		101.1	200.0	200.0
19-1/8"	63"	126.8	200.0	200.0
26-1/2"		98.3	196.6	200.0
37"		78.7	157.4	200.0
53-1/8"		67.0	133.9	200.0
19-1/8"	72"	108.5	200.0	200.0
26-1/2"		83.2	166.5	200.0
37"		65.5	130.9	196.4
53-1/8"		53.7	107.4	161.1
19-1/8"	76"	102.0	200.0	200.0
26-1/2"		77.9	155.9	200.0
37"		60.9	121.8	182.7
53-1/8"		49.3	98.7	148.0

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
OCT 09 2014

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0822.10
Expiration Date May 5, 2020
By Manuel Perez
Miami-Dade Product Control

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:			
no	date	by	description
D	01.03.12		NO CHANGE THIS SHEET
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: –
dr. by: –
chk. by:

drawing no.
W08-93

sheet 8 of 10

PERFORMANCE VALUES OF ALUMINUM BUCK INSTALLATION ANCHORS

EXT.(+) & INT.(−)

WINDOW DIMS.		ANCHOR SPACING INTO CONC.		ANCHOR SPACING INTO HOLLOW BLOCK		ANCHOR SPACING INTO WOOD	
WIDTH	HEIGHT	16" O.C.	8" O.C.	16" O.C.	8" O.C.	16" O.C.	8" O.C.
24"	48"	200.0	200.0	178.7	200.0	200.0	200.0
30"		200.0	200.0	155.9	200.0	200.0	200.0
32"		200.0	200.0	150.8	200.0	200.0	200.0
36"		200.0	200.0	142.9	200.0	200.0	200.0
42"		200.0	200.0	131.3	200.0	176.3	200.0
48"		200.0	200.0	131.3	200.0	180.0	200.0
54"		168.0	200.0	107.2	187.6	144.0	200.0
24"	60"	200.0	200.0	134.0	200.0	200.0	200.0
30"		179.2	200.0	114.3	200.0	200.0	200.0
32"		171.8	200.0	109.6	191.9	200.0	200.0
36"		160.0	200.0	102.1	178.7	200.0	200.0
42"		147.7	200.0	94.2	164.9	176.3	200.0
48"		140.0	200.0	89.3	156.3	180.0	200.0
54"		135.8	200.0	86.6	151.6	142.2	200.0
24"	72"	200.0	200.0	134.0	200.0	200.0	200.0
30"		176.8	200.0	112.8	200.0	200.0	200.0
32"		168.8	200.0	107.7	193.8	200.0	200.0
36"		155.6	200.0	99.3	178.7	200.0	200.0
42"		141.2	200.0	90.1	162.2	176.3	200.0
48"		131.3	200.0	83.8	150.8	180.0	200.0
54"		124.4	200.0	79.4	142.9	142.2	200.0
24"	84"	200.0	200.0	134.0	200.0	200.0	200.0
30"		175.3	200.0	111.9	186.4	200.0	200.0
32"		166.8	200.0	106.4	177.4	200.0	200.0
36"		152.7	200.0	97.5	162.4	200.0	200.0
42"		137.1	200.0	87.5	145.9	176.3	200.0
48"		126.0	200.0	80.4	134.0	180.0	200.0
54"		117.9	196.5	75.2	125.4	142.2	200.0
24"	96"	200.0	200.0	134.0	200.0	200.0	200.0
30"		174.2	200.0	111.2	190.6	200.0	200.0
32"		165.4	200.0	105.5	180.9	200.0	200.0
36"		150.8	200.0	96.2	164.9	200.0	200.0
42"		134.4	200.0	85.8	147.0	176.3	200.0
48"		122.5	200.0	78.2	134.0	180.0	200.0
54"		113.6	194.8	72.5	124.3	142.2	200.0
24"	108"	183.8	200.0	117.3	200.0	200.0	200.0
30"		151.7	200.0	96.8	179.8	200.0	200.0
32"		143.8	200.0	91.8	170.4	200.0	200.0
36"		130.7	200.0	83.4	154.8	200.0	200.0
42"		115.9	200.0	73.9	137.3	176.3	200.0
48"		105.0	195.0	67.0	124.4	180.0	200.0
24"	120"	186.7	200.0	119.1	200.0	200.0	200.0
30"		153.6	200.0	98.0	183.8	200.0	200.0
32"		145.4	200.0	92.8	173.9	200.0	200.0
36"		131.8	200.0	84.1	157.6	200.0	200.0
42"		116.4	200.0	74.3	139.2	176.3	200.0

PERFORMANCE VALUES OF ALUMINUM BUCK INSTALLATION ANCHORS

EXT.(+) & INT.(−)

WINDOW DIMS.		ANCHOR SPACING INTO CONC.		ANCHOR SPACING INTO HOLLOW BLOCK		ANCHOR SPACING INTO WOOD	
WIDTH	HEIGHT	16" O.C.	8" O.C.	16" O.C.	8" O.C.	16" O.C.	8" O.C.
19−1/8"	26"	200.0	200.0	200.0	200.0	200.0	200.0
26−1/2"		200.0	200.0	200.0	200.0	200.0	200.0
37"		200.0	200.0	185.5	200.0	200.0	200.0
53−1/8"		200.0	200.0	148.0	200.0	198.8	200.0
19−1/8"	38−3/8"	200.0	200.0	200.0	200.0	200.0	200.0
26−1/2"		200.0	200.0	173.9	200.0	200.0	200.0
37"		200.0	200.0	157.4	200.0	200.0	200.0
53−1/8"		185.8	200.0	118.5	200.0	159.2	200.0
19−1/8"	50−5/8"	200.0	200.0	196.6	200.0	200.0	200.0
26−1/2"		200.0	200.0	155.9	200.0	200.0	200.0
37"		200.0	200.0	129.9	194.8	200.0	200.0
53−1/8"		171.8	200.0	109.6	180.7	147.3	200.0
19−1/8"	63"	200.0	200.0	188.8	200.0	200.0	200.0
26−1/2"		200.0	200.0	146.4	200.0	200.0	200.0
37"		183.7	200.0	117.2	187.5	200.0	200.0
53−1/8"		156.2	200.0	99.7	159.5	146.9	200.0
19−1/8"	72"	200.0	200.0	161.6	200.0	200.0	200.0
26−1/2"		194.2	200.0	123.9	200.0	200.0	200.0
37"		152.8	200.0	97.5	175.5	200.0	200.0
53−1/8"		125.3	200.0	79.9	143.9	146.9	200.0
19−1/8"	76"	200.0	200.0	151.9	200.0	200.0	200.0
26−1/2"		181.9	200.0	116.0	200.0	200.0	200.0
37"		142.1	200.0	90.7	163.3	200.0	200.0
53−1/8"		115.1	200.0	73.5	132.2	146.9	200.0

ALUMINUM BUCK FRAMING DETAILS

REFER TO SHEETS 3 THRU 9 FOR WINDOW CAPACITIES
USE LOWER APPLICABLE VALUES.

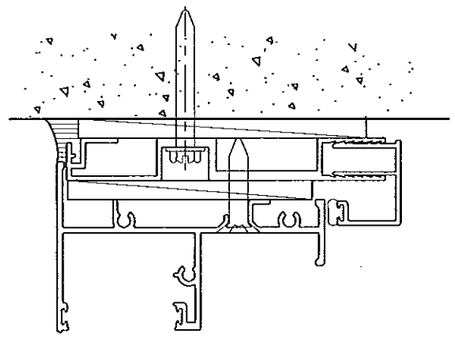

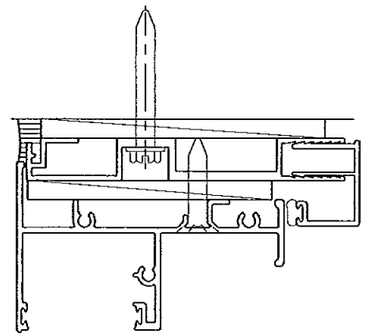

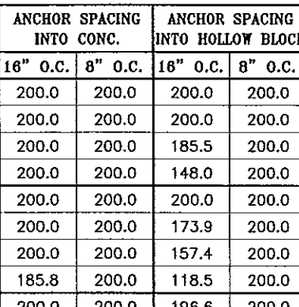

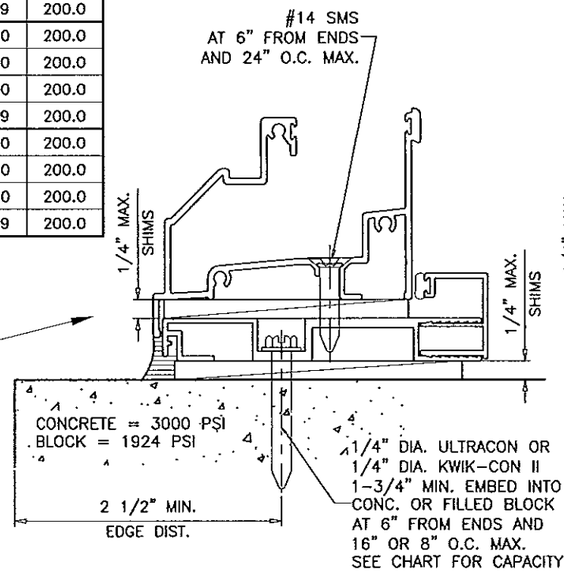

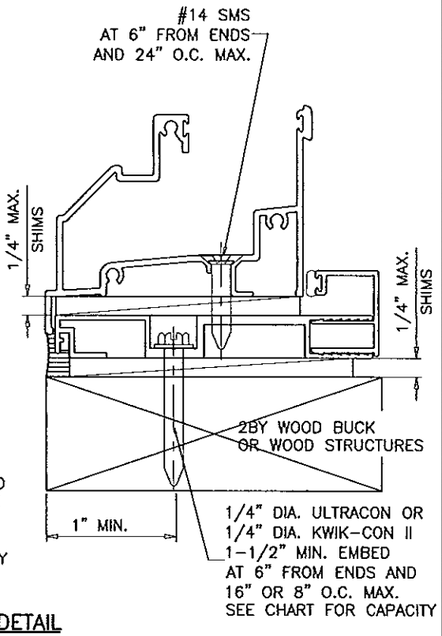

TYPICAL INSTALLATION DETAIL ON ALL FOUR SIDES/USING ALUMINUM BUCK SYSTEM

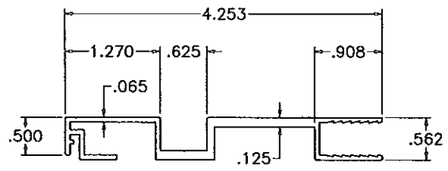

ALUMINUM BUCK
6063−T6



OPTIONAL COVER
6063−T6

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

OCT 09 2014

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0822.10
Expiration Date May 5, 2020
By Manuel Perez
Miami-Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:

no	date	by	description
D	01.03.12		CHART REV.
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: -
dr. by: -
chk. by:

drawing no.
W08-93

PERFORMANCE VALUES OF ALUMINUM BUCK INSTALLATION ANCHORS

EXT.(+) & INT.(−)

WINDOW DIMS.		ANCHORS INTO HOLLOW BLOCK				ANCHORS INTO CONC.				ANCHORS INTO WOOD			
WIDTH	HEIGHT	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8
24"		89.3	178.7	200.0	200.0	140.0	200.0	200.0	200.0	120.0	200.0	200.0	200.0
30"		78.0	155.9	200.0	200.0	122.2	200.0	200.0	200.0	104.7	200.0	200.0	200.0
32"		75.4	150.8	200.0	200.0	118.1	200.0	200.0	200.0	101.3	200.0	200.0	200.0
36"	48"	71.5	142.9	200.0	200.0	112.0	200.0	200.0	200.0	96.0	192.0	200.0	200.0
42"		68.1	136.1	200.0	200.0	106.7	200.0	200.0	200.0	91.4	182.9	200.0	200.0
48"		67.0	134.0	200.0	200.0	105.0	200.0	200.0	200.0	90.0	180.0	200.0	200.0
54"		67.0	134.0	200.0	200.0	105.0	200.0	200.0	200.0	90.0	180.0	200.0	200.0
24"		67.0	134.0	200.0	200.0	105.0	200.0	200.0	200.0	90.0	180.0	200.0	200.0
30"		57.2	114.3	171.5	200.0	89.6	179.2	200.0	200.0	76.8	153.6	200.0	200.0
32"		54.8	109.6	164.5	200.0	85.9	171.8	200.0	200.0	73.6	147.3	200.0	200.0
36"	60"	51.0	102.1	153.1	200.0	80.0	160.0	200.0	200.0	68.6	137.1	200.0	200.0
42"		47.1	94.2	141.4	188.5	73.8	147.7	200.0	200.0	63.3	126.6	189.9	200.0
48"		44.7	89.3	134.0	178.7	70.0	140.0	200.0	200.0	60.0	120.0	180.0	200.0
54"		43.3	86.6	129.9	173.3	67.9	135.8	200.0	200.0	58.2	116.4	174.5	200.0
24"		53.6	107.2	160.8	200.0	84.0	168.0	200.0	200.0	72.0	144.0	200.0	200.0
30"		45.1	90.3	135.4	180.5	70.7	141.5	200.0	200.0	60.6	121.3	181.9	200.0
32"		43.1	86.1	129.2	172.3	67.5	135.0	200.0	200.0	57.9	115.7	173.6	200.0
36"	72"	39.7	79.4	119.1	158.8	62.2	124.4	186.7	200.0	53.3	106.7	160.0	200.0
42"		36.0	72.1	108.1	144.1	56.5	112.9	169.4	200.0	48.4	96.8	145.2	193.6
48"		33.5	67.0	100.5	134.0	52.5	105.0	157.5	200.0	45.0	90.0	135.0	180.0
54"		31.8	63.5	95.3	127.1	49.8	99.6	149.3	199.1	42.7	85.3	128.0	170.7
24"		44.7	89.3	134.0	178.7	70.0	140.0	200.0	200.0	60.0	120.0	180.0	200.0
30"		37.3	74.6	111.9	149.1	58.4	116.9	175.3	200.0	50.1	100.2	150.3	200.0
32"		35.5	70.9	106.4	141.9	55.6	111.2	166.8	200.0	47.6	95.3	142.9	190.6
36"	84"	32.5	65.0	97.5	129.9	50.9	101.8	152.7	200.0	43.6	87.3	130.9	174.5
42"		29.2	58.3	87.5	116.7	45.7	91.4	137.1	182.9	39.2	78.4	117.6	156.7
48"		26.8	53.6	80.4	107.2	42.0	84.0	126.0	168.0	36.0	72.0	108.0	144.0
54"		25.1	50.2	75.2	100.3	39.3	78.6	117.9	157.2	33.7	67.4	101.1	134.7
24"		38.3	76.6	114.9	153.1	60.0	120.0	180.0	200.0	51.4	102.9	154.3	200.0
30"		31.8	63.5	95.3	127.1	49.8	99.6	149.3	199.1	42.7	85.3	128.0	170.7
32"		30.1	60.3	90.4	120.6	47.2	94.5	141.7	189.0	40.5	81.0	121.5	162.0
36"	96"	27.5	55.0	82.5	109.9	43.1	86.2	129.2	172.3	36.9	73.8	110.8	147.7
42"		24.5	49.0	73.5	98.0	38.4	76.8	115.2	153.6	32.9	65.8	98.7	131.7
48"		22.3	44.7	67.0	89.3	35.0	70.0	105.0	140.0	30.0	60.0	90.0	120.0
54"		20.7	41.4	62.1	82.9	32.5	64.9	97.4	129.9	27.8	55.7	83.5	111.3
24"		33.5	67.0	100.5	134.0	52.5	105.0	157.5	200.0	45.0	90.0	135.0	180.0
30"		27.7	55.3	83.0	110.7	43.4	86.7	130.1	173.4	37.2	74.3	111.5	148.6
32"	108"	26.2	52.4	78.7	104.9	41.1	82.2	123.3	164.3	35.2	70.4	105.7	140.9
36"		23.8	47.6	71.5	95.3	37.3	74.7	112.0	149.3	32.0	64.0	96.0	128.0
42"		21.1	42.2	63.4	84.5	33.1	66.2	99.3	132.4	28.4	56.7	85.1	113.5
48"		19.1	38.3	57.4	76.6	30.0	60.0	90.0	120.0	25.7	51.4	77.1	102.9
24"		29.8	59.6	89.3	119.1	46.7	93.3	140.0	186.7	40.0	80.0	120.0	160.0
30"		24.5	49.0	73.5	98.0	38.4	76.8	115.2	153.6	32.9	65.8	98.7	131.7
32"	120"	23.2	46.4	69.6	92.8	36.3	72.7	109.0	145.4	31.2	62.3	93.5	124.6
36"		21.0	42.0	63.1	84.1	32.9	65.9	98.8	131.8	28.2	56.5	84.7	112.9
42"		18.6	37.1	55.7	74.3	29.1	58.2	87.3	116.4	24.9	49.9	74.8	99.7

PERFORMANCE VALUES OF ALUMINUM BUCK INSTALLATION ANCHORS

EXT.(+) & INT.(−)

WINDOW DIMS.		ANCHORS INTO HOLLOW BLOCK				ANCHORS INTO CONC.				ANCHORS INTO WOOD			
WIDTH	HEIGHT	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8
19-1/8"		200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0
26-1/2"	26"	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0
37"		200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0
53-1/8"		200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0	200.0
19-1/8"		140.1	200.0	200.0	200.0	200.0	200.0	200.0	200.0	188.2	200.0	200.0	200.0
26-1/2"	38-3/8"	115.9	200.0	200.0	200.0	181.7	200.0	200.0	200.0	155.7	200.0	200.0	200.0
37"		105.0	200.0	200.0	200.0	164.5	200.0	200.0	200.0	141.0	200.0	200.0	200.0
53-1/8"		104.8	200.0	200.0	200.0	164.3	200.0	200.0	200.0	140.8	200.0	200.0	200.0
19-1/8"		98.3	196.6	200.0	200.0	154.0	200.0	200.0	200.0	132.0	200.0	200.0	200.0
26-1/2"	50-5/8"	77.9	155.9	200.0	200.0	122.1	200.0	200.0	200.0	104.7	200.0	200.0	200.0
37"		64.9	129.9	194.8	200.0	101.8	200.0	200.0	200.0	87.2	174.5	200.0	200.0
53-1/8"		60.2	120.5	180.7	200.0	94.4	188.8	200.0	200.0	80.9	161.8	200.0	200.0
19-1/8"		75.5	151.0	200.0	200.0	118.4	200.0	200.0	200.0	101.4	200.0	200.0	200.0
26-1/2"	63"	58.5	117.1	175.6	200.0	91.7	183.5	200.0	200.0	78.6	157.3	200.0	200.0
37"		46.9	93.8	140.6	187.5	73.5	146.9	200.0	200.0	63.0	125.9	188.9	200.0
53-1/8"		39.9	79.7	119.6	159.5	62.5	125.0	187.5	200.0	53.6	107.1	160.7	200.0
19-1/8"		64.6	129.3	193.9	200.0	101.3	200.0	200.0	200.0	86.8	173.7	200.0	200.0
26-1/2"	72"	49.6	99.2	148.7	198.3	77.7	155.4	200.0	200.0	66.6	133.2	199.8	200.0
37"		39.0	78.0	117.0	156.0	61.1	122.2	183.3	200.0	52.4	104.8	157.1	200.0
53-1/8"		32.0	64.0	95.9	127.9	50.1	100.2	150.3	200.0	43.0	85.9	128.9	171.8
19-1/8"		60.7	121.5	182.2	200.0	95.2	190.4	200.0	200.0	81.6	163.2	200.0	200.0
26-1/2"	76"	46.4	92.8	139.2	185.7	72.7	145.5	200.0	200.0	62.3	124.7	187.0	200.0
37"		36.3	72.6	108.8	145.1	56.9	113.7	170.6	200.0	48.7	97.5	146.2	194.9
53-1/8"		29.4	58.8	88.2	117.6	46.1	92.1	138.2	184.2	39.5	79.0	118.4	157.9

ANCHORS AT ALUMINUM BUCK FRAMING (AT MULLION ENDS)

FOR WINDOW ANCHORING TO ALUMINUM BUCKS USE #14 SCREWS SPACED AS PER SHEETS 7 & 8.

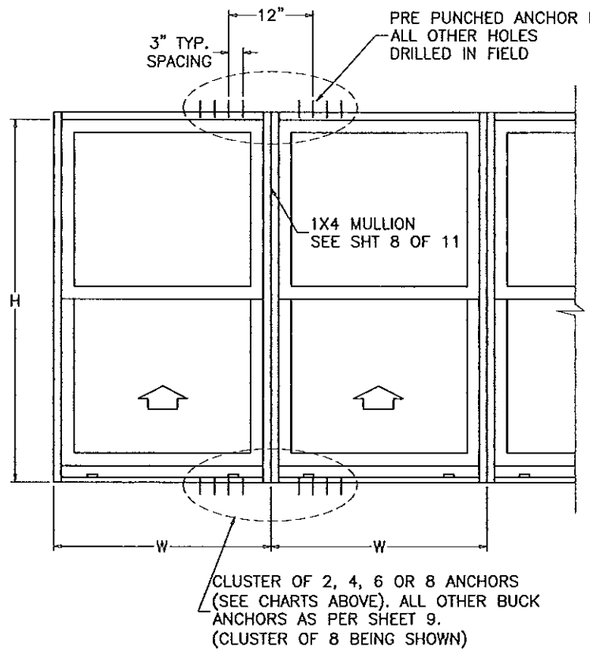

NOTE: ALUMINUM BUCKS ARE SUPPLIED WITH CLUSTER OF 2 (1 SCREW HOLE PER SIDE) STANDARD. EXTRA HOLES MUST BE FIELD DRILLED IF REQUIRED.

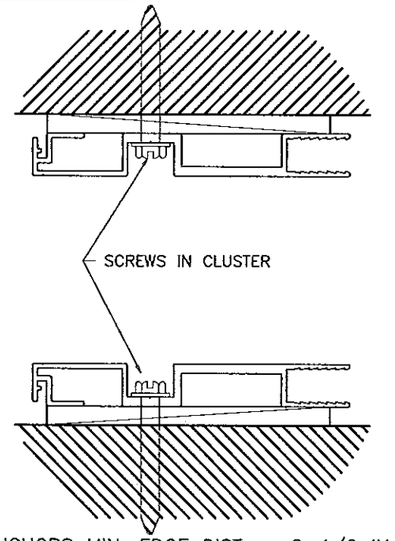

ANCHORS MIN. EDGE DIST. = 2−1/2 IN.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3638

OCT 09 2014

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 14-0822.10
Expiration Date Mar. 5, 2020
By Manuel Perez
Miami Dade Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W08-93CGI

SERIES '360' ALUM SINGLE HUNG WDW. (S.M.I.)

CGI WINDOWS & DOORS
10100 N.W. 25TH STREET
MIAMI, FL. 33172
TEL. (305) 593-6590 FAX. (305) 593-6592

revisions:

no	date	by	description
D	01.03.12		CHART REV.
E	08.06.14		UPDATED TO 2014 FBC

date: 11-21-08
scale: -
dr. by: -
chk. by:

drawing no. W08-93

sheet 10 of 10