



MIAMI-DADE COUNTY  
 PRODUCT CONTROL SECTION  
 11805 SW 26 Street, Room 208  
 Miami, Florida 33175-2474  
 T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
 BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**Overhead Door Corporation**  
**2501 South State Hwy. 121, Suite 200**  
**Lewisville, Texas 75067**

**SCOPE:** This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ). This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Commercial Steel Sectional Garage Door up to 10'-2" Wide with Optional EPS Insulation**

**APPROVAL DOCUMENT:** Drawing No. **D-408776**, titled "Windload Commercial Sectional Steel Door, 50 psf, Dade County, 10'2" Max. Width", sheets 1 and 2 of 2, dated 04/08/1994, with last revision N dated 10/24/2011, prepared by Overhead Door Corporation, signed and sealed by Mark A. Sawicki, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

**LIMITATION:** This door has not been tested for air infiltration (FBC, Energy Conservation Section C402.4.3)

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 11-0912.06 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*[Handwritten Signature]*  
 102/10/2015

NOA No. 14-0825.09  
 Expiration Date: December 28, 2016  
 Approval Date: February 19, 2015  
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**A. DRAWINGS “Submitted under NOA # 11-0330.05”**

1. Drawing No. **D-408776**, titled “Windload Commercial Sectional Steel Door, 50 psf, Dade County, 10’2” Max. Width”, sheets 1 and 2 of 2, dated 04/08/1994, with last revision N dated 10/24/2011, prepared by Overhead Door Corporation, signed and sealed by Mark A. Sawicki, P.E.

**B. TESTS “Submitted under NOA # 06-0616.01”**

1. Test reports on Uniform Static Air Pressure Test, Loading per FBC TAS 202-94 and Forced Entry Resistance Test along with marked-up drawings and installation diagram of “Series 424, 24 GA Commercial Steel Door, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI 06-2063**, dated 02/01/2006, signed and sealed by I. Ghia, P.E.
2. Test reports on 1) Large Missile Impact Test per FBC, TAS 201-94  
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
Along with marked-up drawings and installation diagram of “Series 424, 24 GA Commercial Steel Door, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI 06-4000**, dated 01/13/2006, signed and sealed by I. Ghia, P.E.
3. Test report of Tensile Test per ASTM E8, on door section skin material, prepared by Hurricane Engineering & Testing Inc, Report No. **HETI 06-T525**, dated 02/13/2006, signed and sealed by I. Ghia, P.E.
4. Test report of Salt Fog per ASTM B-117 modified to 1000 hours, on G30, G40 & G90 coupons, prepared by Environmental Testing Laboratory Inc, Report No. **9100550287**, dated 03/13/2006, and signed by B. Richard.
5. Test report of surface burning per ASTM E84 on 1.625” EPS, prepared by Intertek Testing Service, Report No. **3094867SAT-001**, dated 04/13/2006, signed by C. A. Peñaloza.

**C. CALCULATIONS “Submitted under NOA # 06-0616.01”**

1. Calculations prepared by Leroy G. Krupke, page 1 of 1, signed and sealed by L. G. Krupke, P.E., on 06/09/2006.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of code conformance to 2010 and 5<sup>th</sup> edition (2014) FBC issued by Overhead Door Corporation, dated 11/14/2014, signed and sealed by Mark A. Sawicki, P.E.


  
02/10/2015

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 14-0825.09

Expiration Date: December 28, 2016  
Approval Date: February 19, 2015




NOTES

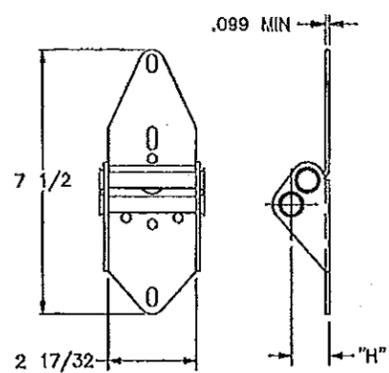


P/N 400643-XXXX, END HINGE STANDARD

PART NUMBER	DIM "H" (REF)
400643-0002	0.84
400643-0003	1.09
400643-0004	1.34
400643-0005	1.59
400643-0006	1.84
400643-0007	2.09
400643-0008	2.34

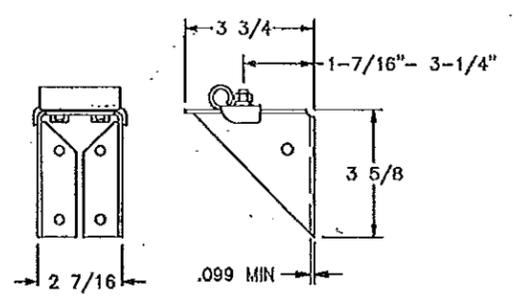


P/N 086590-0000, TOP FIXTURE STANDARD

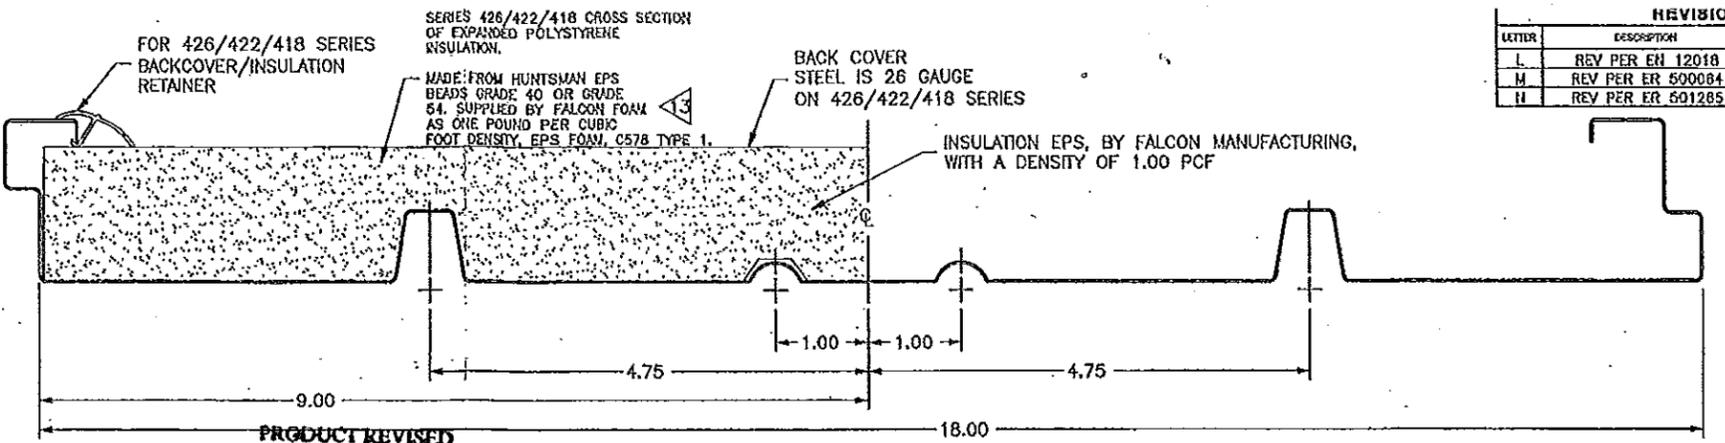


FOR 426/422/418 SERIES BACKCOVER/INSULATION RETAINER  
 SERIES 426/422/418 CROSS SECTION OF EXPANDED POLYSTYRENE INSULATION.  
 MADE FROM HUNTSMAN EPS BEADS GRADE 40 OR GRADE 54. SUPPLIED BY FALCON FOAM AS ONE POUND PER CUBIC FOOT DENSITY, EPS FOAM, C578 TYPE 1.  
 BACK COVER STEEL IS 26 GAUGE ON 426/422/418 SERIES  
 INSULATION EPS, BY FALCON MANUFACTURING, WITH A DENSITY OF 1.00 PCF


LETTER	DESCRIPTION	DATE	APPROVAL
L	REV PER EH 12018	11/2/08	MS
M	REV PER ER 800084	3/28/09	SFT
H	REV PER ER 601285	07/11/11	SFT

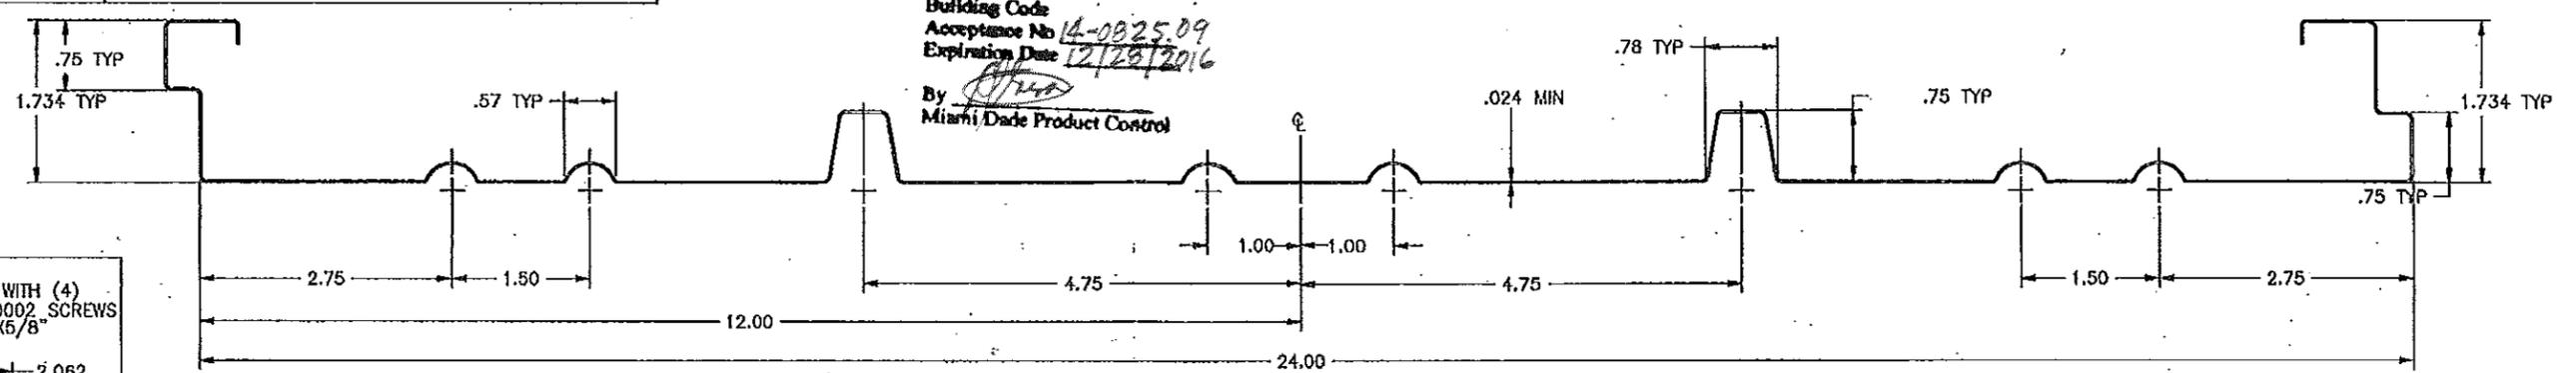


PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No 14-0825.09  
 Expiration Date 12/28/2016  
 By *[Signature]*  
 Miami Dade Product Control

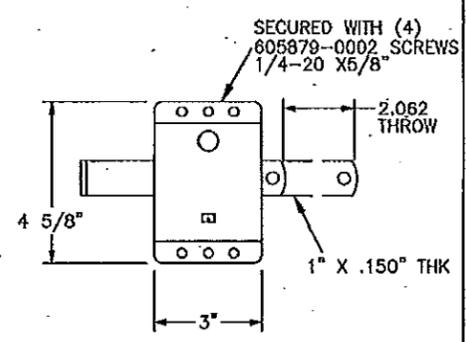


P/N 061601-0000, SLIDE LOCK ASSY

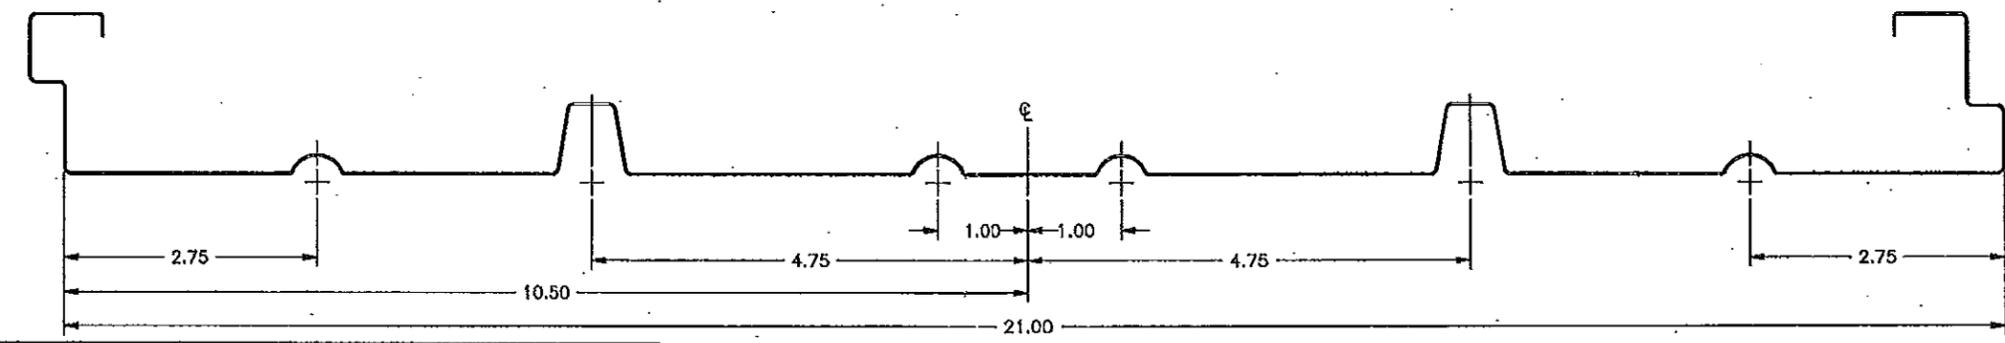


PRODUCT RENEWED as complying with the Florida Building Code  
 Acceptance No 11-0912.06  
 Expiration Date 12/28/2016  
 By *[Signature]*  
 Miami Dade Product Control

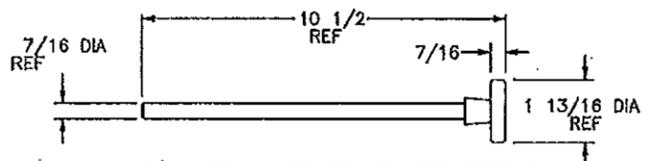

P/N 066341-0007, ROLLER ASSY, 2" TR-5

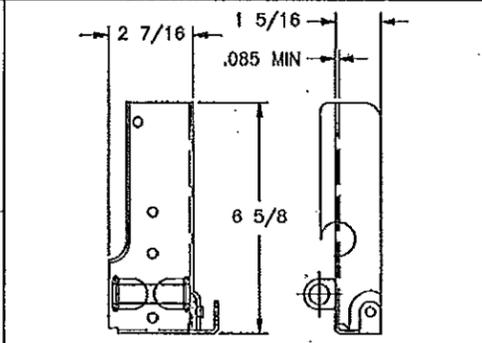


P/N 061141-0001, BOTTOM FIXTURE, LH OPPOSITE  
 P/N 061141-0002, BOTTOM FIXTURE, RH SHOWN STANDARD FOR MAX WEIGHT 560#

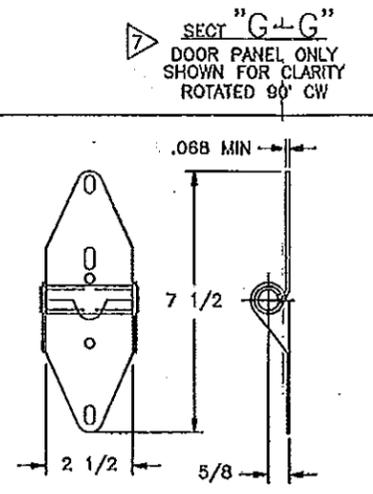


P/N 400735-0001, CENTER HINGE STANDARD FOR 400 SERIES


PART NUMBER	DIMENSION
408263-0002	4.250
408263-0003	5.000
408263-0004	5.750
408263-0005	6.500
408263-0006	7.250

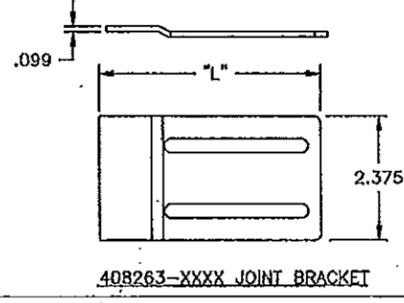

408263-XXXX JOINT BRACKET

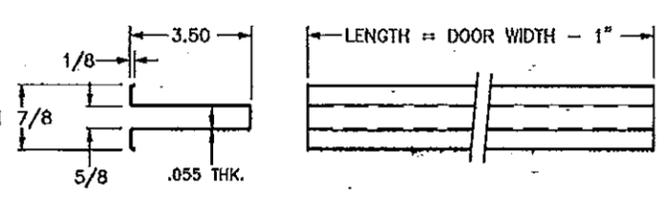


P/N 400650-0003, ROLLED HS-3 STRUT(U BAR)

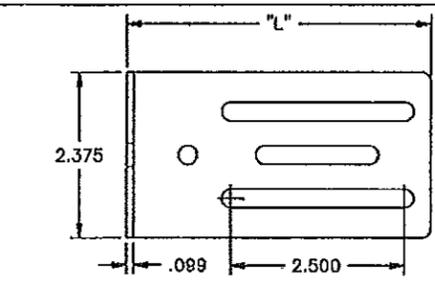

PART NUMBER	"L"
405964-0002	4.37
405964-0003	5.12
405964-0004	3.75


P/N 405964-0002 THRU -0004 JAMB BRACKET

PART NUMBER	"L"	"X"
405964-0000	2.75	1.000
405964-0001	3.25	1.500

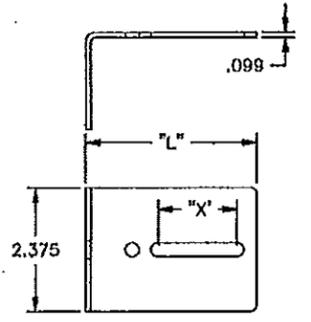

P/N 405964-0000 & -0001 JAMB BRACKET

PART NUMBER	DIMENSIONS
405965-0001	3.000
405965-0002	4.250
405965-0003	5.000
405965-0004	5.750
405965-0005	6.500
405965-0006	7.250

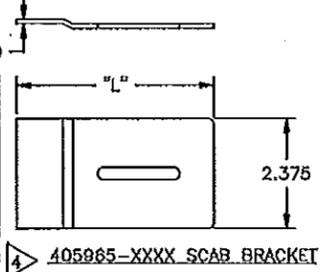

405965-XXXX SCAB BRACKET

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES/FRACONS ON DECIMAL DIMENSIONS  
 HOLE DIAMETERS  
 FINISHES & P. 30  
 FINISHES & V. 17

OVERHEAD DOOR CORPORATION  
 the original door  
 DALLAS, TEXAS

DATE  
 DRAWN BY MANNY VEYNA 6/21/94  
 CHECKED BY P. VESSELS 6/21/94  
 APPROVED BY S. BOUCHER 6/21/94

DRAWING TITLE  
 WINDLOAD COMMERCIAL SECTIONAL STEEL DOOR, 50 PSF, DADE COUNTY, 10'2" MAX WIDTH  
 DRAWING NUMBER D-408776  
 SCALE FULL SHEET 2 OF 2

