



MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Wayne Dalton a Div. of Overhead Door Corporation
3395 Addison Drive
Pensacola, FL 32514

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Models 8024/8124 Code 1340 Steel Sectional Garage Door up to 18'-0" Wide x 8'-0" High with Optional Impact Resistant Glazing

APPROVAL DOCUMENT: Drawing No. 329930, titled "Models 8024/8124, Windload Specification Option Code 1340", sheets 1 through 7 of 7, dated 05/04/2007, prepared by the manufacturer, signed and sealed by Mark A. Sawicki, P.E., bearing the Miami-Dade County Product Control revision stamp with the NOA number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large & Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, manufacturing address, model/series number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 12-0605.10 and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.



Handwritten signature and date: 02/11/2015

NOA No: 14-0825.13
Expiration Date: September 27, 2017
Approval Date: February 19, 2015
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **329930**, titled "Models 8024/8124, Windload Specification Option Code 1340", sheets 1 through 7 of 7, dated 05/04/2007, prepared by the manufacturer, signed and sealed by Mark A. Sawicki, P.E.

B. TESTS "Submitted under NOA # 12-0215.05"

1. Test report on Forced Entry Resistance Test, per FBC TAS 202-94 of a Series/Model 8024/8124 Garage Door, prepared by Architectural Testing, Inc, dated 12/13/2012, signed and sealed by Vinu J. Abraham, P.E.

"Submitted under NOA # 07-1105.03"

2. Test report on 1) Uniform Static Air Pressure Test, per FBC, TAS 202-94
2) Large Missile Impact Test, per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading Test, per FBC, TAS 203-94, along with marked-up drawings of an 18' x 7' Model 8024/8124 Galvanized Steel Sectional Door System with an Aluminum Windload Post, prepared by Certified Testing Laboratories, Inc., Report # **CTLA 1672W-1R**, dated 05/17/2007, signed and sealed by Ramesh Patel, P.E.

3. Test report on 1) Uniform Static Air Pressure Test, per FBC, TAS 202-94
2) Large Missile Impact Test, per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading Test, per FBC, TAS 203-94, along with marked-up drawings of an 18' x 7' Model 8024/8124 Galvanized Steel Sectional Door System with an Aluminum Windload Post and Impact Resistant Glazing, prepared by Certified Testing Laboratories, Inc., Report # **CTLA 1734WR**, dated 11/09/2007, signed and sealed by Ramesh Patel, P.E.

"Submitted under NOA # 07-0808.01"

4. Test report on 1) Uniform Static Air Pressure Test, per FBC, TAS 202-94
2) Test report on Tensile Test, per ASTM E8 along with marked-up drawings, prepared by Certified Testing Laboratories, Inc., Report # **CTLA 1672W**, dated 05/17/2007 and 05/22/2007, signed and sealed by Ramesh Patel, P.E



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 14-0825.13
Expiration Date: September 27, 2017
Approval Date: February 19, 2015

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS “Submitted under NOA # 11-0411.06”

1. Anchoring calculations prepared by John E. Scates, P.E., dated 12/08/2010, signed and sealed by John E. Scates, P.E.

“Submitted under NOA # 07-0808.01”

2. Jamb anchoring calculations prepared by Wayne Dalton Corporation, dated 07/23/2007, signed and sealed by Mark R. Barrow, P.E.

“Submitted under NOA # 07-1105.03”

3. Fastening calculations prepared by Wayne Dalton Corporation, dated 10/24/2007, signed and sealed by Mark R. Barrow, P.E.

D. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **12-0605.05**, issued to Bayer Material Science LLC (MA), for their Makrolon Polycarbonate Sheets, approved on 12/06/2012 and expiring on 08/27/2017.

E. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

F. STATEMENTS

1. Statement letter of code conformance to the 5th edition (2014) FBC issued by Wayne Dalton a Div. of Overhead Door Corporation, dated 08/15/2014, signed and sealed by Mark A. Sawicki, P.E.

“Submitted under NOA # 11-0411.06”

2. Statement letter of code conformance to 2007 and 2010 FBC and no financial interest, issued by John E. Scates, Professional Engineer, dated 12/01/2011, signed and sealed by John E. Scates, P.E.


02/11/2015

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 14-0825.13
Expiration Date: September 27, 2017
Approval Date: February 19, 2015

NOTES:

1. IMPACT RESISTANT GLAZING SYSTEM MAY BE INSTALLED IN TOP OR INTERMEDIATE SECTION (WITH OR WITHOUT DECORATIVE INSERTS). GLAZING SHALL BE 1/4" MAKROLON-AR POLYCARBONATE OR EQUAL (MIAMI-DADE APPROVED). MAXIMUM GLAZING DIMENSIONS SHALL BE 18.56" x 12.26". SEE DETAIL J ON SHEET 4 FOR ASSEMBLY DETAILS.

2. VINYL OR WOOD DOOR STOP NAILED A MAXIMUM OF 6" O.C. MUST OVERLAP TOP AND BOTH ENDS OF PANELS MINIMUM 7/16" TO MEET NEGATIVE PRESSURES.

3. KEY LOCK, SLIDE LOCK, OR OPERATOR REQUIRED.

4. SECTION STEEL TO HAVE A MINIMUM 24 GA THICKNESS WITH A MINIMUM G90 COATING AND A MINIMUM YIELD STRENGTH OF 33.8 KSI.

5. THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

6. WOOD SUBSTRATE FOR DOOR JAMB IS TO BE MINIMUM 2x6 NO. 3 SOUTHERN PINE RELATIVELY KNOT FREE. REFER TO SHEET 3 FOR ATTACHMENT TO SUPPORTING STRUCTURE. FOR DIRECT MOUNTING OF JAMB BRACKETS TO OTHER SUBSTRATES, SEE JAMB DETAIL SHEET 2. FOR MOUNTING OF CONTINUOUS WALL ANGLE, SEE CONTINUOUS WALL ANGLE DETAIL SHEET 3.

7. FOR LOW HEAD ROOM LIFT CONDITIONS, TOP BRACKET SHALL BE A 13 GA LHR 7/4 TOP BRACKET WITH A MINIMUM OF (3) 1/4-14x7/8" SELF DRILLING CRIMPITE SCREWS IN LIEU OF THE BRACKET SHOWN ON THIS DRAWING. U-BAR ON TOP SECTION SHALL BE INSTALLED ON TOP OF LHR TOP BRACKETS.

8. LOUVERS MAY BE INSTALLED ON THE DOOR IF THE TOTAL AREA OF THE LOUVER DOES NOT EXCEED 60 SQUARE INCHES.

9. DOOR WITHOUT POST SYSTEM HAS BEEN TESTED TO WITHSTAND DESIGN PRESSURES CORRESPONDING TO A 75 MPH WIND SPEED (+/-14.40 PSF). POST SYSTEM SHALL BE INSTALLED WHEN WIND SPEEDS ARE EXPECTED TO EXCEED 75 MPH.

10. THIS DOOR HAS NOT BEEN TESTED FOR AIR INFILTRATION.

P3 P5

P4

P1

P4

P3

13 GA HORIZ ANGLE

POST CHAIN ATTACHED TO HORIZ ANGLE WITH S-HOOK

13 GA FLAG ANGLE

15 GA MIN HORIZ TRACK

5/16x1-5/8" LAG SCREW (MIN 4 AS SHOWN)

15 GA MIN VERT TRACK


1/4-20x9/16" TRACK BOLT AND 1/4-20 HEX NUT AT EACH JB-US JAMB BRACKET LOCATION

5/16x1-5/8" LAG SCREW AT EACH JAMB BRACKET

15 GA STIFFENED JAMB BRACKETS SEE SCHEDULE FOR QUANTITY, LOCATION, AND TYPE

KEY LOCK OR SLIDE LOCK EACH END (SEE NOTE 3). SLIDE LOCK SHOWN FOR CLARITY

NOTE: (4) SECTION SOLID DOOR SHOWN. SEE SHEET 4 FOR U-BAR LOCATIONS ON DOORS WITH OTHER SECTION QUANTITIES AND SEE NOTE 1 THIS SHEET FOR GLAZING OPTIONS.

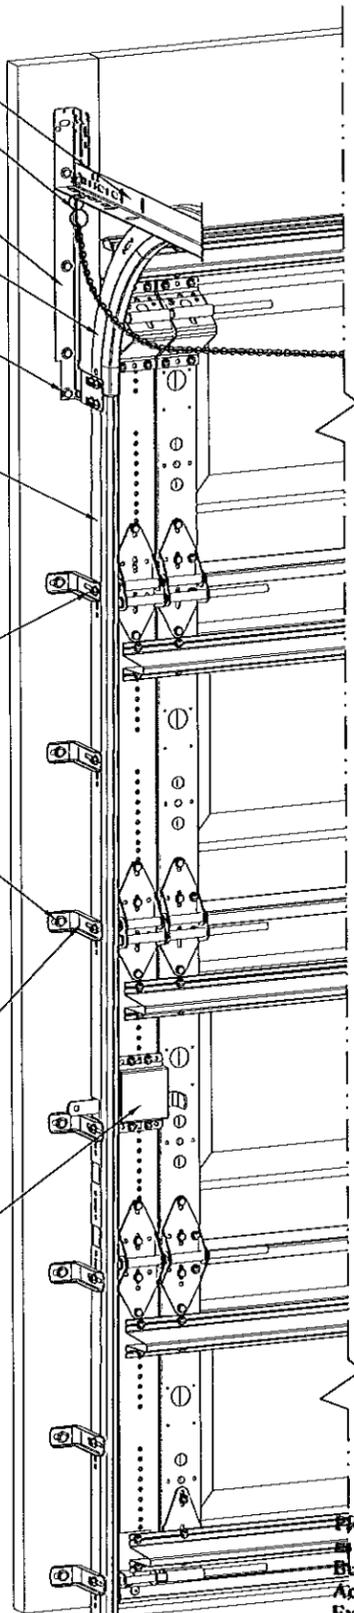

JAMB BRACKET SCHEDULE

DOOR HEIGHT	NO. OF SECTIONS	NO. OF JAMB BRACKETS (EACH JAMB)	LOCATION OF CENTERLINE OF JAMB BRACKETS MEASURED FROM BOTTOM OF TRACK (ALL DIMENSIONS ± 2")
6'-6"	4	7	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/4" (JB-US)
7'-0"	4	7	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 42" (JB-US), 52-1/2" (JB-US), 63-1/4" (JB-US)
7'-6"	5	8	2" (JB-US), 10" (JB-US), 18-3/4" (JB-US), 26-3/4" (JB-US), 36" (JB-US), 45" (JB-US), 54-1/4" (JB-US), 74-1/2" (JB-US)
8'-0"	5	8	2" (JB-US), 10" (JB-US), 21-3/4" (JB-US), 29-3/4" (JB-US), 39" (JB-US), 48" (JB-US), 57-1/2" (JB-US), 75-1/2" (JB-US)

NOTE:

(JB-US) FOLLOWING DIMENSION DENOTES SLOTTED JAMB BRACKET ATTACHED TO TRACK WITH 1/4-20x9/16" TRACK BOLT AND NUT AS SHOWN ABOVE.

ALL DOORS WITH DECORATIVE OVERLAY REQUIRE USE OF CONTINUOUS WALL ANGLE. SEE SHEETS 6 & 7 FOR DETAILS.

SUPERIMPOSED DESIGN PRESSURE LOADS ON SUPPORTING STRUCTURE

MAX DOOR WIDTH	MAX DOOR HEIGHT	UNIFORM LOAD EACH JAMB (PLF)	POINT LOAD AT HEADER AND SLAB AT EACH POST LOCATION (LBS)
17'-0"	7'-0"	+185.5/-209.6	+1507.4/-1712.9
	8'-0"	+185.5/-209.6	+1704.0/-1936.3
18'-0"	7'-0"	+190.7/-215.7	+1637.0/-1850.5
	8'-0"	+190.7/-215.7	+1860.3/-2102.9



MARK A. SAWICKI, PE
2501 S. STATE HWY 121, SUITE 200
LEWISVILLE, TX 75067
FL PE 72613
TX PE 105291



PRODUCT REVISED
complying with the Florida Building Code
Acceptance No. 14-0825-13
Expiration Date 09/29/2017
By [Signature]
Miami Dade Product Control



3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890


STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH: 18'-0"	DATE	NAME
TEST (PSF):	+69.00/-78.00	MAX HEIGHT: 8'-0"	DRAWN	GRT
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT: 21"	CHECKED	MRB
MODEL 8024/8124			SHEET 1 OF 7	
WINDLOAD SPECIFICATION OPTION CODE 1340			DRAWING PART NO.	REV.
			329930	P6

REVISIONS

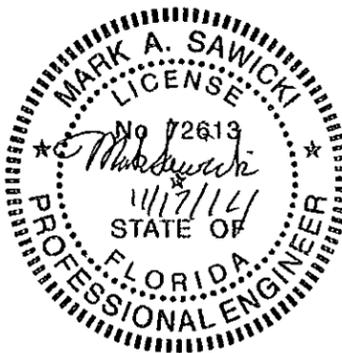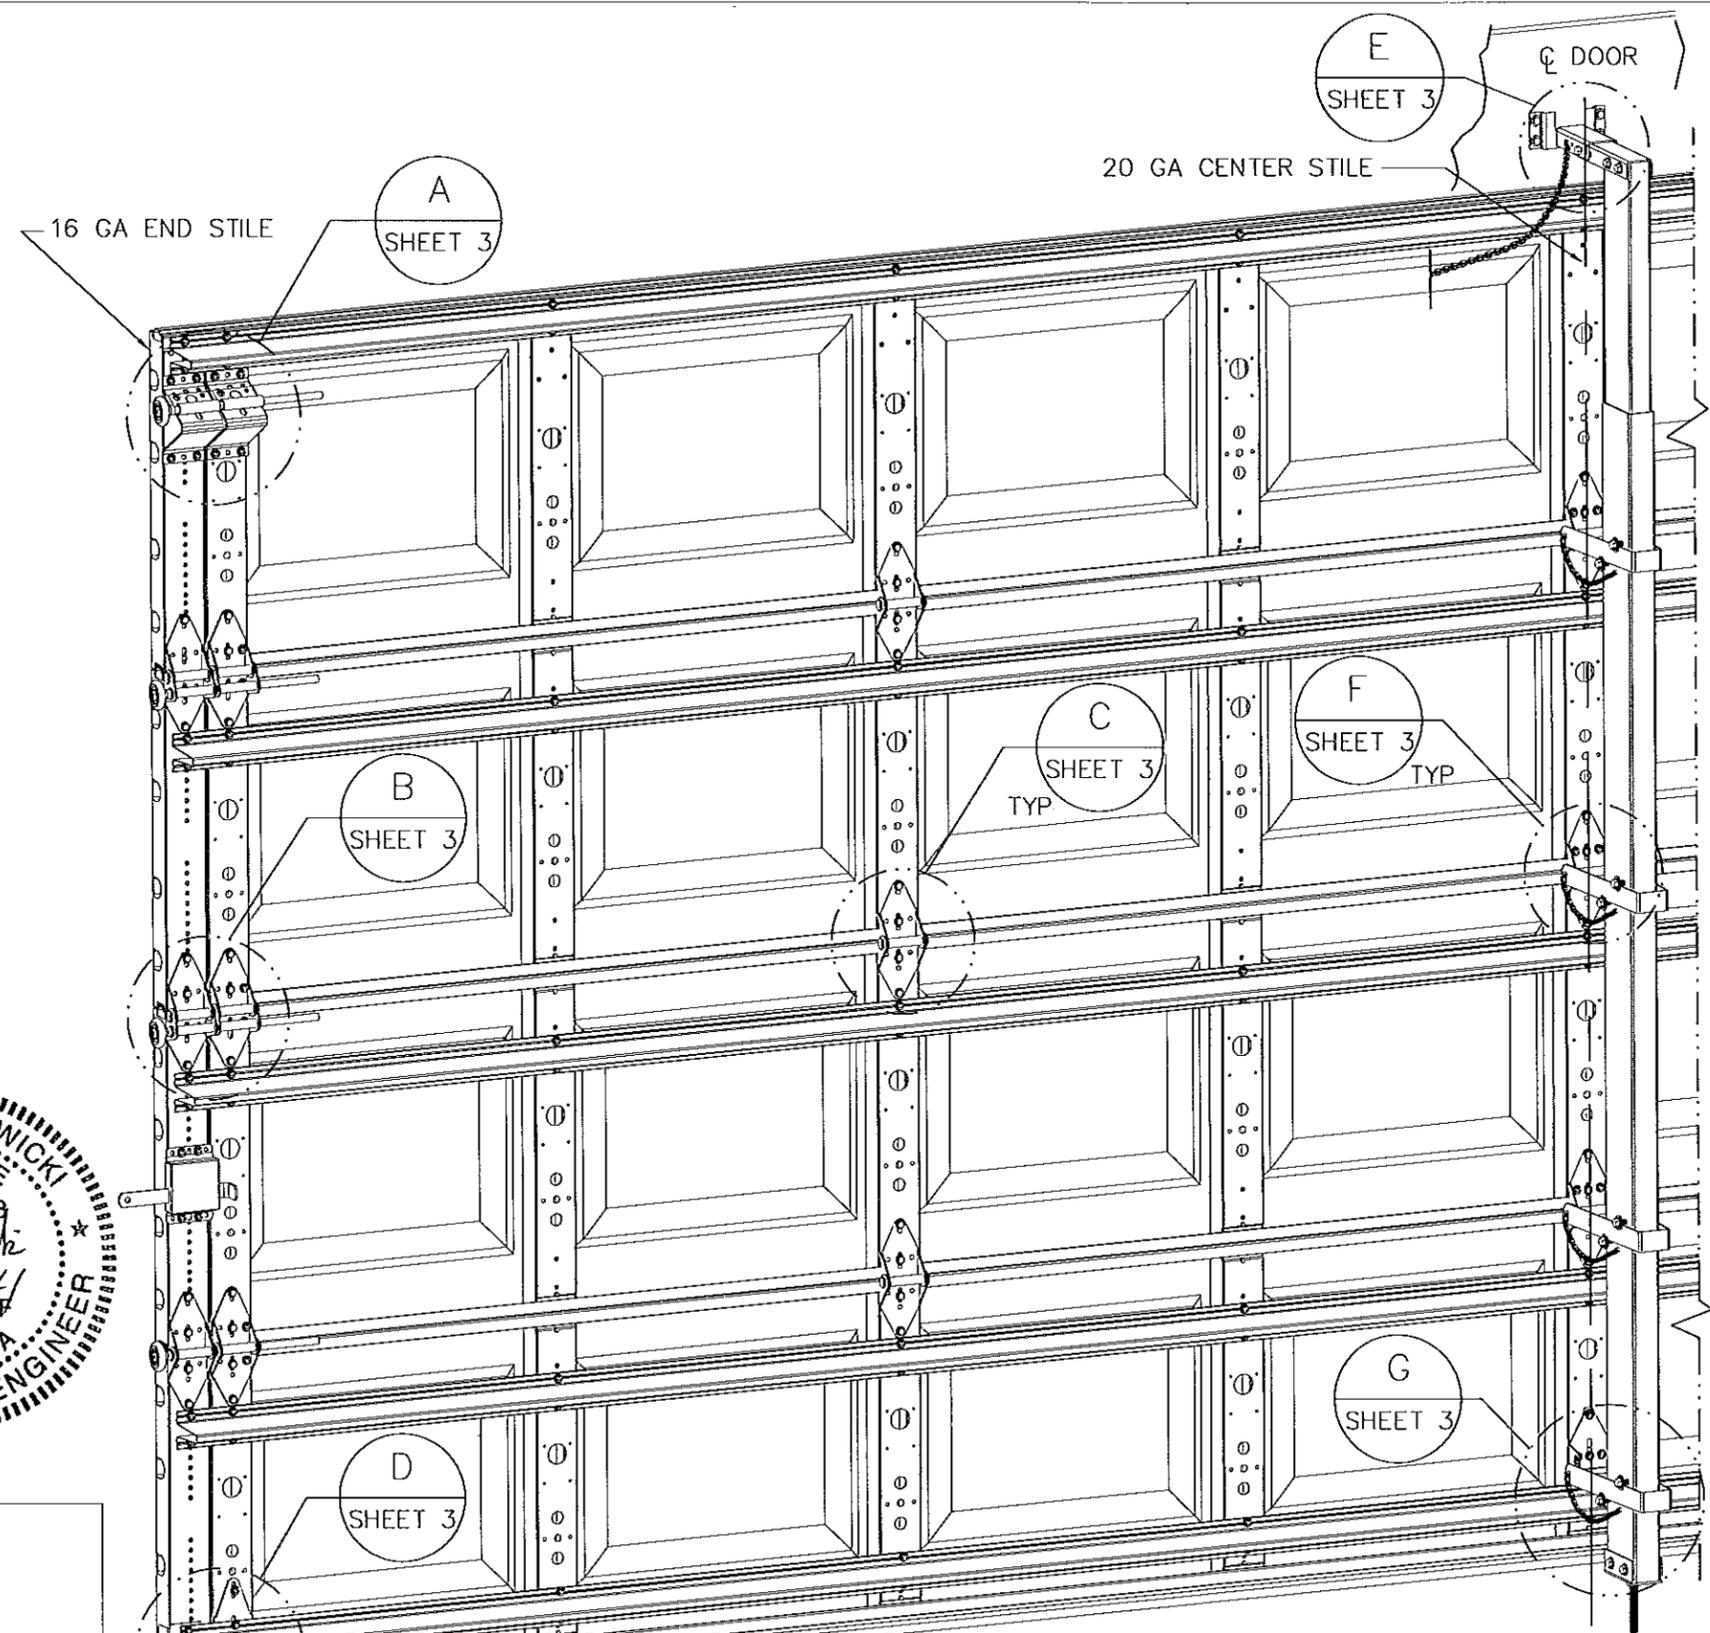

MARK A. SAWICKI, PE
 2501 S. STATE WAY 121, SUITE 200
 LEWISVILLE, TX 75067
 FL PE 72613
 TX PE 162291


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 14-0025.13
 Expiration Date 09/27/2017
 By *[Signature]*
 Miami Dade Product Control



NOTE: 18' DOOR SHOWN. SEE SHEET 4 FOR HINGE, STILE, AND POST LOCATIONS ON OTHER SIZE DOORS.


STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A	
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH: 18'-0"	DATE	NAME	
TEST (PSF):	+69.00/-78.00	MAX HEIGHT: 8'-0"	DRAWN	2/22/07	GRT
IMPACT/CYCLIC RATED (YES/NO): YES		MAX SECTION HEIGHT: 21"	CHECKED	5/4/07	MRB
MODEL 8024/8124			SHEET 2 OF 7		
WINDLOAD SPECIFICATION OPTION CODE 1340			DRAWING PART NO.	REV.	
			329930	P6	

13 GA ROLLER SLIDE ATTACHED TO BRACKET WITH 5/16-18 BOLT & NUT IN CENTER SLOT AND 1/4-20x9/16" TRACK BOLT & 1/4-20 HEX NUT THROUGH ANY TWO ALIGNING HOLES

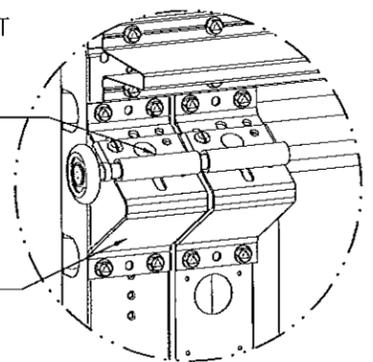


(2) 13 GA COMMERCIAL 'A' FRAME TOP BRACKETS EACH ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS

ADD (2) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS (INSIDE OF EACH INSIDE END HINGE)

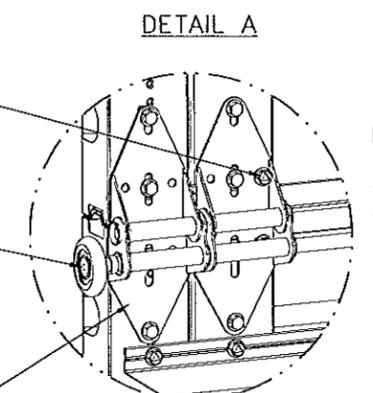


2" STEEL ROLLER WITH 9" GRADE 1144 OR EQUIVALENT STEM


(2) 14 GA WIDE BODY END HINGES EACH ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS

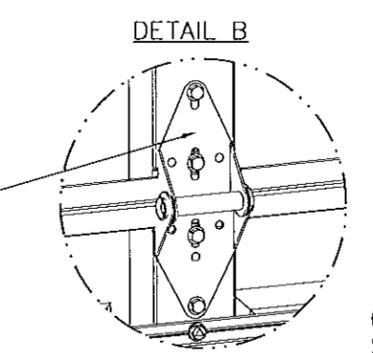


14 GA WIDE BODY INTERMEDIATE HINGE ATTACHED WITH (4) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS

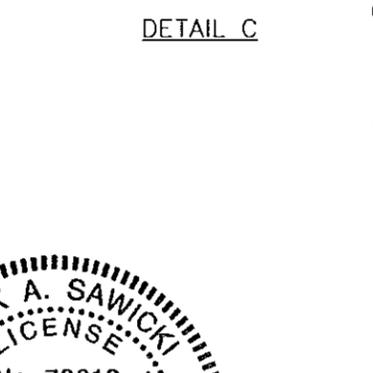

12 GA EXTENSION BRACKET ATTACHED WITH (3) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS (2 THROUGH STRUT AND BRACKET)

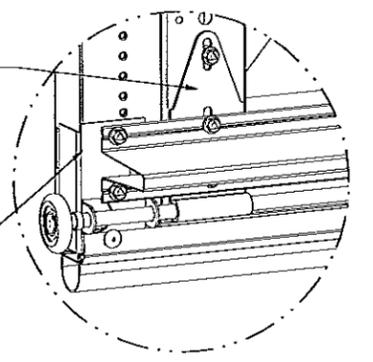

14 GA BOTTOM BRACKET ATTACHED WITH (2) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS THROUGH STRUT AND BOTTOM BRACKET AND (1) 1/4-14x5/8" SELF DRILLING TAMPER RESISTANT SCREW

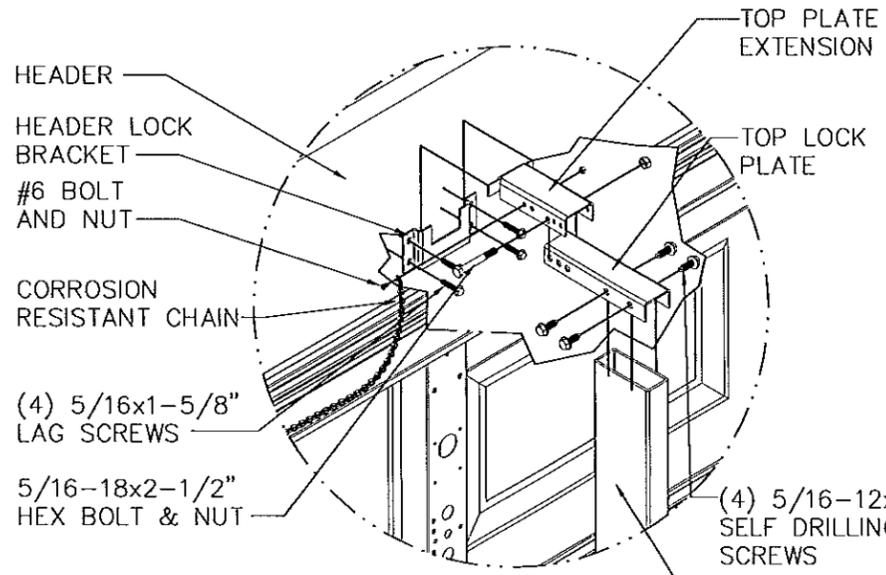

(4) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS

14 GA CENTER HINGE
HITCH PIN

(4) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS ADDED TO EACH HINGE WITH A POST STRAP

CORROSION RESISTANT CHAIN
(2) 5/16-12x1" SELF DRILLING SCREWS WITH 5/16 FLAT WASHERS

#8 x 3/4" SELF DRILLING SCREW

NO. 2 HALF HINGE ALIGN BOTTOM OF HINGE WITH TOP OF THE U-BAR


(4) 1/4-14x7/8" SELF DRILLING CRIMPTITE SCREWS

HITCH PIN
CORROSION RESISTANT CHAIN
(2) 5/16-12x1" SELF DRILLING SCREWS W/ 5/16 FLAT WASHERS

#8 x 3/4" SELF DRILLING SCREW


BOTTOM BRACKET

(4) 5/16-12x1" SELF DRILLING SCREWS

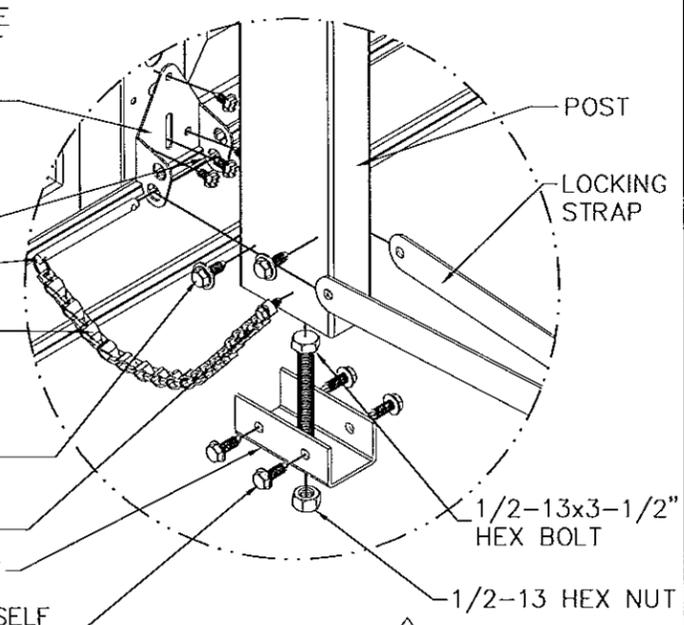

2500 PSI MIN CONCRETE

8" X 8" MIN TURNDOWN SLAB AT EDGE

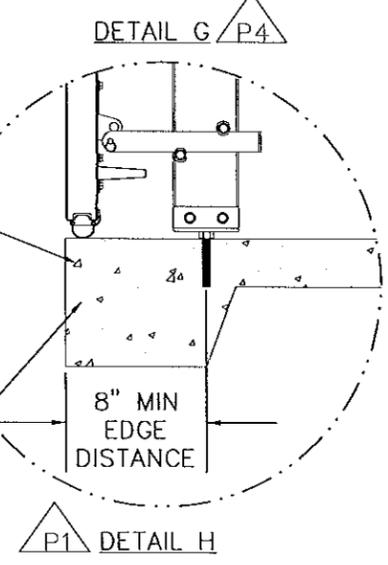


MARK A. SAWICKI, PE
2501 S. STATE HWY 121, SUITE 200
LEWISVILLE, TX 75067
FL PE 72613
TX PE 165291

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 14-0925.13
Expiration Date 09/27/2017
By *[Signature]*
Miami Dade Product Control

Wayne Dalton
3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH:	18'-0"	DATE	NAME
TEST (PSF):	+69.00/-78.00	MAX HEIGHT:	8'-0"	DRAWN	GRT
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT:	21'	CHECKED	MRB
MODEL 8024/8124				SHEET 3 OF 7	
WINDLOAD SPECIFICATION OPTION CODE 1340				DRAWING PART NO.	REV.
				329930	P6


P2 CENTER STILE, INTERMEDIATE HINGE, & POST LOCATIONS

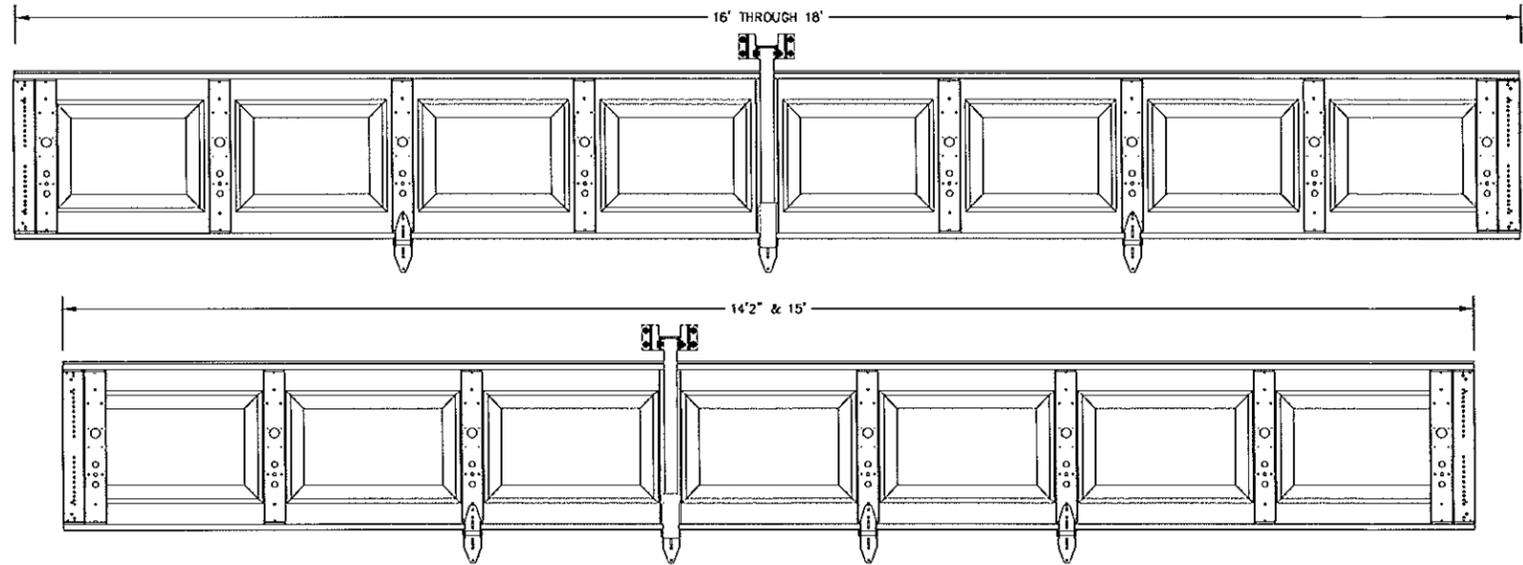


U-BAR LOCATIONS

(5) SECTION DOORS WITH
(7) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

(4) SECTION DOORS WITH
(5) 3" 20 GA 80 KSI U-BARS
LOCATED AS SHOWN

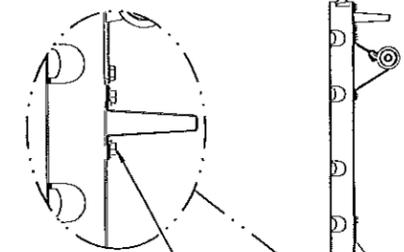

ATTACH U-BAR WITH
(2) 1/4"-14x7/8" SELF
DRILLING CRIMPTITE SCREWS
AT EACH STILE LOCATION, TYP.

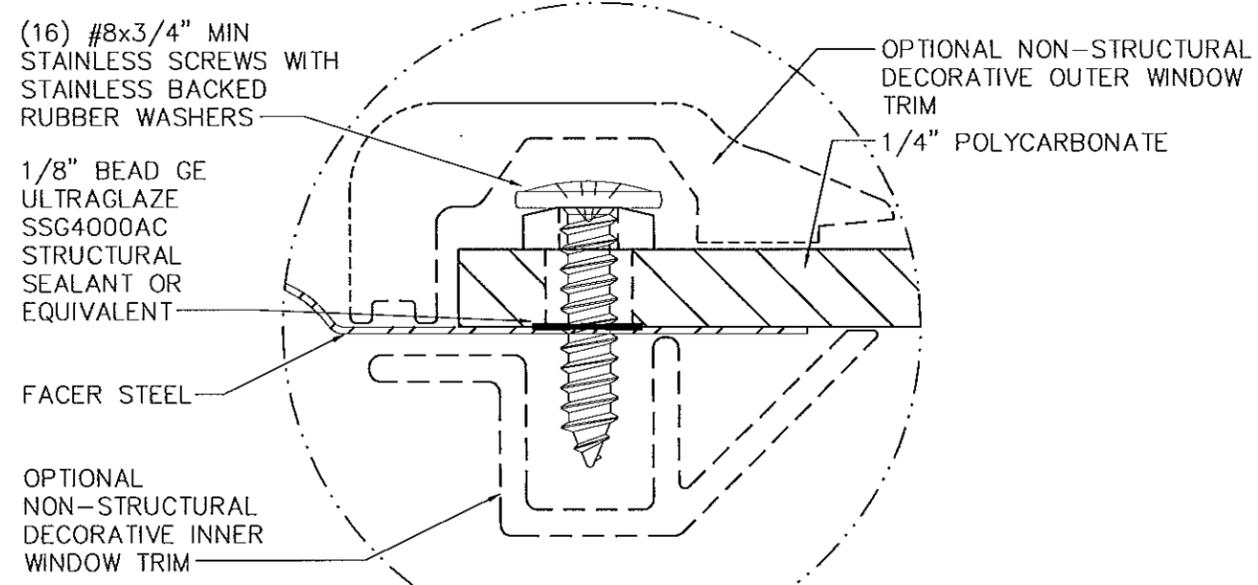


P3 DETAIL J




MARK A. SAWICKI, PE
2501 S. STATE HWY 121, SUITE 200
LENSVILLE, TX 75067
FL PE 72613
TX PE 162291



PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0825.13
Expiration Date 07/27/2017
By *[Signature]*
Miami Dade Product Control





STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH: 18'-0"	DATE	NAME
TEST (PSF):	+69.00/-78.00	MAX HEIGHT: 8'-0"	DRAWN	GRT
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT: 21"	CHECKED	MRB
MODEL 8024/8124			SHEET 4 OF 7	
WINDLOAD SPECIFICATION OPTION CODE 1340			DRAWING PART NO.	REV.
			329930	P6

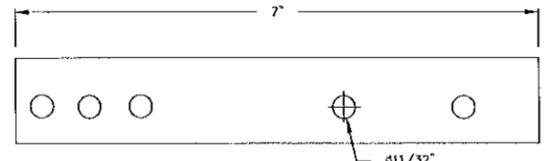



TOP LOCK PLATE
1020 CQ G-60 H.D.G.

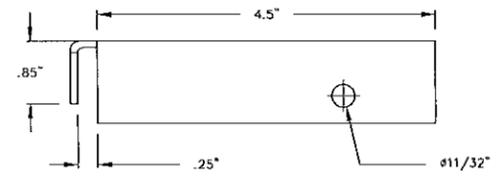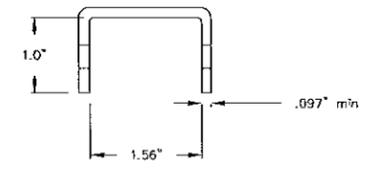


TOP PLATE EXTENSION
1020 CQ G-60 H.D.G.

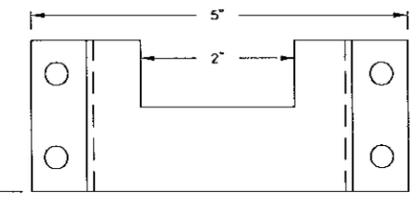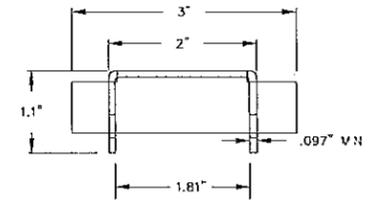

HEADER LOCK BRACKET
1020 CQ G-60 H.D.G.

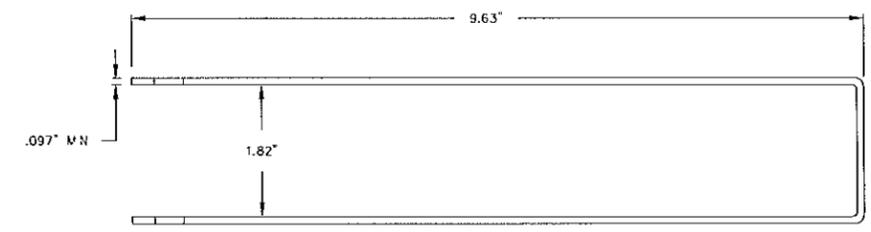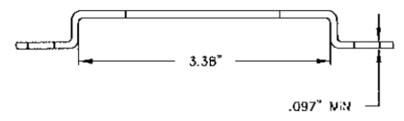


BOTTOM LOCK PLATE
1020 CQ G-60 H.D.G.




LOCK STRAP
1020 CQ G-60 H.D.G.


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0825-13
Expiration Date 09/27/2017
By [Signature]
Miami Dade Product Control

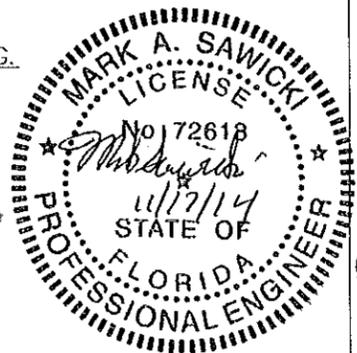




MARK A. SAWICKI, PE
2501 S. STATE HWY 121, SUITE 200
LEWISVILLE, TX 75067
FL PE 72613
TX PE 165231

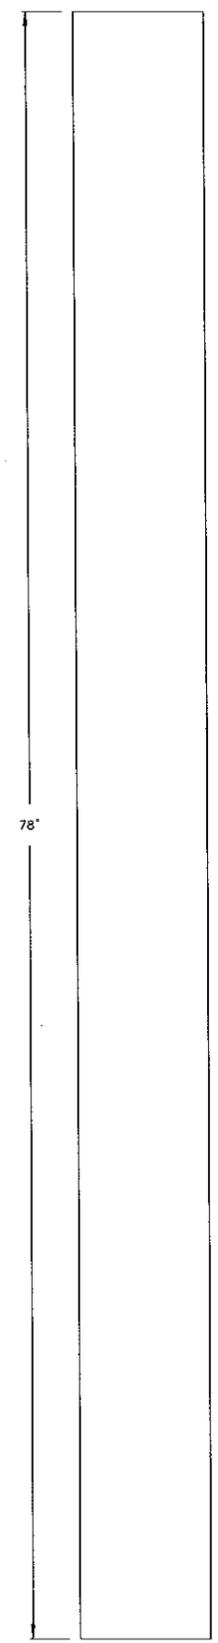


6063 T-6 ALUMINUM OUTER POST

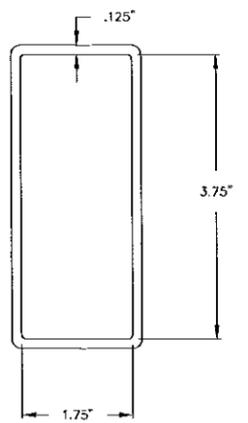


6063 T-6 ALUMINUM INNER POST

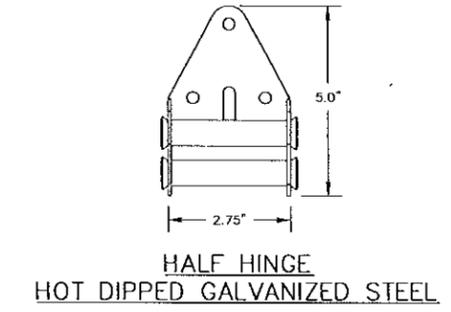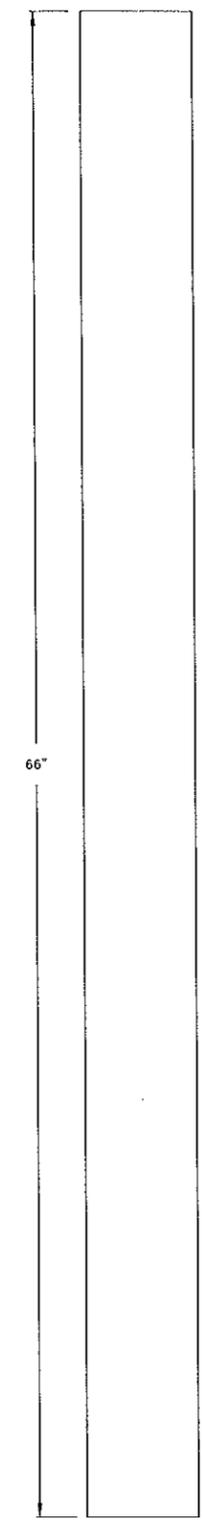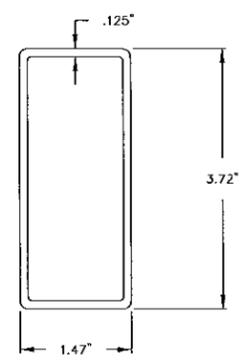


HALF HINGE
HOT DIPPED GALVANIZED STEEL

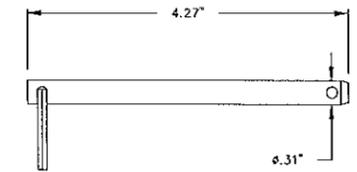

HITCH PIN
1020 CQ G-60 H.D.G.

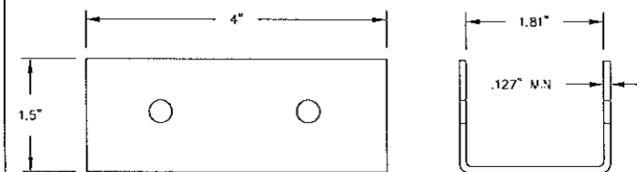


BOTTOM LOCK PLATE
1020 CQ G-60 H.D.G.

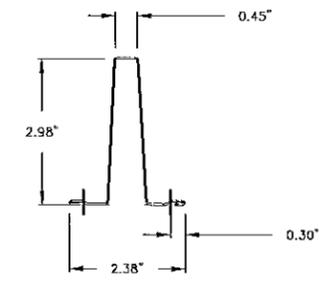

STRUT PROFILE P5

POST SYSTEM
COMPONENT DETAILS



STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH: 18'-0"	DATE	NAME
TEST (PSF):	+69.00/-78.00	MAX HEIGHT: 8'-0"	DRAWN	GRT
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT: 21'	CHECKED	MRB
MODEL 8024/8124			SHEET 5 OF 7	
WINDLOAD SPECIFICATION OPTION CODE 1340			DRAWING PART NO.	REV.
			329930	P6



POST SYSTEM STORAGE P4

NOTE: POST SYSTEM SHALL BE STORED IN A CONVENIENT LOCATION AS CLOSE TO GARAGE DOOR AS POSSIBLE.


HEADER LOCK BRACKET TO SECURE TOP OF POST FOR STORAGE

CORROSION RESISTANT CHAINS, TYP.

HALF HINGE TO SECURE BOTTOM OF POST FOR STORAGE

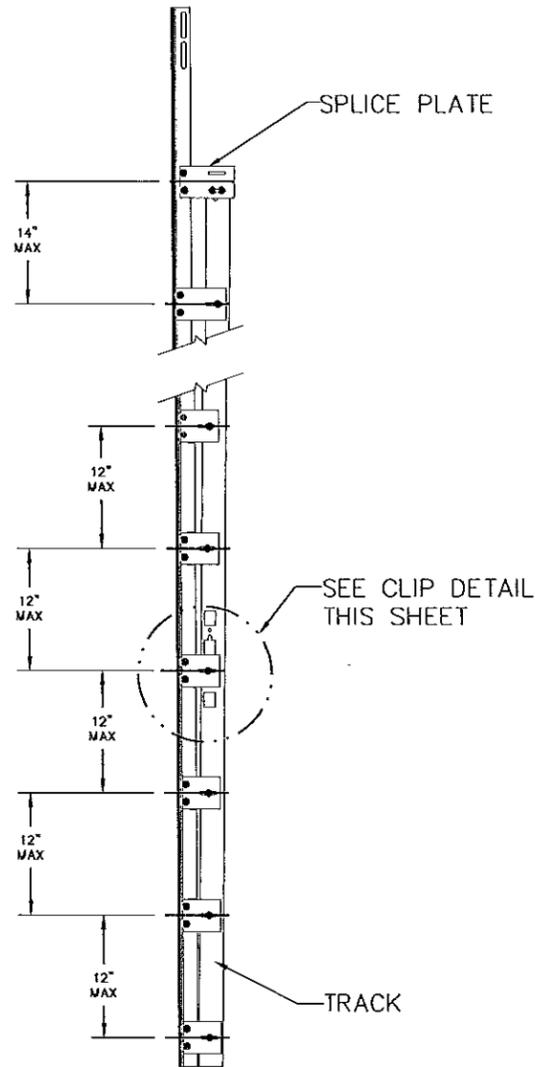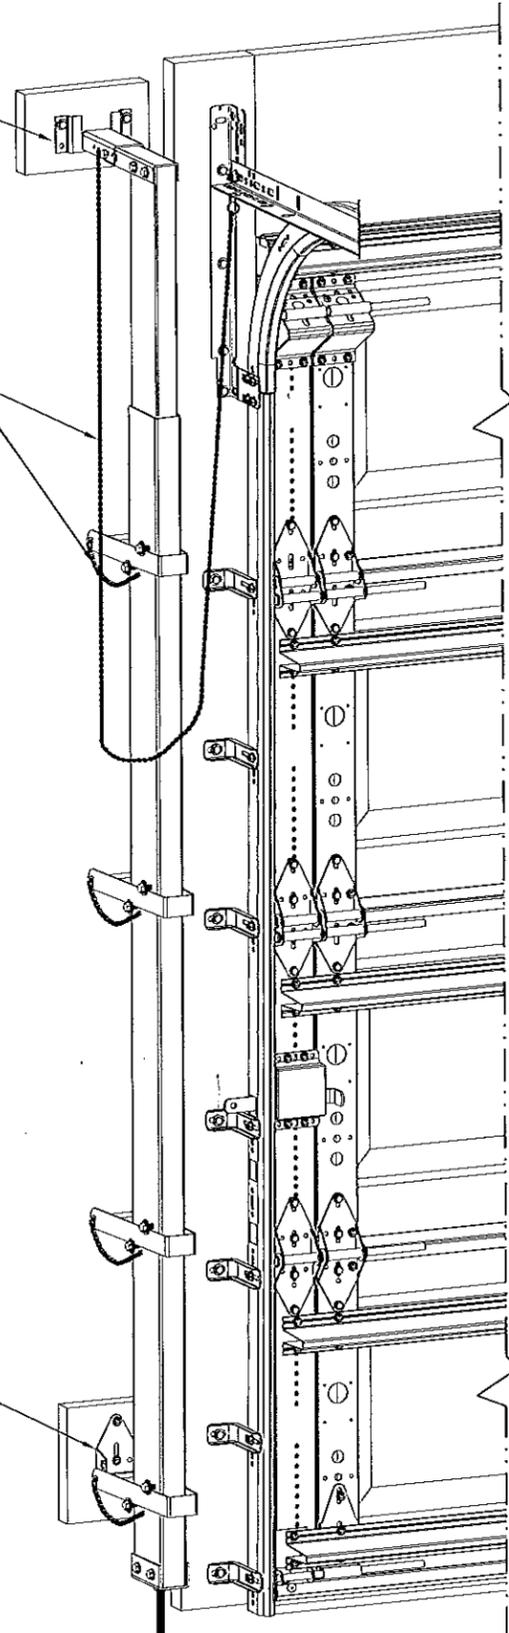


CLIPS TO BE EITHER BOLTED OR WELDED. SEE DETAILS THIS PAGE.

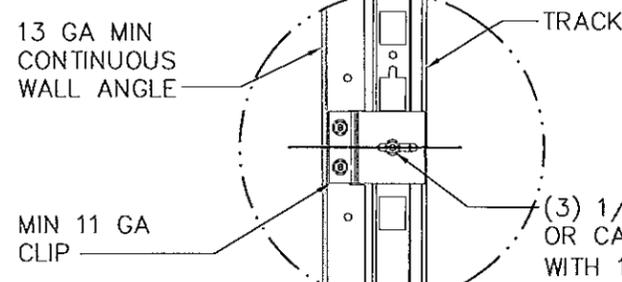

TYPICAL CLIP BOLTING DETAIL

MAX SPACING OF ANCHORS/SCREWS PER JAMB (IN)		
3/8" SIMPSON TITEN HD SCREW ANCHOR TO MINIMUM 2000 PSI CONCRETE ^{NOTE 1}	3/8" SIMPSON TITEN HD SCREW ANCHOR TO MINIMUM 2000 PSI GROUT FILLED CMU ^{NOTE 2}	3/8" X 3" LONG LAG SCREW ^{NOTE 3}
24	24	24

1. BASED ON 3/8" SIMPSON TITEN HEAVY DUTY SCREW ANCHOR WITH A 1" O.D. WASHER INTO CONCRETE WITH A MINIMUM EMBEDMENT DEPTH OF 2-3/4" AND A MINIMUM EDGE DISTANCE OF 2-3/4".
2. BASED ON 3/8" SIMPSON TITEN HEAVY DUTY SCREW ANCHOR WITH A 1" O.D. WASHER INTO GROUT FILLED CMU WITH A MINIMUM EMBEDMENT DEPTH OF 2-3/4", A MINIMUM EDGE DISTANCE OF 4", AND A MINIMUM END DISTANCE OF 4". CONCRETE MASONRY UNITS SHALL CONFORM TO ASTM C90 AND GROUT SHALL CONFORM TO ASTM C476.
3. BASED ON 3/8" DIAMETER x 3" LONG LAG SCREWS WITH 1" O.D. WASHERS WITH A 1-9/32" THREAD PENETRATION INTO SEASONED DRY WOOD SUPPORTING STRUCTURE.
4. PROVIDE QUANTITY OF SCREW ANCHORS OR LAG SCREWS AS REQUIRED TO MAINTAIN MAXIMUM SPACING AS SHOWN IN TABLE WITH A MINIMUM OF THREE (3) SCREW ANCHORS OR LAG SCREWS PER JAMB. SCREW ANCHORS OR LAG SCREWS AT TOP AND BOTTOM OF JAMB SHALL BE PLACED A MAXIMUM OF 6" FROM THE END OF THE JAMB.
5. LOAD PER JAMB CALCULATED TO BE A MAXIMUM OF +190.7/-215.7 LBS PER FOOT.
6. CHART INCLUDES A SAFETY FACTOR OF 4.
7. DOOR JAMB TO BE MINIMUM 2x6 NO. 3 SOUTHERN PINE LUMBER (MIN) MOUNTED DIRECTLY TO SUPPORT STRUCTURE.
8. DESIGN OF THE SUPPORT STRUCTURE SHALL BE THE SOLE RESPONSIBILITY OF THE BUILDING DESIGNER AND SHALL BE DESIGNED FOR THE LOADS LISTED IN NOTE 5.
9. SCREW ANCHORS OR LAG SCREWS SHALL BE INSTALLED PER MANUFACTURER'S WRITTEN INSTRUCTIONS.

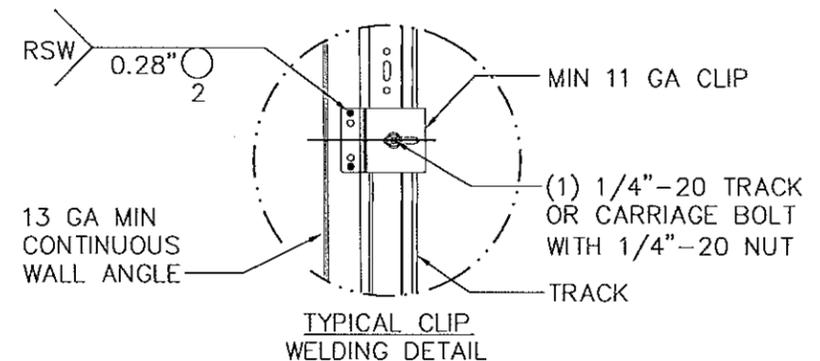

TYPICAL CLIP WELDING DETAIL



MARK A. SAWICKI, PE
2501 S. STATE HWY 121, SUITE 200
LEWISVILLE, TX 75067
FL PE 72613
TX PE 105231

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-0925-13
Expiration Date 09/27/2017






By *[Signature]*
Milan/Dalton Product Control



3395 ADDISON DRIVE
PENSACOLA, FLORIDA 32514
(850) 474-9890

STATIC PRESSURE RATINGS		APPROVED SIZES		SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH:	18'-0"	DATE	NAME
TEST (PSF):	+69.00/-78.00	MAX HEIGHT:	8'-0"	DRAWN	GRT
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT:	21'	CHECKED	MRB
MODEL 8024/8124				SHEET 6 OF 7	
WINDLOAD SPECIFICATION OPTION CODE 1340				DRAWING PART NO.	REV.
				329930	P6

REVISIONS

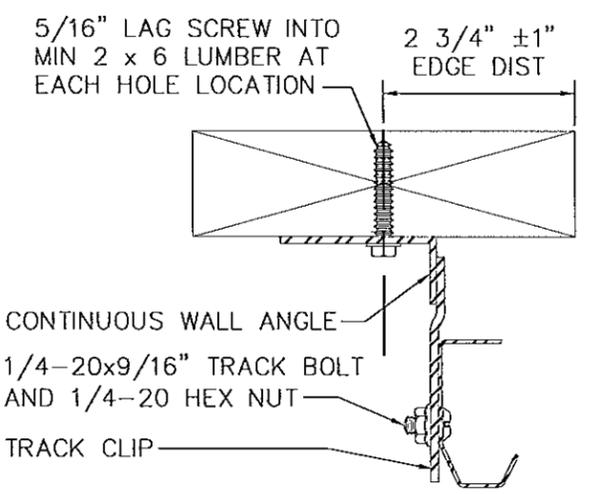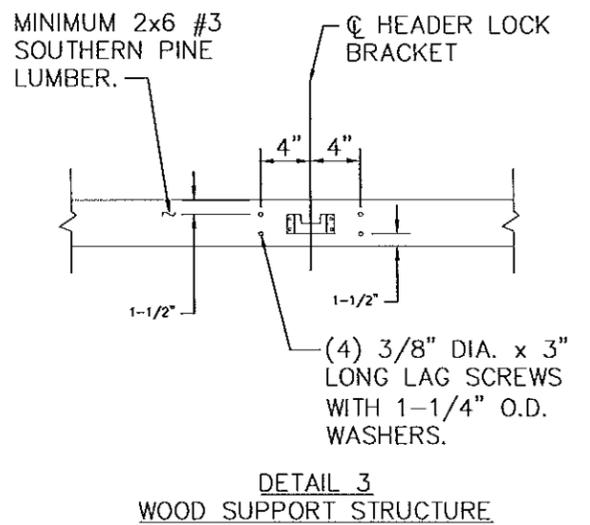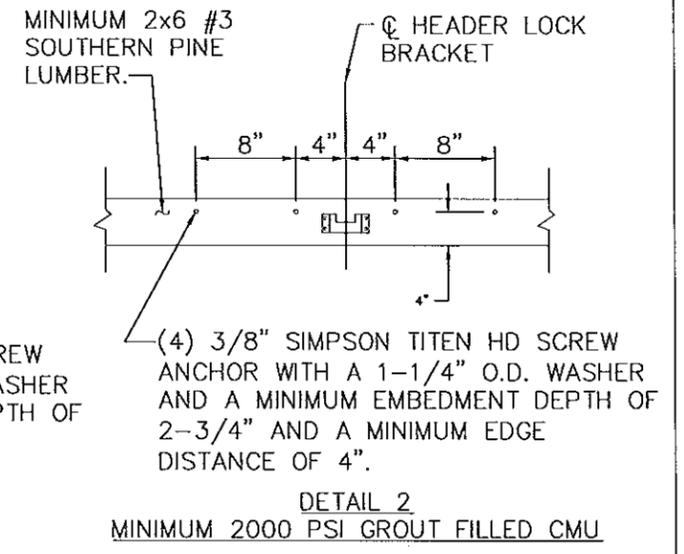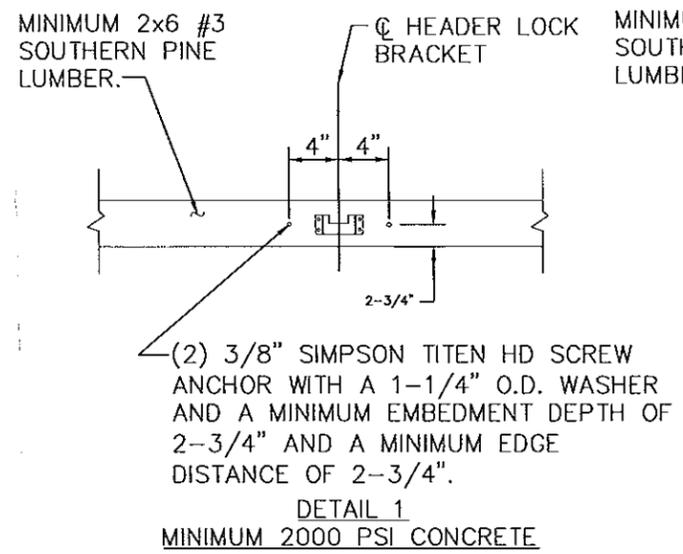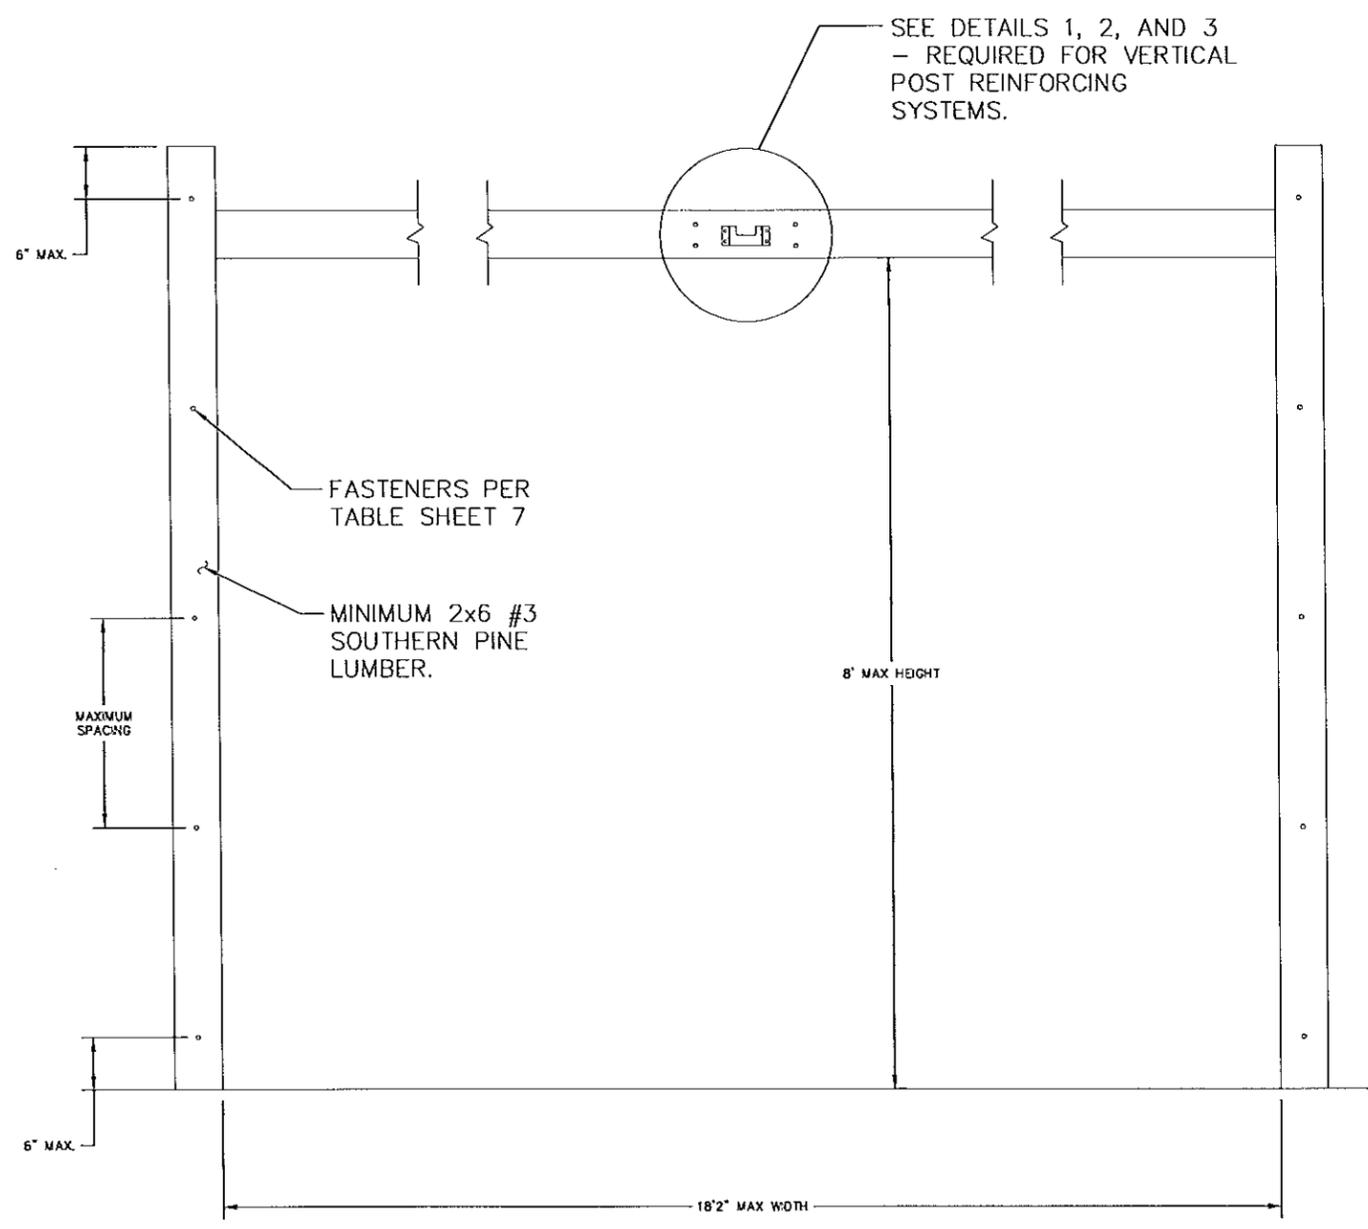

MARK A. SAWICKI, PE
2501 S. STATE HWY 121, SUITE 200
LEWISVILLE, TX 75067
FL PE 72613
TX PE 105291

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-0925.13
Expiration Date 09/27/2017
By [Signature]
Miami Dade Product Control



STATIC PRESSURE RATINGS		APPROVED SIZES	SCALE: N.T.S.	SIZE: A
DESIGN (PSF):	+46.00/-52.00	MAX WIDTH: 18'-0"	DATE	NAME
TEST (PSF):	+69.00/-78.00	MAX HEIGHT: 8'-0"	DRAWN	GRT
IMPACT/CYCLIC RATED (YES/NO):	YES	MAX SECTION HEIGHT: 21"	CHECKED	MRB
MODEL 8024/8124			SHEET 7 OF 7	
WINDLOAD SPECIFICATION OPTION CODE 1340			DRAWING PART NO.	REV.
			329930	P6