



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

NOTICE OF ACCEPTANCE (NOA)

www.miamidade.gov/economy

AWP Windows and Doors, LLC
8130 NW 74 Avenue
MEDLEY, FL. 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "10100" White PVC Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. W09-52, titled "Series 10100 PVC Horiz. Sliding Wdw. (L.M.I./ S.M.I.)" Sheets 01 through 08 of 08, dated 09/30/09 with revision "C" dated 07/02/14, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P. E., bearing the Miami-Dade County Product Control Section Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LIMITATION: Renewal Due To Name Change Only including complying with FBC-2010.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

REVISION of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA No. 12-0118.23 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P. E.



MP
1/8/15

NOA No. 14-1014.01
Expiration Date: January 06, 2020
Approval Date: January 08, 2015
Page 1

AWP Windows and Doors, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 09-1006.09)
2. Drawing No. **W09-52**, titled "Series 10100 PVC Horiz. Sliding Wdw. (L.M.I./ S.M.I.)" Sheets 01 through 08 of 08, dated 09/30/09 with revision "C" dated 07/02/14, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94.
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
 - 7) Standard Test Methods for Deglazing Force of Fenestration Products per ASTM E 987- 88 (2009)along with marked-up drawings and installation diagram of PVC horizontal sliding window, prepared by Fenestration Testing Laboratory, Test Report No. **FTL-5931** dated 05/28/09, signed and sealed by Julio E. Gonzalez, P. E.
(Submitted under previous NOA No. 09-1006.09)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC-2010**, prepared by Al-Farooq Corporation, dated 01/04/12, signed and sealed by Javad Ahmad, P. E. *(Submitted under previous NOA No. 12-0118.23)*
2. **Glazing complies with ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **14-0423.15** issued to **Eastman Chemical Company (MA)** for their "**Saflex CP - Saflex and Saflex HP Composite Glass Interlayers with PET Core**" dated 06/19/14, expiring on 12/11/18.

F. STATEMENTS

1. Letter from owners of existing NOA stating that they have sold all assets to the applicant, that they no longer manufacture the product and relinquish their rights to the current NOA No. 12-0118.23, dated June 24, 2014, signed by Mr. Kevin Barrett.


Manuel Perez, P. E.
Product Control Examiner
NOA No. 14-1014.01
Expiration Date: January 06, 2020
Approval Date: January 08, 2015

AWP Windows and Doors, LLC

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS (CONTINUED)

2. Florida Dept. of State, listing of **AWP WINDOWS AND DOORS, LLC** (Foreign Limited Liability, Co.), as a limited liability company, active and organized under the laws of the State of Florida, dated January 10, 2014 and recorded by B. Bostick, Examiner at the Secretary of State.
3. Delaware Dept. of State, certify of **AWP WINDOWS AND DOORS, LLC** (Foreign Limited Liability, Co.), as a limited liability company, active and organized under the laws of the State of Delaware, dated January 08, 2014 and signed by Jeffrey W. Bullock, Secretary of State.
4. Statement letter of conformance, complying with the **FBC-2010**, and of no financial interest, dated 01/04/12, signed and sealed by Javad Ahmad, P. E.
(Submitted under previous NOA No. 12-0118.23)
5. Florida Dept. of State, listing of Trulite Window & Door Solutions, LLC (Foreign Limited Liability Co.), managed by Arch Intermediate Holding, LLC, Tamarac, FL., dated 02/03/10. *(Submitted under previous NOA No. 12-0118.23)*
6. Certificate of registration of name change from "Trulite Residential Windows, LLC" to "Trulite Window & Door Solutions, LLC" issued by State of Delaware on 10/28/11, signed by J.W. Bullock. *(Submitted under previous NOA No. 12-0118.23)*
7. Certificate of registration of name change from "Arch Windows, LLC" to Trulite Residential Windows, LLC" issued by State of Delaware on 07/27/11, signed by J.W. Bullock. *(Submitted under previous NOA No. 12-0118.23)*
8. Florida Department of State, listing of Arch Window, LLC (Foreign Limited Liability Co.), managed by Arch Intermediate Holding, LLC, Tamarac, Florida, dated 01/22/10. *(Submitted under previous NOA No. 12-0118.23)*
9. Certificate of registration of Arch Windows, LLC (Delaware) in State of Florida dated 02/04/10, managed by Arch Intermediate Holding, LLC. *(Submitted under previous NOA No. 12-0118.23)*
10. Laboratory compliance letter for Test Report No. **FTL-5931**, issued by Fenestration Testing Laboratory, Inc., dated 05/28/09, signed and sealed by Julio E. Gonzalez, P.E. *(Submitted under previous NOA No. 09-1006.09)*
11. Proposal No. **08-1867R1** issued by the Product Control, dated 01/28/09, signed by Manuel Perez, P. E. *(Submitted under previous NOA No. 09-1006.09)*

G. OTHERS

1. Notice of Acceptance No. **12-0118.23**, issued to Trulite Window & Door Solutions, LLC, for their Series "**10100 White PVC Horizontal Sliding Window - L.M.I.**", approved on 03/15/12 and expiring on 01/06/15.


Manuel Perez, P. E.
Product Control Examiner
NOA No. 14-1014.01

Expiration Date: January 06, 2020
Approval Date: January 08, 2015

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

SERIES 10100 PVC HORIZONTAL SLIDING WINDOW

DESIGN LOAD RATINGS FOR THESE WINDOWS TO BE AS PER CHARTS SHOWN ON SHEET 3.

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF H.R./H.R. OR HORIZONTAL ROLLING WITH OTHER WINDOW TYPES IN MODULES OF TWO OR MORE WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).


WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BLDG. CODE.

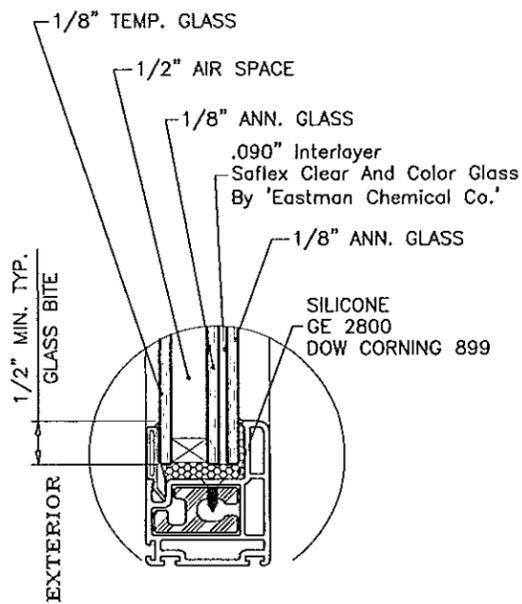

GLASS TYPE 'A'
7/8" OVERALL INSUL. LAM. GLASS
(LARGE & SMALL MISSILE IMPACT GLASS)

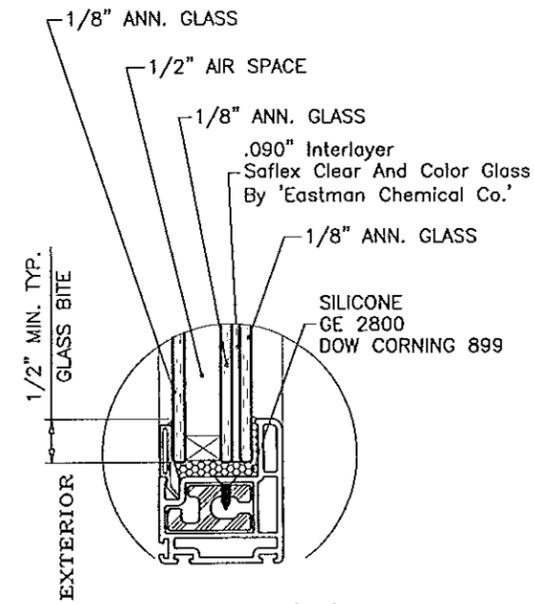

GLASS TYPE 'A1'
7/8" OVERALL INSUL. LAM. GLASS
(LARGE MISSILE IMPACT GLASS)

GLAZING OPTIONS

**INSULATING LAM. GLASS
LARGE & SMALL MISSILE IMPACT**

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 14-1014.01
Expiration Date 2/18/2020
By *Manuel Perez*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 0538
JUL 07 2014



af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP--ANL\W09-52AWP

SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309



no	date	description	by
A	05.06.10	MANUF. NAME REVISED	
B	12.23.11	UPDATED TO 2010 FBC, NAME REV	
C	07.02.14	UPDATED TO 2014 FBC	

date: 09-30-09
scale: 1/2" = 1'-0"
dr. by: HAMID
chk. by:

drawing no.
W09-52
sheet 1 of 8

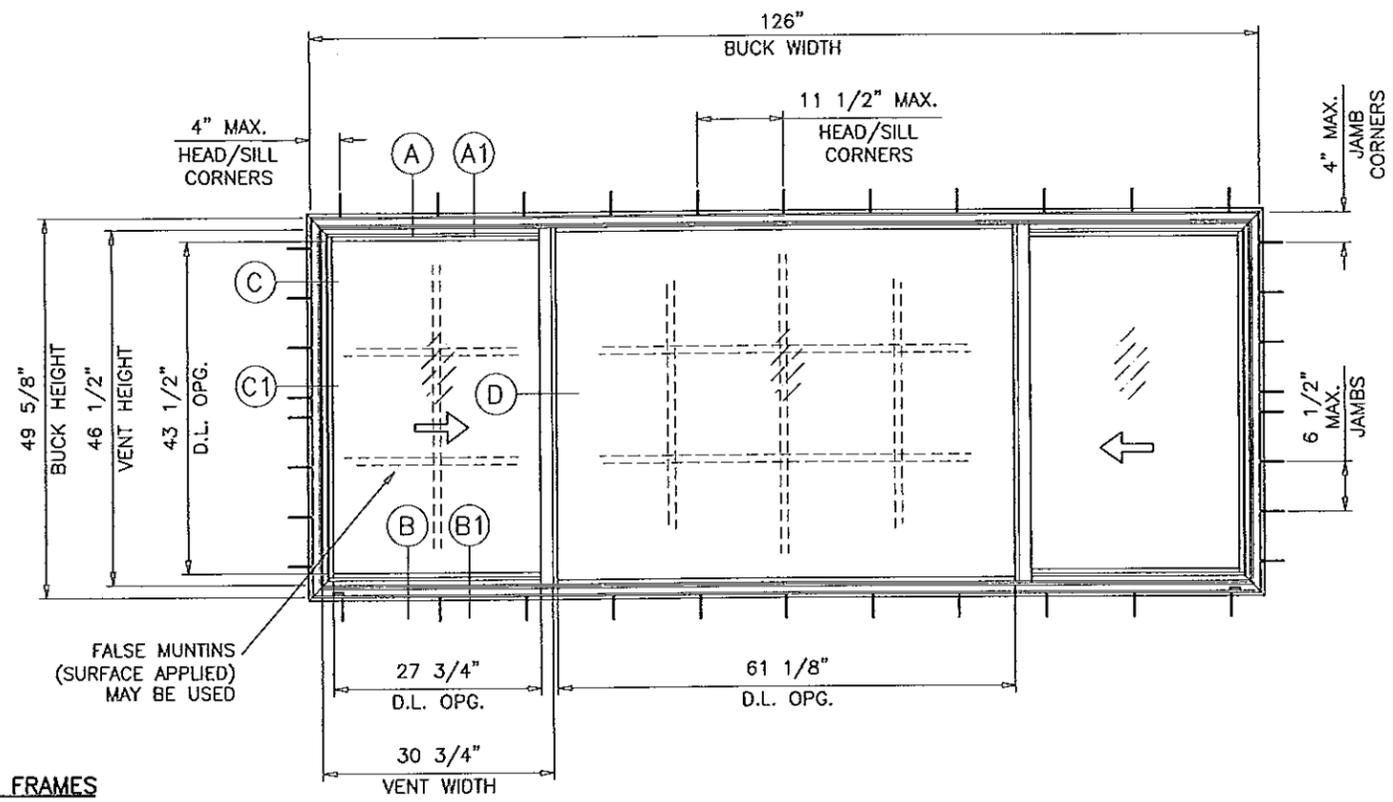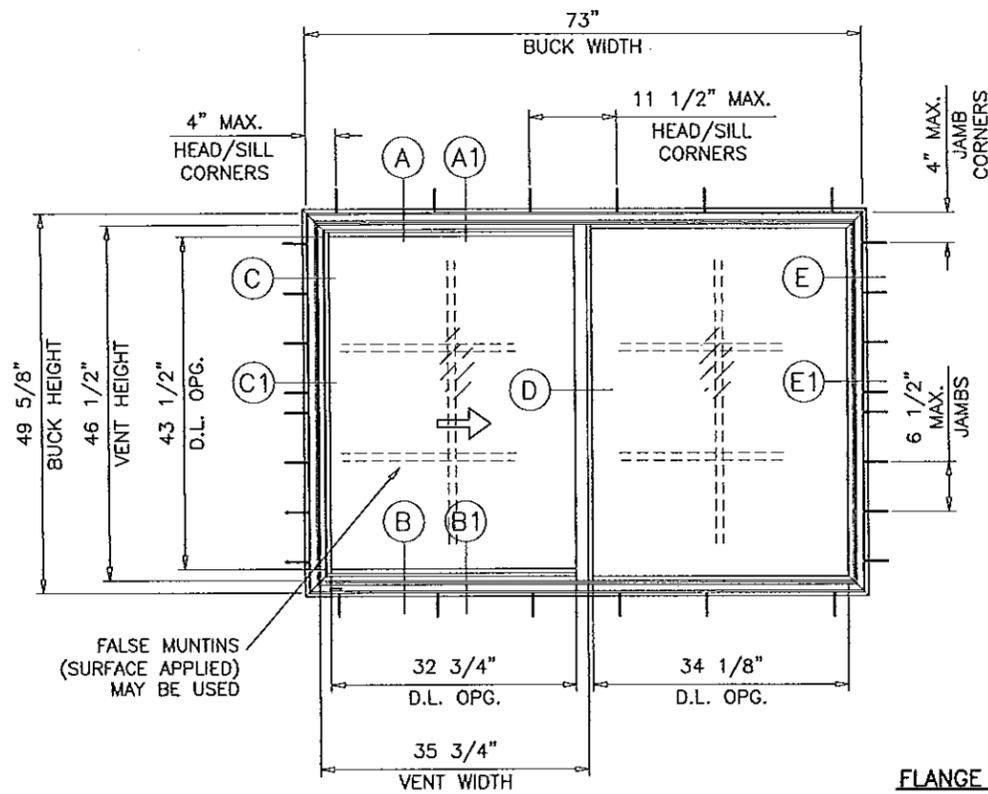

FLANGE & FLUSH FRAMES
TYPICAL ELEVATIONS

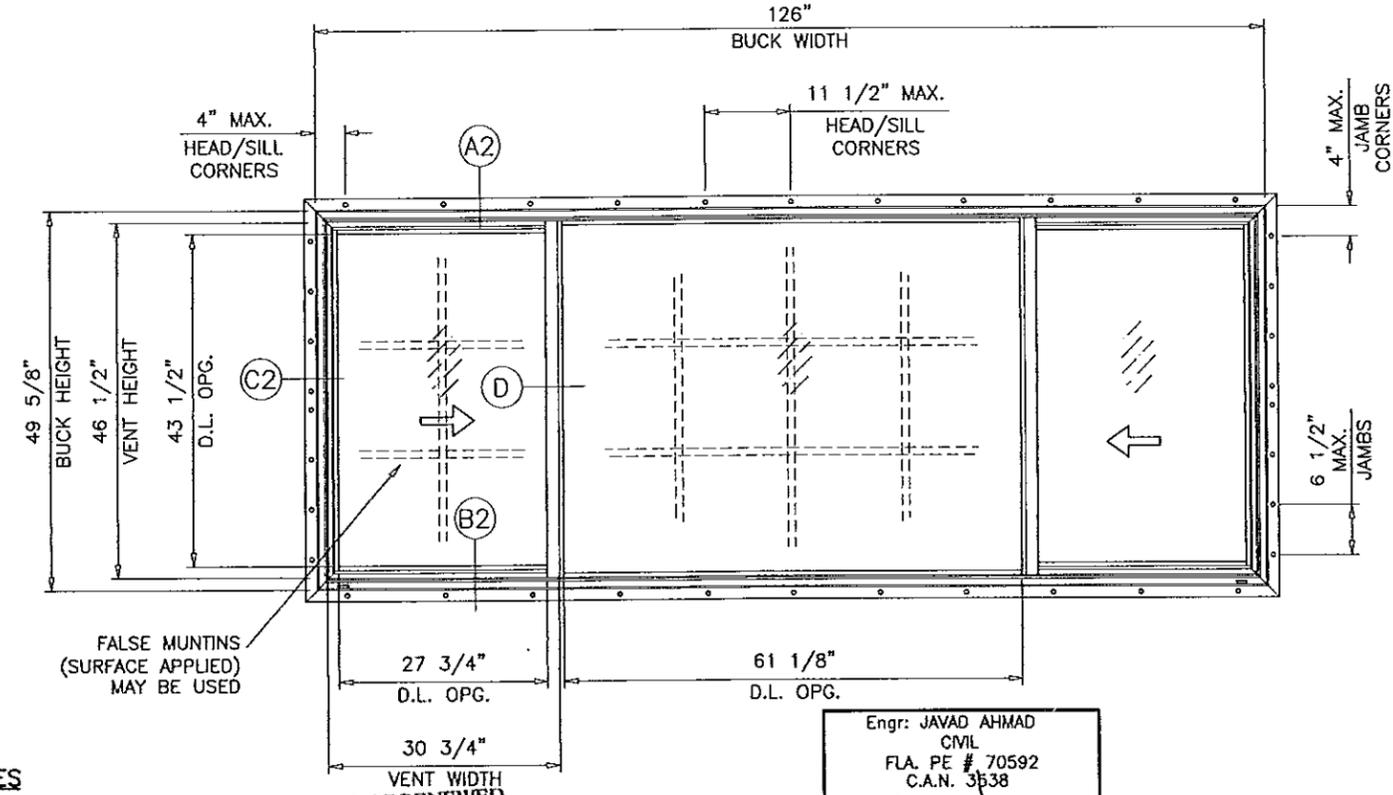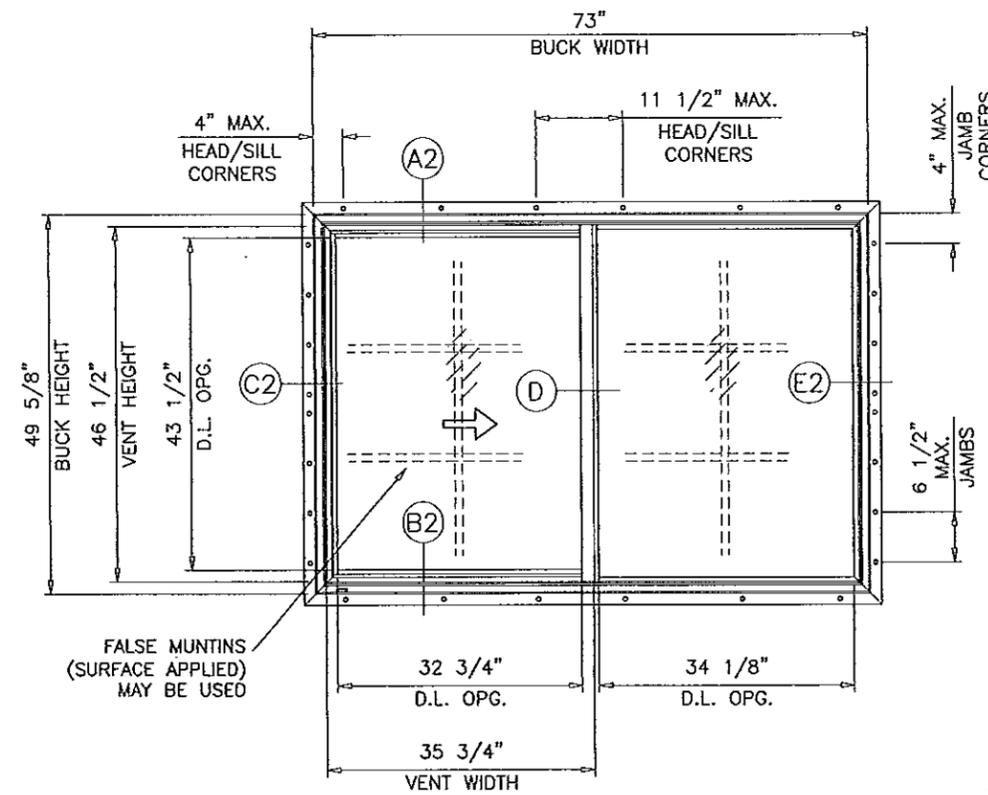

FIN FRAMES
TYPICAL ELEVATIONS

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
JUL 07 2014

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 14-1014.01
Expiration Date 01/06/2020

By: *Manuel Perez*
Miami Trade Product Control

af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W09-52AWP

SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	05.06.10		MANUF. NAME REVISED
B	12.23.11		MANUF. NAME REVISED
C	07.02.14		UPDATED TO 2014 FBC


date: 09-30-09
scale: 1/2"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W09-52


sheet 2 of 8

DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)				
BUCK DIMS.		A	GLASS TYPES 'A' & 'A1'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
25-1/2"	25" (4)	4	65.0	65.0
36"		4	65.0	65.0
52-1/8"		5	65.0	65.0
73"		7	65.0	65.0
25-1/2"	37-3/8" (6)	4	65.0	65.0
36"		4	65.0	65.0
52-1/8"		5	65.0	65.0
73"		7	65.0	65.0
25-1/2"	49-5/8" (8)	4	65.0	65.0
36"		4	65.0	65.0
52-1/8"		5	65.0	65.0
73"		7	65.0	65.0
23"	23" (4)	4	65.0	65.0
35"		4	65.0	65.0
47"		5	65.0	65.0
59"		6	65.0	65.0
71"		7	65.0	65.0
83"	8	65.0	65.0	
23"	35" (6)	4	65.0	65.0
35"		4	65.0	65.0
47"		5	65.0	65.0
59"		6	65.0	65.0
71"		7	65.0	65.0
83"	8	65.0	65.0	
23"	47" (7)	4	65.0	65.0
35"		4	65.0	65.0
47"		5	65.0	65.0
59"		6	65.0	65.0
71"		7	65.0	65.0
23"	49-5/8" (8)	4	65.0	65.0
35"		4	65.0	65.0
47"		5	65.0	65.0
59"		6	65.0	65.0
71"		7	60.1	60.1

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB




OPERATING VENTS TO BE 1/2 OF THE WINDOW WIDTH
'XO OR OX'

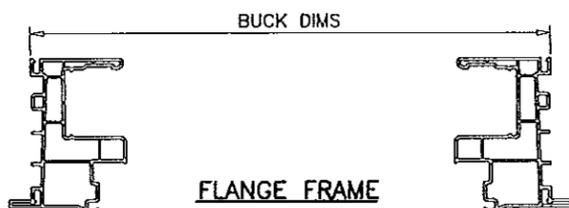


DESIGN LOAD CAPACITY - PSF (XO OR OX SIZES)				
BUCK DIMS.		A	GLASS TYPES 'A' & 'A1'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
54-5/8"	25" (4)	5	65.0	65.0
78-3/4"		8	65.0	65.0
82-3/8"		8	65.0	65.0
54-5/8"	37-3/8" (6)	5	65.0	65.0
78-3/4"		8	65.0	65.0
82-3/8"		8	65.0	65.0
54-5/8"	49-5/8" (8)	5	65.0	65.0
78-3/4"		8	62.7	62.7
82-3/8"		8	61.9	61.9
53-1/8"		5	65.0	65.0
62-1/8"	23" (4)	6	65.0	65.0
71-1/2"		7	65.0	65.0
80-1/8"		8	65.0	65.0
89-1/8"		8	65.0	65.0
53-1/8"	35" (6)	5	65.0	65.0
62-1/8"		6	65.0	65.0
71-1/2"		7	65.0	65.0
80-1/8"		8	65.0	65.0
53-1/8"	47" (7)	5	65.0	65.0
62-1/8"		6	65.0	65.0
71-1/2"		7	65.0	65.0
80-1/8"		8	64.5	64.5
53-1/8"	49-5/8" (8)	5	65.0	65.0
62-1/8"		6	65.0	65.0
71-1/2"		7	64.4	64.4
80-1/8"		8	62.4	62.4

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

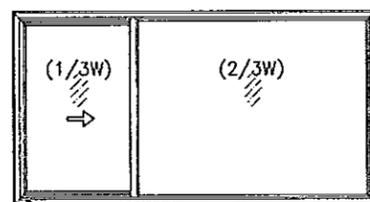


OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH
'XO OR OX'

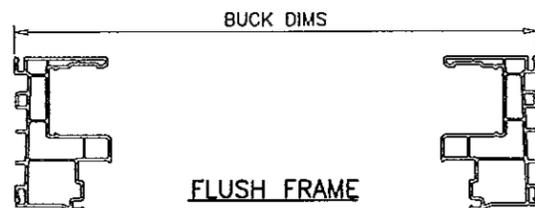


DESIGN LOAD CAPACITY - PSF (XOX SIZES)				
BUCK DIMS.		A	GLASS TYPES 'A' & 'A1'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
73"	25" (4)	7	65.0	65.0
105-1/4"		10	65.0	65.0
110"		10	65.0	65.0
73"	37-3/8" (6)	9	65.0	65.0
105-1/4"		12	65.0	65.0
110"		12	65.0	65.0
73"	49-5/8" (8)	9	65.0	65.0
105-1/4"		12	62.7	62.7
110"		12	61.9	61.9
71"		7	65.0	65.0
83"	23" (4)	8	65.0	65.0
95"		9	65.0	65.0
107"		10	65.0	65.0
119"		11	65.0	65.0
125"		11	65.0	65.0
71"	35" (6)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	65.0	65.0
107"		10	65.0	65.0
119"		11	65.0	65.0
125"	11	65.0	65.0	
71"	47" (7)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	65.0	65.0
107"		10	64.5	64.5
71"	49-5/8" (8)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	64.4	64.4
107"		10	62.4	62.4

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

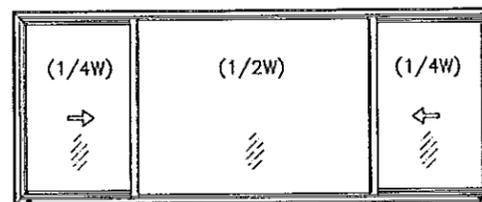


OPERATING VENTS TO BE 1/4 OF THE WINDOW WIDTH
'XOX'

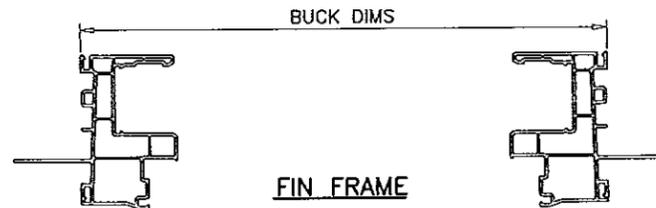

DESIGN LOAD CAPACITY - PSF (XOX SIZES)				
BUCK DIMS.		A	GLASS TYPES 'A' & 'A1'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)
73"	25" (4)	7	65.0	65.0
105-1/4"		10	65.0	65.0
110"		10	65.0	65.0
73"	37-3/8" (6)	9	65.0	65.0
105-1/4"		12	65.0	65.0
110"		12	65.0	65.0
73"		9	65.0	65.0
105-1/4"	49-5/8" (8)	12	62.7	62.7
110"		12	61.9	61.9
71"	23" (4)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	65.0	65.0
107"		10	65.0	65.0
119"		11	65.0	65.0
125"	11	65.0	65.0	
71"	35" (6)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	65.0	65.0
107"		10	65.0	65.0
119"		11	65.0	65.0
125"	11	65.0	65.0	
71"	47" (7)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	65.0	65.0
107"		10	65.0	65.0
71"	49-5/8" (8)	7	65.0	65.0
83"		8	65.0	65.0
95"		9	64.4	64.4

A = NO. OF ANCHORS PER HEAD & SILL
() = NO. OF ANCHORS PER JAMB

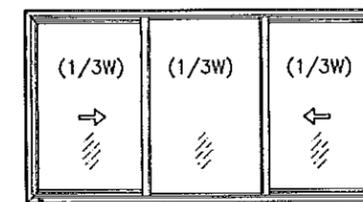

OPERATING VENTS TO BE 1/3 OF THE WINDOW WIDTH
'XOX'

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
JUL 07 2014

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 14-101401
Expiration Date 01/06/2020
By: Manuel Perez
Miami Dade Product Control




afC
AL-FAROQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W09-52AMP

SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description
A	05.06.10	MANUF. NAME REVISED
B	12.23.11	MANUF. NAME REVISED
C	07.02.14	UPDATED TO 2014 FBC

date: 09-30-09
scale: -
dr. by: HAMID
chk. by:

drawing no.
W09-52
sheet 3 of 8

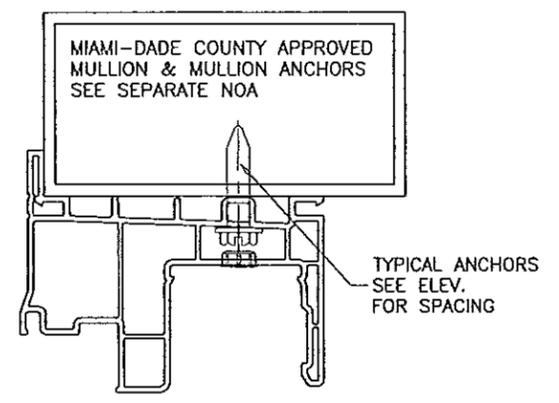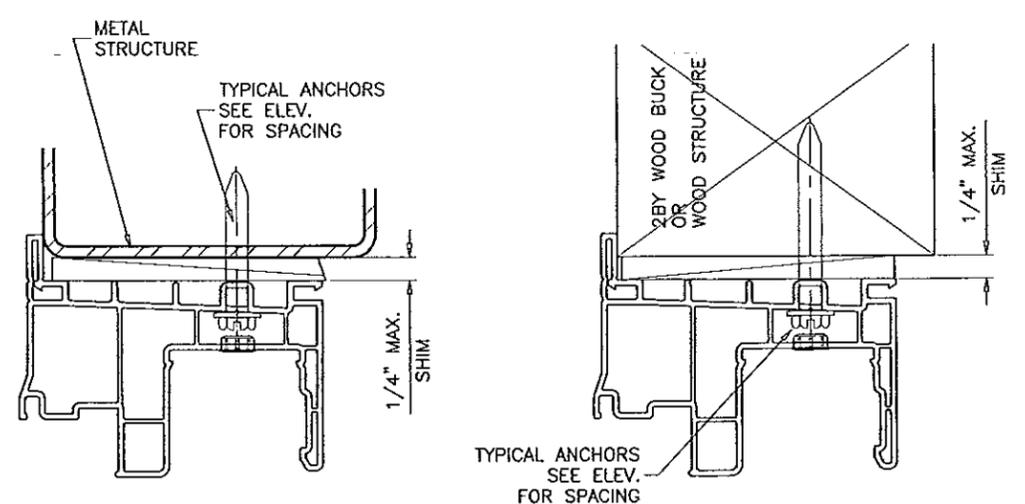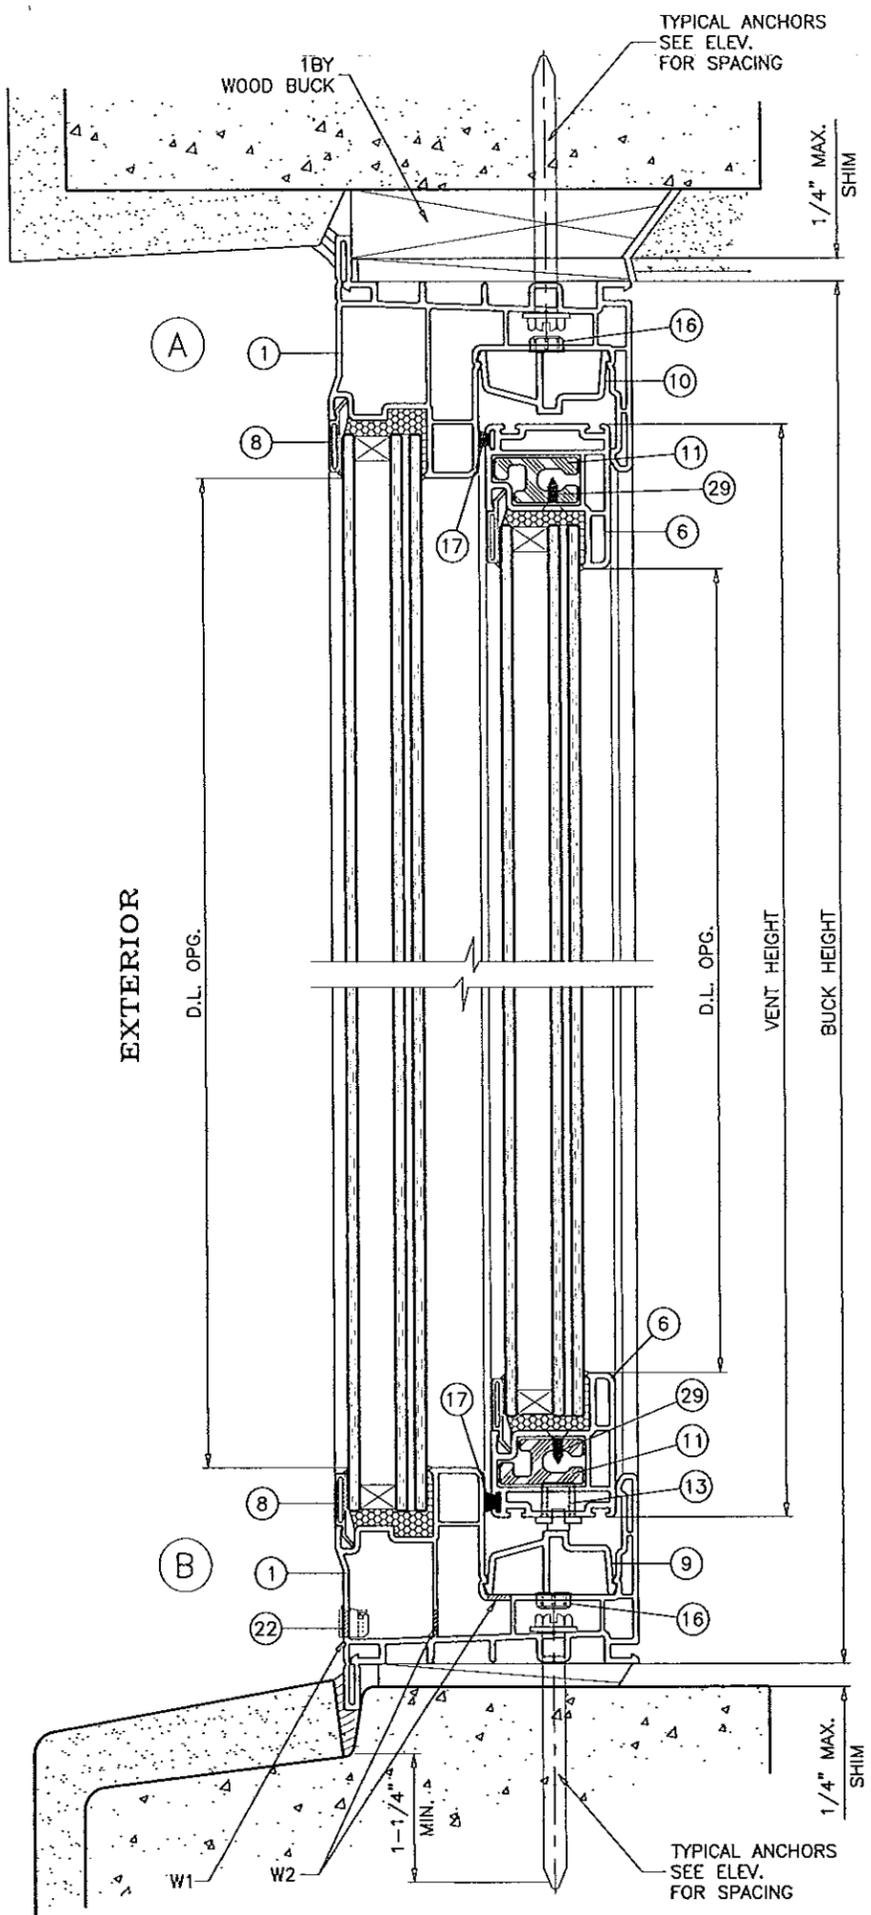

WOOD BUCKS AND METAL STRUCTURE NOT BY AWP WINDOWS MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

WEEPHOLES:

- W1 = 1/4" X 1" WEEP SLOT AT 4" FROM EACH END WITH PLASTIC BAFFLE.
- W2 = 1/4" X 1" WEEP SLOT AT 4" FROM EACH END

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH JOINT SEALER.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

- 1/4" DIA. TAPCON BY 'ITW' (Fu=120 KSI, Fy=92 KSI)
- 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

DIRECTLY INTO CONC. OR MASONRY
1-1/4" MIN. EMBED INTO CONC. OR MASONRY

#12 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)
INTO METAL STRUCTURES

STEEL : 12 GA. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)


#12 SMS OR SELF DRILLING SCREWS (GRADE 2 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = .090")
(NO SHIM SPACE)

TYPICAL EDGE DISTANCE

- INTO CONCRETE AND MASONRY = 2" MIN.
- INTO WOOD STRUCTURE = 1" MIN.
- INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C-90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

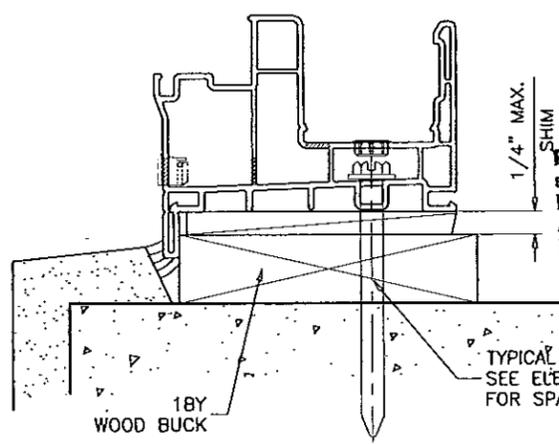

PRODUCT RENEWED
as complying with the Florida
Building Code
Acceptance No. 14-1014.01
Expiration Date 07/07/2020
By *Mamad Elrez*
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
JUL 07 2014




af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
1235 S.W. 87 AVE
MIAMI, FLORIDA 33174
TEL (305) 264-8100 FAX (305) 262-6978
COMP-ANL\W09-52AWP

SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
8130 N.W. 74TH AVE.
MEDLEY, FL. 33166
TEL (305) 887-2646 FAX (305) 883-1309

NO	DATE	BY	DESCRIPTION
A	05.06.10		MANUF. NAME REVISED
B	12.23.11		MANUF. NAME REVISED
C	07.02.14		UPDATED TO 2014 FBC

date: 09-30-09
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W09-52
sheet 4 of 8

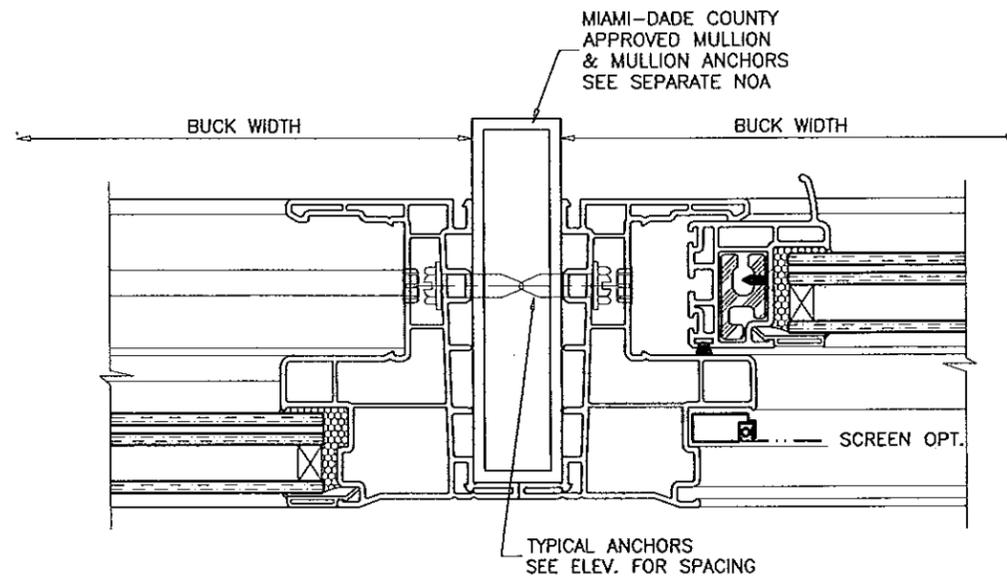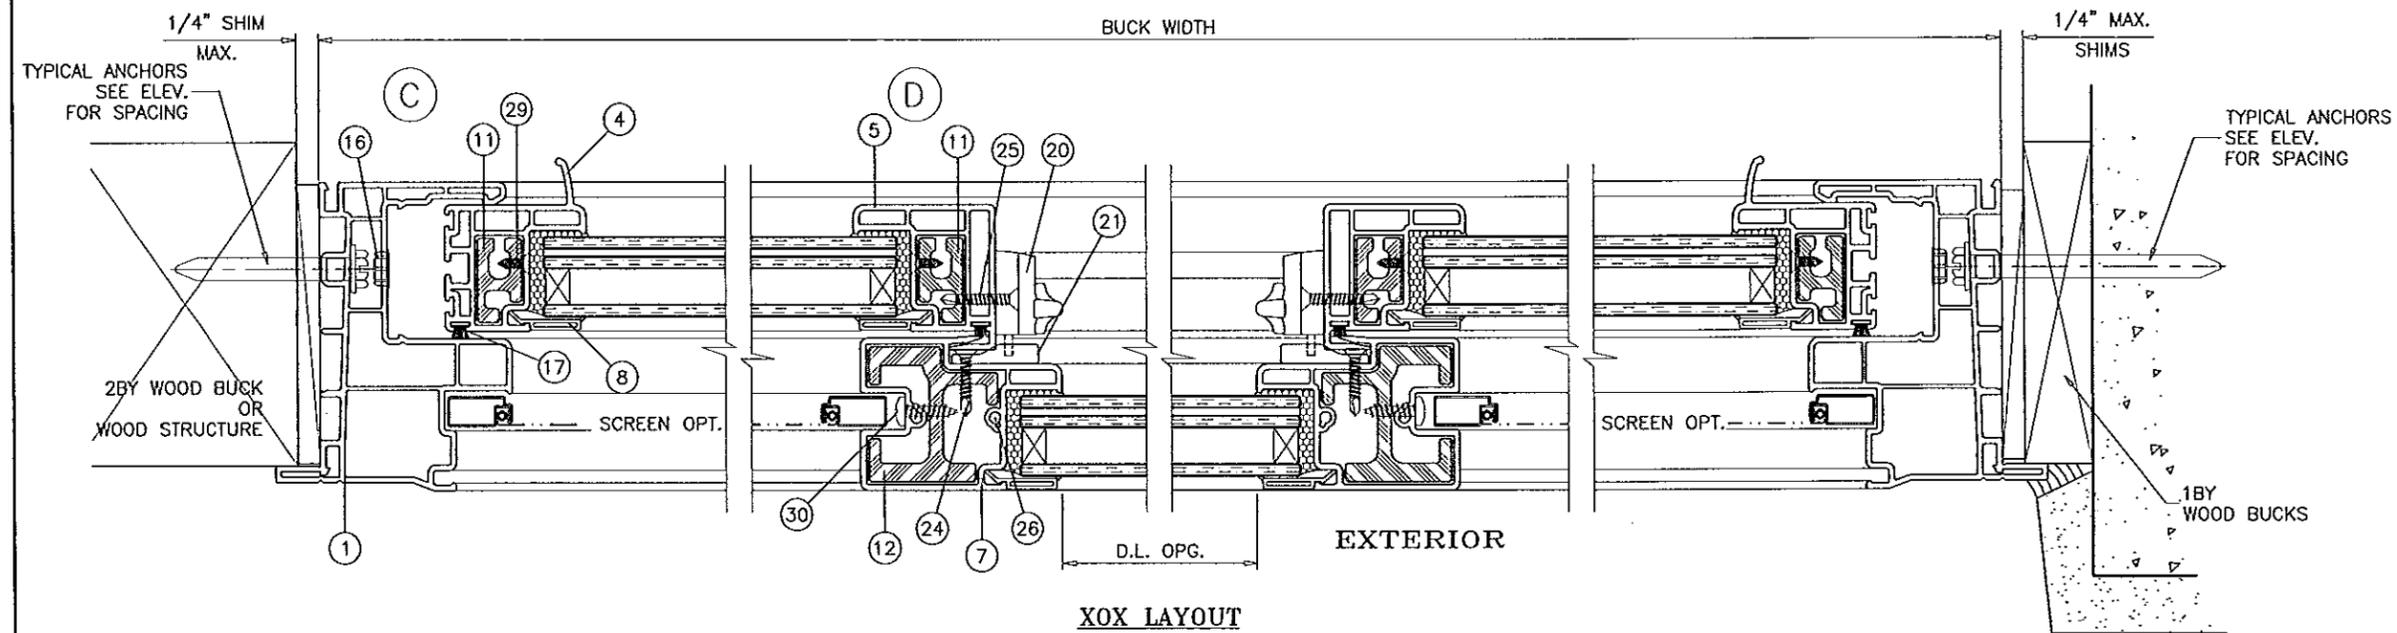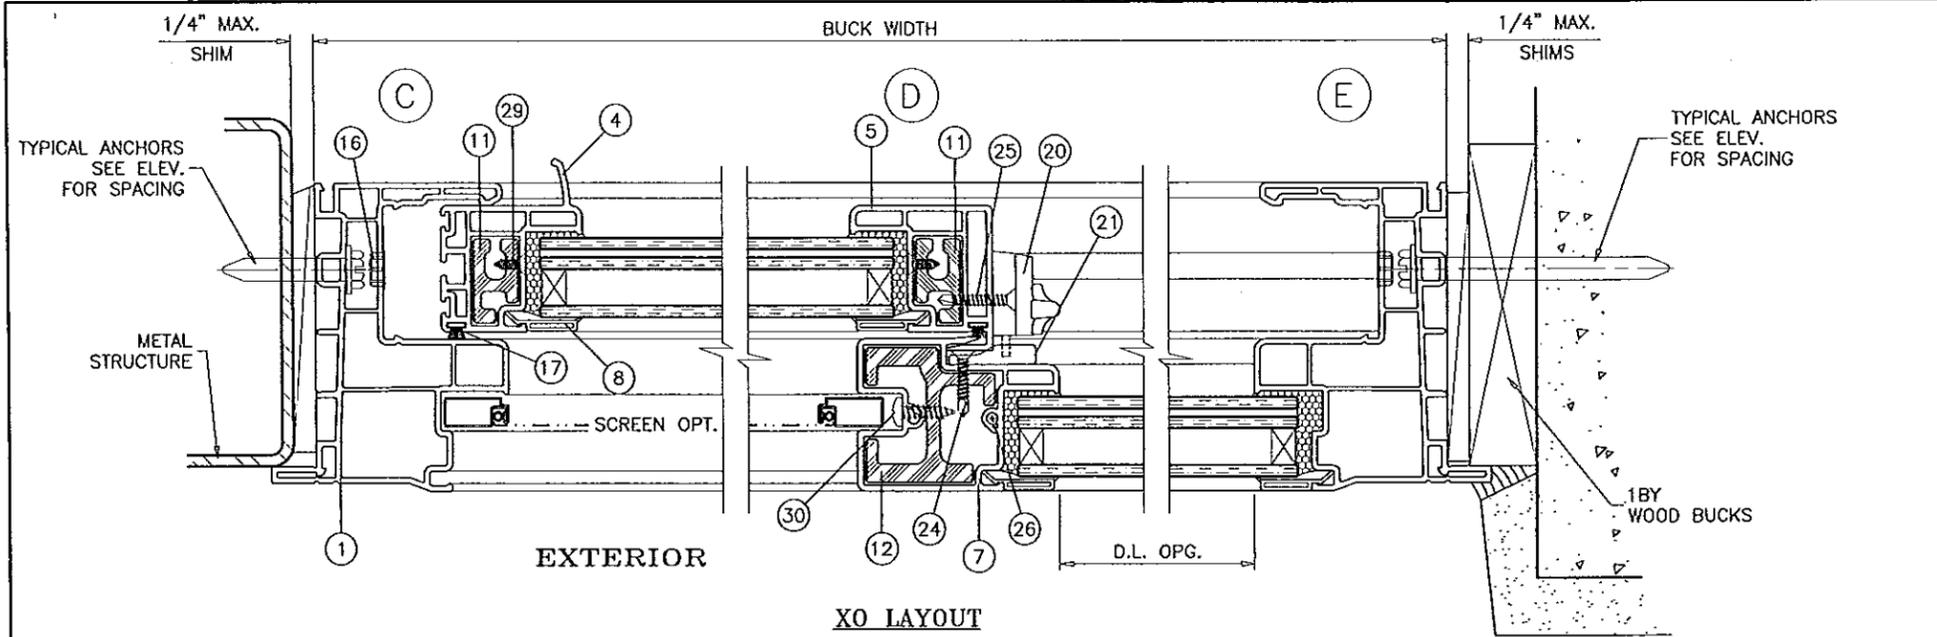

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 14-1014.01
 Expiration Date 01/06/2020
 By *Manuel Peris*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3538
 JUL 07 2014





af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W09-52AWP

SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	description	by
A	05.06.10	MANUF. NAME REVISED	
B	12.23.11	MANUF. NAME REVISED	
C	07.02.14	UPDATED TO 2014 FBC	

date:	09-30-09	scale:	1/2" = 1"
dr. by:	HAMID	chk. by:	

drawing no.	W09-52
sheet	5 of 8

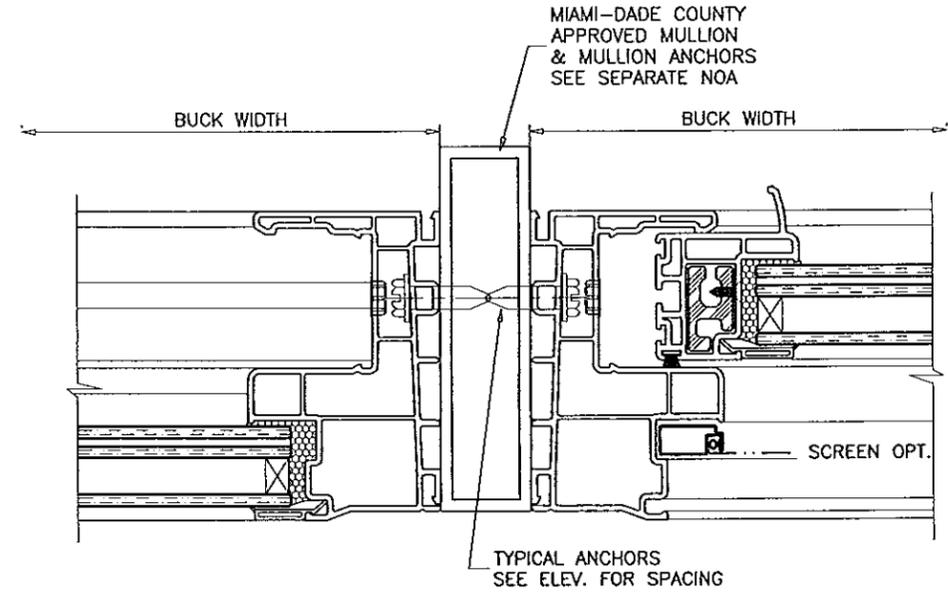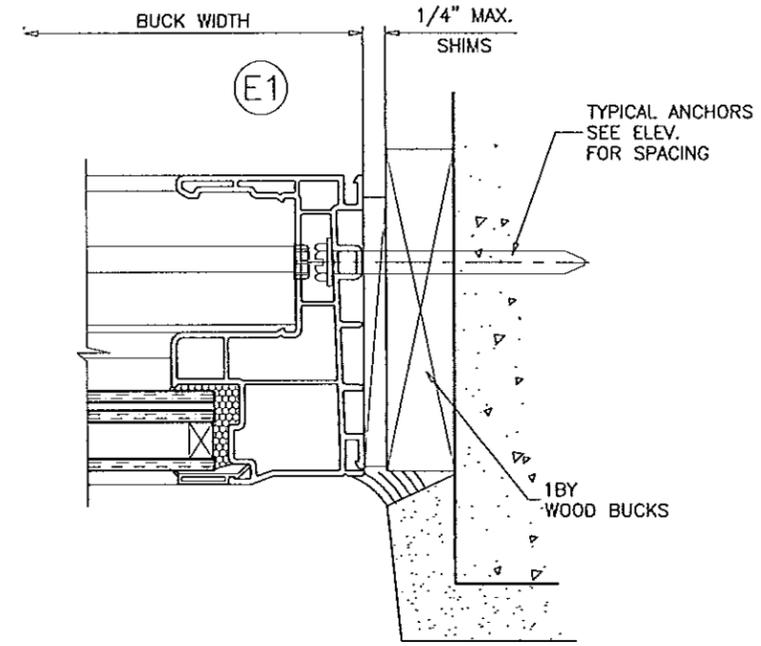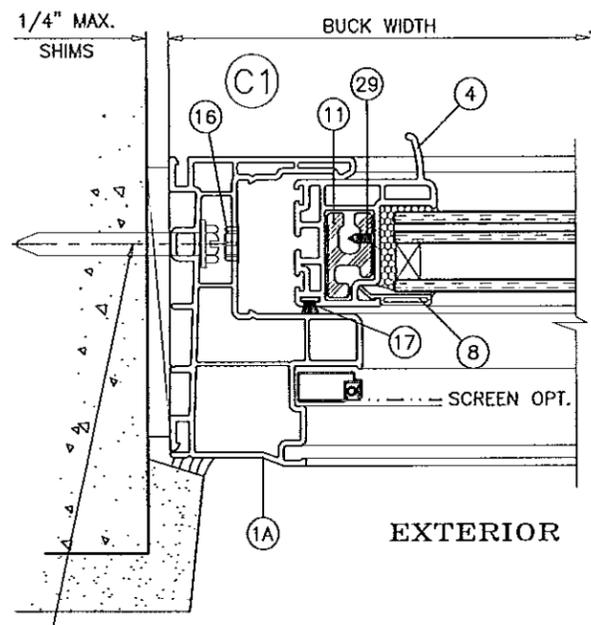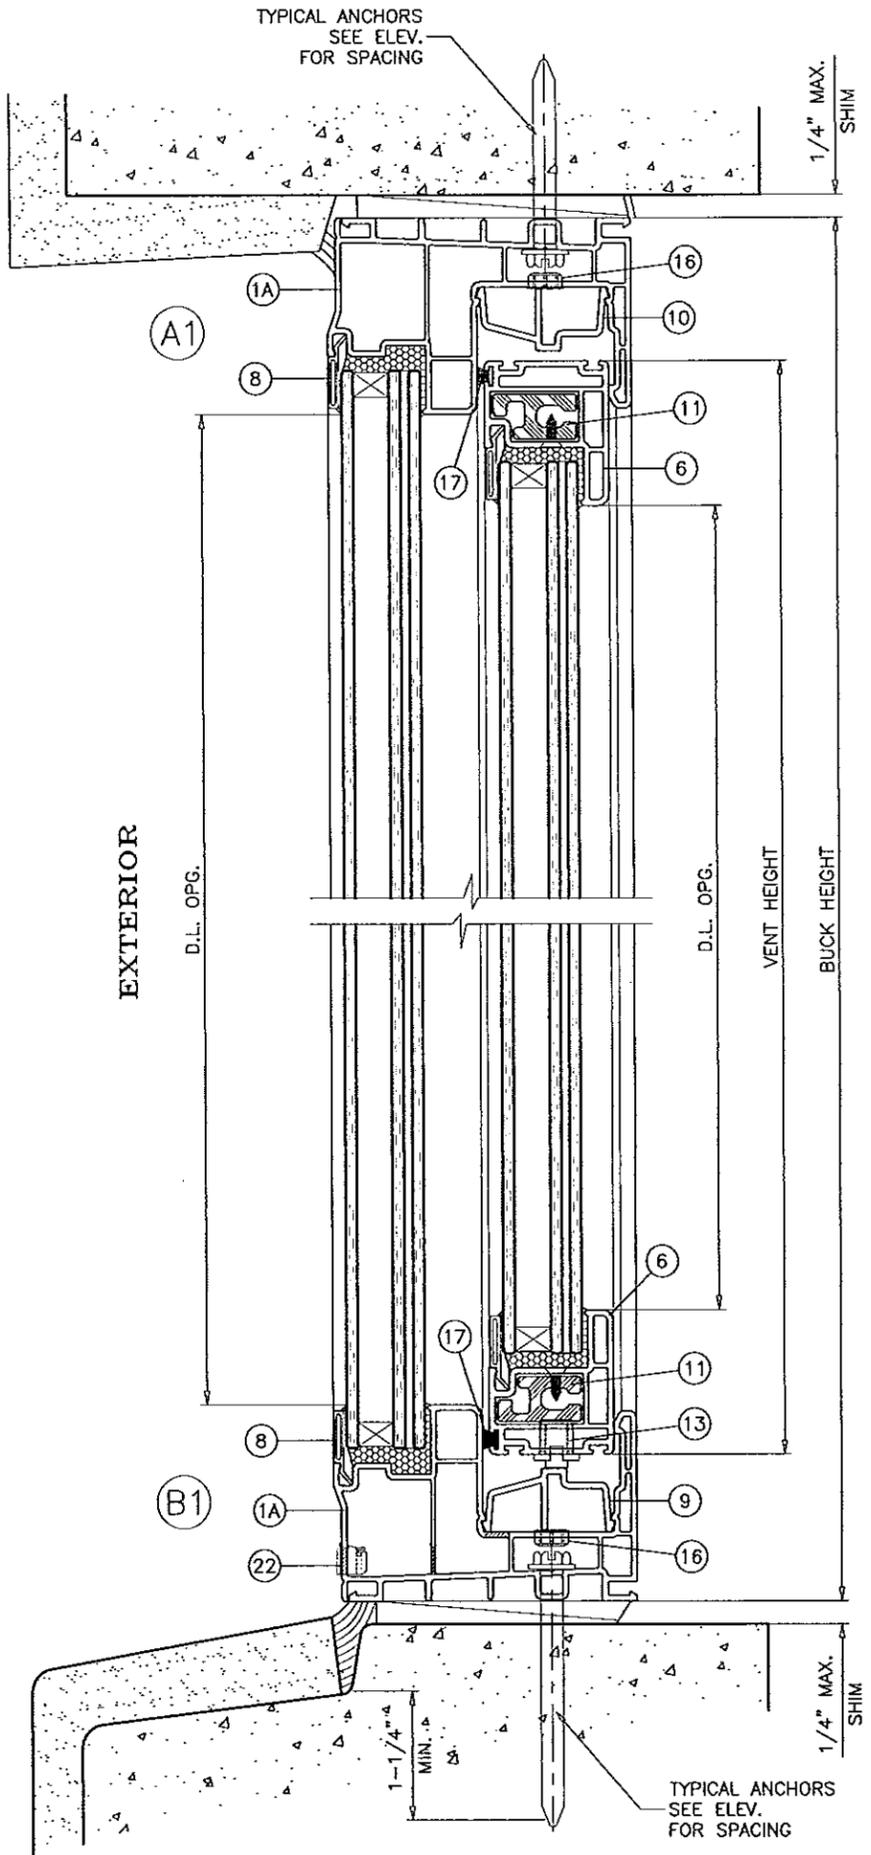

PRODUCT RENEWED
 as complying with the Florida
 Building Code **14-1014.01**
 Acceptance No
 Expiration Date **21/06/2020**
 By *Manuel Lopez*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CIVIL
 FLA. PE # 70592
 C.A.N. 3838
JUL 07 2014

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL (305) 264-8100 FAX (305) 262-6978
 COMP-ANL\W09-52AWP


SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

revisions:


no.	date	description	by
A	05.06.10	MANUF. NAME REVISED	
B	12.23.11	MANUF. NAME REVISED	
C	07.02.14	UPDATED TO 2014 FBC	

date: 09-30-09
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:


drawing no.
W09-52
 sheet 6 of 8

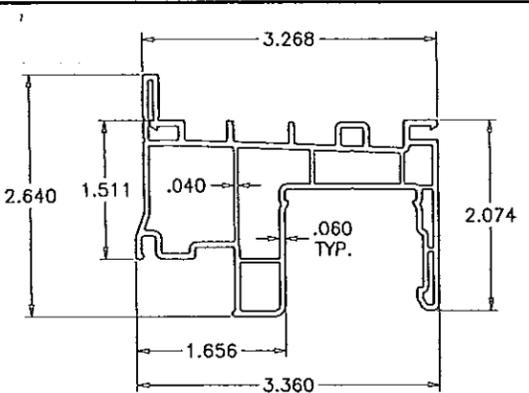


① FLANGE FRAME

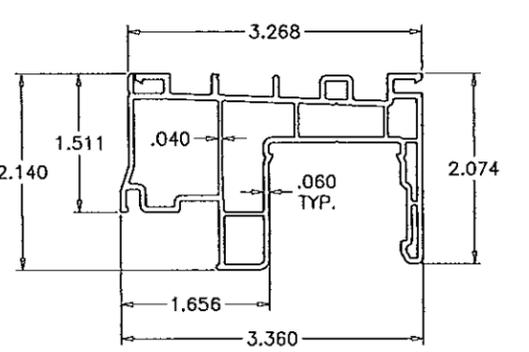


①A FLUSH FRAME

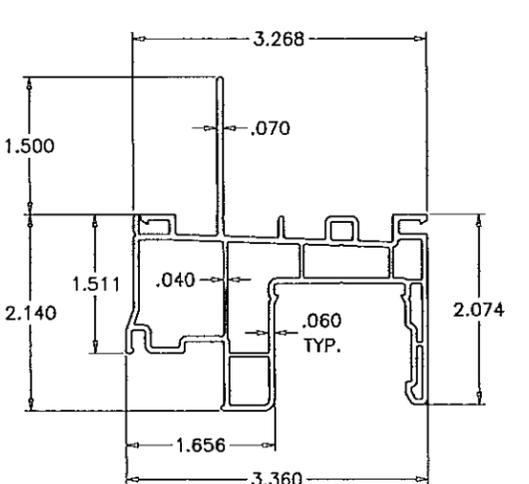


①B FIN FRAME

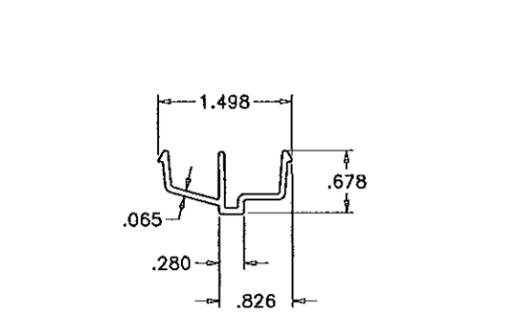


⑨ ROLLER TRACK




⑩ VENT ANTI-LIFT DEVICE

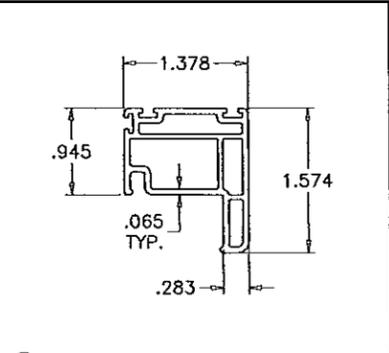


⑥ VENT TOP & BOTTOM RAIL

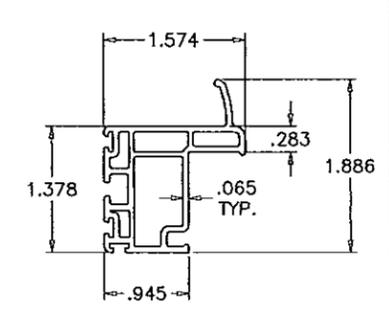


④ VENT LOCK STILE

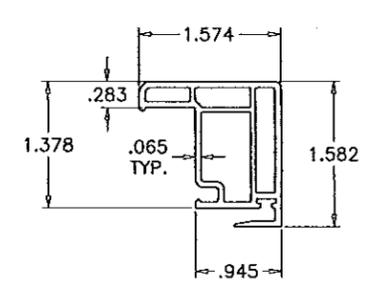


⑤ VENT INTERLOCK STILE

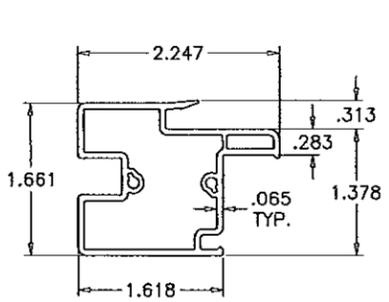


⑦ FIXED INTERLOCK STILE

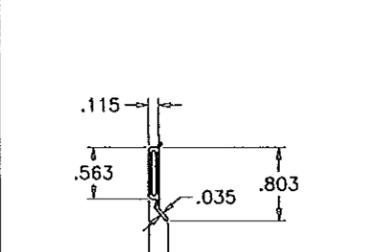

⑧ GLAZING BEAD

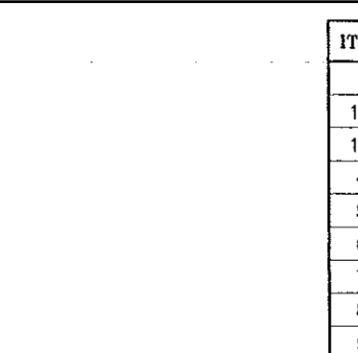


⑪ VENT REINFORCEMENT

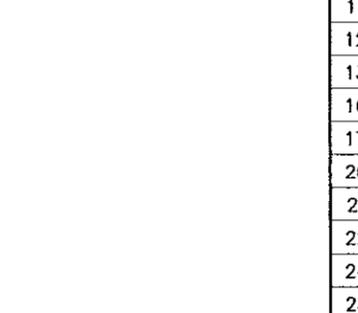


⑫ FIX. INTERLOCK REINF.

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	YV-10101	1	FLANGE FRAME	PVC	-
1A	YV-10101	2	FLUSH FRAME	PVC	-
1B	YV-10101	1	FIN FRAME	PVC	-
4	YV-10003	2	VENT LOCK STILE	PVC	-
5	YV-10004	2	VENT INTERLOCK STILE	PVC	-
6	YV-10005	4	VENT TOP & BOTTOM RAIL	PVC	-
7	YV-10006	2	FRAME FIXED INTERLOCK	PVC	-
8	YV-10007	12	GLAZING BEAD	PVC	-
9	YV-10102	1	ROLLER TRACK	PVC	-
10	YV-10102	2/VENT	VENT ANTI-LIFT DEVICE (4" LONG, AT TOP)	PVC	-
11	YE-1104	4/VENT	VENT REINFORCEMENT	6063-T6	-
12	YE-1103	1 EACH	FIXED INTERLOCK REINFORCEMENT	6063-T6	-
13	YH-1609	2/VENT	ROLLER ASSEMBLY (MOD. 110-2402-92)	NYLON/BRASS	RO-MAI
16	YH-1316	AS REQ'D.	Ø 3/8" HOLE PLUG (MOD. C-13856)	NYLON	ASHLAND
17	YH-602	AS REQ'D.	.187" x .330" FIN SEAL WEATHERSTRIP	-	ULTRAFAB
20	YH-595	2/VENT	SWEEP LOCK (MOD. 677208)	-	DECO
21	YH-597	2/VENT	FACE MOUNTED KEEPER (MOD. 677133)	-	DECO
22	YH-1610	2	WEEP HOLE COVER	-	ASHLAND
24	YF-82	2/KEEPER	#6 x 3/4" F.H. TEK. SQ.DR. KEEPER SCREW	CAD PLATED CRS.	-
25	YF-83	2/LOCK	#8 x 7/8" F.H. TEK. PH.DR. SWEEP LOCK SCREW	CAD PLATED CRS.	-
26	YF-78SH	4	#8 x 2-1/2" P.H. SS. SQ.DR. FIXED MR. SCREW	S. STEEL	-
29	YF-92	14/VENT	#8 x 3/8" F.H. PH.DR. VENT REINF. SCREW	CAD PLATED CRS	-
30	YF-21SS	5/VENT	#8 x 1/2" P.H. SS. PH.DR. FIXED MR. REINF. SCREW	S. STEEL	-

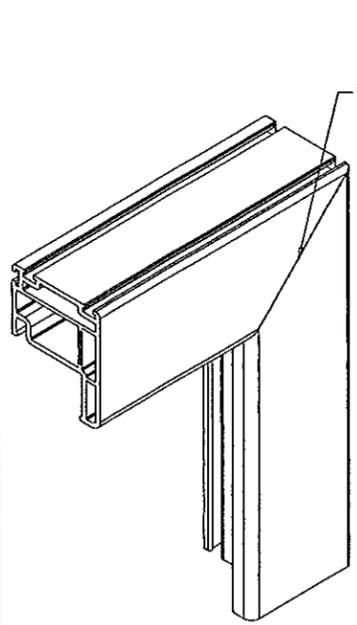

VENT CORNERS

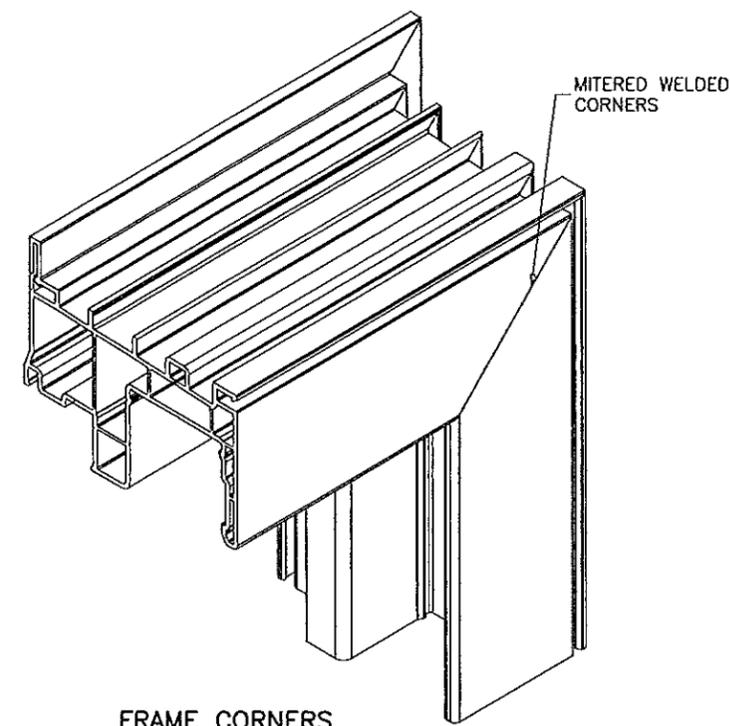

FRAME CORNERS

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 14-1014.01
 Expiration Date 07/06/2020
 By *Manuel Lopez*
 Miami Dade Product Control

Engr: JAVAD AHMAD
 CML
 FLA. PE # 70592
 CA # 58774
 JUL 07 2014

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 1235 S.W. 87 AVE
 MIAMI, FLORIDA 33174
 TEL. (305) 264-8100 FAX (305) 262-6978
 COMP-ANL \ W09-52AWP

SERIES 10100 PVC HORIZ. SLIDING WDW. (L.M.I./S.M.I.)
AWP WINDOWS AND DOORS, LLC
 8130 N.W. 74TH AVE.
 MEDLEY, FL. 33166
 TEL. (305) 887-2646 FAX (305) 883-1309

no	date	by	description
A	05.06.10		MANUF. NAME REVISED
B	12.23.11		MANUF. NAME REVISED
C	07.02.14		UPDATED TO 2014 FBC

date: 09-30-09
 scale: 1/2" = 1"
 dr. by: HAMID
 chk. by:

drawing no.
W09-52
 sheet 8 of 8