

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION 11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

## NOTICE OF ACCEPTANCE (NOA)

Mr. Glass Doors & Windows, Inc. 7440 N.W. 66th Street Miami, Florida 33166

#### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

## DESCRIPTION: "MG-2530" Aluminum Glazed Railing

APPROVAL DOCUMENT: Drawing No. 14-04, titled "Series MG2530 Alum, Glass Railing System", sheets 1 through 4 of 4, prepared by Al-Farooq Corporation, revision #A dated February 26, 2015, signed and sealed by Javad Ahmad, P.E., on February 27, 2015, bearing Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and the approval date by the Miami-Dade County Product Control Section.

## MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. The structural adequacy of the supporting structures is not part of this approval & shall be reviewed by the corresponding Building Dept.

This NOA consists of this page 1, evidence submitted page E-1 as well as approval document mentioned above. The submitted documentation was reviewed by Helmy A. Makar, P.E., M.S.

(MIAMI-DADE COUNTY)

He G. A. Nolon 03/26/2015

NOA No. 14-1022.02 Expiration Date: 03/26/2020 Approval Date: 03/26/2015 Page 1

## Mr. Glass Doors & Windows, Inc.

## NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

#### A. DRAWINGS

1. Drawing No. 14-04, titled "Series MG2530 Alum. Glass Railing System", sheets 1 through 4 of 4, prepared by Al-Farooq Corporation, revision #A dated February 26, 2015, signed and sealed by Javad Ahmad, P.E., on February 27, 2015.

### B. TESTS

1. Test Report No. 7861, by Fenestration Testing Laboratory, Inc., dated September 19, 2014, signed and sealed by Idalmis Ortega, P.E.

### C. CALCULATIONS

- 1. Calculation titled "Series MG 2530 Aluminum & Glass Railing", 61 sheets, dated October 02, 2014, prepared by Al Farooq Corporation, signed and sealed by Javad Ahmad, P.E., on October 16, 2014.
- 2. Calculation titled "Series MG 2530 Aluminum & Glass Railing", 10 sheets, dated February 25, 2015, prepared by Al Farooq Corporation, signed and sealed by Javad Ahmad, P.E., on February 27, 2015.

# D. QUALITY ASSURANCE

1. By Miami-Dade County Department of Regulatory and Economic Resources.

# E. MATERIAL CERTIFICATIONS


- 1. Die Drawings.
- 2. Non-Shrink Precision Grout, Product No. 1585-00 by Commercial Grade Quikrete.


#### F. OTHERS

1. Letter of compliance with the FBC Fifth Edition (2014), dated October 08, 2014, issued by Al Farooq Corporation, signed and sealed by Javad Ahmad, P.E., on October 16, 2014.

Helmy A. Makar, P.E., M.S. Product Control Unit Supervisor NOA No. 14-1022.02

> Expiration Date: 03/26/2020 Approval Date: 03/26/2015

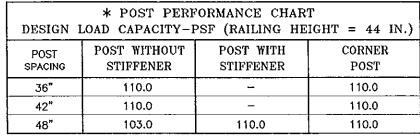

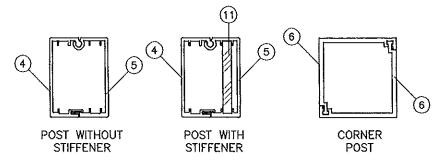

		VARIES (48" MAX.)	VARIES (48" MAX.)	VARIES (48" MAX.)	VARIES (48" MAX.)
		STARTING POST SPACING	INTERMEDIATE POST SPACING	CORNER POST SPACING	CORNER POST SPACING
			VARIES (47 1/2" MAX.)		
			GLASS WIDTH		
			45 1/2" MAX. D.L. OPG.	90	
		(A)	D.C. Or G.		
44" MAX. 42" MIN. AFTER FINISHED FLR. RAILING HEIGHT	37 5/8" MAX. D.L. OPG.	D B		/// E	
<u>,</u>		444	4.4.4.4		4 4 4
c	· [				

TYPICAL ELEVATION

* POST EMBEDMENT CHART (RAILING HEIGHT = 44 IN.)						
CONCRETE	•	· · · · · · · · · · · · · · · · · · ·	POST SPACING	LOAD CAPACITY		
3000 PSI	5 IN.	4 IN.	36 IN.	80.0 PSF		
			42 IN.	70.0 PSF		
			48 IN.	60.0 PSF		
	6 IN.	4 IN.	36 IN.	95.0 PSF		
			42 IN.	84.0 PSF		
			48 IN.	72.0 PSF		
		4 IN.	36 IN.	110.0 PSF		
	5 IN.		42 IN.	93.0 PSF		
4000 PSI			48 IN.	82.0 PSF		
4000 PSI		4 IN.	36 IN.	110.0 PSF		
E	6 IN.		42 IN.	110.0 PSF		
			48 IN.	100.0 PSF		
	5 IN.	4 IN.	36 IN.	110,0 PSF		
5000 PSI			42 IN.	110.0 PSF		
			48 IN.	100.0 PSF		
	6 IN.	4 IN.	36 IN.	110.0 PSF		
			42 IN,	110.0 PSF		
			48 IN.	107.0 PSF		
5000 PSI	5 IN.	4-1/4 IN.	36 IN.	110.0 PSF		
			42 IN.	110.0 PSF		
			48 IN.	100.0 PSF		
	6 IN.	41/4 IN.	36 IN.	110.0 PSF		
			42 IN.	110.0 PSF		
			48 IN.	110.0 PSF		

# \* INSTRUCTIONS: USE CHARTS AS FOLLOWS.

STEP 1 DETERMINE DESIGN WIND LOAD REQUIREMENTS BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.

STEP 2 USE POST PERFORMANCE CHART TO VERIFY POST CAPACITY FOR THE REQUIRED DESIGN LOAD.

STEP 3 USE POST EMBEDMENT CHART TO CHECK POST SPACING AND REQUIRED EMBEDMENT.

STEP 4 THE LOWER VALUE RESULTING FROM STEPS 2 AND 3 SHALL APPLY TO ENTIRE SYSTEM.

#### SERIES MG2530

# ALUMINUM GLASS RAILING SYSTEM

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE HIGH VELOCITY HURRICANE ZONE (HVHZ) FLORIDA BUILDING CODE (FBC) FIFTH EDITION (2014).


DESIGN CRITERIA FOR ALUMINUM, MINIMUM MECHANICAL PROPERTIES AND SAFETY FACTORS ARE IN ACCORDANCE WITH THE "ALUMINUM CONSTRUCTION MANUAL" LATEST EDITION.

ALUMINUM ALLOYS: ALL EXTRUSIONS SHALL BE ALLOY AS SHOWN.

ALL FASTENERS TO BE NON-MAGNETIC STAINLESS STEEL.

ANCHORING OR LOADING CONDITIONS OTHER THAN THOSE SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE.



Approved as complying with the Florida Building Code
Date 03/26/20/5
NOAW/A - 1023.02
Miami Dade Product Control

MR. GLASS DOORS & V 7440 N.W. 66 STREET MIAMI, FL. 33166
TEL (305) 470-8284 FAX. 0 **€**2 drawing no. 14-04 sheet 1 of 4

CORPORATION
DUCT DEVELOPMENT

AL-FAROOQ COF ENGINEERS & PRODUCT I 1235 S.W. 87 AVE MIAMI, FLORIDA 33174 TEL. (305) 2648100

NC.

WINDOWS

GLASS

