



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

K P Building Products, Inc.
402 Boyer Street
Williston, VT 05495

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Vinyl PVC Soffit with 1/2" and 3/4" J-Channel

APPROVAL DOCUMENT: Drawing No. **KPBP0002**, titled "Vinyl PVC Soffit with 1/2" and 3/4" J-Channel", sheets 1 through 6 of 6, dated 09/22/2010, with revision B dated 10/29/2014, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each piece shall bear a permanent label marked at not more than 4' o.c. with KP, Acton, Ontario, Canada or Holly Springs, MS and following statement: "Miami-Dade County Product Control Approved" or "MDCPCA and on soffit packaging it shall state: Manufacturer name, city, state, model number/name, NOA number, TAS 202/TAS 203, net free area (if applicable) and the following statement: "Miami-Dade County Product Control Approved" per FBC 1715.9.3.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 12-0113.03 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.



[Signature]
102/19/2015

NOA No. 14-1112.07
Expiration Date: November 11, 2015
Approval Date: February 26, 2015
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **KBP0002**, titled "Vinyl PVC Soffit with 1/2" and 3/4" J-Channel", sheets 1 through 6 of 6, dated 09/22/2010, with revision B dated 10/29/2014, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.

B. TESTS *"Submitted under NOA # 10-1012.07"*

	Test Report No.	Standard	Date	Signature
1.	98588.01-109-18	TAS 202 and 203	06/15/10	Michael D. Stremmel, P.E.
2.	98584.01-109-18	TAS 202 and 203	06/14/10	Michael D. Stremmel, P.E.
3.	94119.01-106-18	ASTM D3679, D4226, D696, D2457, D2244, D1929, D2843 and D635	06/01/10	Joseph A. Reed, P.E.

"Submitted under NOA # 03-0303.12"

4. RAD 2132 ASTM G26 & D638 12/1998 R. F. Tucker, P.E.

C. CALCULATIONS *"Submitted under NOA # 10-1012.07"*

1. Anchor verification calculations, complying with FBC-2007, prepared by PTC, LLC, dated 09/22/2010, signed and sealed by Robert J. Amoruso, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of code conformance with the 5th edition FBC and of no financial interest, dated 10/29/2014, signed and sealed by Robert J. Amoruso, P.E.

"Submitted under NOA # 12-0113.03"

2. Statement letter of code conformance with FBC 2010 and no financial interest, dated 01/10/2012, signed and sealed by Robert J. Amoruso, P.E.


02/19/2015

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 14-1112.07
Expiration Date: November 11, 2015
Approval Date: February 26, 2015

KP BUILDING PRODUCTS

VINYL PVC SOFFIT WITH 1/2" & 3/4" J-CHANNEL

INSTALLATION ANCHORAGE DETAILS

GENERAL NOTES:

1. THIS PRODUCT HAS BEEN TESTED AND DESIGNED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE (FBC) INCLUDING THOSE SECTIONS OF THE FBC PERTAINING TO THE HIGH VELOCITY HURRICANE ZONE (HVHZ) AT THE DESIGN PRESSURE(S) STATED HEREIN. THE PRODUCT WAS TESTED TO TAS 202 AND TAS 203. IMPACT TESTING TO TAS-201 IS NOT REQUIRED FOR SOFFIT. STRUCTURAL TEST RESULTS BASED ON TAS 202 WERE DIVIDED BY 1.5 AS REQUIRED BY THE CURRENT EDITION OF THE FLORIDA BUILDING CODE.
2. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED ARCHITECTURAL TESTING REPORT #98588.01-109-18 AND #98584.01-109-18, INCLUDING ASSOCIATED LABORATORY STAMPED DRAWINGS.
3. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE, MASONRY AND WOOD FRAMING COMPRISING THE ATTACHMENT SUBSTRATE FOR THE SOFFIT SHALL BE DETERMINED TO BE CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THAT STRUCTURE AND IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD FOR THE PROJECT.
4. OVERHANG RECEIVING VINYL SOFFIT SHALL BE CHECKED FOR STRUCTURAL INADEQUACY, CRACKS OR DEFECTS THAT SHALL BE ELIMINATED.
5. INSTALLATION OF SOFFIT ACCESSORIES AND ACCESSORIES SUCH AS CORNER POSTS, STARTER STRIPS, AND TRIM AROUND OPENINGS SHALL BE DONE IN ACCORDANCE WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE AND THE MANUFACTURER'S INSTRUCTIONS.
6. SITE CONDITIONS THAT DEVIATE FROM THE DETAILS OF THIS DRAWING REQUIRE FURTHER ENGINEERING EVALUATION BY A LICENSED ENGINEER OR REGISTERED ARCHITECT.
7. LABELED IN ACCORDANCE WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE.

INSTALLATION NOTES:

1. ANCHORS SHALL BE THE TYPE, SIZE, EMBEDMENT AND EDGE DISTANCE SHOWN HEREIN FOR RESPECTIVE SUBSTRATE.
2. INSTALLATION ANCHORS SHALL BE AS SHOWN ON THE "FURRING INSTALLATION" AND "SOFFIT INSTALLATION" SECTIONS ON SHEETS 3 THROUGH 6.
3. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES (INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING).
4. FOR CONCRETE BLOCK, DO NOT INSTALL INSTALLATION ANCHORS INTO MORTAR JOINTS. EDGE DISTANCE IS MEASURED FROM FREE EDGE OF BLOCK OR EDGE OF MORTAR JOINT INTO FACE SHELL OF BLOCK.
5. ALL FASTENERS SHALL HAVE CORROSION RESISTANT COATINGS OR MADE OF CORROSION RESISTANT MATERIALS COMPATIBLE WITH THE SUBSTRATE MATERIALS.

VINYL SOFFIT SPECIFICATIONS:

1. KP BUILDING PRODUCTS VINYL SOFFIT IS MANUFACTURED FROM A FORMULATED PVC POWDER COMPOUND MEETING THE SPECIFICATIONS OF ASTM D3679.
2. 12" BRUSHED SOFFIT - SOLID
 - 2.1. WALL THICKNESS: 0.038"
 - 2.2. PANEL LENGTHS: 12' - 0" LONG
 - 2.3. 1/2" J-CHANNEL THICKNESS: 0.042"
 - 2.4. NET FREE AREA: NOT APPLICABLE AS SOFFIT IS SOLID.
4. 10" I-SPAN SOFFIT (D5) - SOLID
 - 4.1. WALL THICKNESS: 0.046"
 - 4.2. PANEL LENGTHS: 12' - 0" LONG
 - 4.3. 3/4" J-CHANNEL THICKNESS: 0.042"
 - 4.4. NET FREE AREA: NOT APPLICABLE AS SOFFIT IS SOLID.

BILL OF MATERIALS

ITEM	DESCRIPTION	MATERIAL
1	10" I-SPAN SOFFIT W/ 3/4" J CHANNEL	VINYL (PVC)
2	12" WOODGRAIN PLAIN SOFFIT W/ 1/2" J CHANNEL	VINYL (PVC)
3	NOT USED	
4	1/2" J-CHANNEL OR 3/4" J-CHANNEL (SEE ITEM 1 & 2)	VINYL (PVC)
5	0.12" SHANK DIAMETER X 1-1/2" LONG ROOFING NAIL WITH 3/8" DIA. HEAD OF SUFFICIENT LENGTH TO ACHIEVE 1" MINIMUM EMBEDMENT TO ATTACH TO FURRING STRIP.	STEEL
6	0.148" SHANK DIAMETER COMMON NAIL OF SUFFICIENT LENGTH TO ACHIEVE 1-1/2" MIN. EMBEDMENT USED TO ATTACH FURRING STRIP TO FURRING STRIP & 1-3/4" MIN. EMBEDMENT USED TO ATTACH FURRING STRIP TO WOOD STRUCTURE.	STEEL
7	3/16" ITW ATT TAPCON OF SUFFICIENT LENGTH TO ACHIEVE A MINIMUM OF 1-1/2" EMBEDMENT & 1-1/2" EDGE DISTANCE IN CONCRETE OR 1" EMBEDMENT & 2" EDGE DISTANCE IN MASONRY (CBS) SUBSTRATE.	STEEL

TABLE OF CONTENTS

SHEET NO.	DESCRIPTION
1	GENERAL NOTES, B.O.M. AND D.P. CHART
2	APPROVED SOFFIT PROFILES
3	FURRING INSTALLATION UP TO 12" DEEP OVERHANG
4	FURRING INSTALLATION UP TO 24" DEEP OVERHANG
5	SOFFIT INSTALLATION UP TO 12" DEEP OVERHANG
6	SOFFIT INSTALLATION UP TO 24" DEEP OVERHANG

DESIGN PRESSURE (PSF) RATING

SOFFIT MODEL	DESIGN PRESSURE (PSF)
10" I-SPAN SOFFIT W 3/4" J CHANNEL	+66.7 psf -33.3 psf
12" WOODGRAIN PLAIN SOFFIT W 1/2" J CHANNEL	+66.7 psf -33.3 psf

PROJECT #414-0801				
B	Update to 5th Edition (2014) Florida Building & Residential Codes	10/29/14	RJA	TJH
A	UPDATE TO 2010 FBC	12/27/11	REV	DATE
REV	DESCRIPTION	DATE	BY	BY

KP BUILDING PRODUCTS
402 BOYER CIRCLE
WILLISTON, VT 05495

VINYL PVC SOFFIT WITH 1/2" AND 3/4" J-CHANNEL
GENERAL NOTES, B.O.M. AND D.P. CHART


DATE: 09/22/10
DRAWING NO: KPBP0002
SCALE: N.T.S.
SHEET: 1 OF 6


PREPARED BY: RJA
DRAWN BY: N.T.S.
REV: B

PFC, LLC
 P.O. Box 530775
 Longwood, FL 32756-0775
 Phone: 321.980.1788
 Fax: 321.980.1789
 Email: info@kp-building.com


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-1112.07
Expiration Date 11/17/2015

By: *[Signature]*
Miami Dade Product Control

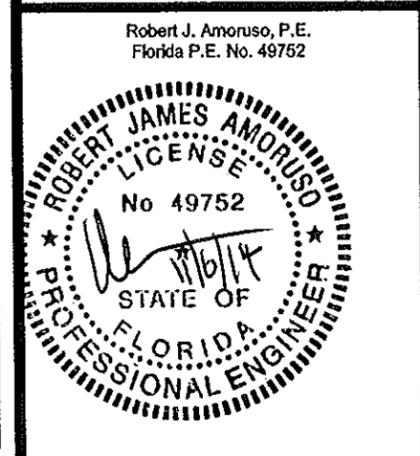


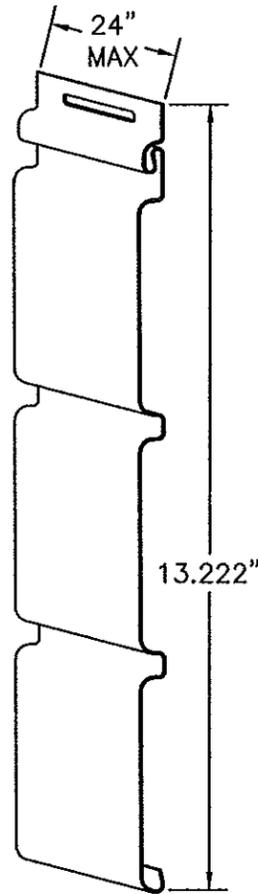


12" BRUSHED SOFFIT - SOLID
(MAX 24" AS SOFFIT)

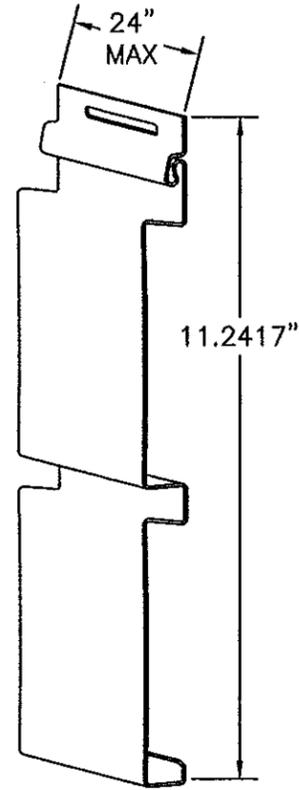

10" I-SPAN SOFFIT - SOLID (D5)
(MAX 24" AS SOFFIT)

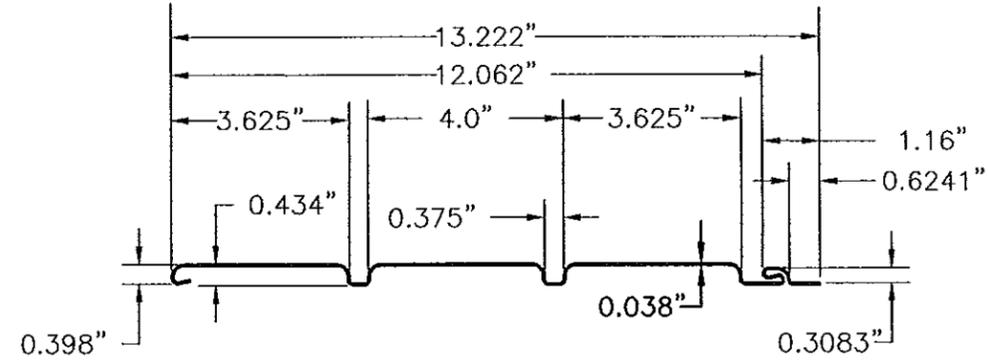

12" BRUSHED SOFFIT - SOLID
0.036" WALL x 12-0" LONG PANEL
▲

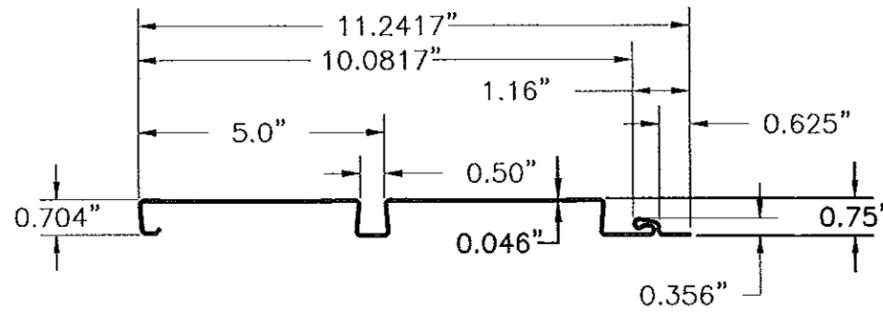


10" I-SPAN SOFFIT - SOLID (D5)
0.046" WALL x 12-0" LONG PANEL
▲

PROJECT #414-0801		DATE	BY
Update to 5th Edition (2014)	10/29/14	RJA	TJH
Florida Building & Residential Codes			
REV	DESCRIPTION	DATE	BY
B	UPDATE TO 2010 FBC	12/27/11	TJH
A			

KP BUILDING PRODUCTS 402 BOYER CIRCLE WILLISTON, VT 05495		DATE:	09/22/10
TITLE: VINYL PVC SOFFIT WITH 1/2" AND 3/4" J-CHANNEL APPROVED SOFFIT PROFILES		DRAWN BY:	RJA
PREPARED BY:		SCALE:	N.T.S.
P.T.C. LLC P.O. Box 520776 Longwood, FL 32752-0776 Phone: 321.690.1788 Fax: 321.690.1789 Email: info@ptc-corp.com		DRAWING NO.:	KPBP0002
		REV:	B
		SHEET:	2 OF 6

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-1112.07
Expiration Date 11/11/2015
By [Signature]
Miami Dade Product Control


Robert J. Amoroso, P.E.
Florida P.E. No. 49752

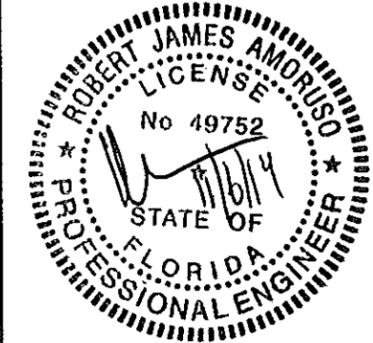

APPROVED SOFFIT PROFILE DIMENSIONS

See Sheet 1, Vinyl Soffit Specifications

FURRING INSTALLATION FOR UP TO 12" DEEP ROOF OVERHANG

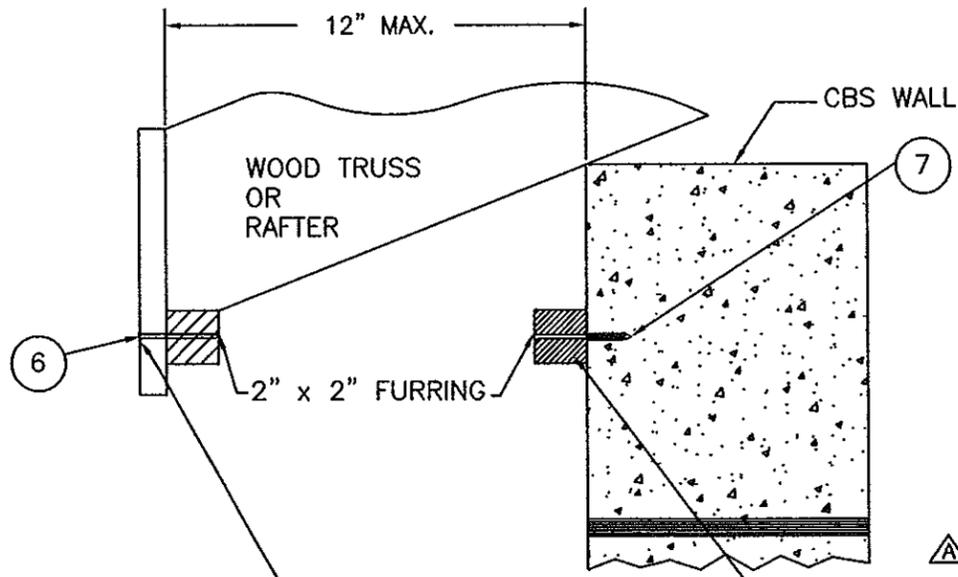


ATTACH FURRING TO FASCIA
USING 0.148" DIA. COMMON NAILS
@ 12" O.C. MAX. W/1.5" MIN. EMB.

2" x 2" S.Y.P. OR GREATER FURRING
STRIP SECURED TO CONCRETE OR CBS WALL USING
3/16" DIA. TAPCON WITH 1.5" MINIMUM EMBEDMENT
INTO CONCRETE OR 1" INTO CBS WALL
12" O.C. MAX.

FURRING INSTALLATION ON A CBS OVERHANG

ATTACH FURRING TO FASCIA
USING 0.148" DIA. COMMON NAILS
@ 12" O.C. MAX. W/1.5" MIN. EMB.

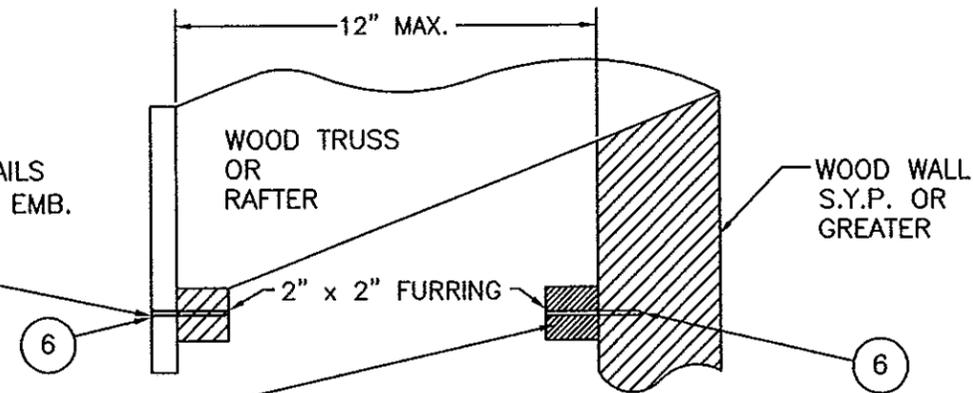

2" x 2" S.Y.P. OR GREATER FURRING
STRIP SECURED TO WOOD WALL USING
0.148" DIA. COMMON NAIL OF SUFFICIENT
LENGTH TO ACHIEVE 1.75" MIN.
EMBEDMENT 12" O.C. MAX.

FURRING INSTALLATION ON A WOOD OVERHANG


PROJECT #414-0801		DATE	BY
Update to 5th Edition (2014) Florida Building & Residential Codes	10/29/14	RJA	TJH
B	A	UPDATE TO 2010 FBC	12/27/11
REV	DESCRIPTION	DATE	BY
KP BUILDING PRODUCTS 402 BOYER CIRCLE WILLISTON, VT 05495		DATE: 09/22/10	DRAWING NO: KPBP0002
TITLE: VINYL PVC SOFFIT WITH 1/2" AND 3/4" J-CHANNEL FURRING INSTALLATION UP TO 12" DEEP OVERHANG		SCALE: N.T.S.	SHEET: 3 OF 6
DRAWN BY: RJA	SCALE: N.T.S.	REV: B	SHEET: 3 OF 6
PREPARED BY:		P.T.C. LLC P.O. Box 620775 Longwood, FL 32750-0775 Phone: 321.680.1788 Fax: 321.680.1789 Email: info@ptc-usa.com	

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-1112-07
Expiration Date 11/11/2015
By *[Signature]*
Miami Dade Product Control


Robert J. Amoruso, P.E.
Florida P.E. No. 49752



FURRING INSTALLATION FOR UP TO 24" DEEP ROOF OVERHANG

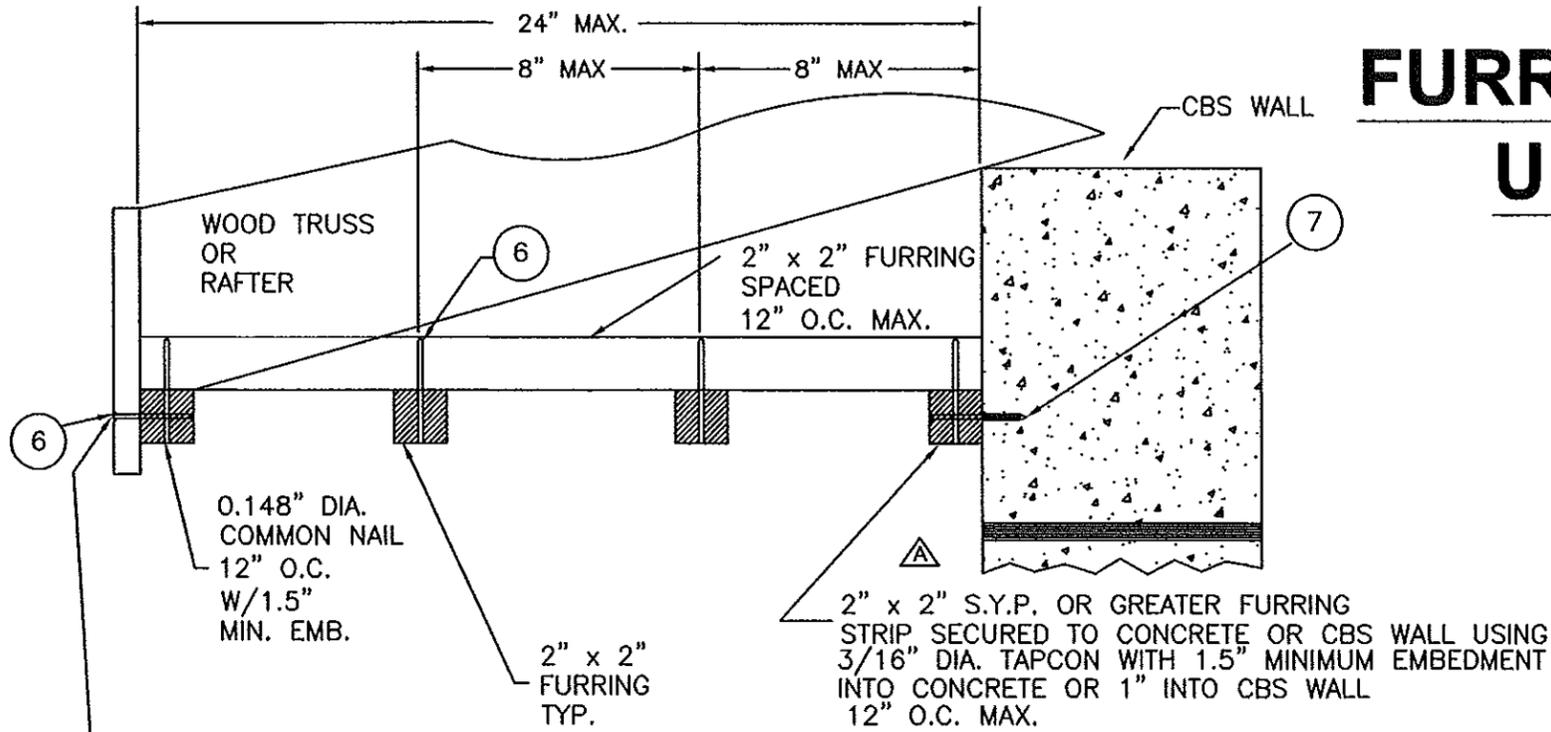

FURRING INSTALLATION ON A CBS OVERHANG

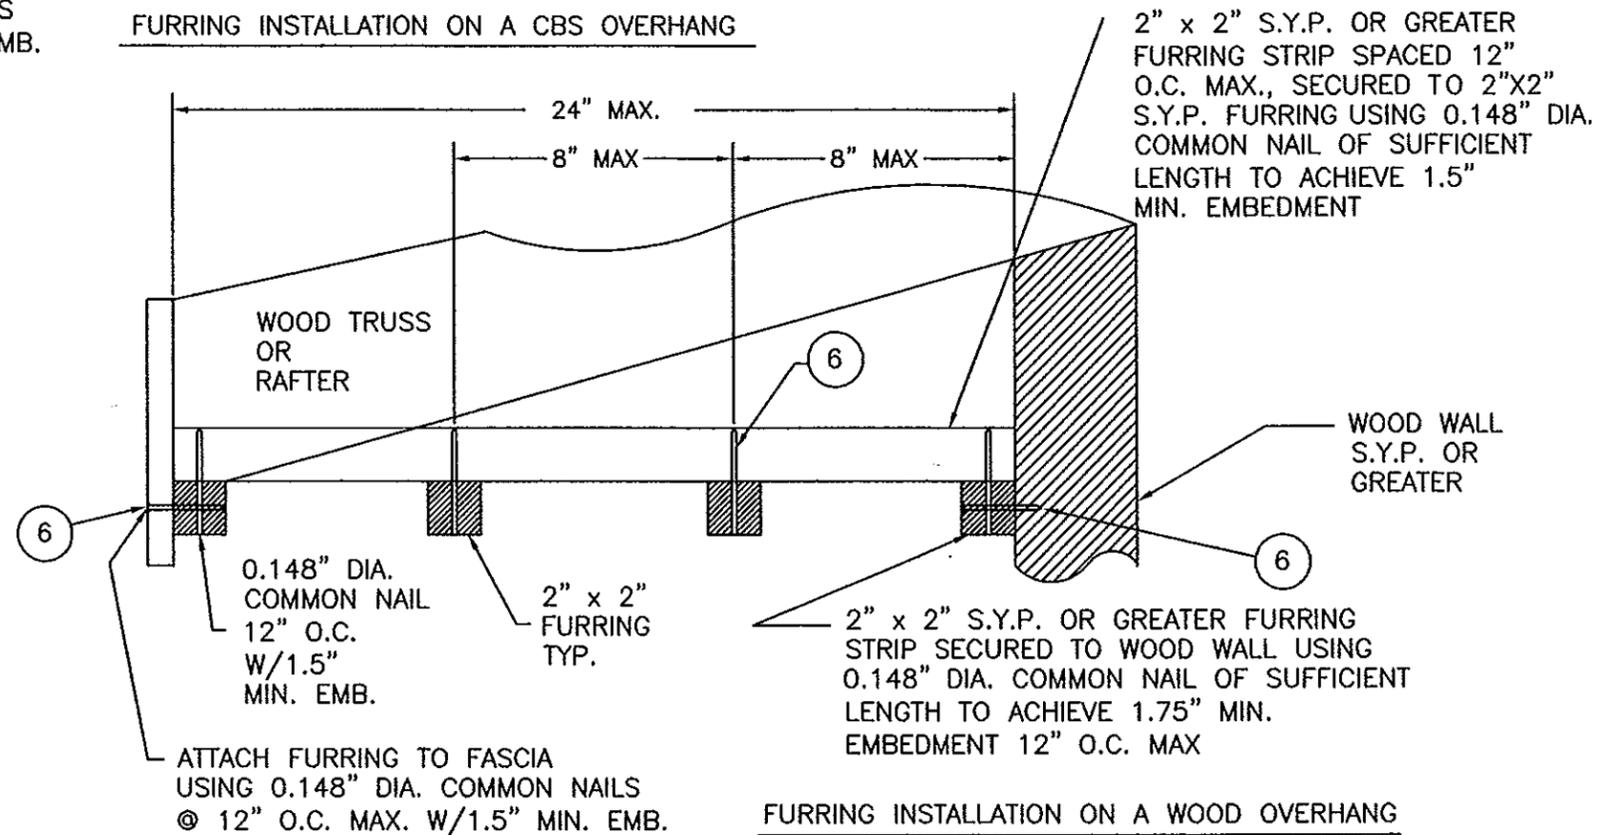


FURRING INSTALLATION ON A WOOD OVERHANG

PROJECT #414-0801		Update to 5th Edition (2014)	RJA	TJH	BY
		Florida Building & Residential Codes	10/29/14		DATE
				A	REV
				12/27/11	DATE
					DESCRIPTION
KP BUILDING PRODUCTS 402 BOYER CIRCLE WILLISTON, VT 05495		VINYL PVC SOFFIT WITH 1/2" AND 3/4" J-CHANNEL FURRING INSTALLATION UP TO 24" DEEP OVERHANG	DATE: 09/22/10	DRAWING NO: KPBP0002	SHEET: 4 OF 6
PREPARED BY: RJA	SCALE: N.T.S.	REV: B			
PTC, LLC P.O. Box 620776 Longwood, FL 32755-0776 Phone: 321.690.1788 Fax: 321.690.1789 Email: info@ptc-corp.com					

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 14-112-07
Expiration Date 11/11/2015
By *[Signature]*
Miami Dade Product Control

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

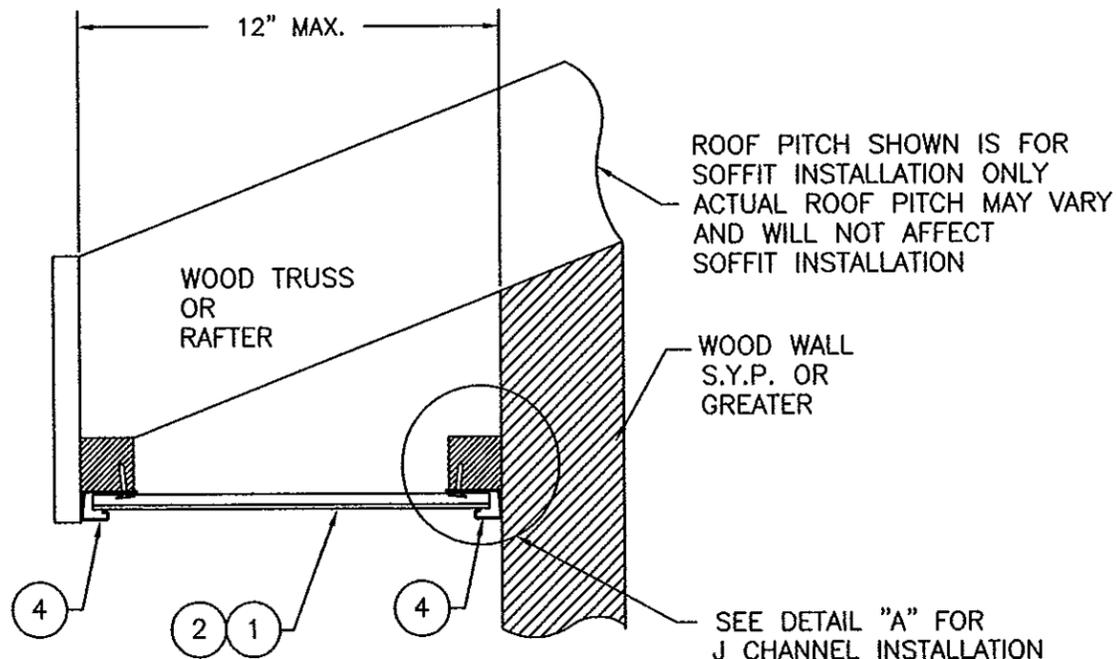


ROOF PITCH SHOWN IS FOR SOFFIT INSTALLATION ONLY
ACTUAL ROOF PITCH MAY VARY
AND WILL NOT AFFECT
SOFFIT INSTALLATION

WOOD WALL
S.Y.P. OR
GREATER

SEE DETAIL "A" FOR
J CHANNEL INSTALLATION
SEE DETAIL "B" FOR
SOFFIT INSTALLATION
SEE DETAIL "C" FOR
FURRING INSTALLATION.

FURRING INSTALLATION ON A WOOD OVERHANG
FOR FURRING INSTALLATION SEE SHEET 3

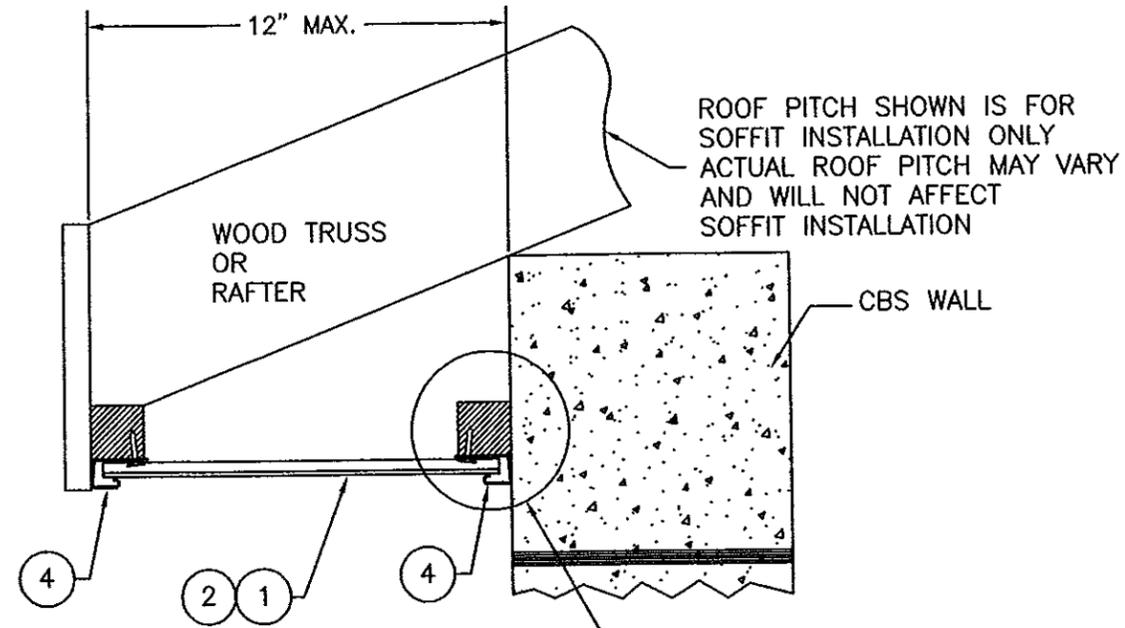


ROOF PITCH SHOWN IS FOR SOFFIT INSTALLATION ONLY
ACTUAL ROOF PITCH MAY VARY
AND WILL NOT AFFECT
SOFFIT INSTALLATION

CBS WALL

FURRING INSTALLATION ON A CBS OVERHANG
FOR FURRING INSTALLATION SEE SHEET 3


SEE DETAIL "A" FOR
J CHANNEL INSTALLATION
SEE DETAIL "B" FOR
SOFFIT INSTALLATION
SEE DETAIL "C" FOR
FURRING INSTALLATION.

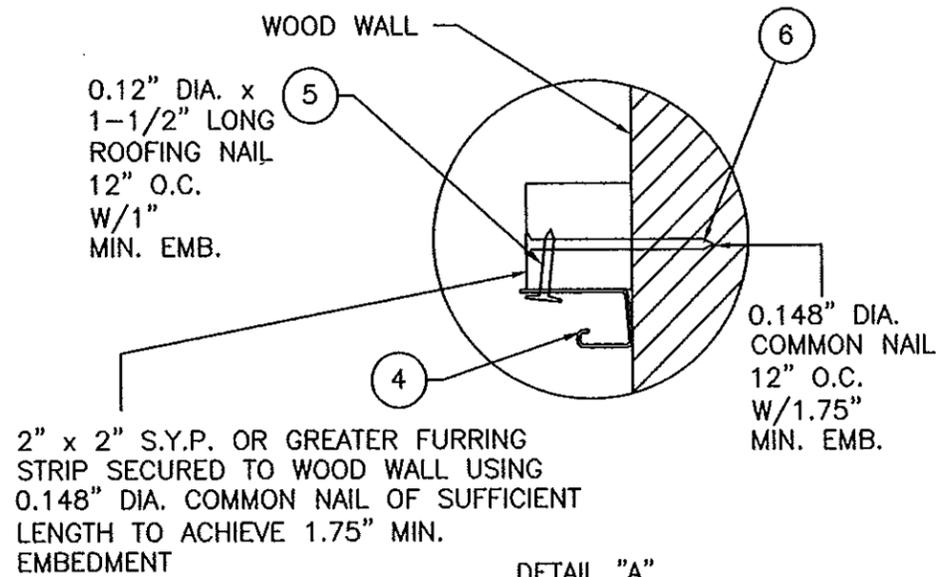

2" x 2" S.Y.P. OR GREATER FURRING
STRIP SECURED TO WOOD WALL USING
0.148" DIA. COMMON NAIL OF SUFFICIENT
LENGTH TO ACHIEVE 1.75" MIN.
EMBEDMENT

DETAIL "A"

J CHANNEL INSTALLATION

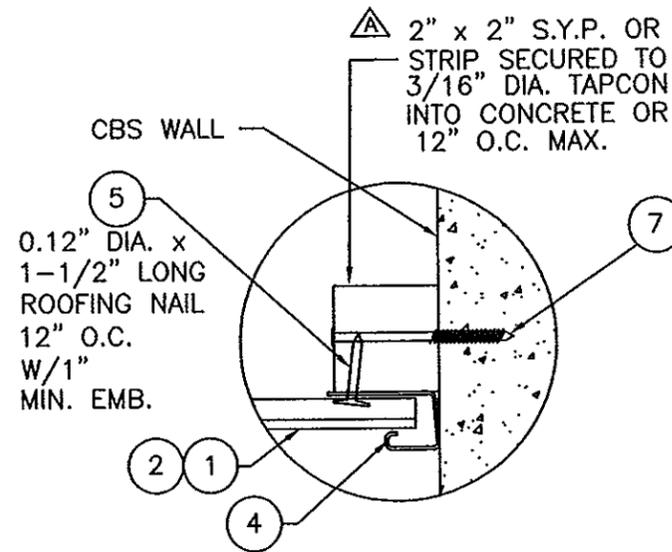

2" x 2" S.Y.P. OR GREATER FURRING
STRIP SECURED TO CONCRETE OR CBS WALL USING
3/16" DIA. TAPCON WITH 1.5" MINIMUM EMBEDMENT
INTO CONCRETE OR 1" INTO CBS WALL
12" O.C. MAX.

DETAIL "B"

SOFFIT INSTALLATION

SOFFIT INSTALLATION FOR UP TO 12" DEEP ROOF OVERHANG

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-112-07
Expiration Date 11/11/2015

By *[Signature]*
Miami Dade Product Control

Robert J. Amoruso, P.E.
Florida P.E. No. 49752



PROJECT #414-0801


		RJA	BY
	Update to 5th Edition (2014) Florida Building & Residential Codes	10/29/14	DATE
B			REV
A	UPDATE TO 2010 FBC	12/27/11	DATE
			DESCRIPTION

KP BUILDING PRODUCTS
402 BOYER CIRCLE
WILLISTON, VT 05495

TITLE: VINYL PVC SOFFIT WITH 1/2" AND 3/4" J-CHANNEL
SOFFIT INSTALLATION UP TO 12" DEEP OVERHANG

PREPARED BY: RJA
DATE: 09/22/10
SCALE: N.T.S.
DRAWING NO: KPBP0002
SHEET: 5 OF 6
REV: B

PTC, LLC
P.O. Box 520775
Largo, FL 32752-0775
Phone: 321.960.1788
Fax: 321.960.1789
Email: info@kpb.com

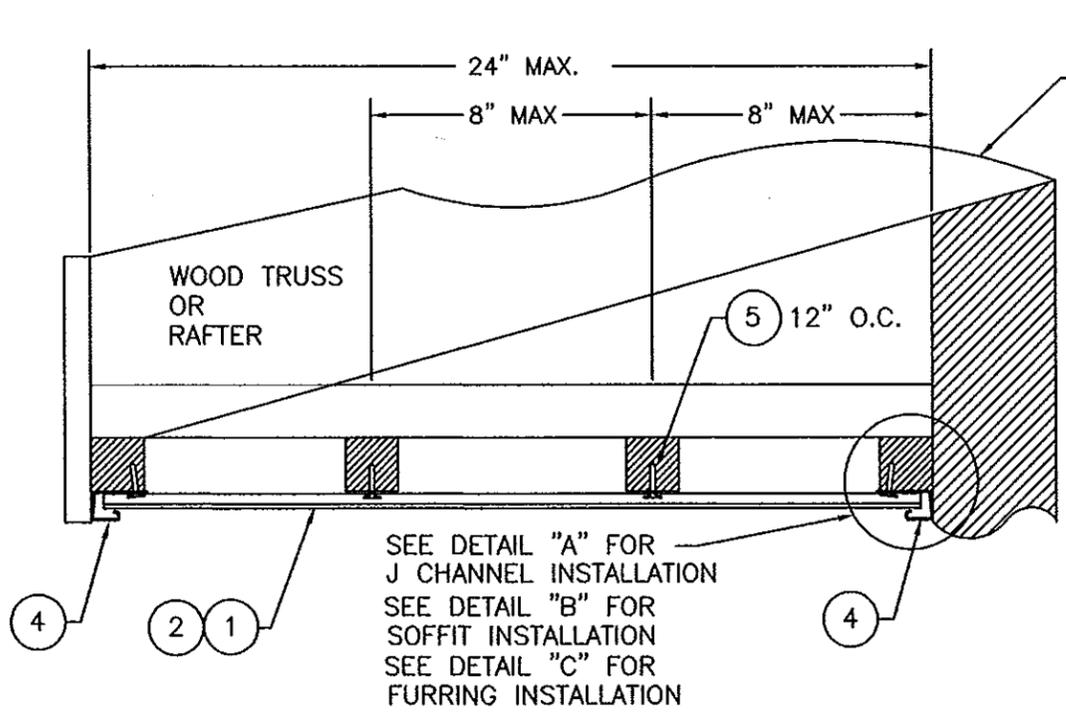



ROOF PITCH SHOWN IS FOR SOFFIT INSTALLATION PURPOSES ONLY
ACTUAL ROOF PITCH MAY VARY
AND WILL NOT AFFECT
SOFFIT INSTALLATION

SOFFIT INSTALLATION FOR UP TO 24" DEEP ROOF OVERHANG

SEE DETAIL "A" FOR
J CHANNEL INSTALLATION
SEE DETAIL "B" FOR
SOFFIT INSTALLATION
SEE DETAIL "C" FOR
FURRING INSTALLATION

TYP. INSTALLATION ON A WOOD OVERHANG
FOR FURRING INSTALLATION SEE SHEET 4

ROOF PITCH SHOWN IS FOR SOFFIT
INSTALLATION PURPOSES ONLY
ACTUAL ROOF PITCH MAY VARY
AND WILL NOT AFFECT
SOFFIT INSTALLATION

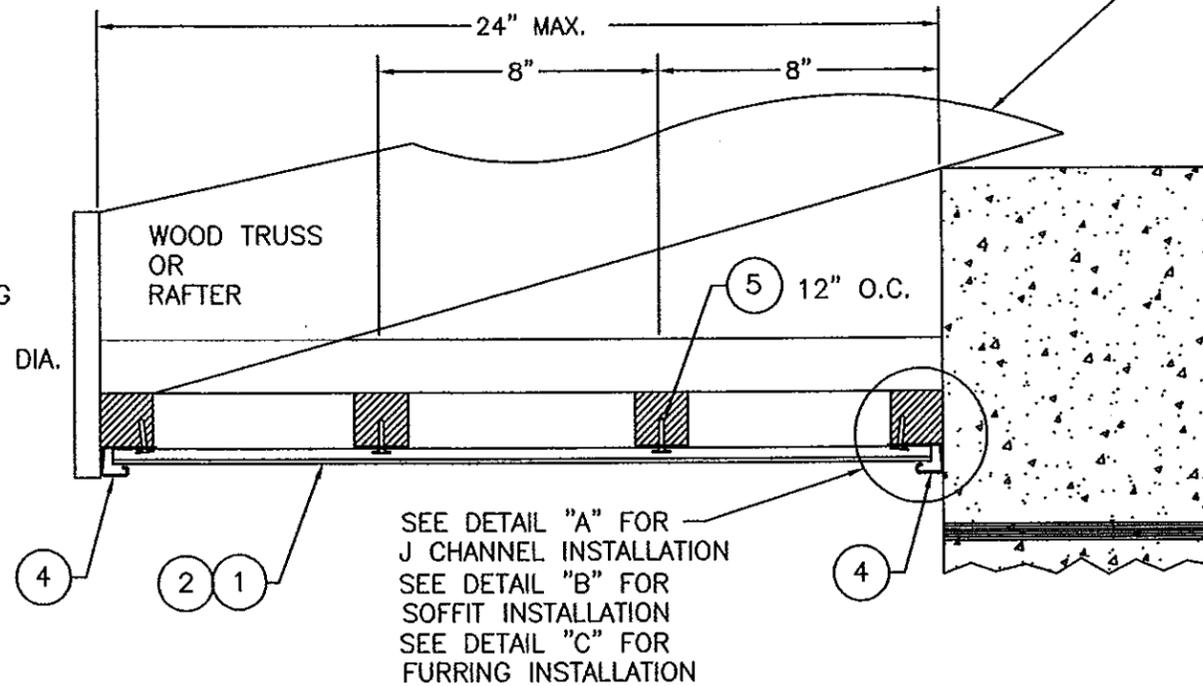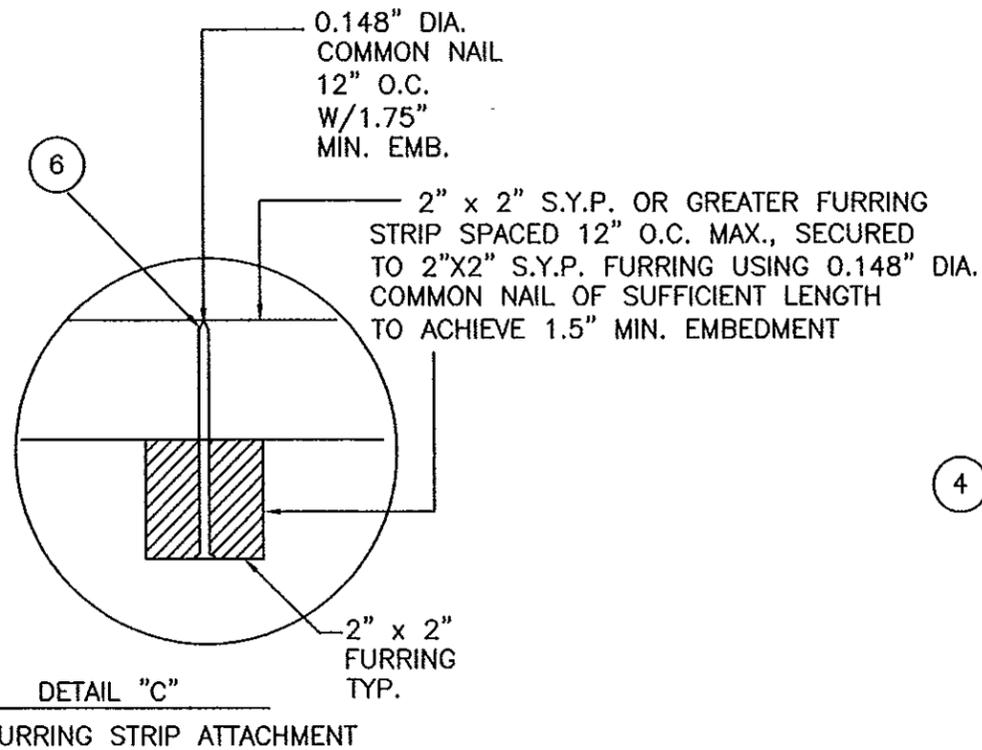

SEE DETAIL "A" FOR
J CHANNEL INSTALLATION
SEE DETAIL "B" FOR
SOFFIT INSTALLATION
SEE DETAIL "C" FOR
FURRING INSTALLATION

TYP. INSTALLATION ON A CBS OVERHANG
FOR FURRING INSTALLATION SEE SHEET 4

PROJECT #414-0801		DATE	BY
Update to 5th Edition (2014) Florida Building & Residential Codes	RJA	10/29/14	TJH
B	A	UPDATE TO 2010 FBC 12/27/11	REV
DESCRIPTION		DATE	BY

KP BUILDING PRODUCTS 402 BOYER CIRCLE WILLISTON, VT 05495	DATE:	09/22/10
	DRAWING NO.:	KPBP0002
TITLE: VINYL PVC SOFFIT WITH 1/2" AND 3/4" J-CHANNEL SOFFIT INSTALLATION UP TO 24" DEEP OVERHANG	DRAWN BY:	RJA
	SCALE:	N.T.S.
PREPARED BY:	DATE:	09/22/10
	SCALE:	N.T.S.
	REV:	B
	SHEET:	6 OF 6

Phone: 321.660.1786
Fax: 321.660.1789
P.O. Box 520775
Longwood, FL 32750-0775
Email: info@kpbuilding.com
FBI# Cert. of Auth. No. 2585

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 14-1112.07
Expiration Date 11/11/2015
By: *[Signature]*
Miami Dade Product Control

Robert J. Amoruso, P.E.
Florida P.E. No. 49752

