



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Thybar Corporation
913 South Kay Avenue
Addison, IL 60101

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: TC-5 Style Steel Roof-Curb for Carrier Rooftop Units

APPROVAL DOCUMENT: Drawing No. RC07653, titled "Roof curb by Thybar Corporation", sheets 1 through 5 of 5, prepared by Paul Selman, P.E., dated October 07, 2009, last revision #4 dated May 15, 2013, signed and sealed by Paul Selman, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each roof-curb shall bear a permanent label with the manufacturer's name or logo, Addison IL, Akron OH, Louisville KY, Dallas TX, or Reno NV and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews NOA # 12-0828.01 and consists of this page 1, evidence submitted pages E-1 & E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



Helmy A. Makar
03/12/2015

NOA No. 15-0218.11
Expiration Date: 02/03/2020
Approval Date: 03/12/2015
Page 1

Thybar Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 09-0416.04

A. DRAWINGS

1. *Drawing No. RC07653, titled "Roofcurb by Thybar Corporation", sheets 1 through 5 of 5, prepared by Paul Selman, P.E., dated April 29, 2009, last revision #1 dated October 28, 2009, signed and sealed by Paul Selman, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *Calculation titled "146 MPH Wind Load Calculation", dated April 14, 2009, sheets 1 through 4 of 4, signed and sealed by Paul J. Selman, P.E.*
2. *Calculation titled "146 MPH Wind Load FBC 2007", dated October 28, 2009, sheets 1 through 35 of 35, signed and sealed by Paul J. Selman, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-0828.01

A. DRAWINGS

1. *Drawing No. RC07653, titled "Roof curb by Thybar Corporation", sheets 1 through 5 of 5, prepared by Paul Selman, P.E., dated October 07, 2009, last revision #4 dated May 15, 2013, signed and sealed by Paul Selman, P.E.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *Calculation titled "Maximum sized Carrier Curb to Structure Bolt Analysis", dated May 16, 2013, one sheet, signed and sealed by Paul J. Selman, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*


Helmy A. Makar, P.E., M.S.

Product Control Unit Supervisor

NOA No. 15-0218.11

Expiration Date: 02/03/2020

Approval Date: 03/12/2015

Thybar Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS


1. *Calculation titled "Maximum sized Carrier Curb to Structure Bolt Analysis", dated May 16, 2013, one sheet, signed and sealed by Paul J. Selman, P.E.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*




Helmy A. Makar, P.E., M.S.
Product Control Unit Supervisor

NOA No. 15-0218.11

Expiration Date: 02/03/2020


Approval Date: 03/12/2015

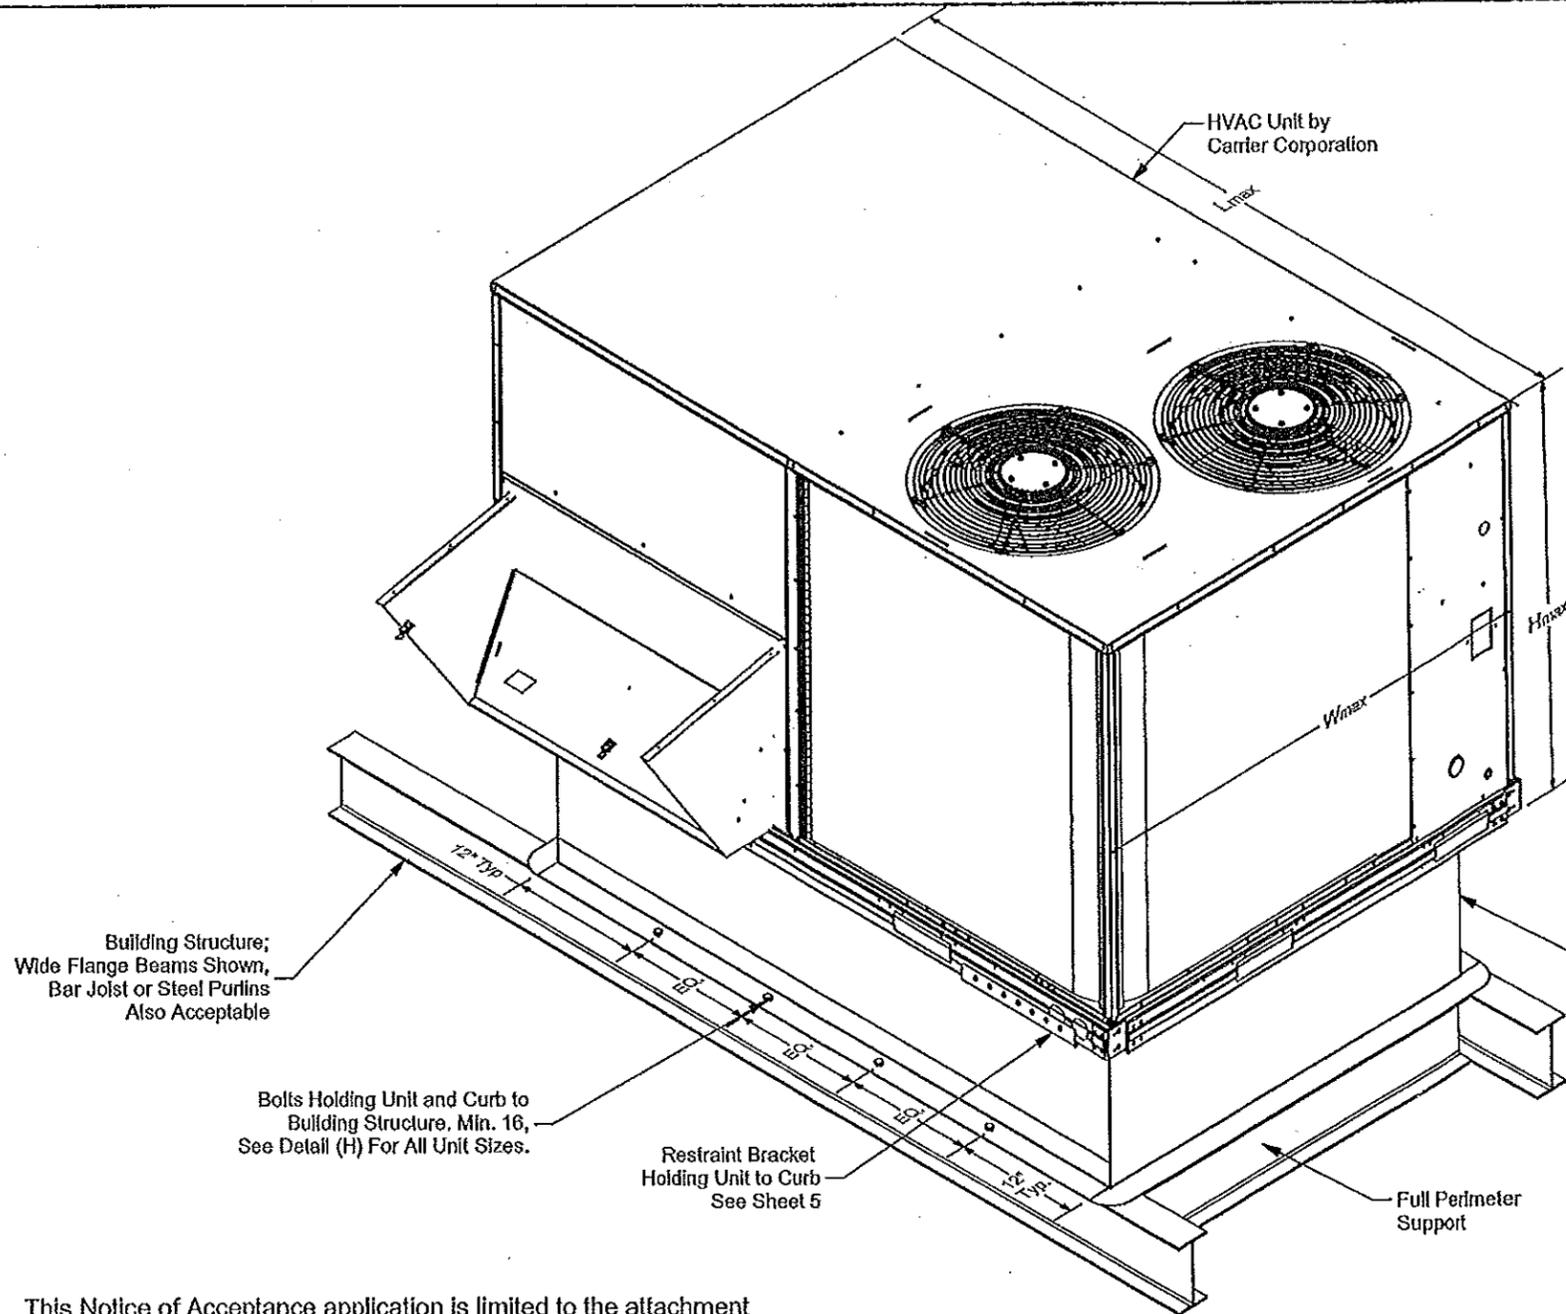

Assembled Isometric View

Unit Dimensions		
Lmax	Wmax	Hmax
157.75"	86.375"	57.375"


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No. 15-0218.11
 Expiration Date 02/03/2020
 By *[Signature]*
 Miami Dade Product Control

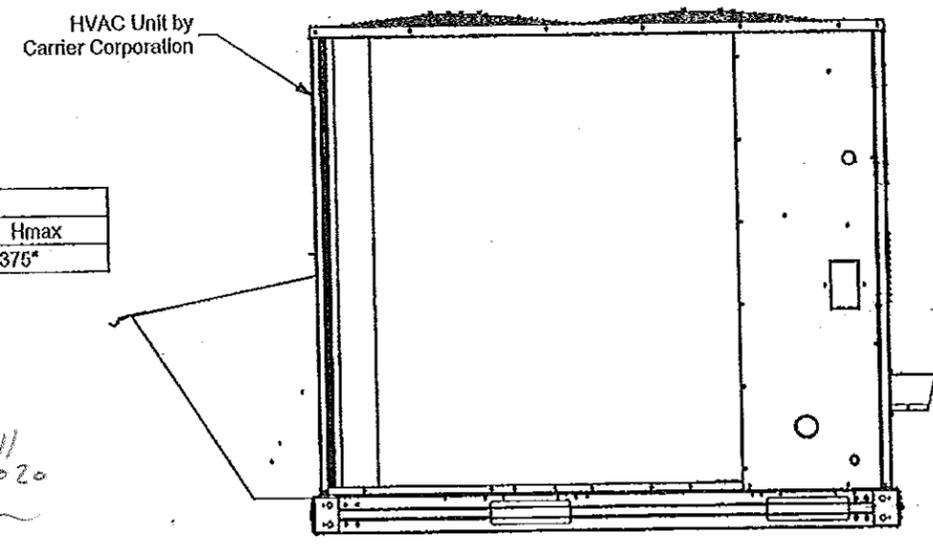

Restraint Bracket Holding Unit to Curb See Sheet 5
 Quantity of restraint brackets to be determined by project specific calculations.
 TEK Screws Holding Curb to Bracket
 TEK Screws Holding Unit to Bracket

Roofcurb by Thybar Corporation See Sheet 2, 3 & 4

Sealing of roofing material to roof curb nailer is not part of this application. Roofing material should be addressed by approved NOA for each project.

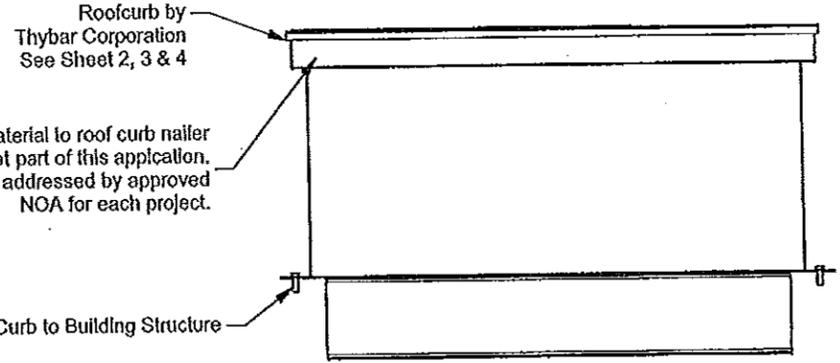

Exploded End View

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No. 12-0828.01
 Expiration Date 02/03/2015
 By *[Signature]*
 Miami Dade Product Control

Nuts & Lock Washers Holding Unit And Curb to Building Structure
 Building Structure; Wide Flange Beams Shown, Bar Joist or Steel Purlins Also Acceptable

This Notice of Acceptance application is limited to the attachment of the HVAC unit to the roof curb, the roof curb itself and the attachment of the roof curb to the roof structure.

Therefore, the restraint system shown in these drawings will be acceptable for all Carrier units with the following model numbers: 48/50XXYY

General Notes:

- 1) These drawings provide a method of attachment so that a Carrier Corporation manufactured HVAC unit will be able to resist the force generated by a wind when the unit is installed on a Thybar Corporation manufactured roofcurb as required by the latest version of the Florida Building Code (FBC).
- 2) The following analysis is being submitted to the Miami-Dade County Product Control Section for review and consideration in assigning a Notice of Acceptance (NOA) for Carrier units installed on Thybar Corporation roofcurbs and restraint brackets.
- 3) The design pressures as determined from Section 1620 of FBC, 2010 Edition and ASCE 7-10 must be multiplied by 0.6

Max lateral pressure 145.7 (psf), Max uplift pressure 70.5 (psf)

Analysis:

- 1) The design wind load for a rooftop-mounted HVAC unit was determined following the requirements of FBC2010 Section 1609.1.1 and Section 29.5 of The American Society of Civil Engineers Standard 7 (ASCE7-10).
- 2) Static analysis was used to ensure that all components between the rooftop-mounted HVAC unit and the building structure are of sufficient strength.
 - a) The load path from the rooftop equipment to the building structure is of sufficient strength to keep the equipment in place while resisting the tension, shear, moment and uplift forces generated by the wind force acting on the rooftop equipment.
 - b) The rooftop unit restraints, the roofcurb wall and the curb attachments to the building structure were all designed and manufactured with the ability to safely transfer the wind-generated force into the building structure.

[Signature]
 Paul Selman, Florida P.E. 65313
 913 S. Kay Avenue
 Addison IL 60101
 05/16/13

REVISION HISTORY			
REV	DESCRIPTION	DATE	REV BY
1	Revised according to H. Makar comments of 10/07/2009	10/7/2009	PJSelman
2	Revised per FBC2010 Requirements	12/10/2012	TAmbrosini
3	Revised according to H. Makar comments of 2/8/2013	2/11/2013	TAmbrosini
4	Revised according to H. Makar comments of 5/14/2013	5/15/2013	TAmbrosini

Thybar Corporation






Qty: _____ Job #: _____ Tag: _____

Dwg. RC07653.ldw By: Vince Cervantes Date: 4/29/2009

RC07653

ThyCurb

Sheet 1 of 5

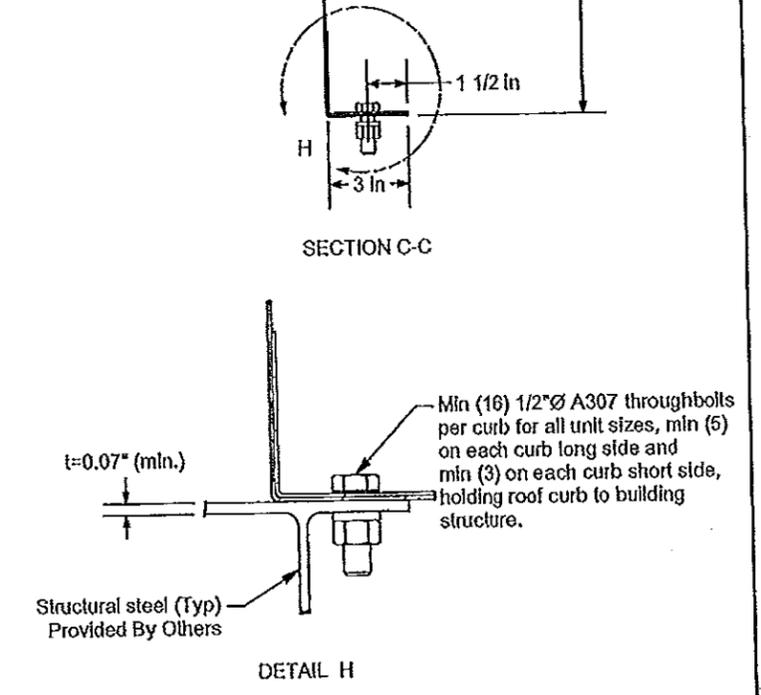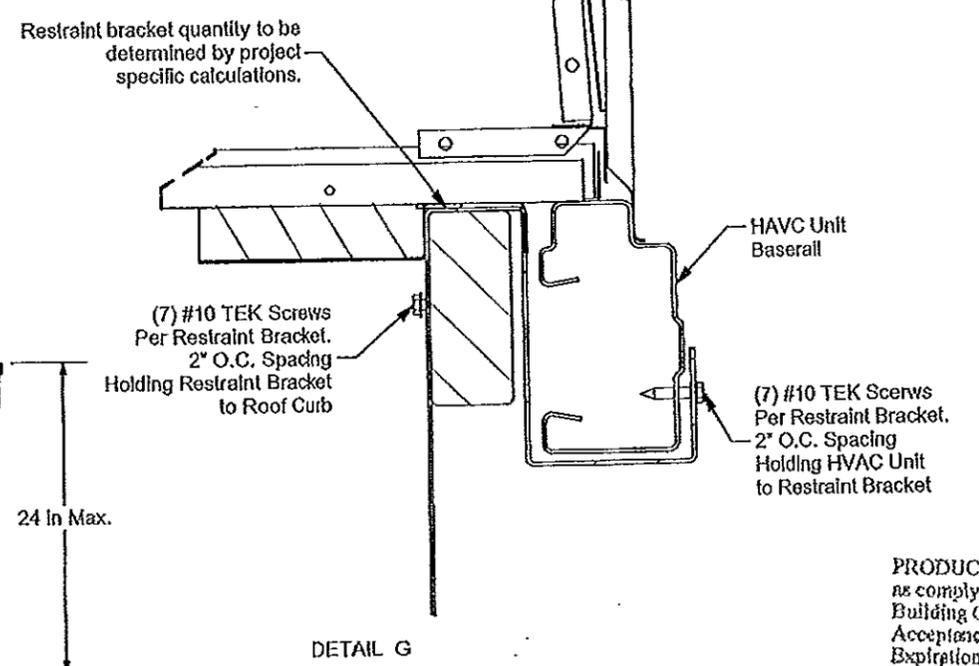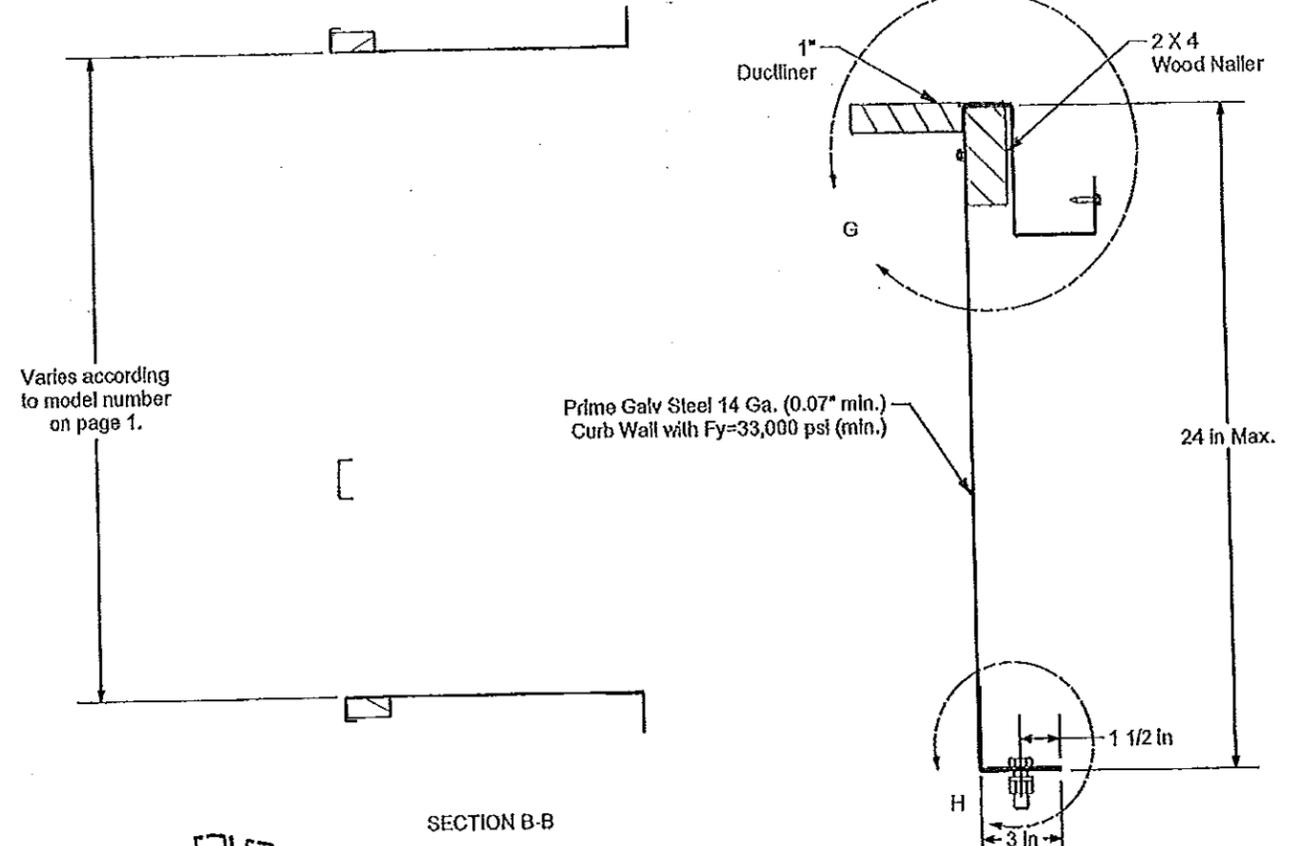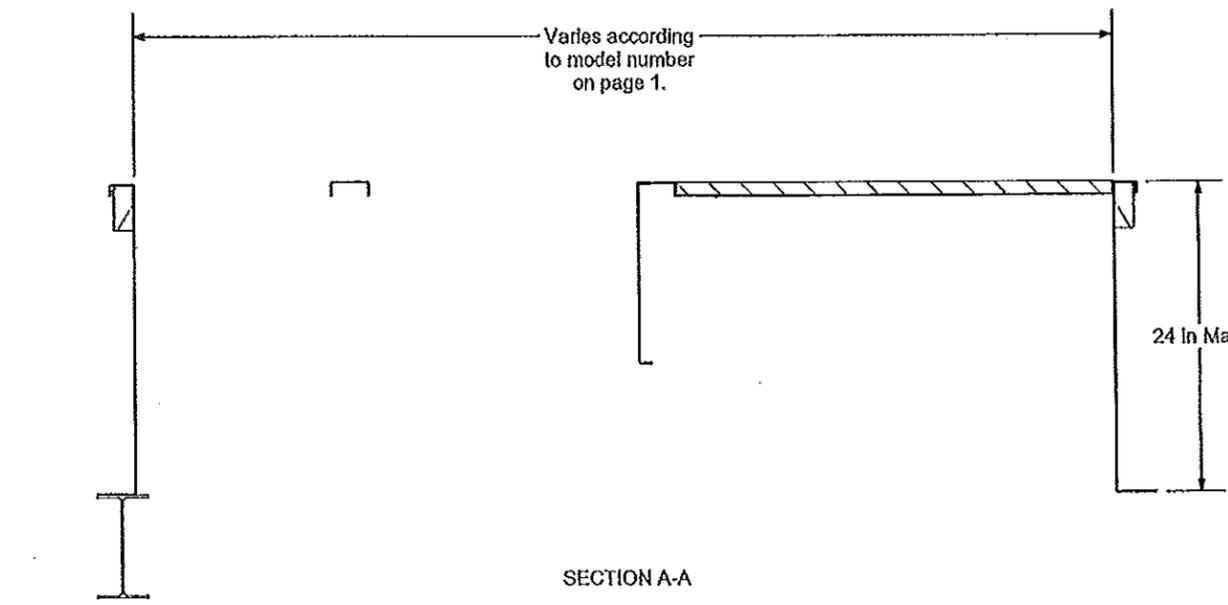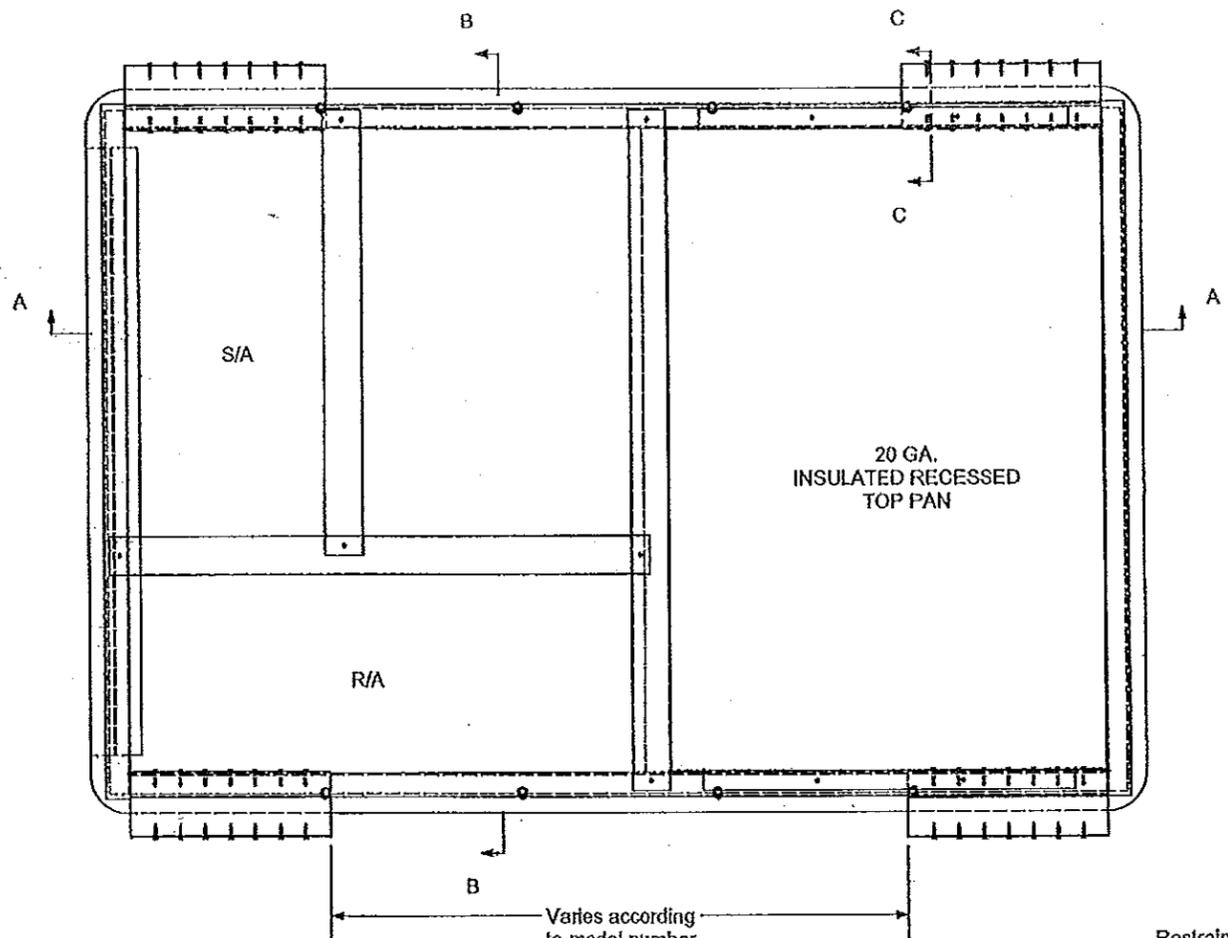


PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0828.01
 Expiration Date 02/03/2015
 By *Heidi A. Miller*
 Miami Dade Product Control

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 15-0218.11
 Expiration Date 02/03/2020
 By *Heidi A. Miller*
 Miami Dade Product Control

Paul Selman
 Paul Selman Florida P.E. 65313
 913 S. Kay Avenue
 Addison IL 60101 05/16/13

Thybar Corporation			
Qty:	Job #:	Tag:	
Dwg. RC07653.idw	By: Vince Cervantes	Date: 4/29/2009	
RC07653			ThyCurb
			Sheet 2 of 5

Part	Qty	Part Number	Description	Material
01	1	RC07653-01	Curb Wall 1	Prime Galv Steel 14 Ga.
02	1	RC07653-02	Curb Wall 2	Prime Galv Steel 14 Ga.
03	1	RC07653-03	Curb Wall 3	Prime Galv Steel 14 Ga.
04	1	RC07653-04	Curb Wall 4	Prime Galv Steel 14 Ga.
05	2	RC07653-05	Angle, Windload	Prime Galv Steel 14 Ga.
06	1	RC07653-06	Channel	Prime Galv Steel 14 Ga.
W01	2	RC07653-W01	52 3/4"	2X4 Wood Nailer
W02	2	RC07653-W02	78"	2X4 Wood Nailer
CADS00103	1	CA5DS00103	Duct Support Channels	Assembly

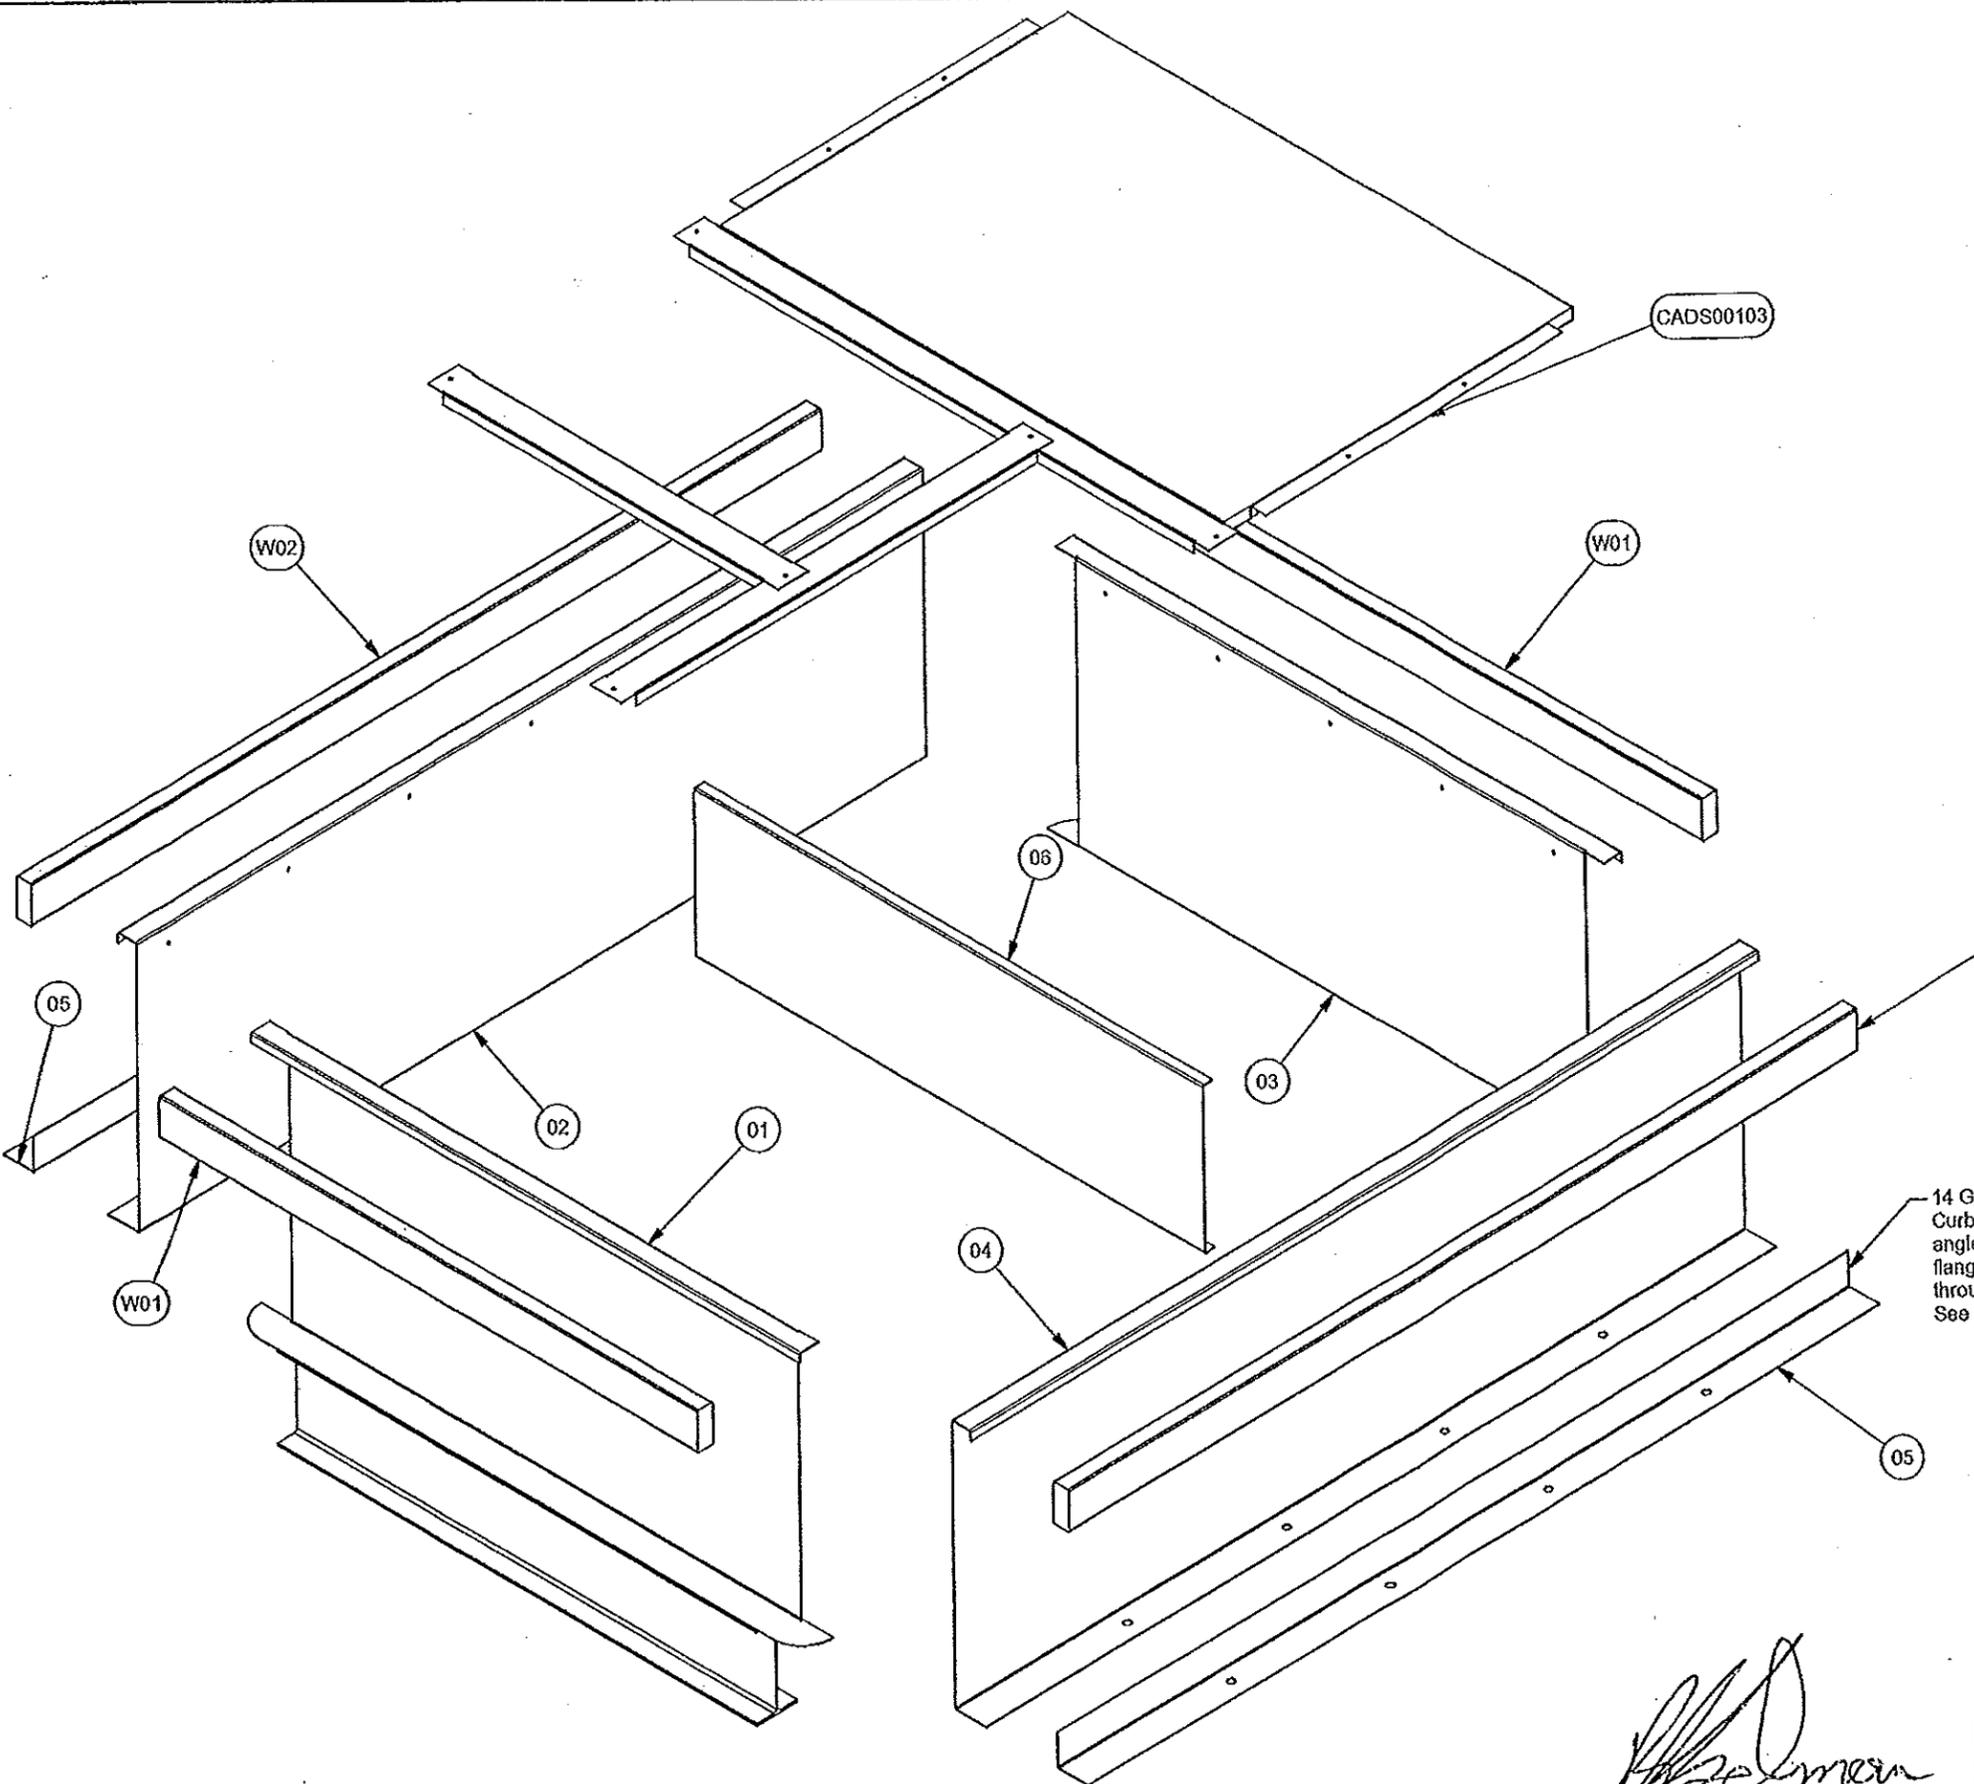








14 GA. Windload Angle
Curb Installer to place
angle over curb base
flange prior to installing
through bolts.
See detail H on page 2.

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 12-0828.01
Expiration Date 02/03/2015
By *Handwritten Signature*
Miami Dade Product Control

PRODUCT RENBVED
as complying with the Florida
Building Code
Acceptance No 15-0218.11
Expiration Date 02/03/2020
By *Handwritten Signature*
Miami Dade Product Control

Handwritten Signature
Paul Selman, Florida P.E. 65313
913 S. Kay Avenue
Addison IL 60101 05/16/13

Thybar Corporation				 ThyCurb Sheet 3 of 5
Qty:	Job #:	Tag:		
Dwg. RC07653.idw		By: Vince Cervantes	Date: 4/29/2009	
RC07653				

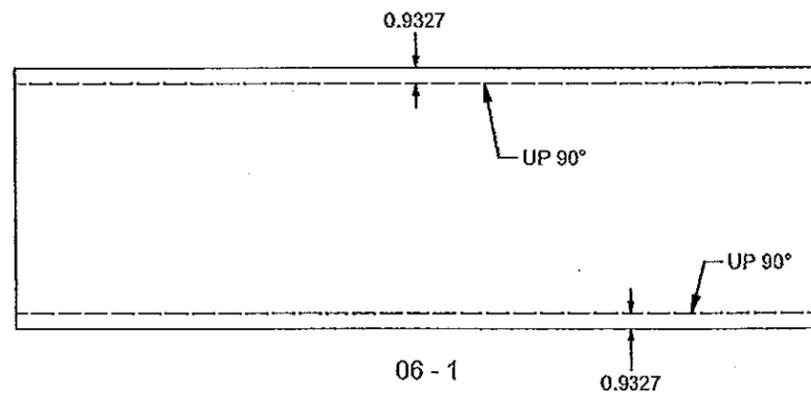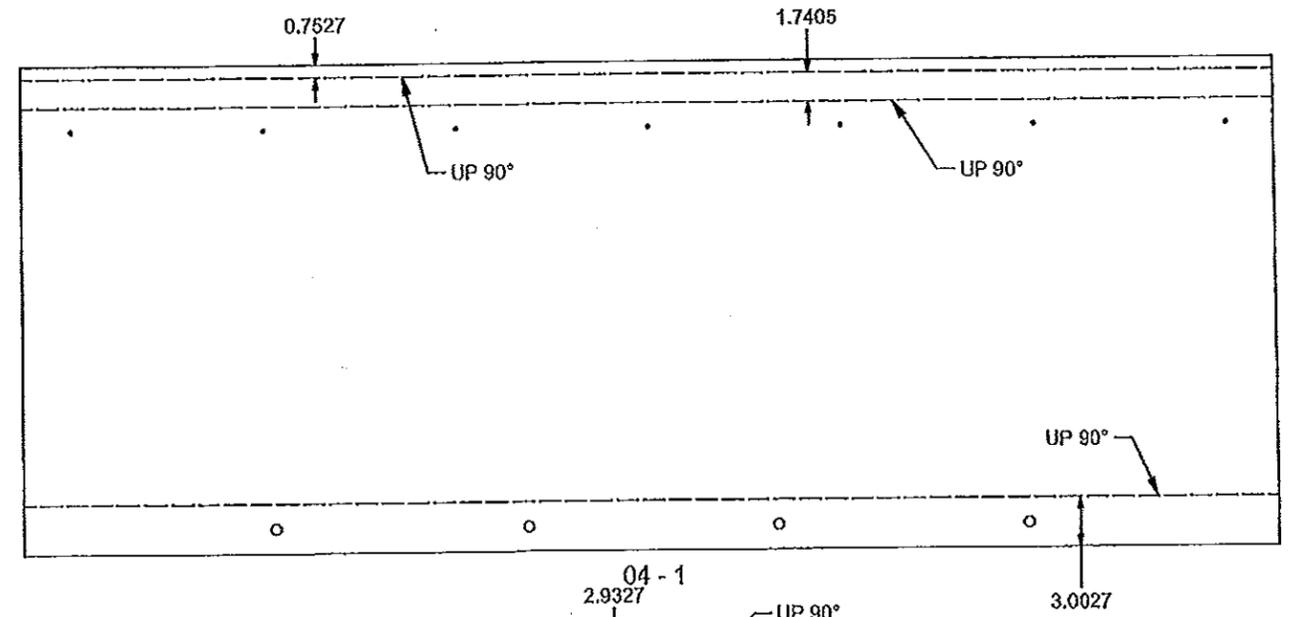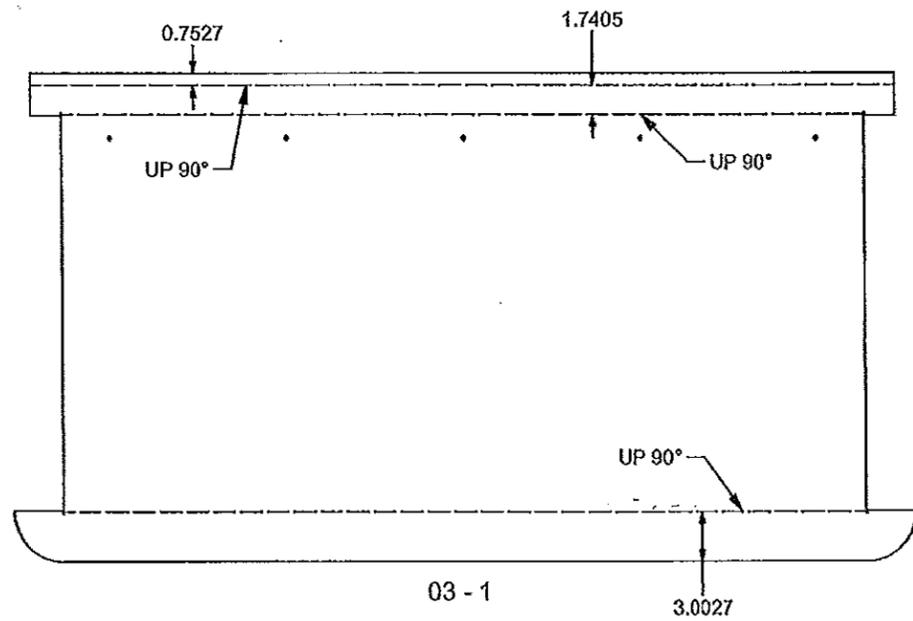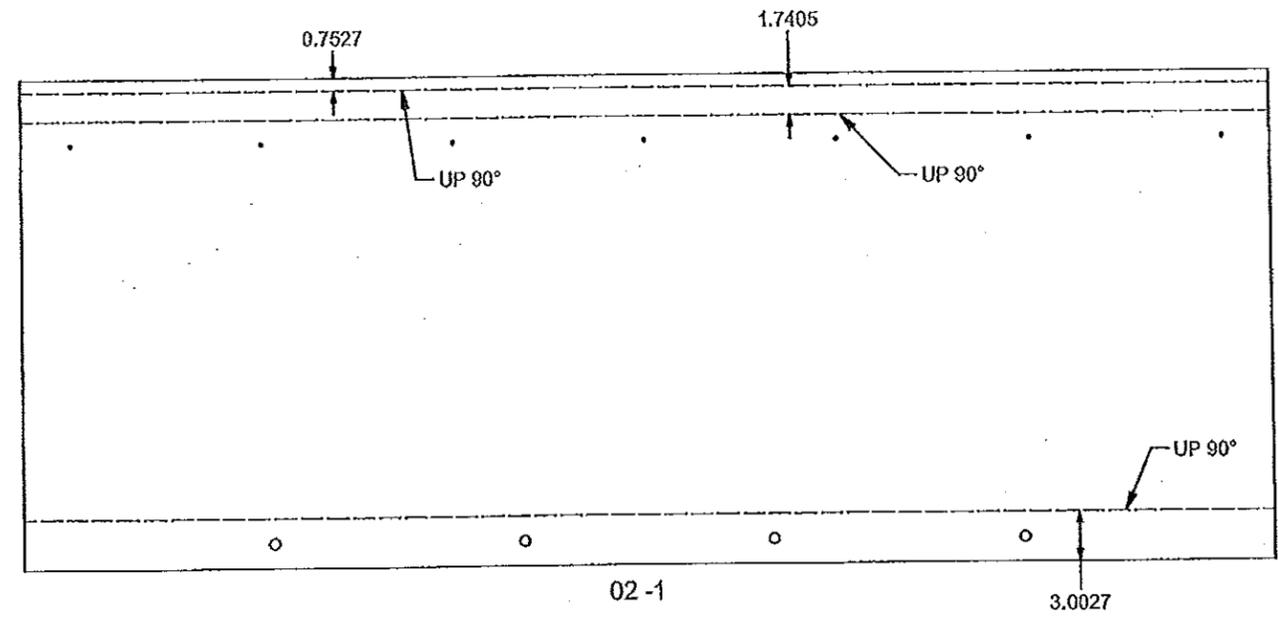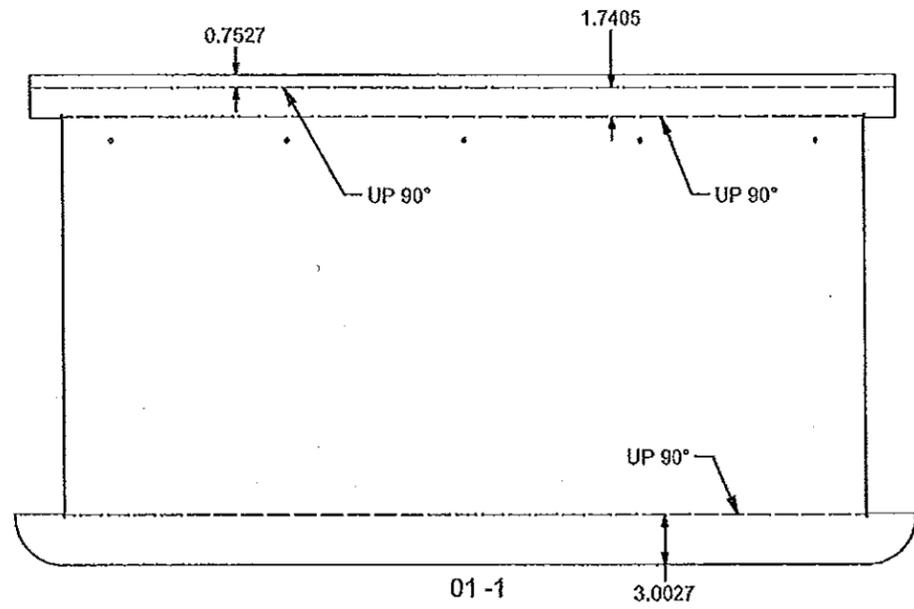

05 - 2

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0828.01
 Expiration Date 02/03/2015
 By *Healy*
 Miami Dade Product Control


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 15-0218.11
 Expiration Date 02/03/2020
 By *Healy*
 Miami Dade Product Control

Paul Selman
 Paul Selman Florida P.E. 65313
 913 S. Kay Avenue
 Addison IL 60101 05/16/13


Thybar Corporation			
Qty:	Job #:	Tag:	
Dwg. RC07653.Idw	By: Vince Cervantes	Date: 4/29/2009	
RC07653			

ThyCurb


 Sheet 4 of 5

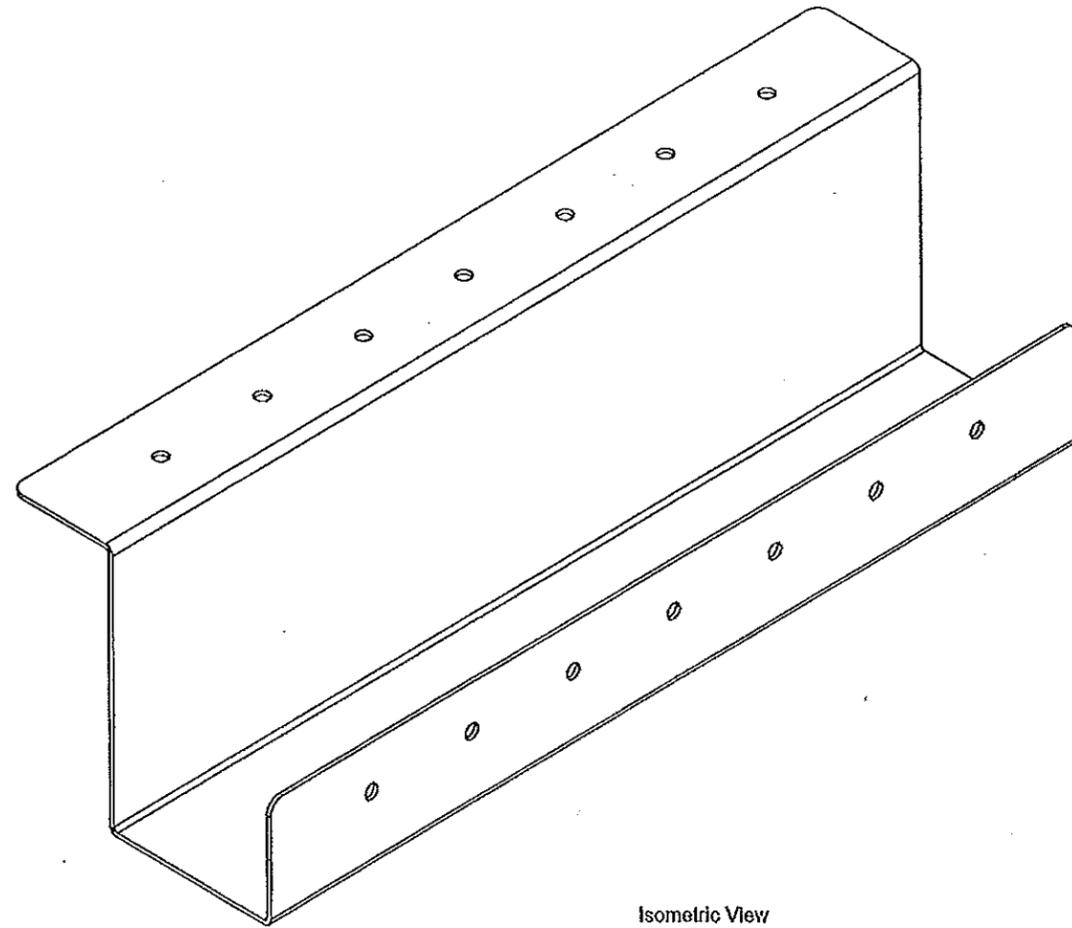

Isometric View

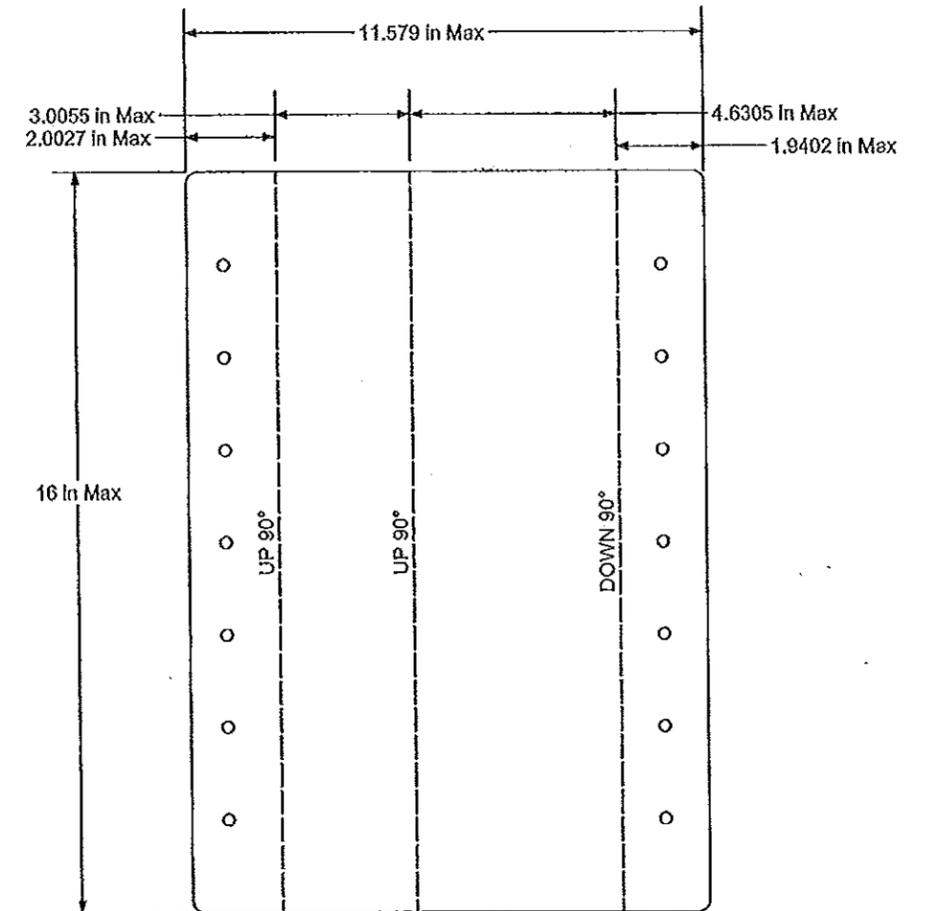

Flat Pattern

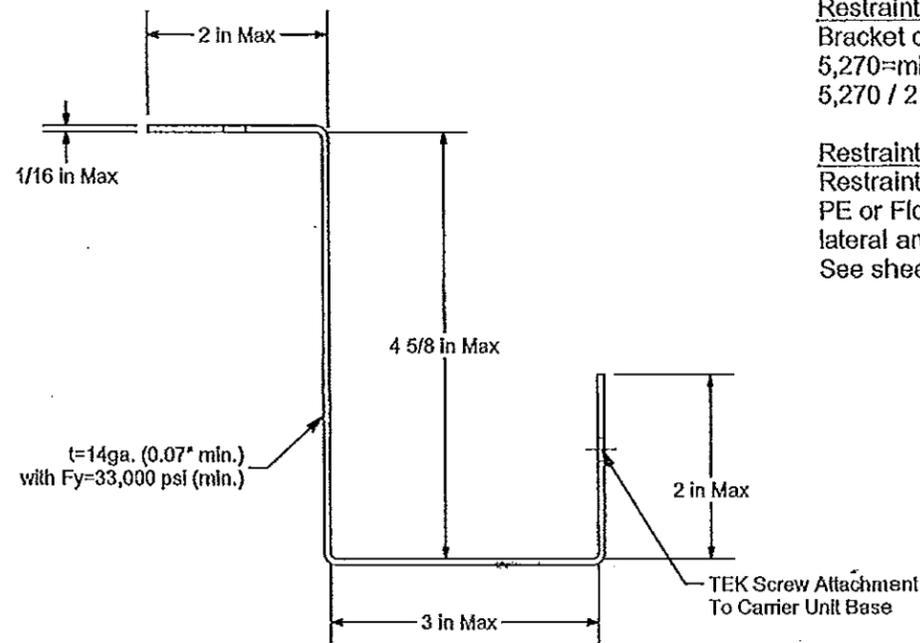

Formed View

Restraint bracket capacity

Bracket capacity is the minimum of bracket shear and tensile capacities with a factor of safety = 2.0
 5,270=minimum of 8,445 and 5,270
 5,270 / 2 Factor of Safety = 2,635 lb

Restraint bracket quantity

Restraint bracket quantity is determined by project specific calculations, performed by a Florida licenced PE or Florida registered Architect, that consider the unique combination of unit size and applicable lateral and uplift pressures for each specific job.
 See sheet #1 for maximum unit size and maximum uplift and lateral pressures.

PRODUCT REVISED
 as complying with the Florida
 Building Code
 Acceptance No 12-0828.01
 Expiration Date 02/03/2015
 By *[Signature]*
 Miami Dade Product Control

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 Acceptance No 15-0218.11
 Expiration Date 02/03/2020
 By *[Signature]*
 Miami Dade Product Control

[Signature]
 Paul Selman Florida P.E. 65313
 913 S. Kay Avenue
 Addison IL 60101 05/16/13

Thybar Corporation				
Qty:	Job #:	Tag:		
Dwg. RC07653.idw	By: Vince Cervantes	Date: 4/29/2009		Sheet 5 of 5
RC07653				