



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**Clopay Building Products Company**  
8585 Duke Boulevard  
Mason, OH 45040

**SCOPE:** This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ). This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: 2" EPS Insulated Steel Sectional Garage Door up to 9'-0" Wide w/ Optional Impact Resistant Lites**

**APPROVAL DOCUMENT:** Drawing No. 101703, titled "HDG/HDGL, 66/68, 4300/01, 4310/67/HDGL, 4400/01, H Models", sheet 1 of 1, dated 11/19/1996, with revision 7 dated 2/2015, prepared by Clopay Building Products Company, signed and sealed by Scott Hamilton, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 12-0710.06 and consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*[Handwritten Signature]*  
04/29/2015

NOA No. 15-0225.06  
Expiration Date: September 20, 2017  
Approval Date: May 7, 2015  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **101703**, titled "HDG/HDGL, 66/68, 4300/01, 4310/67/HDGL, 4400/01, H Models", sheet 1 of 1, dated 11/19/1996, with revision 7 dated 2/2015, prepared by Clopay Building Products Company, signed and sealed by Scott Hamilton, P.E.

**B. TESTS "Submitted under NOA # 09-0929.10"**

1. Test report on Forced Entry Test, per FBC, TAS 202-94, prepared by American Test Lab, Inc., Test Report No. **ATLNC 0428.01-09**, dated 06/03/2009, signed and sealed by David W. Johnson, P.E.  
*"Submitted under NOA # 07-0807.14"*
2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202,  
2) Large Missile Impact Test, per FBC TAS 201,  
3) Cyclic Wind Pressure Test, Loading per FBC TAS 203,  
along with marked-up drawings, prepared by American Test Lab, Inc., Test Report No. **ATLNC 0823.01-06**, dated 12/18/2006, signed and sealed by David W. Johnson, P.E.

**C. CALCULATIONS "Submitted under NOA # 07-0807.14"**

1. Anchoring calculations, prepared by Clopay Building Products Company, dated 07/30/2007, signed and sealed by Scott Hamilton, P.E.

**D. QUALITY ASSURANCE**


1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS "Submitted under NOA # 07-0807.14"**

1. Tensile Test, per ASTM E8, Reports No. **HETI-06-T604/605/606**, prepared by Hurricane Engineering & Testing, Inc., dated 09/22/2006, signed and sealed by Rafael E. Droz-Seda, P.E.
2. Corrosion Resistance Salt Spray Test, per ASTM B117, Report No. **30160-04-63365**, prepared by Stork Twin City Testing Corporation, dated 01/26/2005, signed by John D. Lee, P.E.
3. Ignition Properties of Plastics Test, per ASTM D1929, Report No. **3082959-500**, prepared by Intertek Testing Services NA, Inc., dated 09/16/2005, signed by Anthony Penaloza.
4. Surface Burning Characteristics Test, per ASTM E84, Report No. **3082960-500**, dated 10/04/2005 and Report No. **3094867SAT-001**, dated 04/13/2006, prepared by Intertek Testing Services, NA, Inc., signed by Javier Trevino and Anthony Penaloza.

**F. STATEMENTS**

1. Statement letter of code conformance with the 2010 and the 5<sup>th</sup> edition (2014) FBC issued by Clopay Building Products Company, dated 02/18/2015, signed and sealed by Scott Hamilton, P.E.
2. Statement letter of code conformance to 2010 FBC no financial interest, issued by Clopay Building Products Company, dated 07/06/2012, signed and sealed by Scott Hamilton, P.E.  
*"Submitted under NOA # 12-0710.06"*


  
04/29/2015

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 15-0225.06

Expiration Date: September 20, 2017  
Approval Date: May 7, 2015

CLOPAY MODELS 4300, 4301, 4310, 4400, 4401, HDG, HDGL  
 CLOPAY MODELS H400, H401, H300, H301, H310  
 HOLMES MODELS 66, 67, 68, 6200, 6201, 6203

REV	DATE	DESCRIPTION
1	7-8-97	ADDED MAXIMUM VENT OPENING
2	4/2001	ADD HOLMES MODELS & HDGL; DELETE MODELS 2200, 2201, 2300, 2301, 4200; G-40 MIN. WAS G-60
3	4/2003	ADD "H" MODELS; DELETE M/N 2400/01; 27 GA. ON 4310/HDGL
4	7/31/2006	ADDED OPTIONAL LITES; CLARIFIED END STYLE SCREW AND BACKER PLATES; MIN YIELD WAS 27 KSI
5	1/2012	AFFIRMED COMPLIANCE WITH 2010 FBC
6	7/2012	INCREASED MAXIMUM HEIGHT; ADDED HOLMES 62XX MODELS
7	2/2015	UPDATED CODE COMPLIANCE STATEMENT.

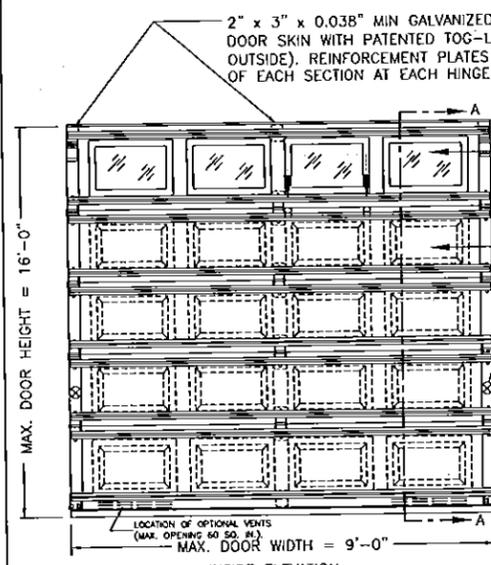

OPTIONAL: ONE ROW OF IMPACT-RESISTANT GLAZING IN EITHER TOP SECTION (SHOWN) OR NEXT-TO-THE-TOP SECTION (NOT SHOWN).

MAX. GLAZING SIZE IS 18-1/2" x 11". GLAZING IS INJECTION MOLDED GE LEXAN SLX2432T, AN APPROVED CC2 PLASTIC IN ACCORDANCE WITH IBC/FBC 2606 SEE SECTION B-B FOR ASSEMBLY DETAILS.



TABLE 1

DOOR HEIGHT	# OF SECTIONS
UP TO 7'0"	4
7'3" TO 8'9"	5
9'0" TO 10'6"	6
10'9" TO 12'3"	7
12'6" TO 14'0"	8
14'3" TO 15'9"	9
16'0"	10

MAX SECTION HEIGHT: 21'

TABLE 2

INSTALLER MODEL	RETAIL MODEL	DESCRIPTION
4300, H300	HDG, 66, 6200	27 GA. MIN. EXTERIOR SKIN; SHORT RAISED PANEL
4400, H400	N/A	24 GA. MIN. EXTERIOR SKIN; SHORT RAISED PANEL
4401, H401	N/A	24 GA. MIN. EXTERIOR SKIN; FLUSH PANEL
4301, H301	68, 6201	27 GA. MIN. EXTERIOR SKIN; FLUSH PANEL
4310, H310	HDGL, 67, 6203	27 GA. MIN. EXTERIOR SKIN; WIDE RAISED PANEL

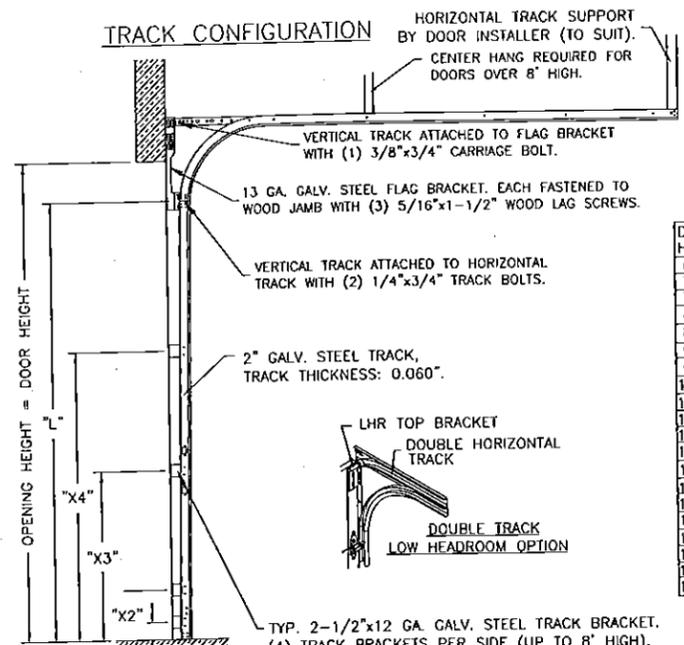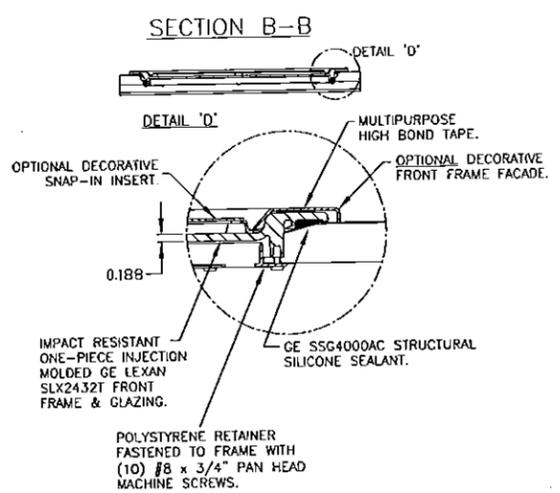

BRACKET PLACEMENTS

DOOR HEIGHT	"L"	"X1"	"X2"	"X3"	"X4"	"X5"	"X6"	"X7"	"X8"
6'-6"	70"	3-1/2"	10"	35"	60"	-	-	-	-
7'-0"	76"	3-1/2"	10"	38"	66"	-	-	-	-
7'-6"	82"	3-1/2"	10"	34"	58"	-	-	-	-
8'-0"	88"	3-1/2"	10"	34"	58"	-	-	-	-
8'-6"	94"	3-1/2"	10"	34"	58"	82"	-	-	-
9'-0"	100"	3-1/2"	10"	34"	58"	82"	-	-	-
9'-6"	106"	3-1/2"	10"	34"	58"	82"	-	-	-
10'-0"	112"	3-1/2"	10"	34"	58"	82"	-	-	-
10'-6"	118"	3-1/2"	10"	34"	58"	82"	106"	-	-
11'-0"	124"	3-1/2"	10"	34"	58"	82"	106"	-	-
11'-6"	130"	3-1/2"	10"	34"	58"	82"	106"	-	-
12'-0"	136"	3-1/2"	10"	34"	58"	82"	106"	130"	-
12'-6"	142"	3-1/2"	10"	34"	58"	82"	106"	130"	-
13'-0"	148"	3-1/2"	10"	34"	58"	82"	106"	130"	-
13'-6"	154"	3-1/2"	10"	34"	58"	82"	106"	130"	-
14'-0"	160"	3-1/2"	10"	34"	58"	82"	106"	130"	-
14'-6"	166"	3-1/2"	10"	34"	58"	82"	106"	130"	154"
15'-0"	172"	3-1/2"	10"	34"	58"	82"	106"	130"	154"
15'-6"	178"	3-1/2"	10"	34"	58"	82"	106"	130"	154"
16'-0"	184"	3-1/2"	10"	34"	58"	82"	106"	130"	154"

PRODUCT REVISED  
 as complying with the Florida Building Code  
 Acceptance No 15-0225.06  
 Expiration Date 09/20/2017  
 By *[Signature]*  
 Miami Dade Product Control

PREPARATION OF JAMBS BY OTHERS  
 NOTE: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

JAMB TO SUPPORTING STRUCTURE ATTACHMENT

- NOTES:
- ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2x6 VERTICAL SYP (GRADE #2 OR BETTER) JAMBS. NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
  - ALL JAMB FASTENERS MAY BE (BUT ARE NOT REQUIRED TO BE) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
  - A 1/3 STRESS INCREASE FOR WIND LOAD WAS NOT USED IN THE CALCULATION OF ALLOWABLE LOADS FOR ANCHORS AND FASTENERS FOR STEEL, CONCRETE AND MASONRY.


WOOD FRAME BUILDINGS  
 STUD WALLS OF DOOR OPENING SHALL BE FRAMED SOLID BY NOT LESS THAN (3) 2x6 PRESSURE TREATED SYP (GRADE #2 OR BETTER) WOOD STUDS OF A STRESS GRADE NOT LESS THAN 1200 PSI NOMINAL EXTREME FIBER STRESS IN BENDING (F<sub>b</sub>). STUD WALLS TO BE CONTINUOUS FROM FOOTING TO THE BEAMS.

BLOCK WALL OR CONCRETE  
 2x6 SYP (GRADE #2 OR BETTER) WOOD JAMB SHALL BE ANCHORED TO GROUT REINFORCED BLOCK WALL OR CONCRETE COLUMN. BLOCK WALL CELLS SHALL BE FILLED WITH CONCRETE AND REINFORCED WITH REINFORCING BARS EXTENDING INTO THE FOOTING AND INTO THE BEAMS. ALL BARS SHALL BE CONTINUOUS FROM THE TIE BEAMS TO FOOTING PER BLOCK WALL OR CONCRETE COLUMN. BLOCK WALLS AND CONCRETE COLUMNS TO BE DESIGNED BY THE BUILDING ENGINEER OR ARCHITECT OF RECORD.

2x6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT  
 (NOT TO BE USED FOR ATTACHMENT OF TRACK BRACKETS)

BUILDING TYPE	ANCHOR	MAXIMUM * ON CENTER DISTANCE BETWEEN FASTENERS	STEEL WASHERS REQUIRED?
C-90, BLOCK* (HOLLOW OR GROUTED)	1/4" x 3" (1-1/4" EMBED) ITW TAPCON CONCRETE ANCHOR (2-1/2" MIN. EDGE DISTANCE)	10-1/2"	1" O.D.
3,000 PSI MIN. CONCRETE	1/4" x 4" (1-3/4" EMBED) ITW TAPCON CONCRETE ANCHOR (2-1/2" MIN. EDGE DISTANCE)	24"	1" O.D.
3,000 PSI MIN. CONCRETE	1/2" x 4" (2-1/4" EMBED) SIMPSON STRONG-TIE WEDGE-ALL WEDGE ANCHOR (2" MIN. EDGE DISTANCE)	21-1/2"	INCLUDED
WOOD-FRAME	1/2" x 4" (1-5/8" EMBED) LAG SCREW (ASTM A307, GRADE A) (2-1/2" MIN. EDGE DISTANCE)	24"	1" O.D.
2,000 PSI MIN. CONCRETE	1/2" x 4" (2-1/2" EMBED) WEJ-IT SLEEVE ANCHOR (2-1/2" MIN. EDGE DISTANCE)	24"	INCLUDED

\* FIRST ANCHOR/SCREW STARTING FROM BOTTOM AT NO MORE THAN HALF OF MAXIMUM ON CENTER DISTANCE. HIGHEST ANCHOR/SCREW INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING HEIGHT.

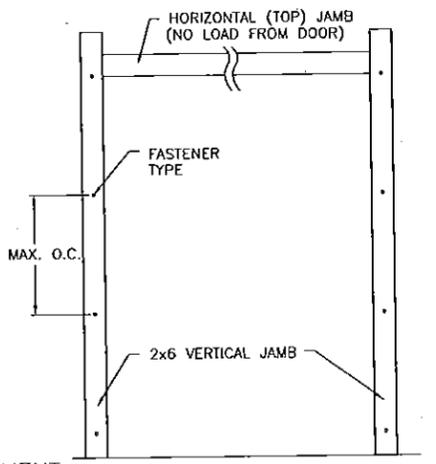

THIS PRODUCT CONFORMS TO THE REQUIREMENTS OF THE 2010 FBC AND THE FIFTH EDITION FBC.

DESIGN LOADS: +48.0 PSF & -60.0 PSF.

DESIGN ENGINEER: SCOTT HAMILTON, P.E. FLORIDA P.E. No. 63286



*[Signature]*  
 2/15/18

**Clopay** Building Products Company

CLOPAY BUILDING PRODUCTS COMPANY  
 8585 DUKE BLVD.  
 MASON, OH 45040  
 (513) 770-4800

SCALE: N/A  
 DATE: 11/19/96  
 DRAWN BY: MWW  
 CHECKED BY:

CLASSIFICATION: APPROVED INSTALLATION  
 DESCRIPTION: HDG/HDGL, 66/68, 4300/01, 4310/67/HDGL, 4400/01, H MODELS  
 DRAWING NUMBER: B 101703  
 MAXIMUM DOOR SIZE: 9'0"W x 16'0"H  
 REV: 6

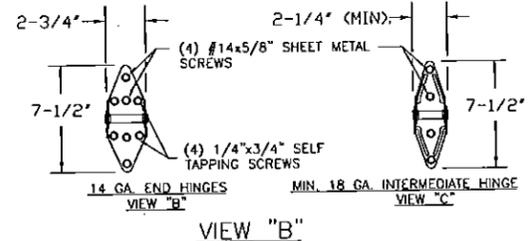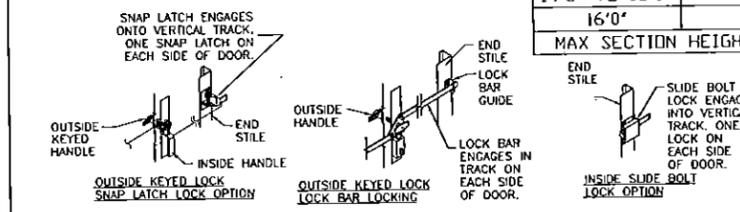

JAMB CONFIGURATION

