



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
 BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
 PRODUCT CONTROL SECTION
 11805 SW 26 Street, Room 208
 Miami, Florida 33175-2474
 T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Clopay Building Products Company
 8585 Duke Boulevard
 Mason, OH 45040

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: 2" Gallery EPS Insulated W8 DP54 Steel Sectional Garage Door up to 9'-0" Wide w/ Optional Impact Resistant Lites

APPROVAL DOCUMENT: Drawing No. **104119**, titled "Gallery 2" EPS Single Car +54/-60 PSF", sheet 1 through 4 of 4, dated 07/08/2008, with revision 05 dated 2/2015, prepared by Clopay Building Products Company, signed and sealed by Scott Hamilton, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # **14-0514.05** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Signature]
 10/13/2015

NOA No 15-0225.24
 Expiration Date: December 16, 2019
 Approval Date: May 21, 2015
 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. 104119, titled "Gallery 2" EPS Single Car +54/-60 PSF", sheet 1 through 4 of 4, dated 07/08/2008, with revision 05 dated 2/2015, prepared by Clopay Building Products Company, signed and sealed by Scott Hamilton, P.E.

B. TESTS "Submitted under NOA # 14-0514.05"

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC, TAS 202-94
5) Tensile Test per ASTM E8

Along with marked-up drawings and installation diagram of 9'x 8', 27ga steel garage door Model GD2LP with Lexan MR10 windows, prepared by American Test Lab, Inc., Test Report No. ATLNC 0326.01-13, dated 05/01/2013, signed and sealed by David W. Johnson, P.E.

2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC, TAS 202-94
5) Tensile Test per ASTM E8

Along with marked-up drawings and installation diagram of 16'2"x 8', 27ga steel garage door Model GD2LPW8 with MAK SL and/or MAK 15 windows, prepared by American Test Lab, Inc., Test Report No. ATLNC 1105-01-13, dated 01/14/2014, signed and sealed by David W. Johnson, P.E.

"Submitted under NOA # 09-0929.10"

3. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, per FBC, TAS 202-94
5) Tensile Test per ASTM E8

Along with marked-up drawings and installation diagram of a 9'x 8', 27ga, Series Gallery, Model GD2SP steel garage door, prepared by American Test Lab, Inc., Test Report No. ATLNC 0428.01-09, dated 06/03/2009, signed and sealed by David W. Johnson, P.E.

4. Test report on Salt Spray per ASTM B117 of painted G40 galvanized coated panels, prepared by Stork Materials Technology, Test Report No. 30160-04-63365, dated 01/26/2005, signed by John D. Lee, P.E.



05/13/2015

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 15-0225.24
Expiration Date: December 16, 2019
Approval Date: May 21, 2015

Clipay Building Products Company

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS *"Submitted under NOA # 14-0514.05"*

1. Jamb anchor calculations, prepared by Clipay Building Products Company, dated 04/11/2014, signed and sealed by Scott Hamilton, P.E.

"Submitted under NOA # 09-0929.10"

2. Jamb anchor calculations, prepared by Clipay Building Products Company, dated 09/04/2009, signed and sealed by Scott Hamilton, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **13-0717.01** issued to SABIC Innovative Plastics for their Lexan Polycarbonate Sheet Products, approved on 11/28/2013, expiring on 07/17/2018.
2. Notice of Acceptance No. **12-0605.05** issued to Bayer Material Science LLC (MA) for their Makrolon Polycarbonate Sheets, approved on 12/06/2012, expiring on 08/27/2017.
3. Test report on Surface Burning Characteristics, per ASTM E84 of Premier Industries' Type I EPS, Report No. **3082960-500**, prepared by Intertek Testing Services, NA, Inc., dated 10/04/2005, signed by Javier Trevino
4. Test report on Ignition Properties of Plastics per ASTM D1929 of Premier Industries' Type I EPS, Report No. **3082959-500**, prepared by Intertek Testing Services, NA, Inc., dated 09/16/2005, signed by C. Anthony Peñaloza.
5. Test report on Surface Burning Characteristics, per ASTM E84 of Falcon's Type I EPS, Report No. **3094867SAT-001**, prepared by Intertek Testing Services, NA, Inc., dated 04/13/2006, signed by C. Anthony Peñaloza
6. Test report on Ignition Properties of Plastics per ASTM D1929 of Falcon's Type I EPS, Report No. **3094867SAT-002**, prepared by Intertek Testing Services, NA, Inc., dated 04/04/2006, signed by C. Anthony Peñaloza.

F. STATEMENTS

1. Statement letter of code conformance with the 2010 and the 5th edition (2014) FBC issued by Clipay Building Products Company, dated 02/18/2015, signed and sealed by Scott Hamilton, P.E.

"Submitted under NOA # 14-0514.05"

2. Statement letters of code conformance to 2010 FBC and no financial interest, both issued by Clipay Building Products Company, dated 04/11/2014, signed and sealed by Scott Hamilton, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No 15-0225.24

Expiration Date: December 16, 2019
Approval Date: May 21, 2015

MODELS	SHORT	LONG
CLOPAY GALLERY	GD2SP, GR2SP	GD2LP, GR2LP
HOLMES ARTISTRY	AR2SP	AR2LP
IDEAL EXPRESSIONS	ED2SP	ED2LP

CYPRESS MODELS	FLUSH
CLOPAY	4302, HDGC
HOLMES	6202
IDEAL	SFC68

SHEET:
1 OF 4


THIS PRODUCT CONFORMS TO THE REQUIREMENTS OF THE 2010 FBC AND THE FIFTH EDITION FBC.

REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
04	-	7/3/14	-	SH	REVISED PER DADE COMMENTS.
05	-	2/2015	-	SH	ADDED CODE COMPLIANCE STATEMENT.




DOOR HEIGHT	# OF SECTIONS
UP TO 6'0"	3
6'3" TO 8'0"	4
8'3" TO 10'0"	5
10'3" TO 12'0"	6
12'3" TO 14'0"	7
14'3" TO 16'0"	8
MAX SECTION HEIGHT: 24'	

DOOR WIDTH	# OF INTERM. HINGES/JOINT
6'2" TO 7'6"	2
7'8" TO 9'0"	1

OPTIONAL GLAZING SHALL BE IMPACT RESISTANT GLAZING. MAXIMUM GLAZING SIZE (DLO) IS 38-1/2"x13". GLAZING MAY BE SHORT-PANEL (SHOWN) OR LONG-PANEL (NOT SHOWN). SEE SECTION B-B ON SHEET 2 FOR DETAILS. GLAZING MAY BE INSTALLED IN TOP SECTION (SHOWN) OR INTERMEDIATE SECTION (NOT SHOWN).

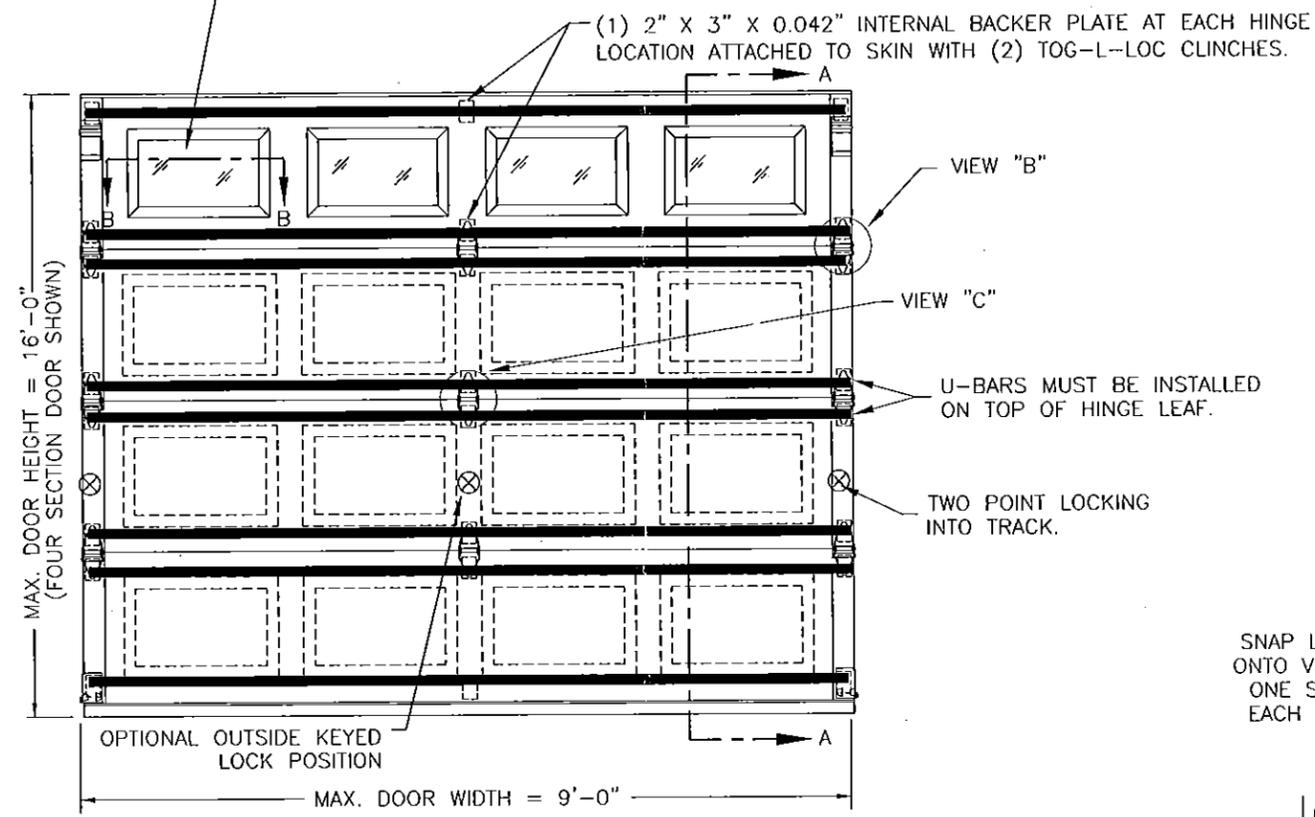

SHORT PANEL SHOWN. LONG PANEL AND FLUSH ALSO AVAILABLE.

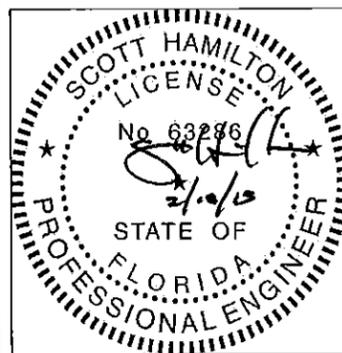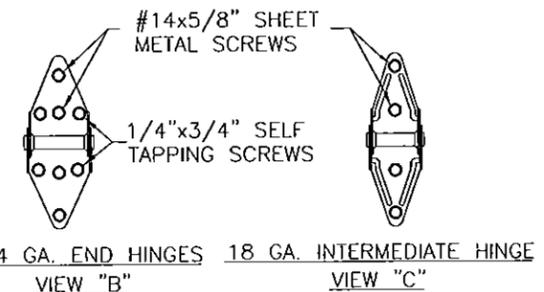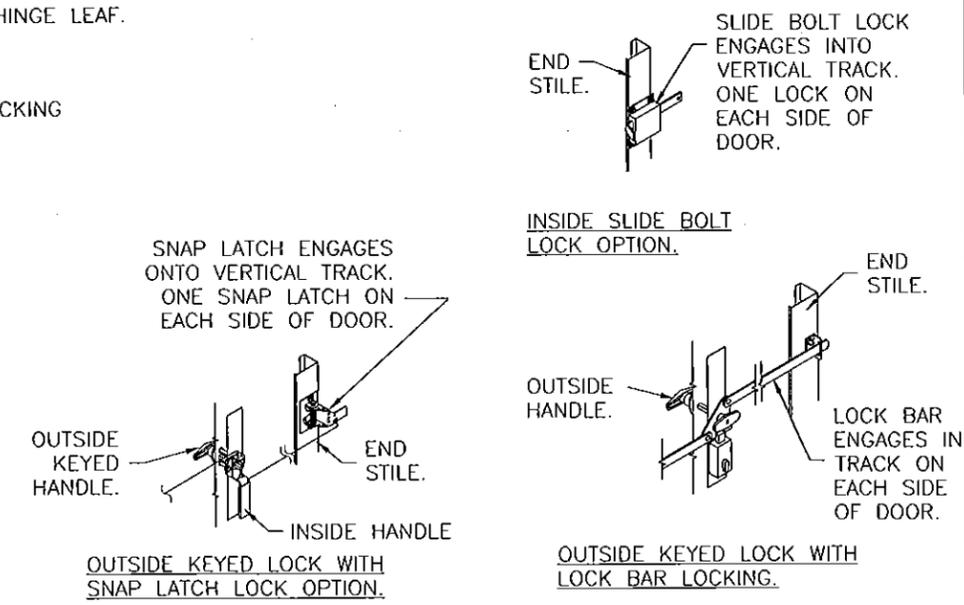

PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 15-0225-24
 Expiration Date 12/16/2019
 By: [Signature]
 Miami Dade Product Control

DESIGN LOADS: +54.0 P.S.F. & -60.0 P.S.F.

Unless Stated Otherwise TOLERANCES are

.0	= ±.031
.00	= ±.015
.000	= ±.005
.0000	= ±.001
Degrees	= ±1/2"

Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

Glopay
 Building Products Company
 8585 Duke Boulevard
 Mason, OH 45040 USA
 Tel. No. 513-770-4800
 Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE DSIE-1F471	
PART NO.: N/A	
WINDLOAD RATING W8 DP54	
DESCRIPTION: GALLERY 2" EPS SINGLE CAR +54/-60 PSF	SCALE: NTS
DRAWN BY: BFA	DATE: 7/8/08
CHECKED BY: --	DATE: --
DWG. NO.: 104119	VER: MD

DESIGN ENGINEER:
SCOTT HAMILTON, P.E.
FLORIDA LICENSE No. 63286


MODELS	SHORT	LONG
CLOPAY GALLERY	GD2SP, GR2SP	GD2LP, GR2LP
HOLMES ARTISTRY	AR2SP	AR2LP
IDEAL EXPRESSIONS	ED2SP	ED2LP

CYPRESS MODELS	FLUSH
CLOPAY	4302, HDGC
HOLMES	6202
IDEAL	SFC68


SHEET:
2 OF 4

REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
05	-	-	-	-	SEE REVISION HISTORY ON SHEET ONE.

IMPACT-RESISTANT CONSTRUCTION:
 SOLID DOORS (NO GLAZING) OR DOORS WITH OPTIONAL IMPACT-RESISTANT GLAZING ARE IMPACT-RESISTANT. OPTIONAL IMPACT RESISTANT ASSEMBLY CONSISTS OF ALUMINUM FRONT FRAME AND SABIC IP LEXAN 9034 (VERSIONS ALSO APPROVED: MR10, 9030, 90318, 90316, 90317, 90311, 90314, 90355) OR BAYER MAKROLON GP (VERSIONS ALSO APPROVED: SL, AR, 15), APPROVED CC1 PLASTICS IN ACCORDANCE WITH IBC/FBC 2606 AND APPROVED C1 PLASTICS IN ACCORDANCE WITH FBC 2612. THE ENTIRE DOOR ASSEMBLY INSTALLED IN COMPLIANCE WITH THIS SECTION MEETS THE WIND LOAD REQUIREMENTS OF THE FLORIDA BUILDING CODE AND INTERNATIONAL BUILDING CODE AND IS LARGE- AND SMALL-MISSILE IMPACT RESISTANT.

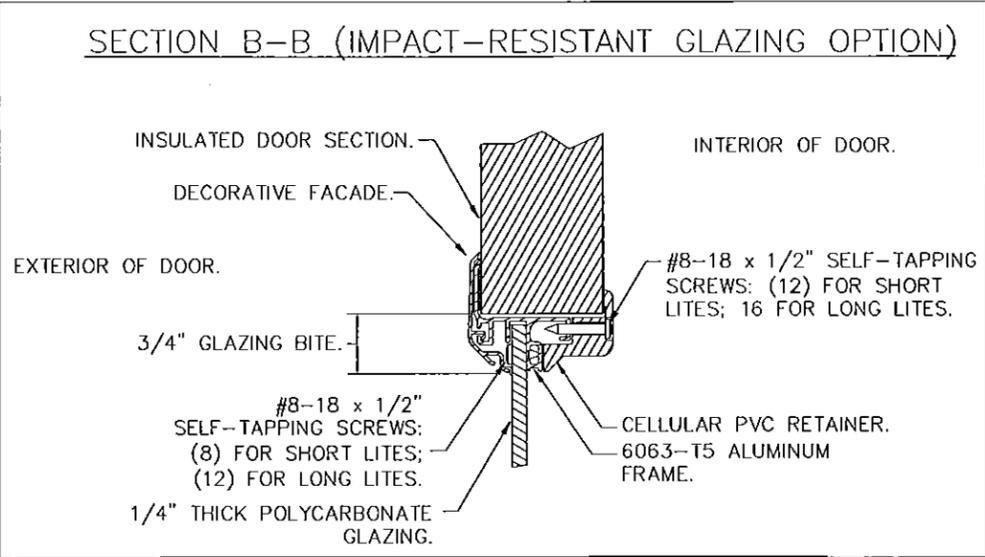

IMPACT-RESISTANT GLAZING DETAILS

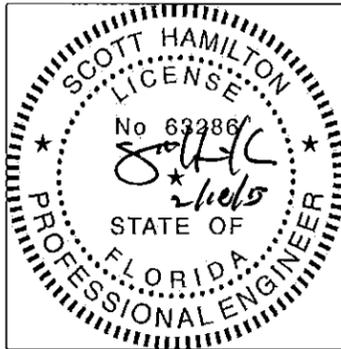

DESIGN ENGINEER:
 SCOTT HAMILTON, P.E.
 FLORIDA LICENSE No. 63286

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 15-0225.24
 Expiration Date 12/16/2019
 By *[Signature]*
 Miami Code Product Control

DESIGN LOADS: +54.0 P.S.F. & -60.0 P.S.F.		MANUFACTURING PRODUCT CODE DSIE-1F471																													
<table border="1"> <tr> <td>Unless Stated Otherwise TOLERANCES are</td> <td>Building Products Company</td> <td colspan="2">8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853</td> </tr> <tr> <td>.0 = ±.031</td> <td></td> <td colspan="2">WINDLOAD RATING W8 DP54</td> </tr> <tr> <td>.00 = ±.015</td> <td></td> <td colspan="2">DESCRIPTION: GALLERY 2" EPS SINGLE CAR +54/-60 PSF</td> </tr> <tr> <td>.000 = ±.005</td> <td></td> <td>DRAWN BY: BFA</td> <td>DATE: 7/8/08</td> </tr> <tr> <td>.0000 = ±.001</td> <td></td> <td>CHECKED BY: --</td> <td>DATE: --</td> </tr> <tr> <td>Degrees = ±1/2'</td> <td></td> <td>DWG. NO.: 104119</td> <td>VER: MD</td> </tr> <tr> <td>Unless Stated Otherwise DIMENSIONS ARE IN INCHES.</td> <td></td> <td></td> <td></td> </tr> </table>		Unless Stated Otherwise TOLERANCES are	Building Products Company	8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853		.0 = ±.031		WINDLOAD RATING W8 DP54		.00 = ±.015		DESCRIPTION: GALLERY 2" EPS SINGLE CAR +54/-60 PSF		.000 = ±.005		DRAWN BY: BFA	DATE: 7/8/08	.0000 = ±.001		CHECKED BY: --	DATE: --	Degrees = ±1/2'		DWG. NO.: 104119	VER: MD	Unless Stated Otherwise DIMENSIONS ARE IN INCHES.				PART NO.: N/A	
Unless Stated Otherwise TOLERANCES are	Building Products Company	8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853																													
.0 = ±.031		WINDLOAD RATING W8 DP54																													
.00 = ±.015		DESCRIPTION: GALLERY 2" EPS SINGLE CAR +54/-60 PSF																													
.000 = ±.005		DRAWN BY: BFA	DATE: 7/8/08																												
.0000 = ±.001		CHECKED BY: --	DATE: --																												
Degrees = ±1/2'		DWG. NO.: 104119	VER: MD																												
Unless Stated Otherwise DIMENSIONS ARE IN INCHES.																															
		SCALE: NTS																													
		SHEET 2 OF 4																													
		DWG. SIZE B																													

MODELS	SHORT	LONG
CLOPAY GALLERY	GD2SP, GR2SP	GD2LP, GR2LP
HOLMES ARTISTRY	AR2SP	AR2LP
IDEAL EXPRESSIONS	ED2SP	ED2LP

CYPRESS MODELS	FLUSH
CLOPAY	4302, HDGC
HOLMES	6202
IDEAL	SFC68

SHEET:
3 OF 4

REVISIONS

REV. NO.	ZONE	DATE	ECN NO.	APPVD.	DESCRIPTION
05	-	-	-	-	SEE REVISION HISTORY ON SHEET ONE.

27 GA. (0.016" MIN.) STEEL EXTERIOR SKIN WITH G-40 MIN. GALV., BAKED-ON PRIMER AND A BAKED-ON POLYESTER PAINTED TOP COAT. MIN. YIELD 36 KSI.

SILICONE FILLED CHANNEL SEPARATES FRONT AND BACK SKIN OF DOOR.

1.95" THICK, 1# DENSITY EXPANDED POLYSTYRENE FOAM INSULATION LAMINATED TO BOTH EXTERIOR AND INTERIOR SKINS. FOAM INSULATION IS AN APPROVED FOAM PLASTIC (PER FBC 2612.2) AND MEETS REQUIREMENTS OF FBC/IBC 2603.4.1.9.

12 GA. GALV. STEEL TOP ROLLER BRACKET. EACH BRACKET ATTACHED W/(4) #14x5/8" SHEET METAL SCREWS.

14 GA. GALV. STEEL ROLLER HINGE. EACH FASTENED TO END STILES W/(4) #14x5/8" SHEET METAL SCREWS AND (4) 1/4"x3/4" SELF TAPPING SCREWS

(2) 3" TALL x 20 GA. GALV. STEEL U-BARS PER DOOR SECTION, ATTACHED WITH (2) 1/4"x3/4" SELF TAPPING SCREWS PER HINGE LOCATION.

27 GA. STEEL GALV. INTERIOR SKIN WITH A BAKED-ON PRIMER AND A BAKED-ON POLYESTER PAINTED TOP COAT.

13 GA. GALV. STEEL BOTTOM BRACKET. ATTACHED WITH (4) #14x5/8" SHEET METAL SCREWS.

ALUMINUM EXTRUSION & VINYL WEATHERSTRIP.


SECTION A-A (SIDE VIEW)

JAMB TO SUPPORTING STRUCTURE ATTACHMENT

- NOTES:
- ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2x6 VERTICAL SYP (GRADE #2 OR BETTER) JAMBS. NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
 - EACH VERTICAL JAMB SEES A MAXIMUM DESIGN LOAD OF +243 LB & -270 LB. PER LINEAR FOOT OF JAMB.
 - ALL JAMB FASTENERS MAY BE (BUT ARE NOT REQUIRED TO BE) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
 - A 1/3 STRESS INCREASE FOR WIND LOAD WAS NOT USED IN THE CALCULATION OF ALLOWABLE LOADS FOR ANCHORS AND FASTENERS FOR STEEL, CONCRETE AND MASONRY.

PREPARATION OF JAMBS BY OTHERS

NOTE: THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

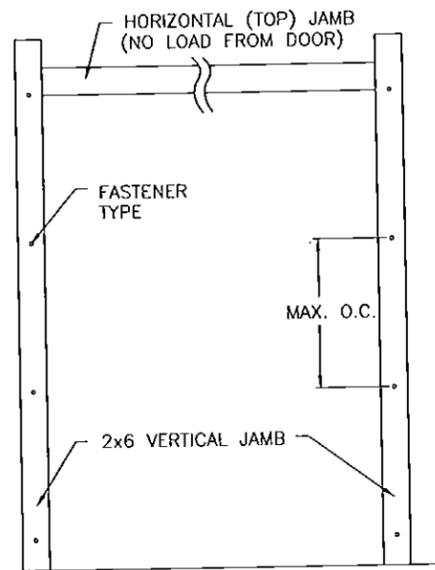


2x6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT

(NOT TO BE USED FOR ATTACHMENT OF TRACK ANGLE TO 2x6 VERTICAL JAMBS OR SUPPORTING STRUCTURE)

BUILDING TYPE	FASTENER TYPE	MAXIMUM ON-CENTER DISTANCE BETWEEN FASTENERS*	STEEL WASHERS REQUIRED?
HOLLOW CMU BLOCK WALL	1/4" x 1-1/4" MIN. EMBED ULTRACON CONCRETE ANCHOR	6-3/4"	1" O.D.
GROUT-FILLED CMU BLOCK	1/4" x 1-3/4" MIN. EMBED ULTRACON CONCRETE ANCHOR	11-1/4"	1" O.D.
2000 PSI MIN. CONCRETE	1/4" x 1" MIN. EMBED ULTRACON CONCRETE ANCHOR	9-3/4"	1" O.D.
2000 PSI MIN. CONCRETE	1/4" x 1" MIN. EMBED TAPCON CONCRETE ANCHOR	8"	1" O.D.
2000 PSI MIN. CONCRETE	3/8" x 1-3/4" MIN. EMBED WEJ-IT ANKR TITE SLEEVE ANCHOR	20-3/4"	INCLUDED
4000 PSI MIN. CONCRETE	3/8" x 1-3/4" MIN. EMBED WEJ-IT ANKR TITE SLEEVE ANCHOR	24"	INCLUDED
WOOD FRAME (SYP 0.55 SG)	1/2" x 3" LAG SCREW (ASTM A307, GRADE A) 1-5/8" EMBED INTO STRUCTURE	22-1/4"	1" O.D.

* FIRST (BOTTOM) ANCHOR STARTING AT NO MORE THAN HALF OF THE MAXIMUM ON-CENTER DISTANCE. HIGHEST ANCHOR INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING.
CLOPAY DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.
MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 2-1/2", EXCLUDING STUCCO THICKNESS.

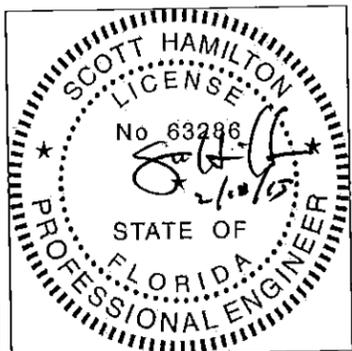

PRODUCT REVISED
in compliance with the Florida Building Code
Acceptance No. 15-0225-24
Expiration Date 12/16/2019
By [Signature]
Miami Trade Product Control

DESIGN ENGINEER:
SCOTT HAMILTON, P.E.
FLORIDA LICENSE No. 63286

DESIGN LOADS: +54.0 P.S.F. & -60.0 P.S.F.

Unless Stated Otherwise
TOLERANCES are
.0 = ±.031
.00 = ±.015
.000 = ±.005
.0000 = ±.001
Degrees = ±1/2'
Unless Stated Otherwise
DIMENSIONS ARE IN INCHES.

Clopay
Building Products Company
8585 Duke Boulevard
Mason, OH 45040 USA
Tel. No. 513-770-4800
Fax No. 513-770-4853

DESCRIPTION: GALLERY 2" EPS SINGLE CAR +54/-60 PSF	DATE: 7/8/08	SCALE: NTS	DWG. SIZE B
DRAWN BY: BFA	DATE: --	SHEET 3 OF 4	VER: MD
CHECKED BY: --	DATE: --		
DWG. NO.: 104119			

MANUFACTURING PRODUCT CODE
DSIE-1F471

PART NO.: N/A

WINDLOAD RATING
W8 DP54

MODELS	SHORT	LONG
CLOPAY GALLERY	GD2SP, GR2SP	GD2LP, GR2LP
HOLMES ARTISTRY	AR2SP	AR2LP
IDEAL EXPRESSIONS	ED2SP	ED2LP


CYPRESS MODELS	FLUSH
CLOPAY	4302, HDGC
HOLMES	6202
IDEAL	SFC68

SHEET:
4 OF 4

REVISIONS						DESCRIPTION
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:		
05	-	-	-	-		SEE REVISION HISTORY ON SHEET ONE.

2" TRACK CONFIGURATION.


NOTE: TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING OF THIS DOOR.

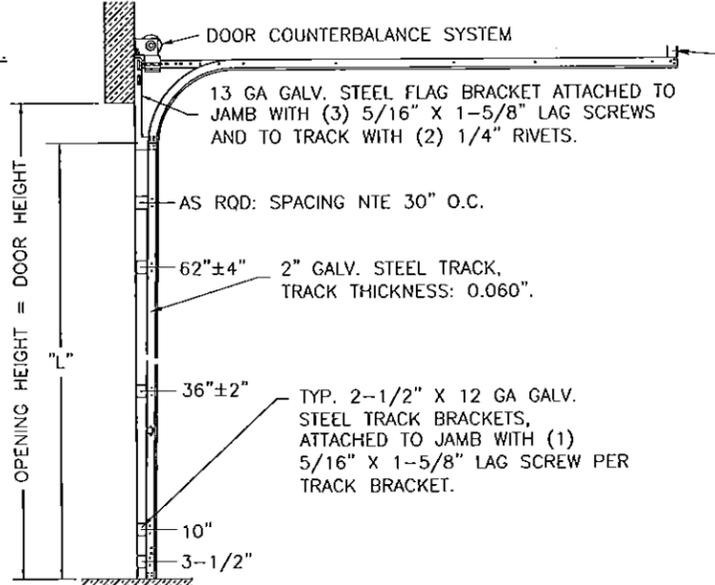

DOOR HEIGHT "L"	"L"
6'-6"	70"
7'-0"	76"
7'-6"	82"
8'-0"	88"
8'-6"	94"
9'-0"	100"
9'-6"	106"
10'-0"	112"
10'-6"	118"
11'-0"	124"
11'-6"	130"
12'-0"	136"
12'-6"	142"
13'-0"	148"
13'-6"	154"
14'-0"	160"
14'-6"	166"
15'-0"	172"
15'-6"	178"
16'-0"	184"


HORIZONTAL TRACK SUPPORT BY DOOR INSTALLER (TO SUIT).

JAMB CONFIGURATION.

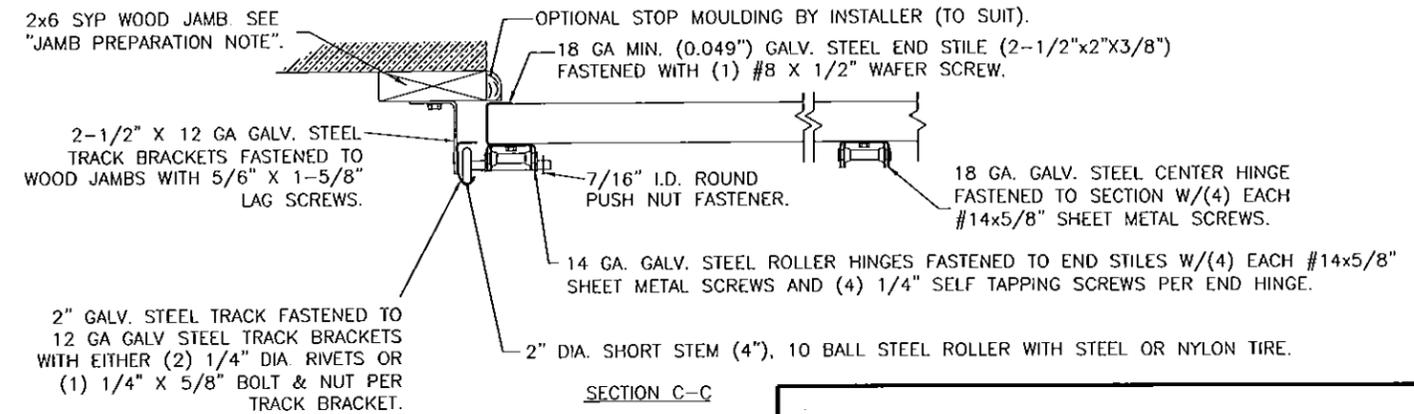


SECTION C-C

PREPARATION OF JAMBS BY OTHERS.

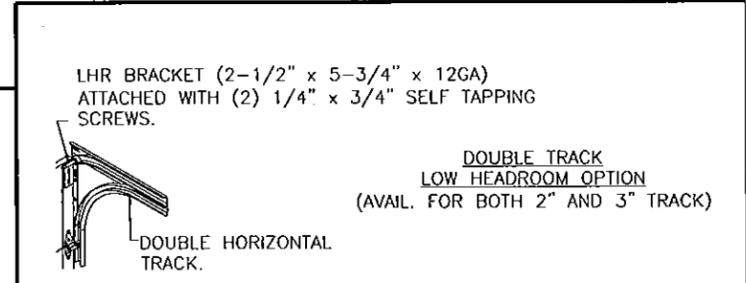

3" TRACK IS ALSO AVAILABLE.

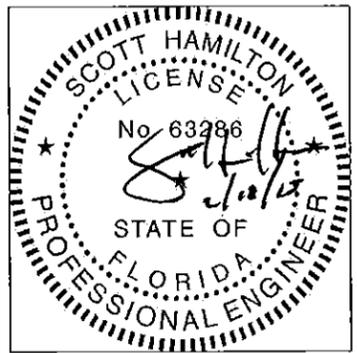

PRODUCT REVISED to comply with the Florida Building Code
 Acceptance No 15-0225.24
 Expiration Date 12/16/2019
 By Miami Made Product Control

DESIGN ENGINEER:
SCOTT HAMILTON, P.E.
FLORIDA LICENSE No. 63286

DESIGN LOADS: +54.0 P.S.F. & -60.0 P.S.F.

Unless Stated Otherwise TOLERANCES are
 .0 = ± 0.31
 .00 = ± 0.15
 .000 = ± 0.05
 .0000 = ± 0.01
 Degrees = ± 1/2'
 Unless Stated Otherwise DIMENSIONS ARE IN INCHES.

Clopay Building Products Company
 8585 Duke Boulevard
 Mason, OH 45040 USA
 Tel. No. 513-770-4800
 Fax No. 513-770-4853

MANUFACTURING PRODUCT CODE
DSIE-1F471

PART NO.: N/A

WINDLOAD RATING
W8 DP54

DESCRIPTION: GALLERY 2" EPS SINGLE CAR +54/-60 PSF			
DRAWN BY: BFA	DATE: 7/8/08	SCALE: NTS	DWG. SIZE B
CHECKED BY: --	DATE: --	SHEET 4 OF 4	
DWG. NO.: 104119	VER: MD		