



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599

**NOTICE OF ACCEPTANCE (NOA)**

[www.miamidadecounty.gov/economy](http://www.miamidadecounty.gov/economy)

Phoenix Architectural Products, Inc.  
3075 Jonquil Drive SE  
Smyrna, GA 30080

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: "Sure guard plus 2007" Window Security Barrier System**

**APPROVAL DOCUMENT:** Drawing No. SGP07-12, titled " Sure Guard Plus 2007 / Window Security Barrier System", sheets 1 through 8 of 8, prepared by V.M. Engineering, dated 01/31/2012, last revision #4 dated April 22, 2015, signed and sealed by Morgan Villanueva, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, the following statement: "Miami-Dade County Product Control Approved", and NOA number, per TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #12-0202.02 and consists of this page 1, evidence submitted pages E-1, E-2, & E-3 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



*Helmy A. Makar*  
05/28/2015

NOA No. 15-0427.12  
Expiration Date: 08/02/2017  
Approval Date: 05/28/2015

**Phoenix Architectural Products, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #07-0403.07**

**A. DRAWINGS**

1. *Drawing No. SGP07-01, titled " Sure Guard Plus 2007 / Window Security Barrier System", sheets 1 through 8 of 8, prepared by V.M. Engineering, dated 03/01/2007, last revision #1 dated June 22, 2007, signed and sealed by Morgan Villanueva, P.E.*

**B. TESTS**

1. *Test report on Large Missile Impact Test, Cyclic Wind Pressure Test and Uniform Static Air Pressure Test of 304 Stainless Steel perforated panel window security barrier system, prepared by Fenestration Testing Laboratory, Inc., Report No. 5118, dated November 29, 2006, signed and sealed by Edmundo Largaespada, P.E.*
2. *Test report on Large Missile Impact Test, Cyclic Wind Pressure Test and Uniform Static Air Pressure Test of 304 Stainless Steel perforated panel window security barrier system, prepared by Fenestration Testing Laboratory, Inc., Report No. 5196, dated March 08, 2007, signed and sealed by Michael Wenzel, P.E. and Carlos S. Rionda, P.E.*

**C. CALCULATIONS**

1. *Anchor calculations dated March 26, 2007, 22 pages, prepared by V.M. Engineering, signed and sealed by Morgan Villanueva, P.E.*

**D. QUALITY ASSURANCE**

1. *By Miami-Dade County Building Code Compliance Office.*

**E. MATERIAL CERTIFICATIONS**

1. *Mill Certified Inspection Report issued by North American Stainless, Inc., dated August 15, 2004, with chemical analysis and mechanical properties for 304 Stainless Steel Perforated Panel.*

**2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #09-0701.02**

**A. DRAWINGS**

1. *Drawing No. SGP07-01, titled " Sure Guard Plus 2007 / Window Security Barrier System", sheets 1 through 8 of 8, prepared by V.M. Engineering, dated 05/26/2009, last revision #2 dated May 26, 2009, signed and sealed by Morgan Villanueva, P.E.*

**B. TESTS**

1. *None.*

**C. CALCULATIONS**

1. *None.*



**Helmy A. Makar, M.S., P.E.**  
**Product Control Unit Supervisor**

**NOA No. 15-0427.12**

**Expiration Date: 08/02/2017**

**Approval Date: 05/28/2015**

**Phoenix Architectural Products, Inc.**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE**

1. *By Miami-Dade County Building Code Compliance Office.*

**E. MATERIAL CERTIFICATIONS**

1. *None.*

**3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #12-0202.02**

**A. DRAWINGS**

1. *Drawing No. SGP07-12, titled "Sure Guard Plus 2007 / Window Security Barrier System", sheets 1 through 8 of 8, prepared by V.M. Engineering, dated 01/31/2012, last revision #3 dated June 07, 2012, signed and sealed by Morgan Villanueva, P.E.*

**B. TESTS**

1. *None.*

**C. CALCULATIONS**

1. *None.*

**D. QUALITY ASSURANCE**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS**

1. *None.*

**4. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS**


1. *Drawing No. SGP07-12, titled "Sure Guard Plus 2007 / Window Security Barrier System", sheets 1 through 8 of 8, prepared by V.M. Engineering, dated 01/31/2012, last revision #4 dated April 22, 2015, signed and sealed by Morgan Villanueva, P.E.*

**B. TESTS**

1. *None.*

**C. CALCULATIONS**

1. *None.*



Henry A. Makar, M.S., P.E.  
Product Control Unit Supervisor

NOA No. 15-0427.12

Expiration Date: 08/02/2017

Approval Date: 05/28/2015

**Phoenix Architectural Products, Inc.**


**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS**

1. *None.*



---

**Helmy A. Makar, M.S., P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 15-0427.12**  
**Expiration Date: 08/02/2017**  
**Approval Date: 05/28/2015**

**GENERAL NOTES FOR NOA SCREEN**

1. THIS SHUTTER "SURE GUARD PLUS 2007" HAS BEEN VERIFIED IN ACCORDANCE WITH SECTIONS 1609 OF THE FLORIDA BUILDING CODE EDITION 2014, AS PER TAS 201-94, TAS 202-94 & TAS 203-94 OF THE TEST PROTOCOLS FOR HIGH-VELOCITY HURRICANE ZONES, AND AS PER AMERICAN TESTING LABORATORY WITH TEST REPORT NO. 5118 AND NO. 5196.

THE DESIGN LOADS COMPLY WITH SECTION 1620 OF THE FLORIDA BUILDING CODE EDITION 2014. THE WIND PRESSURES SHOWN ON SHEETS (4 OF 8) AND (5 OF 8) IN THIS DOCUMENTS ARE AS PER FBC 2014 EDITION (ALLOWABLE SERVICE DESIGN), TO OBTAIN THE EQUIVALENT ULTIMATE WIND PRESSURES, DIVIDE THE WIND PRESSURES SHOWN IN THE TABLES ON SHEETS (4 OF 8) AND (5 OF 8) OF THIS DOCUMENT BY 0.6 FACTOR (ULTIMATE FACTOR DESIGN). IN ORDER TO VERIFY THAT ANCHORS ON THIS PRODUCT APPROVAL DOCUMENTS, AS TESTED, WERE NOT OVERSTRESSED, A 33% INCREASE IN ALLOWABLE STRESS FOR WIND LOADS WAS NOT USED IN THEIR ANALYSIS, AND IN THE LABORATORY THE TEST LOAD WAS 50% MORE OF DESIGN LOAD.

THE "SURE GUARD PLUS 2007" IS ADEQUATE FOR IMPACT AND FATIGUE RESISTANCE AS SHOWN IN THE TEST RESULTS FROM LABORATORY. AND LAST BUT NOT LESS, THE "SURE GUARD PLUS 2007" MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES (H.V.H.Z.)"


- 2. ALL COMPONENTS SHALL BE AS PER BILL OF MATERIALS AS SHOWN ON SHEET 3 OF 8.
- 3. FOR ANCHORS INSTALLATION AND SPACING DETAILS REFER TO SHEETS 6 THROUGH 8 OF 8.
- 4. MAX DESIGN PRESSURE:
  - A. FOR BARRIER FRAME SIZE OF 55" X 98" SEE SHEET 4 OF 8 (ALLOWABLE)
  - B. FOR BARRIER FRAME SIZE OF 64" X 124" SEE SHEET 5 OF 8 (ALLOWABLE)
- 5. SELF DRILLING SCREWS SHALL BE ASTM A510-03, ZINC PLATED AS PER ASTM B-633 WITH MIN. TENSILE STRENGTH OF 100 KSI.
- 6. PRODUCT ANCHORS SHALL BE AS LISTED AND SPACED AS SHOWN ON DETAILS ON SHEETS 3, 6, 7 & 8. ANCHOR EMBEDMENT AND EDGE DISTANCE TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
- 7. A LABEL SHALL BE PLACED FOR EVERY OPENING BY THE SCREEN SHUTTER MANUFACTURER AND SHALL BE EXPOSED ON THE SURFACE OF THE FRAME LABEL SHALL READ:

PHOENIX  
ARCHITECTURAL PRODUCT, INC.  
3075 JONQUIL DRIVE SE, SMYRNA, GA 30080  
MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED

- 8. CONTRACTOR SHALL VERIFY THE EXISTING CONDITIONS OF THE OPENINGS WHERE SCREEN SHUTTER WILL BE INSTALLED TO INSURE ADEQUATE SUBSTRATE.
- 9. THE INSTALLATION OF THIS "SURE GUARD PLUS 2007" HIGH VELOCITY SHUTTER SYSTEM SHALL COMPLY WITH THE SPECIFICATIONS INDICATED IN THIS DRAWINGS PLUS ANY BUILDING AND ZONING REGULATIONS PROVIDED BY THE JURISDICTION WHERE PERMIT IS APPLIED TO.
- 10. THIS PRODUCT APPROVAL DOCUMENTS WILL BE VALID ONLY WHEN IT MEETS THE FOLLOWING TERMS:
  - A. PLANS SHALL BE SIGNED AND SEALED BY THE ENGINEER OF RECORD.
  - B. NO MODIFICATIONS AND/OR ALTERATIONS MAY BE MADE BY ANY MEANS.
- 11. THIS PRODUCT APPROVAL DOCUMENTS WAS NOT PREPARED FOR A SPECIFIC SITE.
- 12. SCREEN SHUTTER DETAILS:
  - A. FRAME SHALL BE EXTRUDED ALUMINUM, CORNERS ARE MITERED BLURTED AND WELDED INCLUDING MID HEIGHT RAIL CONNECTION TO JAMBS WELDING AS PER AMERICAN WELDING SOCIETY D1.2 LATEST EDITION.
  - B. EACH PANEL IS MADE UP OF EXTRUDED ALUMINUM 6063-T6. FRAME MITERED AND ADDITIONALLY JOINED AT THE CORNERS WITH ALUMINUM PLATE (COMPONENT 17) AS SHOWN ON SHEET 2 OF 8.
  - C. SCREEN SHALL BE STAINLESS STEEL 14 GA. (0.075" THICKNESS) AISI 304 SERIES PER ASTM A240, WITH MIN. YIELD STRENGTH OF 40,000 PSI. THE PERFORATED SCREEN HAS CLEAR HOLES (0.1875"φ) SPACED AT 0.25" CENTER TO CENTER STAGGERED. IN ONE INCH SQUARE ARE 16 HOLES WHICH MEANS 44% OF SCREEN IS POROUS.
  - D. FOR FASTENING OF SCREEN REFER TO NOTE 1 OF SHEET 3, MINIMUM EDGE DISTANCE PER FASTENING SCREW/EDGE OF SCREEN IS 1/2" FROM CENTER OF HOLES.
  - E. THE OPERABLE PANELS ARE SECURED WITH A CONTINUOUS CIE-8 (COMPONENT 11) PLUS A SURFACE BOLT AND STRIKE PLATE (COMPONENT 20) AS SHOWN ON SHEET 5 OF 8.

**PHOENIX**  
ARCHITECTURAL PRODUCTS, INC.  
SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
TEL 770.803.6380 FAX 770.803.6388  
www.phoenixwindows.com

**SURE GUARD PLUS 2007**  
WINDOW SECURITY BARRIER SYSTEM



**V.M. Engineering, Inc.**  
of A. No. 27633  
1278 S.W. 153rd Place  
MIAMI, FLORIDA 33196  
TEL: 786-281-6968  
TEL: 305-383-5896




PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0427.12  
Expiration Date 08/02/2017  
By: *[Signature]*  
Miami Dade Product Control


REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
DATE: 4-22-15  
**F.B.C.**  
(High Velocity Hurricane Zone)  
DWG No: **SGP07-12**  
SHEET 1 OF 8


MIAMI-DADE COUNTY

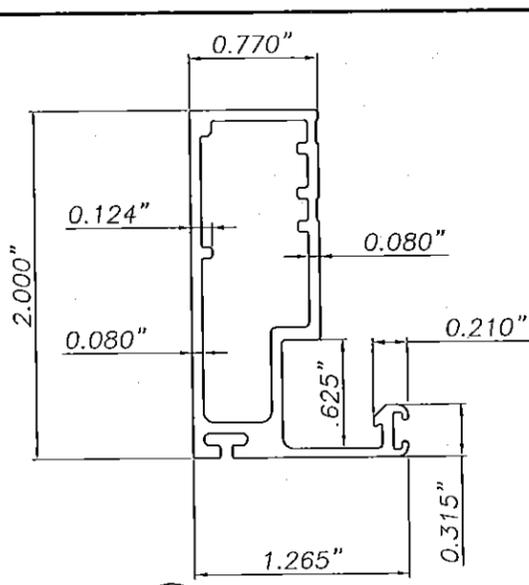


② PAPI-2

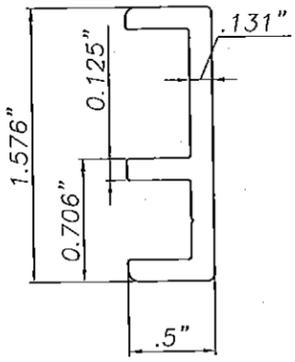


⑱ PAPI-5

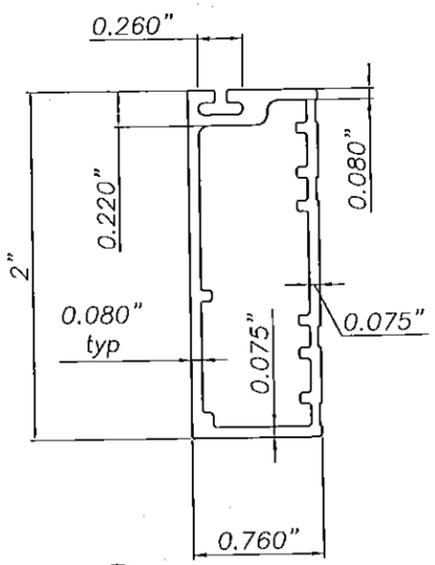


⑦ PAPI-6

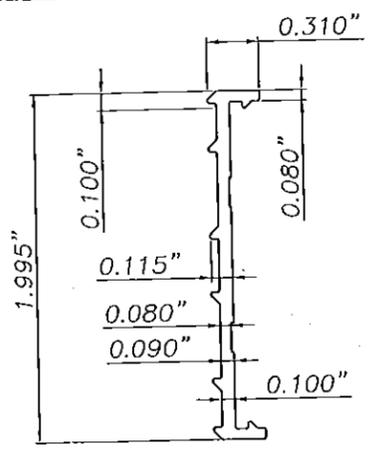


⑯ PAPI-7

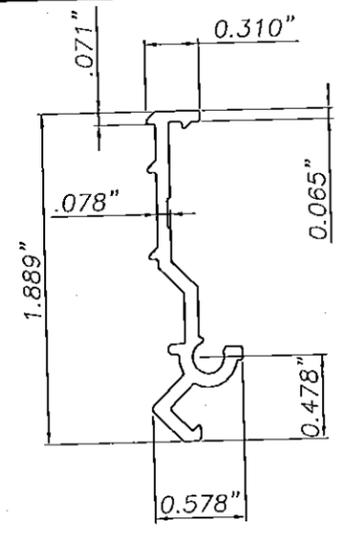


④ PAPI-9

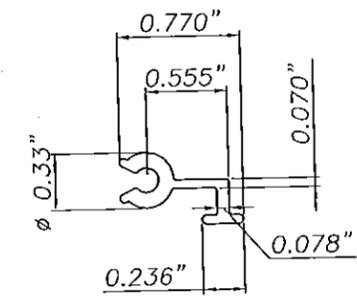


⑮ PAPI-3

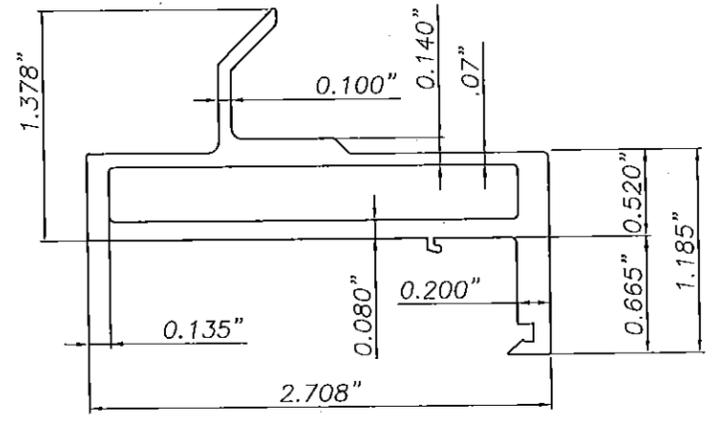


⑥ PAPI-10

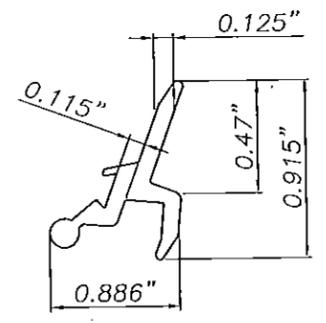


⑪ PAPI-8

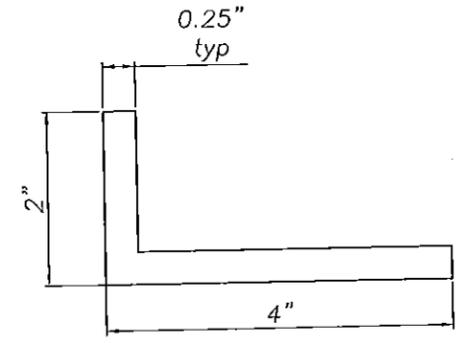

⑫ "L BAR"

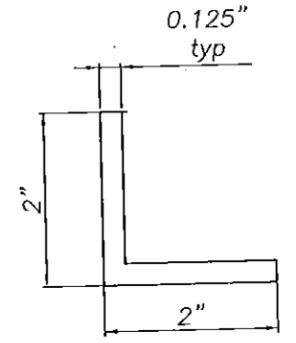


⑬ "L BAR"

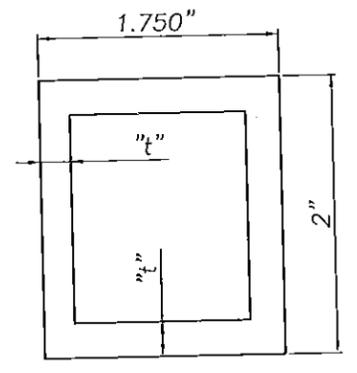


⑧ EXT. ALUM. TUBE


"t"	MULLION SPAN
1/8"	< 98"
1/4"	> 98" < 124"

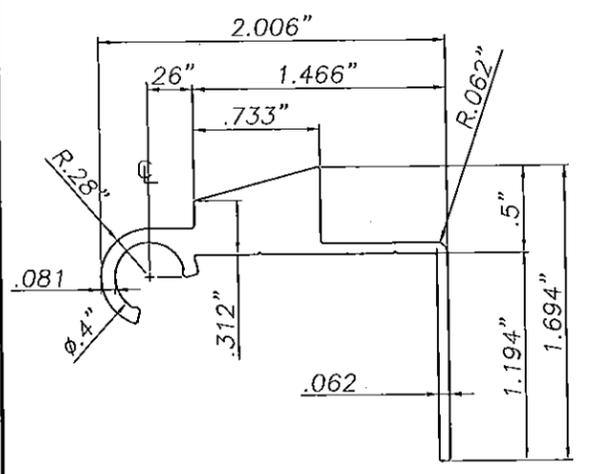


⑩ PAPI-4

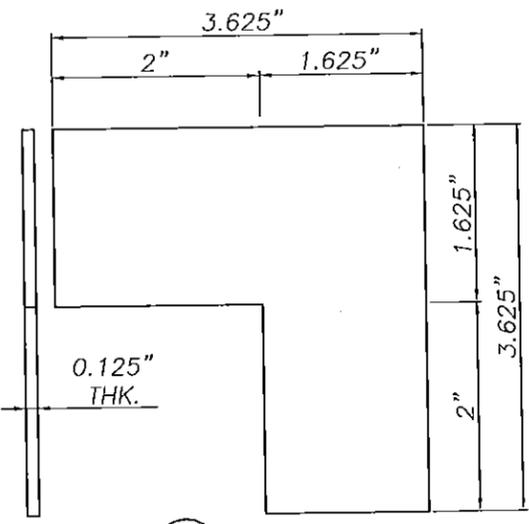

⑰ SP-7

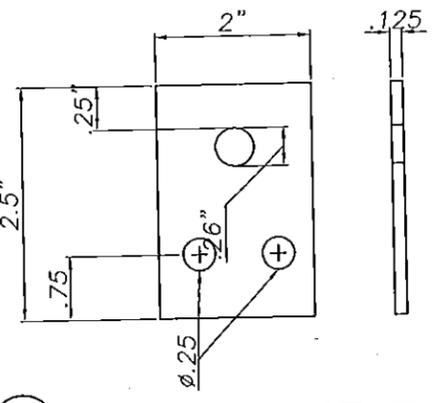

⑳ SURFACE BOLT & STEEL STRIKE PLATE

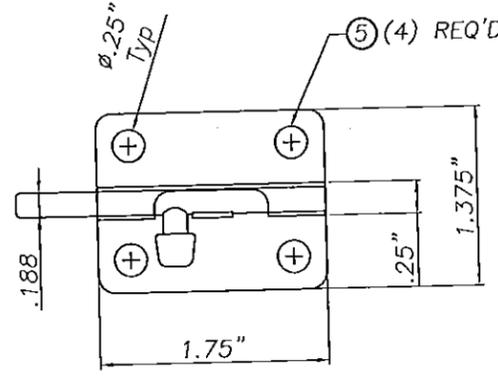

⑤ (4) REQ'D

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0427.12  
Expiration Date 08/02/2017  
By *[Signature]*  
Miami Dade Product Control

MIAMI-DADE COUNTY

**PHOENIX**  
ARCHITECTURAL PRODUCTS, INC.  
SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
TEL 770.803.6380 FAX 770.803.6388  
www.phoenixwindows.com

PRODUCT:  
**SURE GUARD PLUS 2007**  
WINDOW SECURITY BARRIER SYSTEM

**V.M.**  
Engineering, Inc.  
of A. No. 27633  
11278 S.W. 153rd Place  
MIAMI, FLORIDA 33196  
TEL: 786-281-6868  
TEL: 305-383-5896

**MORGAN VILLANUEVA**  
LICENSE  
No. 60202  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
6090

REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
DATE: 4-22-15



**F.B.C.**  
(High Velocity Hurricane Zone)

DWG No: **SGP07-12**

SHEET 2 OF 8



# METAL TO METAL SCREWS NOTES

**NOTE: 1**  
FOUR SCREWS IN EACH CORNER LEG 4" FROM EA. END AND (3) SPACED 2" O.C., THEN CONTINUOUS 6" O.C..

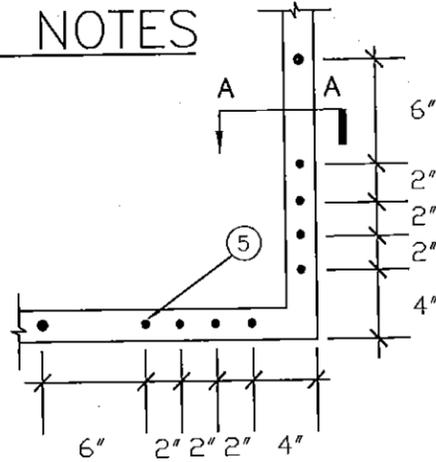

SECTION A-A

**NOTE: 3**  
SCREWS 6" O.C. STAGGERED, SPACED 2.5" MAX. FROM TOP & BOTTOM.

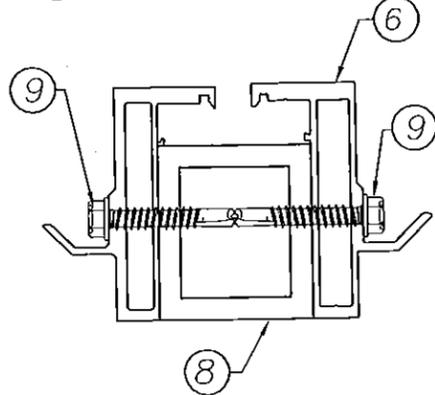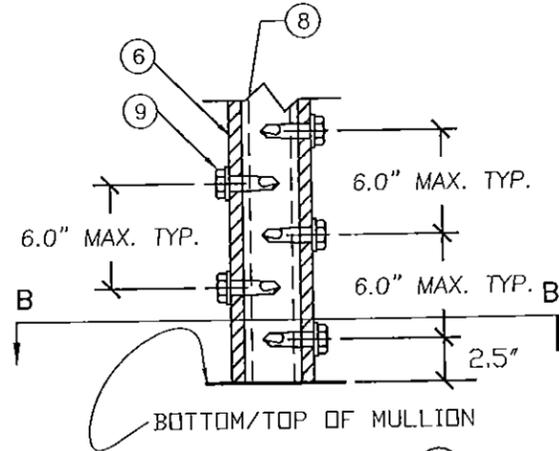

SECTION B-B

# BILL OF MATERIALS

ITEM	DESCRIPTION	MATERIAL MANUFACTURER
①	Perforated Screen (Stainless Steel)	14 GA Stainless Steel
②	Sash Frame PAPI-2	Alum. 6063-T6
③	Weather-strip (Hope Webbing)	Wool Pyle
④	Retainer PAPI-9	Alum. 6063-T6
⑤	#10x3/4" S.D.S. Hex Head Screw	ASTM A-510
⑥	Exterior Frame PAPI-10	Alum. 6063-T6
⑦	Exterior Sash PAPI-6	Alum. 6063-T6
⑧	1 3/4"x2"x1/8" Alum Mullion For 98" Barrier Height 1 3/4"x2"x1/4" Alum. Mullion for Barrier greater than 98" height up to 124" height	Alum. 6063-T6
⑨	#14x1 1/2" S.D.S. HEX HEAD SCREW	ASTM A-510
⑩	Female Hinge PAPI-4	Alum. 6063-T6
⑪	Latch Mechanism PAPI-8	Alum. 6063-T6
⑫	4"x2"x1/4" Alum. Angle	Alum. 6063-T6
⑬	2"x2"x1/8" Alum. Angle	Alum. 6063-T6
⑭	1/4" Ø Tapcon Anchor (min 1 1/4" embed. to block & 1 3/4" to concrete)	ITW BUILDEX
⑮	Male Hinge PAPI-3	Alum. 6063-T6
⑯	Interior Sash PAPI-7	Alum. 6063-T6
⑰	CORNER SUPPORT SP-7	Alum. 3003-H14
⑱	Reinforcement PAPI-5	Alum. 6063-T6
⑲	#10x1" S.D.S. Hex Head Screw	ASTM A-510
⑳	SURFACE BOLT & STEEL PLATE	BRAINERD MFG. CO. MODEL # B5210

**PHOENIX**  
ARCHITECTURAL PRODUCTS, INC.  
SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
TEL 770.803.6380 FAX 770.803.6388  
www.phoenixwindows.com

PRODUCT:  
**SURE GUARD PLUS 2007**  
WINDOW SECURITY BARRIER SYSTEM

**V.M. Engineering, Inc.**  
C. of A. No. 27633  
1278 S.W. 153rd Place  
MIAMI, FLORIDA 33196  
TEL: 786-281-6868  
TEL: 305-383-5896


**MORGAN VILLANUEVA**  
LICENSE  
No. 80292  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
MORGAN VILLANUEVA  
LICENSED PROFESSIONAL ENGINEER  
FLORIDA

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No 15-0427.12  
Expiration Date 08/02/2017  
By *[Signature]*  
Miami Dade Product Control


MIAMI-DADE COUNTY

REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
DATE: 4-22-15  
**F.B.C.**  
(High Velocity Hurricane Zone)  
DWG No: SGP07-12  
SHEET 3 OF 8

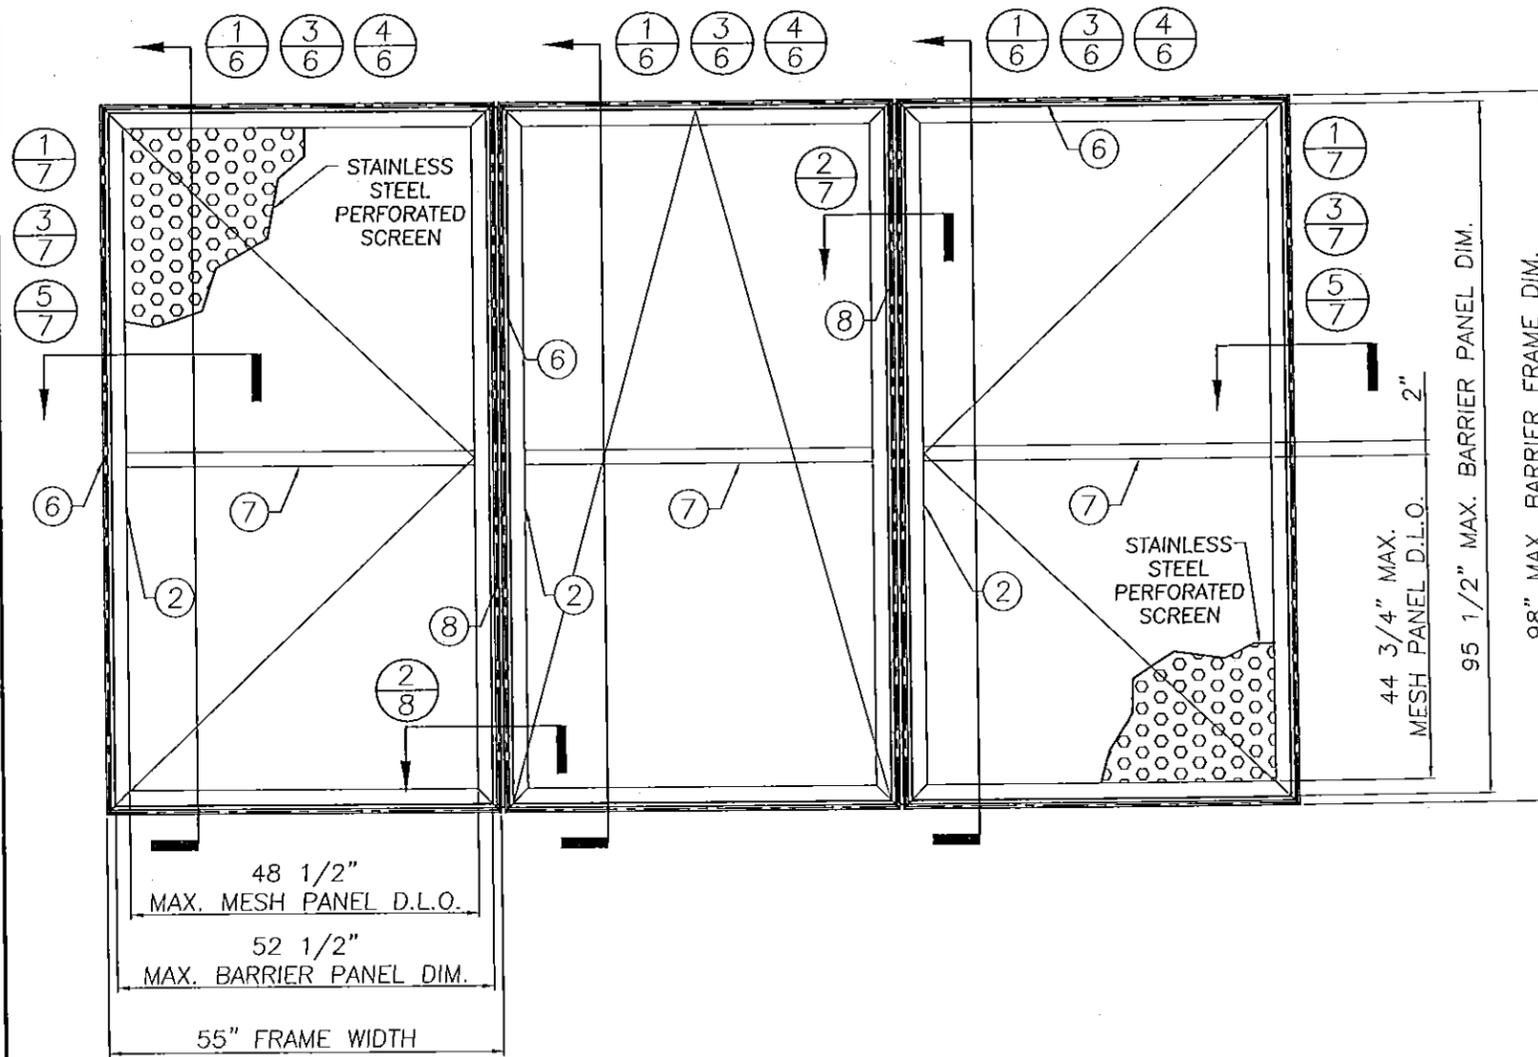

MULTIPLE PANEL ELEVATION  
(55"x98" MAX. BARRIER FRAME)

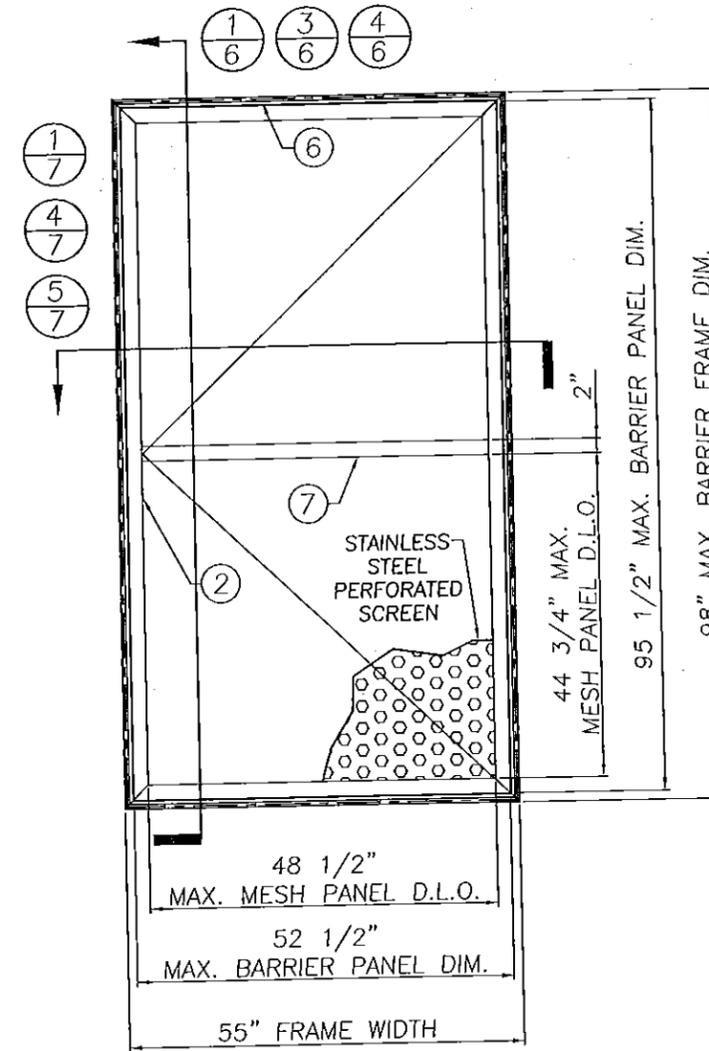


SINGLE PANEL ELEVATION  
(55"x98" MAX. BARRIER FRAME)

DESIGN PRESSURE RATING: (ALLOWABLE)  
 POSITIVE 100 psf      NEGATIVE 144 psf  
 TESTED AS PER TAS 201, 202, 203 IMPACT  
 MISSILE (80 ft/sec & 9 lbs)

NOTE: BARRIER SCREENS MAY BE USED AS  
 SINGLE OR UNLIMITED NUMBER OF HORIZONTAL  
 OR VERTICAL PANELS.

**PHOENIX**  
 ARCHITECTURAL PRODUCTS, INC.  
 SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
 3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
 TEL 770.803.6380 FAX 770.803.6388  
 www.phoenixwindows.com

**SURE GUARD PLUS 2007**  
 WINDOW SECURITY BARRIER SYSTEM



**V.M.**  
 Engineering, Inc.  
 6 of A. No. 27633  
 11278 S.W. 153rd Place  
 MIAMI, FLORIDA 33196  
 TEL: 786-281-6968  
 TEL: 305-383-5896




PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 15-0427.12  
 Expiration Date 08/02/2017  
 By *[Signature]*  
 Miami Dade Product Control


REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
 DATE: 4-22-15  
**F.B.C.**  
 (High Velocity Hurricane Zone)  
 DWG No: SGP07-12  
 SHEET 4 OF 8

MIAMI-DADE COUNTY

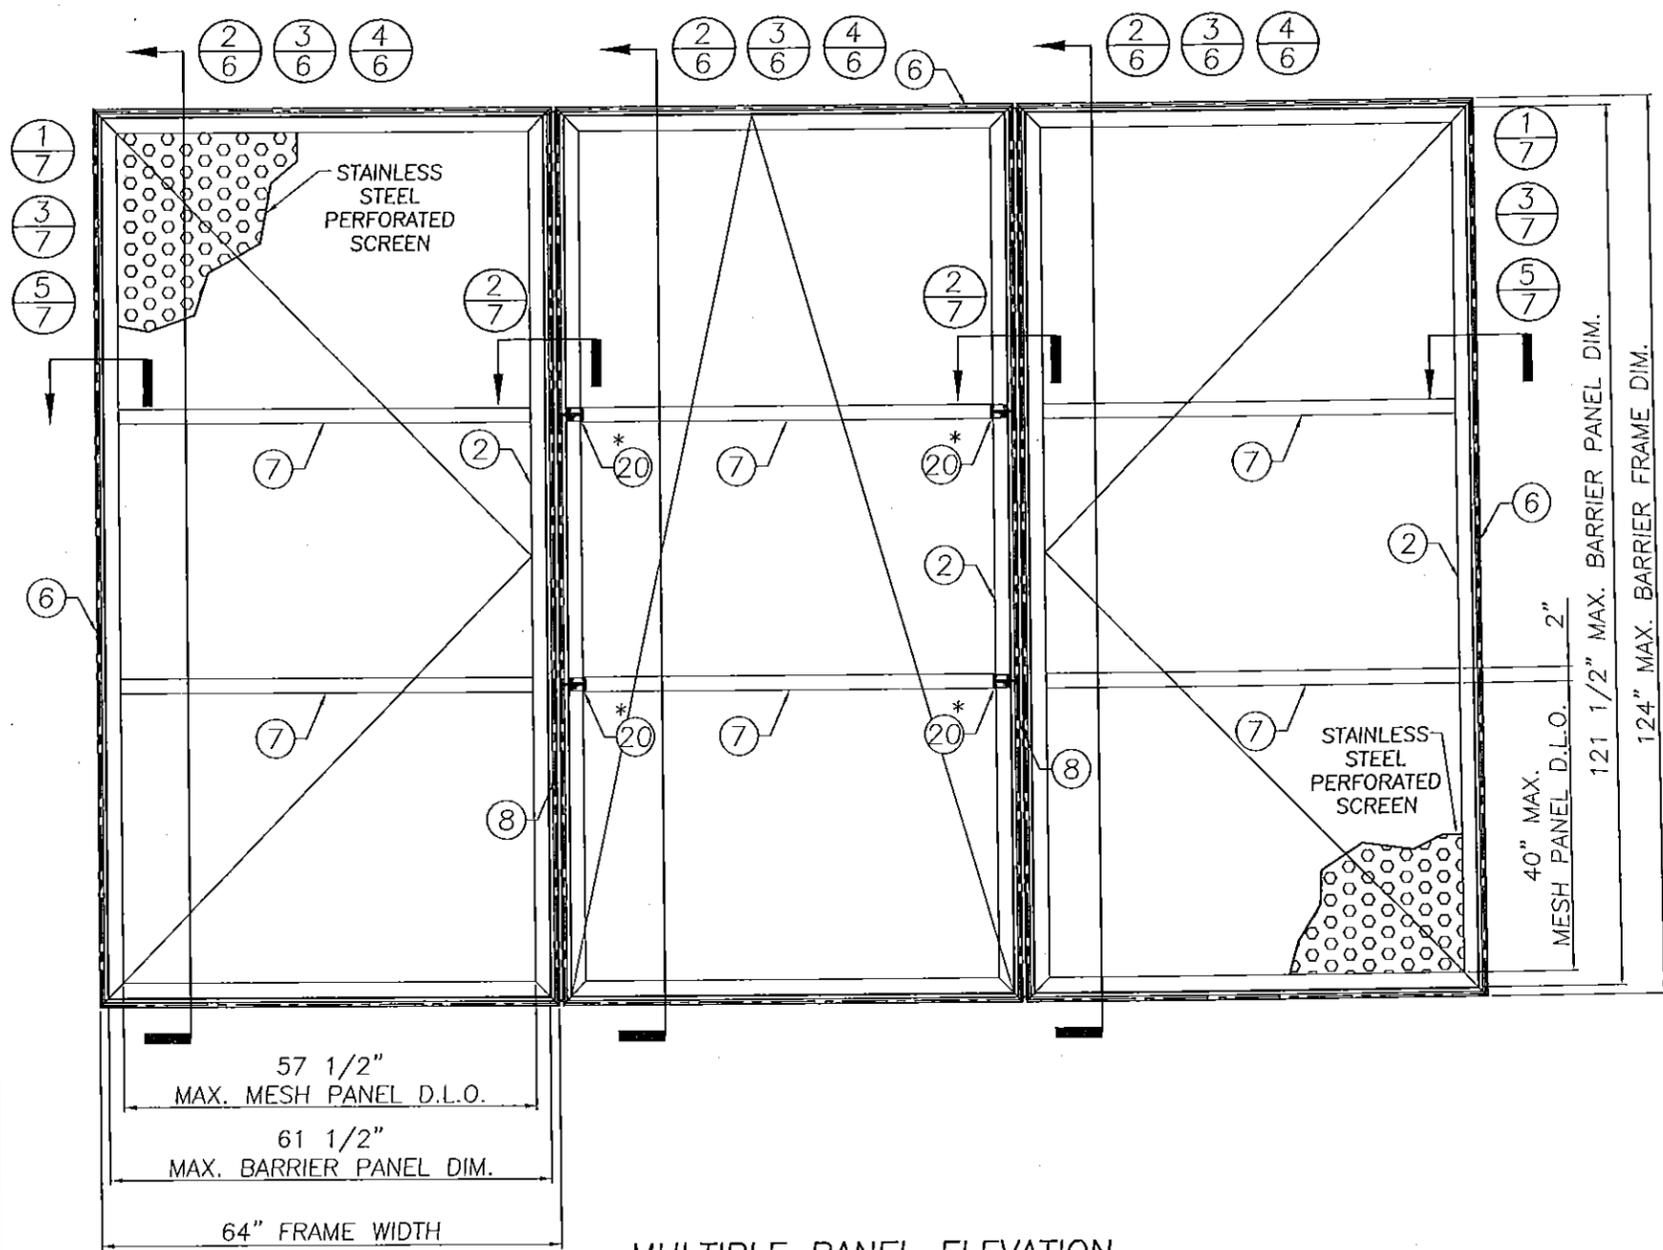

**MULTIPLE PANEL ELEVATION**  
(64"x124" MAX. BARRIER FRAME)

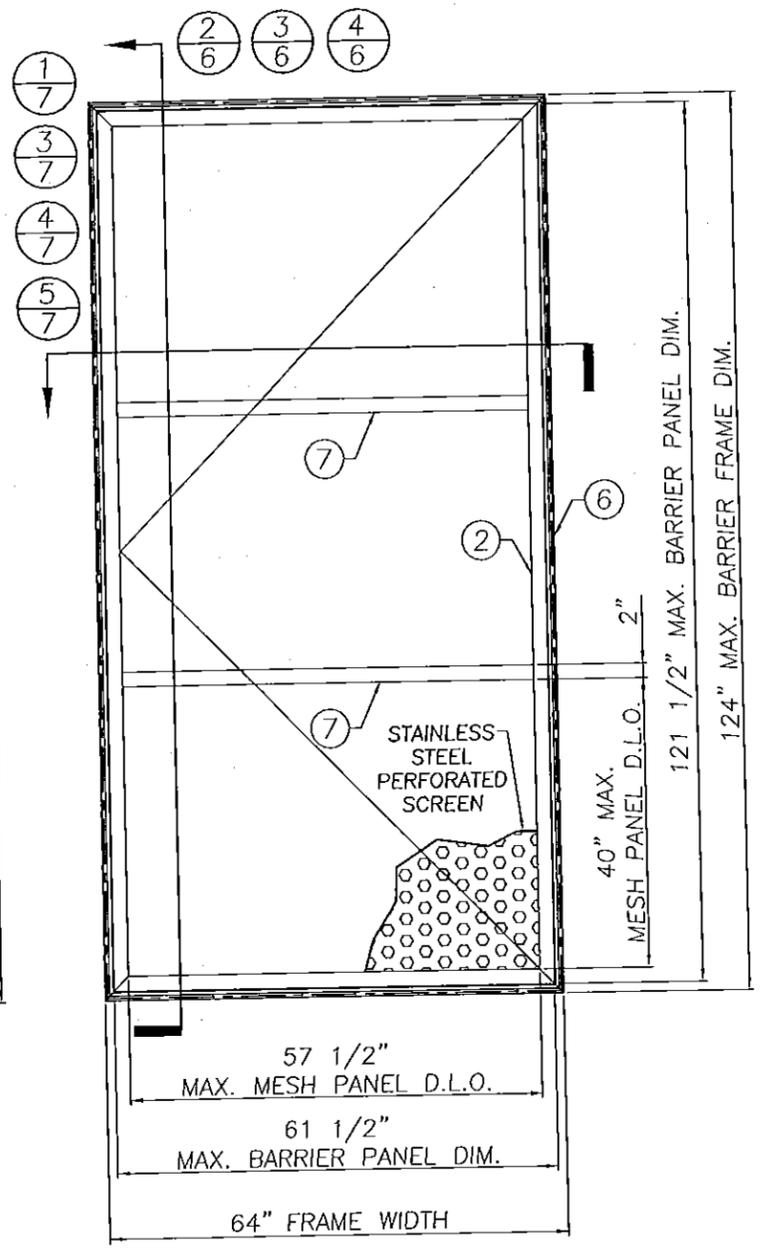

**SINGLE PANEL ELEVATION**  
(64"x124" MAX. BARRIER FRAME)

DESIGN PRESSURE RATING: (ALLOWABLE)  
 POSITIVE 110 psf    NEGATIVE 110 psf  
 TESTED AS PER TAS 201, 202, 203  
 IMPACT MISSILE (50 ft/sec & 9 lbs)


NOTE: BARRIER SCREENS MAY BE USED AS  
 SINGLE OR UNLIMITED NUMBER OF HORIZONTAL  
 OR VERTICAL PANELS.

\* USE ONE PAIR OF SURFACE BOLT 20 AT TOP  
 OR BOTTOM SASH AS SHOWN FOR TOP HINGE  
 BARRIERS ONLY WITH MORE THAN 98" HEIGHT.

**PHOENIX**  
 ARCHITECTURAL PRODUCTS, INC.  
 SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
 3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
 TEL 770.803.6380 FAX 770.803.6388  
 www.phoenixwindows.com

PRODUCT:  
**SURE GUARD PLUS 2007**  
 WINDOW SECURITY BARRIER SYSTEM

**V.M. Engineering, Inc.**  
 C. of A. No. 27633  
 11278 S.W. 153rd Place  
 MIAMI, FLORIDA 33196  
 TEL: 786-281-6968  
 TEL: 305-363-5896

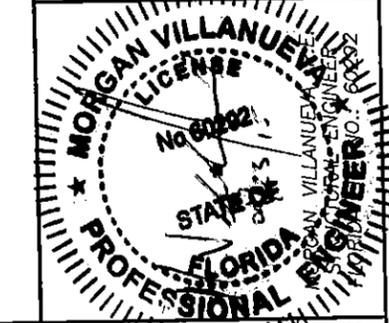


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 15-0427-12  
 Expiration Date 08/02/2017  
 By *Heidi A. Miller*  
 Miami Dade Product Control

MIAMI-DADE COUNTY


REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
 DATE: 4-22-15  
**F.B.C.**  
 (High Velocity Hurricane Zone)  
 DWG No: **SGP07-12**  
 SHEET 5 OF 8

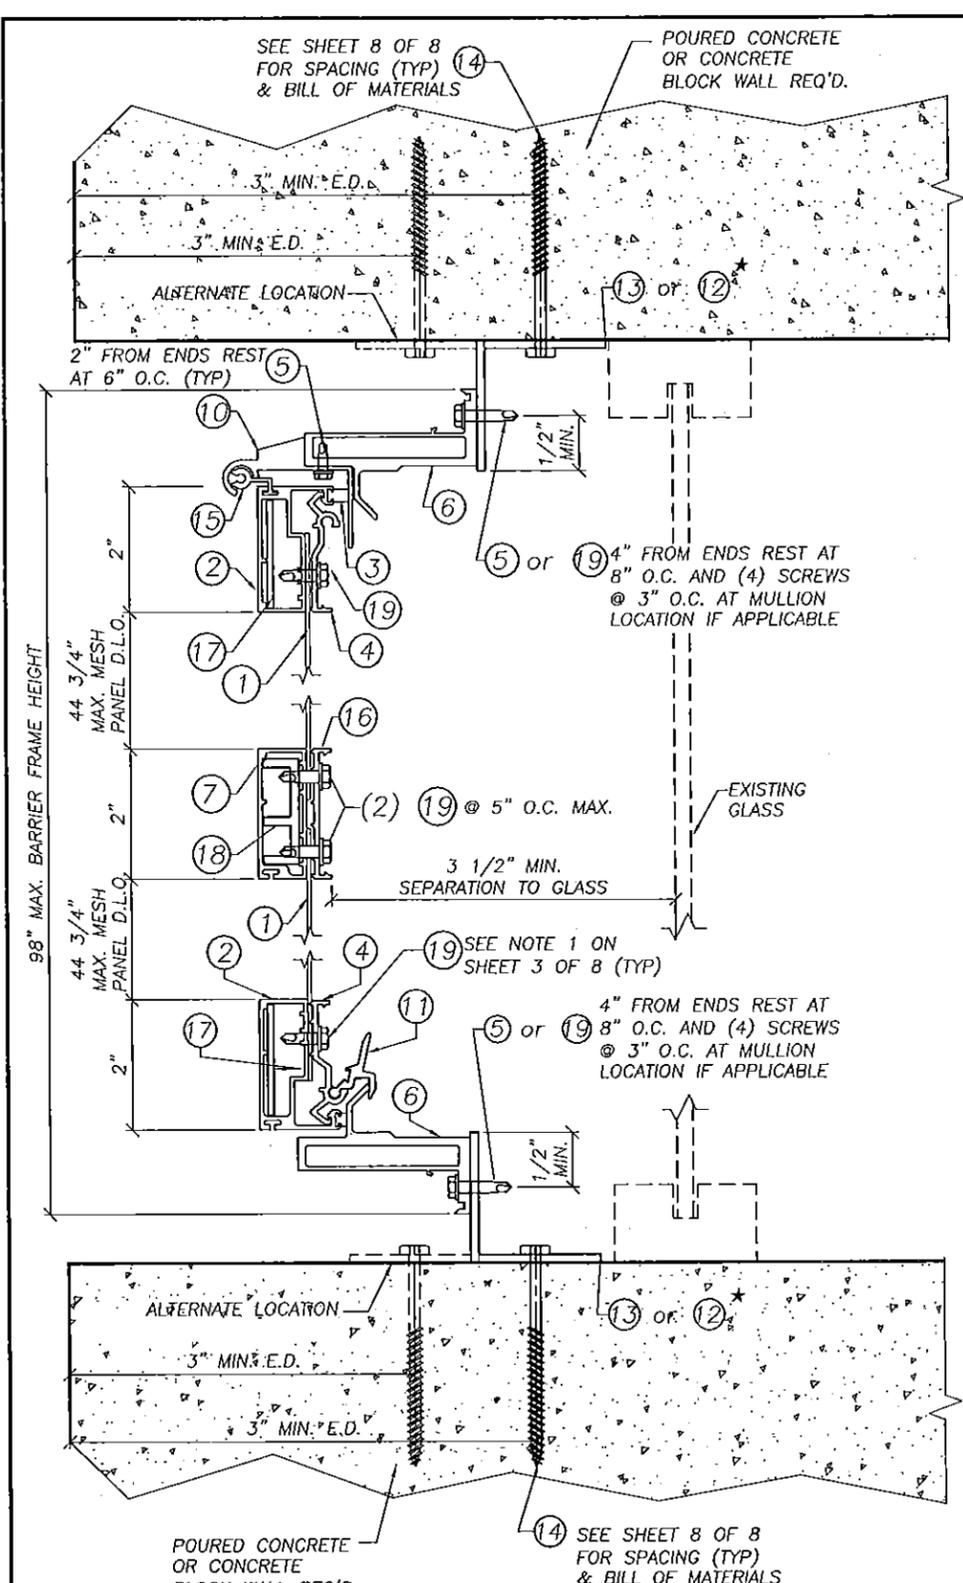


1 VERTICAL CROSS SECTION Side/Top Hinge

\* USE COMPONENT 13. FOR MORE BUILD OUT USE COMPONENT 12

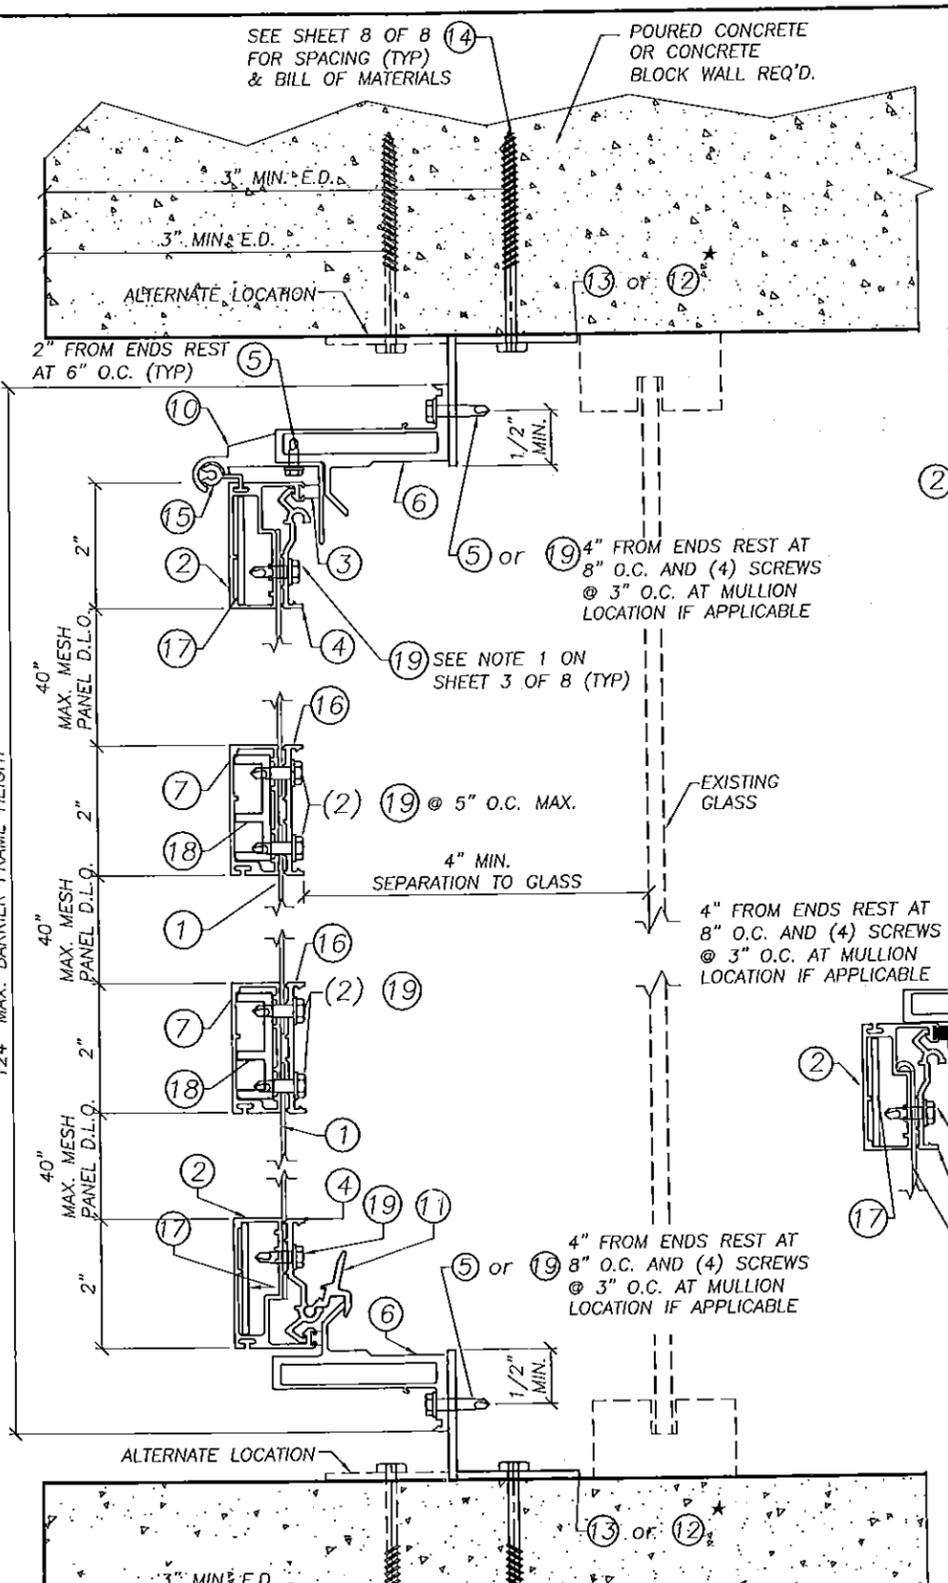


2 VERTICAL CROSS SECTION Side/Top\* Hinge

\* TOP HINGE BARRIES USE SURFACE BOLTS @ SASH LOCATION AS SHOWN ON SHEET 5 OF 8 ONLY FOR BARRIES GREATER THAN 98" HIGH

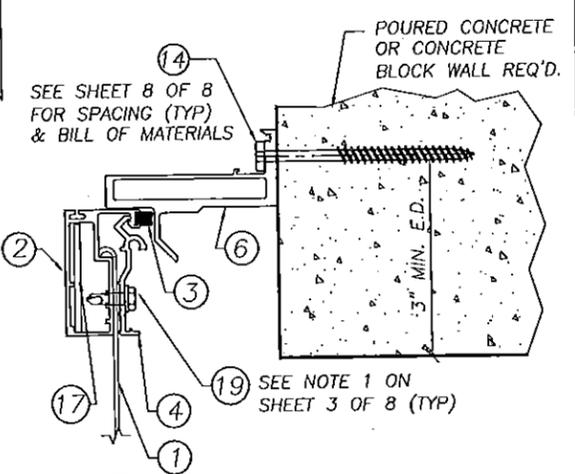

3 VERTICAL CROSS SECTION Optional Surface Mount Method Side/Top Hinge

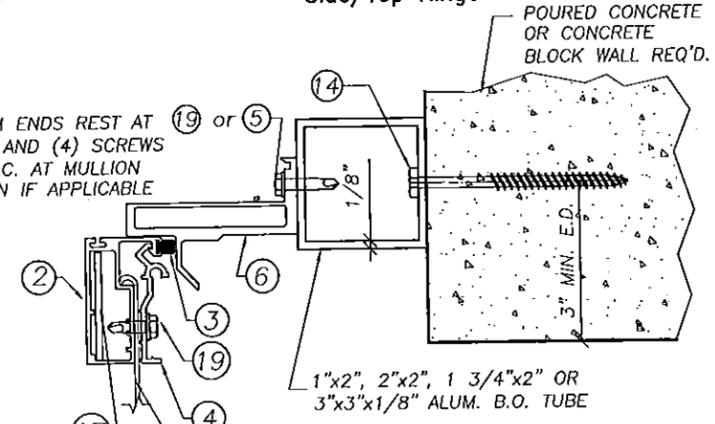

4 VERTICAL CROSS SECTION Optional Buildout Mount Method Side/Top Hinge

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 15-0427,12 Expiration Date 08/02/2017  
By *[Signature]*  
Miami Dade Product Control

MIAMI-DADE COUNTY

**PICO**  
ARCHITECTURAL PRODUCTS, INC.  
SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
TEL 770.803.6380 FAX 770.803.6388  
www.phoenixwindows.com


PRODUCT: **SURE GUARD PLUS 2007**  
WINDOW SECURITY BARRIER SYSTEM

**V.M. Engineering, Inc.**  
C. of A. No. 27633  
11278 S.W. 153rd Place  
MIAMI, FLORIDA 33196  
TEL: 786-281-6968  
TEL: 305-383-5896

**MORGAN VILLANUEVA**  
LICENSED PROFESSIONAL ENGINEER  
STATE OF FLORIDA  
No. 92299

REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
DATE: 4-22-15  
**F.B.C.**  
(High Velocity Hurricane Zone)  
DWG No: **SGP07-12**  
SHEET 6 OF 8

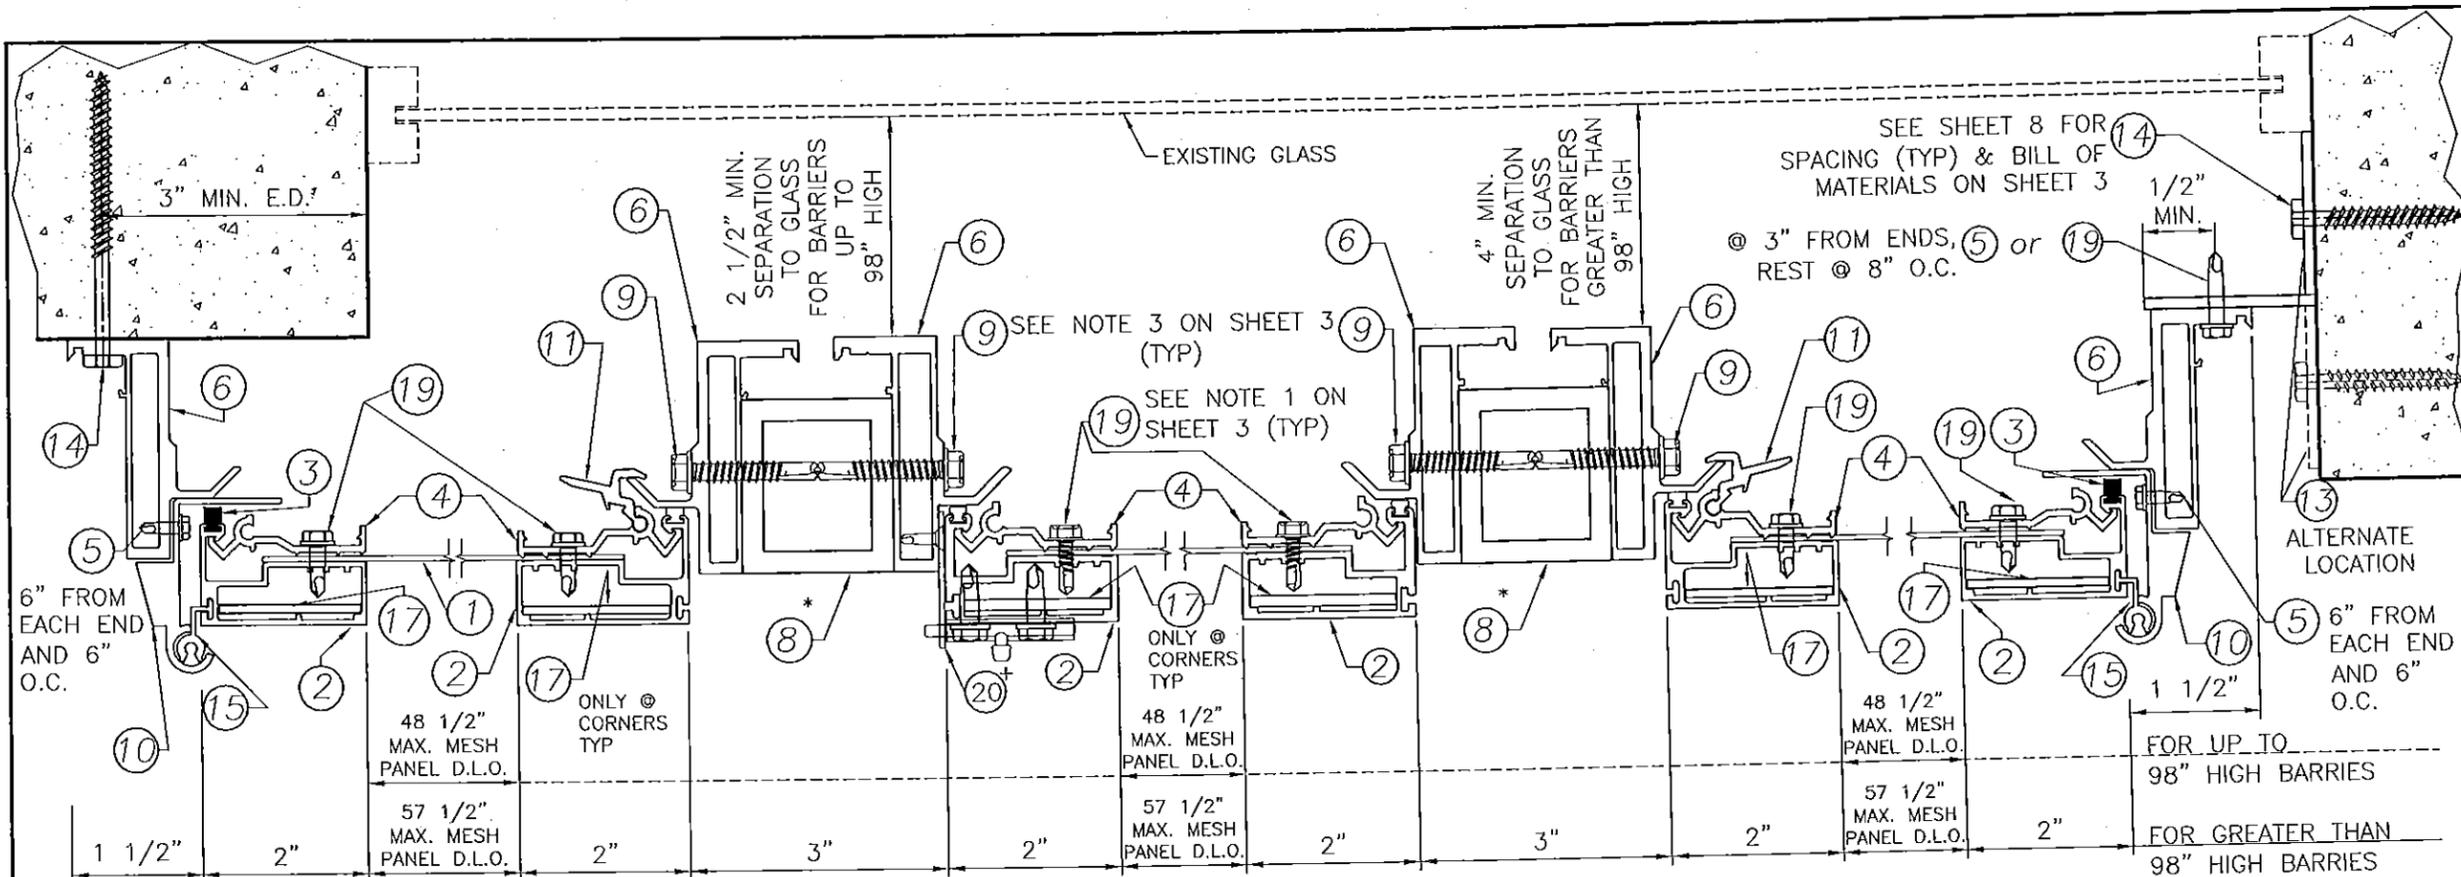

**PICTA**  
**ARCHITECTURAL PRODUCTS, INC.**  
 SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
 3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
 TEL 770.803.6380 FAX 770.803.6388  
 www.picta.com

PRODUCT:  
**SURE GUARD PLUS 2007**  
 WINDOW SECURITY BARRIER SYSTEM



**V.M.**  
**Engineering, Inc.**  
 11278 S.W. 153rd Place  
 MIAMI, FLORIDA 33196  
 TEL: 786-281-6968  
 TEL: 305-383-5696



**1** HORIZONTAL CROSS SECTION  
 MULTIPLE/SINGLE PANELS  
 Side Hinge - Wall Mounted

**2** HORIZONTAL CROSS SECTION  
 MULTIPLE/SINGLE PANELS  
 Top Hinge - Intermediate Barrier

**3** HORIZONTAL CROSS SECTION  
 MULTIPLE/SINGLE PANELS  
 Side Hinge - Trapped Barrier

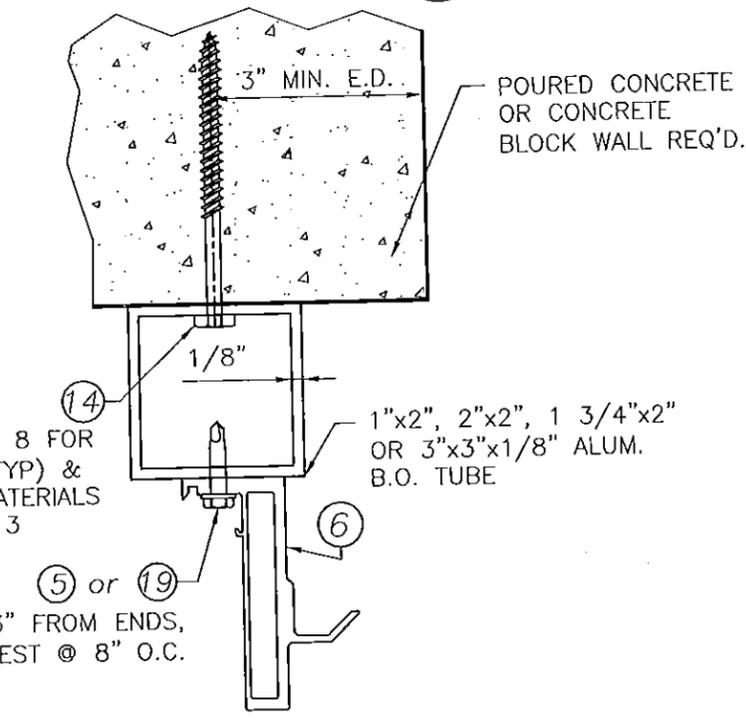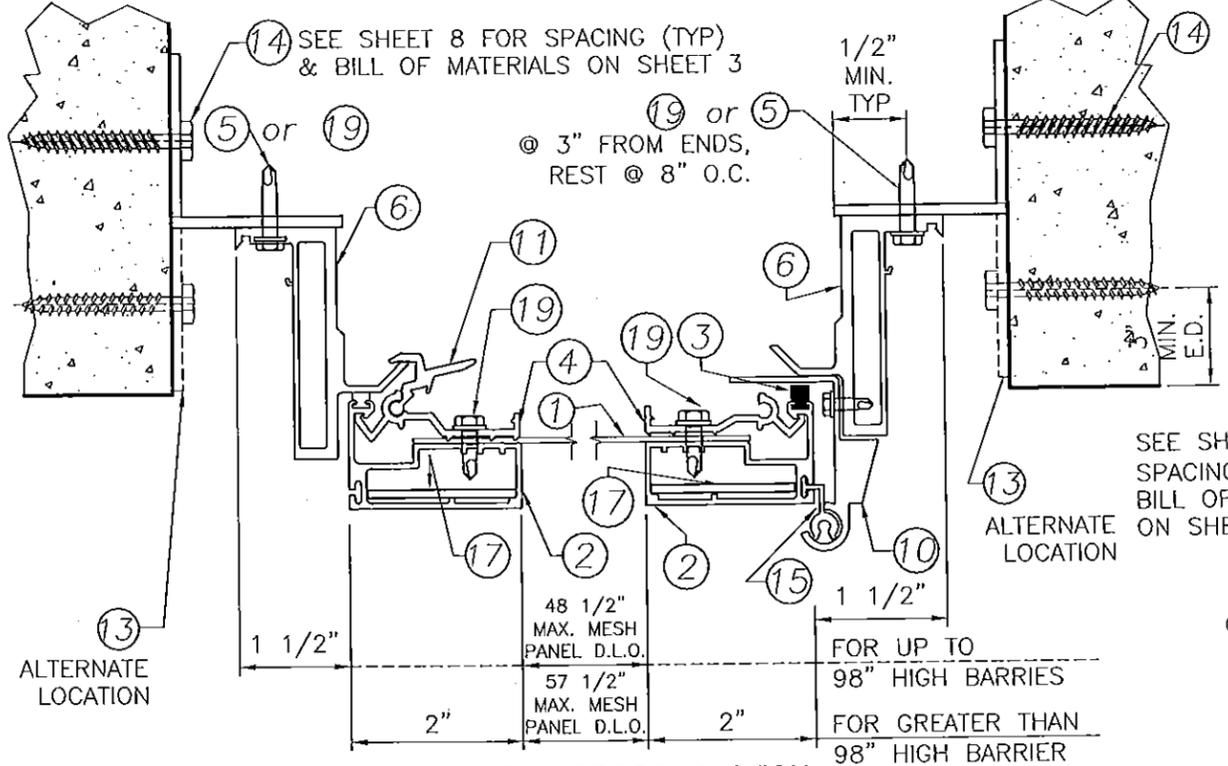

**4** HORIZONTAL CROSS SECTION  
 SINGLE PANEL  
 Side/Top Hinge - Trapped Barrier

**5** HORIZONTAL CROSS SECTION  
 Optional Buildout Mount Method  
 Side/Top Hinge

+ USE (20) ONLY FOR BARRIER GREATER THAN 98" HIGH FRAME SIZE AND TOP HINGE SEE SHEET 5 FOR LOCATION

\* USE (8) W/1/8" THICKNESS FOR BARRIERS UP TO 98" HIGH FRAME SIZE AND USE (8) W/1/4" THICKNESS FOR BARRIERS GREATER THAN 98" HIGH FRAME SIZE


PRODUCT REVISED  
 as complying with the Florida Building Code  
 Acceptance No 15-0427.12  
 Expiration Date 08/02/2017

By *[Signature]*  
 Miami Dade Product Control

REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15


SCALE: AS SHOWN  
 DATE: 4-22-15  
**F.B.C.**  
 (High Velocity Hurricane Zone)  
 DWG No: **SGP07-12**  
 SHEET 7 OF 8

MIAMI-DADE COUNTY

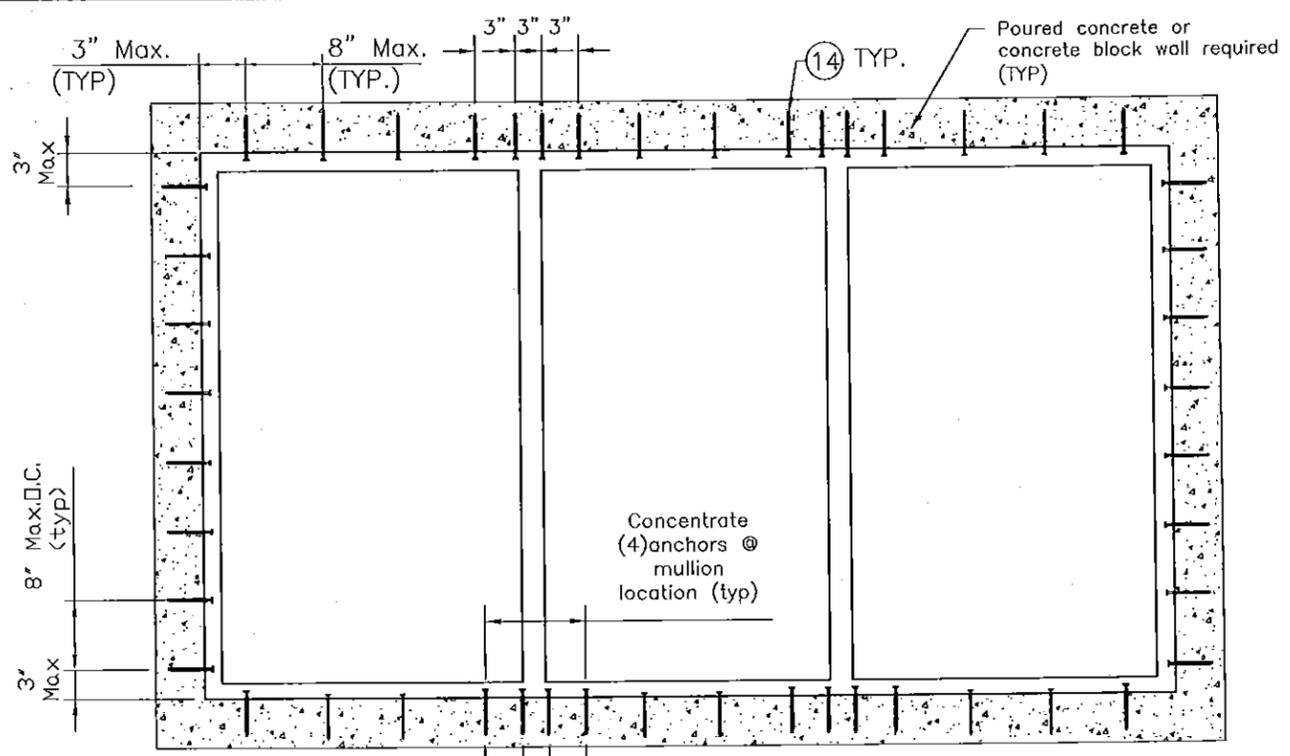


**MULTIPLE PANELS (UNLIMITED)**

**ANCHORAGE FOR INSIDE MOUNTINGS**

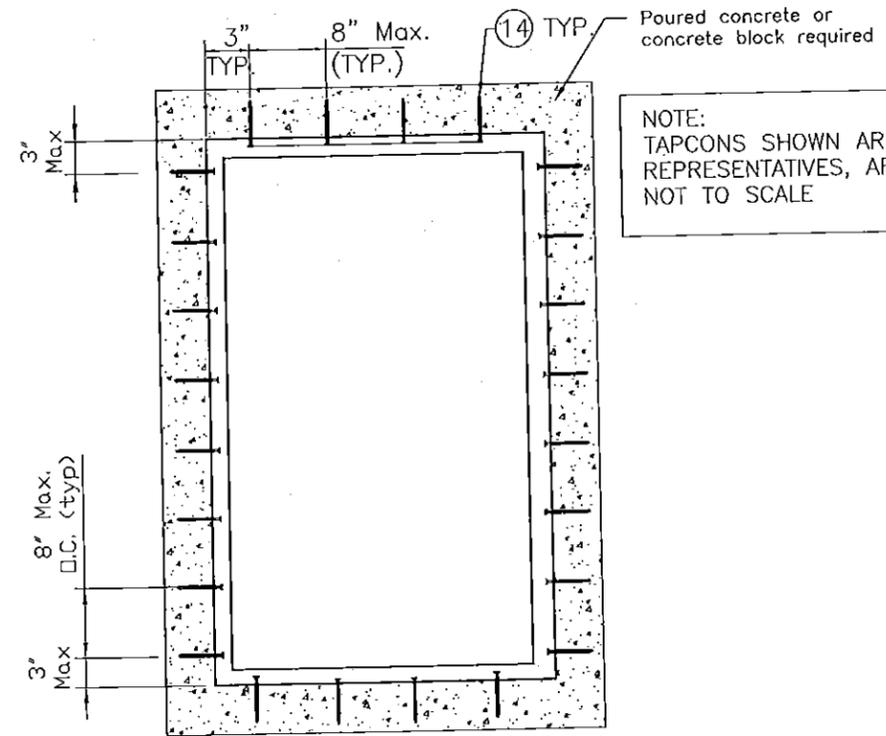


**SINGLE PANEL**

NOTE:  
TAPCONS SHOWN ARE  
REPRESENTATIVES, ARE  
NOT TO SCALE

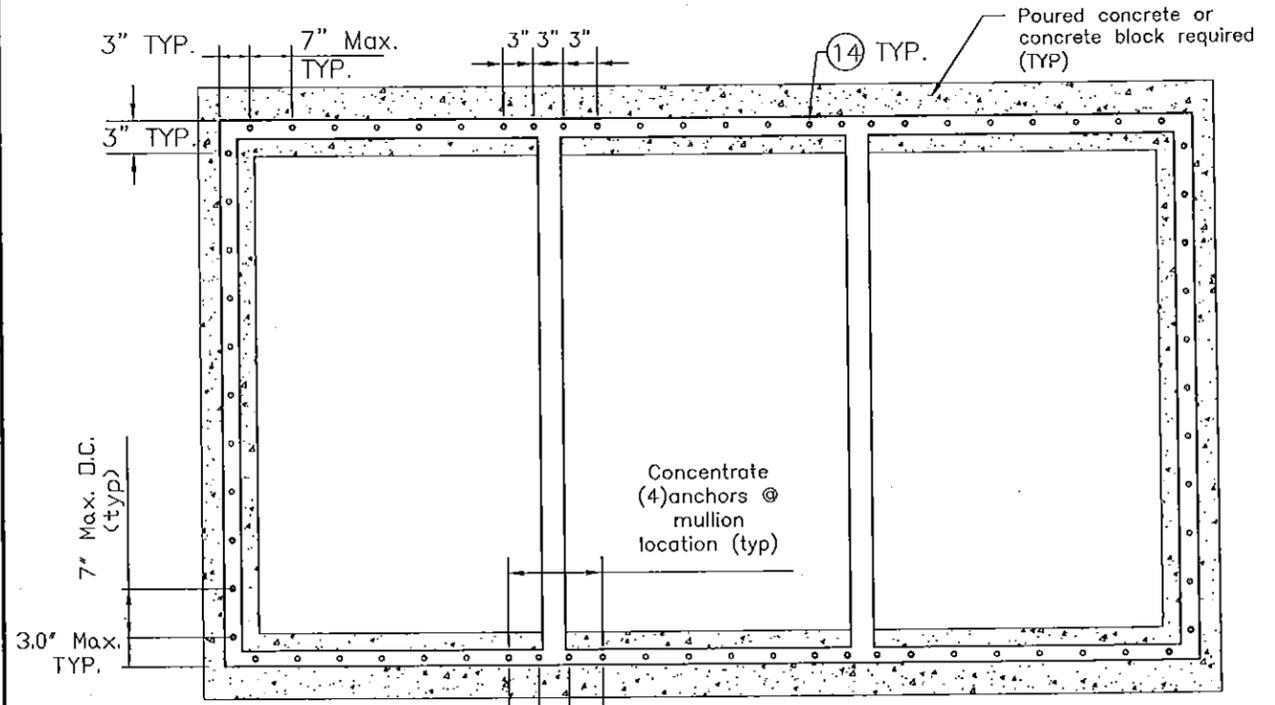

**MULTIPLE PANELS (UNLIMITED)**

**ANCHORAGE FOR SURFACE MOUNTINGS**

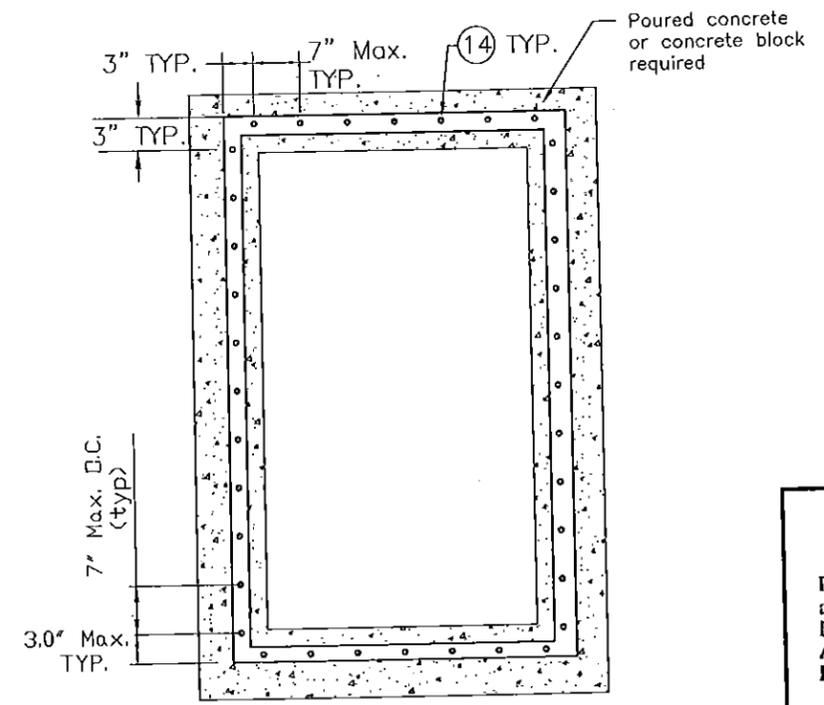


**SINGLE PANEL**



**ARCHITECTURAL PRODUCTS, INC.**  
SECURITY BARRIERS, ALUMINUM WINDOWS & DOORS  
3075 JONQUIL Drive, S.E., Smyrna, GA 30080  
TEL 770.803.6380 FAX 770.803.6388  
www.phoenixwindows.com

**SURE GUARD PLUS 2007**  
WINDOW SECURITY BARRIER SYSTEM

**V.M. Engineering, Inc.**  
C. of A. No. 27633  
11278 S.W. 153rd Place  
MIAMI, FLORIDA 33196  
TEL: 786-281-6968  
TEL: 305-383-5896

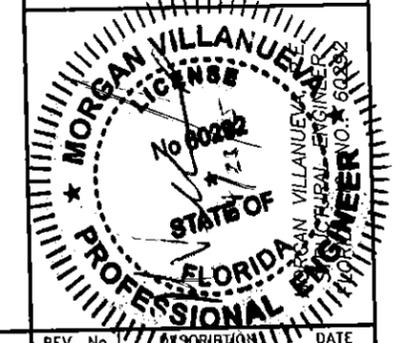

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0427.12  
Expiration Date 08/02/2017  
By *[Signature]*  
Miami Dade Product Control

MIAMI-DADE COUNTY

REV. No	DESCRIPTION	DATE
1	GENERAL	6-22-07
2	RENEWAL AS PER FBC 2007	5-26-09
3	RENEWAL AS PER F.B.C. 2010	6-7-12
4	RENEWAL AS PER F.B.C. 2014	4-22-15

SCALE: AS SHOWN  
DATE: 4-22-15  
**F.B.C.**  
(High Velocity Hurricane Zone)  
DWG No: SGP07-12  
SHEET 8 OF 8