MIAMI-DADE COUNTY
DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

EGS International, LLC
3133 S.W. 25th Street
Pembroke Park, FL 33009

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Atlantic Series Aluminum Sliding Glass Door – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W04-64 Rev H,** titled "Atlantic Series LM 130 Alum Sliding Glass Door", sheets 1 through 8 of 8, prepared by AL-Farooq Corporation, dated 07/07/04 and last revised on 11/12/15, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations:

1. See Design Pressure (DP) ratings with glass types & Reinforcing in sheet **2**. See DP ratings of anchor types in sheet **3**. Lower Design Pressure Ratings shall apply to entire system. Positive (Exterior) DP shall be limited to sill height per sheet **2**.
2. All SGD doors containing operable panel (X) require channel reinforcement (item #31) at Bottom Rails.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its

12/17/15

MIAMI-DADE COUNTY
DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

EGS International, LLC
3133 S.W. 25th Street
Pembroke Park, FL 33009

INSPECTION (cont.): distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA# 14-0807.17** and consists of this page 1, page 2 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Jorge M. Plasencia, P.E.

MIAMI-DADE COUNTY APPROVED

12/17/15

EGS International, LLC.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
   (Submitted under NOA# 12-0131.14, 09-0520.07)
2. Drawing No. **W04-64 Rev H**, titled "Atlantic Series LM 130 Alum Sliding Glass Door", sheets 1 through 8 of 8, prepared by AL-Farooq Corporation, dated 07/07/04 and last revised on 11/12/15, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
   2) Large Missile Impact Test per FBC, TAS 201-94
   3) Smal Missile Impact Test per FBC, TAS 201-94
   4) Cyclic Wind Pressure Loading per FBC, TAS 203-94

   along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5728**, dated 10/10/08, signed and sealed by Carlos Rionda, P.E.
   (Submitted under NOA# 09-0520.07)

2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
   2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
   3) Water Resistance Test, per FBC, TAS 202-94
   4) Large Missile Impact Test per FBC, TAS 201-94
   5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
   6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

   along with marked-up drawings and installation diagram of an aluminum sliding glass door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-4182** and **FTL-4182**, both dated 05/18/04, signed and sealed by Edmundo Largespada, P. E.
   (Submitted under NOA# 09-0520.07)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-2014, 5th Edition, prepared by Al Farooq Corporation, dated 01/18/12 and revised on MAY 17, 2012, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with **ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-0511.01
Expiration Date: December 24, 2019
Approval Date: December 24, 2015

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **14-0423.15** issued Eastman Chemical Company (MA) former Solutia Inc. for "**Saflex CP ™ - Saflex and Saflex HP Composite Glass Interlayer w/ PET Core**", expiring on December 11, 2018.
2. Notice of Acceptance No. **14-0423.17** issued to Eastman Chemical Company (MA) former Solutia Inc. for their "**Saflex clear & color interlayer**", expiring on 05/21/16.

F. STATEMENTS

1. Statement letter of conformance to FBC 2014, 5th Edition and letter of no financial interest, prepared by Al Farooq Corporation, dated 4/30/15, signed and sealed by Javad Ahmad, P.E.
2. Laboratory compliance as part of the above referenced test report.

G. OTHERS

1. This NOA **revises** NOA #14-0807.17 expiring on December 24, 2019.

Jorge M. Plasencia P.E.
Product Control Unit Supervisor
NOA No. 15-0511.01
Expiration Date: December 24, 2019
Approval Date: December 24, 2015

DAYLITE OPENINGS:
D.L.O. HEIGHT = PANEL HEIGHT – 8.875"
D.L.O. WIDTH = PANE
PANEL HEIGHT = DOOR HEIGHT – 2"

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS/REINF.

USING CHART ON SHEET 3 SELECT ANCHOR OPTION WITH DESIGN RATING MORE THAN DESIGN LOADS REQUIRED.

LOWER DESIGN PRESSURES FROM GLASS OR ANCHOR CHARTS WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2014 (5TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.

ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON–METALLIC AND NON–COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE.

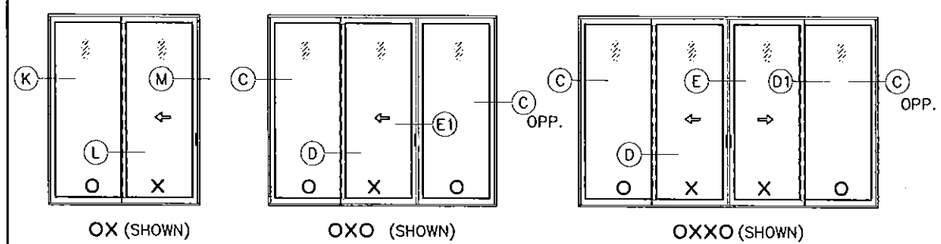

OX (SHOWN)
XO

OXO (SHOWN)

OXXO (SHOWN)

APPROVED CONFIGURATIONS

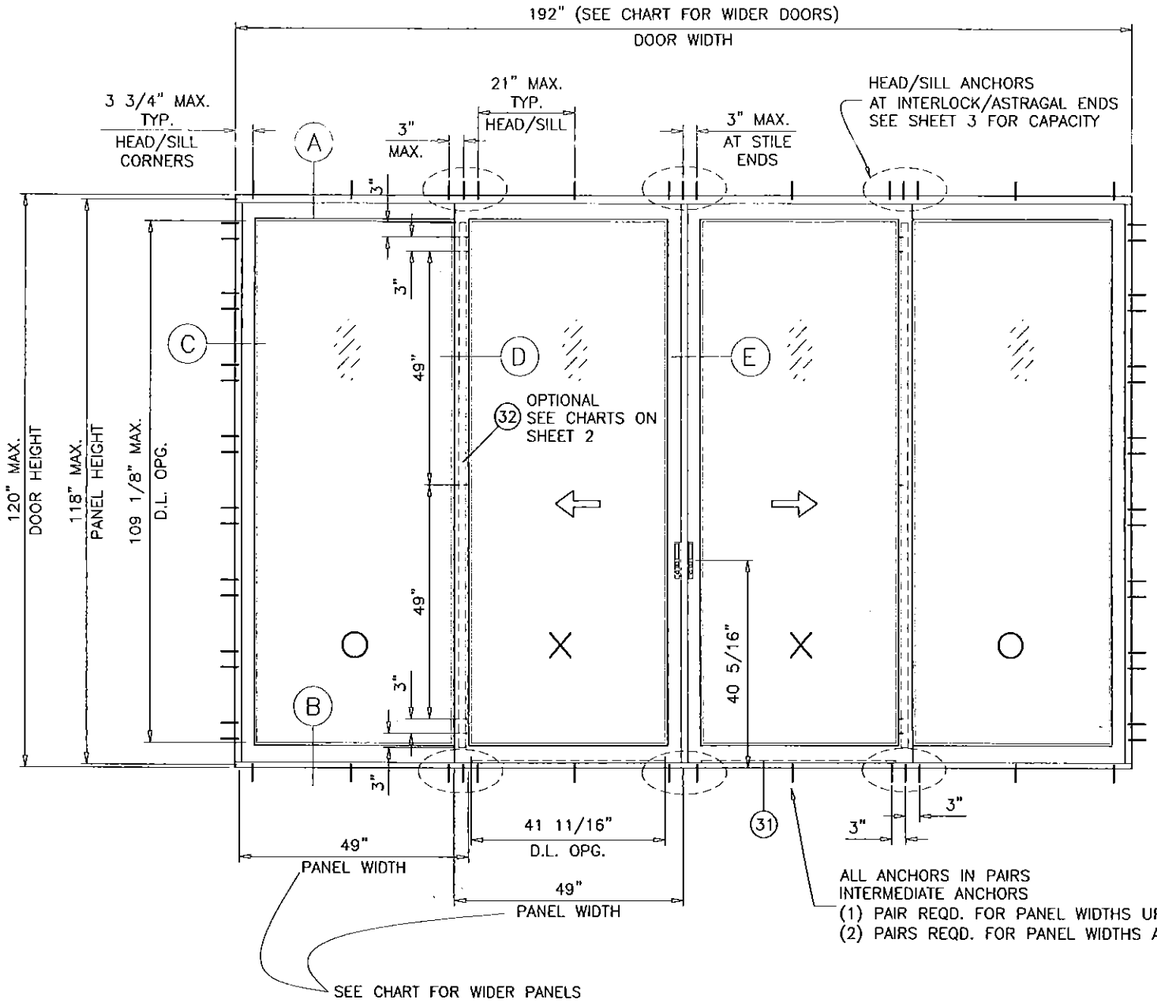

TYPICAL ELEVATION
TESTED UNIT

JAMB ANCHOR SPACING
15" MAX. FOR INSTALLATIONS INTO CONC., WOOD AND METAL STRUCTURES

ALL DOOR INSTALLATIONS MUST BE IN ACCORDANCE WITH EGS INSTALLATION INSTRUCTIONS.
ALL SEALANTS TO BE TREMCO SPECTREM 2 OR EQUAL.
(EQUAL SEALANTS MUST BE TESTED BY SEALANT MANUFACTURER FOR COMPATIBILITY & ADHESION).

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 15-0511.01
Expiration Date 12-24-19
By,
Miami-Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
DEC 09 2015

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP–ANL\W04–64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964–1441 FAX. (954) 964–1533

revisions:

no	date	by	description
E	11.14.11		UPDATED TO 2010 FBC
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		UPDATED TO 2014 FBC
H	11.12.15		REV. PER RER COMMENTS

date: 07-07-04
scale: 3/8"=1'-0"
dr. by: HAMID
chk. by:

drawing no.
W04–64

sheet 1 of 8

DESIGN LOAD CAPACITY – PSF (GLASS)					
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	GLASS TYPE 'A' W/O REINF'D INTERLOCKS		GLASS TYPE 'B' WITH REINF'D INTERLOCKS	
		EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
24	84	80.0	135.0	105.0	130.0
30		80.0	135.0	105.0	130.0
36		80.0	135.0	105.0	130.0
39–1/4		80.0	135.0	105.0	130.0
42		74.8	126.2	105.0	130.0
48		80.0	130.0	105.0	130.0
50		76.8	124.8	100.8	124.8
53		72.5	117.7	95.1	117.7
56		68.6	111.4	90.0	111.4
60		64.0	104.0	84.0	104.0
24	90	80.0	135.0	105.0	130.0
30		80.0	135.0	105.0	130.0
36		80.0	135.0	105.0	130.0
39–1/4		80.0	135.0	105.0	130.0
42		74.8	126.2	105.0	130.0
48		80.0	130.0	105.0	130.0
50		76.8	124.8	100.8	124.8
53		72.5	117.7	95.1	117.7
56		68.6	111.4	90.0	111.4
60		–	–	84.0	104.0
24	96	80.0	135.0	105.0	130.0
30		80.0	135.0	105.0	130.0
36		80.0	135.0	105.0	130.0
39–1/4		80.0	135.0	105.0	130.0
42		80.0	130.0	105.0	130.0
48		80.0	130.0	105.0	130.0
50		76.8	124.8	100.8	124.8
53		72.5	117.7	95.1	117.7
56		–	–	90.0	111.4
60		–	–	84.0	104.0
24	102	80.0	130.0	105.0	130.0
30		80.0	130.0	105.0	130.0
36		80.0	130.0	105.0	130.0
39–1/4		80.0	130.0	105.0	130.0
42		80.0	130.0	105.0	130.0
48		80.0	130.0	105.0	130.0
50		76.8	124.8	100.8	124.8
53		–	–	95.1	117.7
56		–	–	90.0	111.4
24	108	80.0	130.0	105.0	130.0
30		80.0	130.0	105.0	130.0
36		80.0	130.0	105.0	130.0
39–1/4		80.0	130.0	105.0	130.0
42		80.0	130.0	105.0	130.0
48		80.0	130.0	105.0	130.0
50		–	–	100.8	124.8
53		–	–	95.1	117.7

DESIGN LOAD CAPACITY – PSF (GLASS)					
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	GLASS TYPE 'A' W/O REINF'D INTERLOCKS		GLASS TYPE 'B' WITH REINF'D INTERLOCKS	
		EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
24	114	–	–	105.0	130.0
30		–	–	105.0	130.0
36		–	–	105.0	130.0
39–1/4		–	–	105.0	130.0
42		–	–	105.0	130.0
48		–	–	105.0	130.0
50		–	–	100.8	124.8
24	120	–	–	105.0	130.0
30		–	–	105.0	130.0
36		–	–	105.0	130.0
39–1/4		–	–	105.0	130.0
42		–	–	105.0	130.0
48		–	–	105.0	130.0

DOOR SIZES TO COMPLY WITH FBC EGRESS REQUIREMENTS AS APPLICABLE.

$$\text{PANEL WIDTH NOMINAL} = \frac{\text{OVERALL DOOR WIDTH}}{\text{NUMBER OF PANELS}}$$

PANEL HEIGHT = DOOR HEIGHT – 2"

MAX. OVERALL DOOR WIDTH ANY CONFIGURATION = 192"

(INTERPOLATION BETWEEN WIDTHS ALLOWED)

SHOWN CAPACITIES ARE FOR
4.938" SILL HEIGHTS
LIMIT EXTERIOR(+) LOADS AS FOLLOWS
3.750" SILL HT. = +80.0 PSF
3.188" SILL HT. = +53.3 PSF
2.500" SILL HT. = SEE NOTE BELOW

2.500" SILL HEIGHTS CAN BE USED FOR INSTALLATIONS WHERE WATER INFILTRATION RESISTANCE IS NOT REQUIRED OR WHERE OVERHANG RATIO COMPLIES WITH FBC REQUIREMENTS.

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300–09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05–DEC–219

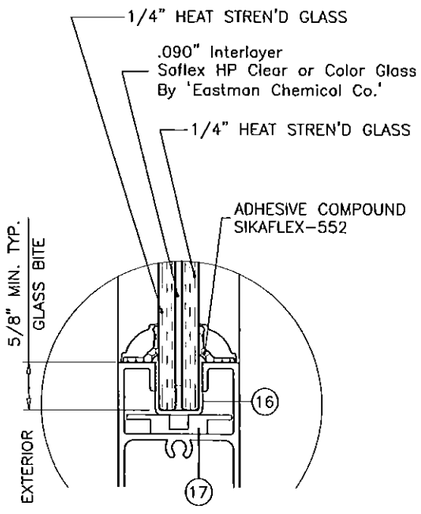

UPTO & INCLUDING 9'–0" HIGH DOORS

GLASS TYPE 'A'

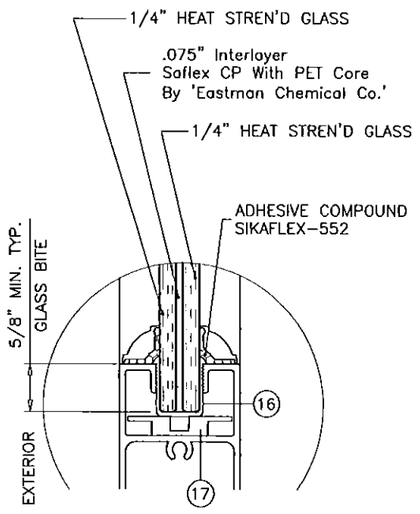

UPTO 10'–0" HIGH DOORS

GLASS TYPE 'B'

GLAZING OPTIONS

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 15-0511.01
Expiration Date Dec. 24, 2019

By:
Miami-Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

DEC 09 20

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP–ANL\W04–64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964–1441 FAX. (954) 964–1533

revisions:

no	date	by	description
E	11.14.11		UPDATED TO 2010 FBC
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		UPDATED TO 2014 FBC
H	11.12.15		NO CHANGE THIS SHEET

date: 07–07–04
scale: 1/2"=1'–0"
dr. by: HAMID
chk. by:

drawing no.
W04–64

HEAD ANCHOR LOAD CAPACITY – PSF

ANCHOR TYPES		'A'	'B' & 'C'	
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	6 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)	4 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)	6 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)
24	84	135.0	135.0	135.0
30		135.0	135.0	135.0
36		135.0	135.0	135.0
39–1/4		135.0	135.0	135.0
42		135.0	135.0	135.0
48		135.0	135.0	135.0
50		135.0	135.0	135.0
53		135.0	135.0	135.0
56		135.0	135.0	135.0
60		134.0	134.0	135.0
24	90	135.0	135.0	135.0
30		135.0	135.0	135.0
36		135.0	135.0	135.0
39–1/4		135.0	135.0	135.0
42		135.0	135.0	135.0
48		135.0	135.0	135.0
50		133.6	133.6	135.0
53		129.0	129.0	135.0
56		125.1	125.1	135.0
60		120.6	120.6	135.0
24	96	135.0	135.0	135.0
30		135.0	135.0	135.0
36		135.0	135.0	135.0
39–1/4		135.0	135.0	135.0
42		135.0	135.0	135.0
48		125.7	125.7	135.0
50		122.3	122.3	135.0
53		117.9	117.9	135.0
56		114.1	114.1	135.0
60		109.7	109.7	135.0
24	102	135.0	135.0	135.0
30		135.0	135.0	135.0
36		135.0	135.0	135.0
39–1/4		134.3	134.3	135.0
42		127.7	127.7	135.0
48		116.0	116.0	135.0
50		112.8	112.8	135.0
53		108.5	108.5	135.0
56		104.8	104.8	135.0
24	108	135.0	135.0	135.0
30		135.0	135.0	135.0
36		134.0	134.0	135.0
39–1/4		125.2	125.2	135.0
42		118.9	118.9	135.0
48		107.7	107.7	135.0
50		104.7	104.7	135.0
53		100.5	100.5	135.0

HEAD ANCHOR LOAD CAPACITY – PSF

ANCHOR TYPES		'A'	'B' & 'C'	
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	6 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)	4 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)	6 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)
24	114	135.0	135.0	135.0
30		135.0	135.0	135.0
36		125.7	125.7	135.0
39–1/4		117.2	117.2	135.0
42		111.2	111.2	135.0
48		100.5	100.5	135.0
50		97.6	97.6	135.0
24	120	135.0	135.0	135.0
30		135.0	135.0	135.0
36		118.3	118.3	135.0
39–1/4		110.2	110.2	135.0
42		104.5	104.5	135.0
48		94.3	94.3	135.0

SILL ANCHOR LOAD CAPACITY – PSF

ANCHOR TYPE		'B'	
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	4 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)	6 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)
24	84	135.0	135.0
30		135.0	135.0
36		135.0	135.0
39–1/4		135.0	135.0
42		135.0	135.0
48		135.0	135.0
50		135.0	135.0
53		135.0	135.0
56		135.0	135.0
60		134.0	135.0
24	90	135.0	135.0
30		135.0	135.0
36		135.0	135.0
39–1/4		135.0	135.0
42		135.0	135.0
48		135.0	135.0
50		133.6	135.0
53		129.0	135.0
56		125.1	135.0
60		120.6	135.0
24	96	135.0	135.0
30		135.0	135.0
36		135.0	135.0
39–1/4		135.0	135.0
42		135.0	135.0
48		125.7	135.0
50		122.3	135.0
53		117.9	135.0
56		114.1	135.0
60		109.7	135.0
24	102	135.0	135.0
30		135.0	135.0
36		135.0	135.0
39–1/4		134.3	135.0
42		127.7	135.0
48		116.0	135.0
50		112.8	135.0
53		108.5	135.0
56		104.8	135.0
24	108	135.0	135.0
30		135.0	135.0
36		134.0	135.0
39–1/4		125.2	135.0
42		118.9	135.0
48		107.7	135.0
50		104.7	135.0
53		100.5	135.0

SILL ANCHOR LOAD CAPACITY – PSF

ANCHOR TYPE		'B'	
PANEL WIDTH NOMINAL INCHES	DOOR HEIGHT INCHES	4 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)	6 ANCHORS AT MTG. STILE ENDS EXT. (+) INT. (–)
24	114	135.0	135.0
30		135.0	135.0
36		125.7	135.0
39–1/4		117.2	135.0
42		111.2	135.0
48		100.5	135.0
50		97.6	135.0
24	120	135.0	135.0
30		135.0	135.0
36		118.3	135.0
39–1/4		110.2	135.0
42		104.5	135.0
48		94.3	135.0

PANEL WIDTH NOMINAL = OVERALL DOOR WIDTH / NUMBER OF PANELS

PANEL HEIGHT = DOOR HEIGHT – 2"

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

AT HEAD

TYPE 'A'– 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1–1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONCRETE
1–1/4" MIN. EMBED INTO CONCRETE

TYPE 'B'– 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE
1–3/4" MIN. EMBED

TYPE 'C'– 1/4" DIA. SELF DRILLING SCREWS (GRADE 5 CRS)
INTO MIAMI–DADE COUNTY APPROVED MULLIONS (1/8" THK. MIN.)
INTO METAL STRUCTURES
STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063–T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

AT SILL

TYPE 'B'– 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE
1–3/4" MIN. EMBED

AT JAMBS

TYPE 'D'– 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
THRU 1BY BUCKS INTO MASONRY
1–1/4" MIN. EMBED INTO MASONRY BLOCK

DIRECTLY INTO MASONRY
1–1/4" MIN. EMBED INTO MASONRY BLOCK

TYPE 'E'– 1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)
INTO 2BY WOOD BUCKS OR WOOD STRUCTURES
1–1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONCRETE
1–1/4" MIN. EMBED INTO CONCRETE

DIRECTLY INTO CONCRETE
1–3/4" MIN. EMBED INTO CONCRETE

TYPE 'F'– #14 SMS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO MIAMI–DADE COUNTY APPROVED MULLIONS (1/8" THK. MIN.)
INTO METAL STRUCTURES
STEEL : 1/8" THK. MIN. (Fy = 36 KSI MIN.)
ALUMINUM : 1/8" THK. MIN. (6063–T5 MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

ANCHOR EDGE DISTANCES

INTO CONCRETE = 2–1/2" MIN.
INTO WOOD STRUCTURE = 1" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD OR JAMBS SG = 0.55 MIN.
CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.
C–90 HOLLOW/FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

PRODUCT REVISED
to complying with the Florida Building Code
Acceptance No. 15-0511.01
Expiration Date 12/24/19
By: Miami-Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
DEC 09 2015

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP–ANL\W04–64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964–1441 FAX. (954) 964–1533

revisions:			
no	date	by	description
E	11.14.11		UPDATED TO 2010 FBC
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		UPDATED TO 2014 FBC
H	11.12.15		REV. PER RER COMMENTS

date: 07–07–04
scale: 1/2"=1'–0"
dr. by: HAMID
chk. by:

drawing no. W04–64

sheet 3 of 8

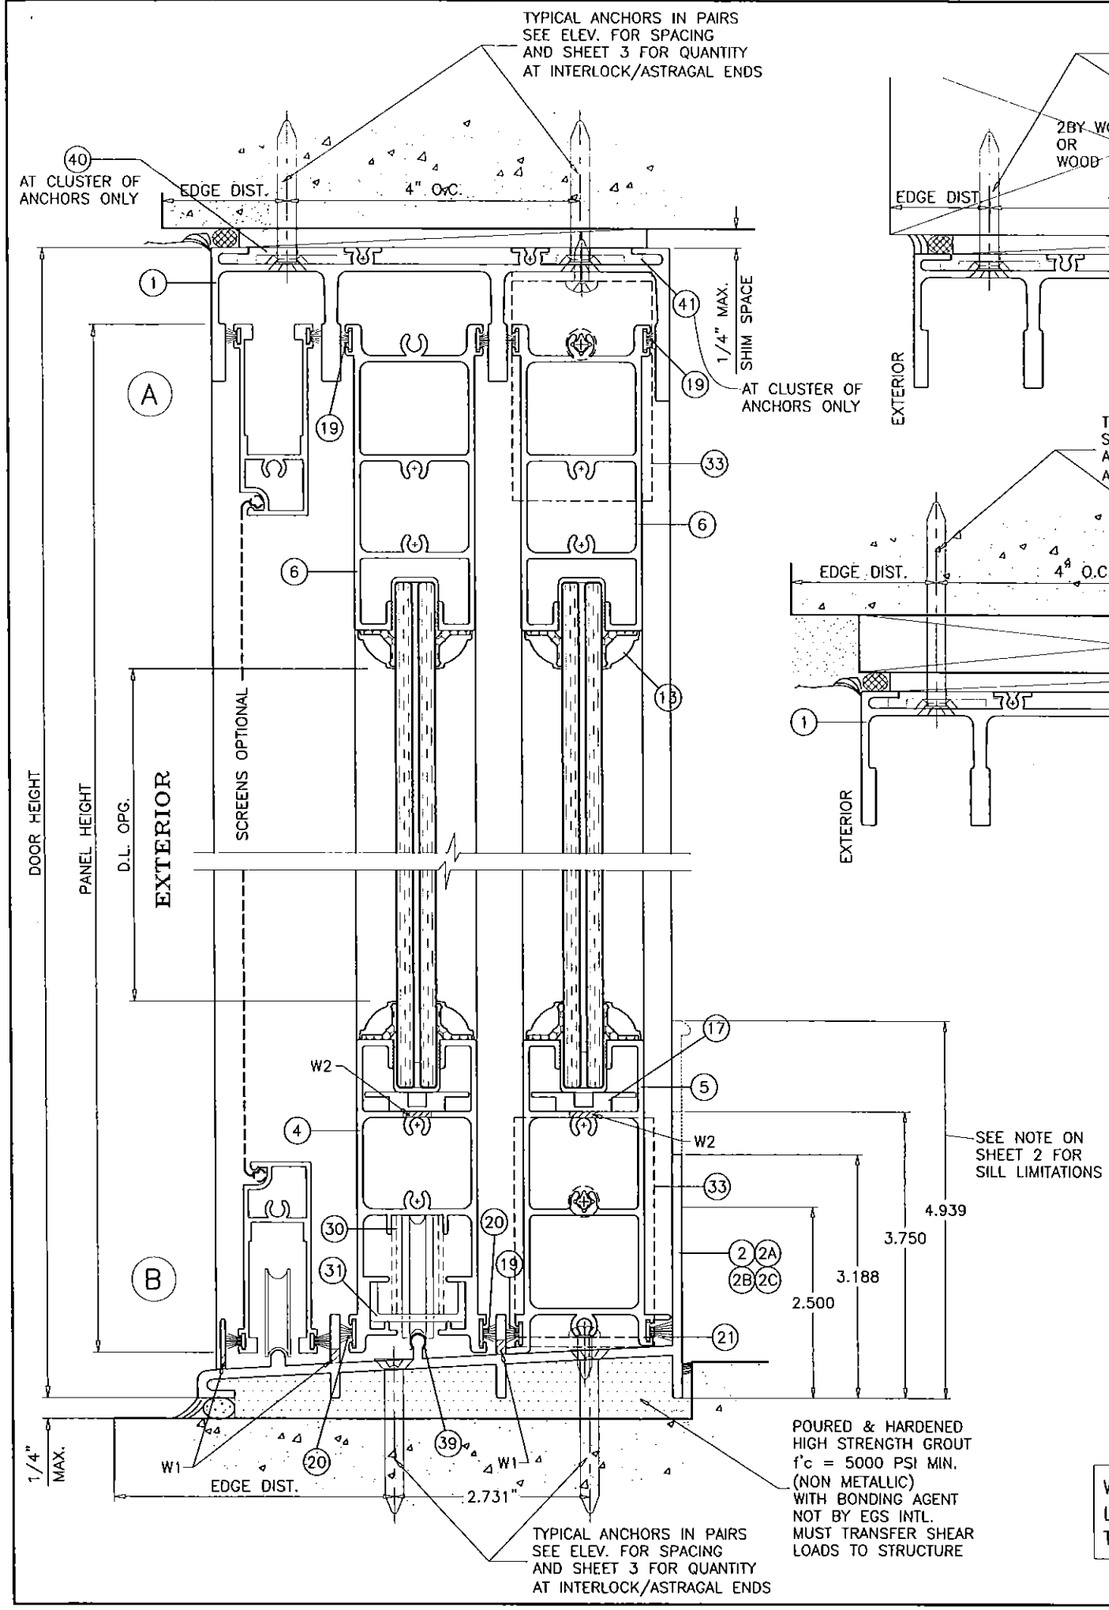

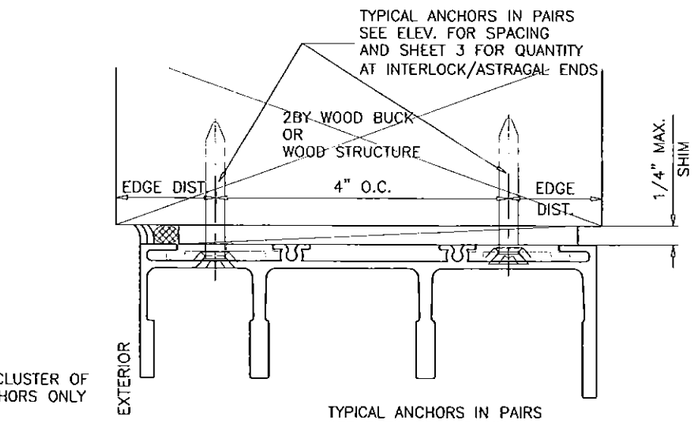

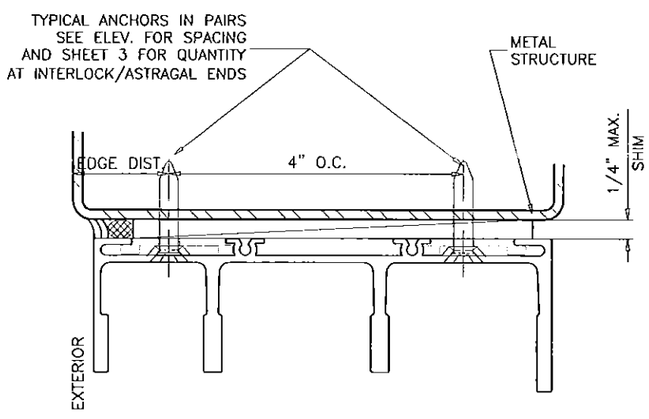

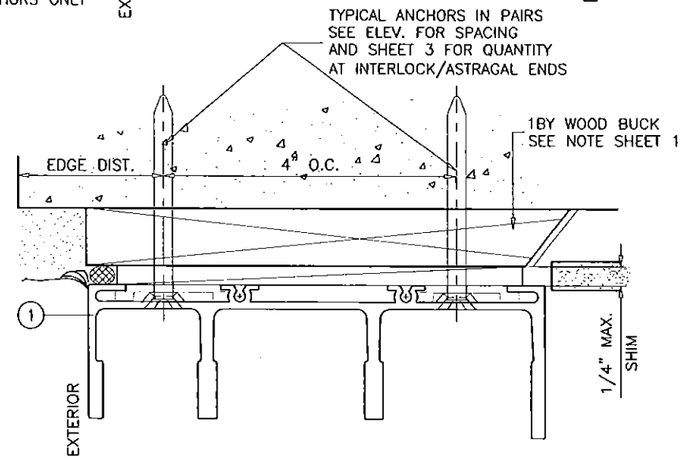

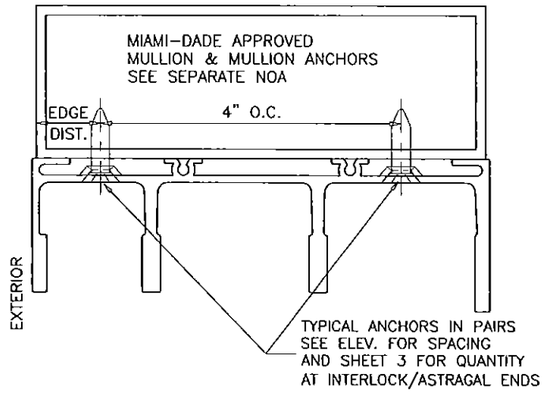

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No. 15-0511.01
Expiration Date 12/24/19
By
Miami-Dade Product Control

SEALANT:

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH WHITE/ALUMINUM COLORED SILICONE.
MAJOR INTERLOCK STILES TOP AND BOTTOM ENDS FILLED WITH EXPANDING URETHANE FOAM.

ALL INSTALLATION ANCHOR HEADS TO BE SEALED & EXPOSED ANCHORS TO BE CAPPED WITH ALUM. BUTTON COVERS.

WEEPHOLES:

W1 = 3/16"H X 3/4"W WEEP SLOTS AT QUARTER POINTS OF EACH PANEL
W2 = 3/8" WEEP HOLE AT 6" FROM ENDS AND CENTER OF EACH RAIL

WOOD BUCKS NOT BY EGS INTL., MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
DEC 09 2015

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W04-64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964-1441 FAX. (954) 964-1533

revisions:			
no	date	by	description
E	11.14.11		NO CHANGE THIS SHEET
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		UPDATED TO 2014 FBC
H	11.12.15		NO CHANGE THIS SHEET

date: 07-07-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-64

sheet 4 of 8

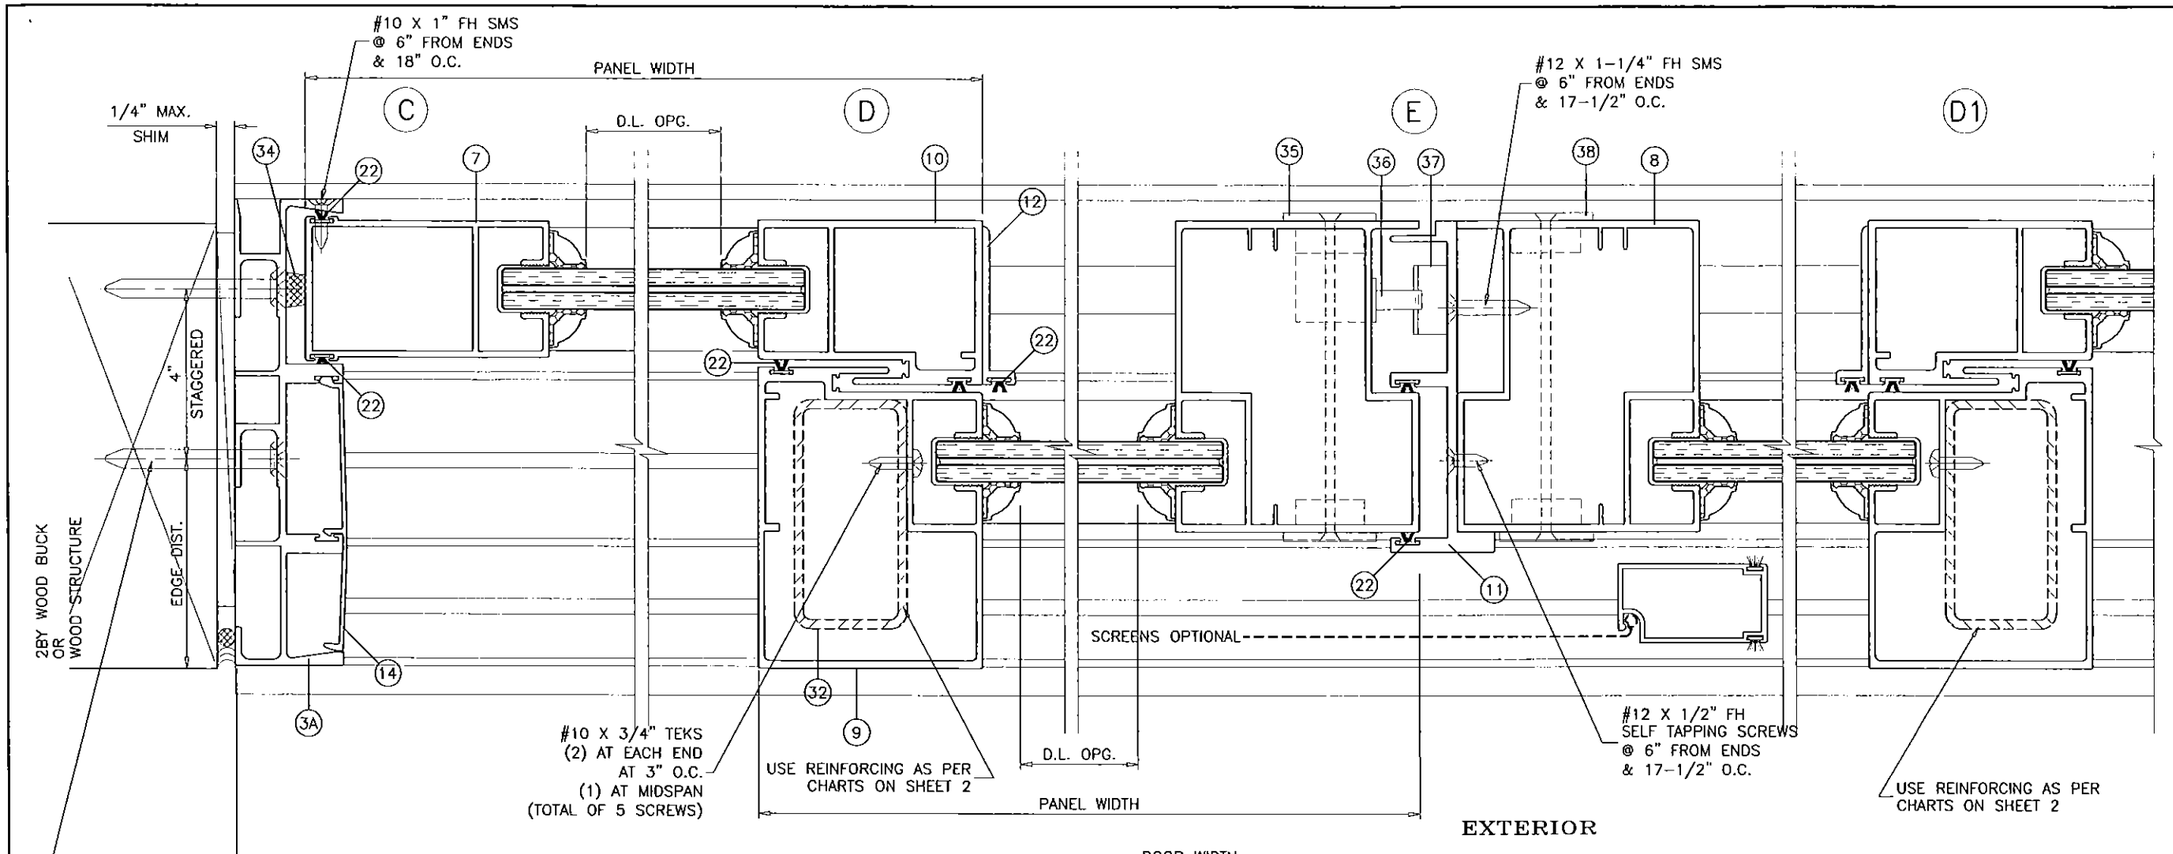

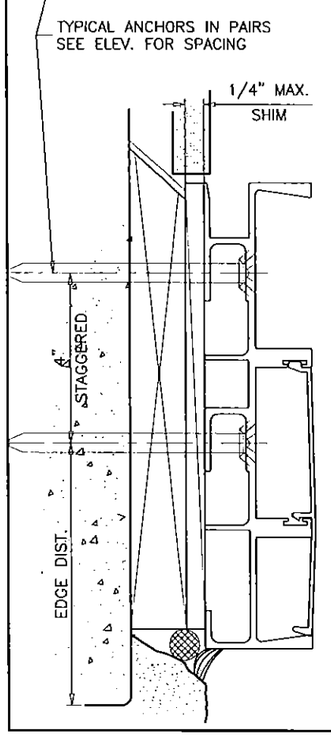

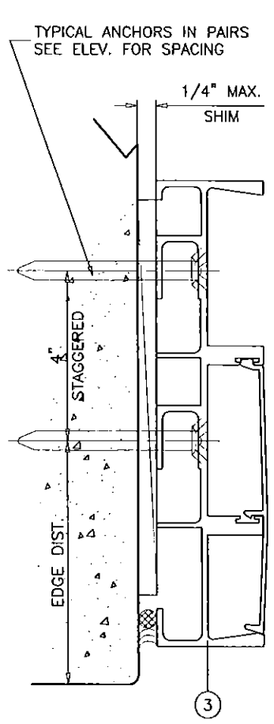

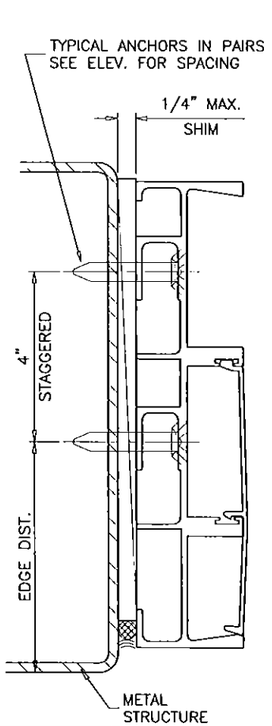

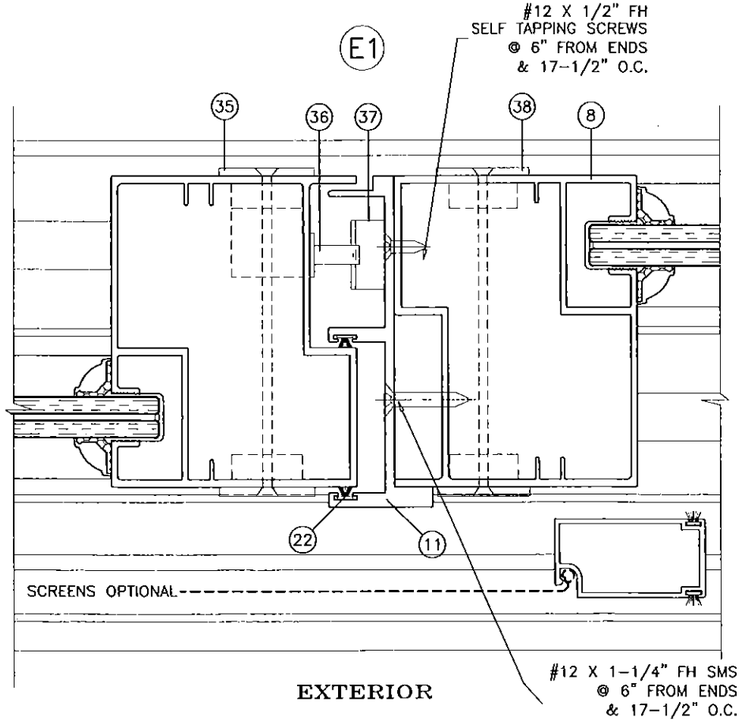

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 15-0511.01
Expiration Date 12/24/19
By:
Miami-Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

DEC 28 2015

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

COMP-ANL\W04-64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964-1441 FAX. (954) 964-1533

revisions:			
no	date	by	description
E	11.14.11		UPDATED TO 2010 FBC
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		UPDATED TO 2014 FBC
H	11.12.15		REV. PER RER COMMENTS

date: 07-07-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-64

sheet 5 of 8

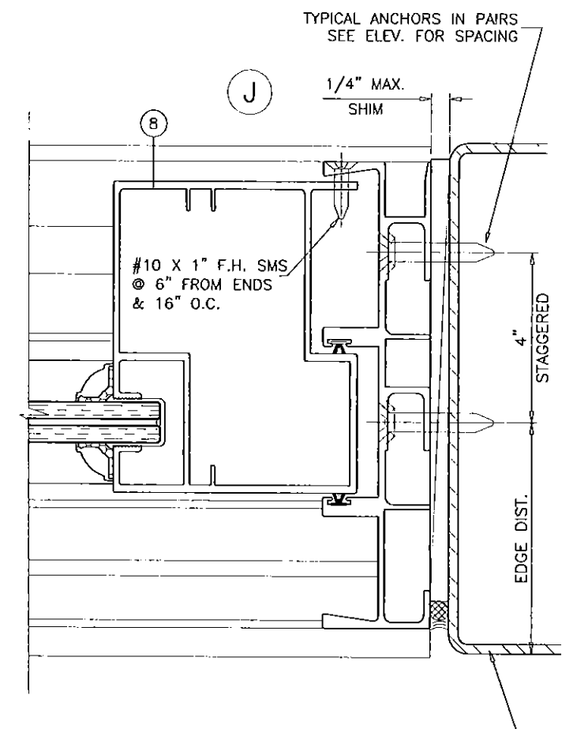

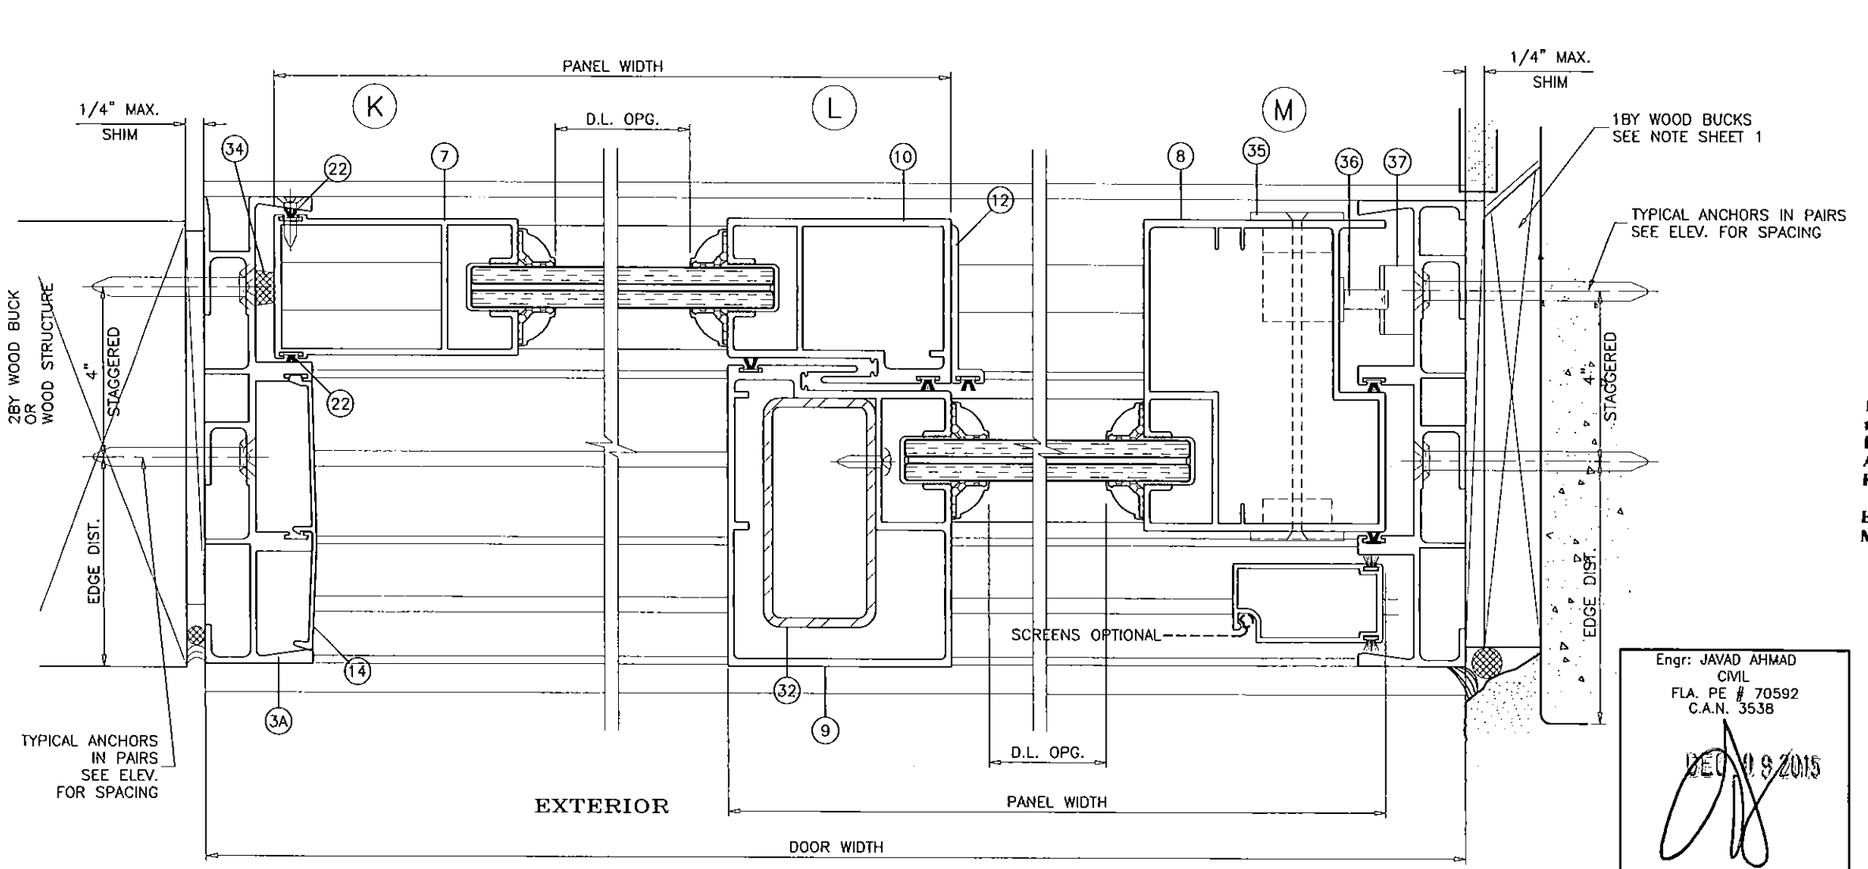

PRODUCT REVISED
as complying with the Florida Building Code
Acceptance No 15-0511.01
Expiration Date 12/24/15
By
Miami Dade Product Control

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538
DEC 9 2015

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964-1533 FAX. (954) 964-1441

revisions:

no	date	by	description
E	11.14.11		UPDATED TO 2010 FBC
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		UPDATED TO 2014 FBC
H	11.12.15		REV. PER RER COMMENTS

date: 07-07-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-64

sheet 6 of 8

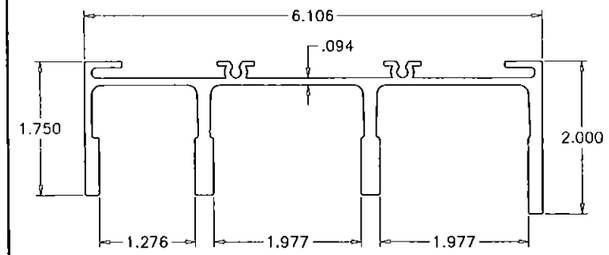

(1) FRAME HEAD

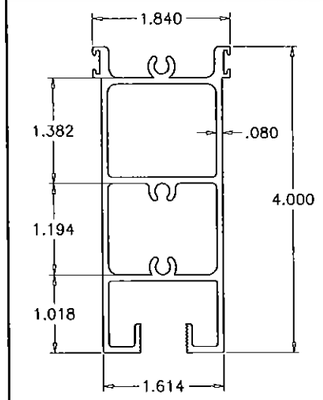

(6) TOP RAIL



(32) REINFORCING TUBE

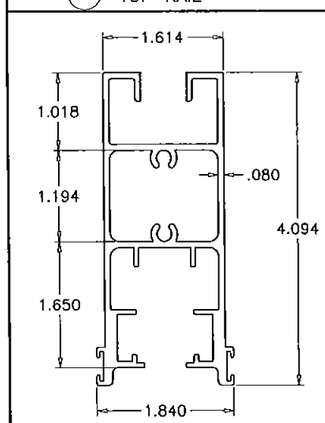

(4) MOVING BOTTOM RAIL

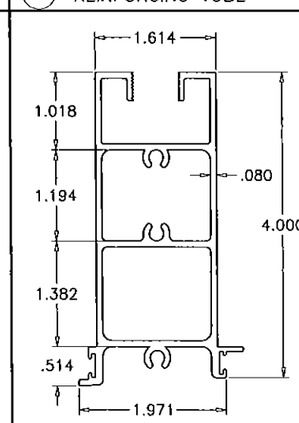

(5) FIXED BOTTOM RAIL

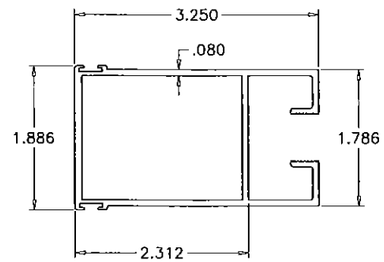

(7) FIXED STILE

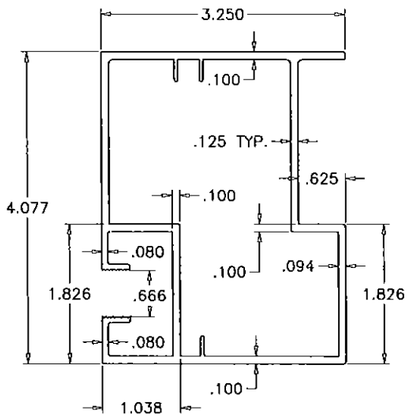

(8) LOCKING STILE

(40) SHEAR CLIP

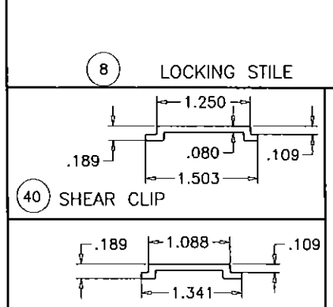

(41) SHEAR CLIP

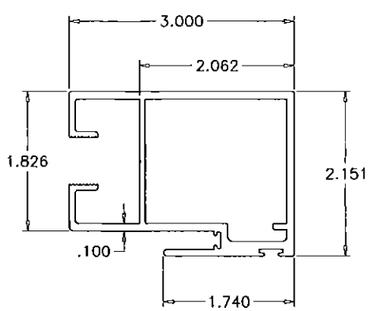

(10) MINOR INTERLOCK

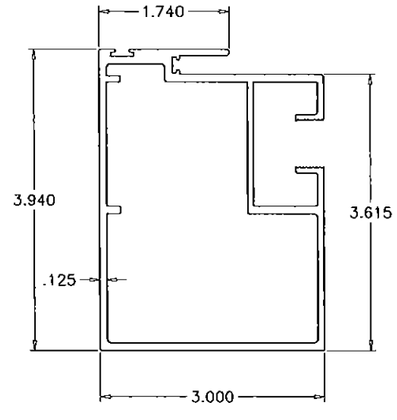

(9) MAJOR INTERLOCK

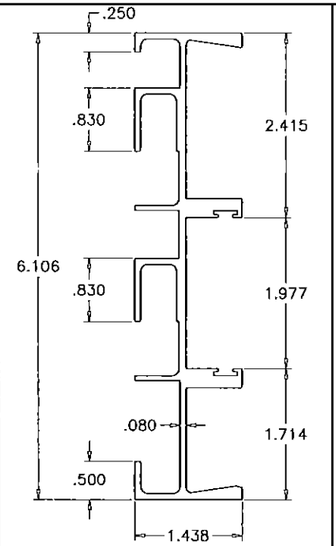

(3) FRAME JAMB W/O POCKET

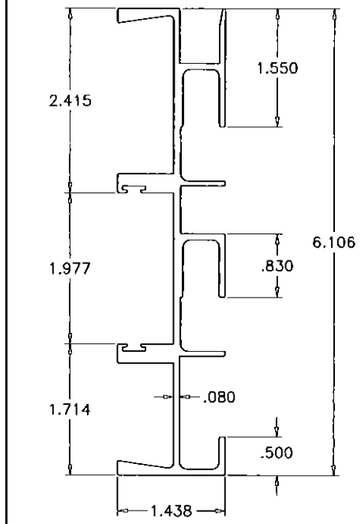

(3A) FRAME JAMB WITH POCKET

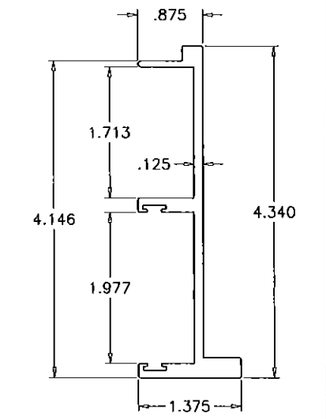

(11) STILE ADAPTER

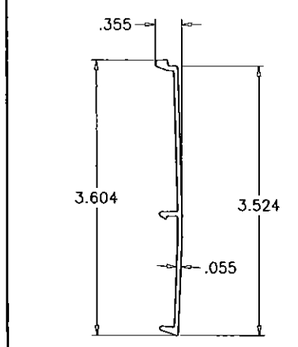

(14) JAMB COVER

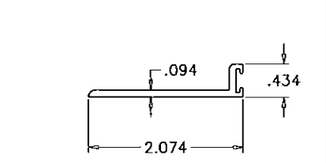

(12) DOOR SWEEP



(13) GLASS ADAPTER

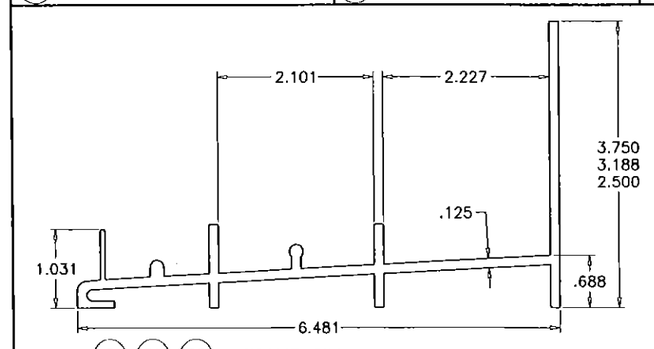

(2) (2A) (2C) FRAME SILL

(SEE WATER RATING SHEET 2)

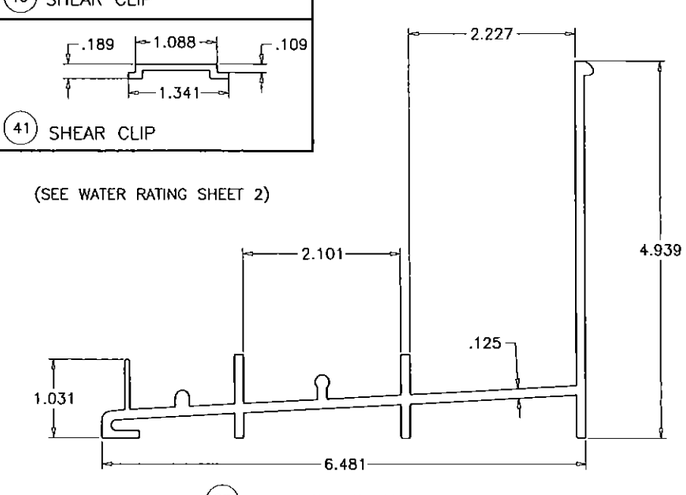

(2B) FRAME SILL



(31) MOV. PANEL REINF.

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

DEC 09 2015

PRODUCT REVISED
as complying with the Florida building Code
Acceptance No. 15-0511.01
Expiration Date 12/24/19

By: _____
Manager Product Control

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964-1441 FAX. (954) 964-1533

revisions:			
no	date	by	description
E	11.14.11		NO CHANGE THIS SHEET
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		NO CHANGE THIS SHEET
H	11.12.15		NO CHANGE THIS SHEET

date: 07-07-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-64

sheet 7 of 8

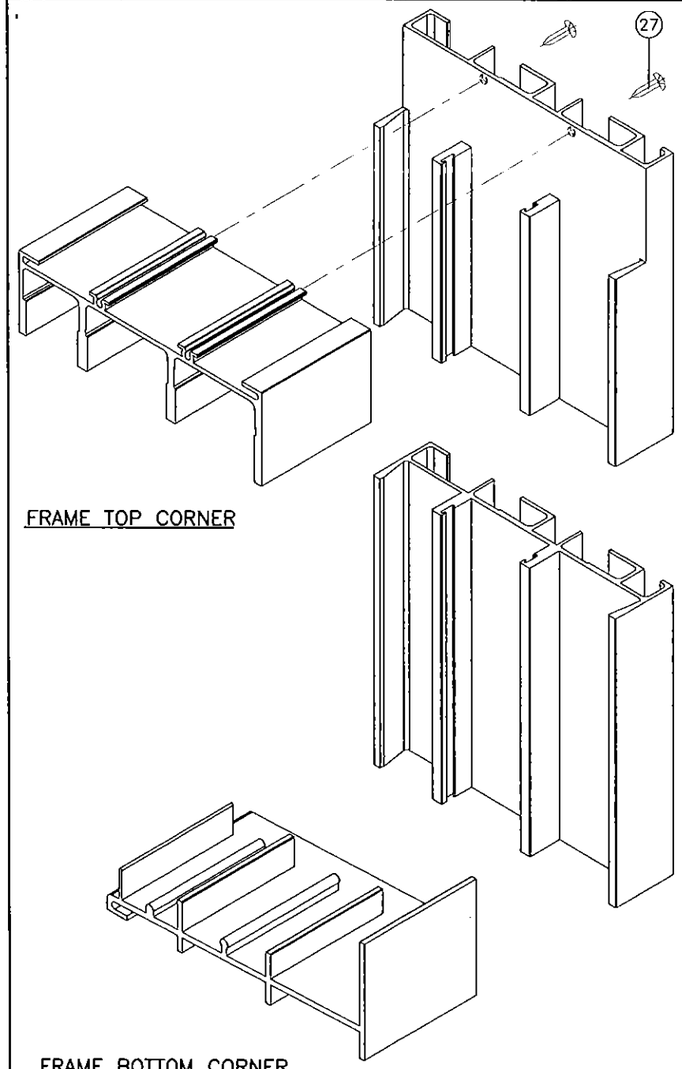

FRAME TOP CORNER

FRAME BOTTOM CORNER

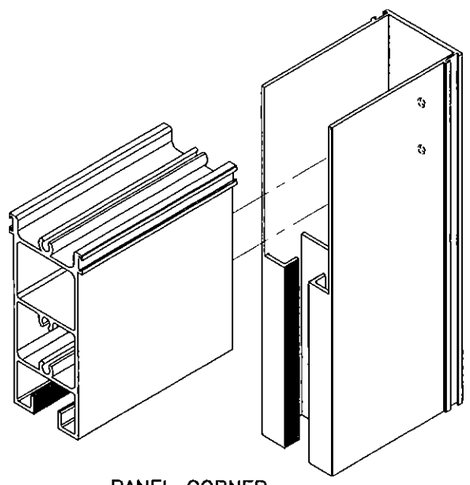

PANEL CORNER

ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	EGS-551	1	FRAME HEAD	6005-T5/6105-T5	-
2	EGS-580	1	FRAME SILL (3-3/16" HIGH)	6005-T5/6105-T5	-
2A	EGS-581	1	FRAME SILL (3-3/4" HIGH)	6005-T5/6105-T5	-
2B	EGS-552	1	FRAME SILL (4-15/16" HIGH)	6005-T5/6105-T5	-
2C	EGS-580	1	FRAME SILL (2-1/2" HIGH)	6005-T5/6105-T5	-
3	EGS-567	2	FRAME JAMB W/O POCKET	6005-T5/6105-T5	-
3A	EGS-553	2	ALT. FRAME JAMB W/ POCKET	6005-T5/6105-T5	-
4	EGS-573	1/MOV. PANEL	MOVING HORIZ. BOTT. RAIL	6005-T5/6105-T5	-
5	EGS-572	1/FIX. PANEL	FIXED HORIZ. BOTT. RAIL	6005-T5/6105-T5	-
6	EGS-571	1/PANEL	TOP RAIL	6005-T5/6105-T5	-
7	EGS-574	AS REQD.	FIXED STILE	6005-T5/6105-T5	-
8	EGS-575	AS REQD.	LOCKING STILE	6005-T5/6105-T5	-
9	EGS-576	AS REQD.	MAJOR INTERLOCK	6005-T5/6105-T5	-
10	EGS-577	AS REQD.	MINOR INTERLOCK	6005-T5/6105-T5	-
11	EGS-561	AS REQD.	STILE ADAPTER	6005-T5/6105-T5	-
12	EGS-566	AS REQD.	DOOR SWEEP	6063-T5/6105-T5	AT TOP OF MOV. PANEL
13	EGS-579	AS REQD.	GLASS ADAPTER	6063-T5/6105-T5	-
14	EGS-570	AS REQD.	JAMB COVER	6063-T5/6105-T5	-
16	EGS-72	AS REQD.	9/16" GLAZING GASKET	SOFT PVC	TEAMPLASTICS (BVC INC.)
17	TX11429E	2/ LITE	SETTING BLOCKS, 4" LONG, @ 10" FROM EACH END	EPDM	TREMCO
19	28027045/7527-6011-4	AS REQD.	FINSEAL WOOLPILE AT HORIZ. RAILS	-	AMESBURY
20	T-2836G	AS REQD.	POLYBOND FINSEAL AT MOV. BOTTOM RAIL	-	ULTRAFAB (.280H X .360 BASE)
21	38027045/7537-6011-6	AS REQD.	FINSEAL WOOLPILE AT FIX. BOTTOM RAIL	-	AMESBURY
22	21027045/7420-6011-2	AS REQD.	FINSEAL WOOLPILE AT VERT. STILES & SWEEP	-	AMESBURY
27	#8 X 3/4"	2/ CORNER	FRAME ASSEMBLY SCREWS	ST. STEEL	PH SMS
28	#12 X 1"	2/ CORNER	PANEL ASSEMBLY SCREWS	ST. STEEL	TH SMS
30	-	2/ PANEL	PANEL ROLLER ASSEMBLY	ST. STEEL	1-11/16" O.D. WHEELS
31	-	1/ MOV. PANEL	ALUM CHANNEL, FULL WIDTH OF PANEL	6063-T5/6105-T5	-
32	-	AS REQD.	INTERLOCK REINFORCEMENT	STEEL	1 1/2" X 3" X 11 G.A.
33	-	AS REQD.	FIX. PANEL CLIP (AT FRAME HEAD/SILL)	ALUMINUM	2 X 3 X 1/8" X 1-7/8" LONG
34	-	AS REQD.	RUBBER BUMPER	-	1/2" X 1/2" SQ. X 3/16" HIGH
35	4430-00-08 OR W5208-NPV30	1	TRIMSET PULL	ABS RESIN OR BRASS (PVD)	ADAMS-RITE OR ASHLAND
36	MS1847-09	1	DEAD LOCK, MOUNTED W/ (2) #6 X 1/4" FH SCREWS	ST. STEEL	ADAMS-RITE
37	4801-05	1	STRIKE, MOUNTED W/ (2) #8 X 1" PH SCREWS & PLASTIC SHIM	ST. STEEL	ADAMS-RITE
38	4432 OR W5208-PP30	1	DUMMY TRIMSET PULL	ABS RESIN OR BRASS (PVD)	ADAMS-RITE OR ASHLAND
39	TC2	1	TRACK COVER	ST/ST	HYGRADE
40	-	AS REQD.	SHEAR CLIP AT CLUSTERS ONLY	6005-T5/6105-T5	-
41	-	AS REQD.	SHEAR CLIP AT CLUSTERS ONLY	6005-T5/6105-T5	-



HARDNESS = 85 SHORE A
TENSILE STRENGTH (BREAK)= 1810 PSI
ELONGATION AT BREAK = 320%
TEAR STRENGTH = 260 LBF/IN
SPECIFIC GRAVITY = 1.45

GLAZING GASKET
SCALE 1:1

16

Engr: JAVAD AHMAD
CIVIL
FLA. PE # 70592
C.A.N. 3538

DEC 09 2015

PRODUCT REVISED
as complying with the Florida building Code
Acceptance No 15-0511.01
Expiration Date 12/24/19

By _____
Miami-Dade Product Control

afc
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W04-64EGS

ATLANTIC SERIES LM 130 ALUM SLIDING GLASS DOOR

EGS INTERNATIONAL, LLC
3133 S.W. 25TH STREET
PEMBROKE PARK, FL. 33009
TEL. (954) 964-1441 FAX. (954) 964-1533

revisions:

no	date	by	description
E	11.14.11		UPDATED TO 2010 FBC
F	05.14.12		REV. PER PERA COMMENTS
G	07.15.14		NO CHANGE THIS SHEET
H	11.12.15		NO CHANGE THIS SHEET

date: 07-07-04
scale: 1/2" = 1"
dr. by: HAMID
chk. by:

drawing no.
W04-64

sheet 8 of 8