



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**NOTICE OF ACCEPTANCE (NOA)**

**Exeter Architectural Products**  
131 Alden Road  
Nanticoke, PA 18634

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

**DESCRIPTION: 4' x 9' Ready Mount Storm Shield Hurricane Barriers**

**APPROVAL DOCUMENT:** Drawing No. SSHB-3, prepared by Exeter Architectural Products, titled "Storm Shield Hurricane Barriers", sheets 1 through 8 of 8, dated 03/23/09, with latest revision #2, dated 11/19/15, signed and sealed by Larry D. Jones, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each panel shall bear a permanent label with the manufacturer's name or logo, **Metairie, LA**, the following statement: "Miami-Dade County Product Control Approved", NOA number, and TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #14-0811.19 and consists of this page 1, evidence submitted pages E-1 and E-2 as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



*Helmy A. Makar*  
04/14/2016

NOA No. 15-0528.06  
Expiration Date: 08/12/2019  
Approval Date: 04/14/2016  
Page 1

**Exeter Architectural Products**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 09-0526.01**

**A. DRAWINGS**

1. *Drawing No. SSHB-3, prepared by Exeter Architectural Products, titled "Storm Shield Hurricane Barriers", sheets 1 through 8 of 8, dated 03/23/09, with latest revision #1 dated 07/13/09, signed and sealed by Thomas H. Maxwell Jr., P.E.*

**B. TEST**

1. *Architectural Testing Report #82181.01-109-18, single unit, per TAS 201, TAS 202, & TAS 203, dated 04/20/2009, signed and sealed by Michael D. Stremmel, P.E.*
2. *Architectural Testing Report #82181.01-109-18, triple units, per TAS 201, TAS 202, & TAS 203, dated 04/20/2009, signed and sealed by Michael D. Stremmel, P.E.*

**C. CALCULATIONS**

1. *Anchor calculations dated 05/15/09, pages 1 and 2 of 2, signed and sealed by Thomas H. Maxwell Jr., P.E. on 05/15/09.*
2. *Revised Anchor calculations dated 07/16/09, 7 pages, signed and sealed by Thomas H. Maxwell Jr., P.E. on 07/16/09.*

**D. QUALITY ASSURANCE**

1. *By Miami-Dade Building Code Compliance Office.*

**E. MATERIAL CERTIFICATION**

1. *Certified Tensile Test Report No. #82181.01-109-18, issued by Architectural Testing, dated 04/20/2009 for perforated infill.*

**F. STATEMENTS**

1. *Letter issued by Thomas H. Maxwell Jr., P.E., certifying this product conforms to the current Florida Building Code, dated 05/05/09, signed by Thomas H. Maxwell, Jr., P.E.*
2. *Letter issued by Thomas H. Maxwell Jr., P.E., certifying no financial interest, dated 05/05/09, signed by Thomas H. Maxwell, Jr., P.E.*

**2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #12-1019.18**

**A. DRAWINGS:**


1. *None.*

**B. TESTS:**

1. *None.*

**C. CALCULATIONS:**

1. *None.*



Helmy A. Makar, P.E., M.S.  
Product Control Section Supervisor

NOA No. 15-0528.06

Expiration Date: 08/12/2019

Approval Date: 04/14/2016

**Exeter Architectural Products**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE:**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS:**

1. *None.*

**F. OTHERS:**

1. *Letter of compliance with the Florida Building Code, 2010 Edition and ASCE 7-10, issued by Thomas H. Maxwell, Jr., P.E. Consulting Engineer, dated September 30, 2012, signed and sealed by Thomas H. Maxwell, Jr., P.E.*

**3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #14-0811.19**

**A. DRAWINGS:**

1. *None.*

**B. TESTS:**

1. *None.*

**C. CALCULATIONS:**

1. *None.*

**D. QUALITY ASSURANCE:**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS:**

1. *None.*

**4. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS:**

1. *Drawing No. SSHB-3, prepared by Exeter Architectural Products, titled "Storm Shield Hurricane Barriers", sheets 1 through 8 of 8, dated 03/23/09, with latest revision #2, dated 11/19/15, signed and sealed by Larry D. Jones, P.E.*

**B. TESTS:**

1. *None.*

**C. CALCULATIONS:**


1. *None.*

**D. QUALITY ASSURANCE:**

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

**E. MATERIAL CERTIFICATIONS:**

1. *None.*

  
Henry A. Makar, P.E., M.S.

Product Control Section Supervisor

NOA No. 15-0528.06

Expiration Date: 08/12/2019

Approval Date: 04/14/2016

GENERAL NOTES

1. THIS PRODUCT IS DESIGNED AS A HURRICANE SHUTTER
2. THESE PRODUCTS SATISFY THE FOLLOWING TESTING CRITERIA FOR LARGE MISSILE IMPACTS AND WIND LOADS IN ACCORDANCE WITH THE FOLLOWING STANDARDS:  
FLORIDA BUILDING CODE 2014, 5TH EDITION, HIGH VELOCITY HURRICANE ZONE (TAS 201-94, TAS 202-94, TAS 203-94)
3. EACH BARRIER SHALL HAVE A PERMANENT LABEL PLACED IN A VISIBLE LOCATION WITH THE FOLLOWING INFORMATION:

EXETER ARCHITECTURAL PRODUCTS  
STORM SHIELD METAIRE, LA  
MIAMI-DADE COUNTY  
PRODUCT CONTROL APPROVED  
TAS-201, TAS-202, TAS-203  
NOA# 15-0528.06

LABEL SIZE: 2" X 3/4"

EXETER ARCHITECTURAL PRODUCTS  
STORM SHIELD NANTICOKE, PA  
MIAMI-DADE COUNTY  
PRODUCT CONTROL APPROVED  
TAS-201, TAS-202, TAS-203  
NOA# 15-0528.06

ALTERNATE MANUFACTURING LOCATION

4. DESIGN PRESSURE CALCULATIONS SHALL BE PERFORMED BY A REGISTERED ARCHITECT OR PROFESSIONAL ENGINEER IN ACCORDANCE WITH ASCE 7-10. THE ALLOWABLE DESIGN PRESSURES FOR EACH PRODUCT TYPE (APPROVED UNDER THIS N.O.A.) ARE LISTED WITH ITS CORRESPONDING DRAWING.
5. ALL ALUMINUM PARTS ARE MADE FROM 6063 T5 SERIES ALUMINUM. THE PERFORATED PANELS SHALL BE .079" (NOMINAL THICKNESS) GALVANNEALED STEEL WITH AN OPTION FOR .079" (NOMINAL THICKNESS) STAINLESS STEEL. ALL PARTS SHALL BE SUPPLIED WITH A PROTECTIVE FINISH.
6. A FASTENER SCHEDULE FOR EACH PRODUCT CAN BE FOUND ON THE INDIVIDUAL DRAWINGS.
7. BARRIER CONSTRUCTION SHALL BE IN ACCORDANCE WITH DESIGNS AND METHODS SET FORTH BY THE MANUFACTURER CONTAINED HEREIN.
8. TO ENSURE PROPER OPERATION, INSTALLATION SHALL BE PERFORMED USING METHODS AND INSTRUCTIONS SET FORTH BY THE MANUFACTURER CONTAINED WITHIN THESE DRAWINGS.
9. UNITS MUST BE ATTACHED TO CONCRETE OR STRUCTURAL COMPONENTS OF THE BUILDING. OUTER WALL COVERINGS OR DECORATIVE ATTACHMENTS THAT ARE NOT PART OF THE BUILDING STRUCTURE ARE NOT SUITABLE FOR MOUNTING.

DRAWING INDEX

PAGE 1 OF 8 - GENERAL NOTES/INDEX

4 X 9 READY MOUNT (ENHANCED)


PAGE 2 OF 8 - 4' X 9' SINGLE, READY MOUNT, FACE MOUNT UNIT.  
PAGE 3 OF 8 - 4' X 9' SINGLE, READY MOUNT, INSET MOUNT UNIT.  
PAGE 4 OF 8 - 4' X 9' TRIPLE, READY MOUNT, FACE MOUNT UNIT.  
PAGE 5 OF 8 - 4' X 9' TRIPLE, READY MOUNT, INSET MOUNT UNIT.

MATERIALS & FASTENER SCHEDULE

PAGE 6 OF 8 - SUBFRAME ASSEMBLY DETAILS  
PAGE 7 OF 8 - COMPONENT/EXTRUSION DETAILS.  
PAGE 8 OF 8 - COMPONENT/EXTRUSION DETAILS. CONT.









CONSULTING ENGINEER  
LARRY D JONES, P.E.  
103 HIGHLANDPARK PLAZA  
COVINGTON, LA 70433  
(985) 893-2104  
FL LIC # 30214

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0528.06  
Expiration Date 08/12/2019  
By *[Signature]*  
Miami Dade Product Control

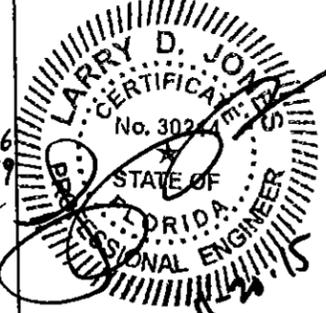


TITLE/CUSTOMER		STORM SHIELD HURRICANE BARRIERS DRAWING INDEX/NOTES	
SCALE: NTS		DRAWN BY: RBM	REVISED
DATE: 3/23/09		Rev 2 11/19/15	
266 34TH ST NEW ORLEANS, LA 70124		PH (570) 693-4220 FAX (570) 693-2575	
PRODUCT CONTROL CODE:		DRAWING NO. SSHB-3	PAGE 1 OF 8



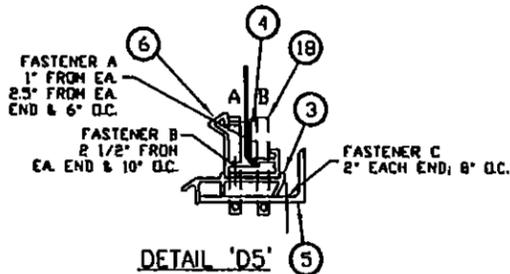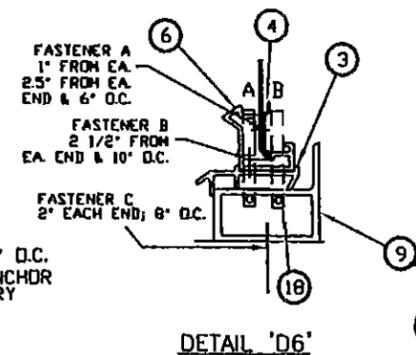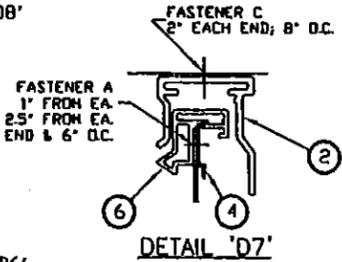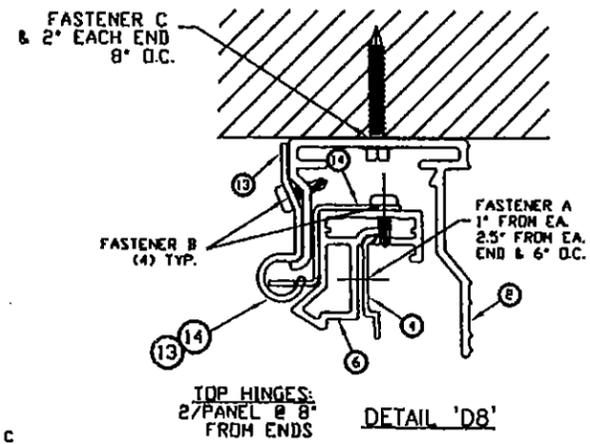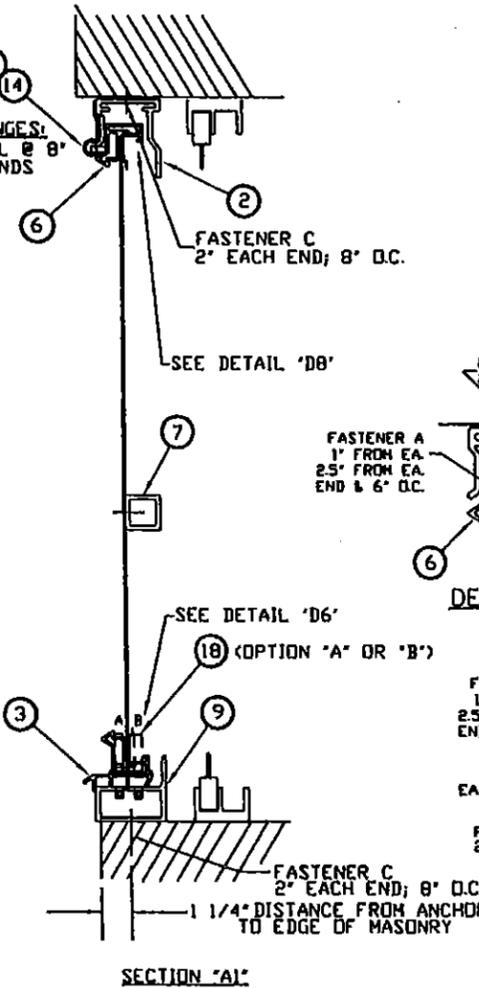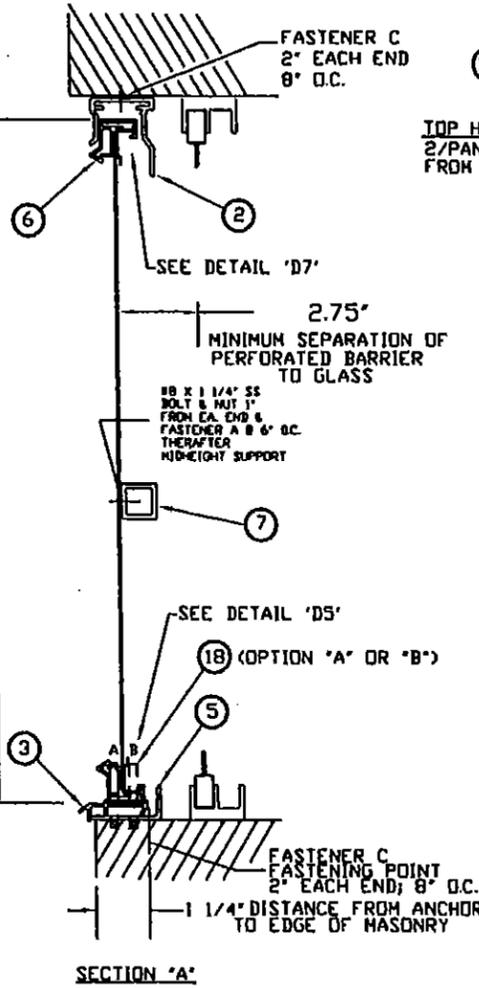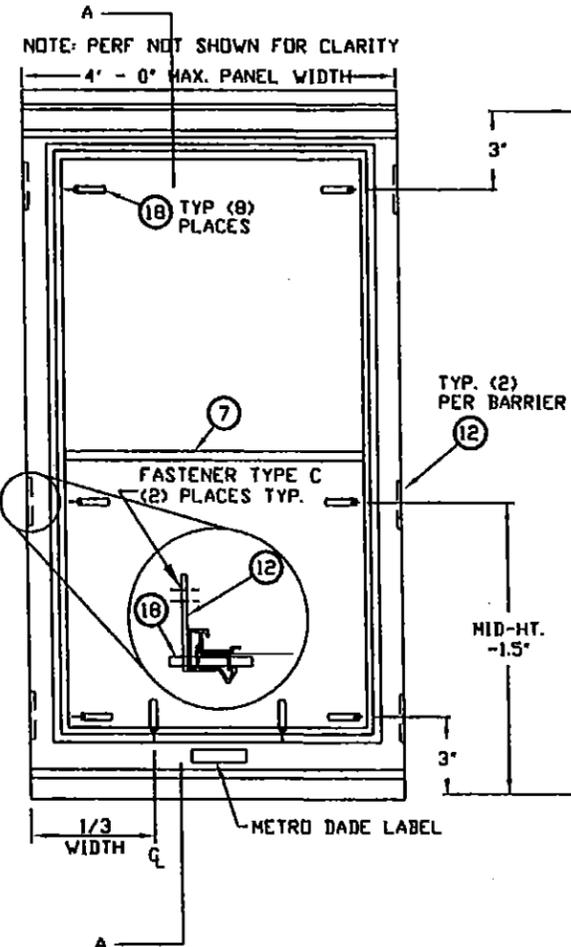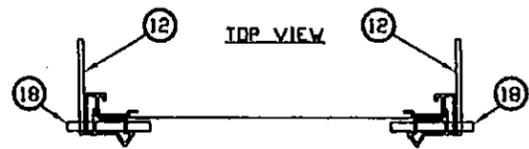

PRODUCT REVISED as complying with the Florida Building Code  
Acceptance No. 15-0528.06  
Expiration Date 08/12/2019  
By *[Signature]*  
Miami Dade Product Control

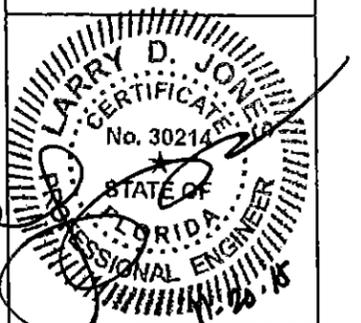

MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	105	105
STAINLESS STEEL	105	105


- NOTES:
- SECTION 'A' IS STANDARD LAYOUT, WHILE SECTION 'A1' SHOWS OPTIONAL FEATURES.
  - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
  - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
  - FASTENER TYPE C: 1/4" X 1 3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
  - SEE PAGE 7 & 8 FOR EXTRUSION DETAILS

TITLE/CUSTOMER  
DETAILS FOR STORM SHIELD HURRICANE BARRIERS  
'READY MOUNT UNITS'  
4' X 9' SINGLE (INSET MOUNT)

SCALE: NTS	WWW.STORMSHIELD.NET	DRAWN BY: RBH
DATE: 3/23/09		REVISED Rev 2 11/19/15
266 34TH ST NEW ORLEANS, LA 70124		PH (570) 693-4220 FAX (570) 693-2575
PRODUCT CONTROL CODE:		DRAWING NO. SSHB-3

PAGE 3 OF 8

CONSULTING ENGINEER  
LARRY D JONES, P.E.  
103 HIGHLANDPARK PLAZA  
COVINGTON, LA 70433  
(985) 893-2104  
FL LIC # 30214

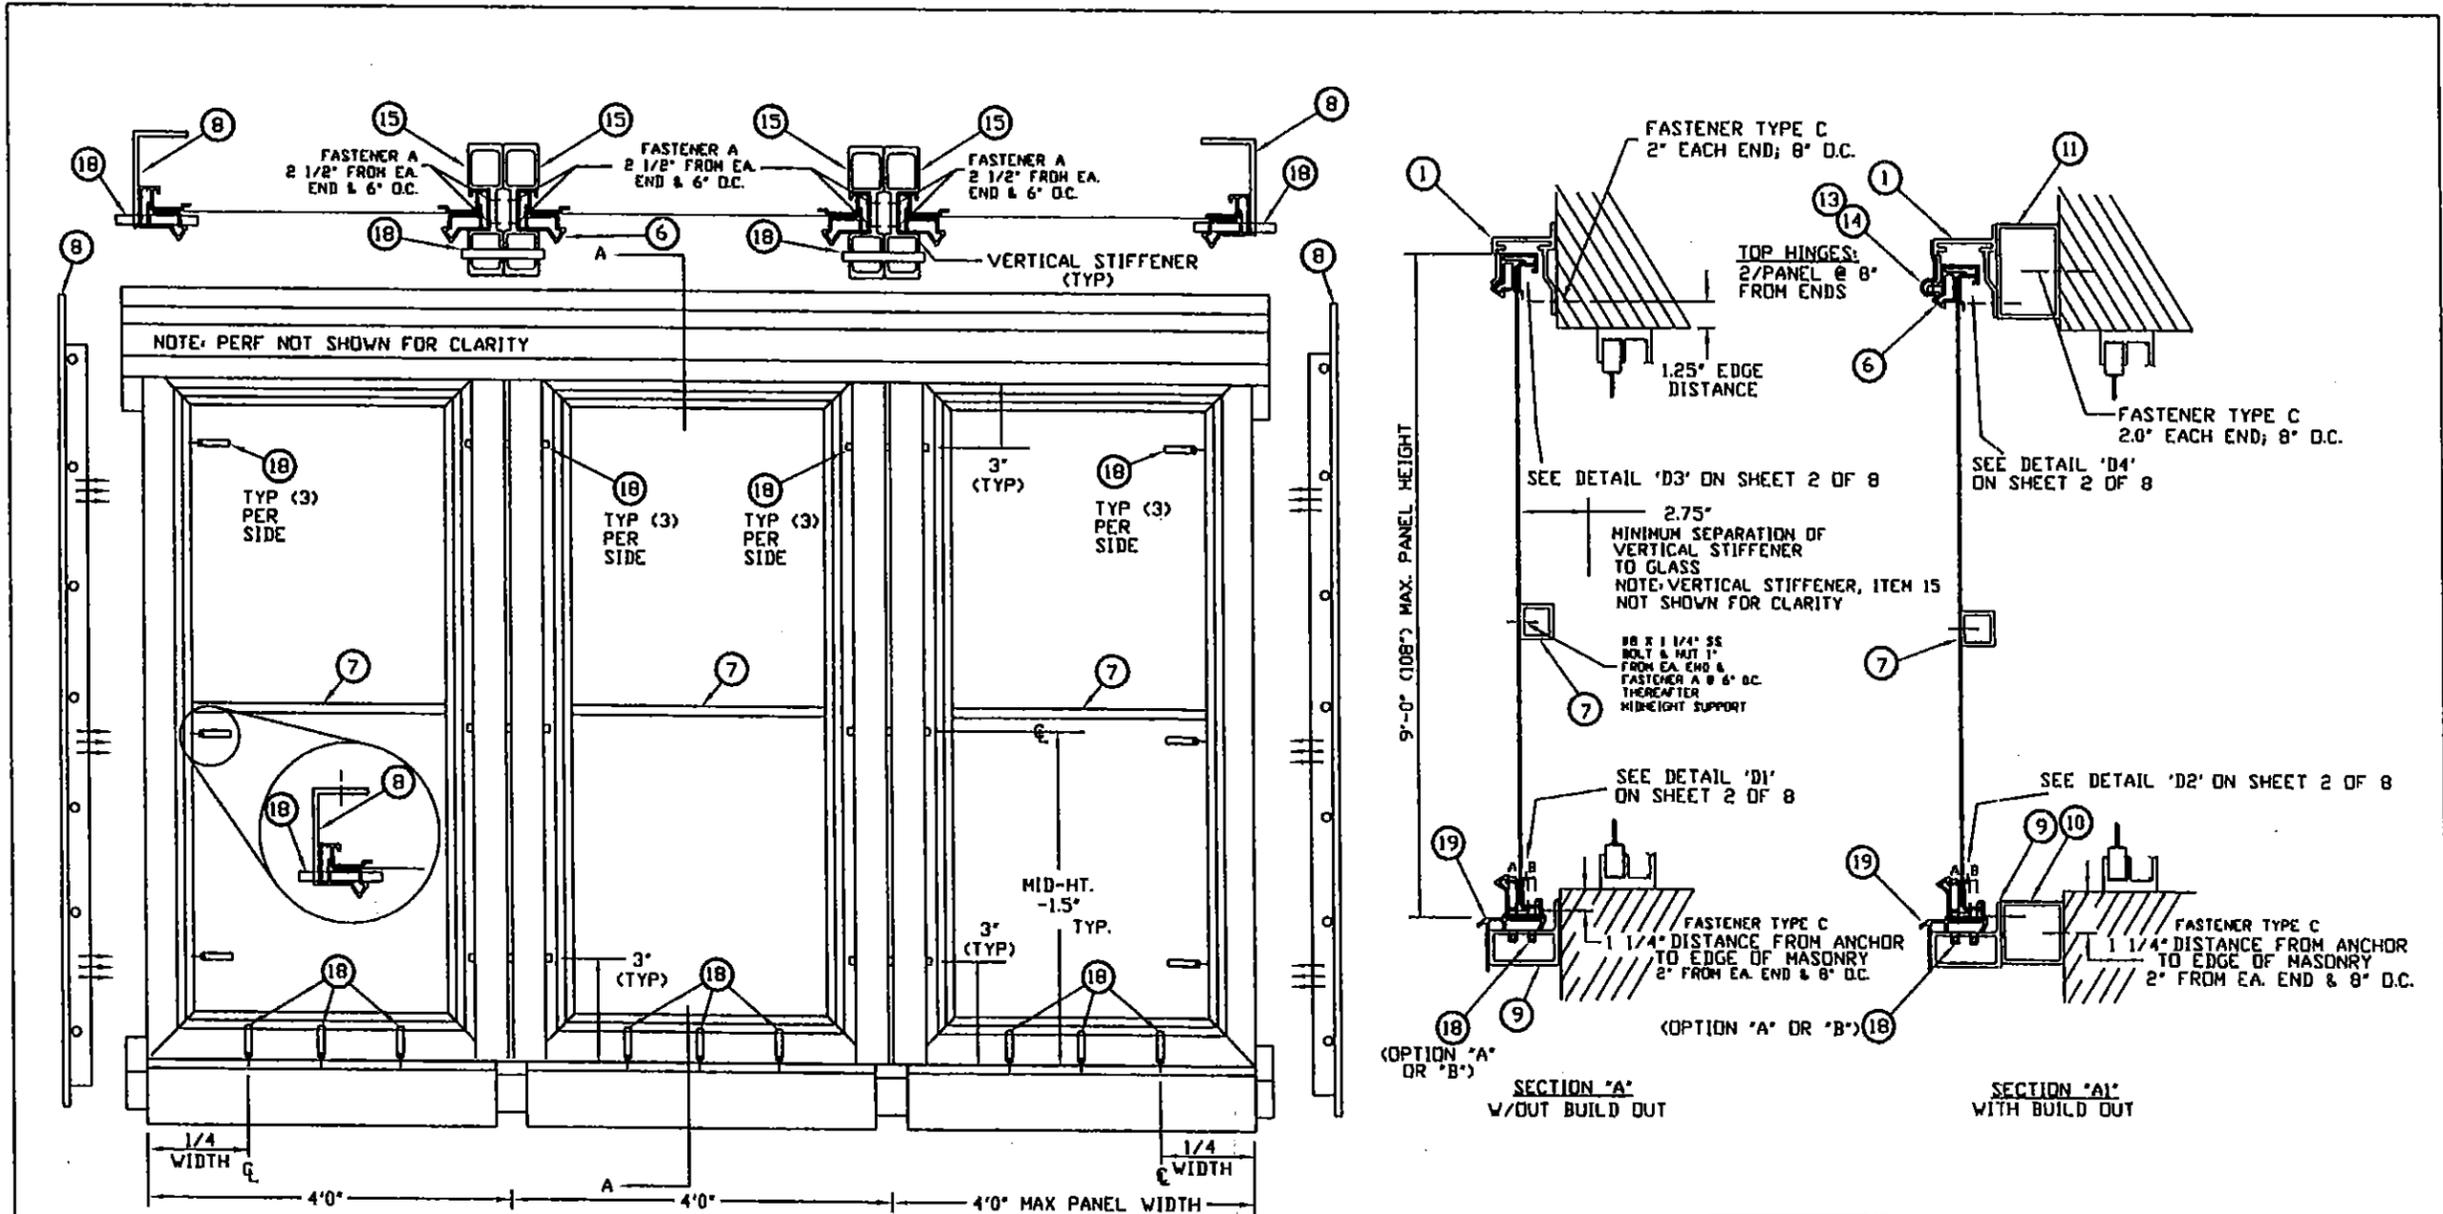


MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	86	86
STAINLESS STEEL	86	86



- NOTES:**
- SECTION "A" IS STANDARD LAYOUT, WHILE SECTION "A1" SHOWS OPTIONAL FEATURES.
  - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
  - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
  - FASTENER TYPE C: 1/4" X 1 3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
  - SEE PAGE 7 & 8 FOR EXTRUSION DETAILS

CONSULTING ENGINEER  
**LARRY D. JONES, P.E.**  
 103 HIGHLANDPARK PLAZA  
 COVINGTON, LA 70433  
 (985) 893-2104  
 FL LIC # 30214

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 15-0528.0  
 Expiration Date 08/12/2019  
 By: *[Signature]*  
 Miami Design Product Control

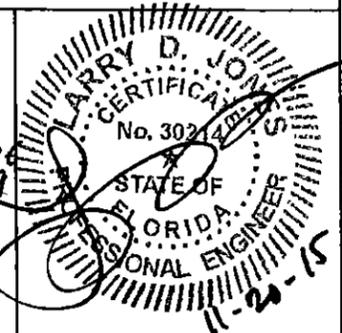

TITLE/CUSTOMER <b>DETAILS FOR STORM SHIELD HURRICANE BARRIERS        "READY MOUNT UNITS"        4' X 9' TRIPLE (FACE MOUNT)</b>		DRAWN BY: RBM	
SCALE: NTS	WWW.STORMSHIELD.NET	REVISED Rev 2 11/19/15	
DATE: 3/23/09		PH (570) 693-4220 FAX (570) 693-2575	
PRODUCT CONTROL CODE:		DRAWING NO. SSHB-3	
		PAGE 4 OF 8	

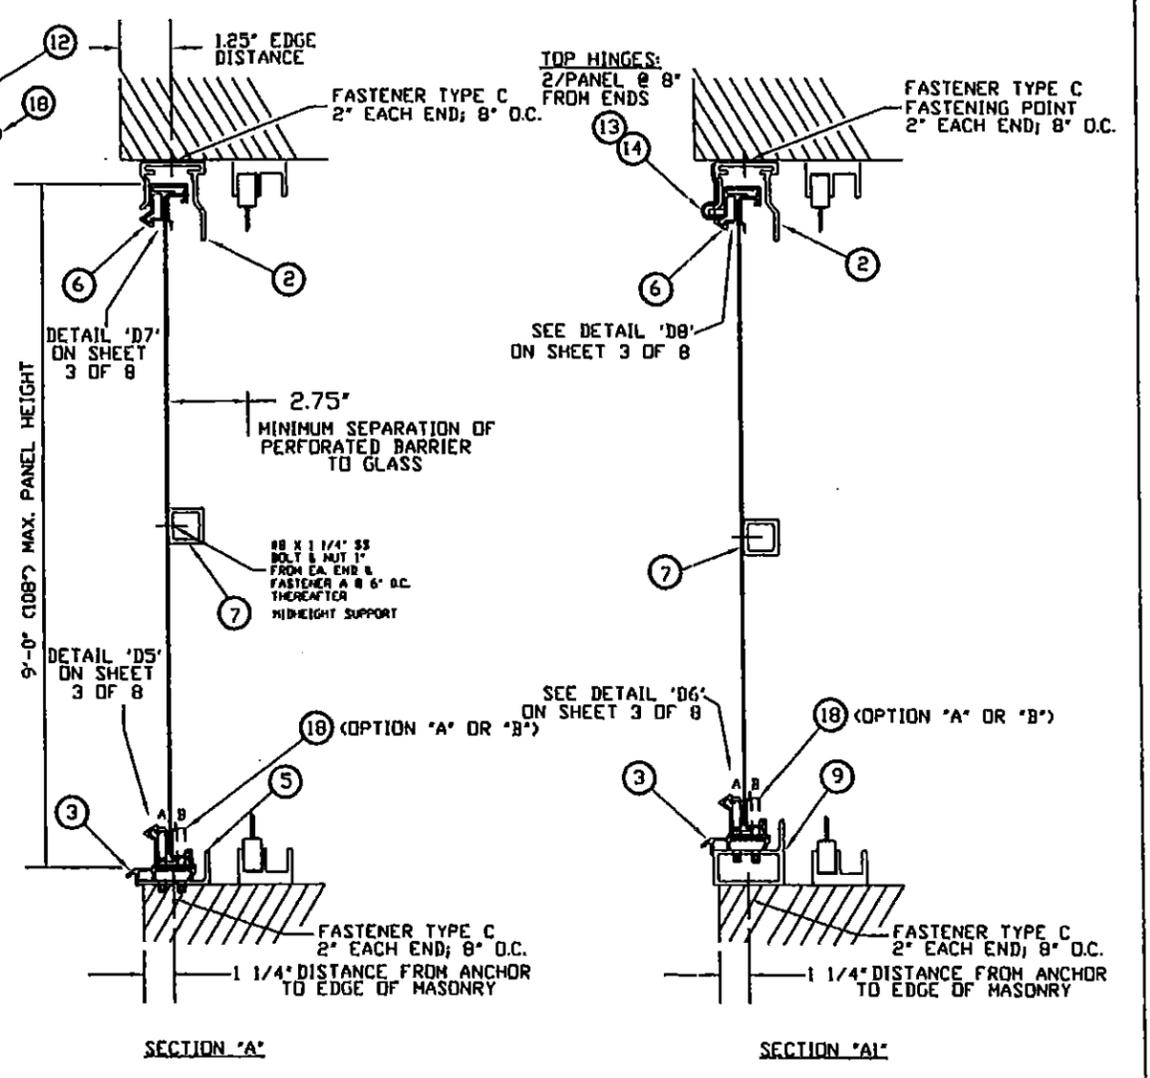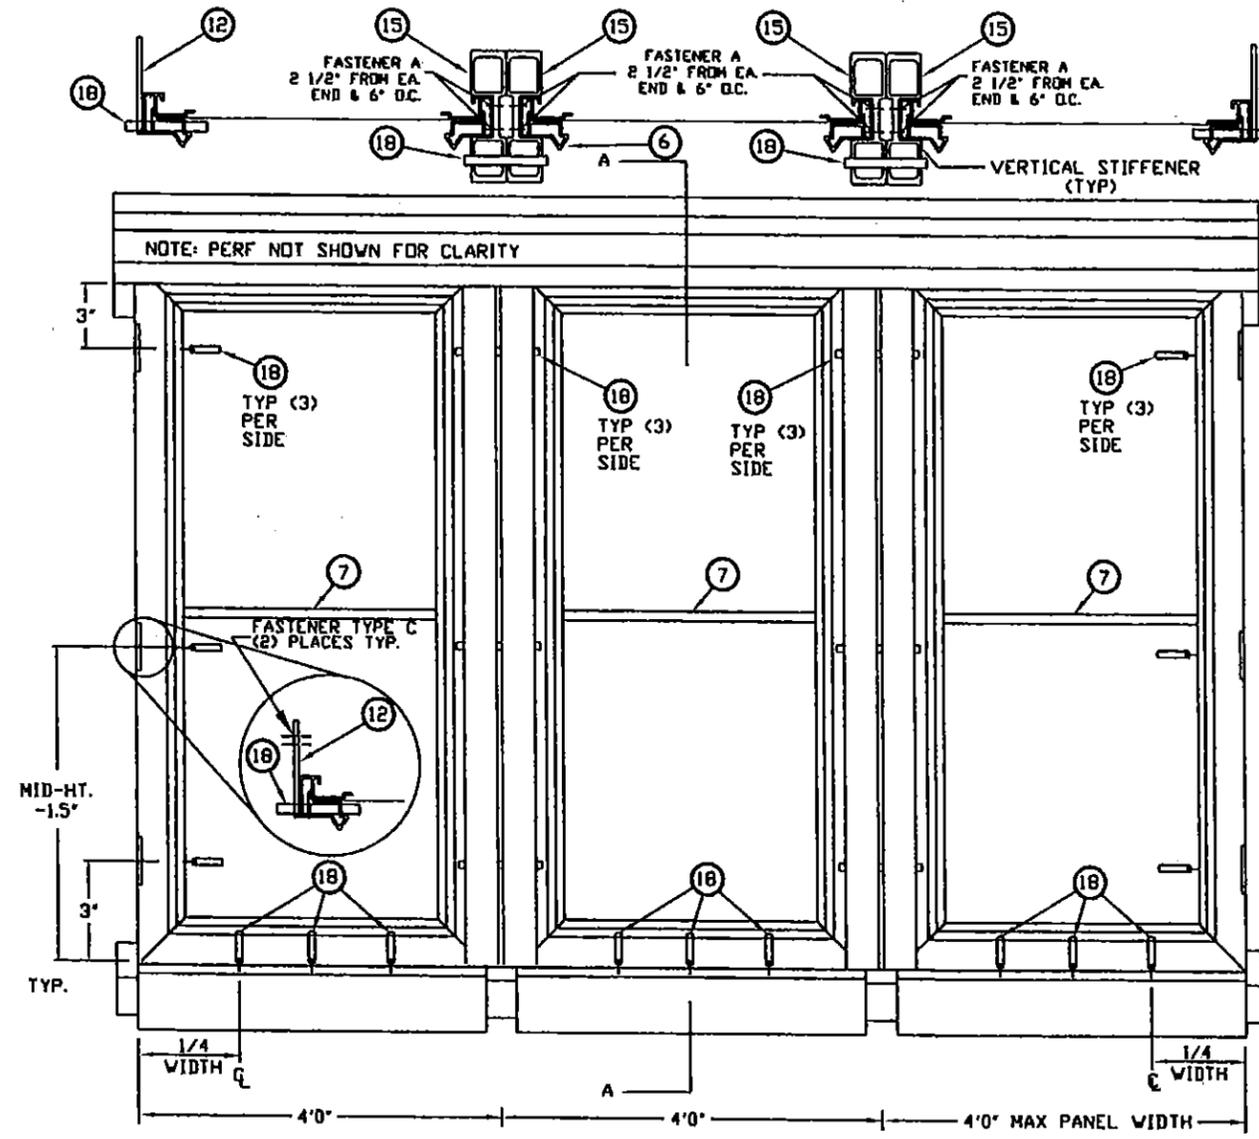


MID HEIGHT TUBE REQUIRED

MAT. TYPE	DESIGN PRESSURE RATING	
	POS. (PSF.)	NEG. (PSF.)
GALVANNEAL	86	86
STAINLESS STEEL	86	86

- NOTES:**
- SECTION 'A' IS STANDARD LAYOUT, WHILE SECTION 'A1' SHOWS OPTIONAL FEATURES.
  - FASTENER TYPE A: #10 X 5/8" SS TEK SCREW
  - FASTENER TYPE B: #10 X 3/4" SS TEK SCREW
  - FASTENER TYPE C: 1/4" X 1 3/4" ELCO TAPCON WITH 1.75" MINIMUM EMBEDMENT WITH FILLED CELLS.
  - SEE PAGE 7 & 8 FOR EXTRUSION DETAILS

CONSULTING ENGINEER  
 LARRY D. JONES, P.E.  
 103 HIGHLANDPARK PLAZA  
 COVINGTON, LA 70433  
 (985) 893-2104  
 FL LIC # 30214


PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No. 15-0528.06  
 Expiration Date 08/12/2019  
 By *[Signature]*  
 Miami Dade Product Control

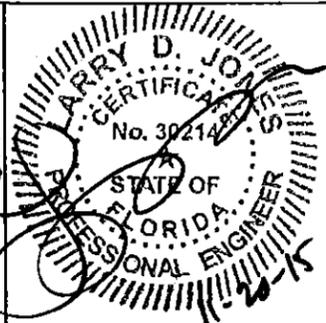


TITLE/CUSTOMER  
 DETAILS FOR STORM SHIELD HURRICANE BARRIERS  
 "READY MOUNT UNITS"  
 4' X 9' TRIPLE (INSET MOUNT)

SCALE: NTS	WWW.STORMSHIELD.NET	DRAWN BY: RBM
DATE: 3/23/09	<b>EXETER</b> ARCHITECTURAL PRODUCTS	REVISED Rev 2 11/19/15
266 34TH ST NEW ORLEANS, LA 70124		PH (570) 693-4220 FAX (570) 693-2575
PRODUCT CONTROL CODE:	DRAWING NO. SSHB-3	
PAGE 5 OF 8		

# HURRICANE BARRIER SUBFRAME ASSEMBLY DETAILS

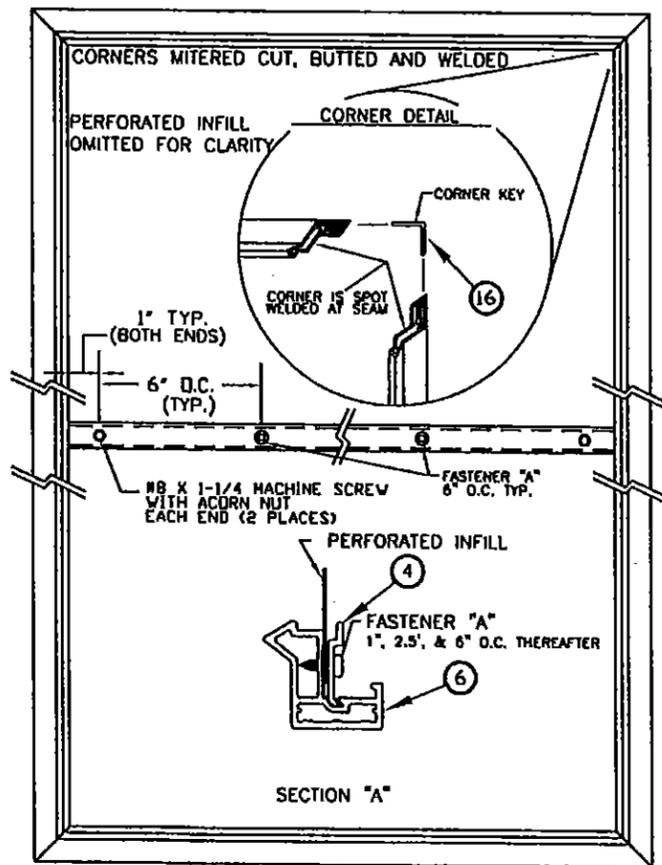

PANEL FRONT

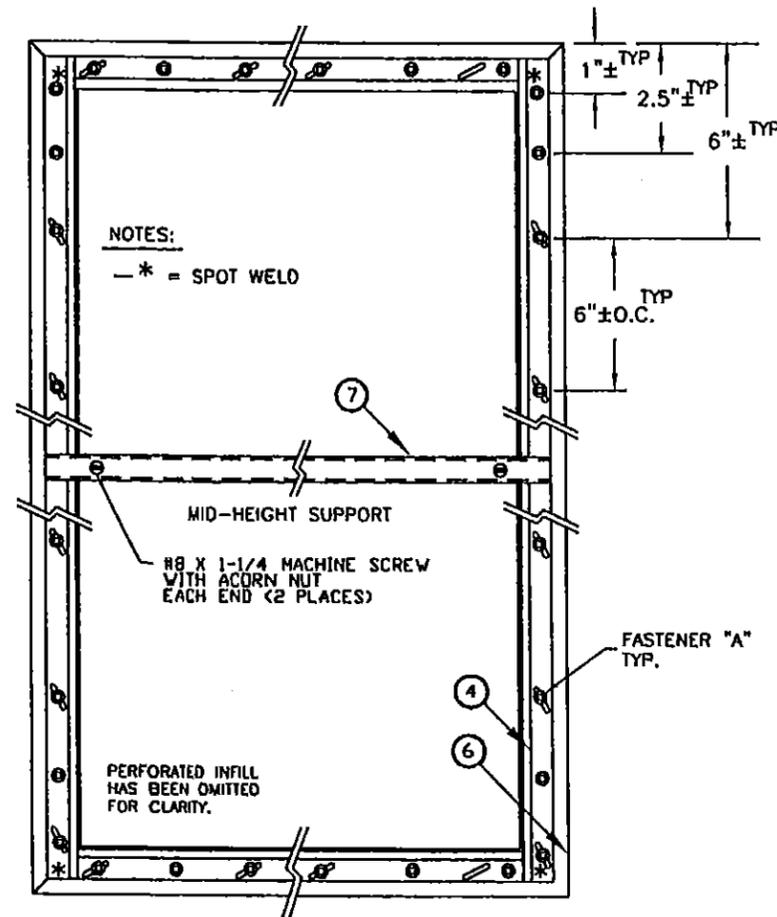


PANEL REAR

1 X 1 X 1/8 MIDHEIGHT SUPPORT:  
REQUIRED AS SHOWN

SCREW LOCATIONS FROM ALL CORNERS AND ON EITHER SIDE OF THE REINFORCEMENT BAR AND SPACED 6" O.C. THEREAFTER.

CONSULTING ENGINEER  
LARRY D JONES, P.E.  
103 HIGHLANDPARK PLAZA  
COVINGTON, LA 70433  
(985) 893-2104  
FL LIC # 30214

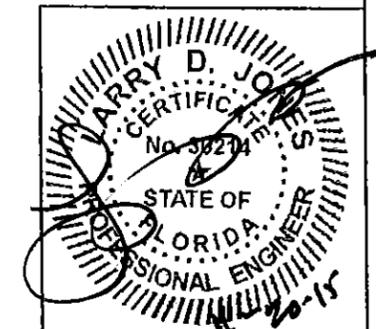


PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0528.06  
Expiration Date 08/12/2019  
By *Heidi A. White*  
Miami Dade Product Control

HARDWARE  
FASTENER A



FASTENER A  
#10X5/8" LONG  
ROBERTSON HEAD  
SELF-TAPPING SCREW  
1" & 2.5" FROM CORNER  
AND 6" O.C. THEREAFTER



MACHINE SCREW  
#8 X 1-1/4 SS  
WITH ACORN NUT  
1" FROM EA. END  
OF MID-HEIGHT SUPP.

TITLE/CUSTOMER

STORM SHIELD  
HURRICANE BARRIER SUBFRAME ASSEMBLY DETAILS  
4' X 9' UNITS (CONT'D)

SCALE: NTS

DATE: 3/23/09

WWW.STORMSHIELD.NET

DRAWN BY: RBM

REVISED

Rev 2 11/19/15

266 34TH ST  
NEW ORLEANS, LA 70124




PH (570) 693-4220  
FAX (570) 693-2575


PRODUCT CONTROL CODE:

DRAWING NO. SSHB-3


PAGE 6 OF 8




① **FACE MOUNT HEADER**  
TYP. WALL .095  
6063 T5 ALLOY

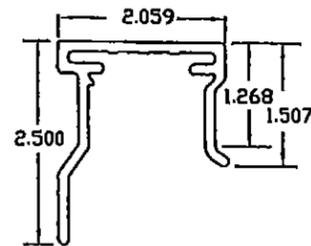


② **INSET MOUNT HEADER**  
TYP. WALL .095  
6063 T5 ALLOY




③ **MOD. BARRIER BRACKET**  
TYP. WALL .080  
6063 T5 ALLOY




④ **BARRIER RAIL**  
TYP. WALL .050  
6063 T5 ALLOY




⑤ **SILL BRACKET**  
TYP. WALL .125  
6063 T5 ALLOY




⑥ **SURROUND FRAME**  
TYP. WALL .080  
6063 T6 ALLOY




⑦ **MID-HEIGHT SUPPORT TUBE**  
TYP. WALL .125  
6063 T5 ALLOY

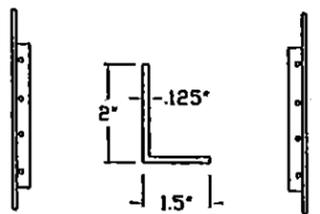


⑧ **2 x 1.5 x 1/8 ANGLE**  
2 X 1.5 X .125 FULL-LENGTH  
JAMB-ANGLE  
FULL PANEL HEIGHT  
6063 T5 ALLOY




⑨ **SECURITY SILL BRACKET**  
TYP. WALL .125  
6063 T5 ALLOY




⑩ **BUILD-OUT TUBE**  
2.000" X 2.000"  
X .125" TUBE  
6063 T5 ALLOY




⑪ **BUILD-OUT TUBE**  
2.000" X 3.000"  
X .125" TUBE  
6063 T5 ALLOY




⑫ **MID-HEIGHT SUPPORT FLAT**  
ALUMINUM FLAT  
2.000 X 3.000 X .125  
6063 T5 ALLOY



⑬ **TOP HINGE PART A**  
TYP. WALL .070  
6063 T5 ALLOY

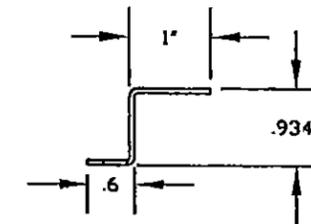

⑭ **TOP HINGE PART B**  
TYP. WALL 13 GA.  
STAINLESS STEEL




PERFORATED PATTERN:  
.1875" HOLES ON .25" STAG PATTERN  
**INVISIPERF II**  
FULL SCALE

**MATERIAL:**  
.079" (NOMINAL THICKNESS)  
GALVANNEALED STEEL  
STRUCTURAL QUALITY GRADE  
33 WITH A60 GALVANNEAL  
COATING PER ASTM A653  
FINISHED WITH POLYESTER  
POWDER COAT.  
.0705" (MIN. THICKNESS)

**OPTIONAL MATERIAL:**  
.079" (NOMINAL THICKNESS)  
STAINLESS STEEL  
PREPARED USING  
ASTM A240 SPECIFICATION.  
WITH THESE MIN. REQUIREMENTS  
-TENSILE STRENGTH - 75 ksi. MIN.  
-YIELD STRENGTH - 58 ksi. MIN.  
-ELONGATION - 40% IN 2" MIN.  
-HARDNESS - 92 r/b MAX.  
FINISHED WITH WEATHER  
RESISTANT, HIGH PERFORMANCE  
ELECTRO-STATIC APPLIED  
COATING.  
.0711" (MIN. THICKNESS)

CONSULTING ENGINEER  
LARRY D. JONES, P.E.  
103 HIGHLANDPARK PLAZA  
COVINGTON, LA 70433  
(985) 893-2104  
FL LIC # 30214

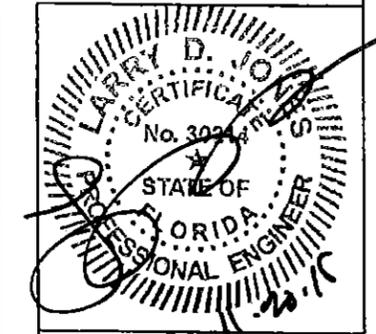

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0528.06  
Expiration Date 08/12/2019  
By *[Signature]*  
Miami Dade Product Control

TITLE/CUSTOMER  
DETAILS FOR STORM SHIELD HURRICANE BARRIERS  
READY MOUNT  
4' X 9' UNITS (CONT'D)

SCALE: NTS

DATE: 3/23/09



DRAWN BY: RBM

REVISED Rev 2 11/19/15


266 34TH ST  
NEW ORLEANS, LA 70124

PRODUCT CONTROL CODE:


PH (570) 693-4220  
FAX (570) 693-2575

DRAWING NO. SSHB-3

PAGE 7 OF 8




⑮ **VERTICAL STIFFENER**  
TYP. WALL = .0938  
6105-T5 ALLOY  
"DOUBLE HOLLOW"

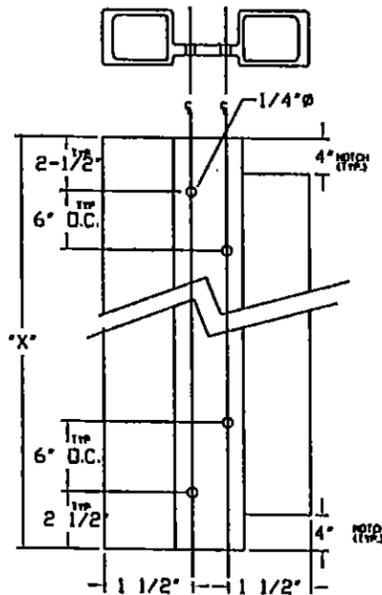

NOTE: SPACING BETWEEN LAST TWO FASTENER HOLES WILL VARY IN THE MIDDLE OF THE EXTRUSION


**FACE/INSET READY MOUNT**  
VERTICAL STIFFENER HOLE LOCATIONS  
TYP. WALL .0938  
6105 T5 ALLOY




⑯ **CORNER KEY**  
TYP. WALL = .095  
6063 T5 ALLOY  
(INTERNAL PART)



⑰ **#14 SHEET METAL SCREW**  
LENGTH = 2.5"  
OPTION A 18-8 STAINLESS STEEL




⑱ **SECURING PIN**  
TYP. DIA. .25"  
OPTION B 304 STAINLESS STEEL



⑲ **STANDARD BARRIER BRACKET**  
TYP. WALL .080  
6063 T5 ALLOY

CONSULTING ENGINEER  
LARRY D JONES, P.E.  
103 HIGHLANDPARK PLAZA  
COVINGTON, LA 70433  
(985) 893-2104  
FL LIC # 30214

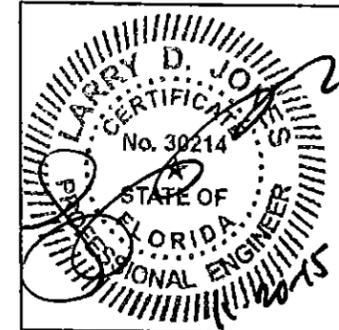

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No 15-0528.06  
Expiration Date 08/12/2019  
By *[Signature]*  
Miami Date Product Control

TITLE/CUSTOMER  
DETAILS FOR STORM SHIELD HURRICANE BARRIERS  
READY MOUNT  
4' X 9' UNITS (CONT'D)

SCALE: NTS  
DATE: 3/23/09



DRAWN BY: RBH  
REVISED Rev 2 11/19/15

266 34TH ST  
NEW ORLEANS, LA 70124

PH (570) 693-4220  
FAX (570) 693-2575

PRODUCT CONTROL CODE:

DRAWING NO. S5HB-3

PAGE 8 OF 8