



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Florida Storm Panel Supply, LLC
14475 N.W. 26th Avenue
Opa-Locka, Florida 33054

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER- Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: 0.029" (min.) Galvanized Steel Storm Panels Shutter

APPROVAL DOCUMENT: Drawing No. AD12-32, titled " 22 ga. Galvanized Steel Storm Panel-LMI ", sheets 1 through 4 of 4, prepared by MCY Engineering, Inc., last revision #1 dated May 27, 2015, signed and sealed by Yiping Wang, P.E., on June 02, 2015, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and the expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state, the following statement: "Miami-Dade County Product Control Approved", and NOA number, per TAS-201, TAS-202, and TAS-203, unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 12-1210.01 and consists of this page 1, evidence submitted pages E-1, E-2, and E-3 as well as approval document mentioned above.

The submitted documentation was reviewed by Helmy A. Makar, P.E., M.S.



Helmy A. Makar
07/23/2015

NOA No. 15-0615.06
Expiration Date: 01/23/2018
Approval Date: 07/23/2015
Page 1

Florida Storm Panels, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL #02-1120.02

A. DRAWINGS

1. *Drawing No. 02-868-111, titled " 22 ga Galvanized Steel Storm Panels ", sheets 1 through 4 of 4, prepared by Frank L. Bennardo, P.E., dated November 18, 2002, last revision dated January 02, 2003, signed and sealed by Frank L. Bennardo, P.E.*

B. TESTS

1. *Test report on: Uniform Static Air Pressure Test, Large Missile Impact Test and Cyclic Wind Pressure Test prepared by Construction Testing Corporation, Report No. 02-041, dated November 18, 2002, signed and sealed by Yamil G. Kuri, P.E.*
2. *Test report on fastener by Construction Testing Corporation, Report No. 02-007A, dated May 06, 2002, signed and sealed by Yamil G. Kuri, P.E.*
3. *Test report on Wood Bushings by Construction Testing Corporation, Report No. 02-038, dated October 07, 2002, signed and sealed by Yamil G. Kuri, P.E.*

C. CALCULATIONS

1. *22 ga. Galvanized Steel Storm Panels and Anchor Calculations, sheets 1 through 26 of 26, dated November 18, 2002, prepared by Frank L. Bennardo, P.E., signed and sealed by Frank L. Bennardo, P.E.*
2. *Anchor Calculations, 9 pages, dated November 18, 2002, prepared by Frank L. Bennardo, P.E., signed and sealed by Frank L. Bennardo, P.E.*

D. MATERIAL CERTIFICATIONS

1. *Mill Certified Inspection Report.*
2. *Certified Tensile Test Report issued by Certified Testing Laboratory, Report Number 1098H, dated October 29, 2002, signed and sealed by Ramesh Patel, P.E.*

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 07-0817.03

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Building Code Compliance Office.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Helmy A. Makar, P.E., M.S.
Product Control Unit Supervisor

NOA No. 15-0615.06

Expiration Date: 01/23/2018

Approval Date: 07/23/2015

Florida Storm Panels, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-0410.01

A. DRAWINGS

1. *Drawing No. AD12-32, titled " 22 ga. Galvanized Steel Storm Panel-LMI ", sheets 1 through 4 of 4, prepared by MCY Engineering, Inc., dated April 02, 2012, signed and sealed by Yiping Wang, P.E., on April 06, 2012.*

B. TESTS

1. *None.*

C. CALCULATIONS

1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Permitting, Environment, and Regulatory Affairs (PERA).*

E. MATERIAL CERTIFICATIONS

1. *None.*

4. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 12-1210.01

A. DRAWINGS

1. *None.*

B. TESTS

1. *None.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE

1. *By Miami-Dade County Department of Regulatory and Economic Resources.*

E. MATERIAL CERTIFICATIONS

1. *None.*



Henry A. Makar, P.E., M.S.
Product Control Unit Supervisor

NOA No. 15-0615.06

Expiration Date: 01/23/2018

Approval Date: 07/23/2015

Florida Storm Panels, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

5. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. AD12-32, titled "22 ga. Galvanized Steel Storm Panel-LMI", sheets 1 through 4 of 4, prepared by MCY Engineering, Inc., last revision #1 dated May 27, 2015, signed and sealed by Yiping Wang, P.E., on June 02, 2015.

B. TESTS

1. *None.*

C. CALCULATIONS


1. *None.*

D. QUALITY ASSURANCE


1. *By Miami-Dade County Department of Regulatory and Economic Resources (RER).*

E. MATERIAL CERTIFICATIONS


1. *None.*




Helmy A. Makar, P.E., M.S.
Product Control Unit Supervisor
NOA No. 15-0615.06
Expiration Date: 01/23/2018
Approval Date: 07/23/2015

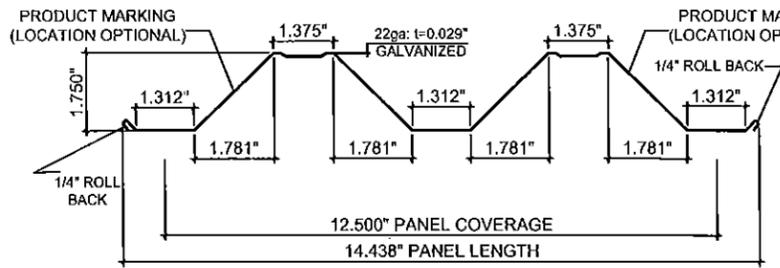


1 STORM PANEL




2 "H" HEADER




3 "U" HEADER




4 BUILD-OUT "F" TRACK




5 "F" TRACK

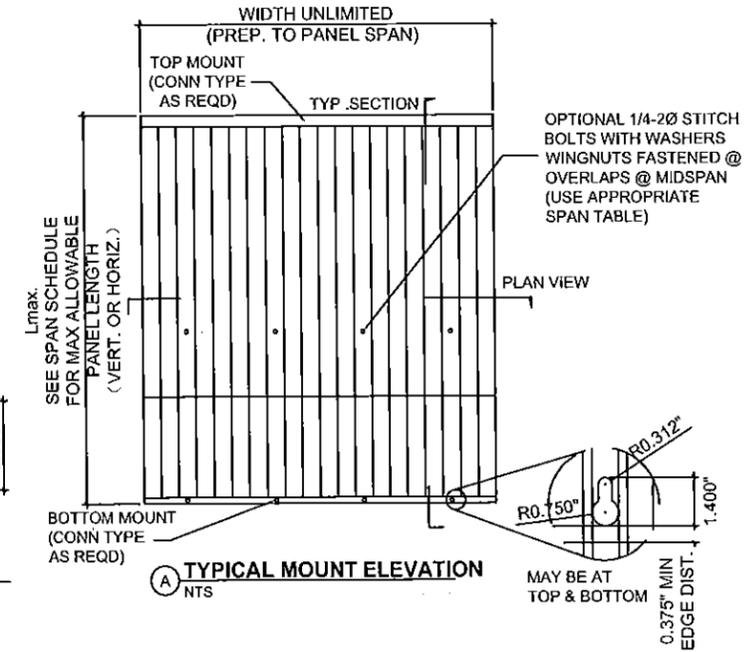


A TYPICAL MOUNT ELEVATION




6 STUDED ANGLE




7 BULL DOUT/CLOSURE ANGLE

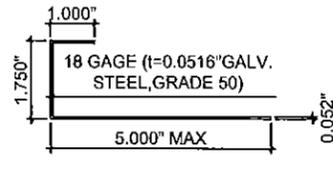


8 J-PAN CLOSURE



9 WASHERED WINGNUT (ZAMAC 3 ALLOY)



10 KEYHOLE WASHER (GLAV. STEEL GRADE 50)



11 HEADER END CAP (1.750\"/>

GENERAL NOTES:

1. THIS SHUTTER SYSTEM HAS BEEN DESIGNED AND TESTED AS A LARGE MISSILE IMPACT PROTECTIVE SYSTEM IN ACCORDANCE WITH THE FLORIDA BUILDING CODE 2014 AND PROTOCOLS TAS 201 FOR LARGE MISSILE IMPACT, TAS 202 FOR UNIFORM STATIC AIR PRESSURE AND TAS 203 FOR CYCLIC WIND LOADING.

2. ULTIMATE DESIGN LOAD OBTAINED FROM ASCE7-10, MULTIPLY BY 0.6 SHALL BE LESS THAN OR EQUAL TO MAX. DESIGN LOAD IN THIS DOCUMENT.

3. NO 33.3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THE ANCHOR SPACING TABLES.

4. POSITIVE AND NEGATIVE DESIGN PRESSURES TO BE USED WITH THESE DRAWINGS SHALL BE DETERMINED BY OTHERS ON A JOB-SPECIFIC BASIS IN ACCORDANCE WITH THE GOVERNING CODE. WHEN ASCE 7-10 IS USED TO CALCULATE PRESSURES FOR USE WITH THIS PRODUCT, THE USE OF A DIRECTIONALITY FACTOR $K_d=0.85$ IS ALLOWED.

5. THE SHUTTER SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. IF SITE CONDITIONS DEVIATE FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS TO BE USED IN CONJUNCTION WITH THIS DOCUMENT.

6. PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND ADDITIONAL IMPOSED LOADS.

7. STORM PANELS SHALL BE 22GA STEEL (GALVANIZED THICKNESS $t=0.029$ MIN) CONFORMING TO ASTM A653, STRUCTURAL QUALITY, GRADE 80, G90 GALV. COATING WITH A MIN. $F_y=92.0$ KSI. ALL EXTRUSIONS SHALL BE 6063-T6 ALUMINIUM ALLOY.


8. PANELS SHALL BE PERMANENTLY LABELED WITH A MINIMUM OF ONE MARKING PER PANEL AS FOLLOWS:

FLORIDA STORM PANELS, INC
OPA-LOCKA, FLORIDA
MIAMI-DADE COUNTY PROD. CONTROL APPROVED


9. STORM PANELS HAVE BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS AND LOADS SHOWN ON THESE DRAWINGS. REFERENCE CONSTRUCTION TESTING CORPORATION (CTC), OF MIAMI, FL, TEST REPORT NO. 02-041.

10. TOP & BOTTOM DETAILS SHOWN MAY BE INTERCHANGED AS FILED CONDITIONS DICTATE. PANELS MAY BE MOUNTED HORIZONTALLY WHERE APPLICABLE, EXCEPT FOR MOUNTING CONDITIONS INCLUDING "H" OR "U" HEADERS.


11. ALL BOLTS & WASHERS SHALL BE ZINC COATED, GALVANIZED OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI.




13 TOP "H" TRACK




14 BOTTOM "H" TRACK




15 TOP "U" TRACK

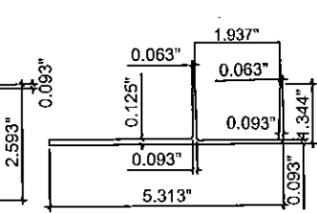


16 BOTTOM "U" TRACK

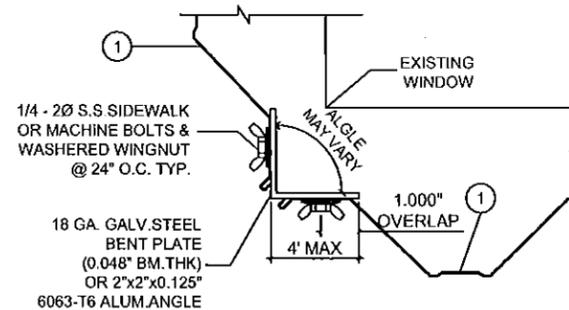


C CORNER CLOSURE DETAIL

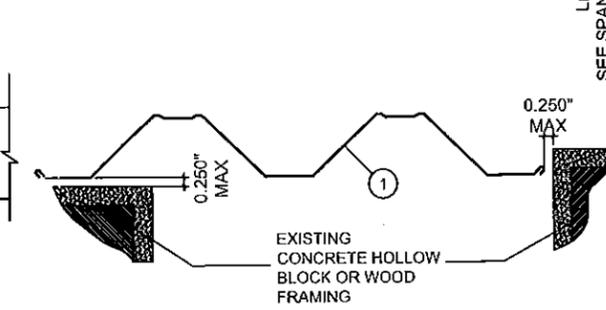


D WALL MOUNT CLOSURE DETAIL

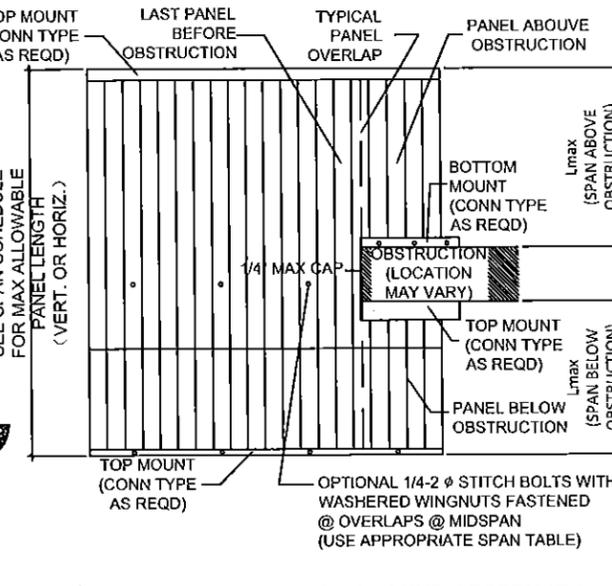

B TYPICAL MOUNT ELEVATION AROUND OBSTRUCTION

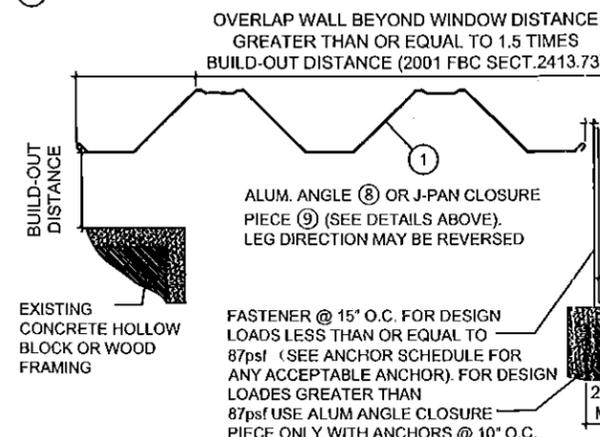

E BUILD-OUT MOUNT CLOSURE DETAIL

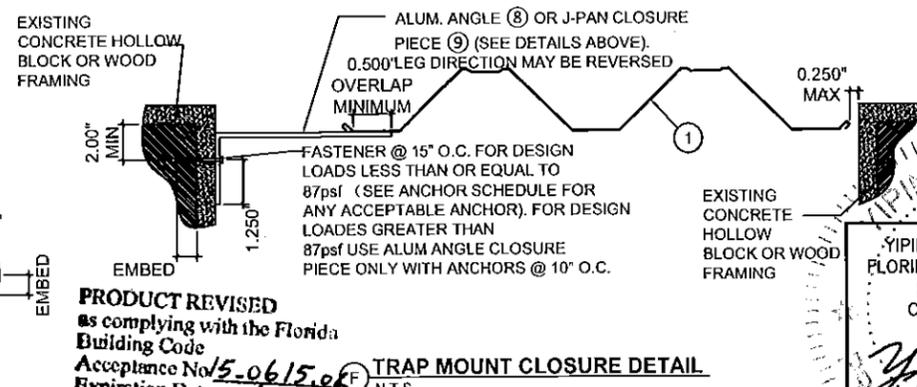


F TRAP MOUNT CLOSURE DETAIL

PRODUCT REVISED

as complying with the Florida Building Code


Acceptance No. 15-0615, 06 F
Expiration Date 01/23/2018

By *[Signature]*
Miami Dade Product Control

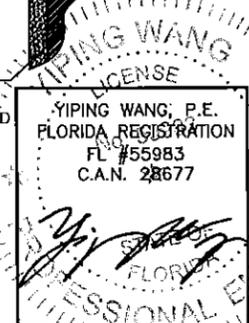


REVISIONS	
NO.	DATE DESCRIPTION
1	06-27-15 UPDATED TO 2014 FBC


MCY	
MCY ENGINEERING, INC. GLAZING CONSULTANTS	
8501 SW 124 Ave. STE. 205A MIAMI, FL 33183	P: 305.271.0117 F: 786.573.5063
www.MCYEngineering.com	
22 GA. GALVANIZED STEEL STORM PANEL - LMI	
FLORIDA STORM PANEL SUPPLY, LLC.	
14475 N.W. 26TH AVE. OPA LOCKA, FL. 33054	
P: (305) 685 - 9000 F: (305) 685 - 7511	
DATE	06-02-15
SCALE	AS NOTED
DRAWN	S.L.
PROJECT	MCY 12-078
DRAWING NO.	AD12-32
1 OF 4	

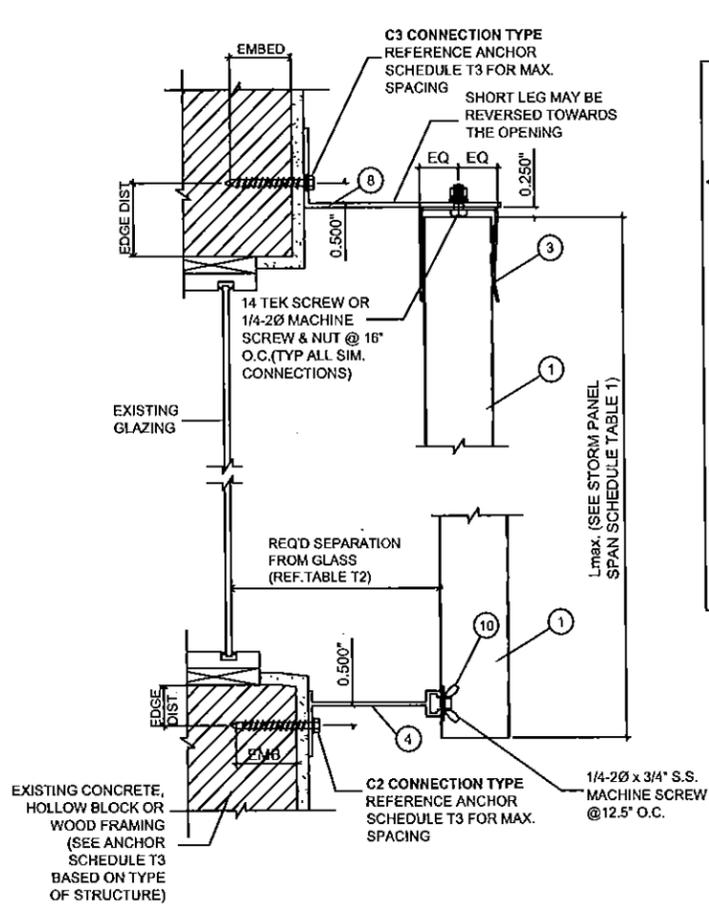


G BUILD-OUT MOUNT SECTION
N.T.S.

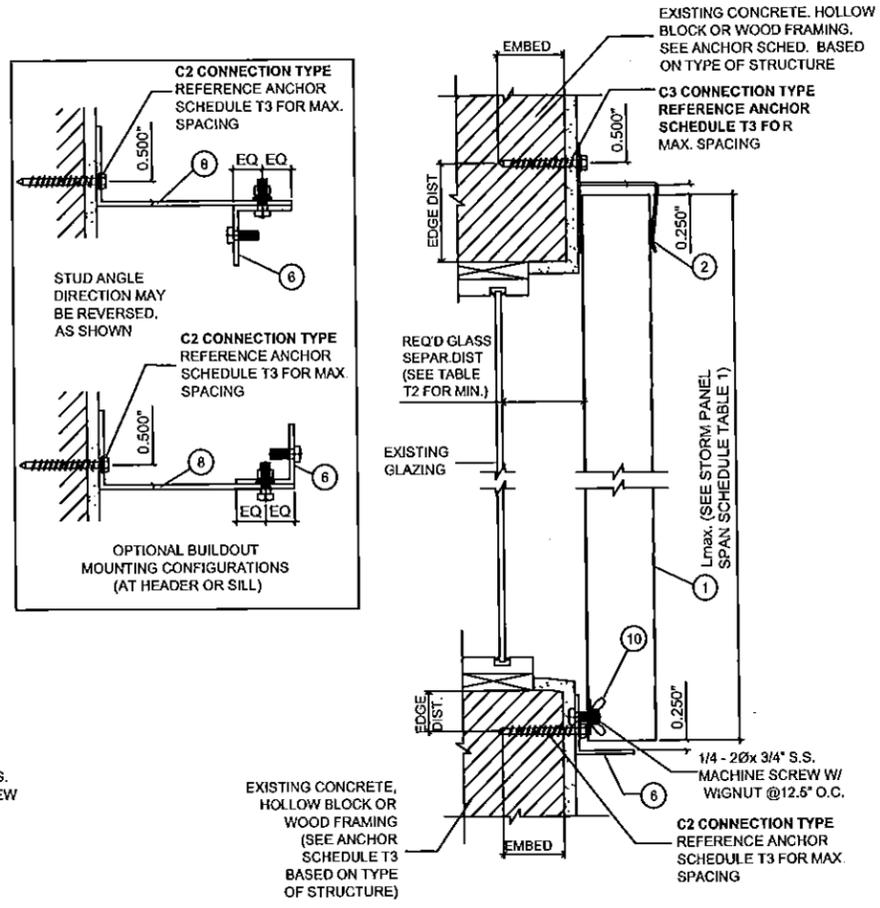

H WALL MOUNT SECTION
N.T.S.

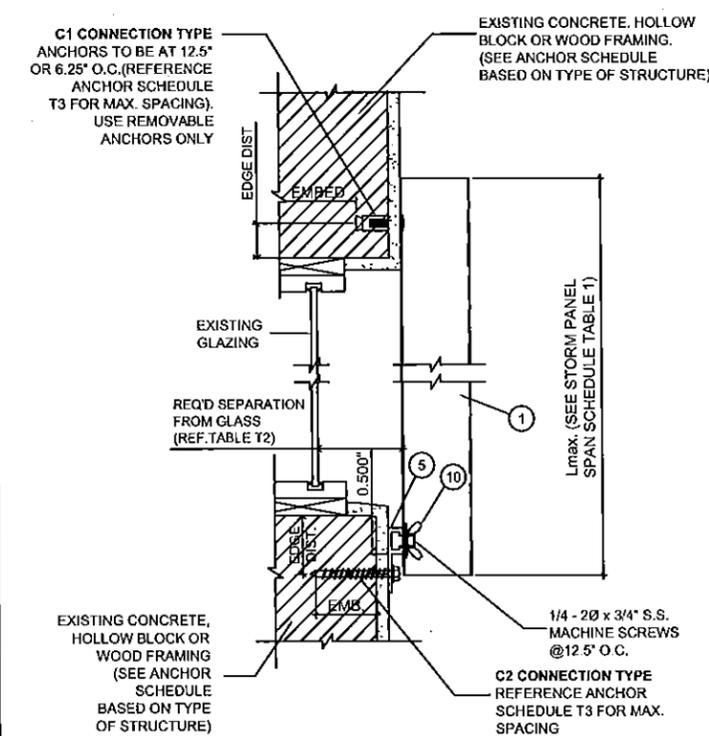

I TRACK /DIRECT MOUNT SECTION
N.T.S.

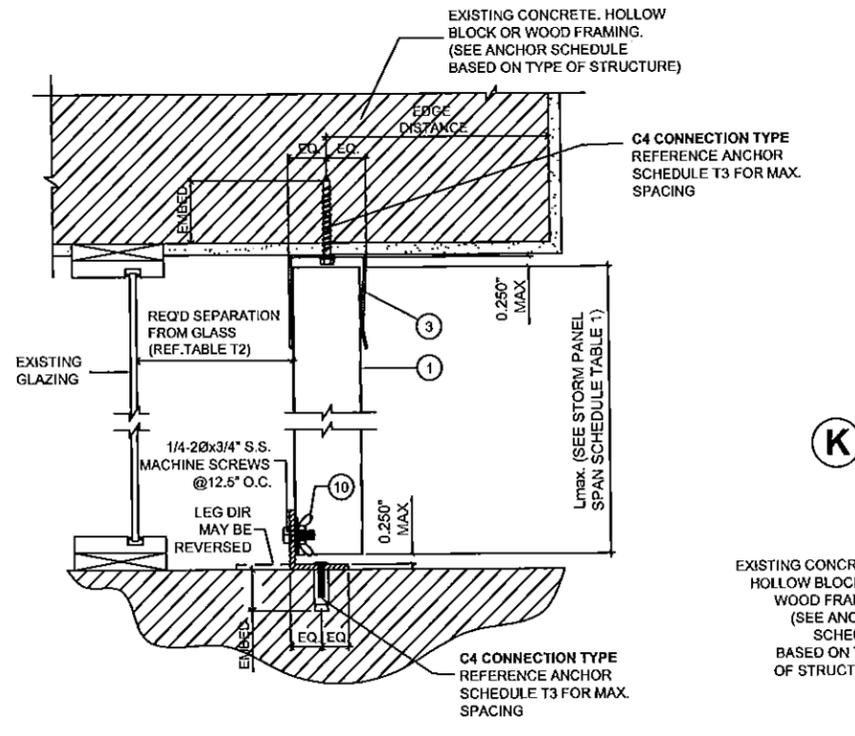

J CEILING/FLOOR MOUNT SECTION
N.T.S.

T1

MAXIMUM ALLOWABLE SPAN SCHEDULE

LOAD W(PSF)	No Stitch Bolts LMAX(I)	Stitch Bolts AT Midspan LMAX(I)
25	10'-7"	10'-7"
30	10'-5"	10'-5"
35	10'-0"	10'-0"
39	9'-9"	9'-9"
40	9'-8"	9'-8"
45	9'-4"	9'-5"
49	8'-11"	9'-3"
50	8'-10"	9'-2"
55	8'-5"	8'-11"
58	8'-2"	8'-10"
60	8'-1"	8'-9"
65	7'-9"	8'-3"
70	7'-6"	7'-8"
72	7'-4"	7'-6"
75	7'-2"	7'-2"
80	6'-9"	6'-9"
90	6'-0"	6'-0"
100	5'-4"	5'-4"
110	4'-10"	4'-10"
120	4'-6"	4'-6"
130	4'-1"	4'-1"


SPAN SCHEDULE NOTES:
 1. ENTER SPAN SCHEDULE WITH NEGATIVE DESIGN LOAD TO DETERMINE MAXIMUM ALLOWABLE STORM PANEL SPAN. SCHEDULE IS ACCEPTABLE FOR USE WITH POSITIVE LOADS LESS THAN OR EQUAL TO NEGATIVE DESIGN LOADS.
 2. INTERPOLATION BETWEEN LOADS IS ACCEPTABLE. OTHERWISE USE NEXT HIGHER LOAD.

T2


MINIMUM SEPARATION FROM GLASS SCHEDULE

Positive Load (PSF)	Span Less Than	Separation (inches) at <= 30'	Separation (inches) at > 30'
30	6'-0"	2.75"	1.22"
	8'-8"	2.75"	1.94"
	10'-5"	3.00"	3.00"
35	6'-0"	2.75"	1.25"
	8'-8"	2.75"	2.10"
	10'-0"	3.00"	3.00"
40	6'-0"	2.75"	1.29"
	8'-8"	2.75"	2.26"
	9'-8"	3.00"	3.00"
45	6'-0"	2.75"	1.32"
	8'-8"	2.75"	2.41"
	9'-4"	2.92"	2.92"
50	6'-0"	2.75"	1.36"
	8'-10"	2.75"	2.73"
	6'-0"	2.75"	1.43"
60	8'-1"	2.75"	2.44"
	6'-0"	2.75"	1.51"
70	7'-6"	2.75"	2.24"

TABLE T2 NOTES:
 1. ENTER SPAN SCHEDULE WITH POSITIVE DESIGN LOAD TO DETERMINE MINIMUM ALLOWABLE STORM PANEL SEPARATION FROM GLASS OR DOOR TO BE PROTECTED. SCHEDULE IS REQUIRED FOR USE WITH POSITIVE LOADS ONLY.
 2. INTERPOLATION BETWEEN LOADS IS ACCEPTABLE. OTHERWISE USE NEXT HIGHER LOAD.

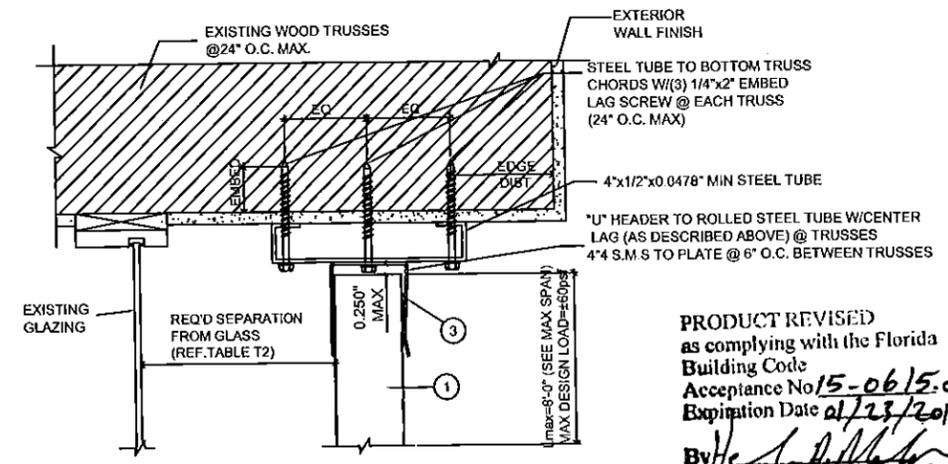

K TRUSS MOUNT SECTION
N.T.S.

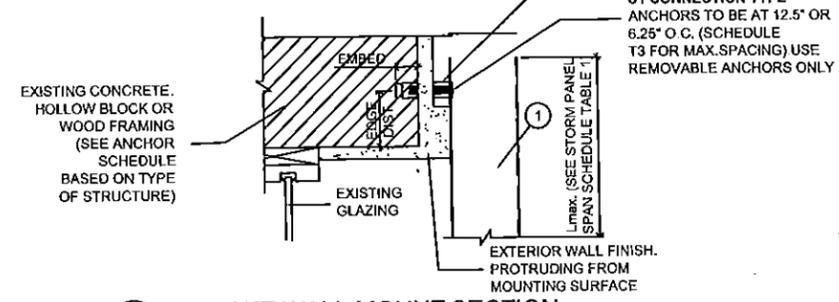

L OFFSET WALL MOUNT SECTION
N.T.S.

PRODUCT REVISED
 as complying with the Florida Building Code
 Acceptance No 15-0615-06
 Expiration Date 01/23/2018
 By: *[Signature]*
 Miami Date Product Control

YIPING WANG, P.E.
 FLORIDA REGISTRATION
 FL #55983
 C.A.N. 28677

REVISIONS

NO.	DATE	DESCRIPTION
1	06-02-15	UPDATED TO 2014 FBC

MCY

MCY ENGINEERING, INC.
 GLAZING CONSULTANTS
 8501 SW 124 Ave. STE. 205A
 MIAMI, FL 33183
 P: 305.271.0117
 F: 786.573.5063
 www.MCYEngineering.com
 MCY.Engineering@Att.net


22 GA. GALVANIZED STEEL STORM PANEL - LMI
FLORIDA STORM PANEL SUPPLY, LLC.
 14475 N.W. 26TH AVE.
 OPA LOCKA, FL. 33054
 P: (305) 685 - 9000 F: (305) 685 - 7511

DATE 06-02-15
SCALE AS NOTED
DRAWN S.L.
PROJECT MCY 12-079


DRAWING NO.
 AD12-32

2 OF 4

OPTIONAL INTERIOR MOUNT INSTALLATION DETAILS


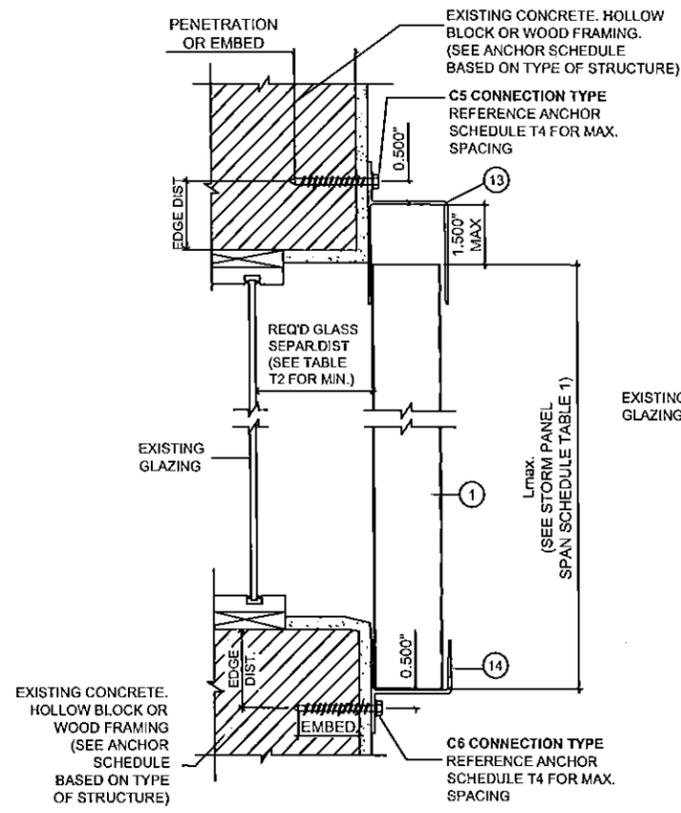


M WALL MOUNT SECTION
WALL MOUNT TRACKS, N.T.S.


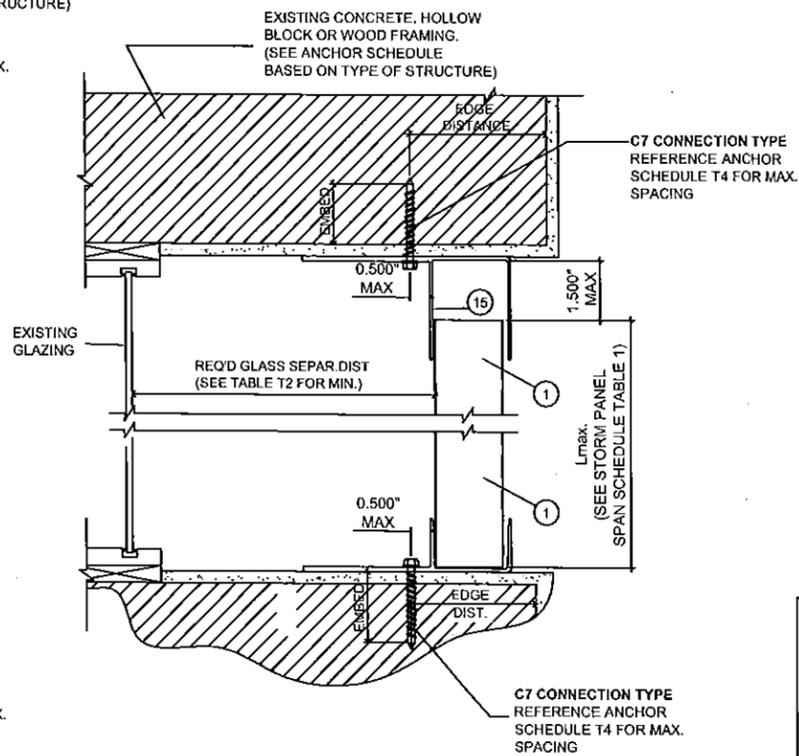


N CEILING/FLOOR MOUNT SECTION
NTS


Q HEADER TRACK ISOMETRIC
TOP TRACK N.T.S.

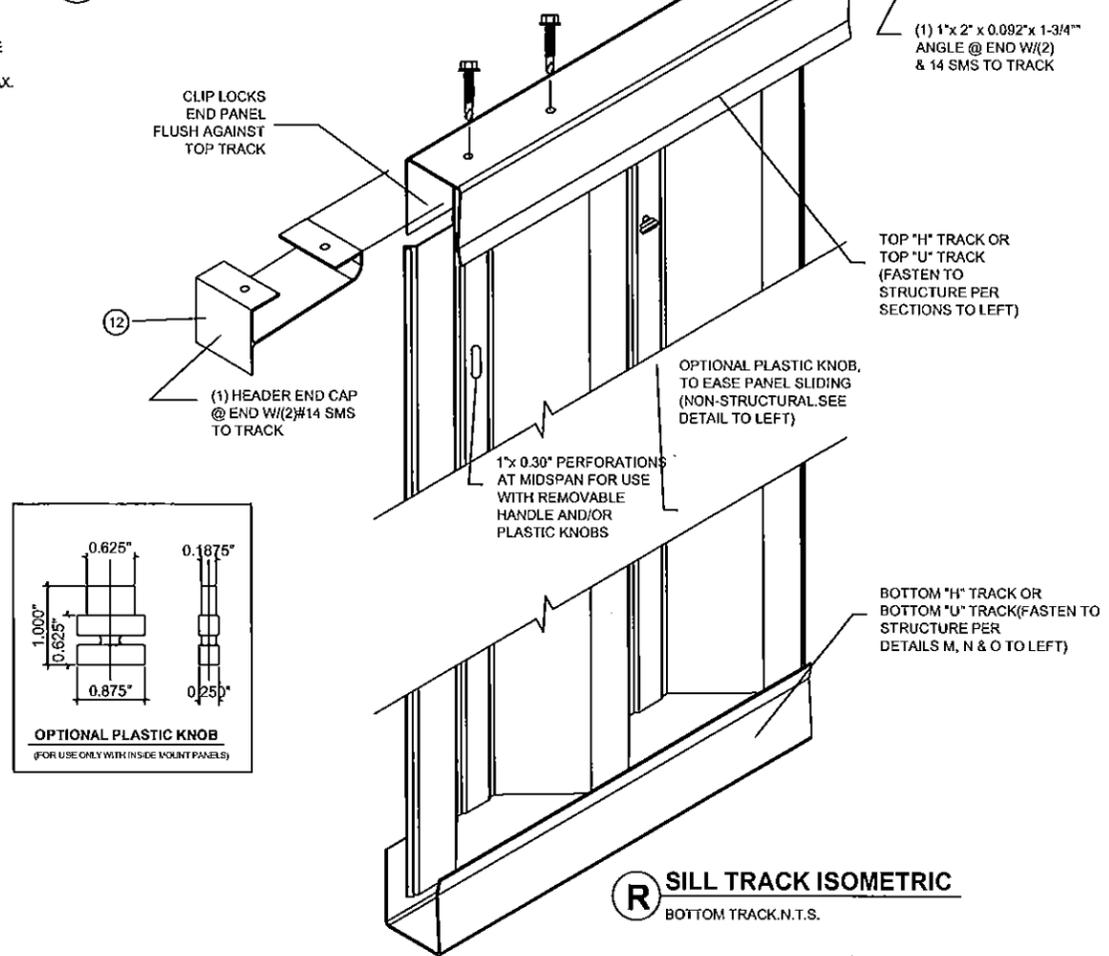

R SILL TRACK ISOMETRIC
BOTTOM TRACK N.T.S.

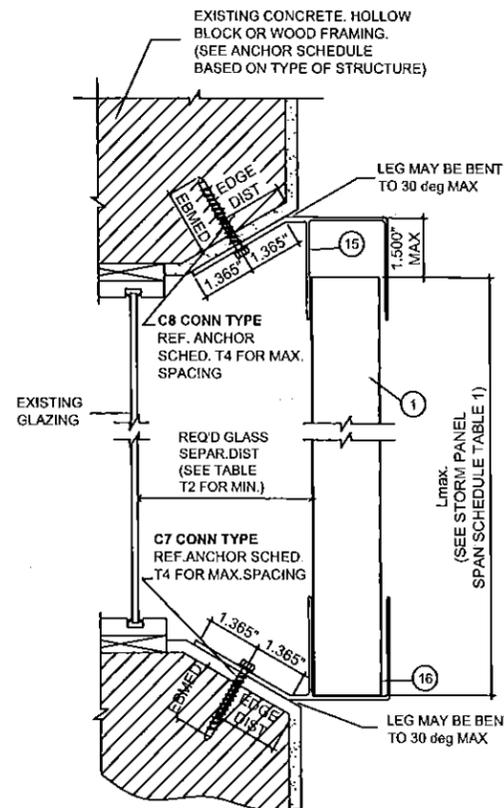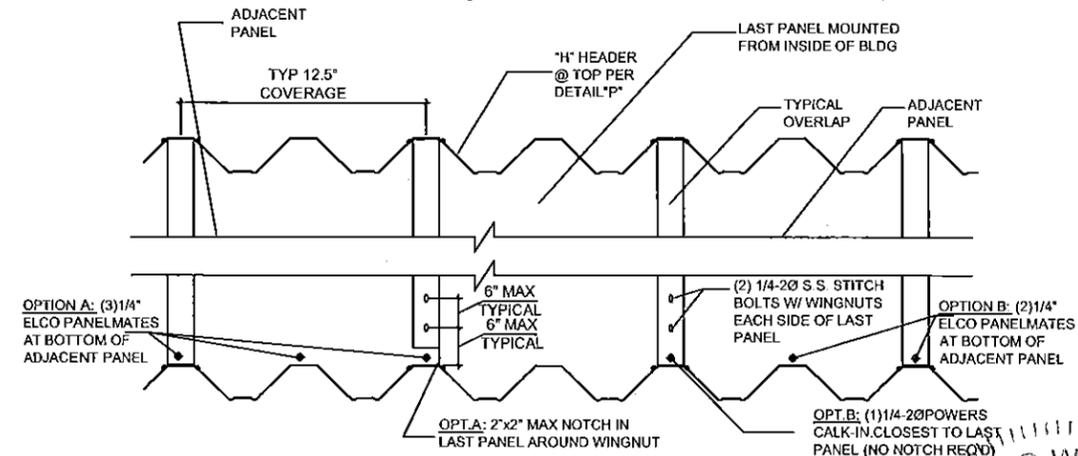


O HEADER/SILL MOUNT SECTION
TRAP MOUNT TRACKS ON ANGLE, N.T.S.

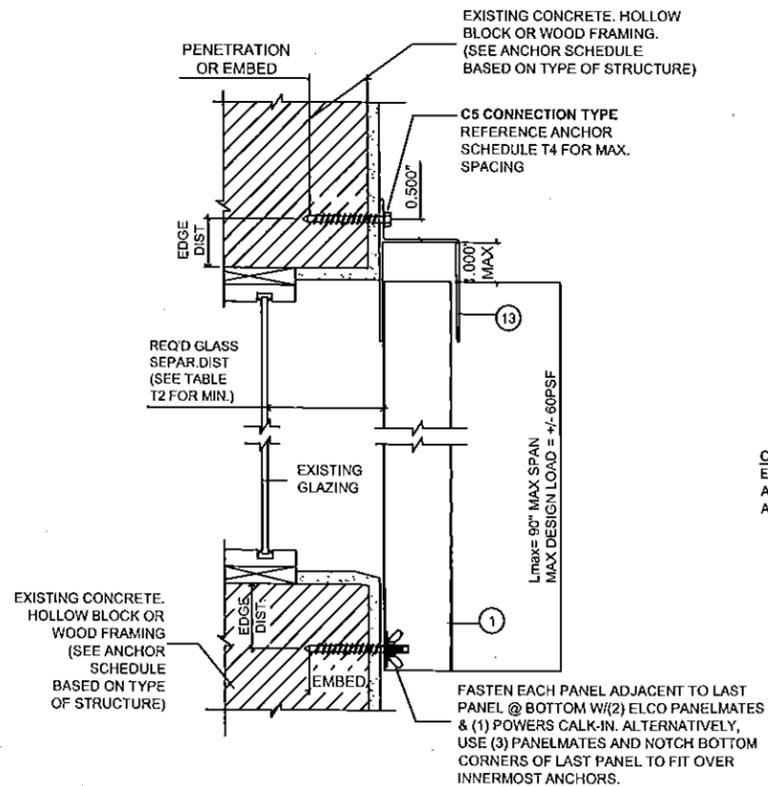


P DIRECT WALL MOUNT SECTION
BOTTOM DIRECT WALL MOUNT (REF. DETAIL 'S'), N.T.S.

S DIRECT WALL MOUNT EXTERIOR ELEVATION
BOTTOM DIRECT WALL MOUNT (REF. DETAIL 'P'), N.T.S.

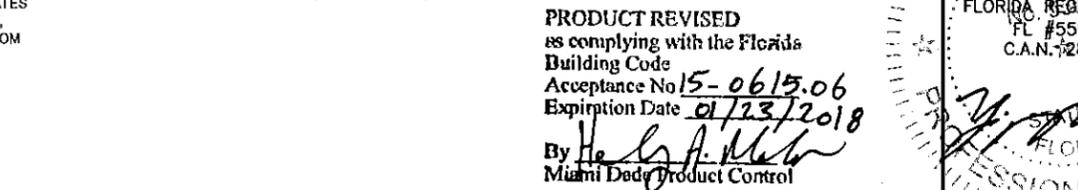

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No 15-0615.06
Expiration Date 01/23/2018
By Healy A. Miller
Miami Dade Product Control

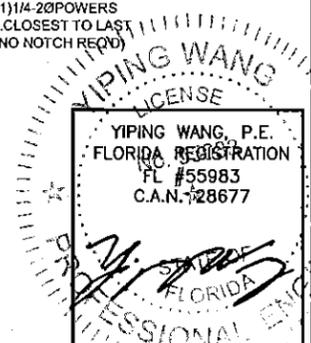

NO.	DATE	DESCRIPTION
1	05-27-15	UPDATED TO 2014 PFC

MCY ENGINEERING, INC.
GLAZING CONSULTANTS
8501 SW 124 Ave. STE. 205A
MIAMI, FL 33183
P: 305.271.0117
F: 766.573.5063
www.MCYEngineering.com
MCY.Engineering@Att.net

22 GA. GALVANIZED STEEL STORM PANEL - LMI
FLORIDA STORM PANEL SUPPLY, LLC.
14475 N.W. 26TH AVE.
OPA LOCKA, FL 33054
P: (305) 685 - 9000 F: (305) 685 - 7511

DATE	06-02-15
SCALE	AS NOTED
DRAWN	S.L.
PROJECT	MCY 12-079
DRAWING NO.	AD12-32

T3 ANCHOR SPACING SCHEDULE

EXIST. STRUCT.	ANCHOR	LOAD (psf)	2.5" EDGE DISTANCE											
			PANS UP TO 5.50ft CONN TYPE				SPANS UP TO 8.67ft CONN TYPE				SPANS UP TO 10.67ft CONN TYPE			
			C1	C2	C3	C4	C1	C2	C3	C4	C1	C2	C3	C4
CONCRETE	1/4" x1-3/4" EMBED ELCO TAPCON (MIN 3320 PSI CONC) Tcap(lb) = 483.00 Vcap(lb) = 475.00	39	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	11.9"	13.5"
	49	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	11.6"	13.3"	12.5"	16.0"	8.4"	10.7"	
	58	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	8.9"	11.1"	12.5"	16.0"	8.0"	10.3"	
	72	12.5"	16.0"	13.0"	14.3"	12.5"	16.0"	8.0"	10.3"	12.5"	16.0"	8.0"	10.3"	
	130	12.5"	16.0"	8.0"	10.3"	12.5"	16.0"	8.0"	10.3"	12.5"	16.0"	8.0"	10.3"	
	1/4" x1-7/8" EMBED ALL-POINTS SOLID-SET LEAD SHIELD ANCHOR Tcap(lb) = 428 Vcap(lb) = 429	39	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	15.2"	15.0"	12.5"	16.0"	10.6"	12.1"
	49	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	10.2"	11.8"	12.5"	16.0"	7.5"	9.5"	
	58	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	7.9"	9.9"	12.5"	16.0"	7.1"	9.2"	
	72	12.5"	16.0"	11.5"	12.7"	12.5"	16.0"	7.1"	9.2"	12.5"	16.0"	7.1"	9.2"	
130	12.5"	16.0"	7.1"	9.2"	12.5"	16.0"	7.1"	9.2"	12.5"	16.0"	7.1"	9.2"		
1/4" x1-2" EMBED ELCO PANELMATE (MIN 3350 PSI CONC) Tcap(lb) = 372.00 Vcap(lb) = 565.00	39	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	13.3"	15.7"	12.5"	16.0"	9.2"	12.6"	
49	12.5"	16.0"	16.0"	16.0"	12.5"	16.0"	8.9"	12.4"	12.5"	16.0"	6.5"	9.9"		
58	12.5"	16.0"	14.9"	16.0"	12.5"	16.0"	6.9"	10.4"	12.5"	16.0"	6.2"	9.6"		
72	12.5"	16.0"	10.0"	13.3"	12.5"	16.0"	6.2"	9.6"	12.5"	16.0"	6.2"	9.6"		
130	12.5"	16.0"	6.2"	9.6"	12.5"	16.0"	6.2"	9.6"	12.5"	16.0"	6.2"	9.6"		

HOLLOW CONC BLOCK	1/4" x1-1/4" EMBED ELCO TAPCON Tcap(lb) = 218.00 Vcap(lb) = 398.00	39	10.0"	12.8"	12.8"	12.6"	10.0"	12.4"	6.2"	7.9"	10.0"	10.0"	4.3"	6.3"
	49	10.0"	12.8"	10.1"	10.0"	5.0"	9.8"	4.2"	6.1"	5.0"	8.0"	3.0"	4.9"	
	58	10.0"	12.8"	6.9"	8.4"	5.0"	8.3"	3.2"	5.2"	5.0"	7.7"	4.8"	4.8"	
	72	10.0"	10.5"	4.7"	6.6"	5.0"	7.7"	4.8"	4.8"	5.0"	7.7"	4.8"	4.8"	
	130	5.0"	7.7"	4.8"	4.8"	5.0"	7.7"	4.8"	4.8"	5.0"	7.7"	4.8"	4.8"	
	1/4" x1-7/8" EMBED ALL-POINTS SOLID-SET LEAD SHIELD ANCHOR Tcap(lb) = 358 Vcap(lb) = 249	39	10.0"	12.8"	12.8"	12.8"	10.0"	12.8"	10.1"	8.2"	10.0"	12.8"	7.0"	6.6"
	49	10.0"	12.8"	12.8"	10.4"	10.0"	12.8"	6.8"	6.5"	10.0"	12.8"	4.9"	5.2"	
	58	10.0"	12.8"	11.4"	8.8"	10.0"	12.8"	5.2"	5.5"	10.0"	12.7"	4.7"	5.1"	
	72	10.0"	12.8"	7.6"	7.0"	10.0"	12.8"	4.7"	5.1"	10.0"	12.7"	4.7"	5.1"	
130	10.0"	12.7"	4.7"	5.1"	10.0"	12.7"	4.7"	5.1"	10.0"	12.7"	4.7"	5.1"		
1/4" x1-1/4" EMBED ELCO PANELMATE Tcap(lb) = 204.75 Vcap(lb) = 233.50	39	10.0"	12.8"	12.8"	9.7"	10.0"	11.6"	5.8"	6.1"	5.0"	9.4"	4.0"	4.9"	
49	10.0"	12.8"	9.5"	7.7"	5.0"	9.2"	3.9"	4.8"	5.0"	7.5"	3.9"	3.7"		
58	10.0"	12.3"	6.5"	6.4"	5.0"	7.8"	3.0"	4.0"	5.0"	7.2"	3.7"	3.7"		
72	5.0"	9.9"	4.4"	5.2"	5.0"	7.2"	3.7"	3.7"	5.0"	7.2"	3.7"	3.7"		
130	5.0"	7.2"	3.7"	3.7"	5.0"	7.2"	3.7"	3.7"	5.0"	7.2"	3.7"	3.7"		

EXIST. STRUCT.	ANCHOR	LOAD (psf)	0.75" EDGE DISTANCE											
			PANS UP TO 5.50ft CONN TYPE				SPANS UP TO 8.67ft CONN TYPE				SPANS UP TO 10.67ft CONN TYPE			
			C1	C2	C3	C4	C1	C2	C3	C4	C1	C2	C3	C4
WOOD	1/4" x 2" THREAD PENETR.LAG SCREW Tcap(lb) = 359.53 Vcap(lb) = 82.97	39	12.5"	16.0"	16.0"	7.5"	12.5"	16.0"	12.8"	4.8"	12.5"	16.0"	8.9"	3.9"
	49	12.5"	16.0"	16.0"	6.0"	12.5"	16.0"	8.6"	3.8"	12.5"	16.0"	6.3"	3.1"	
	58	12.5"	16.0"	14.4"	5.1"	12.5"	16.0"	6.6"	3.2"	12.5"	16.0"	6.0"	3.7	
	72	12.5"	16.0"	9.6"	4.1"	12.5"	16.0"	6.0"	6.0"	12.5"	16.0"	6.0"	6.0	
	130	12.5"	16.0"	6.0"	6.0"	12.5"	16.0"	6.0"	6.0"	12.5"	16.0"	6.0"	6.0	
	#14 x 1-1/2" THREAD PENETR.WOOD SCREW Tcap(lb) = 234.00 Vcap(lb) = 96.74	39	12.5"	16.0"	16.0"	7.7"	12.5"	16.0"	8.3"	4.8"	12.5"	13.5"	5.8"	3.9"
	49	12.5"	16.0"	13.6"	6.1"	12.5"	13.2"	5.6"	3.8"	6.25"	10.7"	4.1"	3.1"	
	58	12.5"	16.0"	9.3"	5.1"	6.25"	11.2"	4.3"	3.2"	6.25"	10.4"	3.9"	3.7	
	72	12.5"	14.2"	6.3"	4.1"	6.25"	10.4"	3.9"	3.9"	6.25"	10.4"	3.9"	3.7	
130	6.25"	10.4"	3.9"	3.9"	6.25"	10.4"	3.9"	3.9"	6.25"	10.4"	3.9"	3.9		
7/16" x 5/8" EMBED BRASS BUSHING & 1/4-20 SCREW Tcap(lb) = 231.50 Vcap(lb) = 232.50	39	12.5"	16.0"	16.0"	13.0"	12.5"	16.0"	8.3"	8.1"	12.5"	13.4"	5.7"	6.6"	
49	12.5"	16.0"	13.5"	10.3"	12.5"	13.1"	5.5"	6.4"	6.25"	10.6"	4.0"	5.2"		
58	12.5"	16.0"	9.2"	8.7"	6.25"	11.1"	4.3"	5.4"	6.25"	10.3"	3.8"	5.0"		
72	12.5"	14.0"	6.2"	6.9"	6.25"	10.3"	3.8"	5.0"	6.25"	10.3"	3.8"	5.0"		
130	6.25"	10.3"	3.8"	5.0"	6.25"	10.3"	3.8"	5.0"	6.25"	10.3"	3.8"	5.0"		

ANCHOR NOTES:

1. SPANS AND LOADS SHOWN HERE ARE FOR DETERMINING ANCHOR SPACING ONLY. ALLOWABLE STORM PANEL SPANS FOR SPECIFIC LOADS MUST BE LIMITED TO THOSE SHOWN IN MAX ALLOWABLE SPAN SCHEDULE (TABLE 'T1').
2. ENTER ANCHOR SCHEDULE BASED ON THE EXISTING STRUCTURE MATERIAL & ANCHOR TYPE. SELECT DESIGN LOAD GREATER THAN OR EQUAL TO NEGATIVE DESIGN LOAD ON SHUTTER AND SELECT SPAN GREATER THAN OR EQUAL TO SHUTTER SPAN.
3. SELECT CONNECTION TYPE BASED ON APPROPRIATE MOUNTING CONDITION (SEE MOUNTING DETAILS ON SHEETS 2 & 3 FOR IDENTIFICATION OF CONNECTION TYPE).
4. ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
5. WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT PLYWOOD. FASTENING TO PLYWOOD IS ACCEPTABLE ONLY FOR SIDE CLOSURE PIECES.

T4 ANCHOR SPACING SCHEDULE
(INSIDE MOUNT PANELS, WALL MOUNT)

EXIST. STRUCT.	ANCHOR	LOAD (psf)	2.5" EDGE DISTANCE			
			SPANS UP TO 5.50ft CONN TYPE		SPANS UP TO 8.67ft CONN TYPE	
			C5	C6	C5	C6
CONCRETE	1/4" x1-3/4" EMBED ELCO TAPCON (MIN 3320PSI CONC) Tcap(lb) = 483.00 Vcap(lb) = 475.00	39	16.0"	16.0"	16.0"	16.0"
	45	16.0"	16.0"	11.4"	16.0"	
	55	16.0"	16.0"	7.5"	16.0"	
	65	14.2"	16.0"	6.0"	16.0"	
	72	11.0"	16.0"	6.0"	16.0"	
	1/4" x1-7/8" EMBED ALL-POINTS SOLID-SET LEAD SHIELD ANCHOR Tcap(lb) = 428.00 Vcap(lb) = 429.00	39	16.0"	16.0"	14.8"	16.0"
	45	16.0"	16.0"	10.1"	16.0"	
	55	16.0"	16.0"	6.6"	16.0"	
	65	12.6"	16.0"	5.3"	16.0"	
72	9.8"	16.0"	5.3"	16.0"		
1/4" x1-2" EMBED ELCO PANELMATE (MIN 3350 PSI CONC) Tcap(lb) = 372.00 Vcap(lb) = 565.00	39	16.0"	16.0"	12.9"	16.0"	
45	16.0"	16.0"	8.8"	16.0"		
55	16.0"	16.0"	5.8"	16.0"		
65	11.0"	16.0"	4.6"	16.0"		
72	8.5"	16.0"	4.6"	16.0"		

HOLLOW CONC BLOCK	1/4" x1-1/4" EMBED ELCO TAPCON Tcap(lb) = 218.00 Vcap(lb) = 398.00	39	12.8"	12.8"	6.0"	12.4"
	49	12.8"	12.8"	4.1"	10.7"	
	58	8.8"	12.8"	8.8"	8.8"	
	72	5.1"	11.6"	7.7"	7.7"	
	130	4.0"	10.5"	7.7"	7.7"	
	1/4" x1-7/8" EMBED ALL-POINTS SOLID-SET LEAD SHIELD ANCHOR Tcap(lb) = 358.00 Vcap(lb) = 249.00	39	12.8"	12.8"	9.9"	12.8"
	49	12.8"	12.8"	6.8"	12.8"	
	58	12.8"	12.8"	4.4"	12.8"	
	72	8.4"	12.8"	3.5"	12.7"	
130	6.5"	12.8"	3.5"	12.7"		
1/4" x1-1/4" EMBED ELCO PANELMATE Tcap(lb) = 204.75 Vcap(lb) = 233.50	39	12.8"	12.8"	5.6"	11.6"	
49	12.8"	12.8"	3.8"	10.0"		
58	8.2"	12.8"	8.2"	8.2"		
72	4.8"	10.9"	7.2"	7.2"		
130	3.7"	9.9"	7.2"	7.2"		

EXIST. STRUCT.	ANCHOR	LOAD (psf)	0.75" EDGE DISTANCE			
			PANS UP TO 5.50ft CONN TYPE		SPANS UP TO 8.67ft CONN TYPE	
			C5	C6	C5	C6
WOOD	1/4" x 2" THREAD PENETR.LAG SCREW Tcap(lb) = 359.53 Vcap(lb) = 82.97	39	16.0"	16.0"	12.4"	16.0"
	45	16.0"	16.0"	8.5"	16.0"	
	55	16.0"	16.0"	5.6"	16.0"	
	65	10.6"	16.0"	4.4"	16.0"	
	72	8.2"	16.0"	4.4"	16.0"	
	#14 x 1-1/2" THREAD PENETR.WOOD SCREW Tcap(lb) = 234.00 Vcap(lb) = 96.74	39	16.0"	16.0"	8.1"	16.0"
	45	16.0"	16.0"	5.5"	14.4"	
	55	11.8"	16.0"	3.6"	11.8"	
	65	6.9"	15.7"	10.4"	10.4"	
72	5.3"	14.2"	10.4"	10.4"		
7/16" x 5/8" EMBED BRASS BUSHING & 1/4-20 SCREW Tcap(lb) = 231.50 Vcap(lb) = 232.50	39	16.0"	16.0"	8.0"	16.0"	
45	16.0"	16.0"	5.5"	14.2"		
55	11.7"	16.0"	3.6"	11.7"		
65	6.8"	15.5"	10.3"	10.3"		
72	5.3"	14.0"	10.3"	10.3"		

T5 ANCHOR SPACING SCHEDULE
(INSIDE MOUNT PANELS, TRAP MOUNT)

EXIST. STRUCT.	ANCHOR	LOAD (psf)	2.0" EDGE DISTANCE			
			SPANS UP TO 5.50ft CONN TYPE		SPANS UP TO 8.67ft CONN TYPE	
			C7	C8	C7	C8
CONCRETE	1/4" x1-3/4" EMBED ELCO TAPCON (MIN 3320PSI CONC) Tcap(lb) = 386.40 Vcap(lb) = 380.00	39	16.0"	15.3"	13.6"	9.7"
	45	16.0"	13.2"	11.8"	8.4"	
	55	15.2"	10.8"	9.6"	6.9"	
	65	12.9"	9.2"	8.5"	6.0"	
	72	11.6"	8.3"	8.5"	6.0"	
	1/4" x1-7/8" EMBED ALL-POINTS SOLID-SET LEAD SHIELD ANCHOR Tcap(lb) = 428.00 Vcap(lb) = 429.00	39	16.0"	16.0"	15.2"	10.8"
	45	16.0"	14.7"	13.2"	9.3"	
	55	16.0"	12.0"	10.8"	7.6"	
	65	14.4"	10.2"	9.5"	6.7"	
72	13.0"	9.2"	9.5"	6.7"		
1/4" x1-2" EMBED ELCO PANELMATE (MIN 3350 PSI CONC) Tcap(lb) = 297.60 Vcap(lb) = 282.50	39	16.0"	11.6"	10.3"	7.4"	
45	14.1"	10.1"	8.9"	6.4"		
55	11.5"	8.2"	7.3"	5.2"		
65	9.7"	7.0"	6.4"	4.6"		
72	8.8"	6.3"	6.4"	4.6"		

HOLLOW CONC BLOCK	1/4" x1-1/4" EMBED ELCO TAPCON Tcap(lb) = 174.00 Vcap(lb) = 318.00	39	10.0"	6.5"	6.4"	4.1"
	49	8.7"	5.6"	5.5"	3.6"	
	58	7.1"	4.6"	4.5"	3.0"	
	72	6.0"	3.9"	4.0"	3.0"	
	130	5.4"	3.6"	4.0"	3.0"	
	1/4" x1-7/8" EMBED ALL-POINTS SOLID-SET LEAD SHIELD ANCHOR Tcap(lb) = 358.00 Vcap(lb) = 249.00	39	12.8"	9.8"	8.3"	6.2"
	49	11.3"	8.5"	7.2"	5.4"	
	58	9.3"	6.9"	5.9"	4.4"	
	72	7.9"	5.9"	5.2"	3.9"	
130	7.1"	5.3"	5.2"	3.9"		
1/4" x1-1/4" EMBED ELCO PANELMATE Tcap(l						