



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

**NOTICE OF ACCEPTANCE (NOA)**

**Innovative Window Concepts, LLC**  
1801 Corporate Drive  
Boynton Beach, FL 33426

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "2041/2062" Aluminum Horizontal Sliding Window – L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **W06-63**, titled "Series 2041/2062 Alum. Horizontal Sliding Wdw." sheets 1 through 6 of 6, dated 09/27/06, with revision D dated 11/24/15, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Rating.**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises and renews NOA # 11-1117.05 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jorge M. Plasencia, P.E.**



*Jorge M. Plasencia*  
4/28/16

NOA No. 15-0619.05  
Expiration Date: February 22, 2022  
Approval Date: February 4, 2016  
Page 1

**Innovative Window Concepts, LLC**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections.  
*(Submitted under previous NOA No. 06-1020.05)*
2. Drawing No **W06-63**, Sheets 1 through 6 of 6, titled "Series 2041/2062 Alum. Horizontal Sliding Wdw.", dated 09/27/06 with revision D dated 11/24/15, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by American Testing Lab of South Florida, Test Report No. **ATL-0720.01-06**, dated 08/22/06, signed and sealed by Henry Hattem, P.E.  
*(Submitted under previous NOA No. 06-1020.05)*
2. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94along with marked-up drawings and installation diagram of a horizontal sliding window, glazed with 5/16" HS and 7/16" HS laminated glass, prepared by American Test Lab of South Florida, Test Report No. **ATLSF-1023.01-06**, dated 11/17/06, signed and sealed by Henry Hattem, P.E. and William R. Mehner, P.E.  
*(Submitted under previous NOA#07-0103.09) (FOR REFERENCE ONLY)*

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with **FBC-2014, 5<sup>th</sup> edition**, prepared by Al-Farooq Corporation, dated 06/05/15 and 01/13/16, signed and sealed by Javad Ahmad, P.E.
2. Glazing complies with **ASTM E1300-09**.

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)



Jorge M. Plasencia, P.E.  
Product Control Unit Supervisor  
NOA No. 15-0619.05  
Expiration Date: February 22, 2022  
Approval Date: February 4, 2016

**Innovative Window Concepts, LLC**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED (continued)**

**E. MATERIAL CERTIFICATIONS**


1. Notice of Acceptance No. **14-0916.11** issued to Kuraray America., Inc. for their “**Sentry Glass ® (Clear and White) Glass Interlayers**” dated 07/09/15, expiring on 07/04/18.
2. Notice of Acceptance No. **14-0916.10** issued to **Kuraray America., Inc.** for their “**Kuraray Butacite® PVB Interlayer**” dated 06/16/15, expiring on 12/11/16.


**F. STATEMENTS**

1. Statement letter of no financial interest, conformance and compliance with the **FBC-2014, 5<sup>th</sup> edition**, dated 06/10/15, signed and sealed by Javad Ahmad, P. E.
2. Proposal No. **11-1159** issued by Product Control Section, BNC, dated September 30, 2011, signed by Manuel Perez, P. E.  
*(Submitted under previous NOA#11-117.05)*


**G. OTHERS**

1. Notice of Acceptance No. **11-1117.05**, issued to Innovative Window Concepts, LLC, for their “**Series 2041/2062 Aluminum Horizontal Sliding Window-L.M.I.**”, approved on 02/09/12 and expiring on 02/22/17.

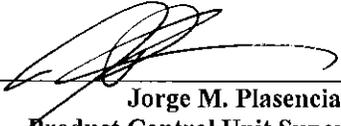  
\_\_\_\_\_  
Jorge M. Plasencia, P.E.  
Product Control Unit Supervisor  
NOA No. 15-0619.05  
Expiration Date: February 22, 2022  
Approval Date: February 4, 2016

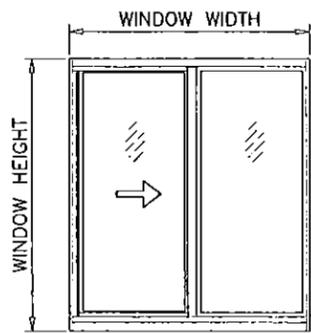

EQUAL LITE WINDOWS (XO OR OX SIZES)	
WINDOW DIMS.	
WINDOW WIDTH	WINDOW HEIGHT
72"	24"
72"	36"
72"	48"
59-3/8"	60"
74"	26"
74"	38-3/8"
70-3/8"	50-5/8"
56-1/2"	63"

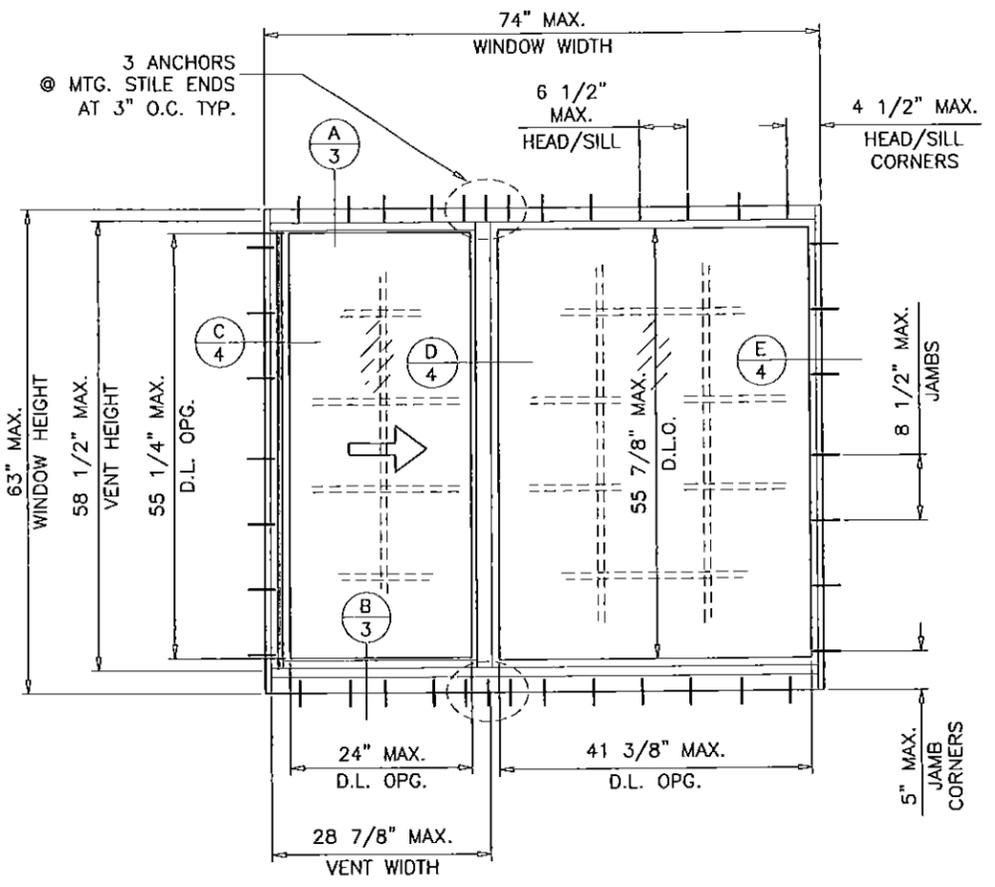

TYPICAL ELEVATION

MAXIMUM DESIGN LOAD RATING = + 75.0 PSF  
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 85.0 PSF  
 SERIES 2041

MAXIMUM DESIGN LOAD RATING = + 75.0 PSF  
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 100.0 PSF  
 SERIES 2062

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

**SERIES 2041/2062  
 ALUMINUM HORIZONTAL SLIDING WINDOW**

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF H.S./H.S. OR HORIZONTAL SLIDING WITH OTHER MIAMI-DADE COUNTY APPR'D WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2014 FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE.


ANCHORS SHALL BE AS LISTED, SPACED AS SHOWN ON DETAILS, ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ANCHORING OR LOADING CONDITIONS NOT SHOWN IN THESE DETAILS ARE NOT PART OF THIS APPROVAL.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2014 FLORIDA BUILDING CODE.

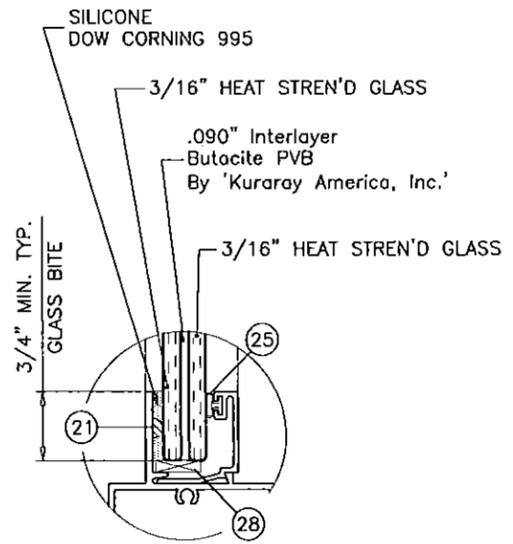

SERIES 2041

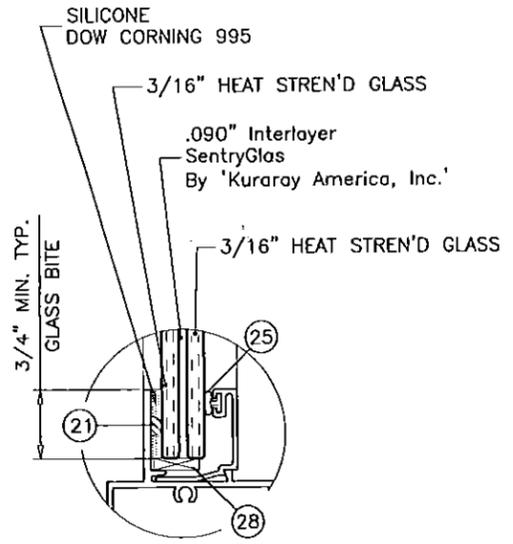

SERIES 2062

GLAZING OPTIONS

NOTE:  
 GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
 JAN 14 2016



PRODUCT REVISED as complying with the Florida Building Code  
 Acceptance No 15-0619.05  
 Expiration Date 2/22/2022  
 By: [Signature]  
 Miami Dade Product Control

**af c**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W06-63\WC

SERIES 2041/2062 ALUM HORIZONTAL SLIDING WDW.  
**INNOVATIVE WINDOW CONCEPTS, LLC**  
 2005 CORPORATE DRIVE  
 BOYNTON BEACH, FL. 33426  
 TEL. (561) 493-2303 FAX. (561) 493-2302

no	date	by	description
A	06.11.09		UPDATED FOR 2007 FBC
B	10.05.11		UPDATED FOR 2010 FBC
C	06.11.15		UPDATED TO 2014 FBC
D	11.24.15		REV. PER PER COMMENTS

date: 09-27-06  
 scale: 1/2" = 1'-0"  
 dr. by: HAMID  
 chk. by:  
 drawing no. W06-63  
 sheet 1 of 6

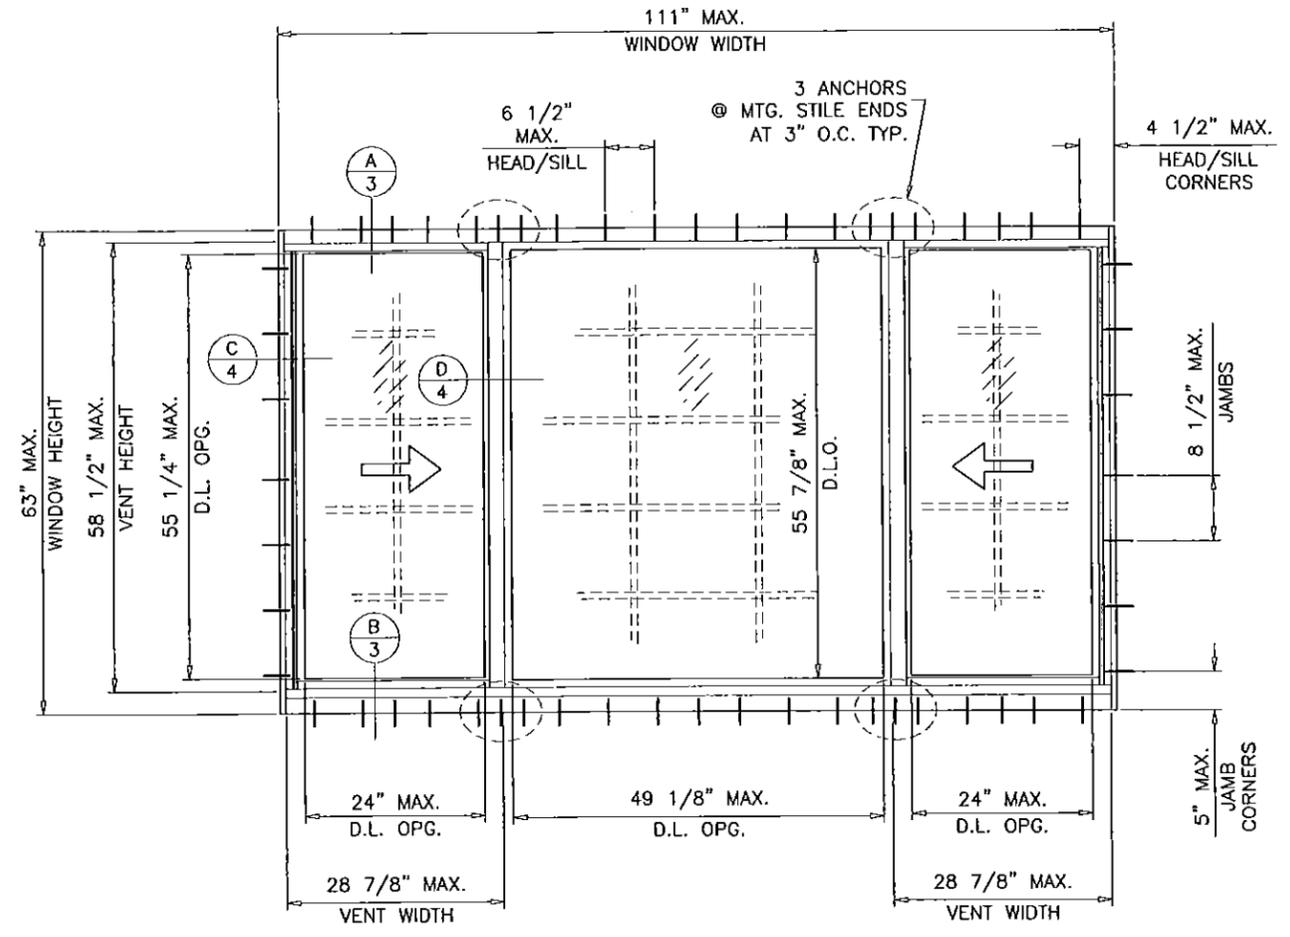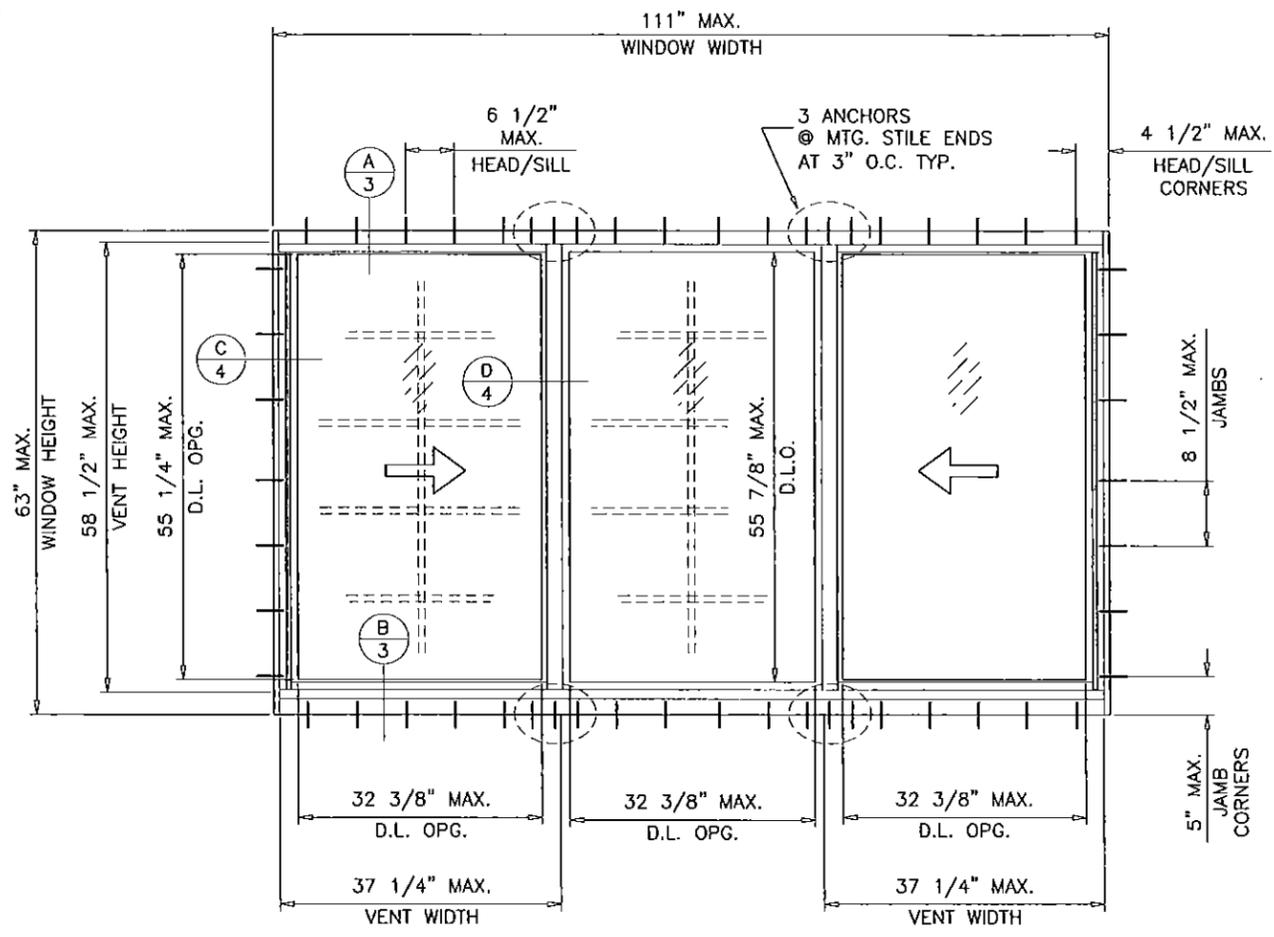

TYPICAL ELEVATIONS

MAXIMUM DESIGN LOAD RATING = + 75.0 PSF  
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 85.0 PSF  
 SERIES 2041

MAXIMUM DESIGN LOAD RATING = + 75.0 PSF  
 (FOR SIZES SHOWN ABOVE OR SMALLER) - 100.0 PSF  
 SERIES 2062

NOTE:  
 GLASS CAPACITIES ON THIS SHEET ARE  
 BASED ON ASTM E1300-09 (3 SEC. GUSTS)  
 AND FLORIDA BUILDING COMMISSION  
 DECLARATORY STATEMENT DCA05-DEC-219

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 0538  
 JAN 14 2016

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 15-0619.05  
 Expiration Date 2/22/2022  
 By: *[Signature]*  
 Miami Date Product Control

**afc**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W06-63IWC

SERIES 2041/2062 ALUM HORIZONTAL SLIDING WDW.  
**INNOVATIVE WINDOW CONCEPTS, LLC**  
 2005 CORPORATE DRIVE  
 BOYNTON BEACH, FL. 33426  
 TEL. (561) 493-2303 FAX. (561) 493-2302





no	date	by	description
A	06.11.09		UPDATED FOR 2007 FBC
B	10.05.11		EQUAL LITE ELEV. ADDED
C	06.11.15		UPDATED TO 2014 FBC
D	11.24.15		REV. PER RER COMMENTS


date:	09-27-06
scale:	1/2" = 1'-0"
dr. by:	HAMID
chk. by:	

drawing no.	W06-63
sheet	2 of 6



WOOD BUCKS AND METAL STRUCTURE NOT BY I.W.C. MUST SUSTAIN LOADS IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.

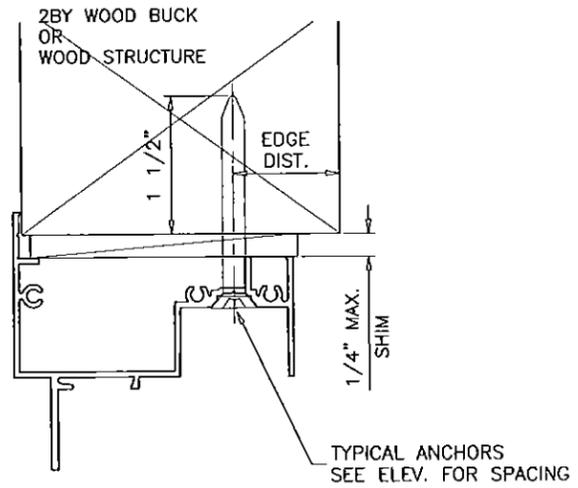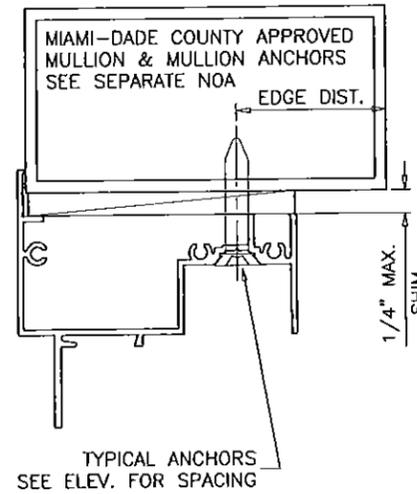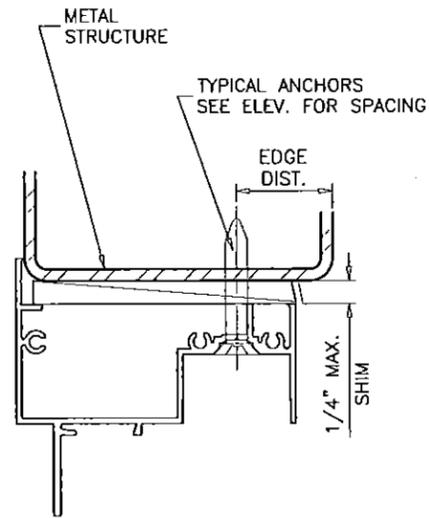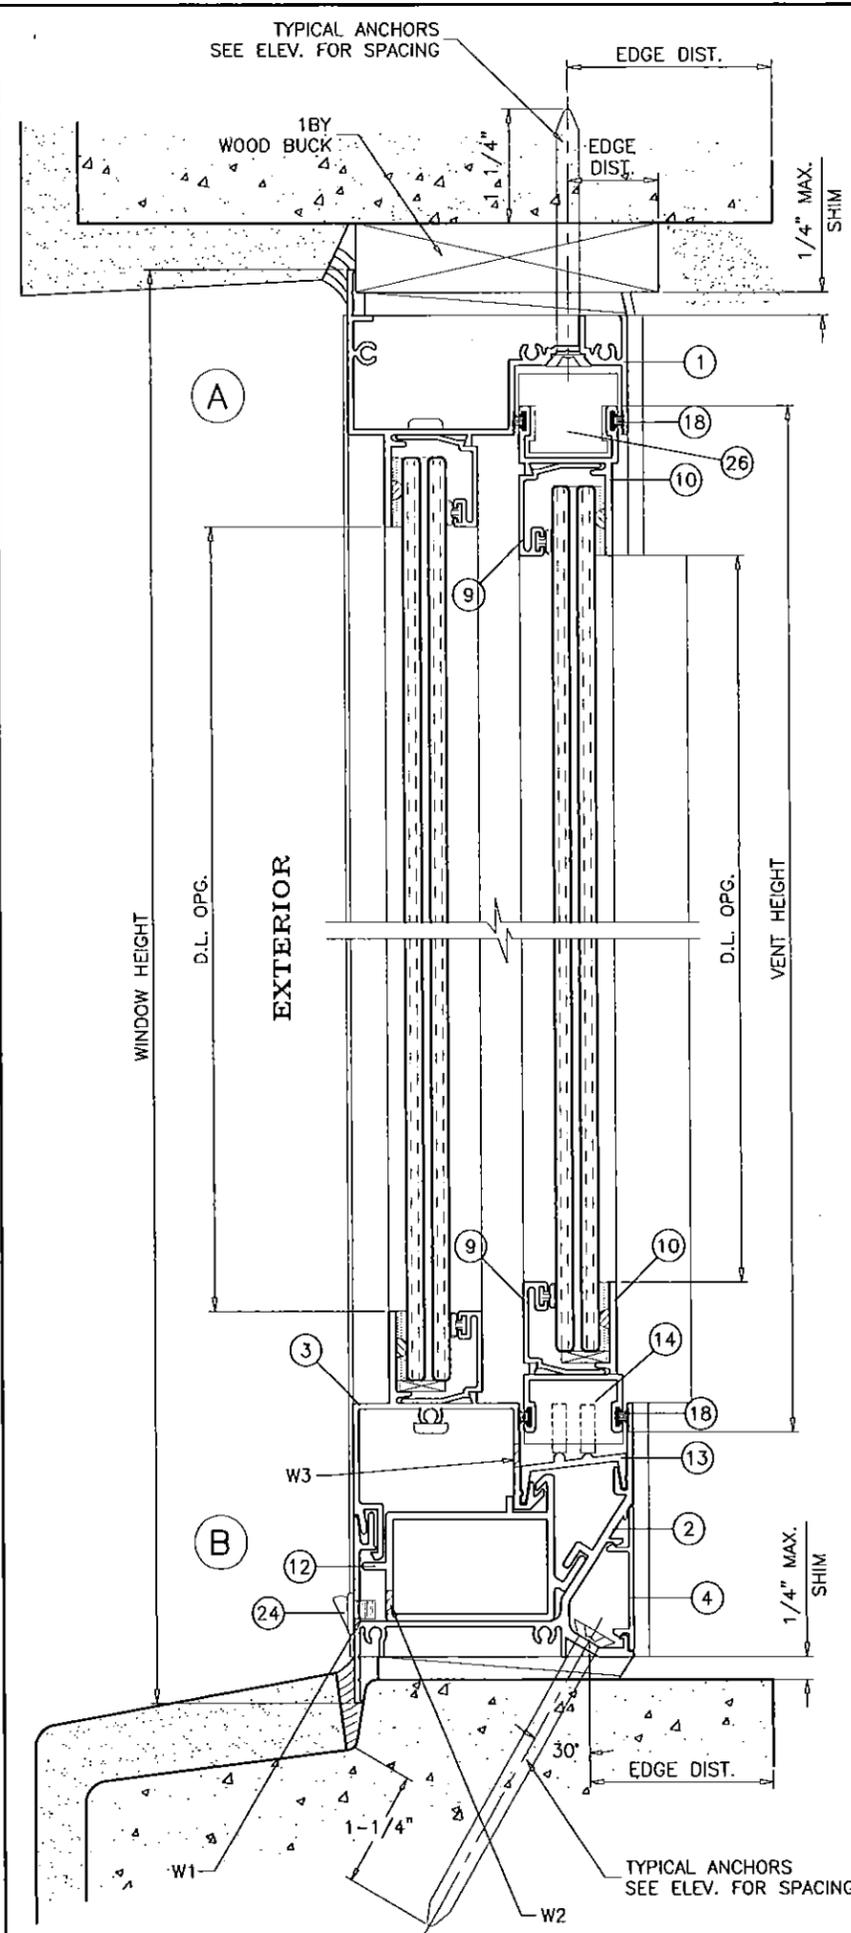

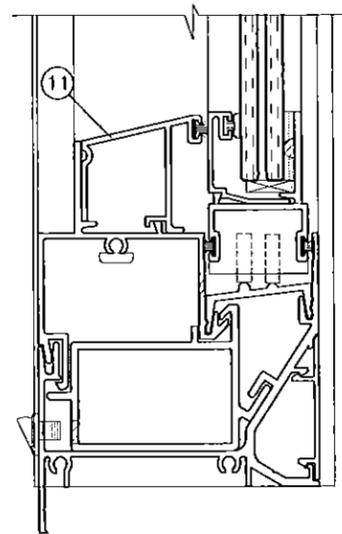**TYPICAL ANCHORS:** SEE ELEV. FOR SPACING

**1/4" DIA. ULTRACON BY 'ELCO'** ( $F_u=177$  KSI,  $F_y=155$  KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES  
1-1/2" MIN. PENETRATION INTO WOOD (HEAD/SILL/JAMBS)

THRU 1BY BUCKS INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY (JAMBS)

DIRECTLY INTO CONC. OR MASONRY  
1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)  
1-1/4" MIN. EMBED INTO CONC. OR MASONRY (JAMBS)

**#14 SMS OR SELF DRILLING SCREWS** (GRADE 2 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS (MIN. THK. = 1/8")

INTO METAL STRUCTURES  
STEEL : 1/8" THK. MIN. ( $F_y = 36$  KSI MIN.)  
ALUMINUM : 1/8" THK. MIN. (6063-T5 MIN.)  
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

**TYPICAL EDGE DISTANCE**

INTO CONCRETE AND MASONRY = 2" MIN.  
INTO WOOD STRUCTURE = 1" MIN.  
INTO METAL STRUCTURE = 1/2" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.  
CONCRETE AT HEAD, SILL OR JAMBS  $f'_c$  = 3000 PSI MIN.  
C-90 HOLLOW/FILLED NORMAL WEIGHT CMU AT JAMBS  $f'_m$  = 2000 PSI MIN.

**WEEPHOLES:**

W1 = 1-5/8" X 1/4" WEEPHOLES AT 7-1/8" FROM EACH END AND 24" O.C. WITH WEEP COVER

W2 = 1" X 1/4" WEEP SLOTS UNDER FIXED LITE AT 24" O.C.

W3 = 1" X 1/4" WEEP SLOTS ON VENT AREA AT 5" FROM ENDS AND 7-3/4" O.C.

Engr: JAVAD AHMAD  
CIVIL  
FLA. PE # 70592  
C.A.N. 13538

JAN 14 2016

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
Acceptance No. 15-0619.05  
Expiration Date 2/22/2022

By   
Miami Dade Product Control

**af c**  
**AL-FAROOQ CORPORATION**  
ENGINEERS & PRODUCT DEVELOPMENT  
9360 SUNSET DRIVE, SUITE 220  
MIAMI, FLORIDA 33173  
TEL (305) 264-8100 FAX (305) 262-6978  
COMP-ANL\W06-63IWC




SERIES 2041/2062 ALUM HORIZONTAL SLIDING WDW.  
**INNOVATIVE WINDOW CONCEPTS, LLC**  
2005 CORPORATE DRIVE  
BOYNTON BEACH, FL. 33426  
TEL (561) 493-2303 FAX (561) 493-2302

revisions:	no	date	by	description
	A	06.11.09		UPDATED FOR 2007 FBC
	B	10.05.11		NO CHANGE THIS SHEET
	C	06.11.15		UPDATED TO 2014 FBC
	D	11.24.15		NO CHANGE THIS SHEET

date: 09-27-06  
scale: 1/2" = 1"  
dr. by: HAMID  
chk. by:

drawing no.  
**W06-63**

sheet 3 of 6

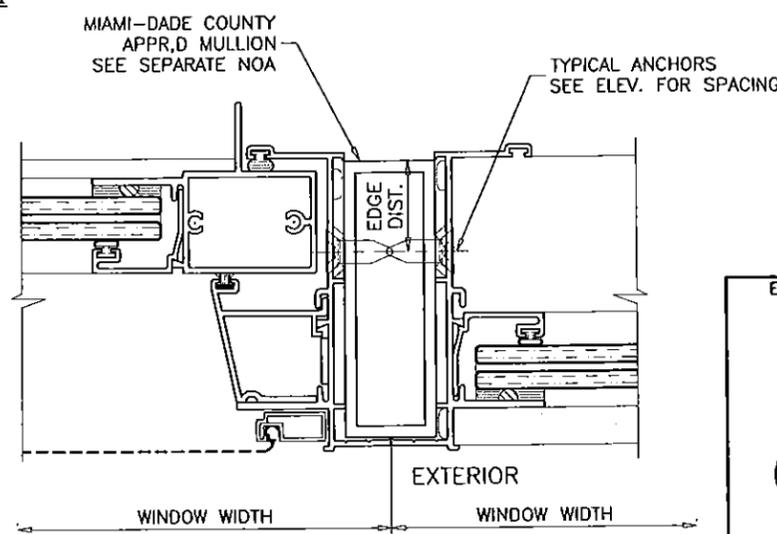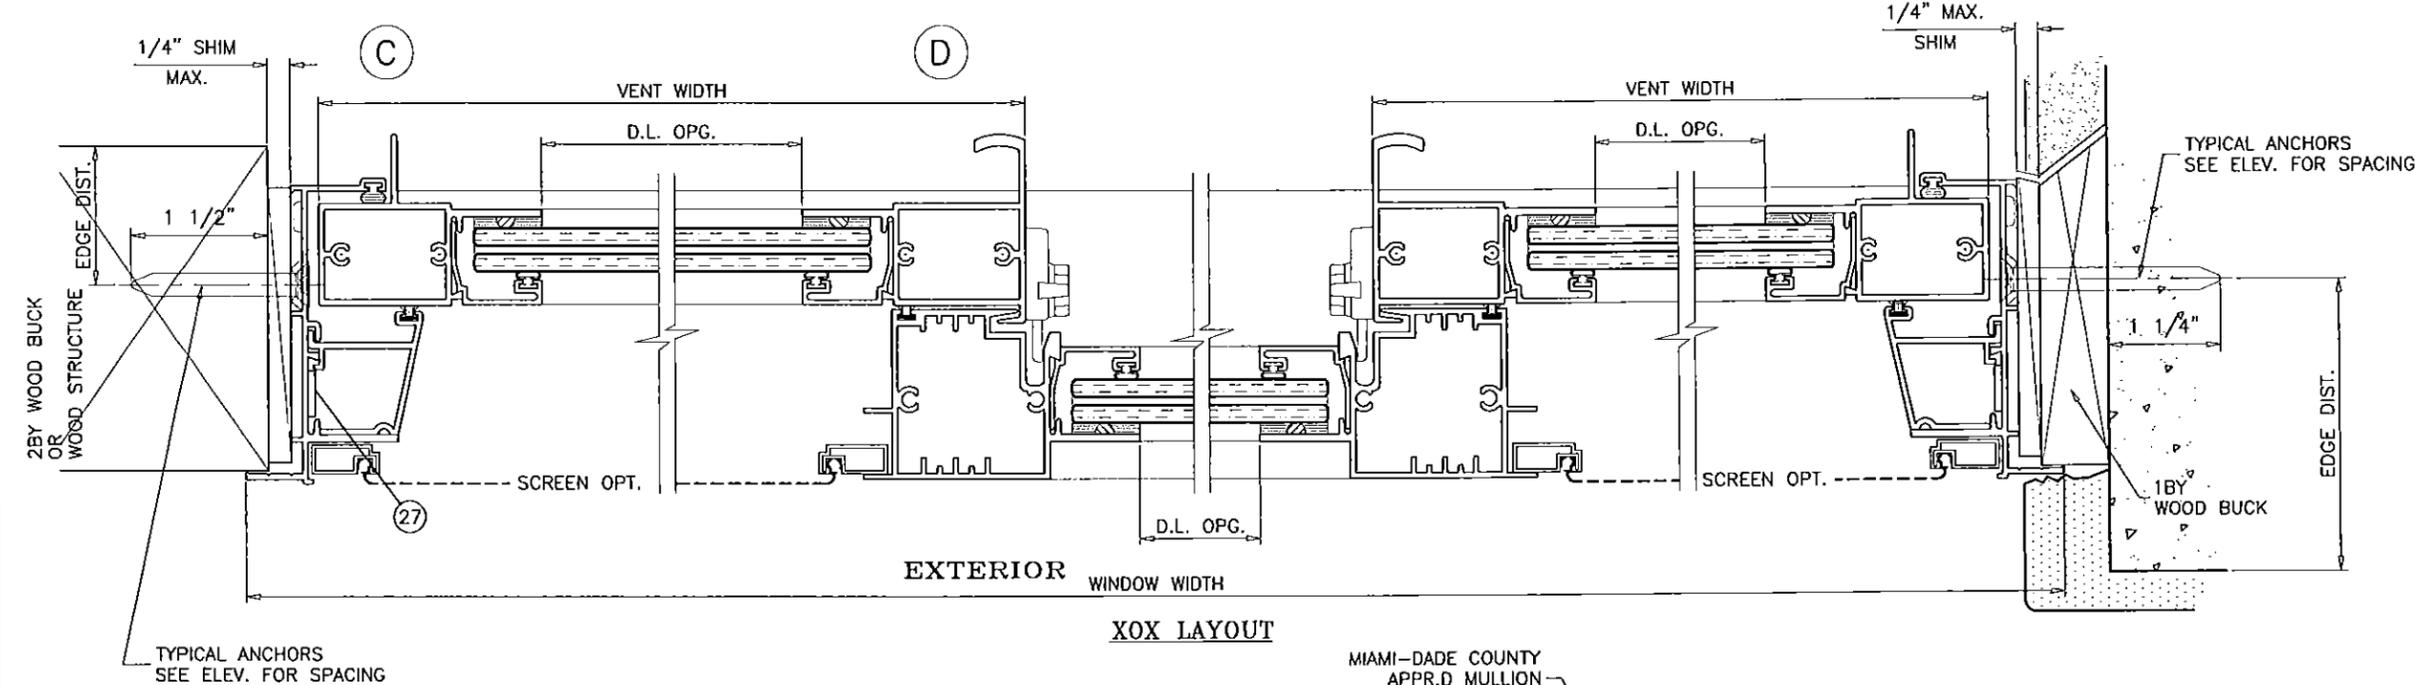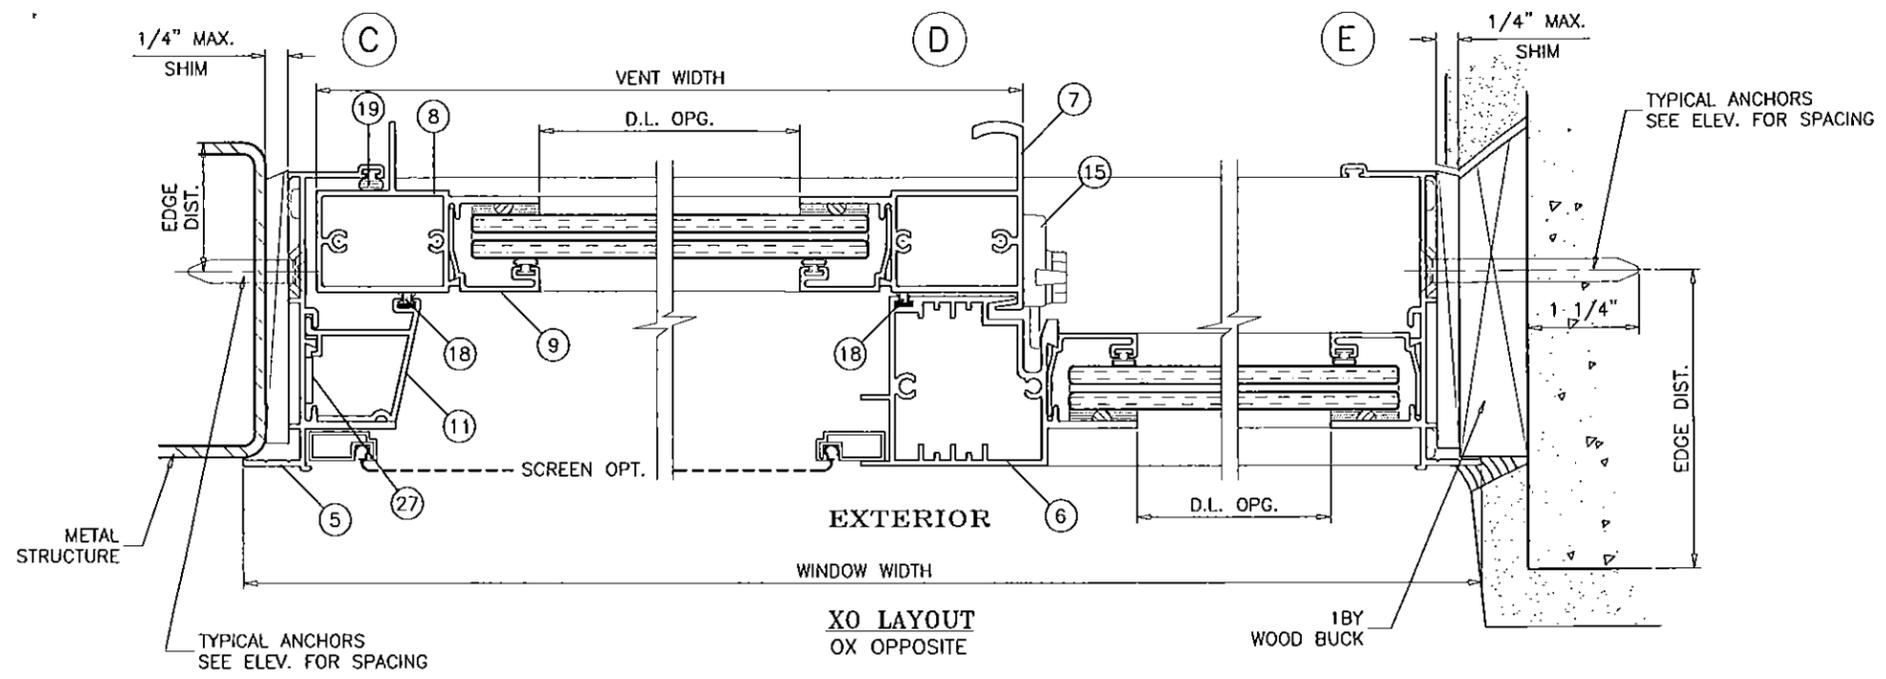

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538

**JAN 14 2016**

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 Acceptance No. 15-0619.05  
 Expiration Date 2/22/2021

By: *[Signature]*  
 Miami Dade Product Control

**af c**

**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W06-63IWC

---

SERIES 2041/2062 ALUM HORIZONTAL SLIDING WDW.

**INNOVATIVE WINDOW CONCEPTS, LLC**  
 2005 CORPORATE DRIVE  
 BOYNTON BEACH, FL. 33426  
 TEL. (561) 493-2303 FAX. (561) 493-2302

---

no	date	by	description
A	06.11.09		UPDATED FOR 2007 FBC
B	10.05.11		NO CHANGE THIS SHEET
C	06.11.15		UPDATED TO 2014 FBC
D	11.24.15		NO CHANGE THIS SHEET


---

date: 09-27-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:


---

drawing no.  
**W06-63**


sheet 4 of 6

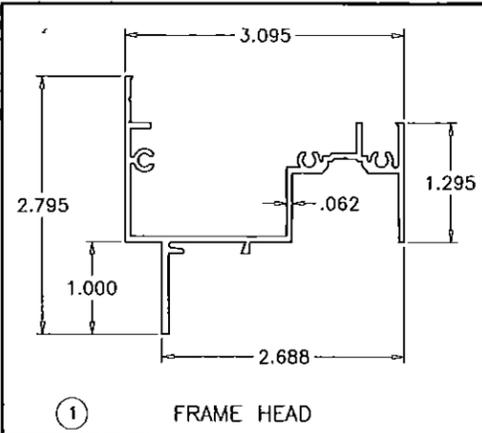


① FRAME HEAD

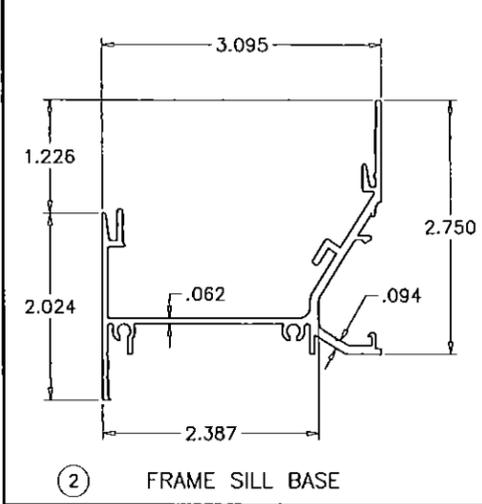


② FRAME SILL BASE

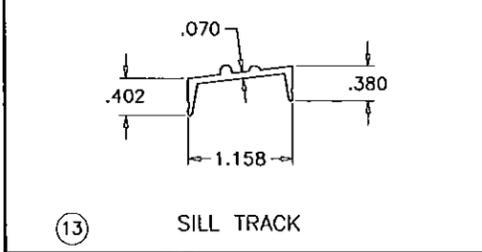


⑬ SILL TRACK

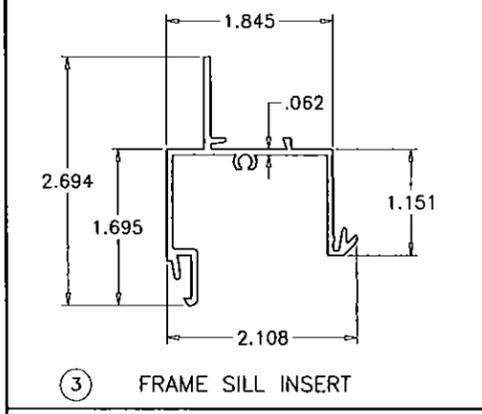


③ FRAME SILL INSERT

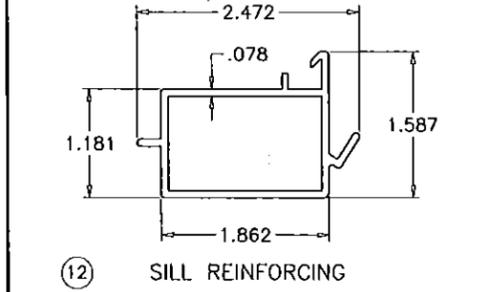


⑫ SILL REINFORCING

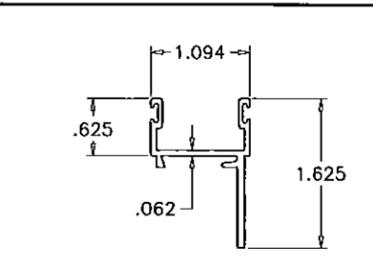


⑩ VENT TOP/BOTTOM RAIL

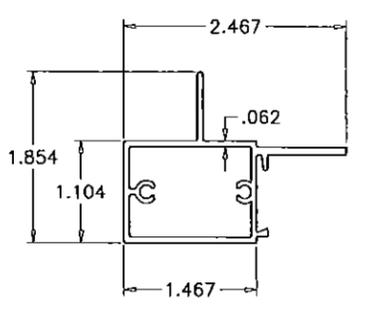


⑧ VENT SIDE PULL

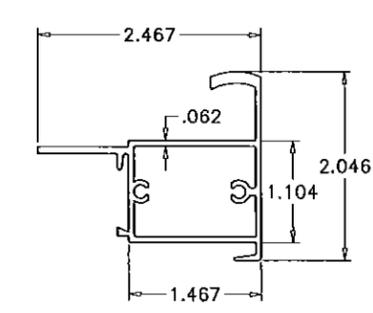


⑦ VENT SIDE INTERLOCK

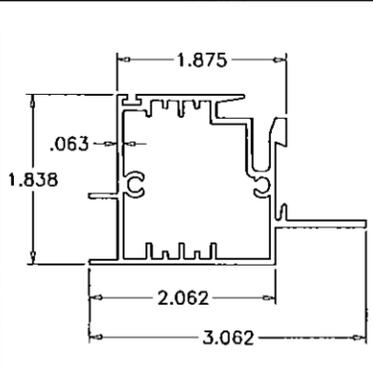


⑥ FIXED MTG. STILE

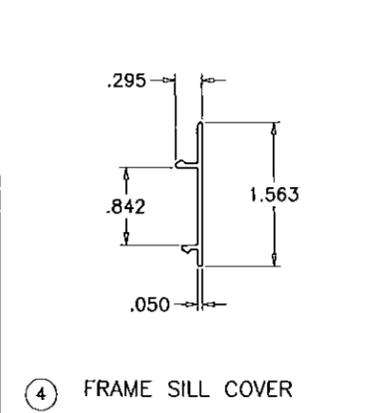

④ FRAME SILL COVER

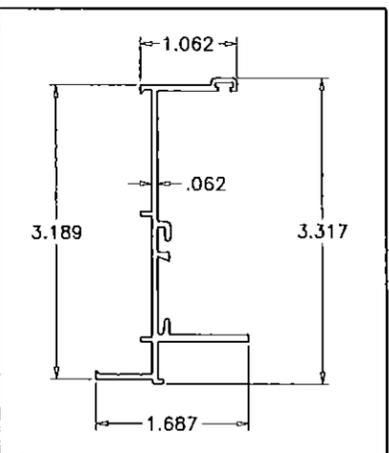

⑤ FRAME JAMB

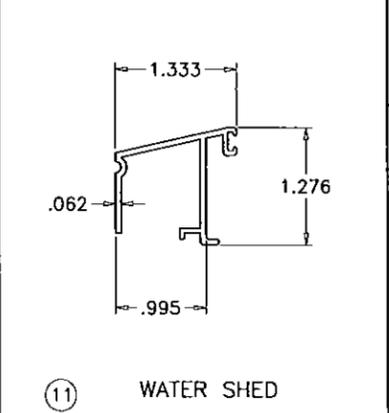


⑪ WATER SHED

ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	021-005	1	FRAME HEAD	6063-T6	-
2	021-014	1	FRAME SILL BASE	6063-T6	-
3	021-013	1	FRAME SILL INSERT	6063-T5	-
4	021-015	1	FRAME SILL COVER	6063-T5	-
5	021-006	2	FRAME JAMB	6063-T6	-
6	022-007	1/	VENT FIXED MEETING STILE	6063-T5	-
7	022-004	1/	VENT SIDE INTERLOCK	6063-T5	-
8	022-019	1/	VENT SIDE PULL	6063-T5	-
9	021-011	4/	GLASS GLAZING BEAD	6063-T5	-
10	021-003	2/	VENT TOP/BOTTOM RAIL	6063-T5	-
11	021-039	1/	VENT WATER SHED	6063-T5	-
12	022-038	-	SILL REINFORCEMENT, 12" LONG	6063-T5	1/ MTG. RAIL & 1 BELOW FIX.
13	021-016	1	TRACK	ALUMINUM	-
14	010-004	2/	VENT WHEEL HOUSING ASSEMBLY	RIGID PVC	M & M PLASTICS
15	004-002	2/	VENT SWEEP LOCK (PD207)	-	SULLIVAN & ASSOC.
16	008-014	AS REQD.	ASSEMBLY SCREWS	ST/ST	#8 X 1" PH SMS
17	008-031	4	MTG. RAIL ASSEMBLY SCREWS	ST/ST	#10 X 1" PH SMS
18	016-002	AS REQD.	.187 X 170 WOOL PILE W/ FIN SEAL	FELT	ULTRAFAB
19	023-001	AS REQD.	.187 X .270 FOAM FILLED BULB	VINYL	AMESBURY
20	012-004	AS REQD.	GLAZING COMPOUND	SILICONE	DOW 995
21	015-006	AS REQD.	1/8" SPACER	ACRYLIC	FRANK LOWE RUBBER
22	012-001	-	SM5504 SEAM SEALER	-	SCHNEE MOREHEAD
23	010-014	AS REQD.	BAFFLE	NYLON	M & M PLASTICS
24	010-015	AS REQD.	WEEP COVER	NYLON	PREFERRED ENGINEERING
25	015-001	AS REQD.	.185 X 220 BULB GASKET (DUROMETER 75±3)	VINYL	MASTER TOOL
26	010-002	2/	VENT END CAP	ACETYL	M & M PLASTICS
27	-	-	LOCK JAMB REINFORCING AT MIDSPAN	6063-T6	1/2" X .078" X 12" LONG
28	015-010	2/	LITE SETTING BLOCK (DUROMETER 85±5)	NEOPRENE	FRANK LOWE RUBBER

**SEALANTS:**

ALL JOINTS AND FRAME CONNECTIONS SEALED WITH SCHNEE MOREHEAD SEAM SEALER SM5504.

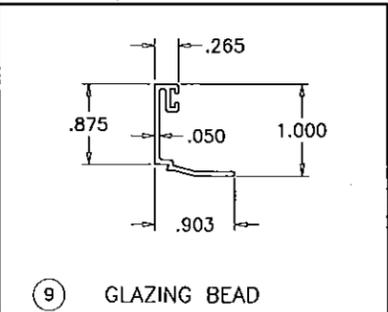

⑨ GLAZING BEAD

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3538  
 JAN 14 2016

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 15-0619.05  
 Expiration Date 2/22/2017  
 By: *[Signature]*  
 Miami Door Product Control

**afC**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL (305) 264-8100 FAX (305) 262-6978  
 COMP-ANL\W06-63IWC


SERIES 2041/2062 ALUM HORIZONTAL SLIDING WDW.  
**INNOVATIVE WINDOW CONCEPTS, LLC**  
 2005 CORPORATE DRIVE  
 BOYNTON BEACH, FL. 33426  
 TEL. (561) 493-2303 FAX. (561) 493-2302

revisions:	no	date	by	description
	A	06.11.09		UPDATED FOR 2007 FBC
	B	10.05.11		DUROMETER ADDED
	C	06.11.15		UPDATED TO 2014 FBC
	D	11.24.15		NO CHANGE THIS SHEET


date: 09-27-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W06-63**


sheet 5 of 6

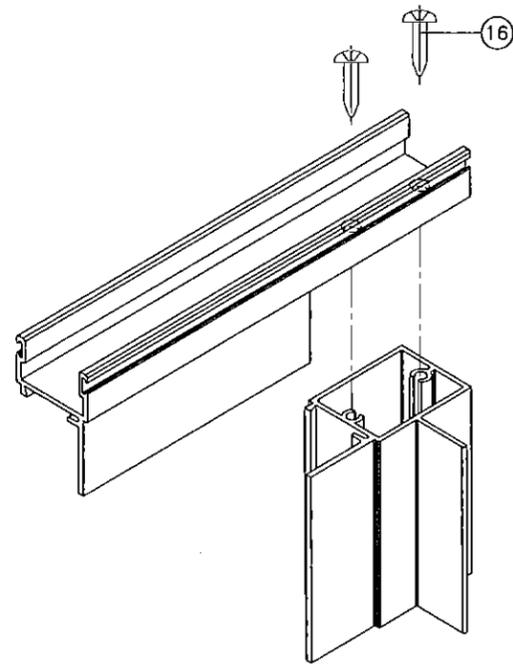


VENT TOP/BOTTOM CORNERS

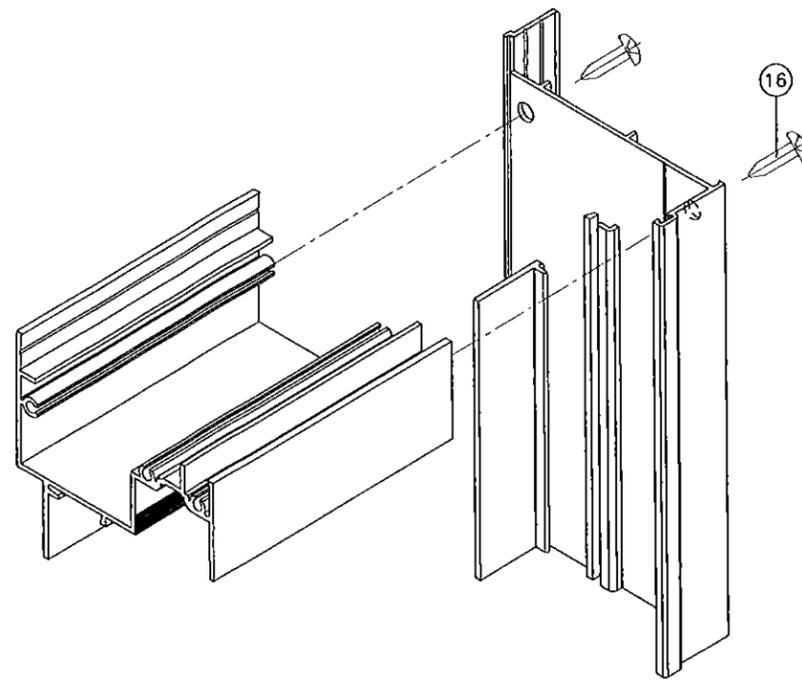

FRAME TOP CORNER

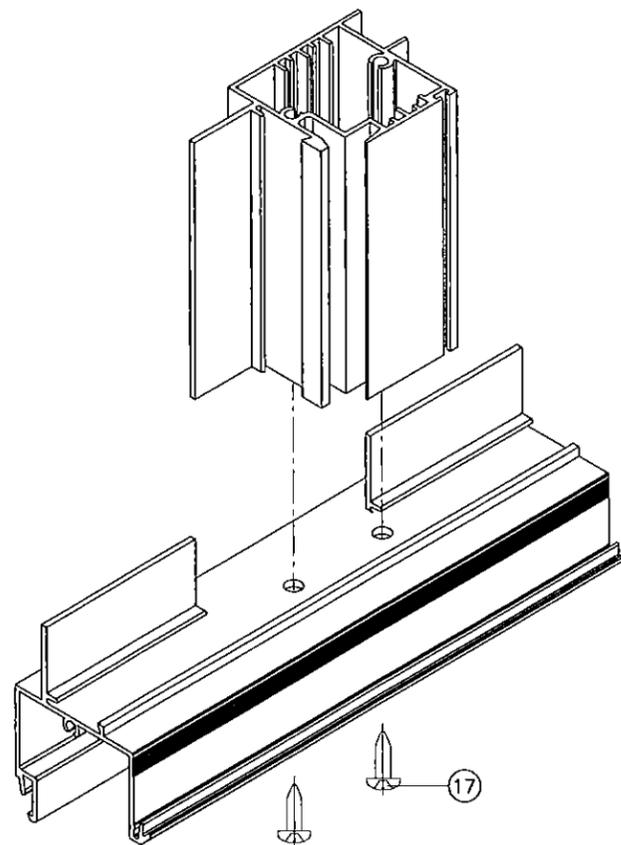

FIXED MTG. RAIL CORNER

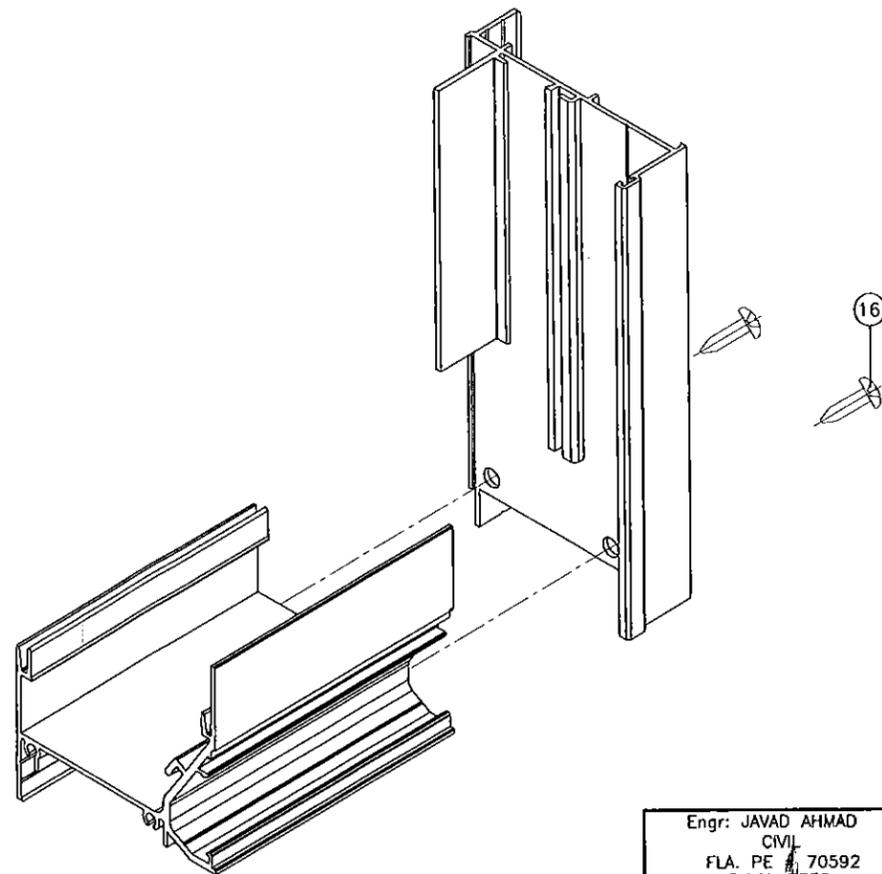

FRAME BOTTOM CORNER

Engr: JAVAD AHMAD  
 CIVIL  
 FLA. PE # 70592  
 C.A.N. 3638  
 JAN 14 2016

PRODUCT REVISED  
 as complying with the Florida  
 Building Code  
 Acceptance No 15-0619.05  
 Expiration Date Feb 22, 2012  
 By: *[Signature]*  
 Minimal Code Product Control

**afc**  
**AL-FAROOQ CORPORATION**  
 ENGINEERS & PRODUCT DEVELOPMENT  
 9360 SUNSET DRIVE, SUITE 220  
 MIAMI, FLORIDA 33173  
 TEL. (305) 264-8100 FAX. (305) 262-6978  
 COMP-ANL\W06-63IWC

SERIES 2041/2062 ALUM HORIZONTAL SLIDING WDW.  
**INNOVATIVE WINDOW CONCEPTS, LLC**  
 2005 CORPORATE DRIVE  
 BOYNTON BEACH, FL. 33426  
 TEL. (561) 493-2303 FAX. (561) 493-2302

no	date	by	description
A	06.11.09		UPDATED FOR 2007 FBC
B	10.05.11		NO CHANGE THIS SHEET
C	06.11.15		UPDATED TO 2014 FBC
D	11.24.15		NO CHANGE THIS SHEET

date: 09-27-06  
 scale: 1/2" = 1"  
 dr. by: HAMID  
 chk. by:

drawing no.  
**W06-63**  
 sheet 6 of 6