



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Dorma Door Control, Inc.
1003 West Broadway
Steellville, Il 62288

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Dorma series "8400" Panic Exit Devices –Component Approval

APPROVAL DOCUMENT: Drawing No. **8000DADE**, titled "8400 Series Single or Pair SVR", sheets 1 through 2 of 2, dated 12/19/00, with revision "4" dated 06/16/15, issued by Building Drops, Inc., signed and sealed by Hermes F. Norero, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LIMITATION:

1. See Design Pressure Ratings (PSF) for applicable in sheets 1 and 2. Rim exit series **8300** is limited to single door application. SVR series **8400** can be single or double door application.
2. The component Panic devices is approved as an alternate to corresponding locks of outswing commercial Steel door, having current NOA (w/ applicable steel reinforcements at lock, astragal & hinge stiles), with **18 ga. (0.045"** min.) steel door panel no wider and higher than this approved drawings in **16 ga. (0.053"** min.) steel Door frames.
3. The Lower Design Pressure Rating of this component or impacted door (under separate approval) shall control for the system.
4. Electrical devices, fire rating and egress requirements are not part of the review and such application to be reviewed and approved by AHJ (Authority Having Jurisdiction).

RP
6/16/2016

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.



RP
3/1/2016

NOA No. 15-0630.07
Expiration Date: January 03, 2017
Approval Date: March 10, 2016
Page 1



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Dorma Door Control, Inc.
1003 West Broadway
Steelville, IL 62288

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT:

The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION:

A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 12-1106.07** and consists of these pages 1 and 2, and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jorge M. Plasencia, P.E.**



Jorge M. Plasencia
3/10/2016

NOA No. 15-0630.07
Expiration Date: January 03, 2017
Approval Date: March 10, 2016
Page 2

Dorma Door Control, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA's No.'s 11-1128.05 and 01-0423.01)
2. Drawing No. **8000DADE**, titled "8400 Series Single or Pair SVR", sheets 1 through 2 of 2, dated 12/19/00, with revision "4" dated 06/16/15, issued by Building Drops, Inc., signed and sealed by Hermes F. Norero, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94(Not Performed)
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94 (Not Performed)
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of Dorma's series 8300 (single Rim Exit, 9400 SVR and 9400 SVR Hardware devices in 18 ga. steel doors w/ 16 ga. steel frames , prepared by Intertek, Test Report No. **ITS-100571083MID-001**, dated 06/25/12, signed and sealed by Rick Curkeet, P.E.
(Submitted under previous NOA No. 11-1128.05)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94(Not Performed)
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94 (Not Performed)
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of Dorma's series 8300 (single Rim Exit, 9400 SVR and 9400 SVR Hardware devices in 18 ga. steel doors w/ 16 ga. steel frames , prepared by Intertek, Test Reports No.'s **ATI-0137581.01**, **ATI-0137581.02** and **ATI-0137581.04**, dated 03/16/01, all signed and sealed by Allen N. Reeves, P.E.
(Submitted under previous NOA No. 01-0423.01)

C. CALCULATIONS

1. Product evaluation Report No. **BDI-3802** of Panic Exit devices series comparison provided by Building Drops, Inc., signed and sealed by Hermes F. Norero, P.E.
2. Statement letter of compliance to FBC, dated 07/26/12, issued by H. R. Engineering Inc., signed and sealed by Allen N. Reeves, P.E.
(Submitted under previous NOA No. 11-1128.05)
3. Engineering evaluation of Panic Exit devices series comparison provided by Dorma Inc.
(Submitted under previous NOA No. 01-0423.01)



Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-0630.07
Expiration Date: January 03, 2017
Approval Date: March 10, 2016

Dorma Door Control, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC-5th Edition (2014)**, and of no financial interest, dated 06/16/15, issued, signed and sealed by Hermes F. Norero, P.E.
2. Notification of Successor Engineer for manufacturer's NOA document per **Section 61G15-27.001** of the **Florida Administrative Code**, notifying original engineer that the successor engineer is assuming full professional and legal responsibility for all engineering documents pertaining to this NOA, dated 06/16/15, signed and sealed by Hermes F. Norero, P.E.
3. Laboratory addendum letter for Test Report No. **ITS-100571083MID-001**, dated 05/30/13, issued by Intertek Testing Lab, Inc., signed and sealed by Rick Curkeet, P.E. *(Submitted under previous NOA No. 11-1128.05)*
4. Laboratory compliance letter for Test Report No. **ITS-100571083MID-001**, dated 06/25/12, issued by Intertek Testing Lab, Inc., signed and sealed by Rick Curkeet, P.E. *(Submitted under previous NOA No. 11-1128.05)*
5. Laboratory compliance letter for Test Reports No.'s **ATI-0137581.01**, **ATI-0137581.02** and **ATI-0137581.04**, all issued by Architectural Testing Laboratory, Inc., dated 03/16/01, signed and sealed by Allen N. Reeves, P.E. *(Submitted under previous NOA No. 01-0423.01)*
6. Merger agreement between Dorma Door Control, Inc. and Dorma Steelville, Inc. dated 02/28/03, both signed by Paul T. Kosakowaski, president. *(Submitted under previous NOA No. 06-0912.04)*

G. OTHERS


1. Notice of Acceptance No. **12-1106.07**, issued to Dorma Door Control, Inc., for their "**Dorma series 8000 Panic Exit Devices - Component Approval**", approved on 08/08/13 and expiring on 01/03/17.
2. DORMA's update catalog per acknowledgement letter, dated 04/24/06. *(Submitted under previous NOA No. 12-1106.07)*




Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-0630.07
Expiration Date: January 03, 2017
Approval Date: March 10, 2016

BILL OF MATERIAL			
ITEM	DESCRIPTION	PART NUMBER	QTY.
1	DOOR & FRAME	Under Sep. NOA	1
2	8300/F8300 CHASSIS ASSY.	SEE NOTES	1
3	TOUCHBAR/RAIL ASSY.		1
4	THRU BOLTS		6
5	ENDCAP BRACKET		1
6	OUTSIDE TRIM		1
7	ENDCAP		1
8	CHASSIS COVER		1
9	STRIKE ANGLE		1
10	12-24 R.H.P.M.S.		6
11	8-32 T.H.P.M.S.		6
12	12-24 F.H.P.M.S.		8
13	HINGES		4
14	#463 STRIKE	SEE NOTES	1
15	END COVER		1
16	#8 X 1" F.H.W.S.		2


CHASSIS ASSEMBLY MATERIAL: STEEL, BOLT 304 STAINLESS
 STRIKE MATERIAL: 701 SANDCAST MALLEABLE IRON FERRATIC GRADE 32510

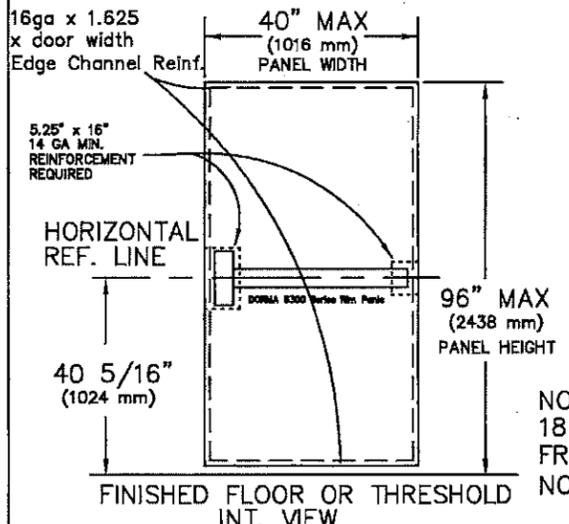

NOTE:
 18 GA DOORS AND 16 GA FRAMES UNDER SEPERATE NOA APPROVAL, 1 3/4" THICK, 1 5/8"

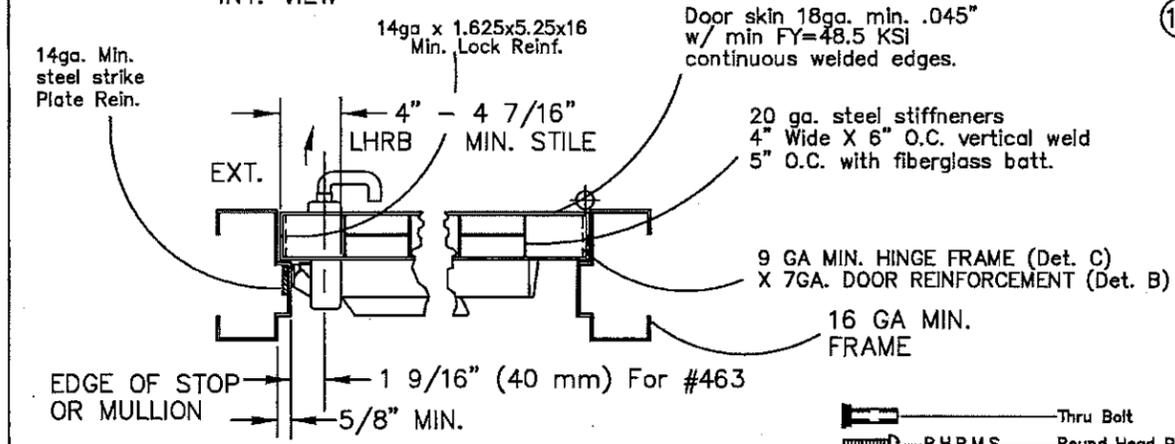

DORMA 8300/F8300 Rim Panic Exit Devices (Component Approval)
 On Impact Flush Outswing Single Steel Door Having Current NOA or Current HVHZ Florida State Approval

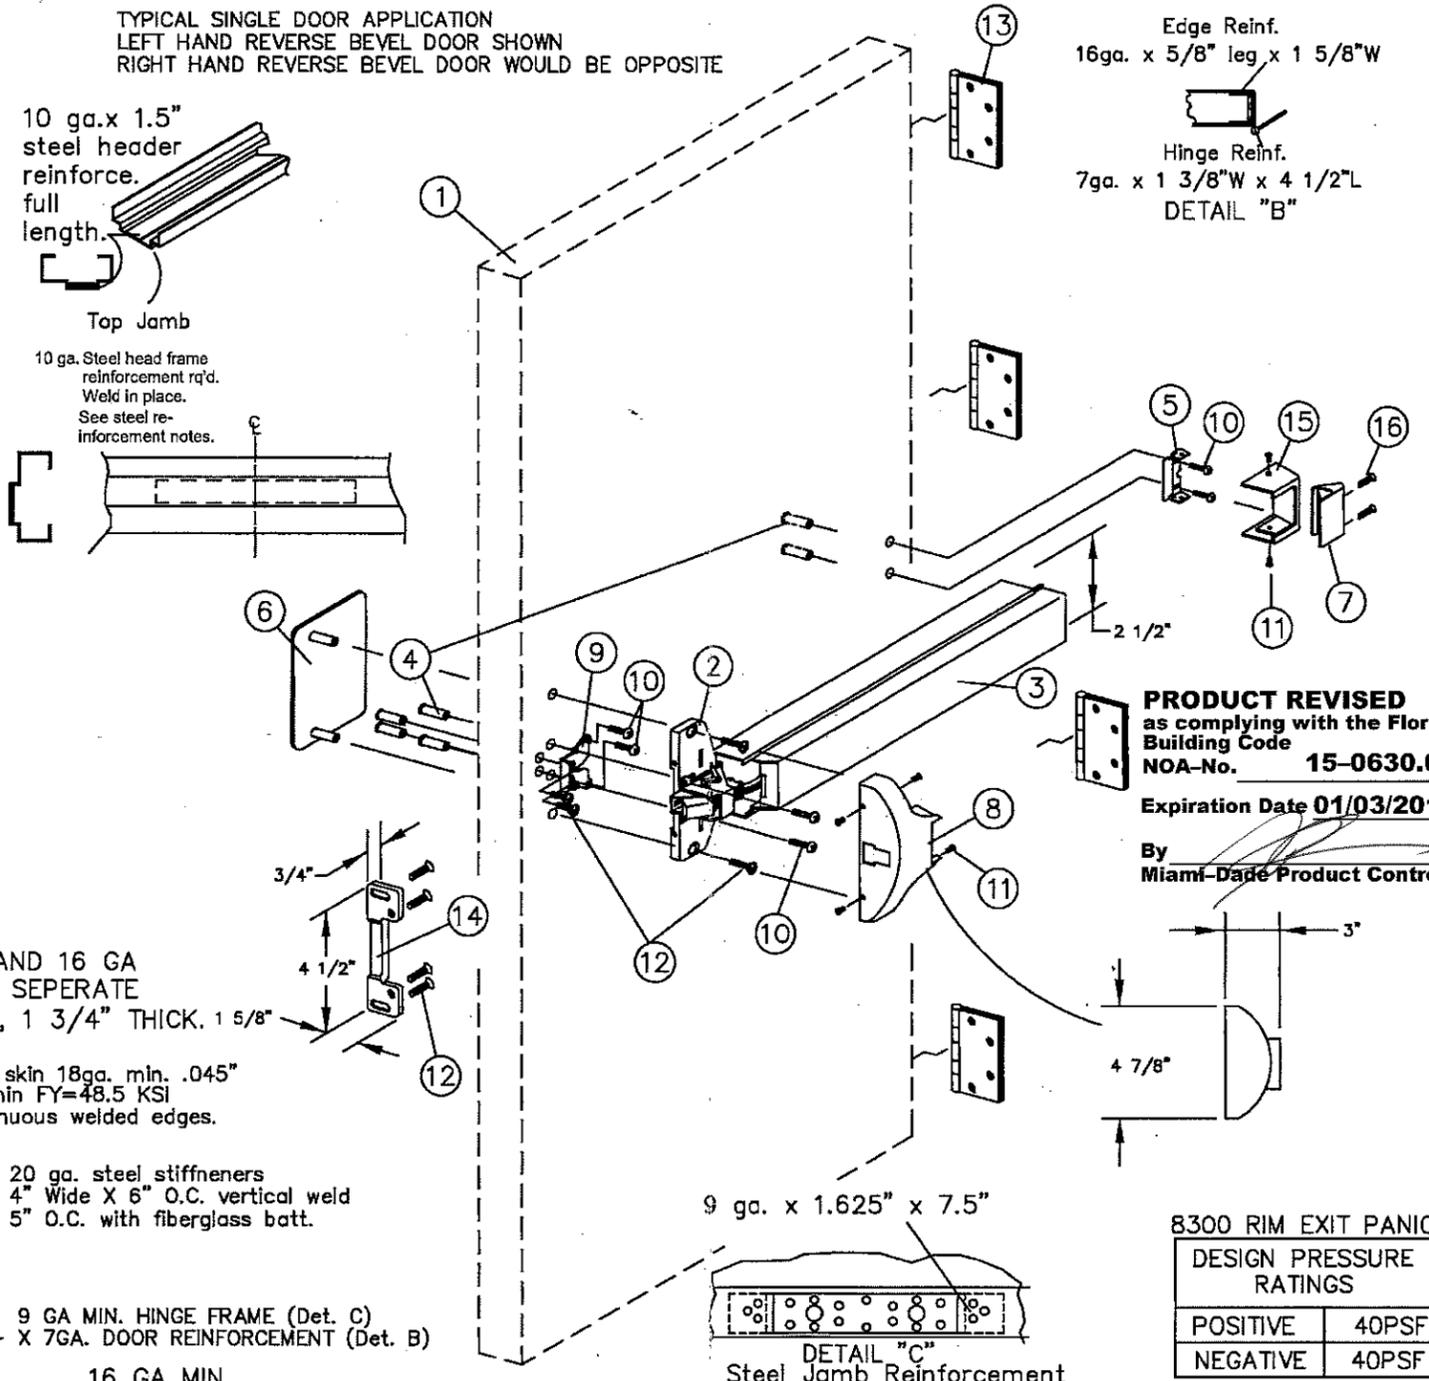

PRODUCT REVISED
 as complying with the Florida Building Code
 NOA-No. 15-0630.07
 Expiration Date 01/03/2017
 By Miami-Dade Product Control


8300 RIM EXIT PANIC	
DESIGN PRESSURE RATINGS	
POSITIVE	40PSF
NEGATIVE	40PSF

DESCRIPTION: 8300 RIM SERIES SINGLE DOOR (DADE)	
MATERIAL:	
CORL. WIDTH:	UNLESS NOTED OTHERWISE DECIMALS .XXX ±.005 DECIMALS .XX ±.010 FRACTIONS 1/64 ±1/64 ANGLES ±2°
PROGRESSION:	
WEIGHT:	
FINISH:	
SCALE: NONE	DRAWN BY: T.A. DATE: 12-19-00



GENERAL NOTES

- LIMITATIONS:
- Devices approved to be used as equal alternative to corresponding lock approved to be used in applic. 18ga (min .045") w/min FY=48.5 KSI outswing steel doors holding a current NOA, lowest design pressure of door or this component will apply.
 - Device shall be installed on 18ga (min .045") w/min FY=48.5 KSI commercial steel door panel no wider or higher than shown on these approved drawings.
 - Installation of this device requires steel reinforcement as indicated.
 - Electrical options are not part of this approval and must be reviewed by corresponding authority.
- Certifications:
 Underwriters Laboratories-UL10C, UL305, UBC 7-2 (1997), ANSI-BHMA 156.3 Grade 1 Exit Hardware 3/4" Min. latchbolt throw.
 All reinforcement to be spot welded or better by door manufacturer.
 All dimensions in accordance with manufacturer's standard installation instructions.
 Frame: 16 ga. min.
 Door: 18ga (min..045") w/min. FY=48.5 KSI
 Hinge/Jamb reinforcement: As noted.
 Header channel: 10ga. x 1.5" x width.
 Lock stile/hinge stile, panic box reinforcement: 14 ga min.
- Outside trim may be one of the following: 80DT, 8PDT, 8003, 8P03, 8003P, K03, R03, C03, K08, R08, C08, K23, R23, or C23.
 Thrubolts must be used on all install.
 Strike angel must be installed.

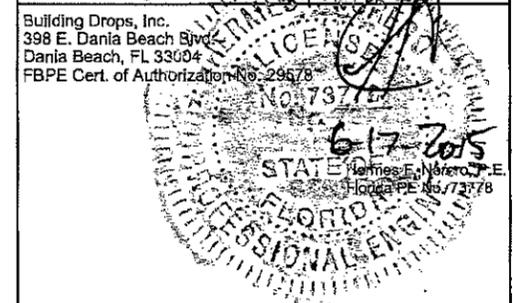





5th Edition FBC Update	4	LS	6-16-15
Update per Dade	3	TA	5-2-13
Update per retest	2	TA	5-30-12
Revised Print	1	TA	9-1-01
REVISIONS	NO.	BY	DATE
DWG. 1 OF 2	8000DADE		
DWG. NO.			

BILL OF MATERIAL			
ITEM	DESCRIPTION	PART NUMBER	QTY.
1	DOOR & FRAME	Under Sep. NOA	1
2	8400 CHASSIS ASSY.	STEEL	1
3	TOUCHBAR/RAIL ASSY.		1
4	THRU BOLTS		8
5	ENDCAP BRACKET		1
6	OUTSIDE TRIM		1
7	ENDCAP		1
8	CHASSIS COVER		1
9	12-24 F.H.P.M.S.		2
10	12-24 R.H.P.M.S.		8
11	8-32 T.H.P.M.S.		10
12	LATCH COVER		2
13	HINGES		3
14	#426 STRIKE PACK	SANDCAST GRAY IRON CLASS 20	1
15	STRIKE ANGLE	STAINLESS STEEL	1
16	TOP LATCH ASSEMBLY	STEEL	1
17	TOP CONNECTING ROD	1/2" O.D. ALUMINUM TUBING	1
18	BOTTOM CONNECTING ROD	1/2" O.D. ALUMINUM TUBING	1
19	BOTTOM LATCH BRACKET	STEEL	1
20	SLIDE BOLT ASSEMBLY	STEEL	1
21	#340 STRIKE PACK	STEEL	1
22	ROD GUIDE ASSEMBLY		2
23	#8 x 1" R.H.P.T.S.		4
24	ROD PIN		2
25	END COVER		1
26	#8 X 1" F.H.W.S.		2

DORMA 8400/F8400 Surface Vertical Rod Application
 On Outswing Single And Pair Steel Doors Having Current NOA or Current HVHZ Florida State Approval

TYPICAL SURFACE VERTICAL ROD INSTALLATION
 LEFT HAND REVERSE BEVEL DOOR SHOWN
 RIGHT HAND REVERSE BEVEL DOOR WOULD BE OPPOSITE

- Thru Bolt
- R.H.P.M.S.—Round Head Phillips Machine Screw
- F.H.P.M.S.—Flat Head Phillips Machine Screw
- O.H.P.M.S.—Oval Head Phillips Machine Screw
- F.H.P.U.C.M.S.—Flat Head Phillips Undercut Machine Screw
- T.H.P.U.C.M.S.—Flat Head Phillips Undercut Machine Screw

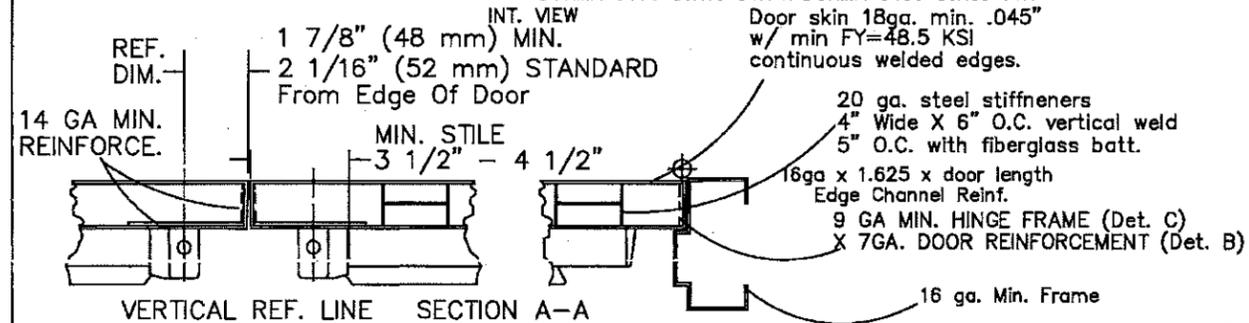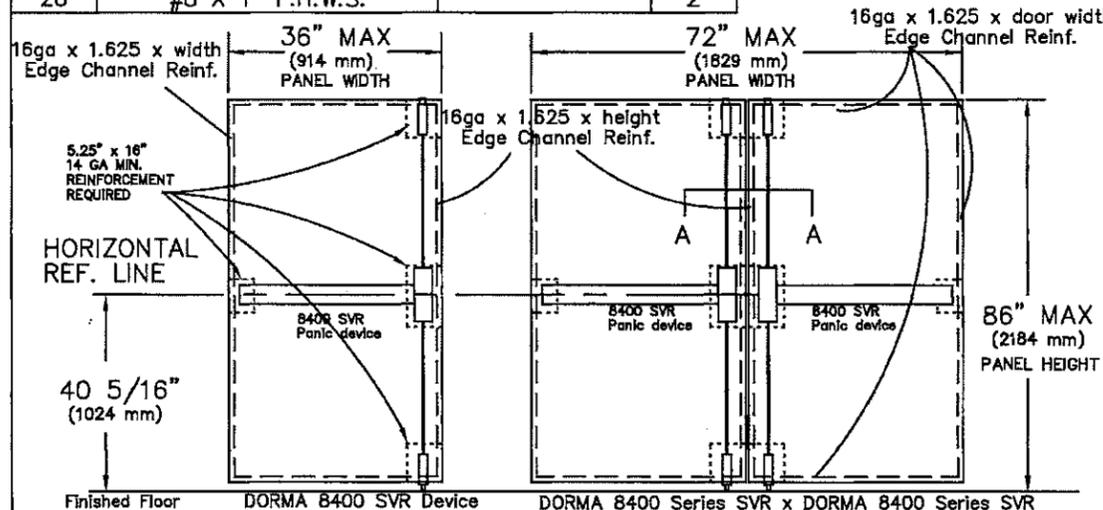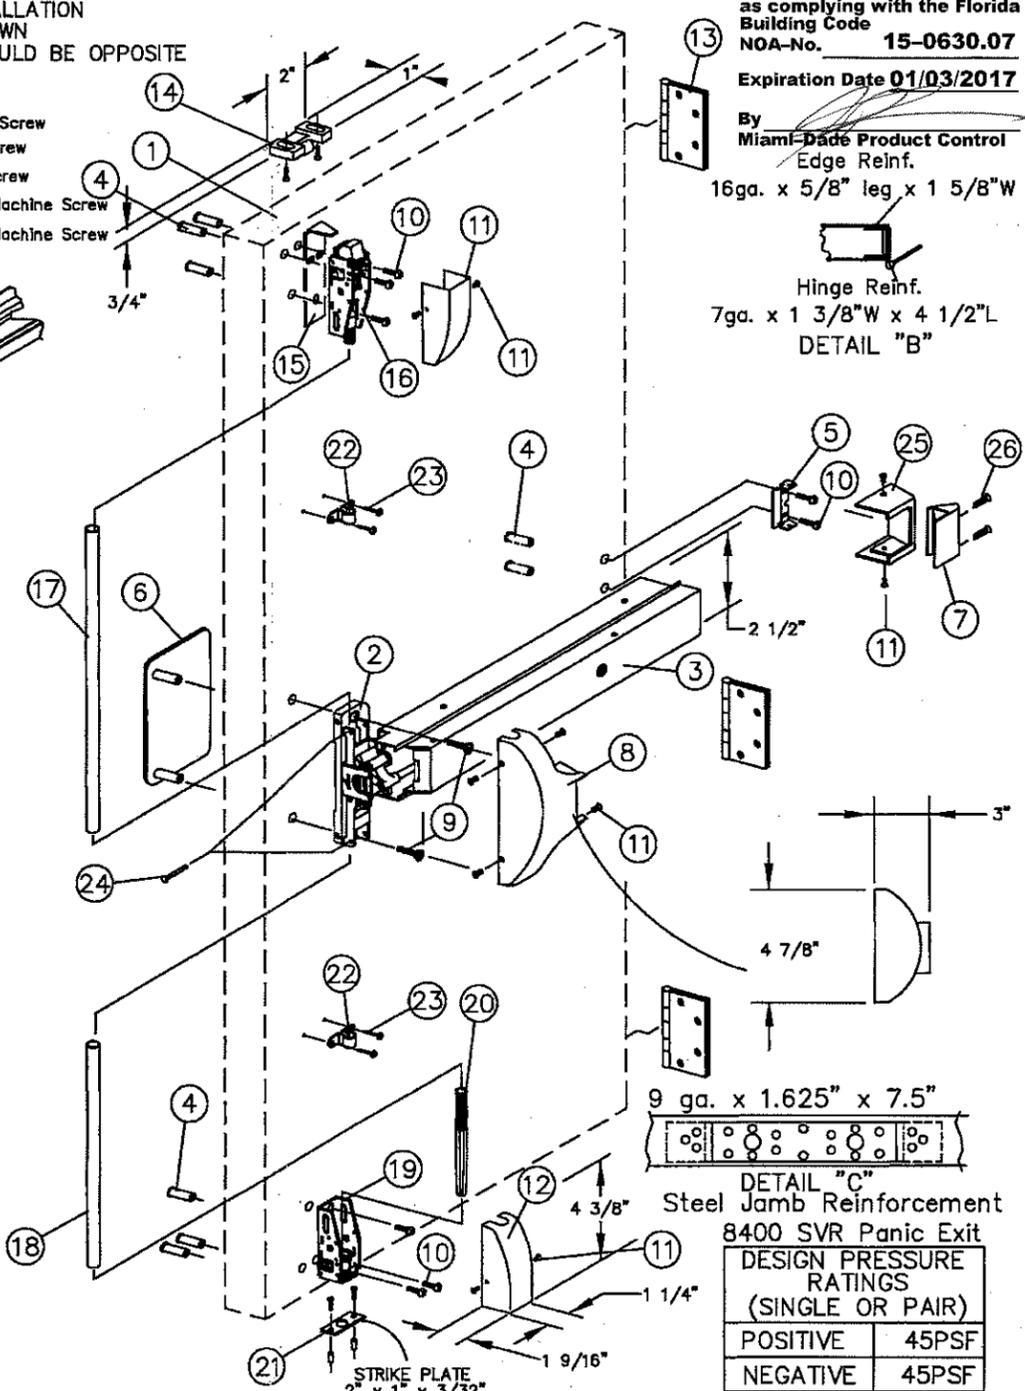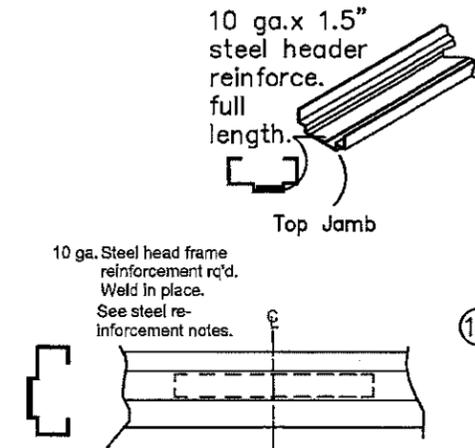

DESCRIPTION: 8400 SERIES SINGLE OR PAIR SVR

MATERIAL:	
COIL WIDTH:	
PROGRESSION:	
WEIGHT:	
FINISH:	
SCALE: NONE	

UNLESS NOTED OTHERWISE
 DECIMALS .XXX ±.005
 DECIMALS .XX ±.010
 FRACTIONS ±1/64
 ANGLES ±2°



DRAWN BY: T.A. DATE: 12-20-00

GENERAL NOTES

- LIMITATIONS:
- Devices approved to be used as equal alternative to corresponding lock approved to be used in applic. 18ga (min .045") w/min FY=48.5 KSI outswing steel doors holding a current NOA, lowest design pressure of door or this component will apply.
 - Device shall be installed on 18ga (min .045") w/min FY=48.5 KSI commercial steel door panel no wider or higher than shown on these approved drawings.
 - Installation of this device requires steel reinforcement as indicated.
 - Electrical options are not part of this approval and must be reviewed by corresponding authority.
- Certifications:
 Underwriters Laboratories-UL10C, UL305, UBC 7-2 (1997), ANSI-BHMA 156.3 Grade 1 Exit Hardware
 3/4" Min. latchbolt throw.
 All reinforcement to be spot welded or better by door manufacturer.
 All dimensions in accordance with manufacturer's standard installation instructions.
 Frame: 16 ga. min.
 Door: 18ga (min..045") w/min. FY=48.5 KSI
 Hinge/Jamb reinforcement: As noted.
 Header channel: 10ga. x 1.5" x width.
 Lock stile/hinge stile, panic box reinforcement: 14 ga min.
- Outside trim may be one of the following: 80DT, 8PDT, 8003, 8P03, 8003P, K03, R03, C03, K08, R08, C08, K23, R23, or C23.
- Thrubolts must be used on all install. Strike angel must be installed.

Building Drops, Inc.
 398 E. Dania Beach Blvd.
 Dania Beach, FL 33004
 FBPE Cert. of Authorization No. 29578

5th Edition FBC Update	4	LS	6-16-15
Update per Dade	3	TA	5-2-13
Update per retest	2	TA	5-30-12
Revised Print	1	TA	9-4-01
REVISIONS	NO.	BY	DATE
DWG. 2 OF 2			
DWG. NO.	8000DADE		