



MIAMI-DADE COUNTY  
 PRODUCT CONTROL SECTION  
 11805 SW 26 Street, Room 208  
 Miami, Florida 33175-2474  
 T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
 BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

WinDoor, Incorporated  
 7500 Amsterdam drive  
 Orlando, Florida, 32832

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ). This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "V-800" Outswing Single Vinyl Door-LMI**

**APPROVAL DOCUMENT:** Drawing No. 08-01766 Rev C, titled "Series V-800 Vinyl Outswing Single Door", sheets 1, 1A, 2 through 10 of 10, prepared by manufacturer, dated 09/10/12 and last revised on 10/03/2013, signed and sealed by Luis R. Lomas, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**Limitations:**

1. See multi-locking points for Hoppe in sheet 8 and hardware detail in sheet 9. The Hoppe hardware shoot bolts at head & sill must engage min 3/4" beyond the door frame into specified substrate.
2. Standard Door sill (detail, sheet 5) to be set with 3/8" continuous full width construction sealant, compatible to the substrate with min 18 #/in (PLI) durable shear strength (see note #14, sheet 1). The Low profile sill to be secured with min three screws (detail, sheet6) & with additional optional construction sealant.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", as noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official. This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above. The submitted documentation was reviewed by **Jorge M. Plasencia, P.E.**



*J.P.*  
 3/1/2016

NOA No. 15-0723.14  
 Expiration Date: February 06, 2019  
 Approval Date: March 10, 2016  
 Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections  
*(Submitted under previous NOA No. 13-0110.01)*
2. Drawing No. **08-01766 Rev C**, titled "Series V-800 Vinyl Outswing Single Door", sheets 1, 1A, 2 through 10 of 10, prepared by manufacturer, dated 09/10/12 and last revised on 10/03/2013, signed and sealed by Luis R. Lomas, P.E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with marked-up drawings and installation diagram of Vinyl Single outswing, prepared by National Certified Testing Laboratories Inc, Test Report No. **NCTL-210-3825-2A** dated 08/13/12 and revised on 09/26/12 Rev 01, 03-12-13 Rev 02 and 09/30/13 Rev 03, signed & sealed by Gerald J, Ferrara, P.E.  
*(Submitted under previous NOA No. 13-0110.01)*

**C. CALCULATIONS**

1. Anchor verification calculations & structural analysis, complying with FBC-2014, dated 07/09/2014, prepared, signed and sealed by Luis R. Lomas, P.E.
2. Glazing complies with ASTM E-1300-04.

**D. QUALITY ASSURANCE**


1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **14-0916.11** issued to Kuraray America., Inc. (formerly E.I. DuPont De Nemours & Co.) for their "**Sentry Glass® (Clear and White) Glass Interlayers**", expiring on 01/14/17.
2. Notice of Acceptance No. **12-0106.01** issued to Veka, Inc. for their "**White Rigid PVC**", expiring on 03/04/17.

**F. STATEMENTS**

1. Statement letter of conformance to FBC 2014 and "No financial interest", dated 07/10/2015, prepared, signed and sealed by Luis R. Lomas, P.E.
2. Test lab compliance statement, part of the above referenced reports.

  
\_\_\_\_\_  
Jorge M. Plasencia, P.E.  
Product Control Unit Supervisor  
NOA No. 15-0723.14  
Expiration Date: February 06, 2019  
Approval Date: March 10, 2016

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**G. OTHER**

1. Test Proposals #12-0642 dated 04/24/12 approved by RER.  
*(Submitted under previous NOA No. 13-0110.01)*

  
\_\_\_\_\_  
Jorge M. Plasencia, P.E.  
Product Control Unit Supervisor  
NOA No. 15-0723.14  
Expiration Date: February 06, 2019  
Approval Date: March 10, 2016

NOTES:

1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING THE HVHZ.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. PROPERLY SECURED 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
5. FRAME MATERIAL: EXTRUDED RIGID PVC.
6. UNITS MUST BE GLAZED PER ASTM E1300-04, SEE SHEET 3 FOR GLASS OPTIONS.
7. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
8. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM TO BE 1/4".
9. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #14 GRADE 5 WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 7/16" MINIMUM EMBEDMENT INTO SUBSTRATE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
10. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" ITW TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. FOR ANCHORING INTO METAL STRUCTURE USE #14 GRADE 5 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
12. ALL FASTENERS TO BE CORROSION RESISTANT.
13. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
  - A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42
  - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
  - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
  - D. METAL STRUCTURE: STEEL 18GA, 33KSI OR ALUMINUM 6063-T5 1/8" THICK MINIMUM
14. STANDARD DOOR SILL TO BE SET IN A FULL WIDTH, CONTINUOUS 3/8" THICK BED OF SEALANT, WITHOUT 1/4" SHIM SPACING, EQUAL TO OR BETTER THAN C.R. LAURENCE M64 POLYURETHANE CONSTRUCTION SEALANT HAVING 18 #/IN (PLI) SHEAR STRENGTH. SEALANT AT LOW SILL IS ADDITIONAL SUPPLEMENT TO ANCHOR SCREWS. A COMPATIBILITY OF ALUMINUM DOOR SILL, SEALANT AND ADJACENT SUBSTRATE TO BE DETERMINED BY ARCHITECT OF RECORD.

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

Approved as complying with the  
 Florida Building Code  
 Date FEB 06, 2014  
 NOA# 13-0110-01  
 Miami-Dade Product Control  
 By Isang L. Chung

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **15-0723.14**  
 Expiration Date **02/06/2019**  
 By [Signature]  
 Miami-Dade Product Control

SIGNED: 10/03/2013

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
1A	ELEVATIONS
2 - 3	B.O.M., CROSS SECTIONS AND GLAZING DETAIL
4 - 6	INSTALLATION DETAILS
7	COMPONENTS
8 - 10	HARDWARE DETAILS & LOCATIONS


**WinDoor** 7500 AMSTERDAM DRIVE  
 INCORPORATED ORLANDO, FL 32832  
 Phone: 407.481.8100  
 Fax: 407.481.0505 www.windoorinc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
 WITH STANDARD AND LOW PROFILE SILLS  
 ELEVATION AND NOTES

DRAWN: V.L. DWG NO. 08-01766 REV C  
 SCALE NTS DATE 9/10/12 SHEET 1 OF 10



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/16/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

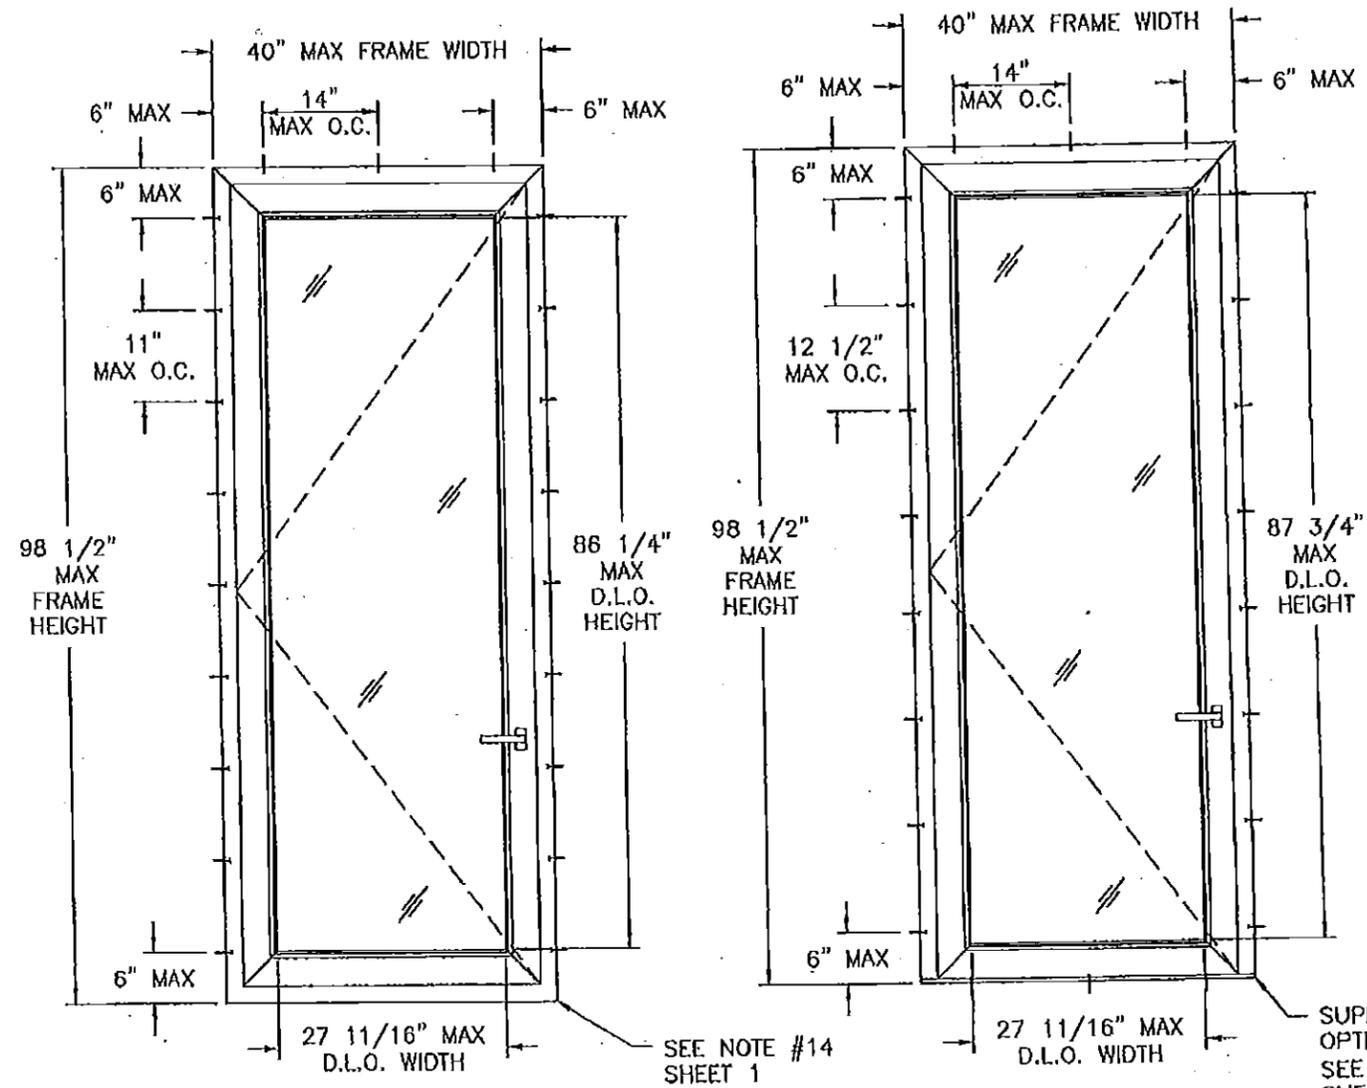

**V-800 VINYL OUT SWING SINGLE DOOR**  
STANDARD SILL EXTERIOR VIEW

**V-800 VINYL OUT SWING SINGLE DOOR**  
LOW PROFILE SILL - EXTERIOR VIEW

SEE NOTE #14 SHEET 1

SUPPLEMENT OPTION  
SEE NOTE #14 SHEET 1

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. **15-0723.14**  
Expiration Date **02/06/2019**  
By *[Signature]*  
Miami-Dade Product Control

SIGNED: 10/03/2013

DESIGN PRESSURE RATING	IMPACT RATING
±90.0PSF	LARGE MISSILE IMPACT

Approved as complying with the Florida Building Code Date: 2/6/13 NOA: 13-0110-01 Miami-Dade Product Control By: <i>[Signature]</i>	<b>WinDoor</b> INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0505 www.windoorinc.com	
	V-800 VINYL OUT-SWING SINGLE DOOR WITH STANDARD AND LOW PROFILE SILLS ELEVATIONS	
DRAWN: V.L. SCALE: NTS	DWG NO. 08-01766 DATE: 9/10/12	REV C SHEET 1A OF 10



PARTS LIST				
NO.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	101.214	3 1/8" TALL MAIN FRAME	VEKA	*WHITE RIGID PVC
2	103.242	4 1/8" TALL OUTSWING SHSH FRAME	VEKA	*WHITE RIGID PVC
3		LOW PROFILE SILL ASSEMBLY	VEKA	SEE SUBASSEMBLY
3A	104.427	SILL PART A	VEKA	ALUMINUM 6063-T5
3B	104.427_A	SILL PART B	VEKA	ALUMINUM 6060-T66
3C	104.428	LOW PROFILE SILL COVER	VEKA	*WHITE RIGID PVC
4	NOT USED			
5	101.208	2 5/8" TALL FRAME (REGULAR SILL)	VEKA	*WHITE RIGID PVC
6	FH-07295	HEAD/JAMB FRAME REINFORCEMENT	KEYMARK	ALUMINUM 6005-T61
7	FH-07296	SASH REINFORCEMENT	KEYMARK	ALUMINUM 6005-T61
8	FH-06606	STANDARD SILL REINFORCEMENT	KEYMARK	ALUMINUM 6005-T61
9	104.129	GASKET RECEIVER	VEKA	*WHITE RIGID PVC
10	AP299	1/4" HINGED SCREW COVER PVC	ARK-PLASTICS	*WHITE RIGID PVC
11	112.026	GASKET	VEKA	
12	112.380	FRAME POCKET FILLER	VEKA	EPDM 60 DURO
13	112.050	GLAZING GASKET	VEKA	EPDM 60 DURO
14	112.253	GLAZING GASKET	VEKA	EPDM 60 DURO
15	FH06512	JAMB FRAME REINFORCEMENT	KEYMARK	ALUMINUM 6005-T61
16	107.200	1" GLASS STOP	VEKA	*WHITE RIGID PVC
17	00598N	ROTO PS 27 DOOR HINGE	ROTO	
18	3672216	COVER PLATE	FUHR	ALUMINUM 6005-T61
28		#10x3/4" PH SCREW		
29		#10x1-1/2" PH SCREW		
30		#10x2" FH SCREW		
31	01-100-7755-002	SETTING BLOCK	FRANK LOWE	80 DUROMETER
32	SIKA 552	SILICONE SEALANT	SIKA	
33	SEE SHEET 9	HOPPE SILL LOCKING HARDWARE	HOPPE	S.S.

\* WHITE PVC/EXTRUSION SHALL BE LABELED W/AAMA CERTIFICATE, EXTRUDER'S NAME, CITY, STATE & "MDCA"

ITEMS 19-27 ARE SHOWN IN SHEET 9. FOR STANDARD AND LOW PROFILE SILL ITEM #33

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

FOR ILLUSTRATION PURPOSES ONLY  
FOR INSTALLATION DETAILS SEE SHEETS 4 AND 5

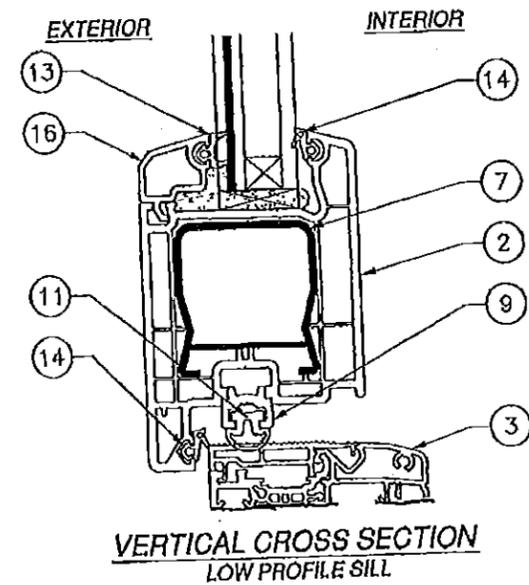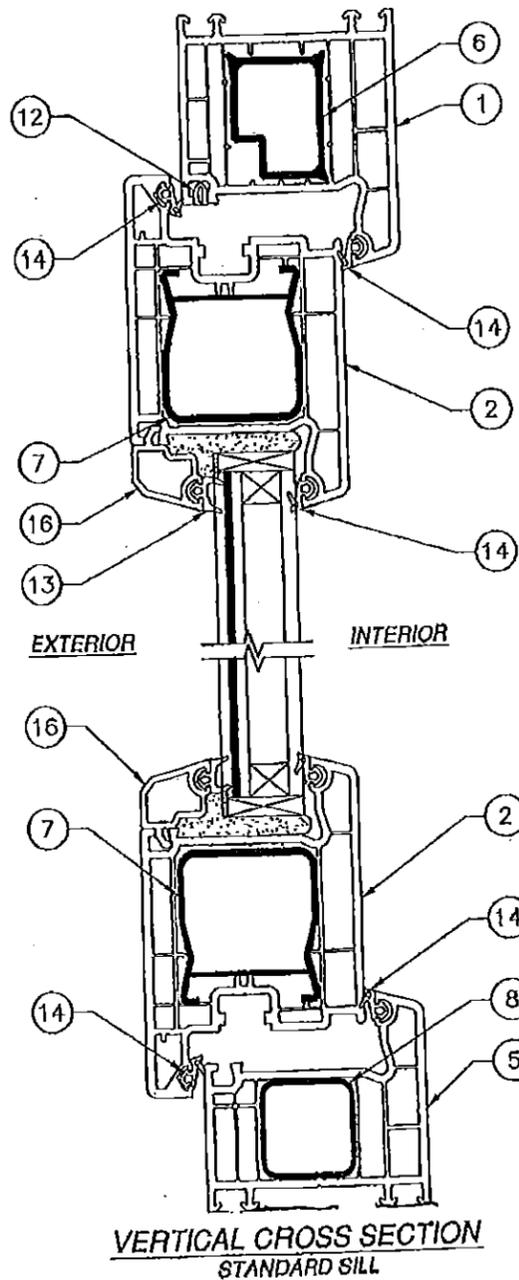

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. **15-0723.14**  
Expiration Date **02/06/2019**  
By *[Signature]*  
Miami-Bade Product Control

Approved as complying with the Florida Building Code  
Date *2/6/19*  
By *[Signature]*  
Miami-Bade Product Control

**WinDoor**  
INCORPORATED

7500 AMSTERDAM DRIVE  
ORLANDO, FL 32832  
Phone: 407.481.8400  
Fax: 407.481.0205  
www.win-door-inc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
WITH STANDARD AND LOW PROFILE SILLS  
B.O.M. AND CROSS SECTIONS



DRAWN: V.L. DWG NO. 08-01766 REV C  
SCALE NTS DATE 9/10/12 SHEET 2 OF 10

SIGNED: 10/03/2013



FOR ILLUSTRATION PURPOSES ONLY  
FOR INSTALLATION DETAILS SEE SHEETS 4 AND 5

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

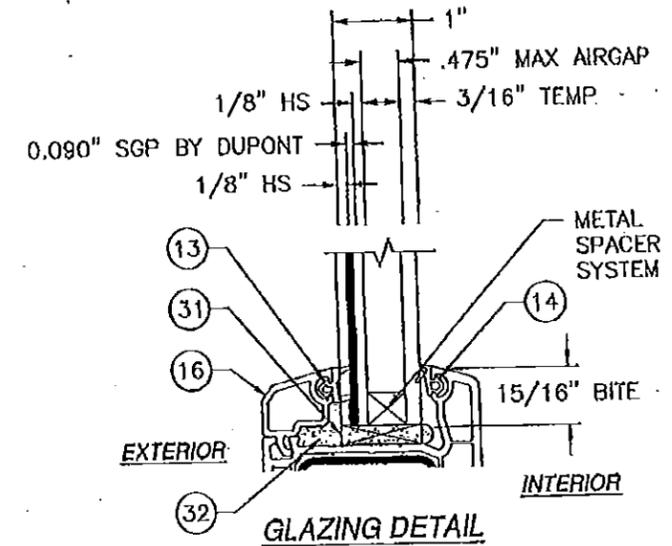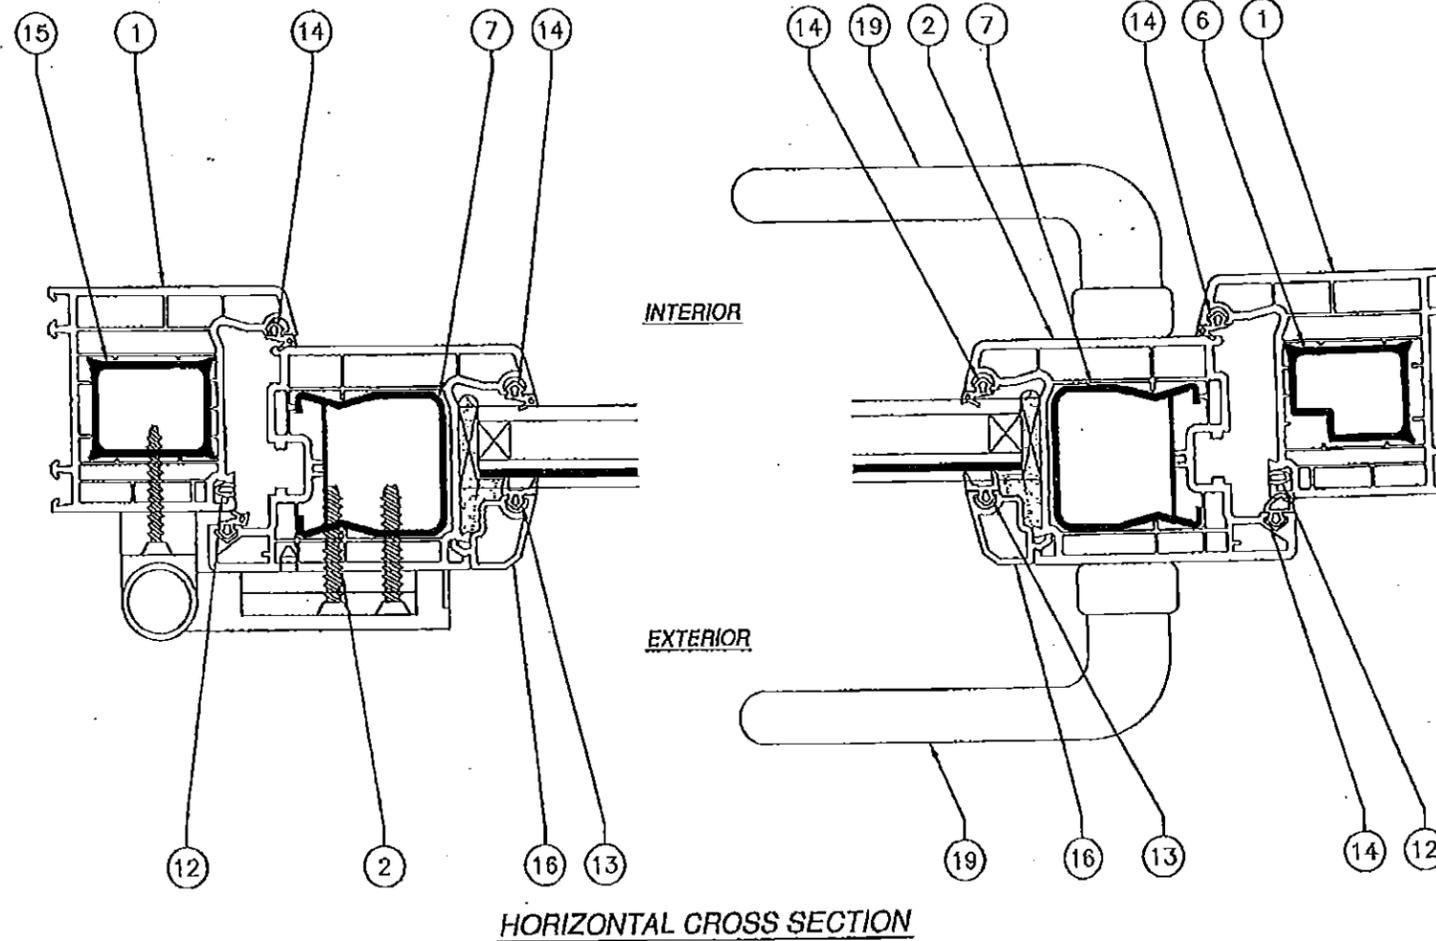

SIGNED: 10/03/2013

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **15-0723.14**  
 Expiration Date **02/06/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

Approved as complying with the  
 Florida Building Code  
 Date *2/6/19*  
 NOA *15-0723.14*  
 Miami-Dade Product Control  
 By *[Signature]*

**WinDoor**  
 INCORPORATED


7500 AMSTERDAM DRIVE  
 ORLANDO, FL 32832  
 Phone: 407.481.8400  
 Fax: 407.481.0505  
 www.windoorinc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
 WITH STANDARD AND LOW PROFILE SILLS  
 CROSS SECTIONS AND GLAZING DETAILS

DRAWN: V.L.	DWG NO. 08-01766	REV C
SCALE NTS	DATE 9/10/12	SHEET 3 OF 10



REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

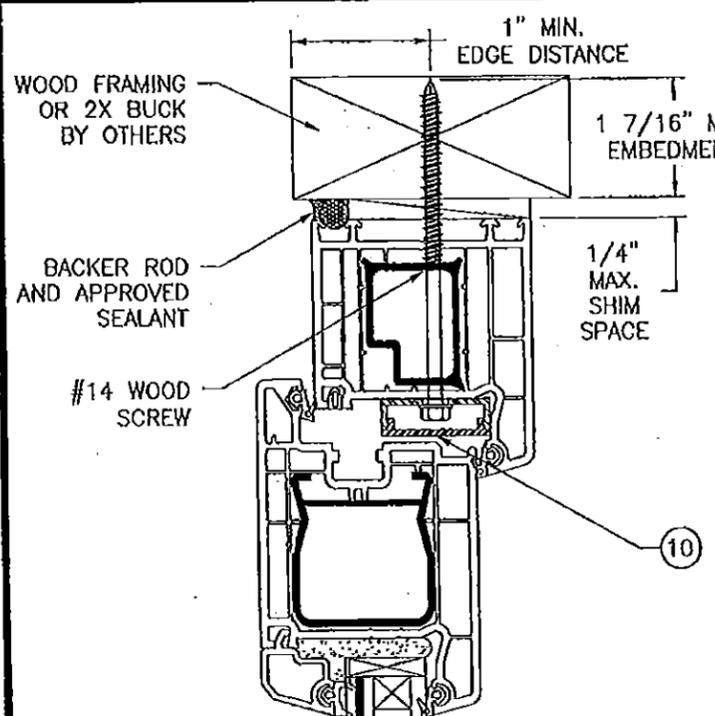


EXTERIOR INTERIOR

APPROVED SEALANT  
WOOD FRAMING OR 2X BUCK BY OTHERS  
3/8" BED OF CONSTRUCTION SEALANT SEE NOTE 14 SHEET 1

**VERTICAL CROSS SECTION**  
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTES:  
- SEALANT AND BACKER ROD MATERIAL AND JOINT DESIGN BY OTHERS.  
- INTERIOR AND EXTERIOR FINISHES BY OTHERS OMITTED FOR CLARITY.

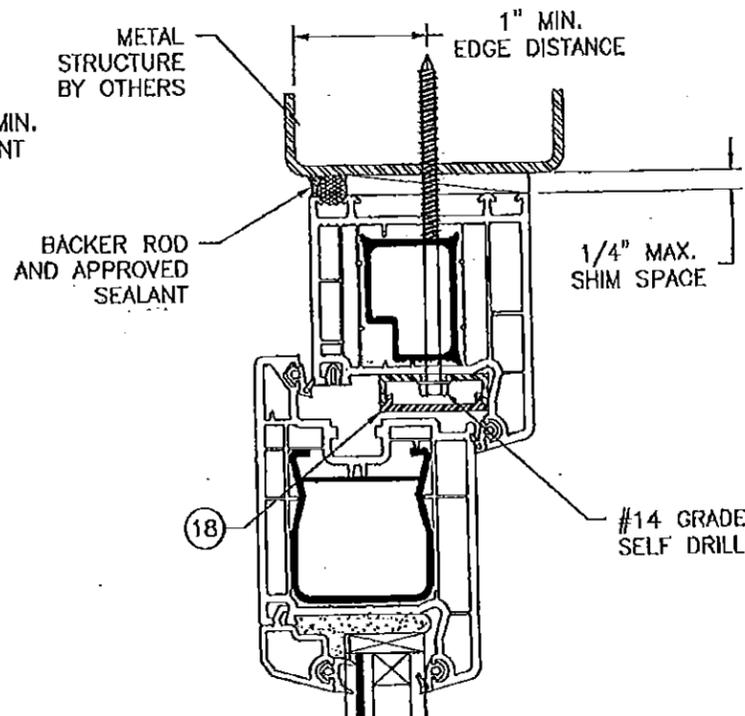


EXTERIOR INTERIOR


APPROVED SEALANT  
METAL STRUCTURE BY OTHERS  
3/8" BED OF CONSTRUCTION SEALANT SEE NOTE 14 SHEET 1

**VERTICAL CROSS SECTION**  
METAL STRUCTURE INSTALLATION

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. **15-0723.14**  
Expiration Date **02/06/2019**  
By *[Signature]*  
Miami-Dade Product Control

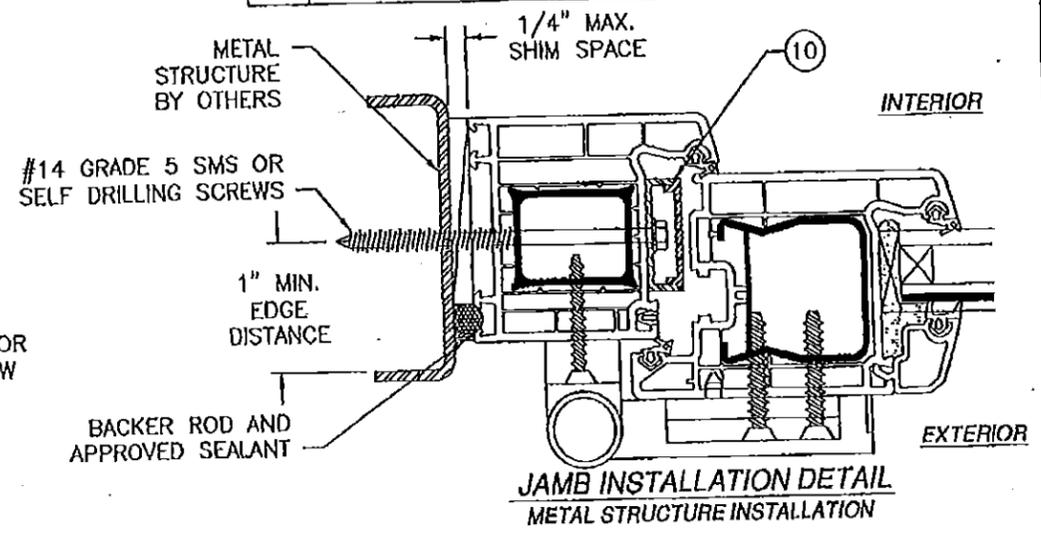

**JAMB INSTALLATION DETAIL**  
METAL STRUCTURE INSTALLATION

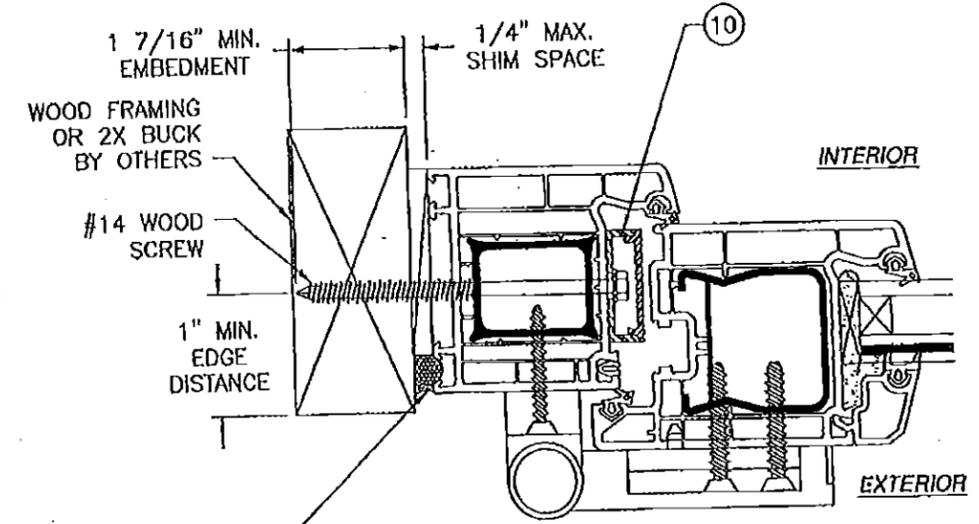

**JAMB INSTALLATION DETAIL**  
WOOD FRAMING OR 2X BUCK INSTALLATION


SIGNED: 10/03/2013

Approved as complying with the Florida Building Code  
Date *2/6/19*  
NOA *15-0723.14*  
Miami-Dade Product Control  
*[Signature]*



**WinDoor**  
INCORPORATED  
7500 AMSTERDAM DRIVE  
ORLANDO, FL 32832  
Phone: 407.481.8400  
Fax: 407.481.0505  
www.windoorinc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
WITH STANDARD AND LOW PROFILE SILLS  
INSTALLATION DETAILS


DRAWN: V.L. DWG NO. 08-01766 REV C  
SCALE NTS DATE 9/10/12 SHEET 4 OF 10

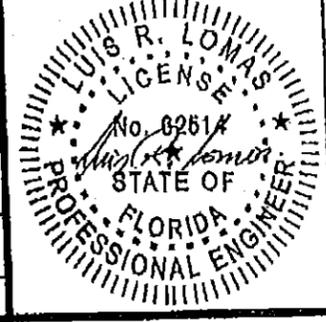

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

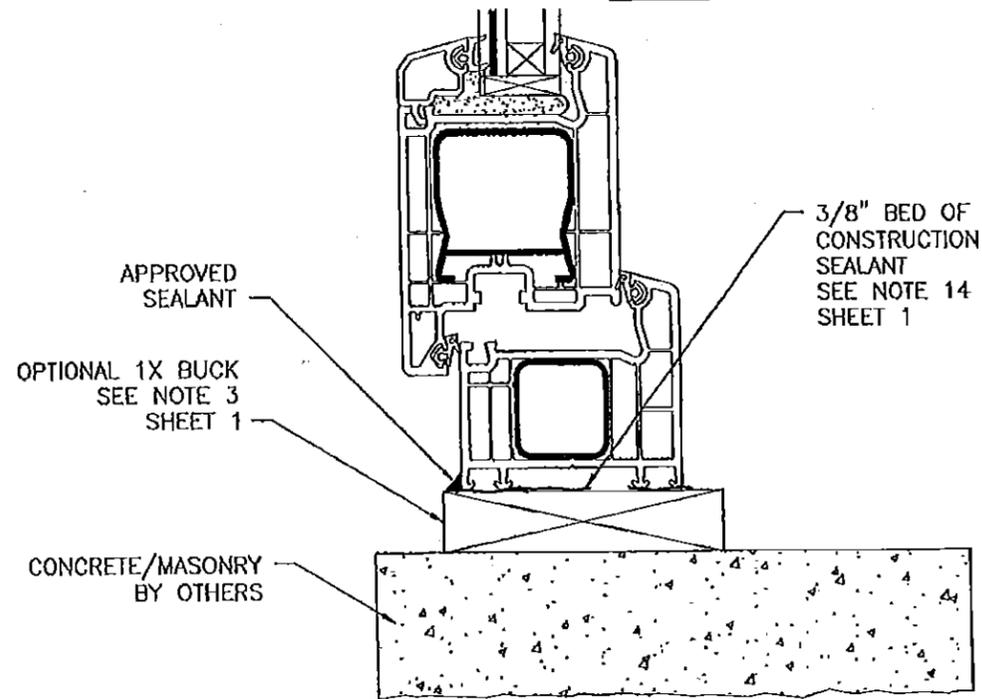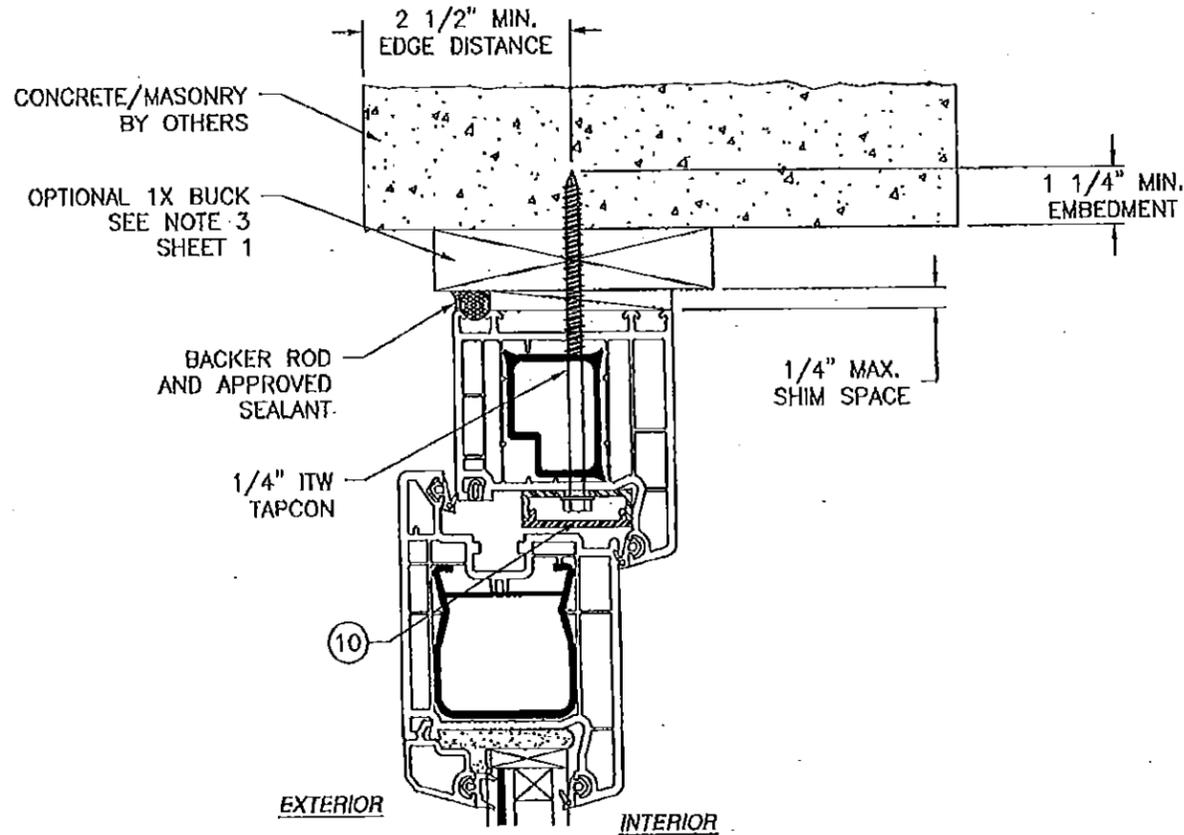

**VERTICAL CROSS SECTION  
CONCRETE/MASONRY INSTALLATION**

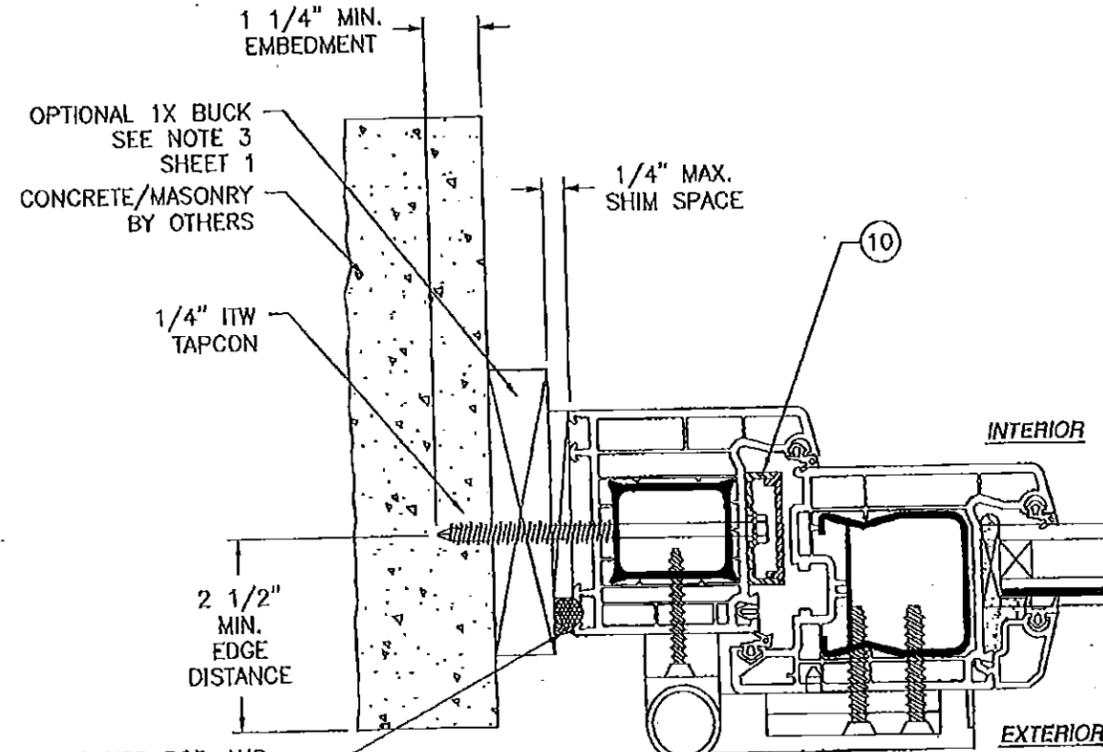

**JAMB INSTALLATION DETAIL  
CONCRETE/MASONRY INSTALLATION**

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **15-0723.14**

Expiration Date **02/06/2019**

By *[Signature]*  
Miami-Date Product Control

NOTES:  
- SEALANT AND BACKER ROD MATERIAL AND JOINT DESIGN BY OTHERS.  
- INTERIOR AND EXTERIOR FINISHES BY OTHERS OMITTED FOR CLARITY.

SIGNED: 10/03/2013


Approved as complying with the  
Florida Building Code  
Date *2/6/14*  
NOA *13-0711-01*  
Miami-Date Product Control  
By *[Signature]*

**WinDoor**  
INCORPORATED


7500 AMSTERDAM DRIVE  
ORLANDO, FL 32832  
Phone: 407.491.2400  
Fax: 407.481.0505 www.windoorinc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
WITH STANDARD AND LOW PROFILE SILLS  
INSTALLATION DETAILS


DRAWN: V.L.	DWG NO. 08-01766	REV C
SCALE NTS	DATE 9/10/12	SHEET 5 OF 10

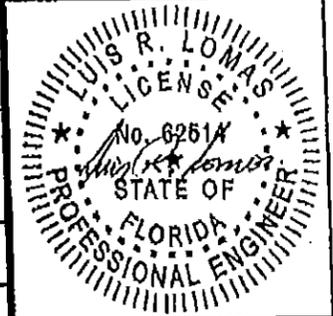


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

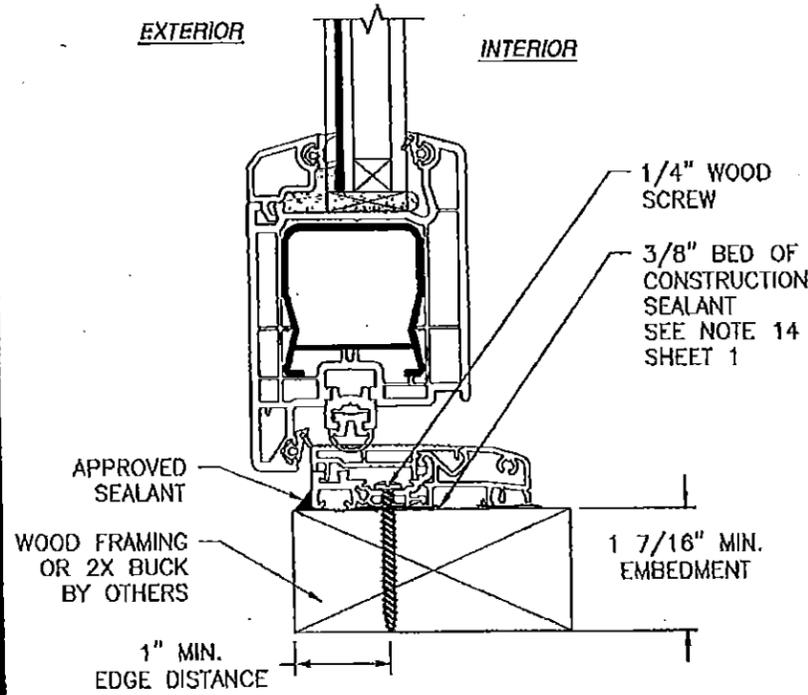

**VERTICAL CROSS SECTION**  
**WOOD FRAMING OR 2X BUCK INSTALLATION**  
 LOW PROFILE SILL SHOWN  
 FOR HEAD & JAMB INSTALLATION REFER TO SHEETS 4 & 5

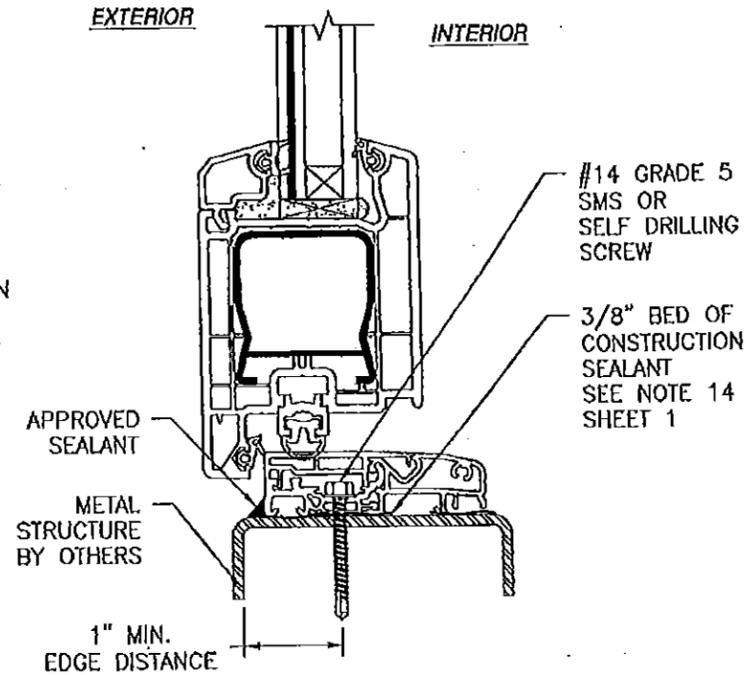

**VERTICAL CROSS SECTION**  
**METAL STRUCTURE INSTALLATION**  
 LOW PROFILE SILL SHOWN  
 FOR HEAD & JAMB INSTALLATION REFER TO SHEETS 4 & 5

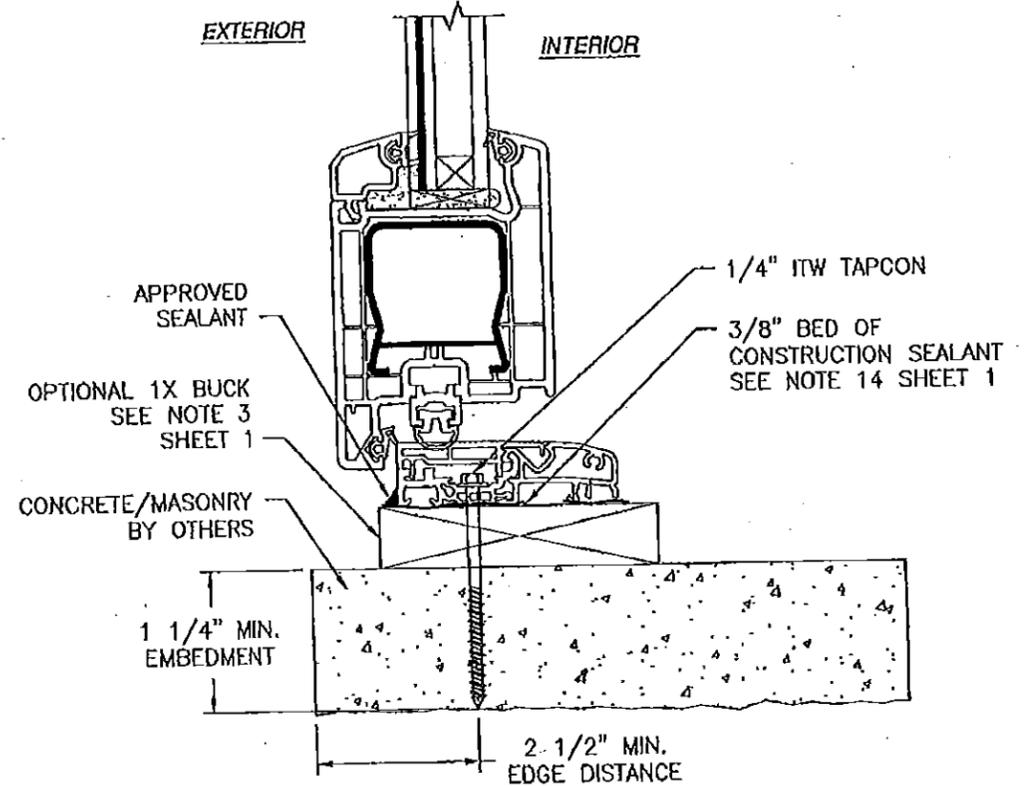

**VERTICAL CROSS SECTION**  
**CONCRETE/MASONRY INSTALLATION**  
 LOW PROFILE SILL SHOWN  
 FOR HEAD & JAMB INSTALLATION REFER TO SHEETS 4 & 5


SIGNED: 10/03/2013

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 NOA-No. **15-0723.14**  
 Expiration Date **02/06/2019**  
 By *[Signature]*  
 Miami-Dade Product Control


Approved as complying with the Florida Building Code Date <i>2/6/14</i> NOA# <i>15-0723.14</i> Miami-Dade Product Control By <i>[Signature]</i>	<b>WinDoor</b> INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.2400 Fax: 407.481.0905 www.win-door-inc.com	
	<b>V-800 VINYL OUT-SWING SINGLE DOOR WITH STANDARD AND LOW PROFILE SILLS INSTALLATION DETAILS</b>	
DRAWN: V.L. SCALE NTS	DWG NO. 08-01766 DATE 9/10/12	REV C SHEET 6 OF 10

NOTES:  
 - SEALANT AND BACKER ROD MATERIAL AND JOINT DESIGN BY OTHERS.  
 - INTERIOR AND EXTERIOR FINISHES BY OTHERS OMITTED FOR CLARITY.


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

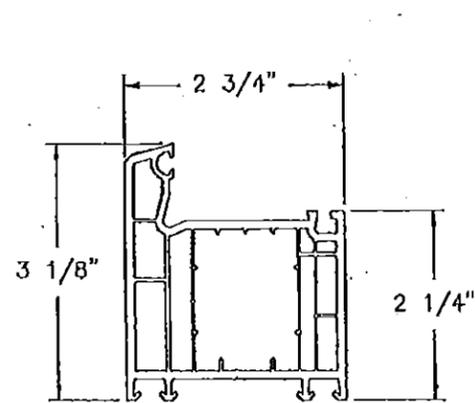


① **FRAME**  
RIGID PVC .110" THICK

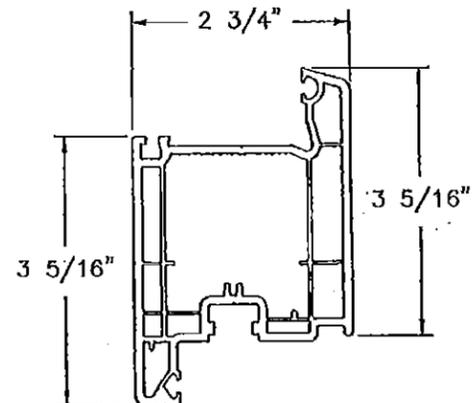


② **SASH**  
RIGID PVC .110" THICK

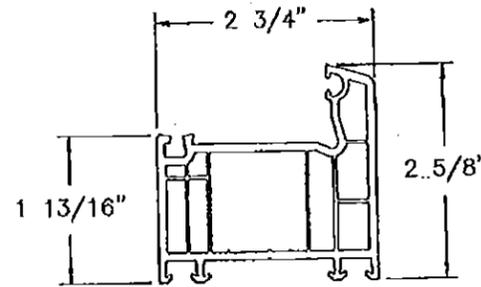


⑤ **FRAME SILL**  
RIGID PVC .110" THICK

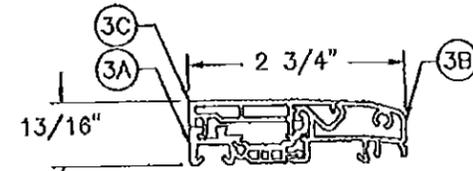


③ **LOW PROFILE SILL ASSEMBLY**




⑬ **GLAZING BEAD**  
RIGID PVC .075" THICK




⑦ **REINFORCEMENT**  
ALUMINUM 6005-T61 .080" THICK



⑧ **REINFORCEMENT**  
ALUMINUM 6005-T61 .080" THICK




⑮ **REINFORCEMENT**  
ALUMINUM 6005-T61 .080" THICK

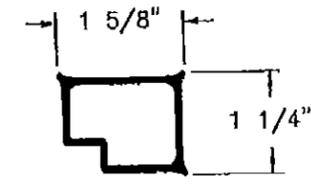


⑥ **REINFORCEMENT**  
ALUMINUM 6005-T61 .080" THICK


③ **SUBASSEMBLY PARTS**



③C **SILL COVER PART C**  
RIGID PVC .059" THICK



③A **SILL PART A**  
ALUMINUM 6063-T6 .079" THICK.




③B **SILL PART B**  
ALUMINUM 6060-T66 .059" THICK.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **15-0723.14**  
Expiration Date **02/06/2019**  
By *[Signature]*  
Miami-Date Product Control


SIGNED: 10/03/2013

Approved as complying with the Florida Building Code Date: <i>2/6/14</i> NOA: <i>15-0723.14</i> Miami-Date Product Control By: <i>[Signature]</i>	<b>WinDoor</b> INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0305 www.windoorinc.com	
	<b>V-800 VINYL OUT-SWING SINGLE DOOR WITH STANDARD AND LOW PROFILE SILLS COMPONENTS</b>	
DRAWN: V.L.	DWG NO. 08-01766	REV C
SCALE NTS	DATE 9/10/12	SHEET 7 OF 10

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

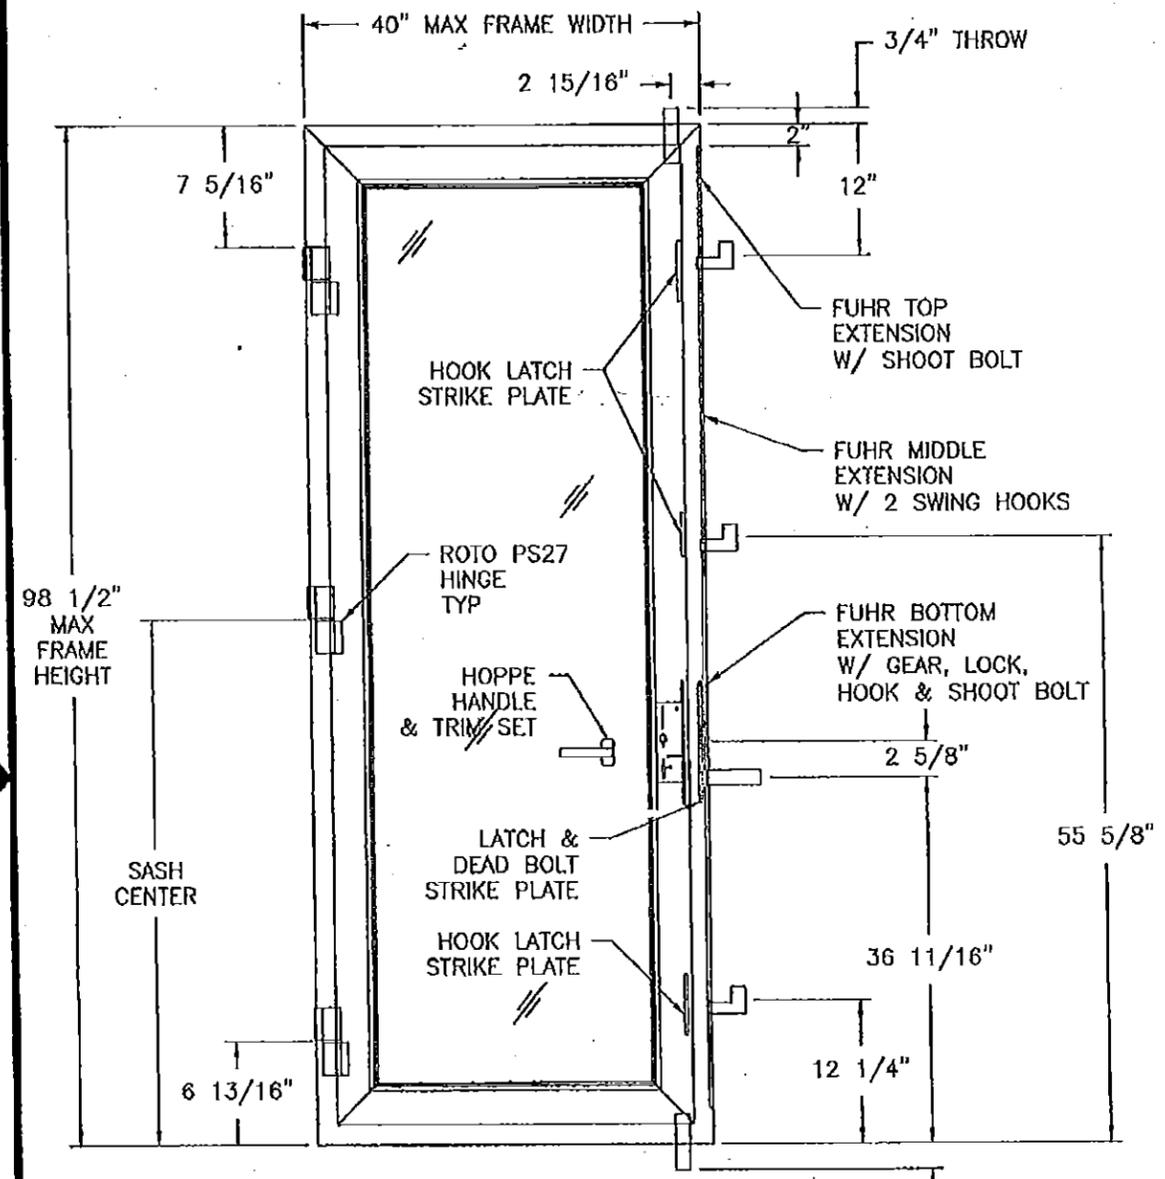

**DOOR HARDWARE LAYOUT  
W/ STANDARD SILL**

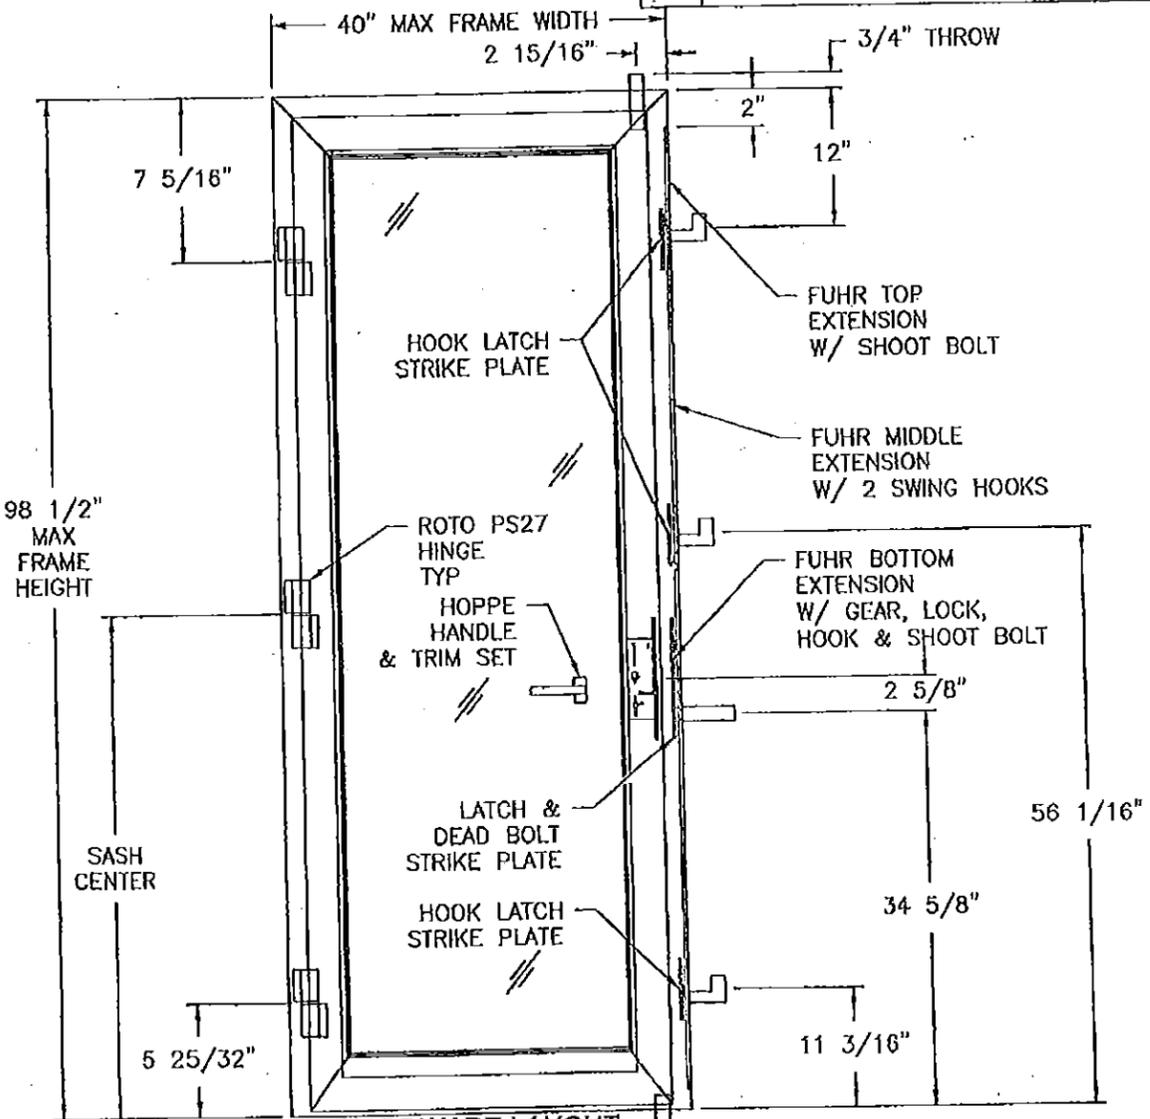

**HARDWARE LAYOUT  
W/ LOW PROFILE SILL**

SIGNED: 10/03/2013


**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **15-0723.14**  
Expiration Date **02/06/2019**  
By *[Signature]*  
Miami-Dade Product Control


Approved as complying with the  
Florida Building Code  
Date *10/03/13*  
NOA *15-0723.14*  
By *[Signature]*  
Miami-Dade Product Control

**WinDoor**  
INCORPORATED  
7500 AMSTERDAM DRIVE  
ORLANDO, FL 32832  
Phone: 407.481.8400  
Fax: 407.481.0505  
www.windoorinc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
WITH STANDARD AND LOW PROFILE SILLS  
HARDWARE LOCATIONS

DRAWN: V.L. DWG NO. 08-01766 REV C  
SCALE NTS DATE 9/10/12 SHEET 8 OF 10

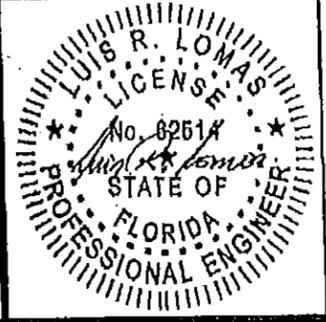


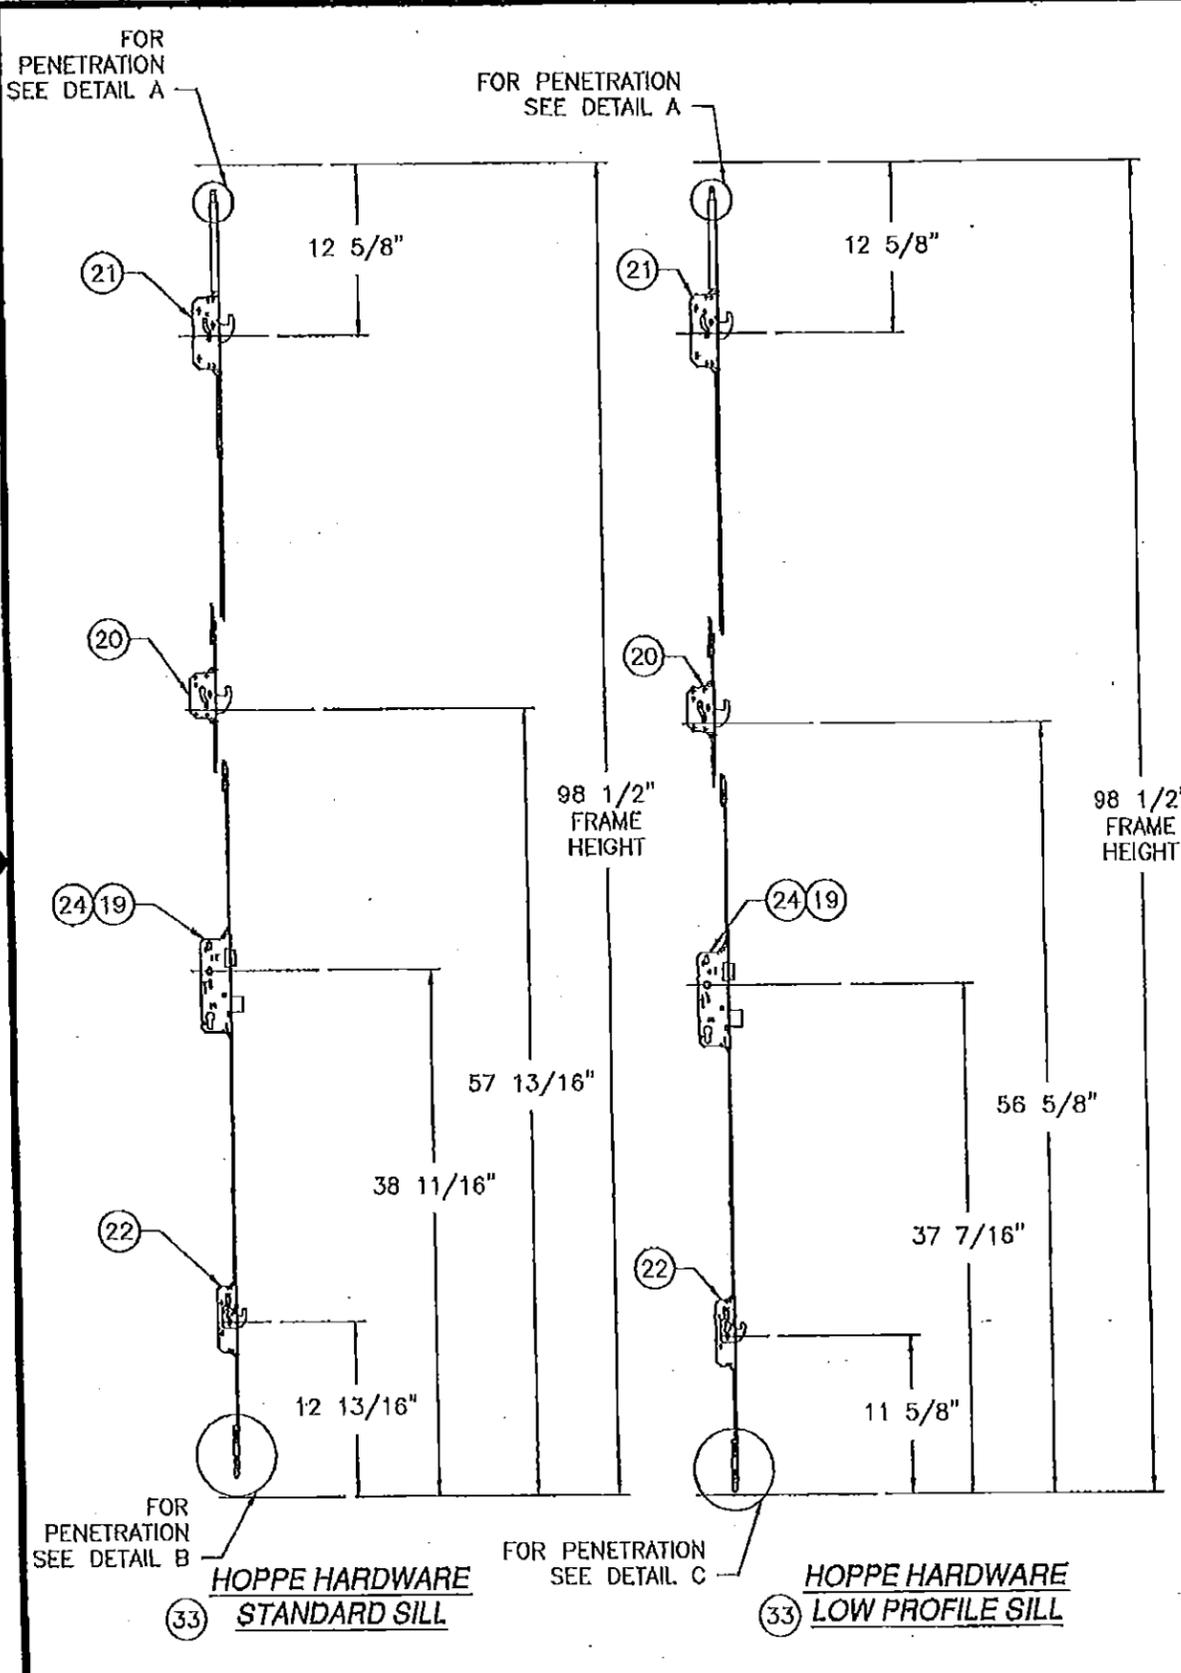

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **15-0723.14**  
 Expiration Date **02/06/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

HOPPE HARDWARE SUB-PARTS OF ITEM #33				
NO.	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
19	02472-410	DOOR HANDLE	HOPPE	HOPPE HARDWARE
20	3683679	MIDDLE EXTENSION HOOK	FUHR	HOPPE HARDWARE
21	8787247	TOP EXTENSION HOOK	FUHR	HOPPE HARDWARE
22	3683556	GEAR	FUHR	HOPPE HARDWARE
23	3683661	SWING HOOK STRIKE	FUHR	HOPPE HARDWARE
24	3583002	LATCH & DEADBOLT STRIKE	FUHR	HOPPE HARDWARE
25	3434373	SHOOTBOLT STRIKE	FUHR	HOPPE HARDWARE
26	3683644	UNDERPLATE	FUHR	HOPPE HARDWARE
27	3683652	UNDERPLATE	FUHR	HOPPE HARDWARE

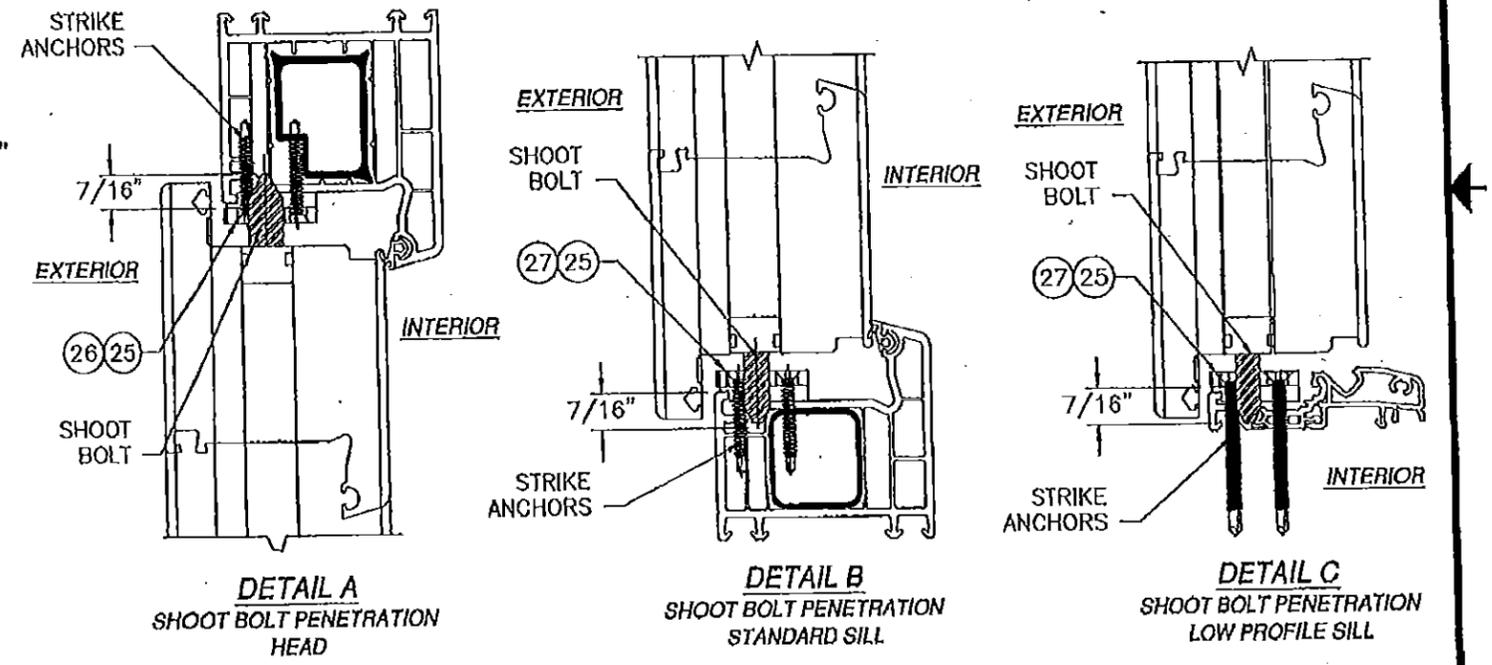


SIGNED: 10/03/2013

Approved as complying with the Florida Building Code  
 Date *2/6/14*  
 By *[Signature]*  
 Miami-Dade Product Control


**WinDoor INCORPORATED**  
 7500 AMSTERDAM DRIVE  
 ORLANDO, FL 32832  
 Phone: 407.481.8400  
 Fax: 407.481.0305  
 www.windoorinc.com

V-800 VINYL OUT-SWING SINGLE DOOR  
 WITH STANDARD AND LOW PROFILE SILLS  
 HARDWARE LOCATIONS


DRAWN: V.L. DWG NO. 08-01766 REV C  
 SCALE NTS DATE 9/10/12 SHEET 9 OF 10

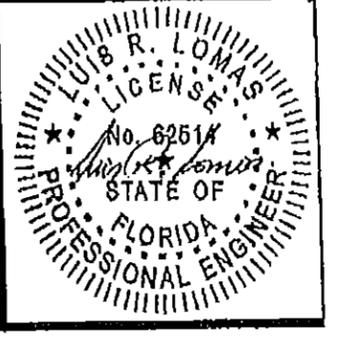




REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/13	R.L.
B	REVISED PER MD COMMENTS	07/15/13	R.L.
C	REVISED PER MD COMMENTS	10/01/13	R.L.

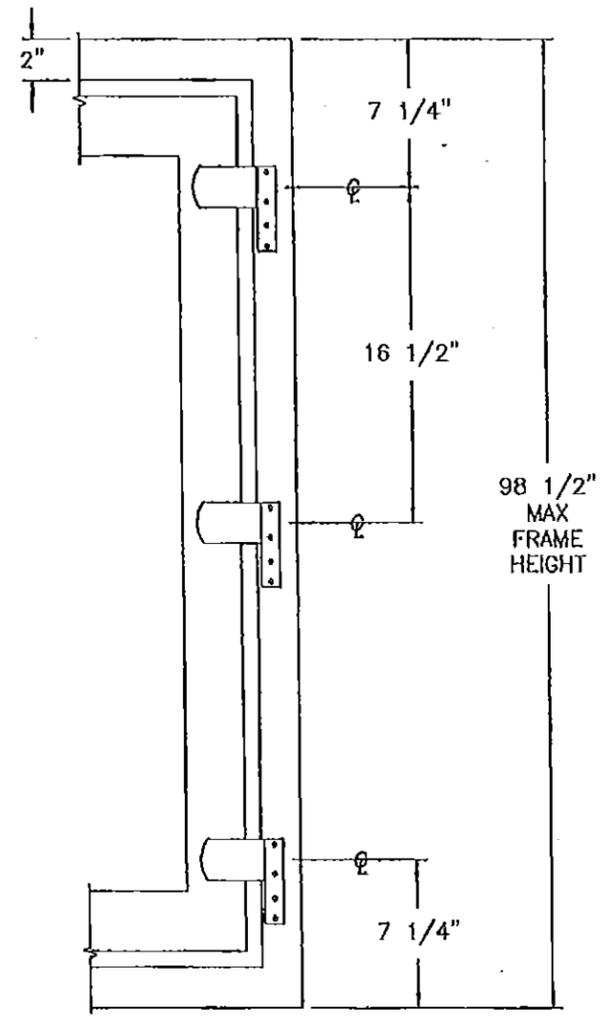

HINGE LOCATION WITH STANDARD SILL

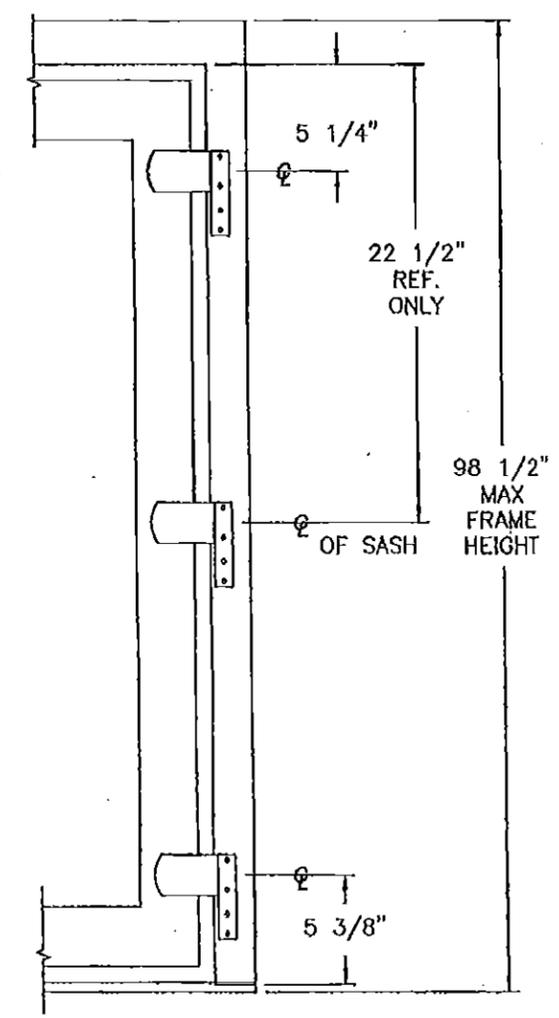

HINGE LOCATION LOW PROFILE SILL

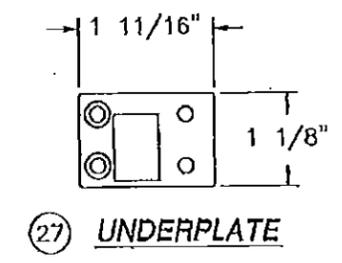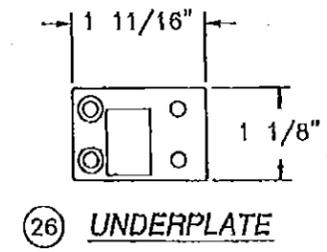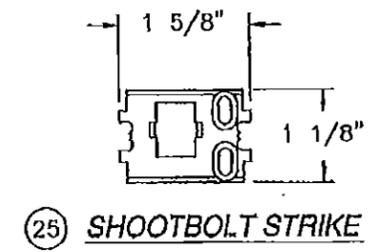

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 NOA-No. **15-0723.14**  
 Expiration Date **02/06/2019**  
 By *[Signature]*  
 Miami-Date Product Control

Approved as complying with the Florida Building Code  
 Date: *2/6/14*  
 NOA# *13-210-01*  
 Miami-Date Product Control  
 By: *[Signature]*

**WinDoor INCORPORATED**  
 7500 AMSTERDAM DRIVE  
 ORLANDO, FL 32832  
 Phone: 407.481.8100  
 Fax: 407.481.0505  
 www.win-door-inc.com

V-800 VINYL OUT-SWING SINGLE DOOR WITH STANDARD AND LOW PROFILE SILLS HINGE LOCATIONS

DRAWN: V.L. DWG NO. 08-01766 REV C

SCALE NTS DATE 9/10/12 SHEET 10 OF 10

SIGNED: 10/03/2013

