



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

WinDoor, Inc.
7500 Amsterdam Drive
Orlando, FL 32832

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.-

DESCRIPTION: Series "3000" Aluminum Fixed Window - S.M.I.

APPROVAL DOCUMENT: Drawing No. 08-02215, titled "3000 Aluminum Fixed Window Impact – SGP – HVHZ – Equal Leg and Flange SMI", sheets 1 through 8 of 8, dated 06/21/13, with revision B dated 03/03/164, prepared by manufacturer, signed and sealed by Luis R. Lomas, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA# 13-1121.10 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



MP
3/30/16

NOA No. 15-0723.19
Expiration Date: April 03, 2019
Approval Date: April 07, 2016
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under previous NOA No. 13-1121.10)
2. Drawing No. **08-02215**, titled "3000 Aluminum Fixed Window Impact – SGP – HVHZ – Equal Leg and Flange SMP", sheets 1 through 8 of 8, dated 06/21/13, with revision B dated 03/03/16, prepared by manufacturer, signed and sealed by Luis R. Lomas, P.E.
(Submitted under previous NOA No. 13-1121.10)

B. TESTS

1. Test reports on:
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
 - 5) Small Missile Impact Test per FBC, TAS 201-94
 - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94along with marked-up drawings and installation diagram of a series 3000 aluminum fixed window, prepared by National Certified Testing Laboratories, Test Report No. **NCTL-210-3882-01**, dated 09/05/13 and revised on 02/21/14, signed and sealed by Gerard J. Ferrara, P.E.
(Submitted under previous NOA No. 13-1121.10)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC-5th Edition (2014)**, dated 06/09/15, prepared by manufacturer, signed and sealed by Luis R. Lomas, P.E.
2. Glazing complies with **ASTM E1300-04**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **14-0916.11** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 06/25/15, expiring on 07/04/18.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 15-0723.19
Expiration Date: April 03, 2019
Approval Date: April 07, 2016

WinDoor, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC-5th Edition (2014)**, and of no financial interest, dated June 9, 2015, issued by manufacturer, signed and sealed by Luis R. Lomas, P.E.

G. OTHERS

1. Notice of Acceptance No. **13-1121.10**, issued to WinDoor, Inc. for their Series "3000" Aluminum Fixed Window - S.M.I. approved on 04/03/14 and expiring on 04/03/19.



Manuel Perez, P.E.
Product Control/Examiner
NOA No. 15-0723.19

Expiration Date: April 03, 2019
Approval Date: April 07, 2016

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

NOTES:


1. THE PRODUCT SHOWN HEREIN IS DESIGNED AND MANUFACTURED TO COMPLY WITH REQUIREMENTS OF THE FLORIDA BUILDING CODE 5th EDITION (2014) INCLUDING THE HVHZ.
2. WOOD FRAMING AND MASONRY OPENING TO BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO STRUCTURE. FRAMING AND MASONRY OPENING IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X BUCK OVER MASONRY/CONCRETE IS OPTIONAL. WHERE 1X BUCK IS NOT USED DISSIMILAR MATERIALS MUST BE SEPARATED WITH APPROVED COATING OR MEMBRANE. SELECTION OF COATING OR MEMBRANE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. ALLOWABLE STRESS INCREASE OF 1/3 WAS NOT USED IN THE DESIGN OF THE PRODUCT SHOWN HEREIN. WIND LOAD DURATION FACTOR Cd=1.6 WAS USED FOR WOOD ANCHOR CALCULATIONS.
5. FRAME MATERIAL: ALUMINUM 6063-T6
6. UNITS MUST BE GLAZED PER ASTM E1300-04, SEE SHEET 3 FOR GLASS DETAILS.
7. APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED FOR THIS PRODUCT IN WIND BORNE DEBRIS REGIONS.
8. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM. SHIM WHERE SPACE OF 1/16" OR GREATER OCCURS. MAXIMUM ALLOWABLE SHIM STACK TO BE 1/4".
9. FOR ANCHORING INTO WOOD FRAMING OR 2X BUCK USE #14 CUT-THREAD WOOD SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 7/16" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 5/8" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
10. FOR ANCHORING INTO MASONRY/CONCRETE USE 1/4" ELCO CRETE-FLEX TAPCONS WITH SUFFICIENT LENGTH TO ACHIEVE A 1 1/4" MINIMUM EMBEDMENT INTO SUBSTRATE WITH 2 1/2" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
11. FOR ANCHORING INTO METAL STRUCTURE USE #14 SMS OR SELF DRILLING SCREWS WITH SUFFICIENT LENGTH TO ACHIEVE 3 THREADS MINIMUM BEYOND STRUCTURE INTERIOR WALL WITH 1" MINIMUM EDGE DISTANCE. LOCATE ANCHORS AS SHOWN IN ELEVATIONS AND INSTALLATION DETAILS.
12. ALL FASTENERS TO BE CORROSION RESISTANT.
13. INSTALLATION ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH ANCHOR MANUFACTURER'S INSTALLATION INSTRUCTIONS AND ANCHORS SHALL NOT BE USED IN SUBSTRATES WITH STRENGTHS LESS THAN THE MINIMUM STRENGTH SPECIFIED BELOW:
 - A. WOOD - MINIMUM SPECIFIC GRAVITY OF G=0.42
 - B. CONCRETE - MINIMUM COMPRESSIVE STRENGTH OF 3,192 PSI.
 - C. MASONRY - STRENGTH CONFORMANCE TO ASTM C-90, GRADE N, TYPE 1 (OR GREATER).
 - D. METAL STRUCTURE: STEEL 16GA, 33KSI OR ALUMINUM 6063-T5 1/8" THICK MINIMUM

SIGNED: 03/03/2016

TABLE OF CONTENTS	
SHEET NO.	DESCRIPTION
1	NOTES
2	ELEVATIONS AND ANCHORING
3	B.O.M., CROSS SECTIONS & GLAZING DETAILS
4 - 7	INSTALLATION DETAILS
8	COMPONENTS

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 15-0723.19 Expiration Date April 3, 2019 By <i>Manuel Perez</i> Miami Dade Product Control	WinDoor INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0505 www.windoorinc.com	
	3000 ALUMINUM FIXED WINDOW IMPACT SGP - HVHZ - EQUAL LEG AND FLANGE SMI NOTES	
DRAWN: V.L.	DWG NO. 08-02215	REV B
SCALE NTS	DATE 06/21/2013	SHEET 1 OF 8

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

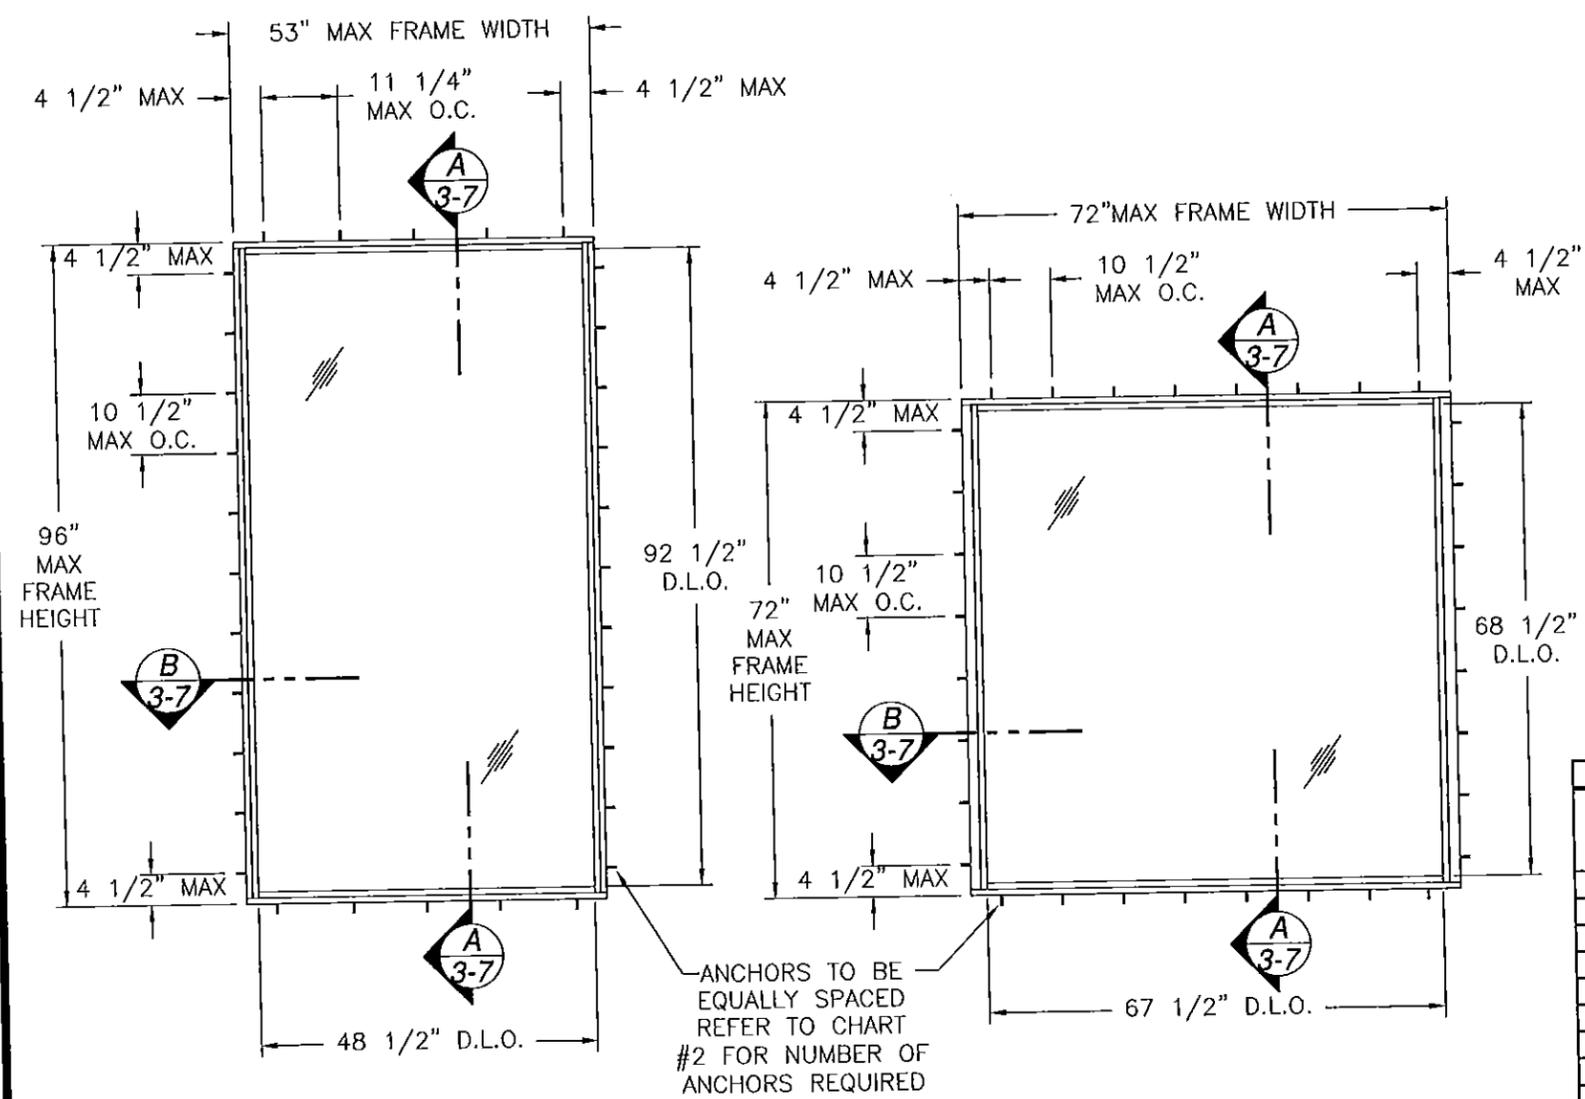

3000 ALUMINUM FIXED WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±110.0PSF	LARGE AND SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4 AND HVHZ
REFER TO CHART #1 FOR ADDITIONAL UNIT RATINGS

3000 ALUMINUM FIXED WINDOW
EXTERIOR VIEW

DESIGN PRESSURE RATING	IMPACT RATING
±120.0PSF	LARGE AND SMALL MISSILE IMPACT

MISSILE LEVEL D, WIND ZONE 4 AND HVHZ
REFER TO CHART #1 FOR ADDITIONAL UNIT RATINGS

CHART #1

		Design pressure rating (psf)															
		Frame width (in)															
Frame Height (in)	30.0		36.0		42.0		48.0		53.0		60.0		66.0		72.0		
	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	Pos	Neg	
30.0	120.0	139.6	120.0	138.0	120.0	136.3	120.0	134.7	120.0	133.3	120.0	131.4	120.0	129.7	120.0	128.1	
36.0	120.0	138.0	120.0	137.8	120.0	135.8	120.0	133.9	120.0	132.2	120.0	129.9	120.0	127.9	120.0	125.9	
42.0	120.0	136.3	120.0	135.8	120.0	135.7	120.0	133.4	120.0	131.4	120.0	128.7	120.0	126.4	120.0	124.1	
48.0	120.0	134.7	120.0	133.9	120.0	133.4	120.0	133.2	120.0	131.0	120.0	127.9	120.0	125.3	120.0	122.8	
54.0	120.0	133.0	120.0	131.9	120.0	131.0	120.0	130.6	120.0	130.4	120.0	127.5	120.0	124.5	120.0	121.5	
60.0	120.0	131.4	120.0	129.9	120.0	128.7	120.0	127.9	120.0	127.5	120.0	127.3	120.0	124.0	120.0	120.7	
66.0	120.0	129.7	120.0	127.9	120.0	126.4	120.0	125.3	120.0	124.6	120.0	124.0	120.0	123.8	120.0	120.2	
72.0	120.0	128.1	120.0	126.9	120.0	124.1	120.0	122.6	120.0	121.7	120.0	120.7	120.0	120.2	120.0	120.0	
78.0	120.0	126.4	120.0	124.0	120.0	121.8	120.0	120.0	118.7	118.7	117.4	117.4	116.5	-	-	-	
84.0	120.0	124.8	120.0	122.0	119.5	119.5	117.4	117.4	115.8	115.8	114.1	114.1	-	-	-	-	
90.0	120.0	123.1	120.0	120.0	117.2	117.2	114.7	114.7	112.9	112.9	-	-	-	-	-	-	
96.0	120.0	121.5	118.0	118.0	114.9	114.9	112.1	112.1	110.0	110.0	-	-	-	-	-	-	
102.0	119.8	119.8	116.0	116.0	112.6	112.6	109.4	109.4	-	-	-	-	-	-	-	-	
108.0	118.2	118.2	114.1	114.1	110.3	110.3	106.8	106.8	-	-	-	-	-	-	-	-	
114.0	116.5	116.5	112.1	112.1	108.0	108.0	-	-	-	-	-	-	-	-	-	-	
120.0	114.9	114.9	110.1	110.1	105.7	105.7	-	-	-	-	-	-	-	-	-	-	

CHART #2

		Number of anchors required															
		Frame width (in)															
Frame Height (in)	30.0		36.0		42.0		48.0		53.0		60.0		66.0		72.0		
	H&S	Jamb	H&S	Jamb	H&S	Jamb	H&S	Jamb	H&S	Jamb	H&S	Jamb	H&S	Jamb	H&S	Jamb	
30.0	3	3	4	3	4	3	5	3	5	3	6	3	7	3	7	3	
36.0	3	4	4	4	4	4	5	4	5	4	6	4	7	4	7	4	
42.0	3	5	4	5	4	5	5	5	5	5	6	5	7	5	8	5	
48.0	3	5	4	5	4	5	5	5	5	5	6	6	7	6	8	6	
54.0	3	6	4	6	4	6	5	6	5	6	6	6	7	6	8	6	
60.0	3	6	4	6	4	6	5	6	5	6	6	6	7	6	8	6	
66.0	3	7	4	7	4	7	5	7	5	7	6	7	7	7	8	7	
72.0	3	7	4	7	4	7	5	8	5	8	6	8	7	8	8	7	
78.0	3	8	4	8	4	8	5	8	5	9	6	9	7	9	-	-	
84.0	3	8	4	8	4	9	5	9	5	10	6	10	-	-	-	-	
90.0	3	9	4	9	4	9	5	10	5	10	-	-	-	-	-	-	
96.0	3	9	4	9	4	10	5	10	5	11	-	-	-	-	-	-	
102.0	3	10	4	10	4	10	5	11	-	-	-	-	-	-	-	-	
108.0	3	11	4	11	4	11	5	12	-	-	-	-	-	-	-	-	
114.0	3	11	4	11	4	11	-	-	-	-	-	-	-	-	-	-	
120.0	3	12	4	12	4	12	-	-	-	-	-	-	-	-	-	-	

SIGNED: 03/03/2016

PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 15-0723.19
Expiration Date April 9, 2019
By *Manuel Torres*
Miami Dade Product Control

WinDoor
INCORPORATED
7500 AMSTERDAM DRIVE
ORLANDO, FL 32832
Phone: 407.481.8400
Fax: 407.481.0505
www.windoorinc.com

3000 ALUMINUM FIXED WINDOW IMPACT
SGP - HVHZ - EQUAL LEG AND FLANGE SMI
ELEVATIONS AND ANCHORING


DRAWN: V.L.	DWG NO. 08-02215	REV B
----------------	---------------------	----------

SCALE NTS DATE 06/21/2013 SHEET 2 OF 8




BILL OF MATERIALS				
ITEM NO.:	PART NUMBER	DESCRIPTION	MANUFACTURER	MATERIAL
1	FS-07419	FRAME HEAD AND SILL EQUAL LEG	KEYMARK	ALUMINUM 6063-T6
2	FS-06614	FRAME JAMB EQUAL LEG	KEYMARK	ALUMINUM 6063-T6
3	FS-07418	FRAME HEAD AND SILL FLANGE	KEYMARK	ALUMINUM 6063-T6
4	FS-06663	FRAME JAMB FLANGE	KEYMARK	ALUMINUM 6063-T6
5	FS-06671	HEAD FILLER	KEYMARK	ALUMINUM 6063-T6
6	FS-5910	SILL RETAINER	KEYMARK	ALUMINUM 6063-T6
7	FS-04501	JAMB TRACK RECESSED COVER	KEYMARK	ALUMINUM 6063-T6
8	FS-07175	9/16" GLASS STOP	KEYMARK	ALUMINUM 6063-T6
9	FS-07353	1" GLASS STOP	KEYMARK	ALUMINUM 6063-T6
10	4000SH-BL-TP1152	GLASS VINYL	TEAM PLASTICS	
11	4000SH-BL-TP1104	GLASS VINYL		
12	FS-04501	COVER FOR INSTALLATION CREWS		
13	121104	GLAS SHIM 85 DUROMETER	FRANK LOWE	
14	SIKA 552	URETHANE SEALANT	SIKA	
15	DOW 995	SILICONE	DOW CORNING	

#8 X 3/4" SMS OR SELF DRILLING SCREW

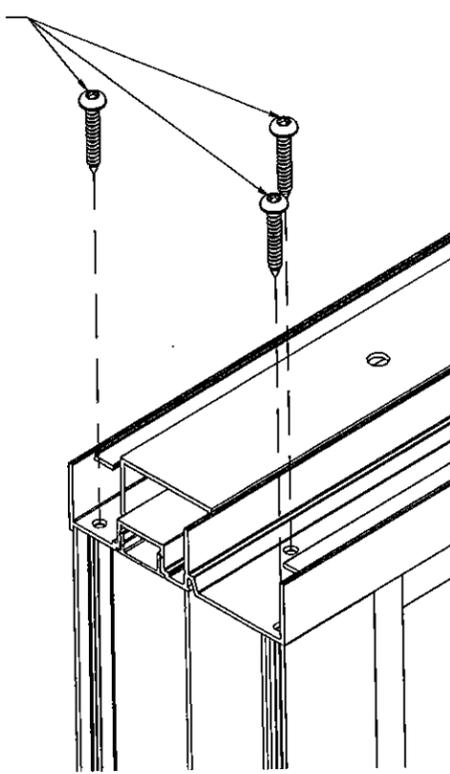


CORNER DETAIL


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

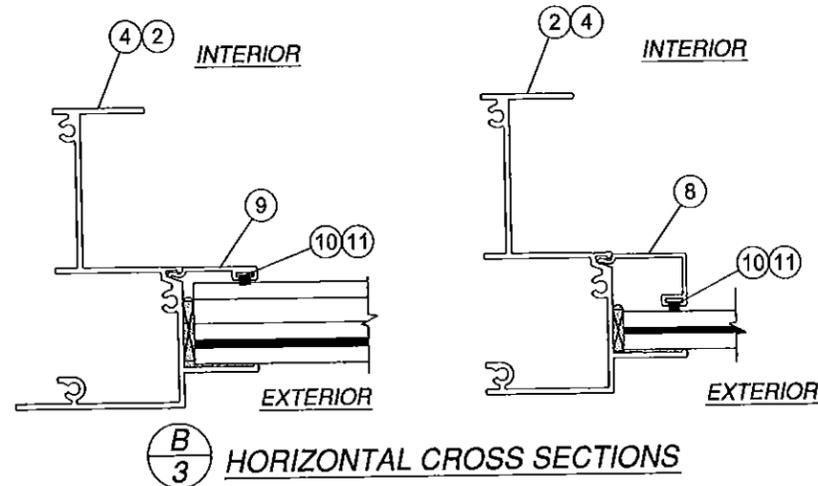


$\frac{B}{3}$ HORIZONTAL CROSS SECTIONS

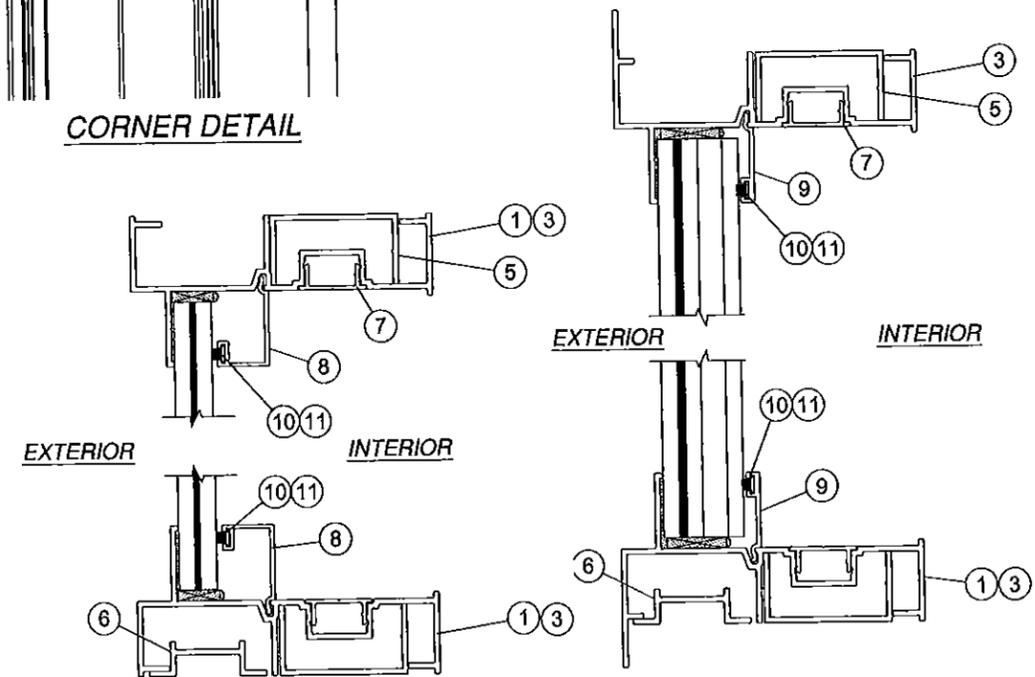

$\frac{A}{3}$ VERTICAL CROSS SECTIONS

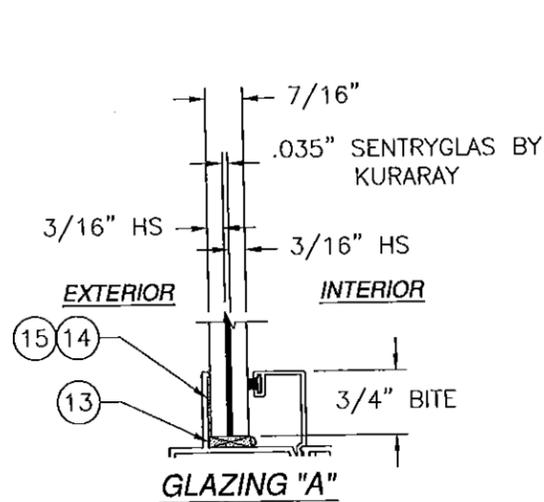

GLAZING "A"

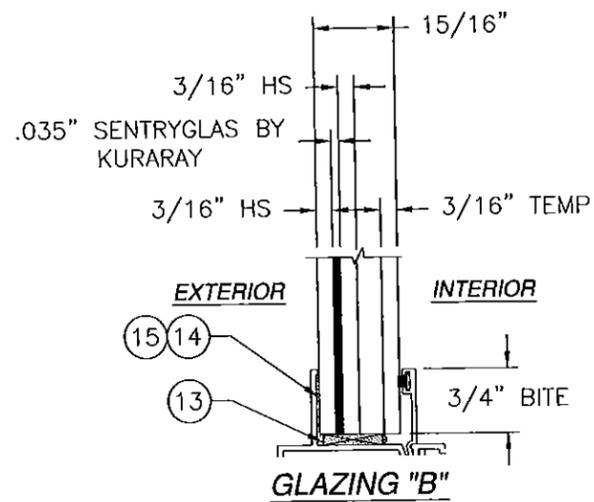

GLAZING "B"

SIGNED: 03/03/2016


PRODUCT REVISED as complying with the Florida Building Code
 Acceptance No. 15-0723.19
 Expiration Date Apr 13, 2019
 By Manuel Ferrer
 Miami Dade Product Control

WinDoor
INCORPORATED


7500 AMSTERDAM DRIVE
 ORLANDO, FL 32832
 Phone: 407.481.8400
 Fax: 407.481.0505
 www.windoorinc.com

3000 ALUMINUM FIXED WINDOW IMPACT
 SGP - HVHZ - EQUAL LEG AND FLANGE SMI
 B.O.M., CROSS SECTIONS & GLAZING DETAILS


DRAWN: V.L.	DWG NO. 08-02215	REV B
SCALE NTS	DATE 06/21/2013	SHEET 3 OF 8

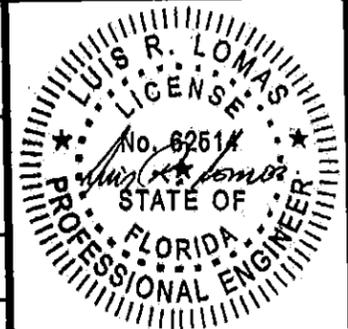


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

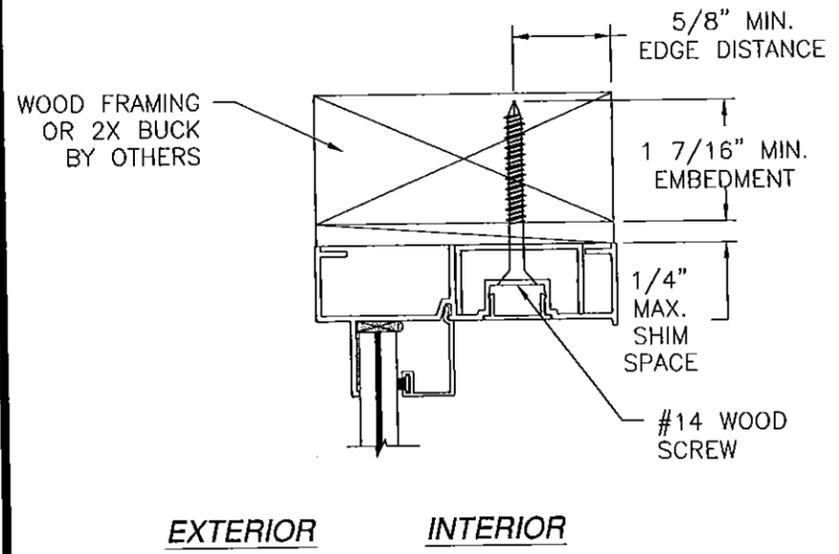


A
4 VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

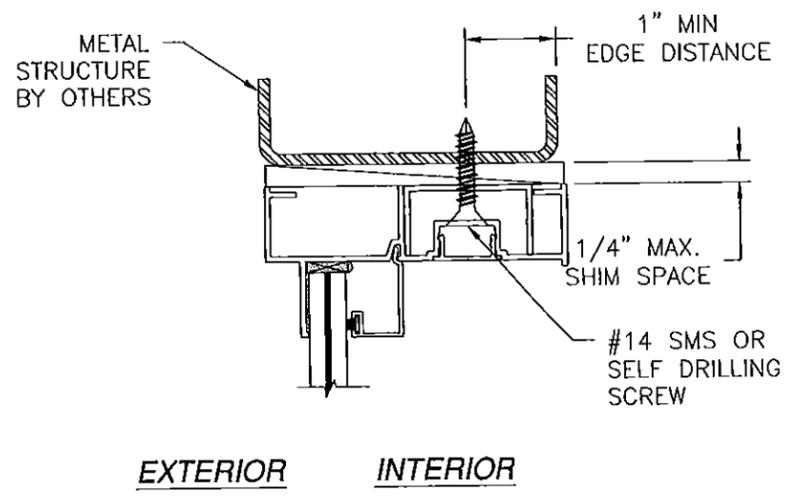


A
4 VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

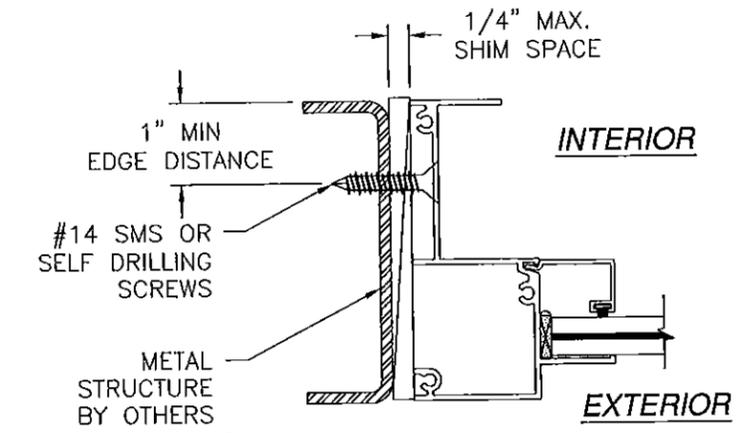


B
4 JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

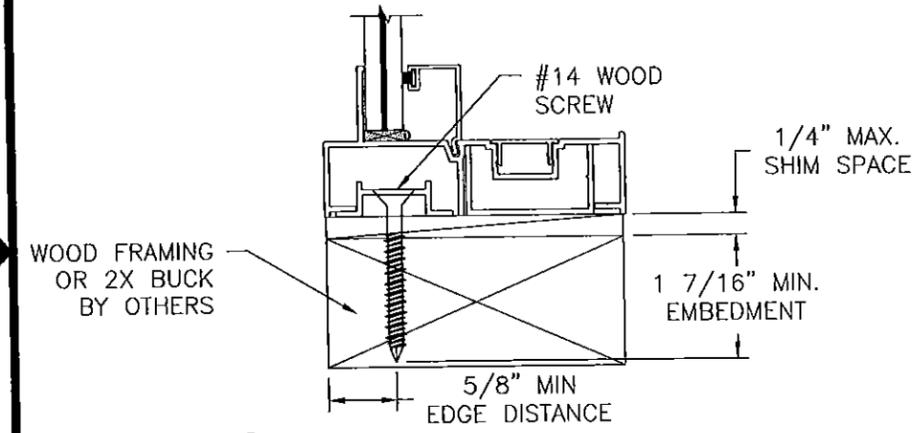

A
4 VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

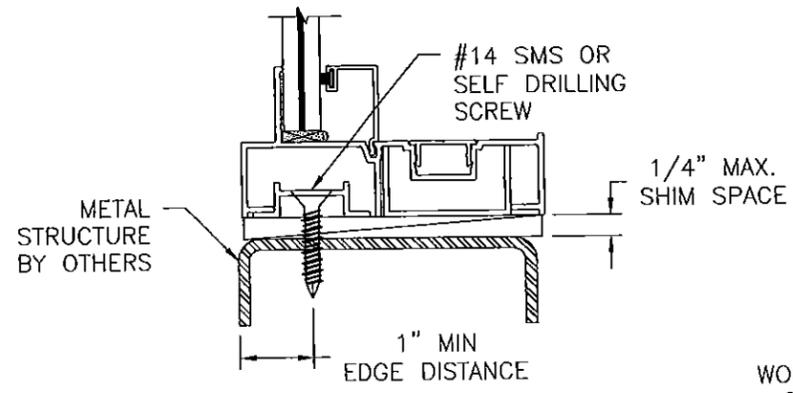

A
4 VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

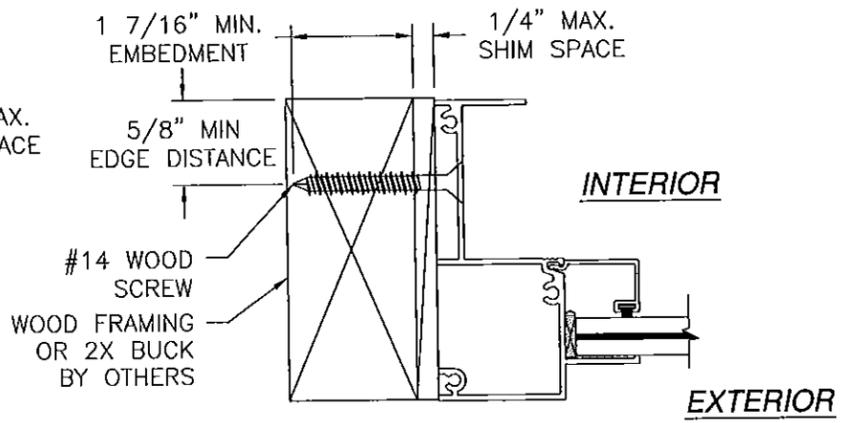


B
4 JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTE:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112



SIGNED: 03/03/2016

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 15-0723.19 Expiration Date April 3, 2019 By <i>Manuel Jerez</i> Miami Dade Product Control	WinDoor INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0505 www.windoorinc.com	
	3000 ALUMINUM FIXED WINDOW IMPACT SGP - HVHZ - EQUAL LEG AND FLANGE SMI EQUAL LEG INSTALLATION DETAILS	
DRAWN: V.L.	DWG NO. 08-02215	REV B
SCALE NTS	DATE 06/21/2013	SHEET 4 OF 8

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

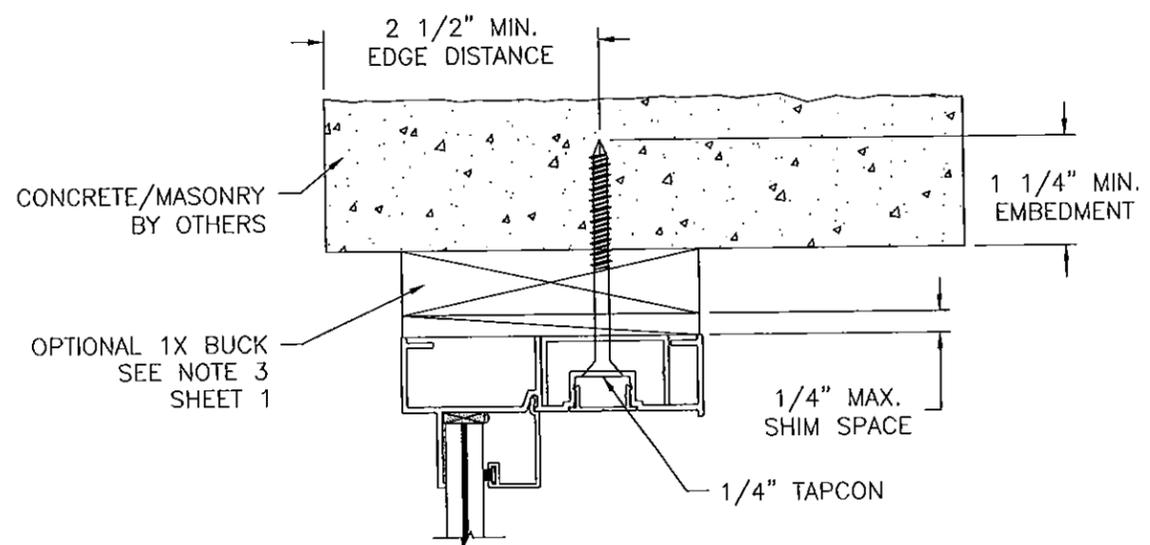

EXTERIOR INTERIOR

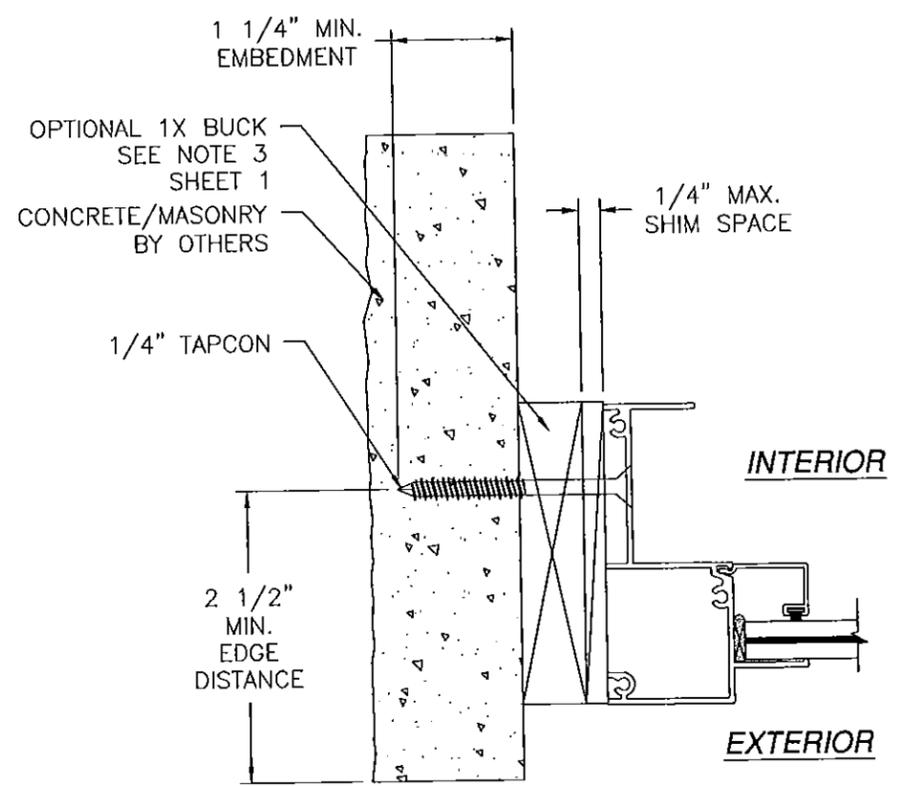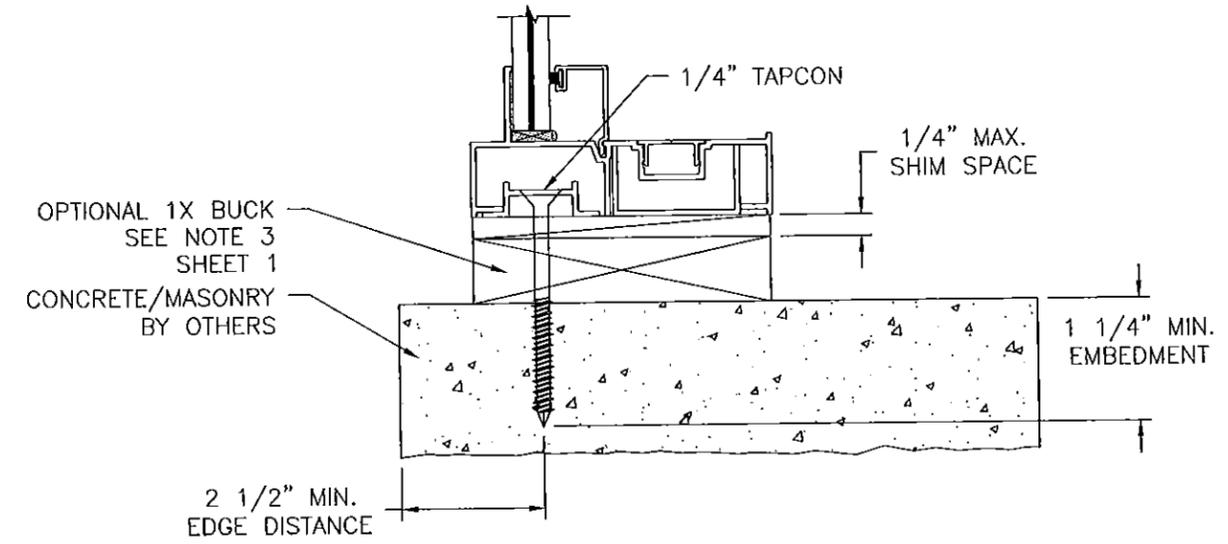


B
5 JAMB INSTALLATION DETAIL
CONCRETE/MASONRY INSTALLATION

A
5 VERTICAL CROSS SECTION
CONCRETE/MASONRY INSTALLATION


NOTE:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 15-0723.19 Expiration Date April 3, 2019 By <i>Manuel Perez</i> Miami Date Product Control	WinDoor INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0505 www.windoorinc.com	SIGNED: 03/03/2016
	3000 ALUMINUM FIXED WINDOW IMPACT SGP - HVHZ - EQUAL LEG AND FLANGE SMI EQUAL LEG INSTALLATION DETAILS	
DRAWN: V.L.	DWG NO. 08-02215	REV B
SCALE NTS	DATE 06/21/2013	SHEET 5 OF 8


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

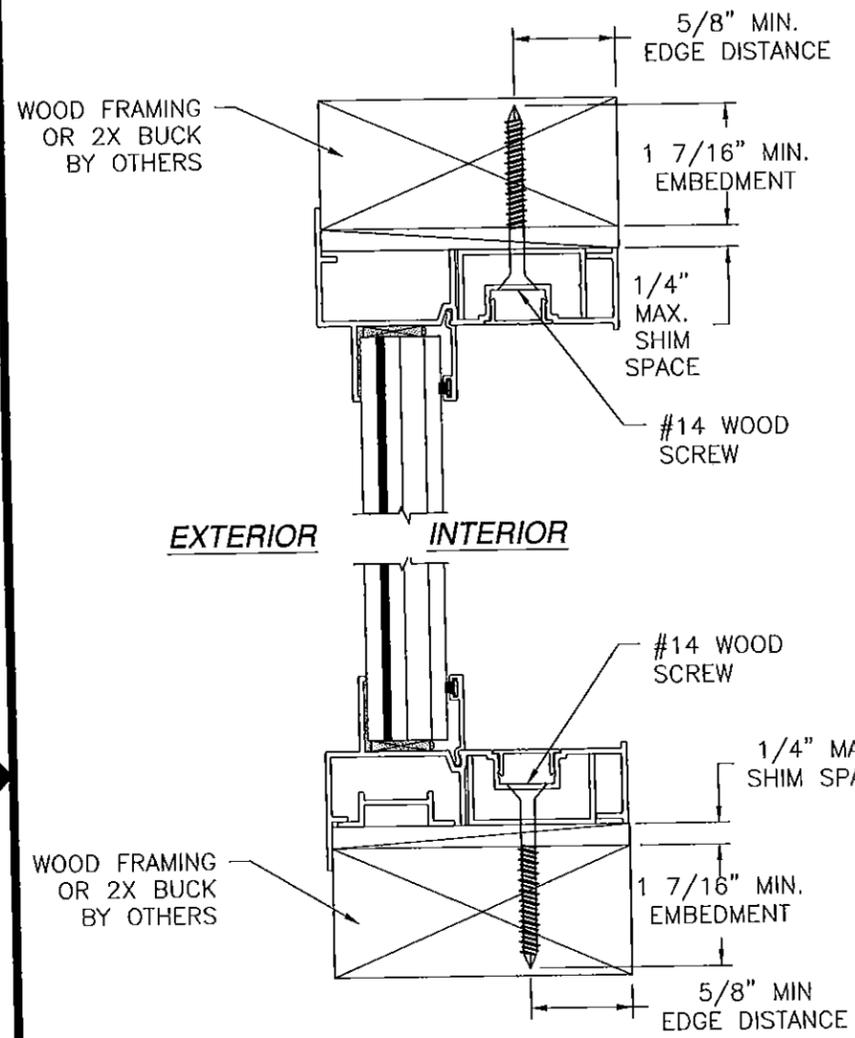


A
6 VERTICAL CROSS SECTION
WOOD FRAMING OR 2X BUCK INSTALLATION

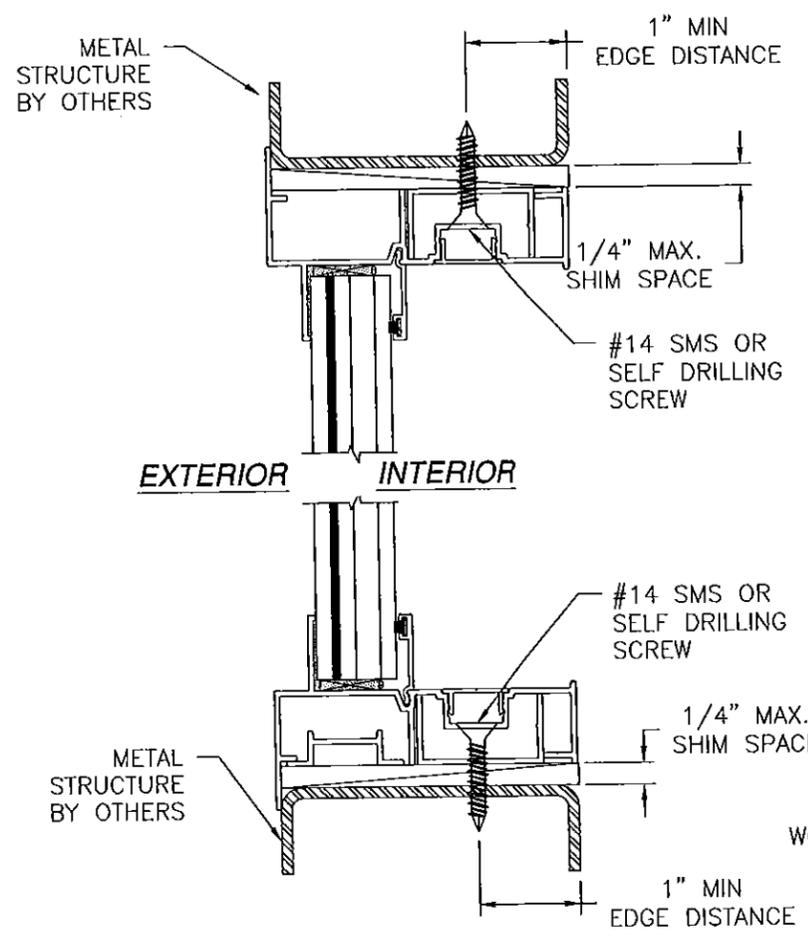

A
6 VERTICAL CROSS SECTION
METAL STRUCTURE INSTALLATION

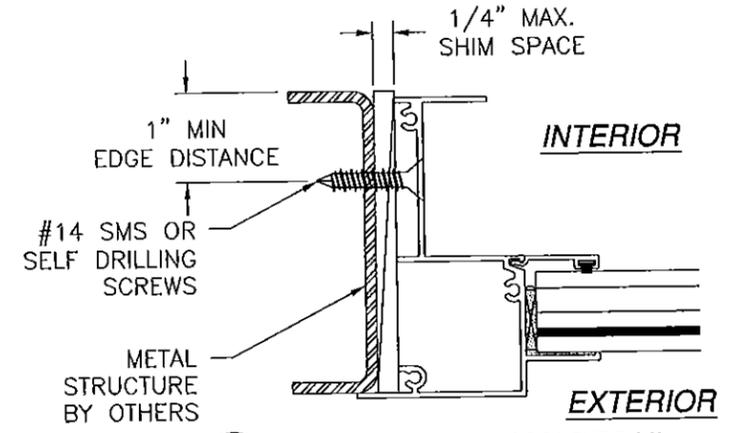

B
6 JAMB INSTALLATION DETAIL
METAL STRUCTURE INSTALLATION

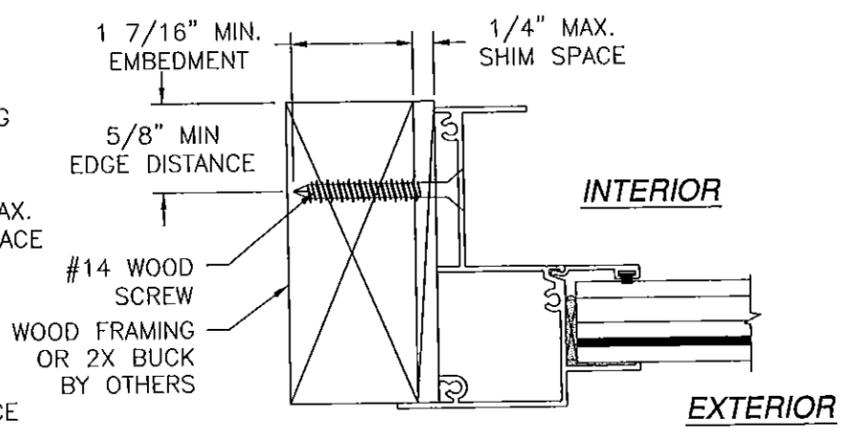


B
6 JAMB INSTALLATION DETAIL
WOOD FRAMING OR 2X BUCK INSTALLATION

NOTE:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


SIGNED: 03/03/2016

PRODUCT REVISED as complying with the Florida Building Code Acceptance No. 15-0723.19 Expiration Date April 13, 2019 By <i>Manuel Perez</i> Miami Dade Product Control	WinDoor INCORPORATED 750 BAMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0505 www.windoorinc.com		
	3000 ALUMINUM FIXED WINDOW IMPACT SGP - HVHZ - EQUAL LEG AND FLANGE SMI FLANGE INSTALLATION DETAILS		
	DRAWN: V.L. SCALE: NTS		DWG NO. 08-02215 DATE: 06/21/2013

REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

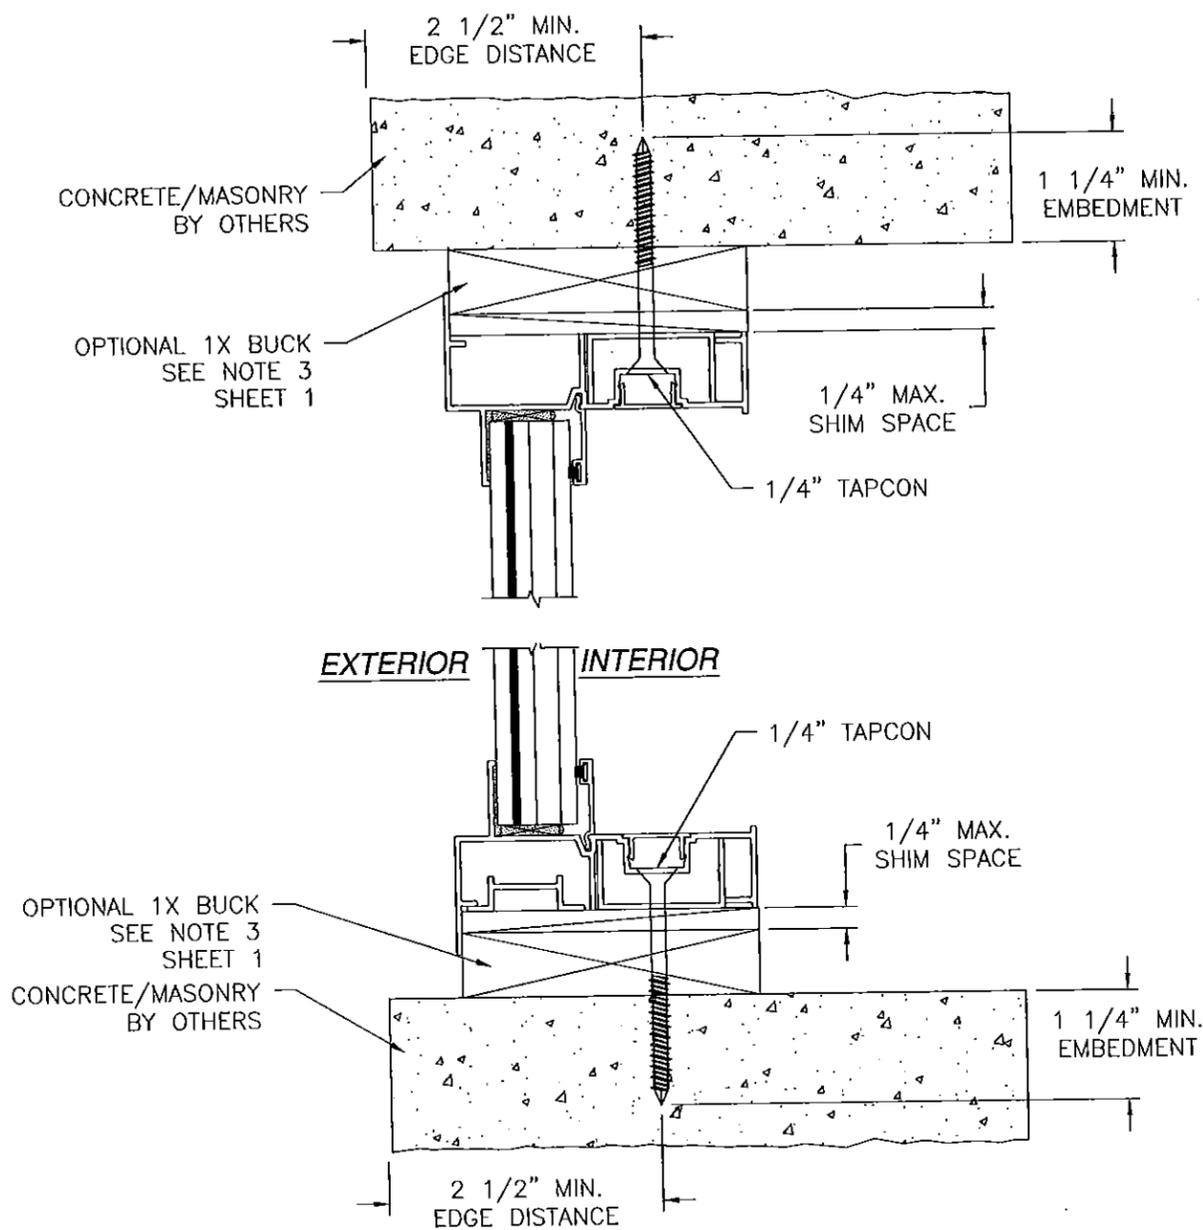

(A) VERTICAL CROSS SECTION
7 CONCRETE/MASONRY INSTALLATION

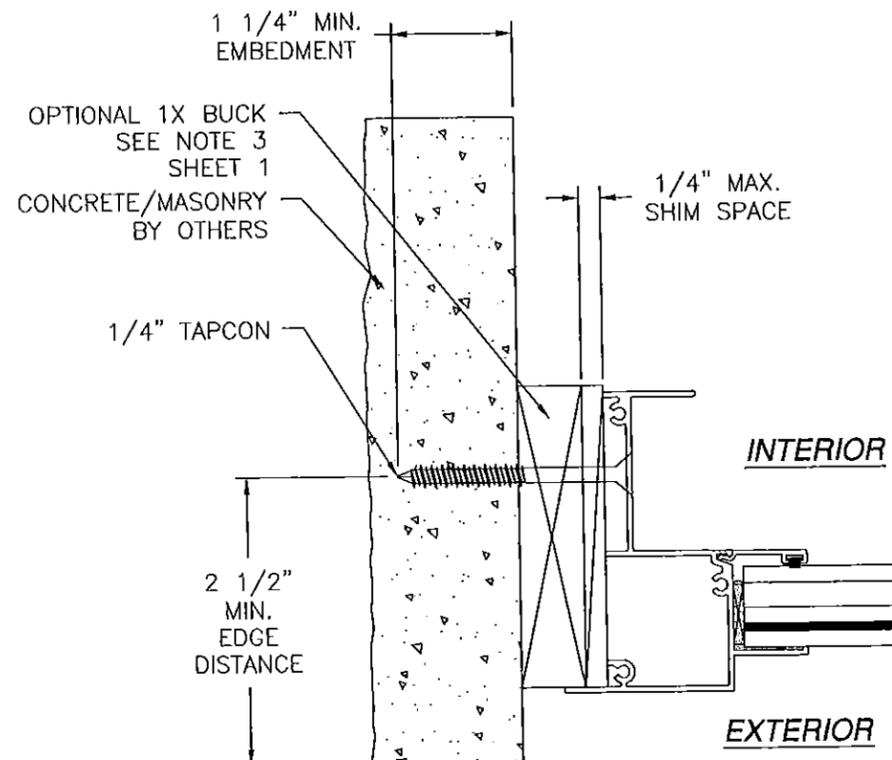

(B) JAMB INSTALLATION DETAIL
7 CONCRETE/MASONRY INSTALLATION

SIGNED: 03/03/2016

NOTE:
1. INTERIOR AND EXTERIOR FINISHES, BY OTHERS, NOT SHOWN FOR CLARITY.
2. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH ASTM E2112


PRODUCT REVISED
as complying with the Florida
Building Code
Acceptance No. 15-0723.19
Expiration Date April 3, 2019
By *Manuel Perez*
Miami Dade Product Control

WinDoor
INCORPORATED


7500 AMSTERDAM DRIVE
ORLANDO, FL 32832
Phone: 407.481.8400
Fax: 407.481.0505 www.windoorinc.com

3000 ALUMINUM FIXED WINDOW IMPACT
SGP - HVHZ - EQUAL LEG AND FLANGE SMI
FLANGE INSTALLATION DETAILS


DRAWN: V.L.	DWG. NO. 08-02215	REV B
SCALE NTS	DATE 06/21/2013	SHEET 7 OF 8

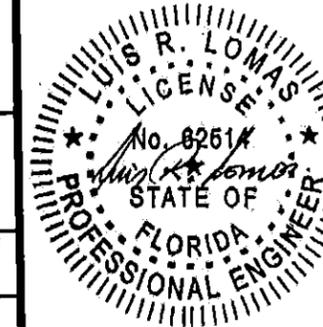


REVISIONS			
REV	DESCRIPTION	DATE	APPROVED
A	REVISED PER MD COMMENTS	03/13/14	R.L.
B	REVISED CHART #2 & GLAZING DETAILS	03/03/16	R.L.

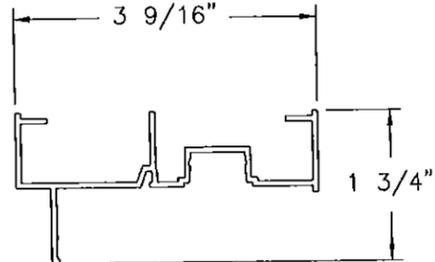


① **FRAME W/ CHANNEL**
ALUMINUM 6063-T6 .063 THICK

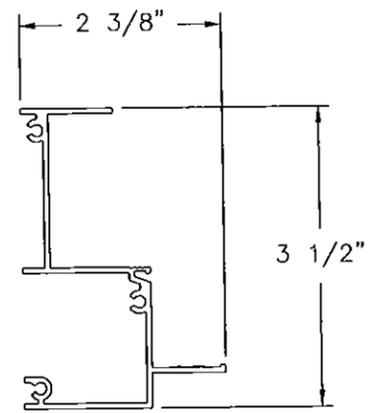


② **FRAME JAMB**
ALUMINUM 6063-T6 .063 THICK

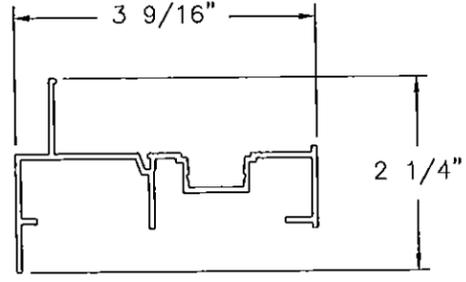


③ **FRAME W/ CHANNEL**
ALUMINUM 6063-T6 .063 THICK

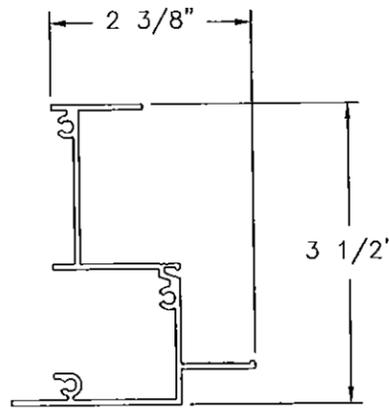


④ **FRAME JAMB**
ALUMINUM 6063-T6 .063 THICK




⑤ **HEAD FILLER**
ALUMINUM 6063-T6 .063 THICK




⑥ **SILL RETAINER**
ALUMINUM 6063-T6 .063 THICK



⑦ **JAMB TRACK RECESSED COVER**
ALUMINUM 6063-T6 .045" THICK



⑧ **GLAZING STOP**
ALUMINUM 6063-T6 .063 THICK



⑨ **GLAZING STOP**
ALUMINUM 6063-T6 .063 THICK

SIGNED: 03/03/2016

PRODUCT REVISED as complying with the Florida Building Code Acceptance No 15-0723.19 Expiration Date April 3, 2019 By <i>Manuel Perez</i> Miami Dade Product Control	WinDoor INCORPORATED 7500 AMSTERDAM DRIVE ORLANDO, FL 32832 Phone: 407.481.8400 Fax: 407.481.0505 www.windoorinc.com		
	3000 ALUMINUM FIXED WINDOW IMPACT SGP - HVHZ - EQUAL LEG AND FLANGE SMI COMPONENTS		
	DRAWN: V.L.		DWG NO. 08-02215
SCALE NTS	DATE 06/21/2013	SHEET 8 OF 8	