



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

RC Home Showcase, Inc.
2970 NW 75th Avenue
Miami, FL 33122

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "FX360" Aluminum Window Wall System - L.M.I.

APPROVAL DOCUMENT: Drawing No. 15 136, titled "Series FX360 (L.M.I.)", sheets 1 through 7 of 7, dated 12/08/15 revised on 01/04/16, prepared by Eastern Engineering Group, signed and sealed by Gonzalo A. Paz, P.E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Jorge M. Plasencia, P.E.**



J.P.
1/13/2014

NOA No. 15-0902.01
Expiration Date: January 21, 2021
Approval Date: January 21, 2016
Page 1

RC Home Showcase, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections.
2. Drawing No. **15 136**, titled "Series FX360 (L.M.I.)", sheets 1 through 7 of 7, dated 12/08/15 revised on 01/04/16, prepared by Eastern Engineering Group, signed and sealed by Gonzalo A. Paz, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of an aluminum window wall system with single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-15-5059** and **HETI-15-5064**, both dated 06/12/15, signed and sealed by Rafael E. Droz-Seda, P.E.
2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94
2) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system with single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s **HETI-15-5060** and **HETI-15-5065**, both dated 06/12/15, signed and sealed by Rafael E. Droz-Seda, P.E.
3. Test reports on: 1) Drop Load Test (400 Ft. Lb.), per ANSI Z97.1-09 Category A
CPSC 16 CFR, Category II Part 1201.4 and per FBC, Ch. 2406
along with marked-up drawings and installation diagram of aluminum window wall system with single hung window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-15-5060A**, dated 06/12/15, signed and sealed by Rafael E. Droz-Seda, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 5th Edition (2014)**, dated 10/13/15 and revised on 11/05/15, prepared by Eastern Engineering Group, signed and sealed by Gonzalo A. Paz, P.E.
2. **Glazing complies with ASTM E1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).



Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-0902.01

Expiration Date: January 21, 2021
Approval Date: January 21, 2016

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **14-0916.11** issued to **Kuraray America, Inc.** for their "**SentryGlas® (Clear and White) Glass Interlayers**" dated 06/25/15, expiring on 07/04/18.

F. STATEMENTS

1. Statement letters of conformance, complying with **FBC 5th Edition (2014)**, and of no financial interest, dated 10/12/15, issued by Eastern Engineering Group, signed and sealed by Gonzalo A. Paz, P.E.
2. Laboratory compliance letters for Test Reports No.'s **HETI-15-5059, HETI-15-5060, HETI-15-5060A, HETI-15-5064** and **HETI-15-5065**, all issued by Hurricane Engineering & Testing, Inc., all dated 06/12/15, signed and sealed by Rafael E. Droz-Seda, P.E.
3. Proposal No. **15-0359** issued by the Product Control Section, dated 03/23/15, signed by Manuel Perez, P.E.

G. OTHERS

1. None.





Jorge M. Plasencia, P.E.
Product Control Unit Supervisor
NOA No. 15-0902.01
Expiration Date: January 21, 2021
Approval Date: January 21, 2016

GENERAL NOTES

1. THIS WINDOWS SYSTEM IS DESIGNED AND TESTED TO COMPLY W/ THE REQUIREMENTS OF THE FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE VELOCITY (HVHZ) AND ASTM 1300-09 THESE WINDOWS ARE RATE FOR LARGE MISSILE IMPACT. (SHUTTERS ARE NOT REQUIRED)
2. ANCHORS SHOWN IN DRAWINGS ARE AS PER TEST UNITS. ANCHORS ON ALL PANEL SIZES ARE NOT TO EXCEED THESE MAXIMUM SPACING ON CENTER (O.C.) AND AS TABULATED ON SHEET 4
3. ANCHOR CONDITIONS NOT DESCRIBED IN THESE DRAWING'S ARE TO BE ENGINEERED ON A SITE SPECIFIC BASIS, UNDER A SEPARATE APPROVAL AND TO BE REVIEWED BY BUILDING OFFICIAL.
4. LOAD DURATION INCREASE IN ALLOWABLE STRESS IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.
5. ANCHORS EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.
6. GLASS PANEL TO BE LAMINATED GLASS 9/16" NOMINAL, COMPOSED OF (2) 1/4" HEAT STRENGTHENED GLASS WITH 0.090" SENTRYGLASS INTERLAYER BY KURARAY AMERICA, INC.
7. EXT. & INT. FALSE MOUNTINGS ARE OPTIONAL & AND TO BE APPLIED W/ SILICONE.
8. ALL METAL/STEEL IN CONTACT WITH ALUMINUM OR OTHER DISSIMILAR MATERIALS TO BE PAINTED OR PLATED AND SHALL MEET THE FLORIDA BLDG. CODE & ADOPTED STANDARDS.
9. SEE SHEET 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.
10. USE RATING GREATER THAN DESIGN LOADS REQUIRED
11. LOWER DESIGN PRESSURES FROM MULLION OR WINDOW CHARTS WILL APPLY TO ENTIRE SYSTEM.
12. EXISTING STRUCTURE TO SUPPORT THE LOADS IMPOSED BY THE WINDOW OR WINDOW WALL SYSTEM. ENGINEER ON RECORD OF THE BUILDING SHALL VERIFY THE STRUCTURE FOR SUCH LOADINGS.
13. SYSTEM COMPLIES WITH REQUIREMENTS OF ANSI Z-97.1-04/09


DESIGN SEQUENCE

- STEP 1: DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG, HEIGHT, WIND ZONE USING APPLICABLE ASCE 7-10 (2010) STANDARD.
- STEP 2: DETERMINE SYSTEM CAPACITY FROM TABLES ON SHEET 3 AND GLASS CAPACITY ON SHEET 2.
- STEP 3: THE LOWEST VALUE RESULTING FROM STEP 2 SHALL APPLY TO ENTIRE SYSTEM.

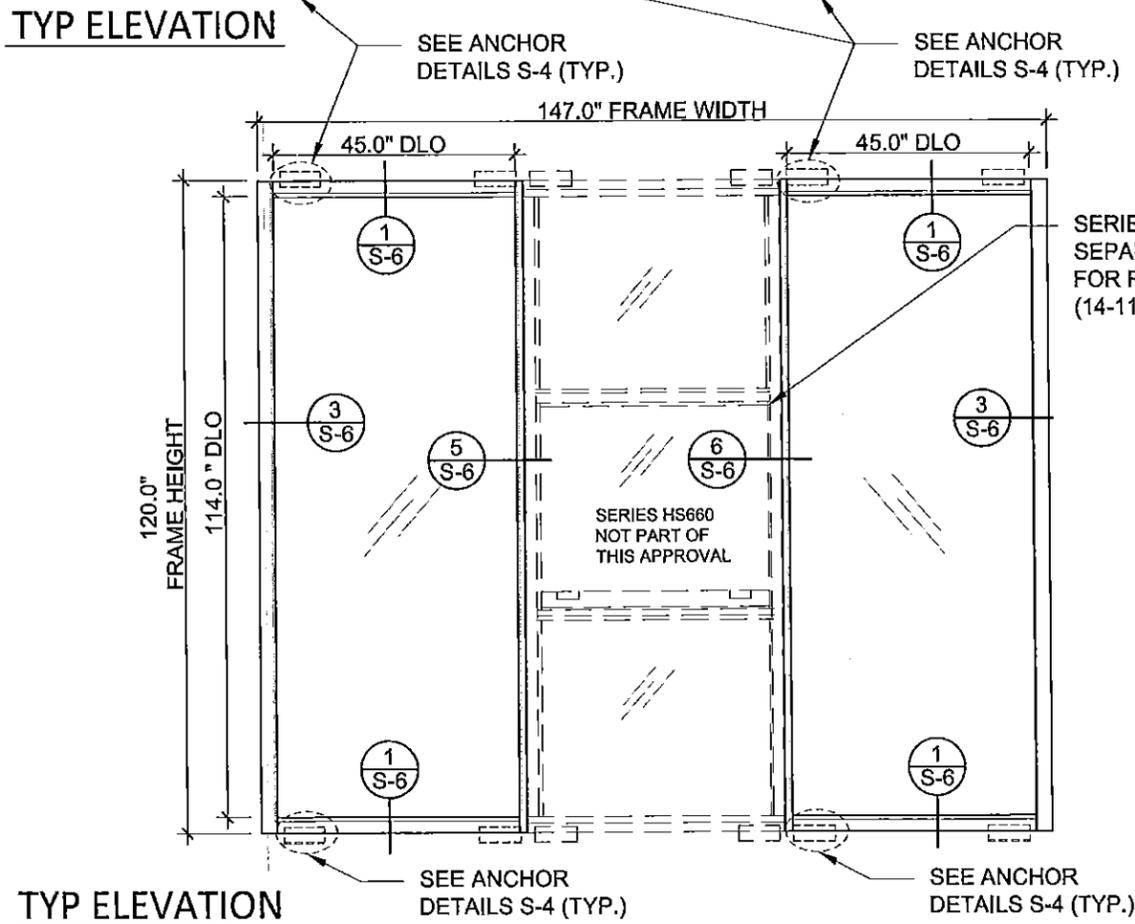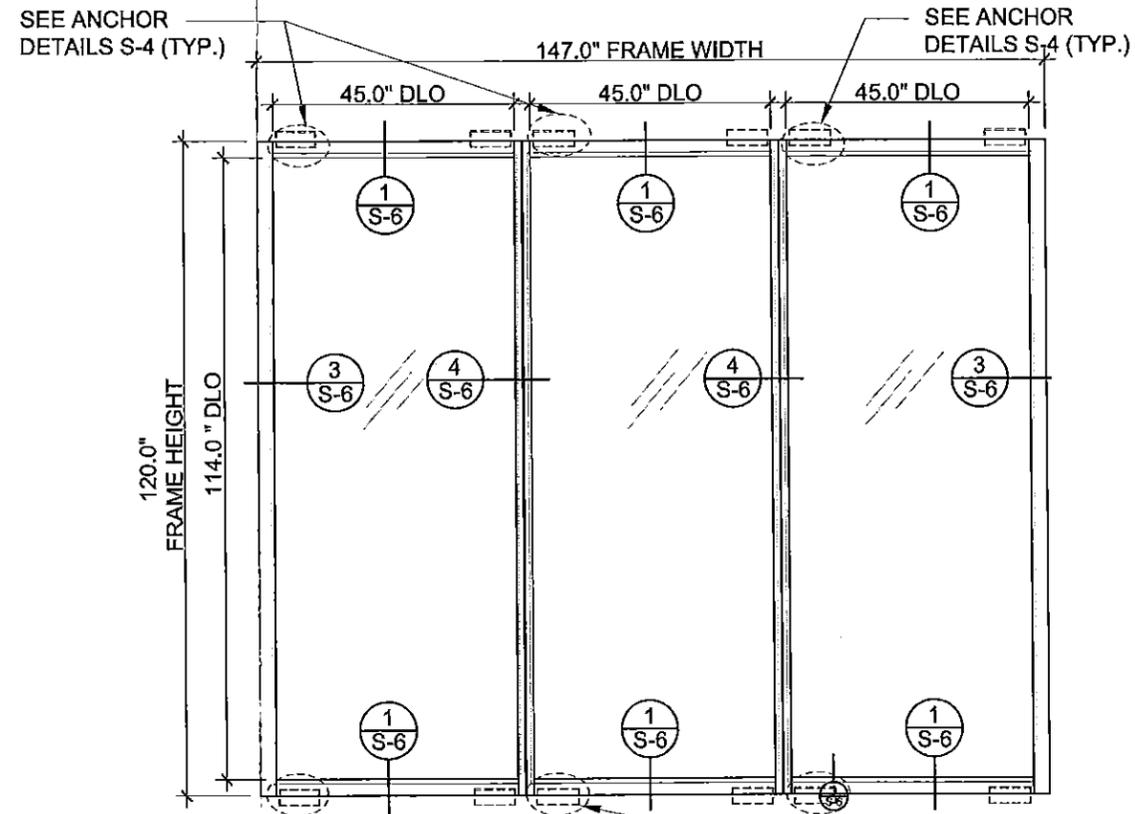

SERIES HS660 UNDER SEPARATE NOA DRAWING FOR REFERENCE ONLY (14-1118.03)

Approved as complying with the Florida Building Code
 Date: JAN 21 2016
 NOA: 15-0902.01
 Miami Dade Product Control
 By: *[Signature]*

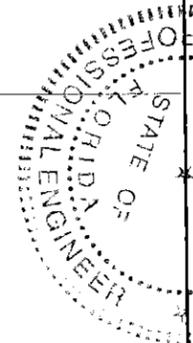


EASTERN ENGINEERING GROUP
 3401 NW 82 AVE SUITE 370 Miami, Florida 33122
 Tel: (305) 599-8133 Fax: (305) 599-8076
 www.easterneg.com
 RAISSA R. LOPEZ, PE (Lic No.-59399)
 GONZALO A. PAZ, PE (Lic No.-60734)
 CERT. OF AUTHORIZATION No. 26655

REVISIONS	DESCRIPTION	DATE
No.		

JOB No. 15 136
 DESIGNED & DRAWN:
 SCALE: AS SHOWN


NOA SERIES FX360 (LMI)
 16115 NW 52nd Ave.
 Miami Gardens, FL 33014
 Phone: (305) 392-6214
 Fax: (305) 260-6432



STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 License No. 60734
 GONZALO A. PAZ, PE
 1/4/2016




Glass Design Load Capacity(PSF)				Glass Design Load Capacity(PSF)				Glass Design Load Capacity(PSF)			
D.L.O Width (in)	D.L.O Height (in)	Design Load Capacity (psf)		D.L.O Width (in)	D.L.O Height (in)	Design Load Capacity (psf)		D.L.O Width (in)	D.L.O Height (in)	Design Load Capacity (psf)	
		(+)	(-)			(+)	(-)			(+)	(-)
27.0	60.0	110.0	110.0	39.0	60.0	110.0	110.0	51.0	60.0	110.0	110.0
	66.0	110.0	110.0		66.0	110.0	110.0		66.0	110.0	110.0
	72.0	110.0	110.0		72.0	110.0	110.0		72.0	110.0	110.0
	78.0	110.0	110.0		78.0	110.0	110.0		78.0	110.0	110.0
	84.0	110.0	110.0		84.0	110.0	110.0		84.0	110.0	110.0
	90.0	110.0	110.0		90.0	110.0	110.0		90.0	110.0	110.0
	96.0	110.0	110.0		96.0	110.0	110.0		96.0	110.0	110.0
	102.0	110.0	110.0		102.0	110.0	110.0		102.0	110.0	110.0
	108.0	110.0	110.0		108.0	110.0	110.0		108.0	110.0	110.0
	114.0	110.0	110.0		114.0	110.0	110.0		114.0	110.0	110.0
33.0	60.0	110.0	110.0	45.0	60.0	110.0	110.0	57.0	60.0	110.0	110.0
	66.0	110.0	110.0		66.0	110.0	110.0		72.0	110.0	110.0
	72.0	110.0	110.0		72.0	110.0	110.0		78.0	110.0	110.0
	78.0	110.0	110.0		78.0	110.0	110.0		84.0	110.0	110.0
	84.0	110.0	110.0		84.0	110.0	110.0		90.0	110.0	110.0
	90.0	110.0	110.0		90.0	110.0	110.0				
	96.0	110.0	110.0		96.0	110.0	110.0				
	102.0	110.0	110.0		102.0	110.0	110.0				
	108.0	110.0	110.0		108.0	110.0	110.0				
	114.0	110.0	110.0		114.0	110.0	110.0				

D.L.O Width= Frame Width-3"
D.L.O Height= Frame Height-6"

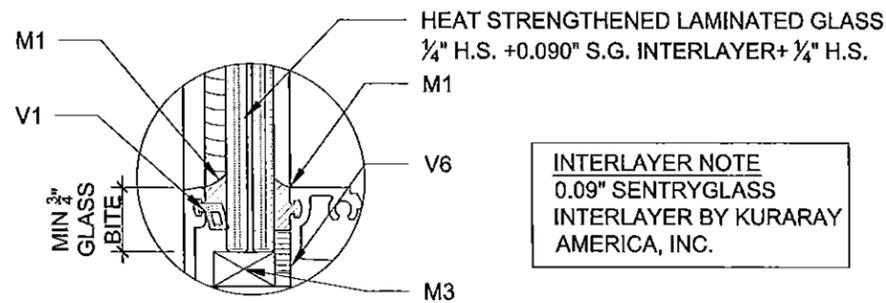

INTERLAYER NOTE
0.09" SENTRYGLASS
INTERLAYER BY KURARAY
AMERICA, INC.

GLASS TYPE "G1" DETAIL
SCALE: 6"=1'-0"

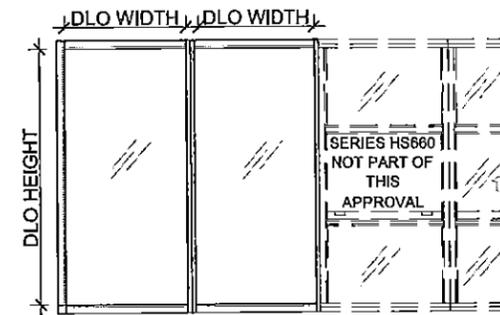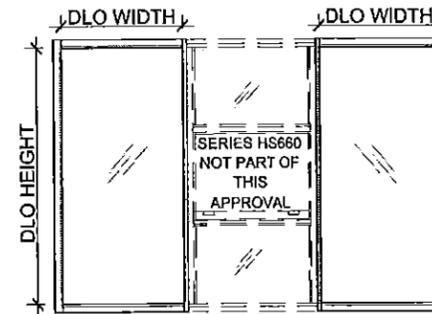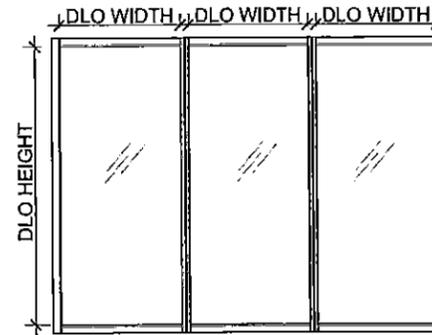

Approved as complying with the
Florida Building Code
Date JAN 29 2016
NOA 15-09202-01
Miami Dade Product Control
By *[Signature]*

Product: NOA SERIES FX360 (LMI)
16115 NW 52nd Ave.
Miami Gardens, FL 33014
Phone: (305) 392-6214
FAX: (305) 260-6432

ARC
HOME SHOWCASE
ALUMINUM WINDOWS AND DOORS

Professional Engineer Seal
1/4/2016

SHEET: 2 OF 7



EASTERN ENGINEERING GROUP
3401 NW 82 AVE SUITE 370 Miami, Florida 33122
Tel: (305) 599-6133 Fax: (305) 599-8076
www.easterneg.com

RAISSA R. LOPEZ, PE (Lic No-59399)
 GONZALO A. PAZ, PE (Lic No-60734)
CERT. OF AUTHORIZATION No. 26655






REVISIONS	DESCRIPTION
No.	DATE

JOB No. 15 136
DESIGNED & DRAWN:
SCALE: AS SHOWN


Panel Width (in)	Panel Height (in)	Mullion A, B, C	
		Mullion /Jamb Load Capacity (psf) (+)	Mullion /Jamb Load Capacity (psf) (-)
30	66	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	72	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	78	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	84	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	

Panel Width (in)	Panel Height (in)	Mullion A, B, C	
		Mullion /Jamb Load Capacity (psf) (+)	Mullion /Jamb Load Capacity (psf) (-)
30	90	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	96	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	102	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	108	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	

Panel Width (in)	Panel Height (in)	Mullion A, B, C	
		Mullion /Jamb Load Capacity (psf) (+)	Mullion /Jamb Load Capacity (psf) (-)
30	114	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	
30	120	110.0	110.0
36		110.0	110.0
42		110.0	110.0
46		110.0	110.0
48		110.0	110.0
54		62.6	62.6
60	37.0	37.0	

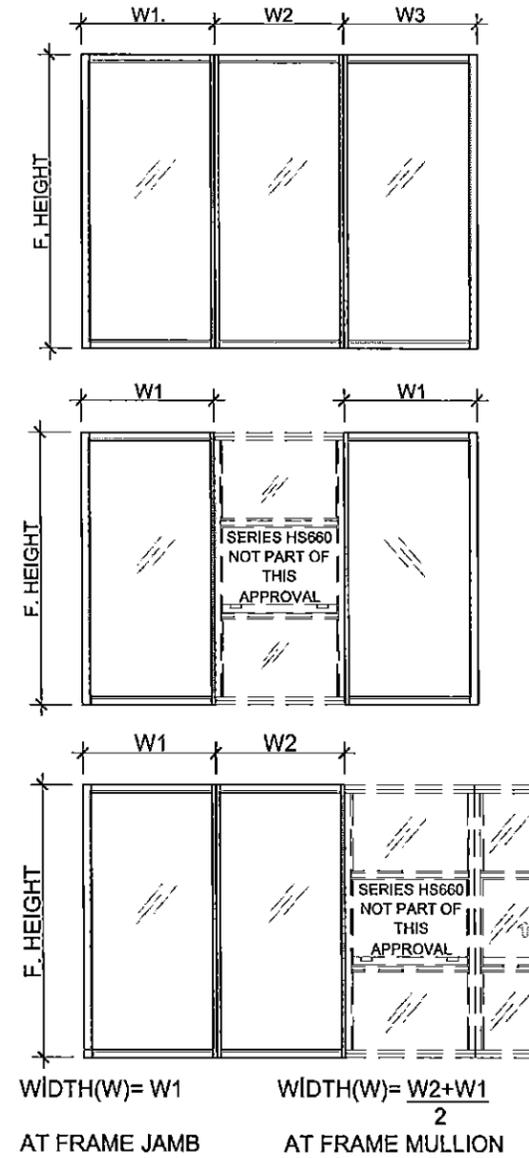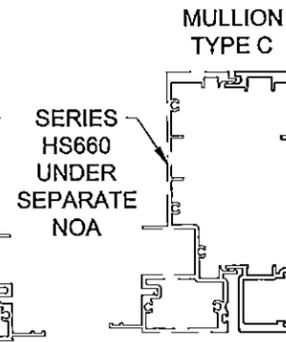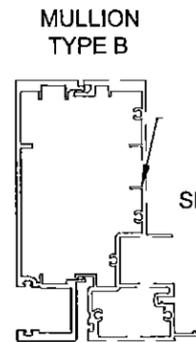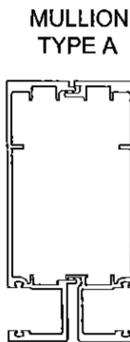

Approved as complying with the Florida Building Code
 Date JAN 21 2016
 NOA # 15-0902.01
 Miami Code Product Control
 By [Signature]

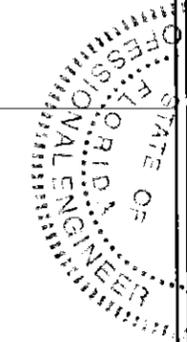

EASTERN ENGINEERING GROUP
 3401 NW 82 AVE SUITE 370 Miami, Florida 33122
 Tel: (305) 595-8133 Fax: (305) 595-8076
 www.eesterneg.com
 RAISSA R. LOPEZ, PE (Lic No-59399)
 GONZALO A. PAZ, PE (Lic No-60734)
 CERT. OF AUTHORIZATION No. 26855


REVISIONS	DESCRIPTION
No.	DATE

JOB No. 15 136
 DESIGNED & DRAWN:
 SCALE: AS SHOWN

NOA SERIES FX360 (LMI)
 16115 NW 52nd Ave.
 Miami Gardens, FL 33014
 Phone: (305) 382-6214
 Fax: (305) 260-6432





ONZALO A. PAZ
 LICENSE # 60733
 1/24/2016

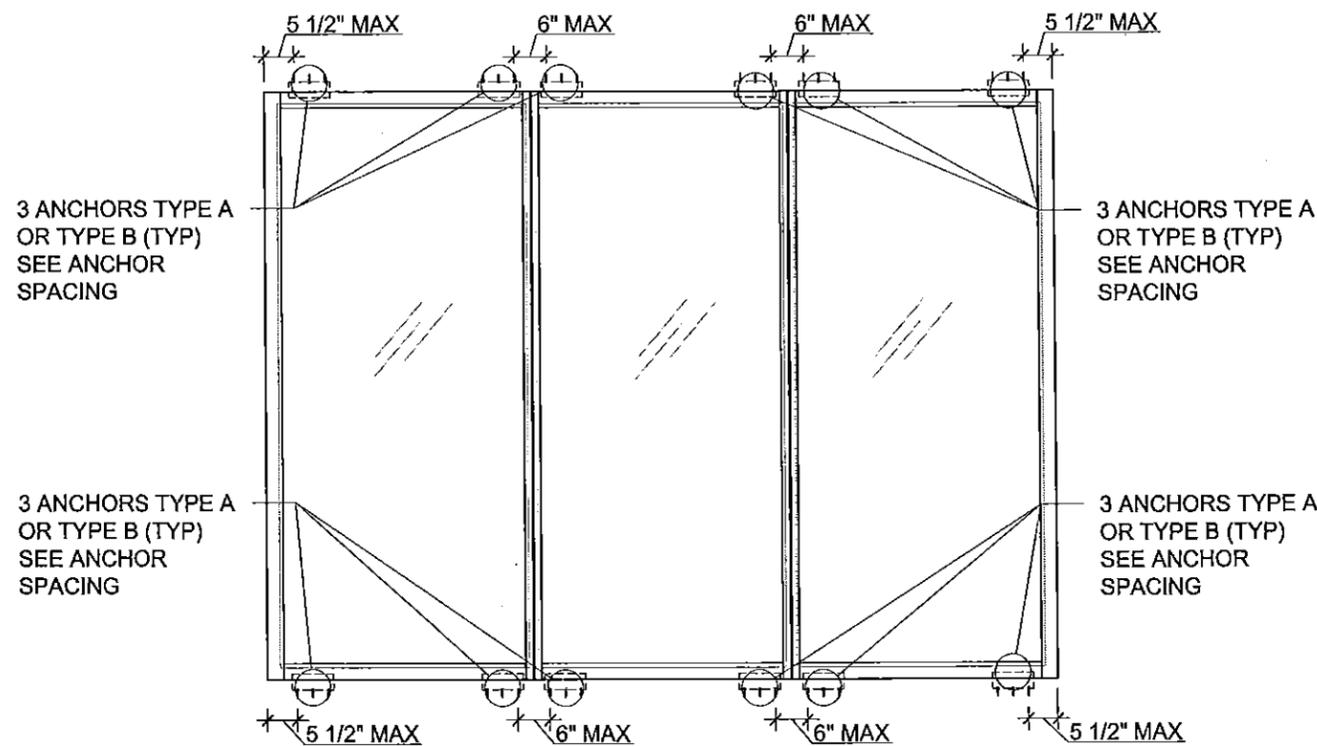

ANCHOR TYPE	ANCHORS DESCRIPTION
A	1/4"Ø KWIK CON II (+) W/ 1 3/4" MIN PENETRATION INTO 3KSI CONCRETE @ 2 7/8" OC MIN & W/ 2 1/2" EDGE DISTANCE. (Fy=137KSI, Fu=138KSI) (S2 @ BILL OF MATERIALS)
B	1/4"-20"Ø KWIK-FLEX SDS Gr 5 W/ 3/4" MIN PENETRATION INTO METAL STRUCTURE @ 5/8" O.C. MIN & W/ 1/2" EDGE DISTANCE. (Fy=92KSI, Fu=120KSI) (S8 @ BILL OF MAT.)

ANCHOR TYPE "A" DETAIL

SCALE: 3"=1'-0"

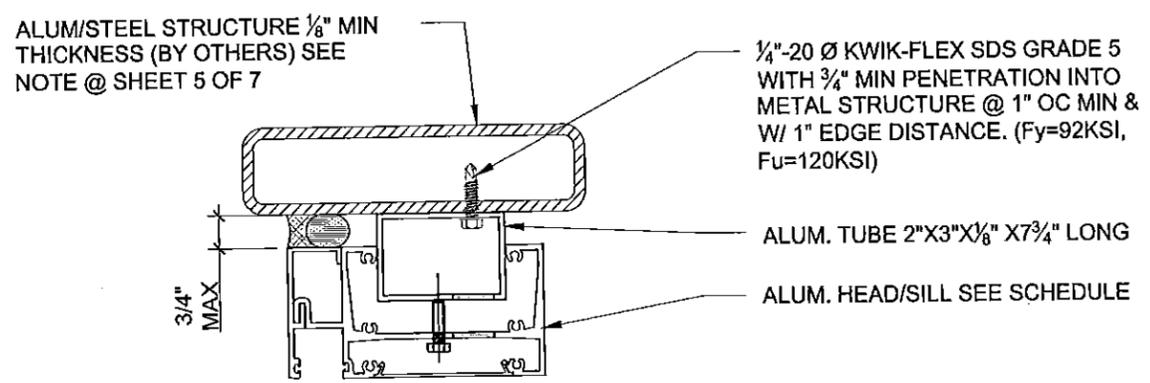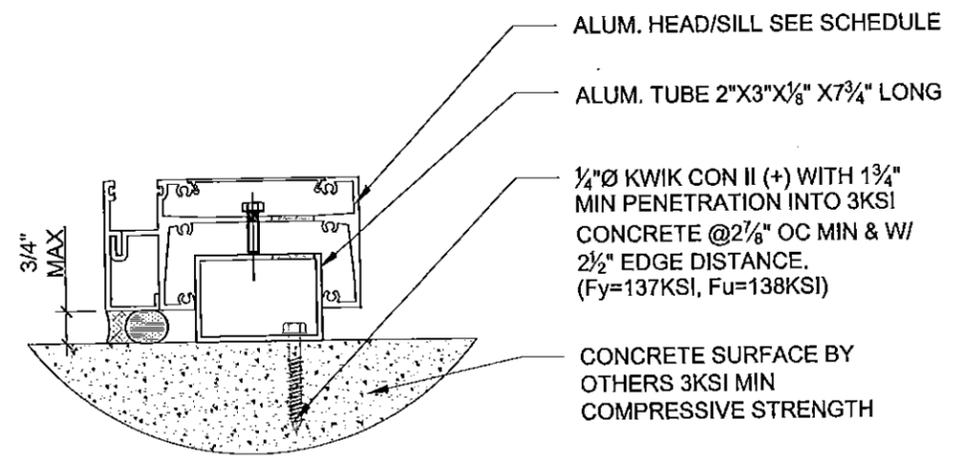


ANCHOR TYPE "B" DETAIL

SCALE: 3"=1'-0"

ANCHOR SPACING

SCALE: 3"=1'-0"

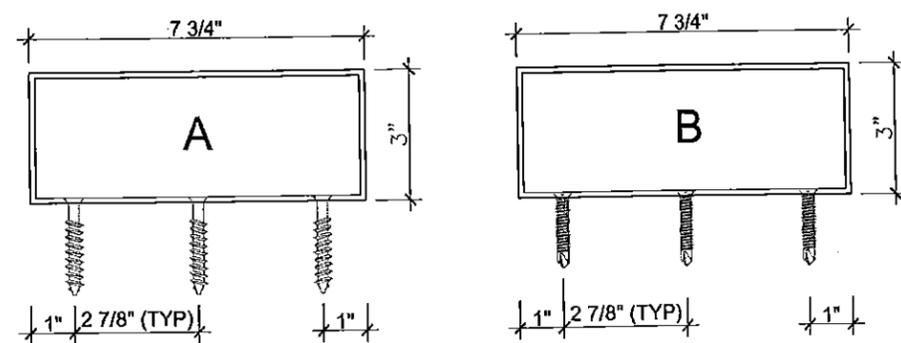

Approved as complying with the Florida Building Code 2016
 Date: JAN 29 2016
 NOA: 15-0902.01
 Miami Dade Product Control
 By: [Signature]



EASTERN ENGINEERING GROUP
 3401 NW 82 AVE SUITE 970 Miami, Florida 33122
 Tel: (305) 599-3133 Fax: (305) 599-6076
 www.eeasterneng.com

RAISSA R. LOPEZ, PE (Lic No-59399)
 GONZALO A. PAL, PE (Lic No-60734)
 CERT. OF AUTHORIZATION No. 26655



REVISIONS	DESCRIPTION	DATE	NO.

JOB No. 15 136
 DESIGNED & DRAWN:
 SCALE: AS SHOWN

Product: NOA SERIES FX360 (LMI)
 16115 NW 52nd Ave.
 Miami Gardens, FL 33014
 Phone: (305) 392-6214
 Fax: (305) 260-6432

HRC
 HOME SHOWCASE
 ALUMINUM WINDOWS AND DOORS

1/2/2016

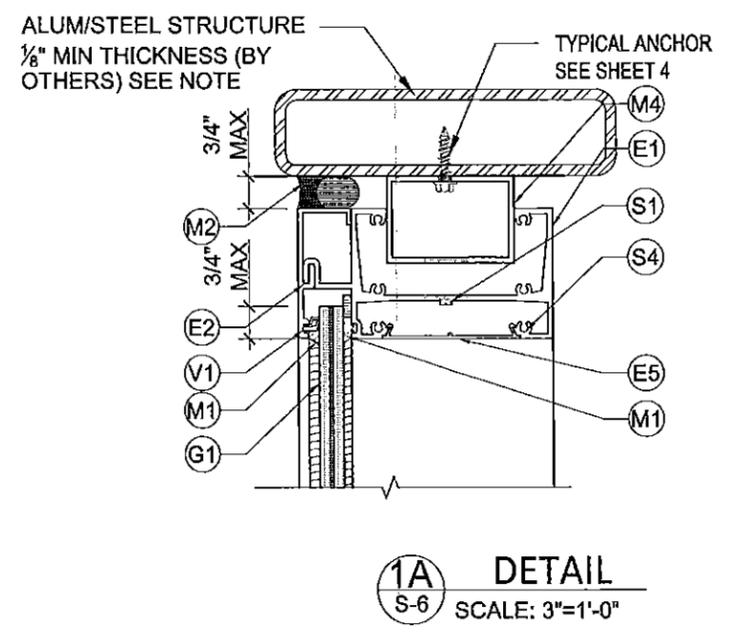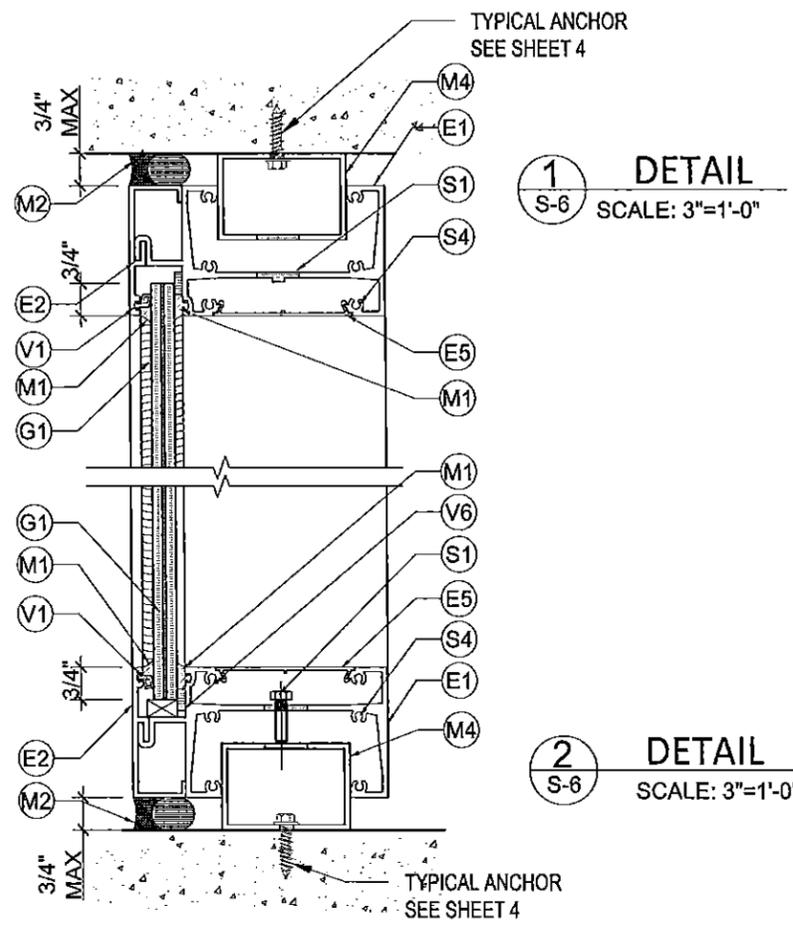

NOTE:


- SEE SHEET 4 FOR ANCHORS SPEC.
- ALL JOINTS AND FRAME CONNECTIONS SEALED WITH DOW CORNING 795 SEALANT
- METAL STRUCT./MULLION BY OTHERS MUST SUSTAIN LOAD IMPOSED BY GLAZING SYSTEM AND TRANSFER THEM TO THE BUILDING STRUCTURE.
- SETTING BLOCK TO BE SARLINK TPV 5775B By TECKNOR APEX CO. W/ HARDNESS 75±5 SHORE A (M3 @ BILL OF MATERIALS)
- ALUMINUM MULLION MIN ALLOY 6061-T6 OR STEEL MULLION MIN ALLOY A36

GAP DIMENSIONS

1/4" MIN FOR UP TO 8'-0" HIGH FRAME


5/16" MIN FOR UP TO 9'-0" HIGH FRAME

SILICONE DOW CORNING 795 OR 790 W/ BACKER ROD

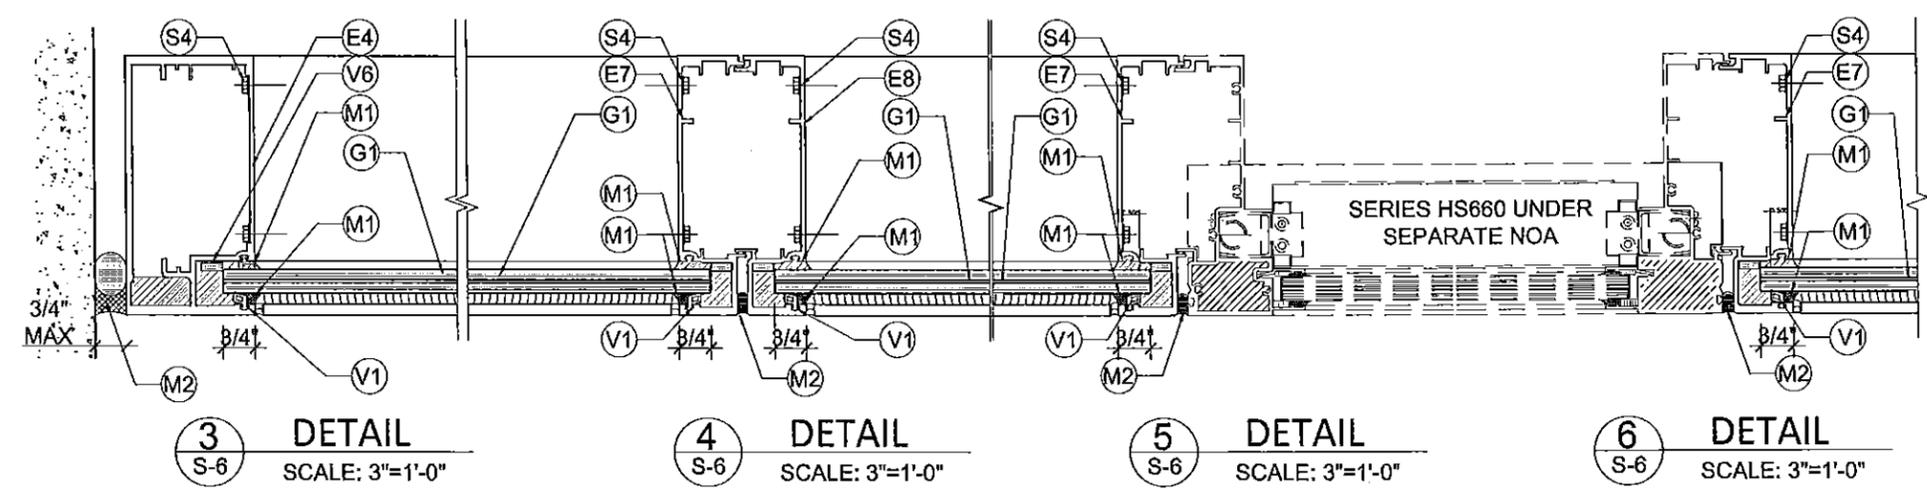

Approved as complying with the
Florida Building Code
Date **JAN 21 2016**
NOA# **15-0902.01**
Miami Dade Product Control

By

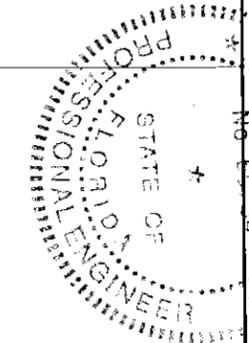


EASTERN ENGINEERING GROUP
3401 NW 82 AVE SUITE 370 Miami, Florida 33122
Tel. (305) 599-8133 Fax. (305) 599-3076
www.easteng.com

RAISSA R. LOPEZ, PE (Lic No-59399)
 GONZALO A. PAZ, PE (Lic No-60734)
CERT. OF AUTHORIZATION No. 26655

REVISIONS	DESCRIPTION	DATE
No.		

JOB No. **15 136**
DESIGNED & DRAWN:
SCALE: AS SHOWN


Product: **NOA SERIES FX360 (LMI)**
16115 NW 52nd Ave.
Miami Gardens, FL 33014
Phone: (305) 392-6214
Fax: (305) 260-6432

ARC
HOME SHOWCASE
ALUMINUM WINDOWS AND DOORS

1/4/2016

SHEET:
5 OF 7

SERIES FX 360 EXTRUSIONS

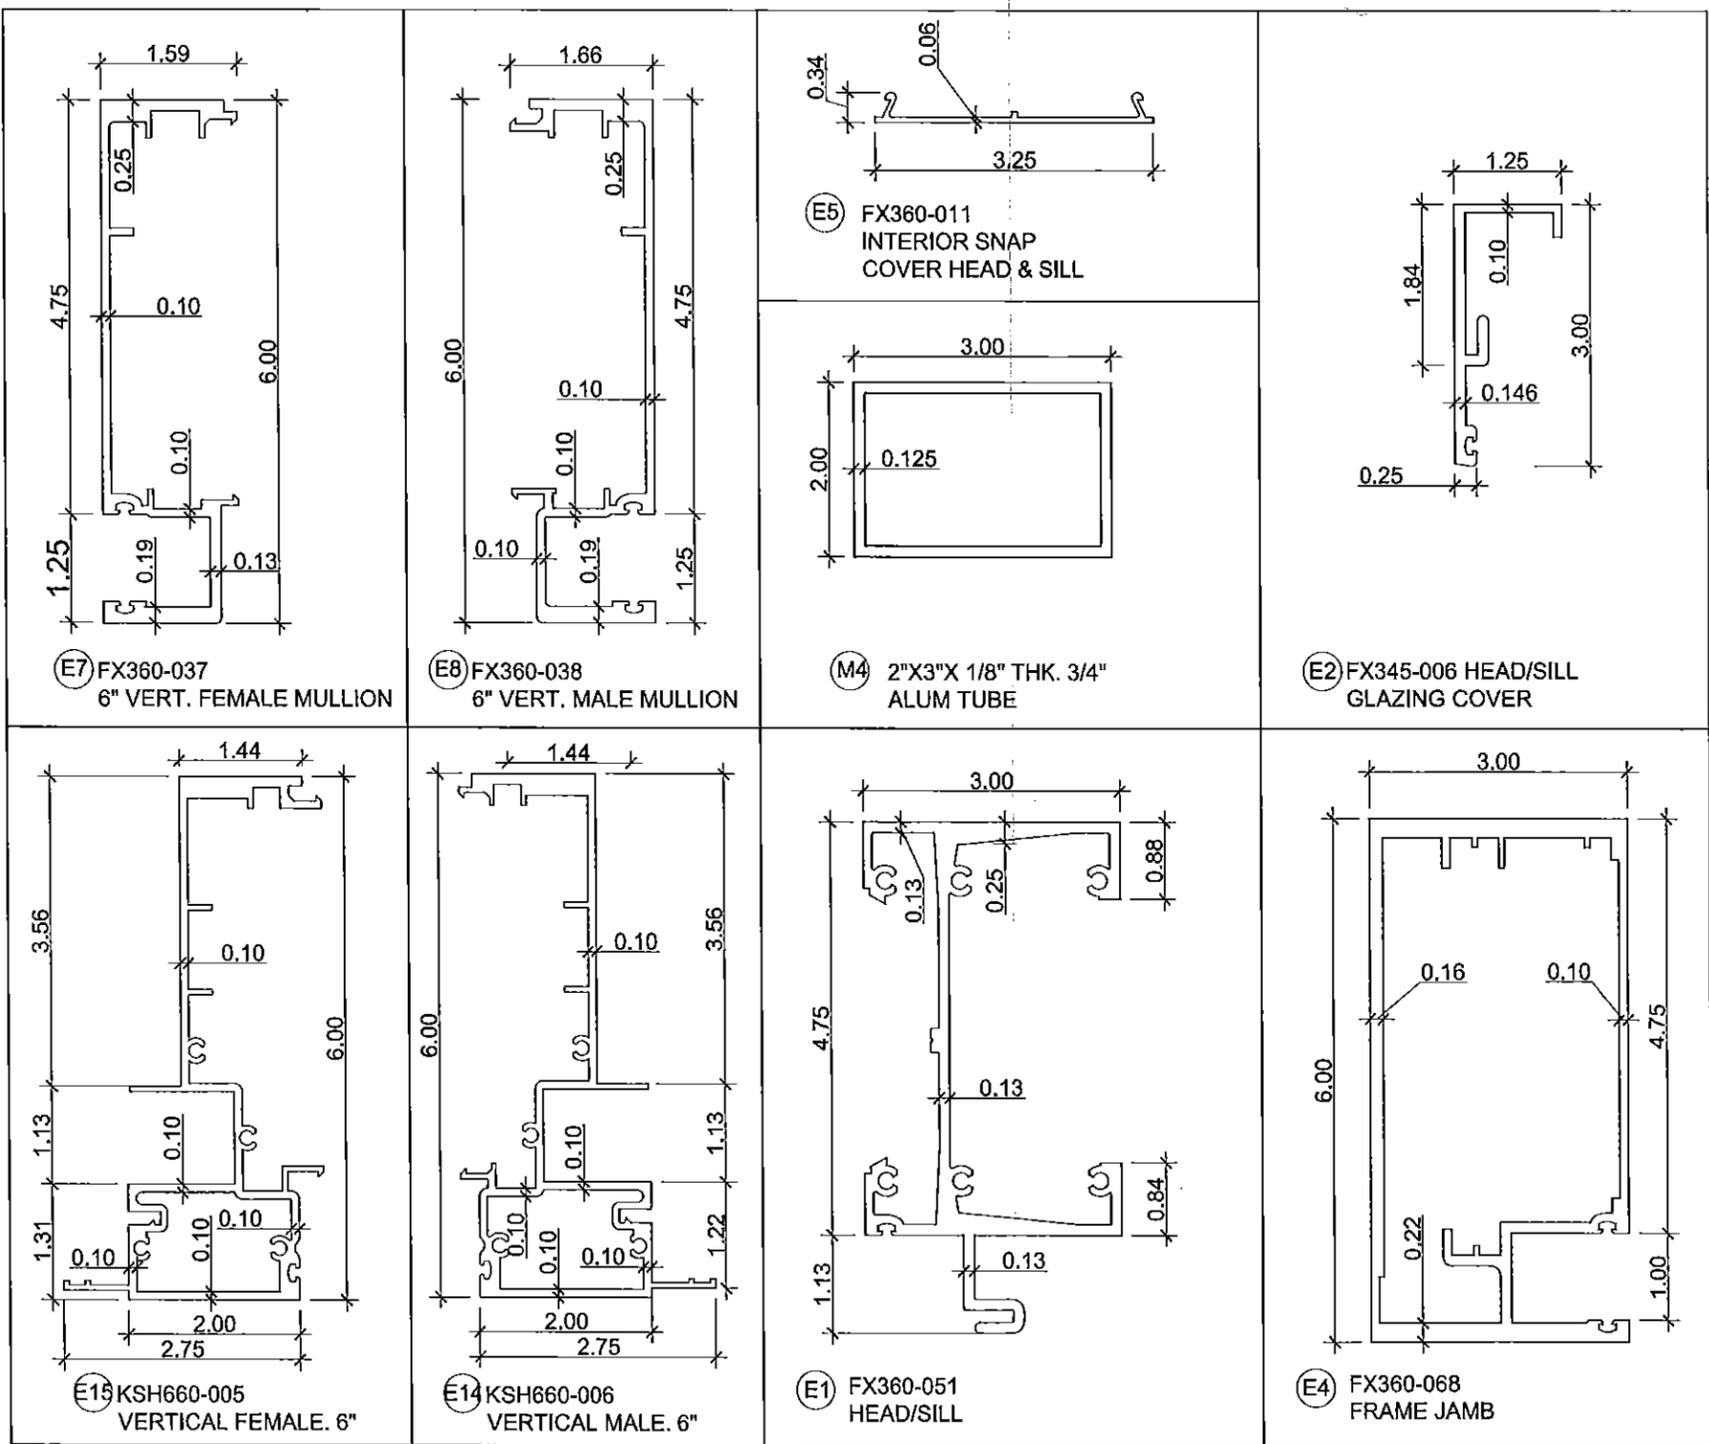

Approved as complying with the
Florida Building Code
Date JAN 21 2016
NOA# 15-0902.01
Miami Date Product Control
By

Product: **NOA SERIES FX360 (LMI)**

16115 NW 52nd Ave.
Miami Gardens, FL 33014
Phone: (305) 392-6214
Fax: (305) 260-6432

ARC
HOME SHOWCASE
ALUMINUM EXTRUSIONS

1/4/2016

SHEET: **6 OF 7**

EASTERN ENGINEERING GROUP
3401 NW 62 AVE SUITE 370 Miami, Florida 33122
Tel: (305) 556-9133 Fax: (305) 599-8076
www.eastmeg.com



REVISIONS
No. DATE DESCRIPTION

JOB No. **15 136**
DESIGNED & DRAWN:
SCALE: AS SHOWN

RAISSA R. LOPEZ, PE (Lic No-59399)
 GONZALO A. PAZ, PE (Lic No-60734)
CERT. OF AUTHORIZATION No. 26655




CODE	PART No.	DESCRIPTION
EXTRUSIONS		
E1	FX360-051	HEAD & SILL (STANDARD) 6063-T5 A.ALLOY.
E2	FX345-006	HEAD & SILL GLAZING COVER 6063-T5 A.ALLOY.
E3	FX345-005	INTERMEDIATE GLAZING COVER 6063-T6 A.ALLOY.
E4	FX360-068	FRAME JAMB 6063-T6 A.ALLOY.
E7	FX360-037	6" VERT. FEMALE MULLION 6063-T6 A.ALLOY.
E8	FX360-038	6" VERT. MALE MULLION 6063-T6 A.ALLOY.
E14	KSH660-006	VERTICAL MALE. 6" 6063-T6 A.ALLOY.
E15	KSH660-007	VERTICAL FEMALE. 6" 6063-T6 A.ALLOY.
GASKETS		
V1	V-059	BACK-UP VYNIL
V6	TAPE	3/16" x 3/8" FOAM TAPE SINGLE FACE. L.M.I.
MISCELLANEOUS		
M1		DC 983 SILICONE
M2		DC 795 SILICONE
M3		1/8" X 1/2" X 4" LG. SARLINK TPV 5775B SETTING BLOCK BY TEKNOR APEX CO. WITH HARDNESS 75±5 SHORE A
M4		2"X3"X 1/8" THK. ALUM TUBE, 7 3/4" LONG (ALLOY 6063-T5)
SCREWS		
S1		1/4"-20 X 1/2" LG. PH. PHILLIPS STS. ST/ST "F" POINT.
S2		1/4 DIAM. KWIK CON II (+). HX.HD (INSTALLATION, CS)
S3		#8 X 1" PH. SMS. ST/ST (TRANSPORTATION)
S4		#12 X 1 1/4" LG. HX. HD. SMS. ST/ST (ASSEMBLY)
S5		#10 x 1" LG. SMS PH PH TYPE B. ASSEMBLY S.S SCREW
S6		#8-18 x 1" LG. SMS PH PH S.STEEL
S7		#8-18 x 3/8" LG. SMS PH PH S.STEEL
S8		HH 1/4"-20 x 2 1/2" S.S. BOLT. FULL THREAD, Gr 5
S9		#8-18 x 7/16" UNDERCUT FLAT HEAD SMS SS 304
S10		#10-16 x 1/2" PH PH SMS SS 304
S11		#10-16 x 1 1/2" PH FH SMS SS 304
GLASS		
G1		9/16" LMI GLASS W/ 0.090" S.G. by KURARAY AMERICA, INC.

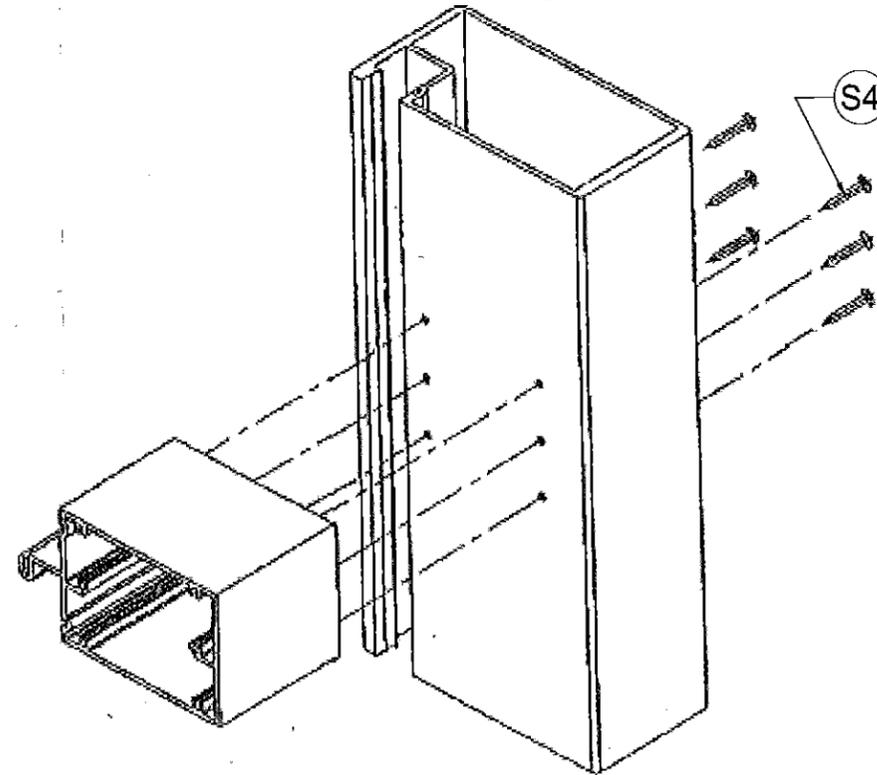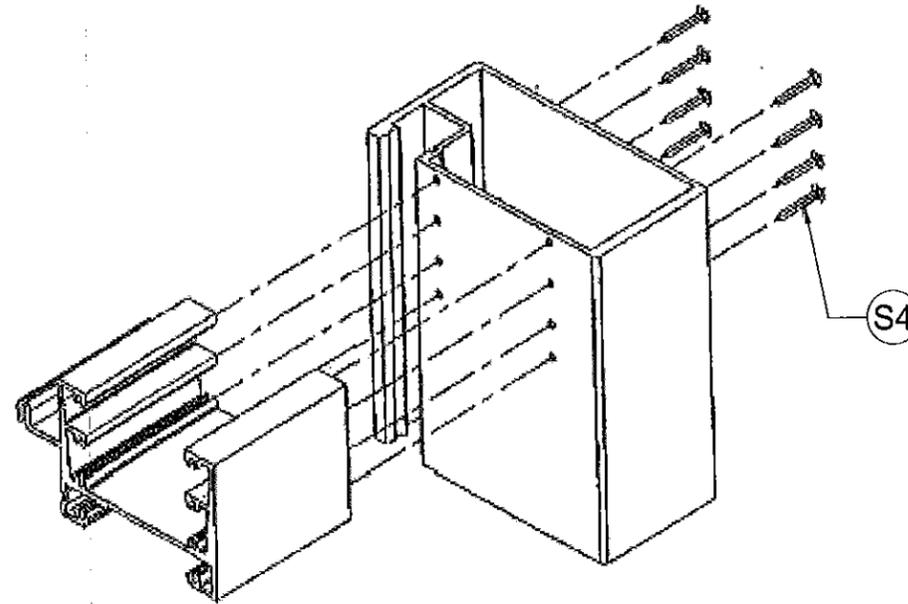

FRAME CORNER

Approved as complying with the Florida Building Code
 Date JAN 7 2016
 NOA 15-0902.01
 Miami Date Product Control
 By [Signature]

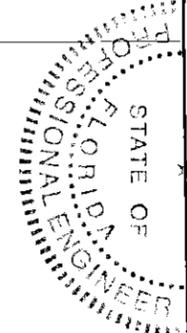


EASTERN ENGINEERING GROUP
 3401 NW 82 AVE SUITE 370 Miami, Florida 33122
 Tel: (305) 599-8733 Fax: (305) 599-8076
 www.eeasterneng.com
 RAISSA R. LOPEZ, PE (Lic No--59399)
 GONZALO A. PAZ, PE (Lic No--60734)
 CERT. OF AUTHORIZATION No. 26655

REVISIONS	DESCRIPTION	DATE	No.

JOB No. 15 136
 DESIGNED & DRAWN:
 SCALE: AS SHOWN

Product: NOA SERIES FX360 (LMI)
 16115 NW 52nd Ave.
 Miami Gardens, FL 33014
 Phone: (305) 392 - 6214
 Fax: (305) 260 - 6432



STATE OF FLORIDA
 PROFESSIONAL ENGINEER
 GONZALO A. PAZ
 License No. 60734
 1/7/2016