



MIAMI-DADE COUNTY  
 PRODUCT CONTROL SECTION  
 11805 SW 26 Street, Room 208  
 Miami, Florida 33175-2474  
 T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
 BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**Rupp Air Management Systems**  
**101 North Industrial Parkway**  
**West Union, IA 52175**

**SCOPE:** This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ). This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Utility Set Exhaust and A Series Supply Steel Rooftop Fans**

**APPROVAL DOCUMENT:** Drawing No. **NOA2**, titled "Steel Utility Set Exhaust and A Series Steel Supply Fans", sheets 1 through 16 of 16, dated 08/25/2008, with revision 4 dated 10/14/2013, prepared by Rupp Air Management Systems, signed and sealed by L. David Rice, P.E. on 03/22/2016, bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, one of the five manufacturing locations: Youngsville, NC or Muskogee, OK or Redding, CA or West Union, IA or Bedford, PA or Groveland, FL, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**LIMITATION:** These fans cannot be installed within the ridge area, FBC 1523.6.5.2.13.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises **NOA # 15-0410.12** and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



*Utrera*  
 07/01/2016

NOA No. 16-0407.03  
 Expiration Date: March 4, 2019  
 Approval Date: July 7, 2016  
 Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **NOA2**, titled "Steel Utility Set Exhaust and A Series Steel Supply Fans", sheets 1 through 16 of 16, dated 08/25/2008, with revision 4 dated 10/14/2013, prepared by CaptiveAire Systems, Inc, signed and sealed by L. David Rice, P.E. on 03/22/2016.

**B. TESTS "*Submitted under NOA # 14-0317.04*"**

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of Series/Model USBI 11 and USBI 36 roof mounted exhaust fans, prepared by Architectural Testing, Inc., Test Report No. **D2865.01-109-18**, dated 12/12/2013, signed and sealed by Michael D. Stremmel, P.E.

***"Submitted under NOA No. 12-0724.02"***

2. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of Series/Model CASRE roof mounted exhaust fan, prepared by Architectural Testing, Inc., Test Report No. **B9460.01-109-18**, dated 05/31/2012, signed and sealed by Michael D. Stremmel, P.E.

***"Submitted under NOA No. 08-1124.08"***

3. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
along with marked-up drawings and installation diagram of Series/Model HRE-24, high velocity roof fan, BI-36CARM, roof mounted exhaust fan and A5-925, modular down discharge blower, prepared by Architectural Testing, Inc., Test Report No. **83748.01-109-18**, dated 10/07/2008, with Revision 1 dated 01/06/2009, signed and sealed by Michael D. Stremmel, P.E.

**C. CALCULATIONS "*Submitted under NOA # 14-0317.04*"**

1. Anchor verification calculations prepared by Rice Engineering, dated 02/21/2014, signed and sealed by L. David Rice, P.E.

***"Submitted under NOA No. 12-0724.02"***

2. Anchor verification calculations prepared by Rice Engineering, dated 07/05/2012, signed and sealed by L. David Rice, P.E.

***"Submitted under NOA No. 08-1124.08"***

3. Anchor verification calculations, prepared by Rice Engineering, dated 11/12/2008, with revision dated 01/20/2008, signed and sealed by L. David Rice, P.E.



---

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 16-0407.03  
Expiration Date: March 4, 2019  
Approval Date: July 7, 2016

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of code conformance to the 5<sup>th</sup> edition (2014) FBC issued by Rice Engineering, dated 02/18/2016, signed and sealed by L. David Rice, P.E.  
  
*“Submitted under NOA # 15-0410.12”*
2. Private label agreement dated 03/17/2015.  
  
*“Submitted under NOA # 14-0317.04”*
3. Statement letters of code conformance to 2010 FBC and of no financial interest issued by Rice Engineering, dated 01/17/2014, signed and sealed by L. David Rice, P.E.  
  
*“Submitted under NOA No. 08-1124.08”*
4. Laboratory compliance letter issued by Architectural Testing, Inc., for Test Reports No. **83748.01-109-18**, dated 10/08/2008, signed and sealed by Michael D. Stremmel, P.E.



---

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 16-0407.03  
Expiration Date: March 4, 2019  
Approval Date: July 7, 2016

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**D. QUALITY ASSURANCE**

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

**E. MATERIAL CERTIFICATIONS**

1. None.

**F. STATEMENTS**

1. Statement letter of code conformance to the 5<sup>th</sup> edition (2014) FBC issued by Rice Engineering, dated 02/18/2016, signed and sealed by L. David Rice, P.E.

*“Submitted under NOA # 15-0410.12”*

2. Private label agreement dated 03/17/2015.

*“Submitted under NOA # 14-0317.04”*

3. Statement letters of code conformance to 2010 FBC and of no financial interest issued by Rice Engineering, dated 01/17/2014, signed and sealed by L. David Rice, P.E.

*“Submitted under NOA No. 08-1124.08”*

4. Laboratory compliance letter issued by Architectural Testing, Inc., for Test Reports No. **83748.01-109-18**, dated 10/08/2008, signed and sealed by Michael D. Stremmel, P.E.




---

Carlos M. Utrera, P.E.  
Product Control Examiner  
NOA No. 16-0407.03  
Expiration Date: March 4, 2019  
Approval Date: July 7, 2016

# Dimensional Data - Steel Utility Set Exhaust

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

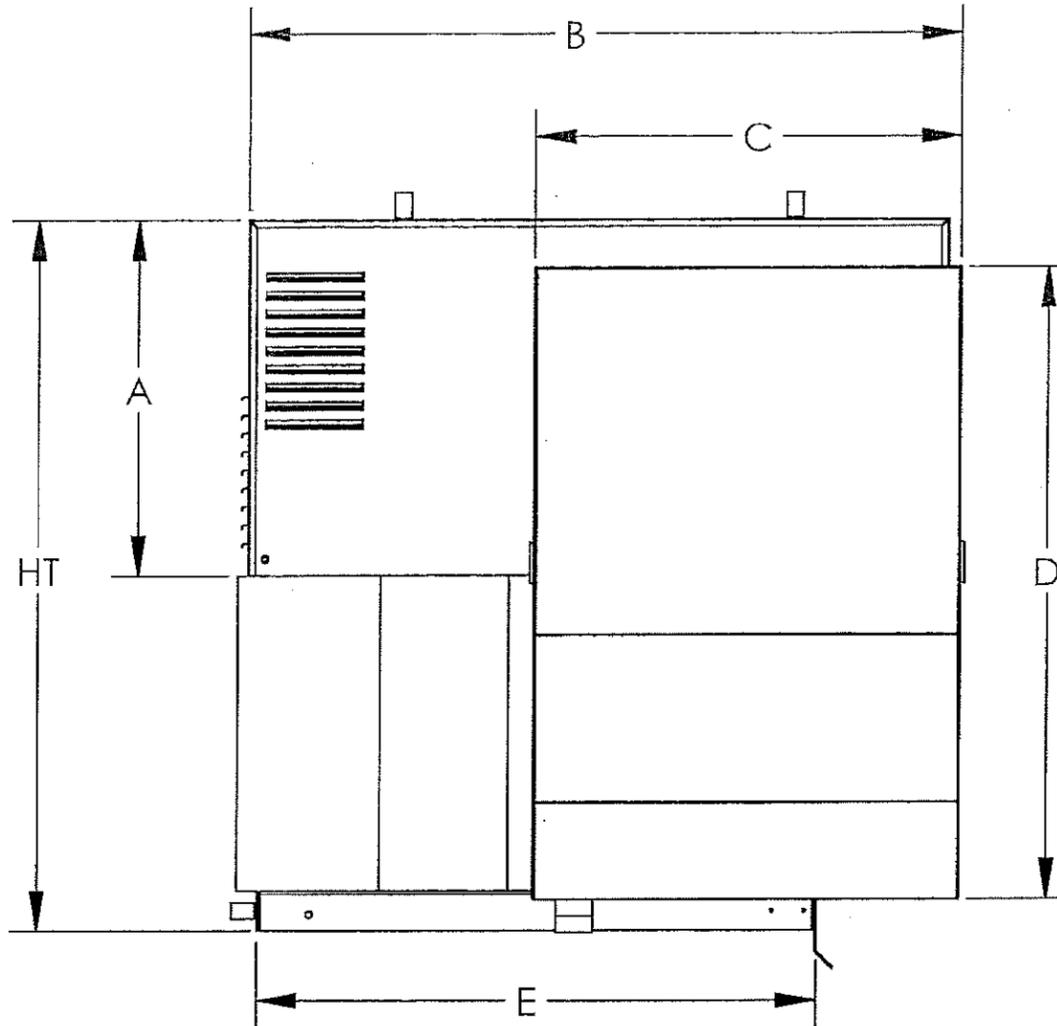


**General Notes:**

1. This approval is for the structural capacity and impact rating of the exterior housing only; it does not include any interior mechanism or electrical part.
2. These fans have not been wind tested for Wind Driven Rain Test per Florida Building code, TAS100 (A)-95.

**DESIGN PRESSURE: +30.0 / -130.0 PSF**  
**LARGE MISSILE IMPACT RESISTANT**

03/22/2016

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

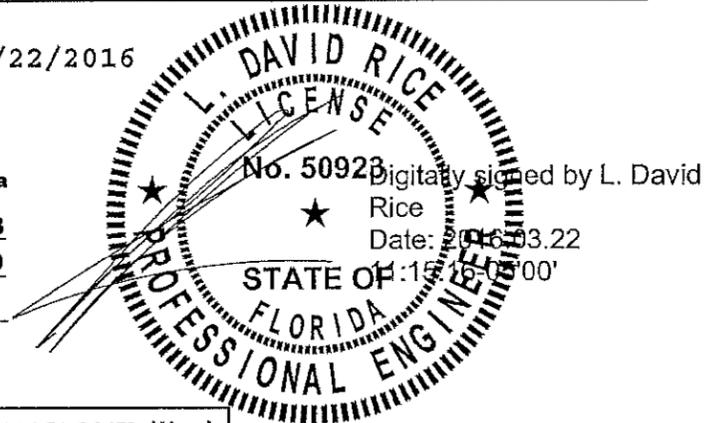

FAN MODEL	HT (in)	A (in)	B (in)	C (in)	D (in)	E (in)	WEIGHT (lbs)
RA-VE1300	30-15/16	17-3/4	23-1/2	14-3/4	25-1/2	21-1/2	147
RA-VE1600	34-1/4	18-1/4	29-1/4	17-7/8	29-1/2	25-1/2	204
RA-VE2000	40-1/16	21-3/4	36-3/8	21-1/2	33-7/8	29-1/2	251
RA-VE2400	43-5/8	21-3/4	43-1/4	26-1/4	38-3/4	34-1/2	362

Florida Firm No.: F-01000005061  
 Certificate of Authorization: 9090

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08034.

**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A  
 Blank Size: N/A x N/A  
 Weight: N/A lbs



Part Number: N/A  
 MACOLA Number: N/A  
 Drawing Name: HRE SERIES  
 Drawn By: N Perry  
 Drawing Number: NOA2  
 Sheet: 1 of 16

Unless Otherwise Specified  
 Dimensions are in Inches.  
 Standard Tolerances are:  
 Fractions: ±1/16  
 Decimal: .XX±05  
 .XXX±015  
 Angles: ±1°



# Exploded Material View - Steel Utility Set Exhaust

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

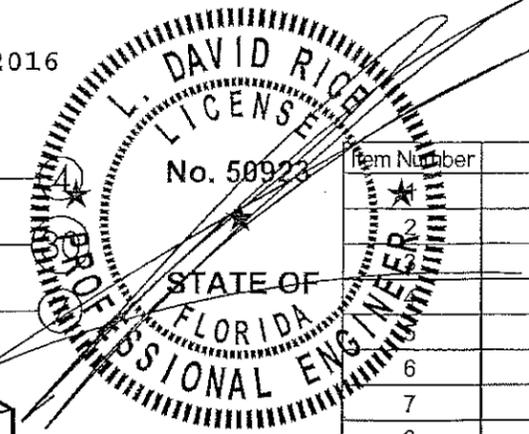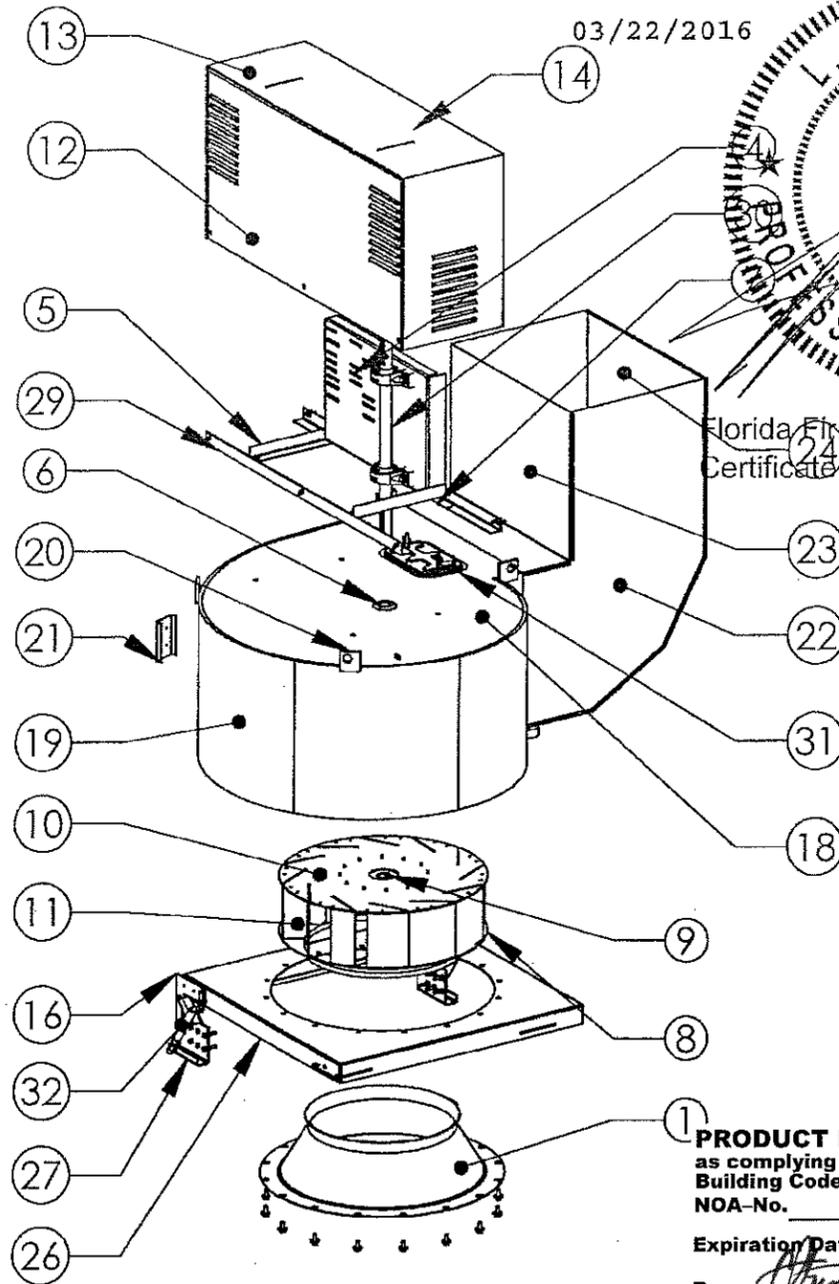

Florida Firm No.: F-01000005061  
 Certificate of Authorization: 9090

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

Item Number	Description	Material
1	INLET, STL	12G. HRP&O
2	BAFFLE (NOT SHOWN)	16G. HRP&O
3	BRG SUPPORT (NOT SHOWN)	1-1/2x1-1/2x1/8 ANGLE IRON
4	MOTOR P'FORM	11G. HRP&O
5	DRIVE FRAME, SIDE RAIL	1-1/2x1-1/2x1/8 ANGLE IRON
6	VINYL SEALING GROMMET - 1-7/16"	VINYL
7	VIBRATION ISOLATOR	RUBBER
8	SHROUD, STL	12G. HRP&O
9	HUBPLT	A-36 H.R, C.D. STRESS PROOF
10	BACK PLATE	8G. HRP&O
11	BLADE	10G. HRP&O INX50
12	DRIVE COVER SIDE	20G. GALV G90
13	DRIVE COVER TOP	20G. GALV G90
14	HANDLE	11G. HRP&O
15	CURB BRKT RH, FORMED (NOT SHOWN)	3/16 HRP&O
16	CURB BRKT LH, FORMED	3/16 HRP&O
17	END, OPEN, LASER (NOT SHOWN)	14G. HRPO
18	END, CLOSED, LASER	14G. HRPO
19	SCROLL, FORMED	16G. HRP&O
20	MOTOR P'FORM LUG	3/8 FLAT BAR (HR)
21	DISCONNECT BRKT	12G. HRP&O
22	EXHAUST DUCT SIDE	16G. HRP&O
23	EXHAUST DUCT TOP	16G. HRP&O
24	EXHAUST DUCT BOTTOM	16G. HRP&O
25	BI DRAIN FTG (NOT SHOWN)	BLACK IRON PIPE
26	LIFTING FRAME CAP	12G. HRP&O
27	PIVOT BRKT LH	3/16 HRP&O
28	PIVOT BRKT RH (NOT SHOWN)	3/16 HRP&O
29	DRIVE FRAME, BOTTOM RAIL	1-1/2x1-1/2x1/8 ANGLE IRON
30	SHAFT	1-7/16 C1045 HSDF
31	CLEANOUT DOOR	HOT DIPPED GALV
32	GAS SHOCK	N/A

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08034.

**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A  
 Blank Size: N/A x N/A  
 Weight: N/A lbs


Part Number: N/A  
 MACOLA Number: N/A  
 Drawing Name: HRE SERIES  
 Drawn By: N Perry  
 Drawing Number: NOA2  
 Sheet: 2 of 16

Unless Otherwise Specified  
 Dimensions are in Inches.  
 Standard Tolerances are:  
 Fractions: ±1/16  
 Decimal: .XX±.05  
 .XXX±.015  
 Angles: ±1°





# Installation - Steel Utility Set Exhaust

03/22/2016

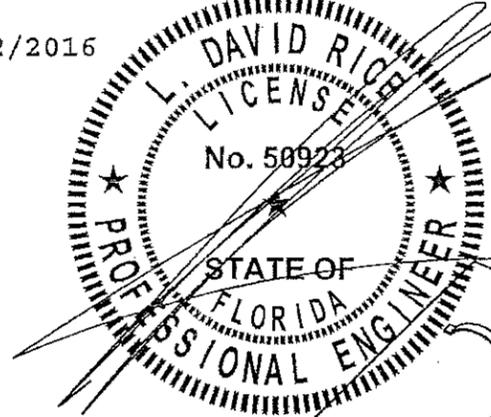


Florida Firm No.: F-01000005061  
Certificate of Authorization: 8090

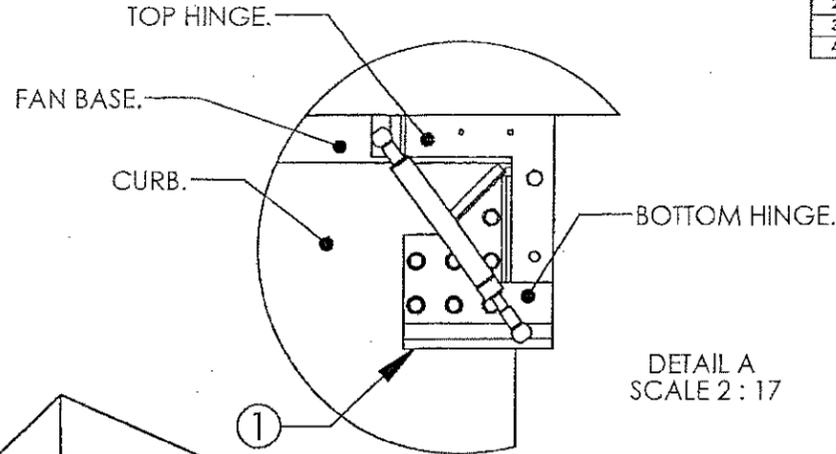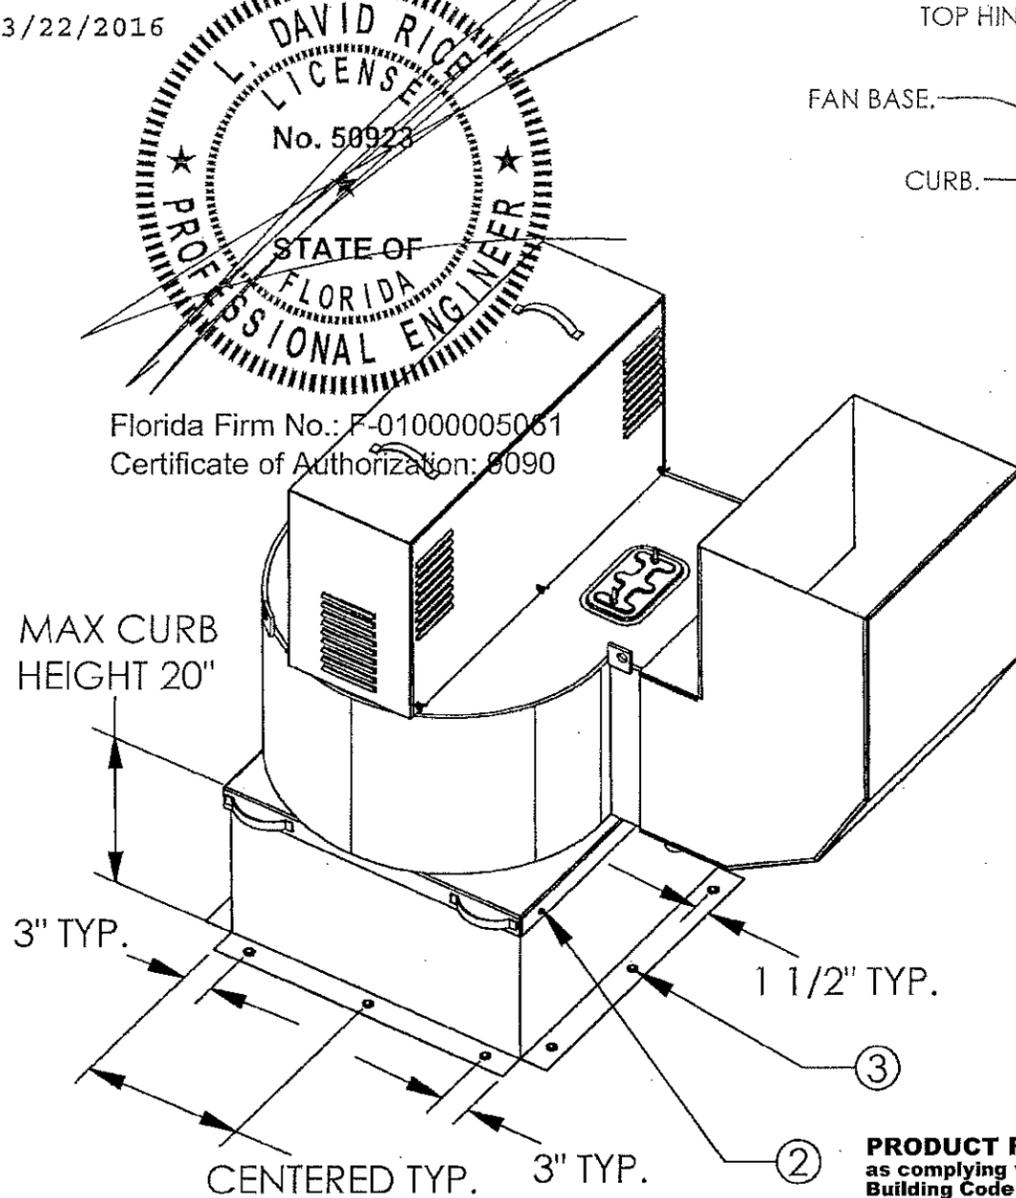

DETAIL A  
SCALE 2:17

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

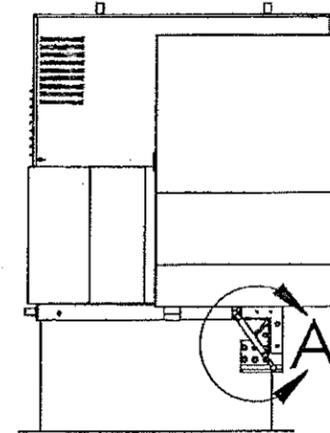

1. ALL HRE FANS COME WITH A HINGE KIT STANDARD THE TOP HINGE IS FACTORY INSTALLED THE BOTTOM HINGE SHOULD BE INSTALLED PER DIRECTIONS PROVIDED WITH HARDWARE.

2. SECURE FAN BASE TO CURB USING A MINIMUM OF (2) 1/4"-14 X 2" ZINC PLATED STEEL SELF DRILLING SCREWS THROUGH PRE-PUNCHED HOLES IN THE FAN BASE.

3. SECURE CURB TO ROOF FRAMING MEMBERS BY DRILLING 1/4" DIA PILOT HOLES IN THE CURB FLANGE AT LOCATIONS SHOWN IN THE DIAGRAM AND USING A MINIMUM OF (12) 3/8" X 2" (MINIMUM ENBEDMENT), ZINC PLATED STEEL LAG BOLTS AND ZINC PLATED WASHERS FOR 3/8" SCREW SIZE THROUGH FLANGE AND INTO ROOF FRAMING MEMBERS WITH A MAXIMUM SPACING OF 16 7/8".

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **16-0407.03**  
Expiration Date **03/04/2019**  
By *[Signature]*  
Miami-Dade Product Control

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08034.

**Rupp Air Management Systems**  
101 North Industrial Parkway West  
Union, IA 52175  
P 800.334.9256 / 919.227.5994

Material: N/A  
Blank Size: N/A x N/A  
Weight: N/A lbs

Part Number: N/A  
MACOLA Number: N/A  
Drawing Name: HRE SERIES  
Drawn By: N Perry  
Drawing Number: NOA2  
Sheet: 3 of 16


Unless Otherwise Specified  
Dimensions are in Inches.  
Standard Tolerances are:  
Fractions: ±1/16  
Decimal: .XX±.05  
.XXX±.015  
Angles: ±1°



**RUPPAIR**  
MANAGEMENT SYSTEMS®

# Dimensional Data - Steel Utility Set Exhaust

03/22/2016

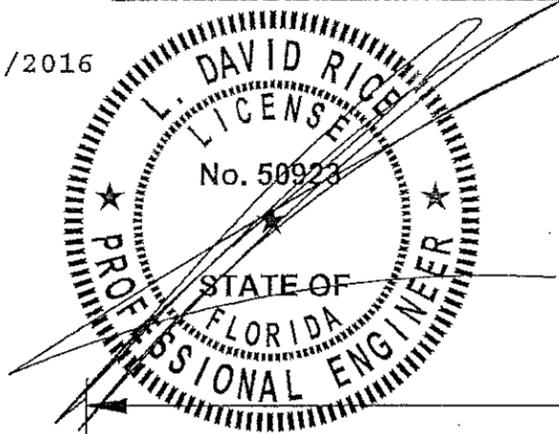


**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

**General Notes:**

1. This approval is for the structural capacity and impact rating of the exterior housing only; it does not include any interior mechanism or electrical part.
2. These fans have not been wind tested for Wind Driven Rain Test per Florida Building code, TAS100 (A)-95.

Florida Firm No.: F-01000005061  
 Certificate of Authorization: 9090

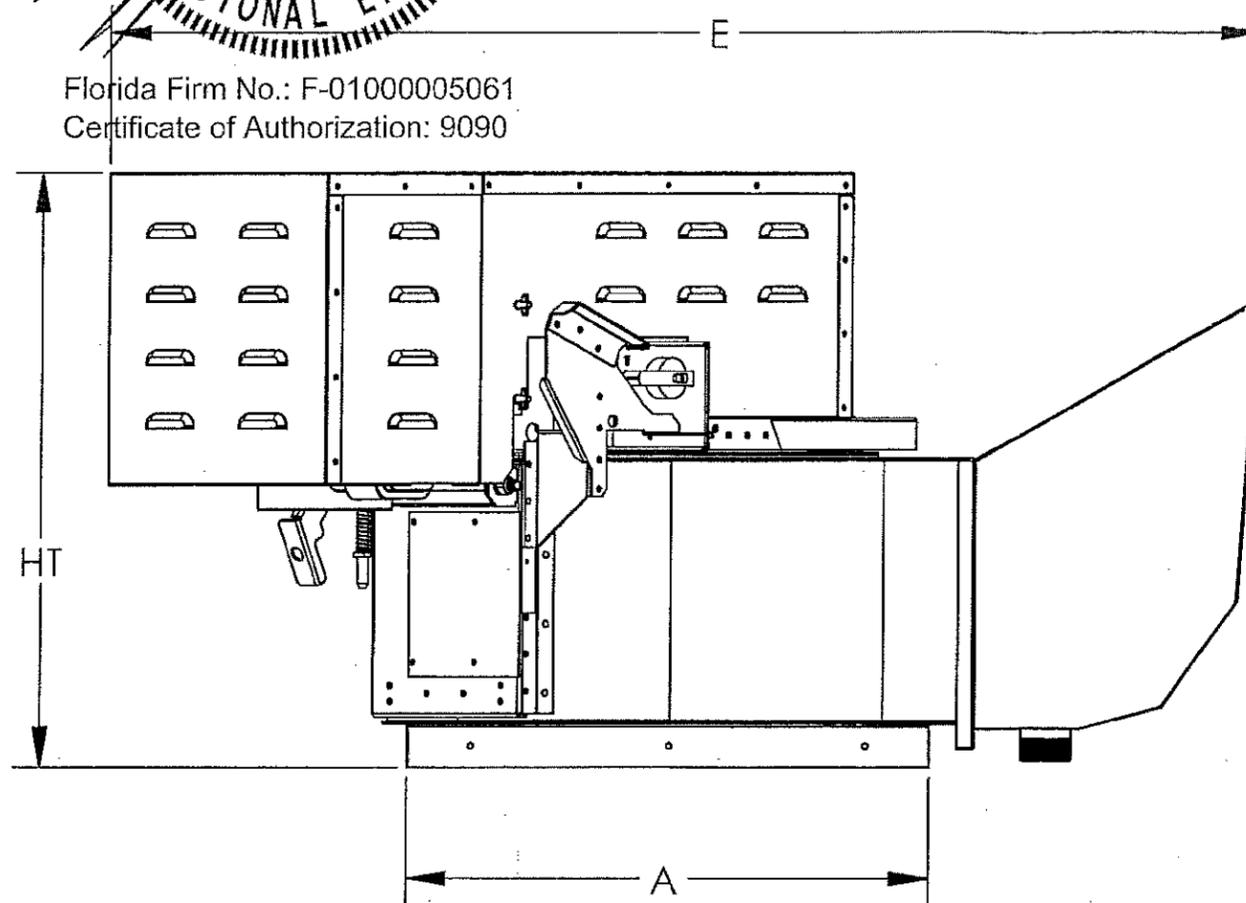

FAN MODEL	HT (in)	A (in)	E (in)	WEIGHT (lbs)
RA-RE1300BD	27	21	49	191
RA-RE1300DD	28-1/4	21	42	163
RA-RE1500BD	28	24-3/4	54	229
RA-RE1500DD	29-3/8	24-3/4	46	198
RA-RE1800BD	29-1/2	28	58	264
RA-RE1800DD	30-7/8	28	51	228
RA-RE2000BD	32	28	64	323
RA-RE2000DD	32	28	56	302
RA-RE2400BD	36	33	73	414
RA-RE2400DD	36	33	65	389

**DESIGN PRESSURE: +100.0 / -100.0 PSF**  
**LARGE MISSILE IMPACT RESISTANT**

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 12024.


**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A	Part Number: N/A	Unless Otherwise Specified Dimensions are in inches.  Standard Tolerances are: Fractions: ±1/16 Decimal: .XX±.05 .XXX±.015 Angles: ±1°
Blank Size: N/A x N/A	MACOLA/AX Number: N/A	
Weight: N/A lbs	Drawing Name: RE SERIES	
	Drawn By: N Perry	
	Drawing Number: NOA2	
	Sheet: 4 of 16	



# Exploded Material View - Steel Utility Set Exhaust

03/22/2016

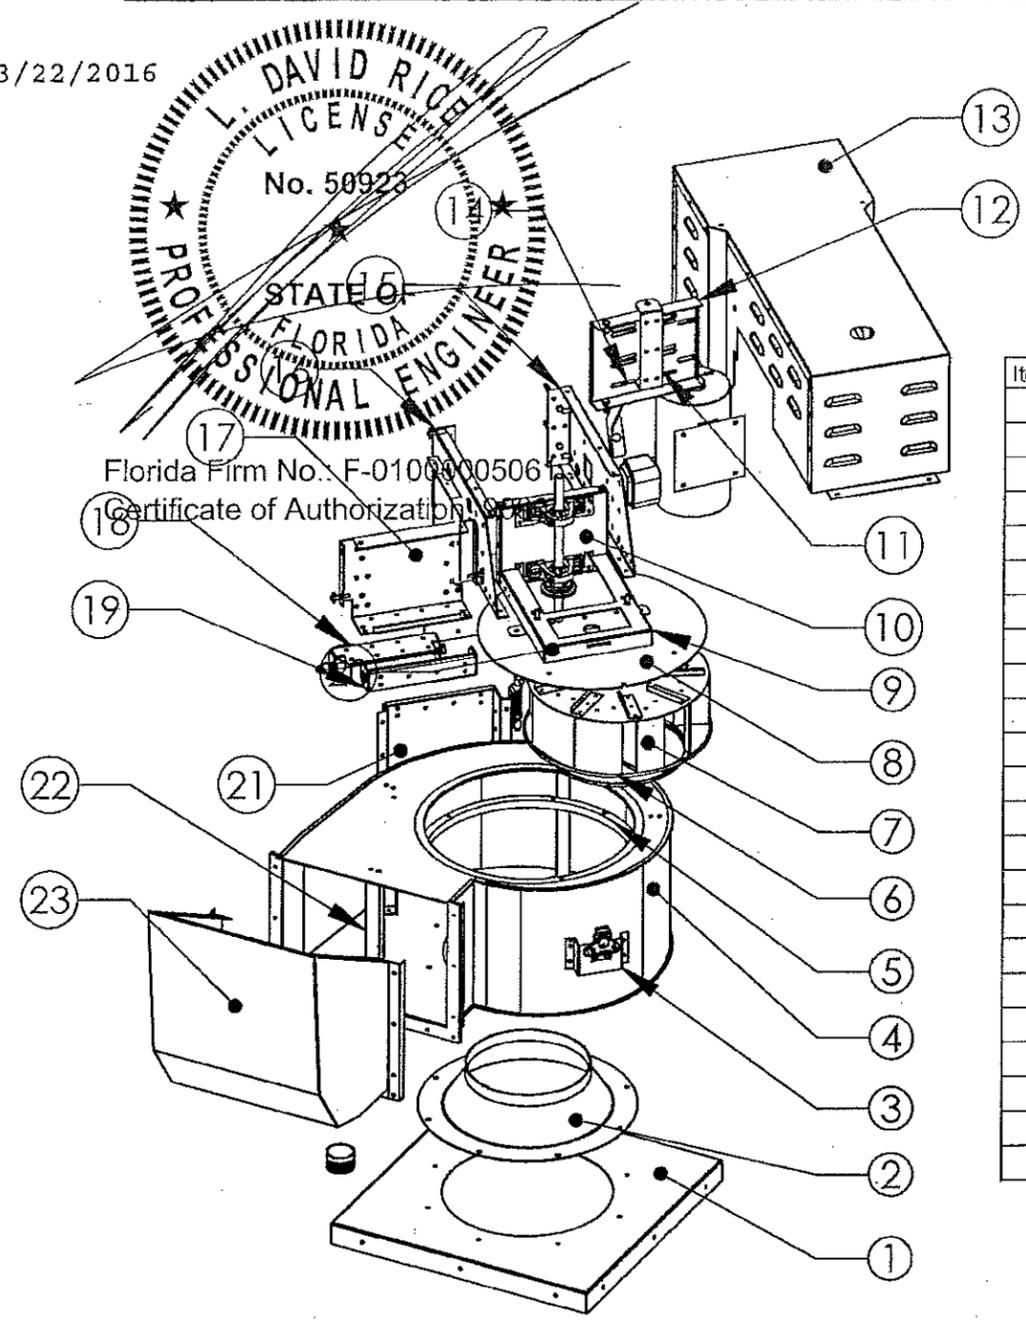

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

Item Number	Description	Material
1	FAN BASE	16 GA GALVANIZED G90 STEEL
2	SPUN INLET	.080 1100-0 ALUMINUM
3	LATCH PLATE	16 GA GALVANIZED G90 STEEL
4	SCROLL HOUSING ASSEMBLY	20 GA ALUMINIZED STEEL
5	SCROLL SUPPORT RING	5/8 X 3/4 X 1/8 GALVANIZED STEEL G90 STEEL
6	WHEEL VENTURI	.080 3003-0 ALUMINUM
7	WHEEL BLADE	.080 5052-H32 ALUMINUM
8	TOP PLATE	12 GA GALVANIZED G90 STEEL
9	LIFTING HANDLE	12 GA GALVANIZED G90 STEEL
10	BEARING PLATE	12 GA GALVANIZED G90 STEEL
11	MOTOR PIVOT PLATE	10 GA GALVANIZED G90 STEEL
12	MOTOR PLATE	12 GA GALVANIZED G90 STEEL
13	MOTOR COVER	20 GA GALVANIZED G90 STEEL
14	LOCK PLATE	10 GA GALVANIZED G90 STEEL
15	SUPPORT PLATE RIGHT	12 GA GALVANIZED G90 STEEL
16	SUPPORT PLATE LEFT	12 GA GALVANIZED G90 STEEL
17	SUPPORT END PLATE	10 GA GALVANIZED G90 STEEL
18	FAN PIVOT PLATE A	10 GA GALVANIZED G90 STEEL
19	FAN PIVOT PLATE B	10 GA GALVANIZED G90 STEEL
20	WHEEL BLADE TOP	16 GA GALVANIZED G90 STEEL
21	POWER PACK BACK SUPPORT	10 GA GALVANIZED G90 STEEL
22	SCROLL SUPPORT	16 GA GALVANIZED G90 STEEL
23	GREASE SCOOP	18 GA ALUMINIZED G90 STEEL

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number ATI 12024.

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control


**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A	Part Number: N/A	Unless Otherwise Specified Dimensions are in Inches.
Blank Size: N/A x N/A	MACOLA/AX Number: N/A	
Weight: N/A lbs	Drawing Name: RE SERIES	
	Drawn By: N Perry	
	Drawing Number: NOA2	
	Sheet: 5 of 16	Standard Tolerances are: Fractions: ±1/16 Decimal: XX±.05 XXX±.015 Angles: ±1°



# Installation - Steel Utility Set Exhaust


03/22/2016

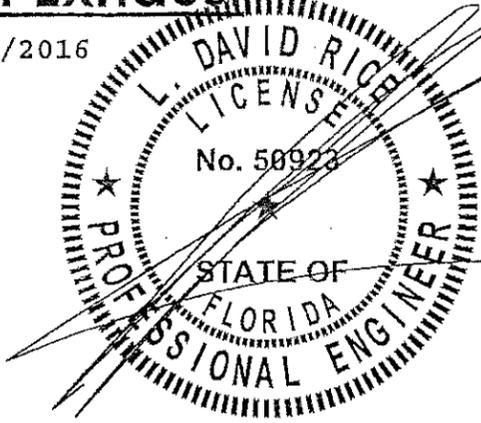

Florida Firm No.: F-0100005061  
 Certificate of Authorization: 9090

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By   
 Miami-Dade Product Control

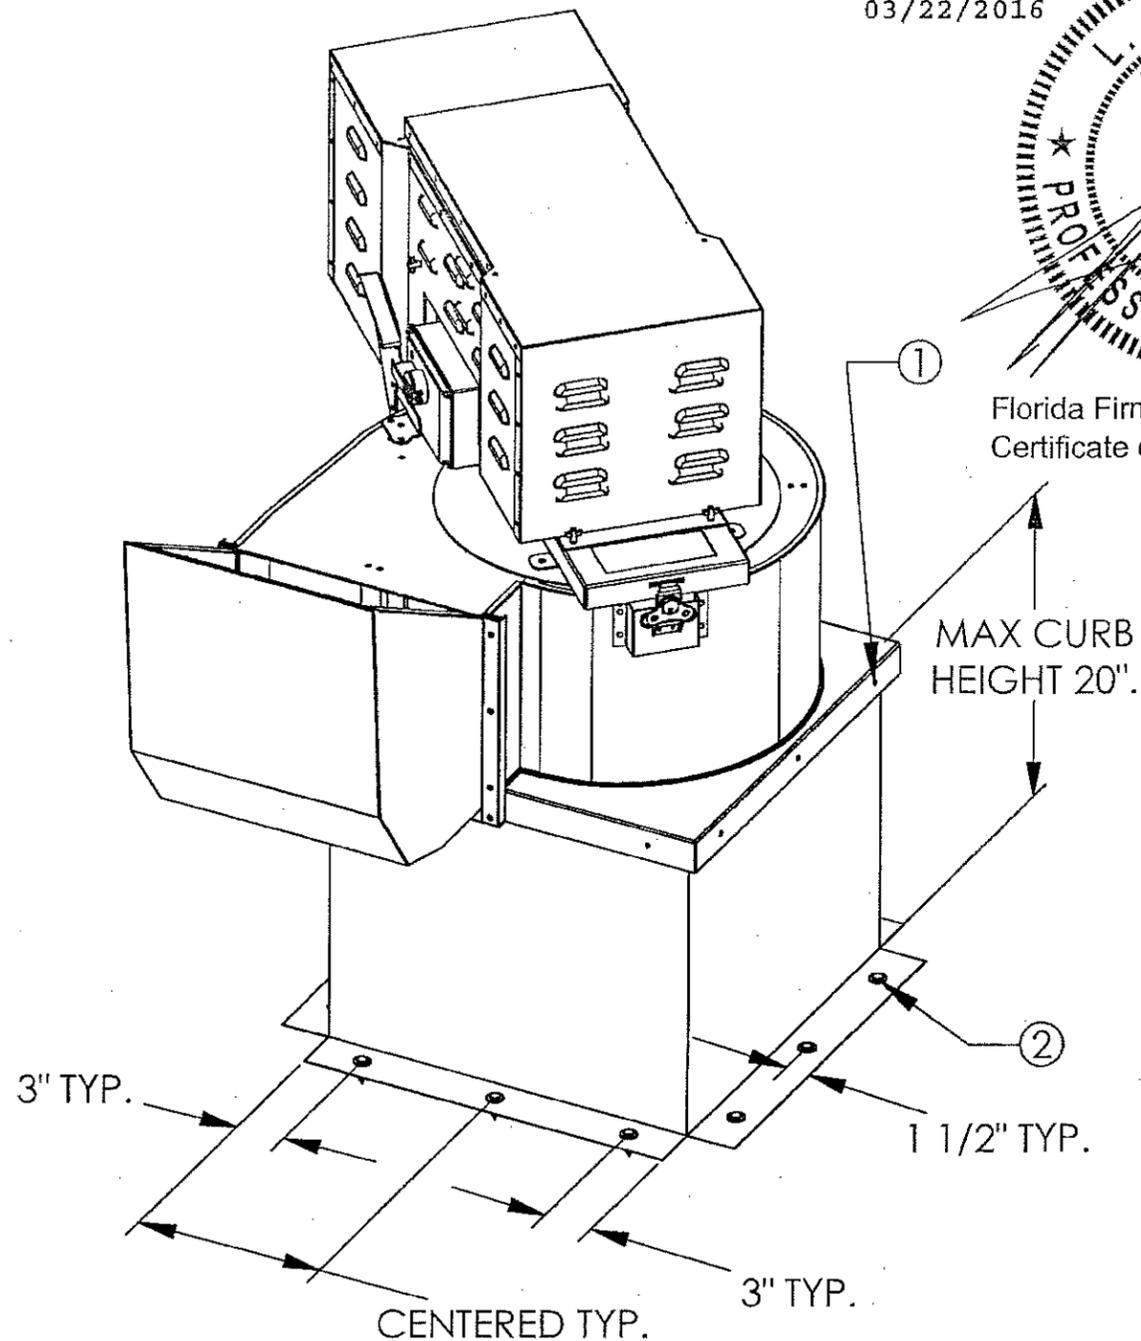

1. SECURE FAN BASE TO CURB USING A MINIMUM OF (12) 1/4"-14 X 2" ZINC PLATED STEEL SELF DRILLING SCREWS THROUGH PRE-PUNCHED HOLES IN THE FAN BASE.
2. SECURE CURB TO ROOF FRAMING MEMBERS BY DRILLING 1/4" DIA PILOT HOLES IN THE CURB FLANGE AT LOCATIONS SHOWN IN THE DIAGRAM AND USING A MINIMUM OF (12) 3/8" X 2" (MINIMUM ENBEDMENT), ZINC PLATED STEEL LAG BOLTS AND ZINC PLATED WASHERS FOR 3/8" SCREW SIZE THROUGH FLANGE AND INTO ROOF FRAMING MEMBERS WITH A MAXIMUM SPACING OF 16 7/8".

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number ATI 12024.

**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994


Material: N/A  
 Blank Size: N/A x N/A  
 Weight: N/A lbs

Part Number: N/A  
 MACOLA/AX Number: N/A  
 Drawing Name: RE SERIES  
 Drawn By: N Perry  
 Drawing Number: NOA2  
 Sheet: 6 of 16


Unless Otherwise Specified  
 Dimensions are in inches.  
 Standard Tolerances are:  
 Fractions: ±1/16  
 Decimal: .XX±.05  
 .XXX±.015  
 Angles: ±1°



# Dimensional Data - Steel Utility Set Exhaust

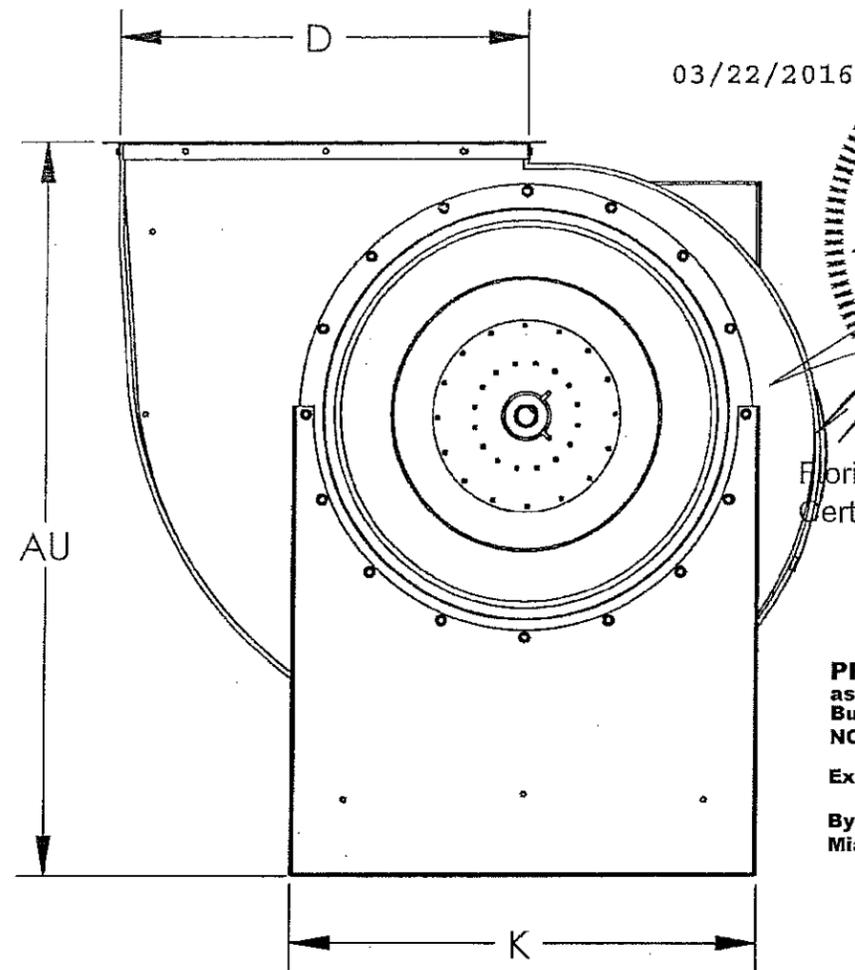

03/22/2016

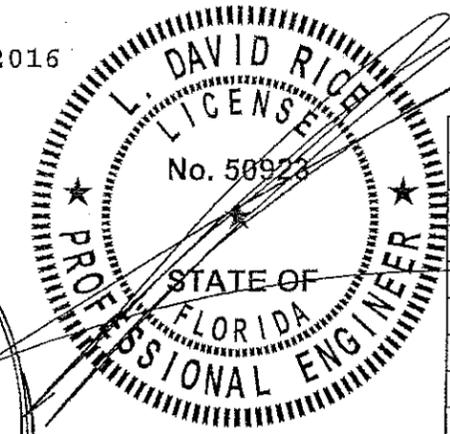

Florida Firm No.: F-01000005061  
Certificate of Authorization: 9090

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **16-0407.03**  
Expiration Date **03/04/2019**  
By *[Signature]*  
Miami-Dade Product Control

**DESIGN PRESSURE: +30.0 / -130.0 PSF**  
**LARGE MISSILE IMPACT RESISTANT**

**General Notes:**

1. This approval is for the structural capacity and impact rating of the exterior housing only; it does not include any interior mechanism or electrical part.
2. These fans have not been wind tested for Wind Driven Rain Test per Florida Building code, TAS100 (A)-95.

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08034.

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

FAN MODEL	AU (in)	D (in)	K (in)	WEIGHT (lbs)
BI10RARM	23-5/8	11-5/16	13-3/16	90
BI12RARM	30-1/16	13	16-9/16	165
BI13RARM	30-13/16	14-3/8	16-9/16	170
BI15RARM	31-13/16	15-3/4	16-9/16	180
BI16RARM	34-11/16	17-5/8	16-7/16	200
BI18RARM	35-13/16	19-3/8	16-9/16	220
BI20RARM	42-15/16	21-1/4	25-1/4	405
BI22RARM	44-3/8	23-5/8	25-1/4	430
BI24RARM	49-13/16	26	29-15/16	500
BI27RARM	51-7/16	28-5/8	28-15/16	525
BI30RARM	64-11/16	31-3/4	43-3/8	800
BI33RARM	65-5/8	34-7/8	43-3/8	875
BI36RARM	68-13/16	38-5/8	43-3/8	915
CB10RARM	23-1/2	8-1/4	13	60
CB12RARM	24-1/16	13-1/8	16	110
CB15RARM	29-1/8	16-1/8	19	140
CB18RARM	35-1/2	19-9/16	22-5/8	210
CB20RARM	38-7/8	21-7/16	22-5/8	250
CB22RARM	42-7/8	23-13/16	26-1/8	320
CB24RARM	49-9/16	26-3/16	26-1/8	380
CB27RARM	52	29	30-3/8	450
CB30RARM	59-1/4	32-3/16	39	750
CB36RARM	71-3/8	39-1/8	47	990
USI100RA	20-11/16	11-1/4	9-1/16	99
USI137RA	27-3/8	15-5/8	12-7/8	161
USI161RA	32-1/4	18-1/8	15-1/8	203
USI200RA	38-3/4	22-3/8	15-1/2	237
USI245RA	48-9/16	27-3/8	18-1/2	375
USI270RA	46-3/8	30-1/8	18-1/2	383
USI300RA	56-5/8	33-7/16	21-3/4	585
USI330RA	58-1/2	36-3/4	21-3/4	592
USI365RA	62-3/4	40-5/8	22-3/8	714


**Rupp Air Management Systems**  
101 North Industrial Parkway West  
Union, IA 52175  
P 800.334.9256 / 919.227.5994

Material: N/A	Part Number: N/A	Unless Otherwise Specified Dimensions are in Inches.  Standard Tolerances are: Fractions: ±1/16 Decimal: .XX±.05 .XXX±.015 Angles: ±1°
Blank Size: N/A x N/A	MACOLA Number: N/A	
Weight: N/A lbs	Drawing Name: BI, CB, USI, SERIES	
	Drawn By: N Perry	
	Drawing Number: NOA2	
	Sheet: 7 of 16	




# Exploded Material View - Steel Utility Set Exhaust

03/22/2016

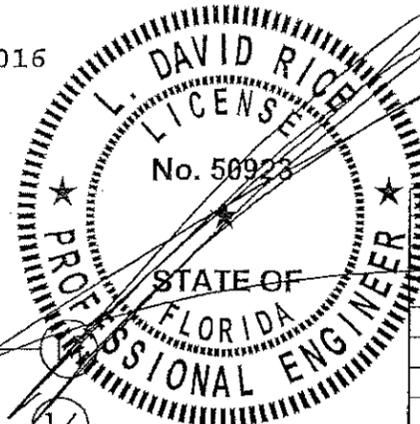

Florida Firm No.: F-01000005061  
 Certificate of Authorization: 9090

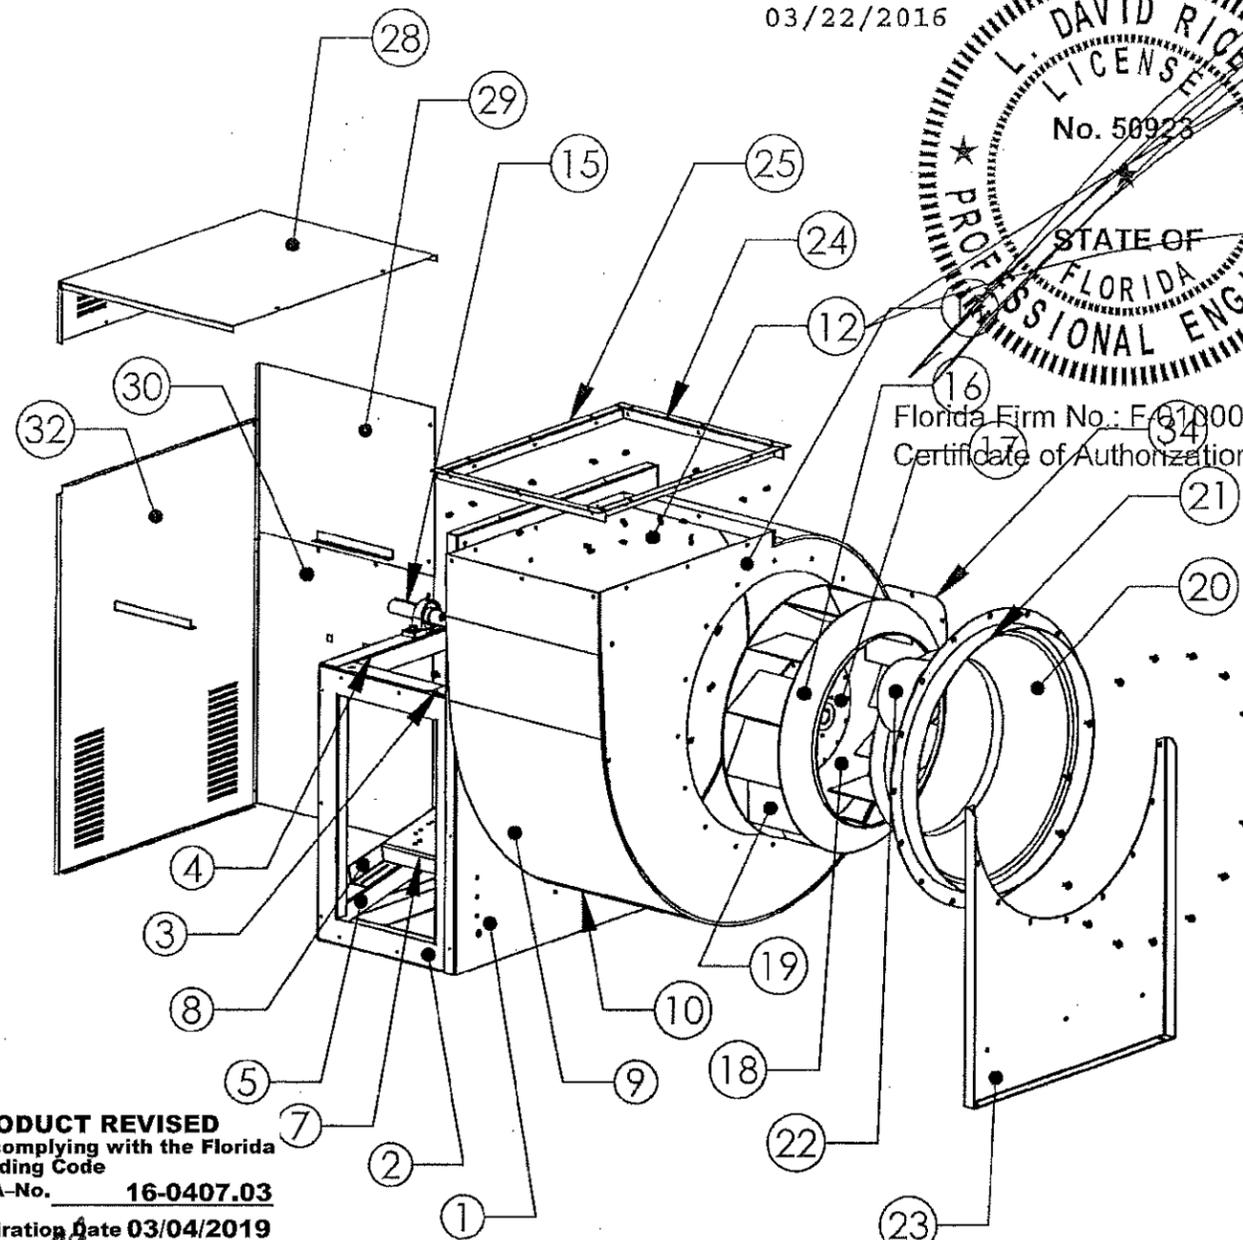

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

Item Number	Description	Material
1	BACK PANEL	11G. HRP&O
2	CAB SIDE	11G. HRP&O
3	BRG SUPPT/INNER	11G. HRP&O
4	BRG SUPPT/OUTER FRAME	11G. HRP&O
5	BRG SUPPT/OUTER FRAME	11G. HRP&O
6	STRTH ANGLE (NOT SHOWN)	2X2X1/8 ANGLE IRON
7	MOTOR P'FORM BASE	3/16 HRP&O
8	MOTOR SLIDE RAIL	11G. HRP&O
9	SCROLL, FLG SIDE	16G. HRP&O
10	SCROLL, BTM SIDE	16G. HRP&O
11	END OPEN,LASER	14G. HRP&O
12	END CLOSED,LASER	14G. HRP&O
13	BI DRAIN FTG (NOT SHOWN)	BLACK IRON PIPE
14	ALUM SHAFT SLEEVE (NOT SHOWN)	3/16 ALUM
15	SHAFT	C1045 HSDF
16	SHROUD,ALUM	5052-H32 ALUM
17	HUBPLATE ALUM	2024-T351 ALUM
18	BACKPLATE	1/4G 5052-H32 ALUM
19	BLADE	3/16G 5052-H32 ALUM
20	INLET,STL	12G. HRP&O
21	COLLAR-INLET	12G. HRP&O
22	BAFFLE LASER	14G. HRP&O
23	LEG	11G. HRP&O
24	DISCH FLNG HORZ	12G. HRP&O
25	DISCH FLNG VERT	12G. HRP&O
26	9212 SIDE DISCH. FLANGE (NOT SHOWN)	18G. G90
27	CAB COVER TOP SIDE LH (NOT SHOWN)	20G. G90
28	CAB COVER TOP	20G. G90
29	CAB COVER TOP SIDE RH	20G. G90
30	CAB COVER BTM SIDE RH	20G. G90
31	CAB COVER BTM SIDE LH (NOT SHOWN)	20G. G90
32	CAB COVER BACK	20G. G90
33	HANDLE BI'S (NOT SHOWN)	11G. HRP&O
34	CLEANOUT DOOR	16G. HRP&O

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**

By *[Signature]*  
 Miami-Dade Product Control

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number ATI 08034.


**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A	Part Number: N/A	Unless Otherwise Specified Dimensions are in Inches.  Standard Tolerances are: Fractions: ±1/16 Decimal: .XX±.05 XXX±.015 Angles: ±1°
Blank Size: N/A x N/A	MACOLA Number: N/A	
Weight: N/A lbs	Drawing Name: BI, CB, USI, SERIES	
	Drawn By: N Perry	
	Drawing Number: NOA2	
	Sheet: 8 of 16	



# Installation - Steel Utility Set Exhaust



03/22/2016

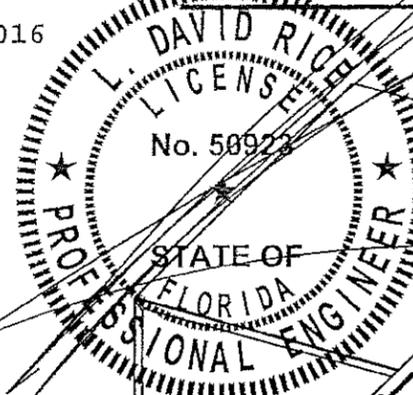

Florida Firm No.: F-01000095061  
Certificate of Authorization: 9090

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **16-0407.03**  
Expiration Date **03/04/2019**  
By *[Signature]*  
Miami-Dade Product Control

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

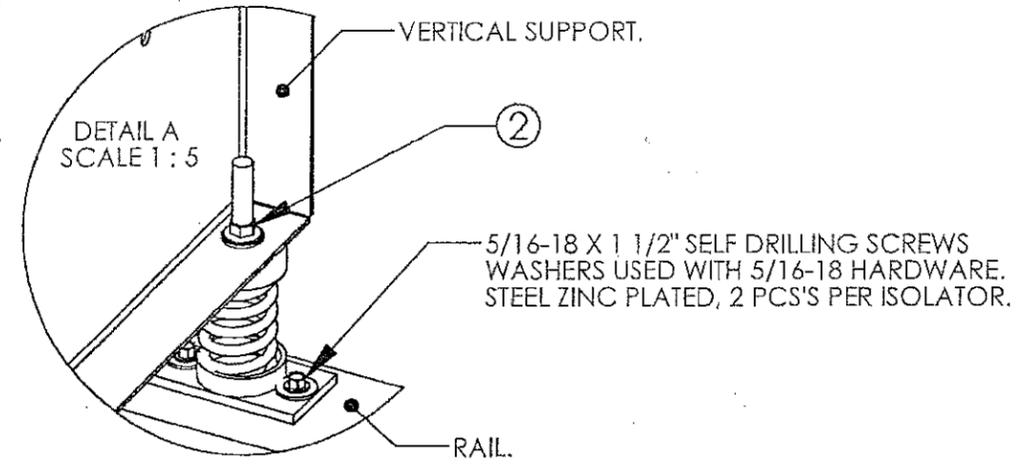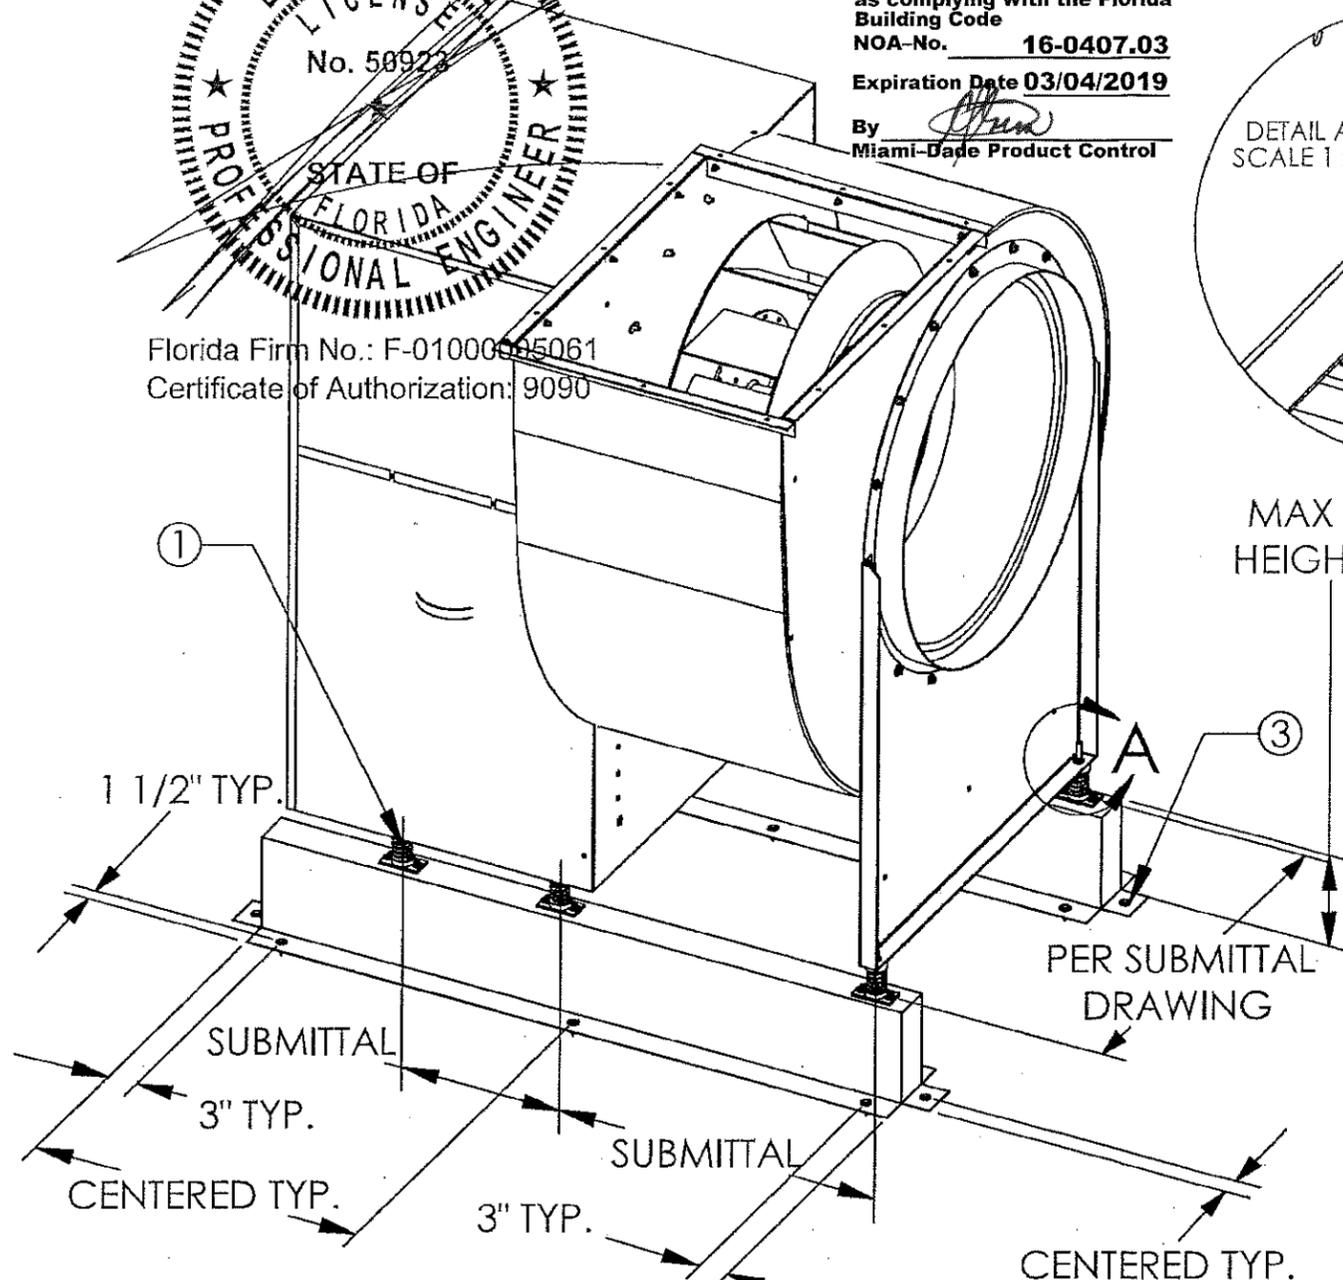

1. LOCATE VIBRATION ISOLATORS AS NEEDED ON THE RAIL CENTER ON THE RAIL AND SECURE WITH 5/16-18 X 1 1/2" SELF DRILLING SCREWS AND APPROPRIATE SIZED WASHERS ALL HARDWARE SHOULD BE STEEL ZINC PLATED.
2. THE VIBRATION ISOLATOR IS BOLTED TO THE FAN PER THE INSTRUCTION GUIDE SUPPLIED WITH THE ISOLATOR.
3. SECURE RAIL TO ROOF FRAMING MEMBERS BY DRILLING 1/4" DIA PILOT HOLES IN THE RAIL FLANGE AT LOCATIONS SHOWN IN THE DIAGRAM AND USING A MINIMUM OF (8) 3/8" X 2" (MINIMUM ENBEDMENT), ZINC PLATED STEEL LAG BOLTS AND ZINC PLATED WASHERS FOR 3/8" SCREW SIZE THROUGH FLANGE AND INTO ROOF FRAMING MEMBERS WITH A MAXIMUM SPACING OF 34 1/2".

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number ATI 08034.



**Rupp Air Management Systems**  
101 North Industrial Parkway West  
Union, IA 52175  
P 800.334.9256 / 919.227.5994

Material: N/A	Part Number: N/A	Unless Otherwise Specified Dimensions are in inches.
Blank Size: N/A x N/A	MACOLA Number: N/A	
Weight: N/A lbs	Drawing Name: BI, CB, USI, SERIES	
	Drawn By: N Perry	
	Drawing Number: NOA2	
	Sheet: 9 of 16	Standard Tolerances are: Fractions: ±1/16 Decimal: .XX±.05 .XXX±.015 Angles: ±1°



# Dimensional Data - Steel Utility Set Exhaust

03/22/2016

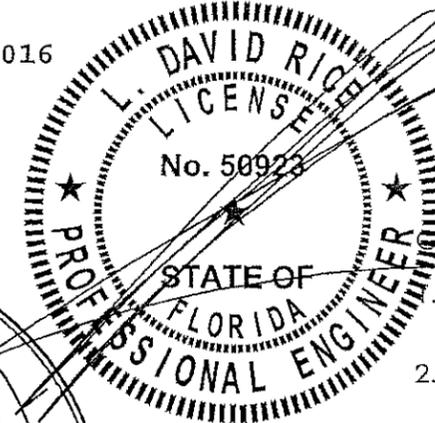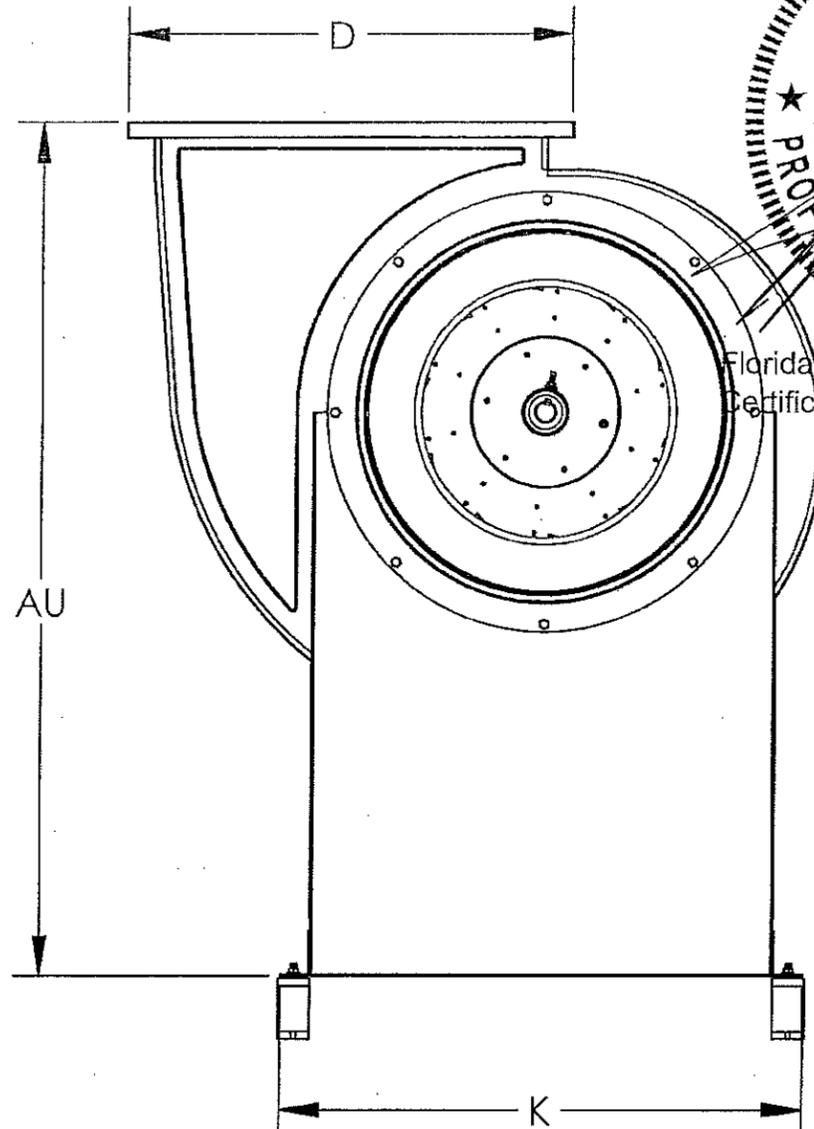

Florida Firm No.: F-01000005061  
 Certificate of Authorization: 9090

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

**General Notes:**

- This approval is for the structural capacity and impact rating of the exterior housing only; it does not include any interior mechanism or electrical part.
- These fans have not been wind tested for Wind Driven Rain Test per Florida Building code, TAS100 (A)-95.

FAN MODEL	AU (in)	D (in)	K (in)	WEIGHT (lbs)
RABI11BD-RM	27-1/8	12	17-5/8	165
RABI13BD-RM	31-3/8	14	19-5/8	190
RABI15BD-RM	35-3/4	16-3/8	22	235
RABI18BD-RM	42-1/8	19-1/2	26-1/4	318
RABI20BD-RM	47-7/8	21-1/2	27-7/8	373
RABI24BD-RM	56-3/8	25-3/4	34-7/8	684
RABI30BD-RM	61-7/8	32	41-5/8	999
RABI36BD-RM	69-1/4	38-5/8	47-3/8	1280

**DESIGN PRESSURE: +112.5 / -112.5 PSF**  
**LARGE MISSILE IMPACT RESISTANT**

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

**Notes:**

- Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
- Tested for areas including high velocity hurricane zones.
- Tested under Miami-Dade County Notification number ATI 08034.

Material: N/A  
 Blank Size: N/A x N/A  
 Weight: N/A lbs  
**CONFIDENTIAL**


Part Number: N/A  
 MACOLA/AX Number: N/A  
 Drawing Name: USBI SERIES  
 Drawn By: N Perry  
 Parent Assembly: NOA2  
 Sheet: 10 of 16


Unless Otherwise Specified  
 Dimensions are in Inches.  
 Standard Tolerances are:  
 Fractions: ±1/16  
 Decimal: .XX±.05  
 .XXX±.015  
 Angles: ±1°



# Exploded Material View - Steel Utility Set Exhaust

03/22/2016

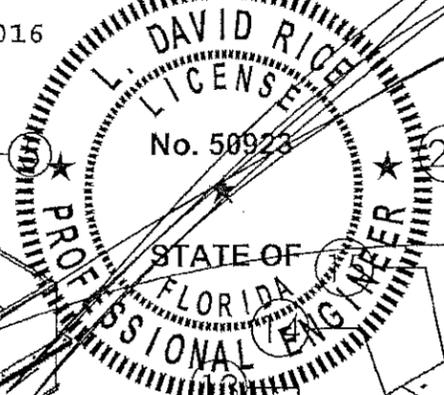  
 L. DAVID RICH  
 LICENSE  
 No. 50923  
 STATE OF FLORIDA  
 PROFESSIONAL ENGINEER  
 Florida Firm No.: F-01000005061  
 Certificate of Authorization: 9000

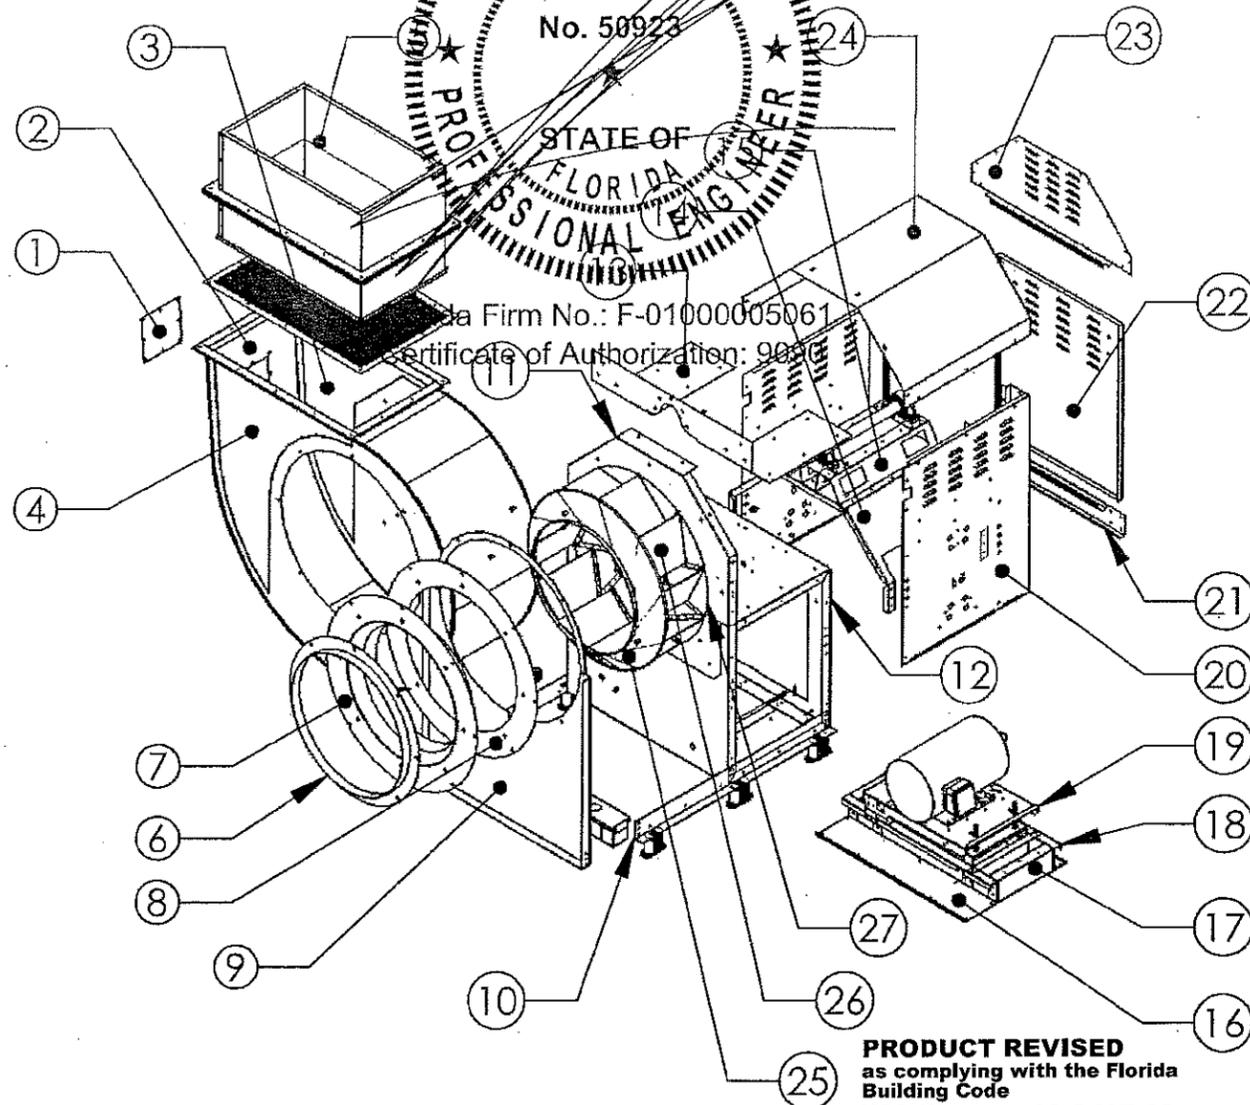

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08034.

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

Item Number	Description	Material
1	SCROLL ACCESS DOOR	16 GA GALV
2	WRAPPER	20 GA ALUMINIZED
3	SCROLL BOTTOM	16 GA ALUMINIZED
4	SCROLL TOP	16 GA ALUMINIZED
5	DISCHARGE COVER	20 GA GALV
6	INLET ANGLE RING	2X2X1/8 ANGLE IRON
7	WHEEL INLET	.080 1100-0 ALUM
8	INLET SUPPORT RING	14 GA GALV
9	FRONT SCROLL SUPPORT	12 GA GALV
10	SIDE RAIL	12 GA GALV
11	VERTICAL SUPPORT	14 GA GALV
12	BEARING PLATE SUPPORT	14 GA GALV
13	TOP SUPPPORT PLATE	14 GA GALV
14	INSIDE SUPPORT	12 GA GALV
15	BEARING PLATE	12 GA GALV
16	LEFT SIDE MOTOR PLATE	12 GA GALV
17	END CAP PLATE	12 GA GALV
18	RIGHT SIDE MOTOR PLATE	12 GA GALV
19	MOTOR PLATE	10 GA GALV
20	MOTOR COVER SIDE	20 GA GALV
21	MOTOR COVER BOTTOM	20 GA GALV
22	MOTOR COVER ACCESS DOOR	20 GA GALV
23	MOTOR COVER TOP FRONT	20 GA GALV
24	MOTOR COVER TOP	20 GA GALV
25	WHEEL BLADE BOTTOM	.080 ALUM 3003-0
26	WHEEL PRIMARY BLADE	.080 ALUM 5052-H32
27	WHEEL BLADE TOP	16 GA GALV

**DESIGN PRESSURE: +112.5 / -112.5 PSF**  
**LARGE MISSILE IMPACT RESISTANT**

**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A  
 Blank Size: N/A x N/A  
 Weight: N/A lbs  
**CONFIDENTIAL**

Part Number: N/A  
 MACOLA/AX Number: N/A  
 Drawing Name: USBI SERIES  
 Drawn By: N Perry  
 Parent Assembly: N/A  
 Sheet: 11 of 16



Unless Otherwise Specified  
 Dimensions are in Inches.  
 Standard Tolerances are:  
 Fractions: ±1/16  
 Decimal: .XX±.05  
 .XXX±.015  
 Angles: ±1°




# Installation - Steel Utility Set Exhaust

03/22/2016

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

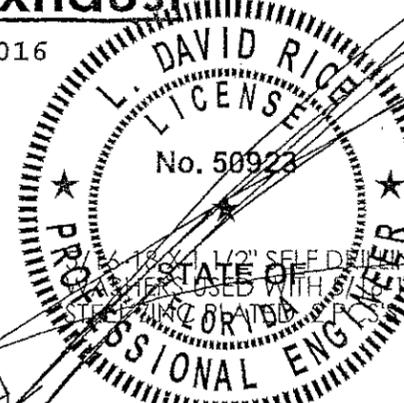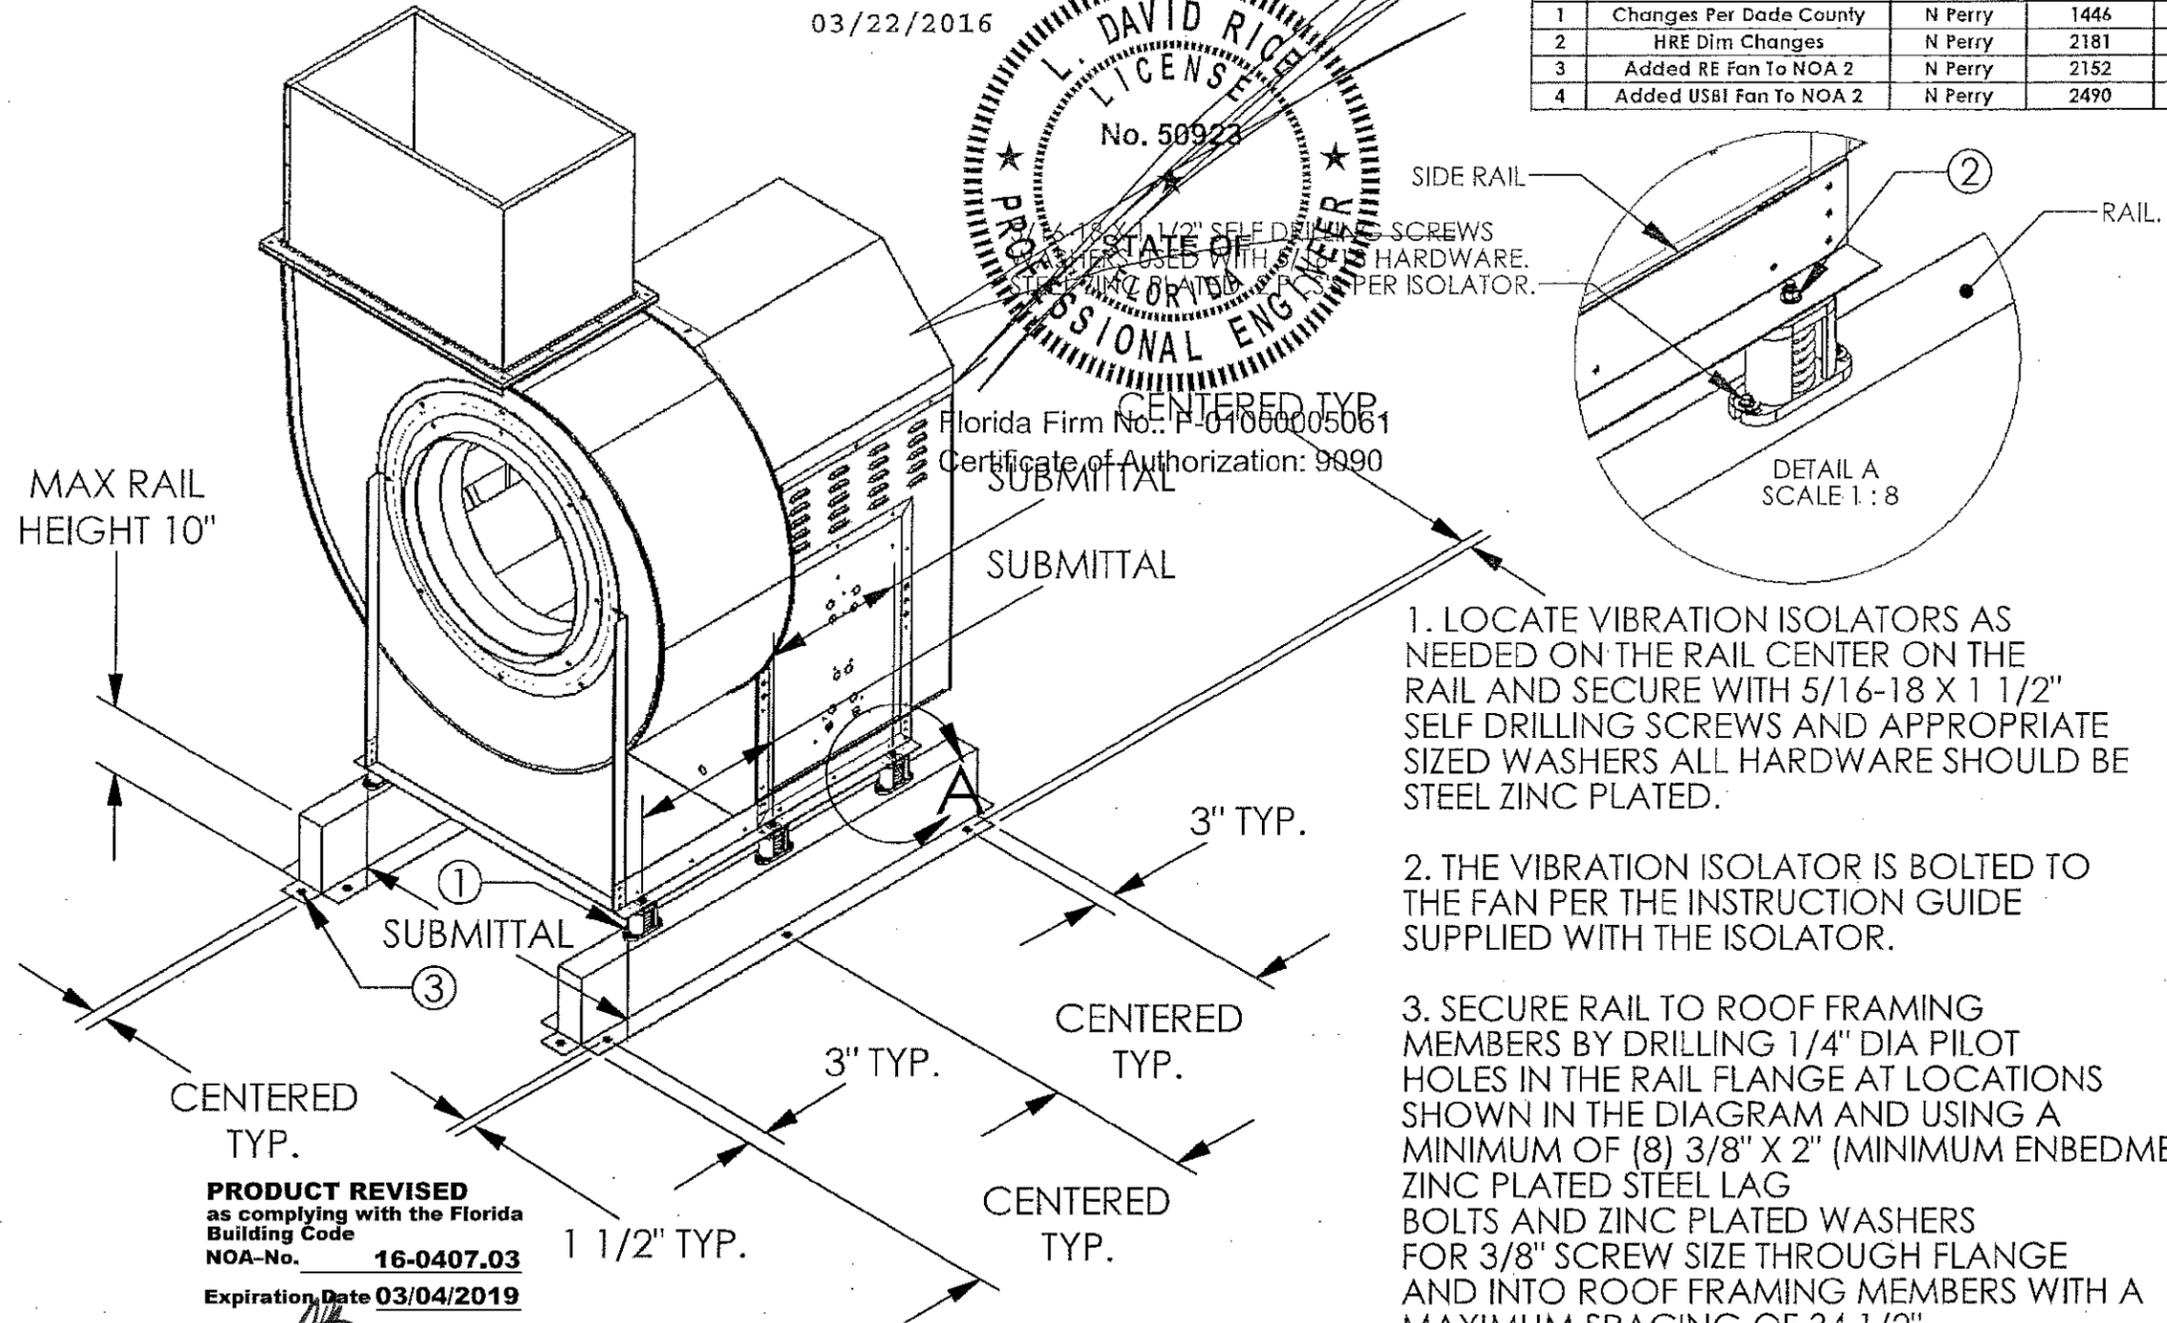

Florida Firm No.: F-0100005061  
 Certificate of Authorization: 9090

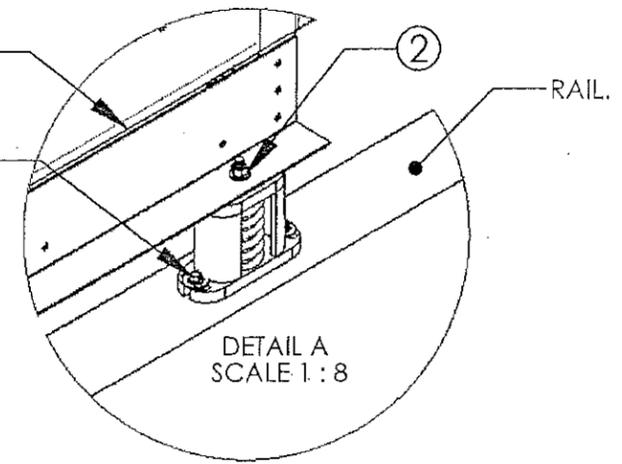

1. LOCATE VIBRATION ISOLATORS AS NEEDED ON THE RAIL CENTER ON THE RAIL AND SECURE WITH 5/16-18 X 1 1/2" SELF DRILLING SCREWS AND APPROPRIATE SIZED WASHERS ALL HARDWARE SHOULD BE STEEL ZINC PLATED.
2. THE VIBRATION ISOLATOR IS BOLTED TO THE FAN PER THE INSTRUCTION GUIDE SUPPLIED WITH THE ISOLATOR.
3. SECURE RAIL TO ROOF FRAMING MEMBERS BY DRILLING 1/4" DIA PILOT HOLES IN THE RAIL FLANGE AT LOCATIONS SHOWN IN THE DIAGRAM AND USING A MINIMUM OF (8) 3/8" X 2" (MINIMUM ENBEDMENT), ZINC PLATED STEEL LAG BOLTS AND ZINC PLATED WASHERS FOR 3/8" SCREW SIZE THROUGH FLANGE AND INTO ROOF FRAMING MEMBERS WITH A MAXIMUM SPACING OF 34 1/2".

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number AT1 08034.

**Rupp Air Management Systems**  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

Material: N/A  
 Blank Size: N/A x N/A  
 Weight: N/A lbs

Part Number: N/A  
 MACOLA/AX Number: N/A  
 Drawing Name: USBI SERIES  
 Drawn By: N Perry  
 Parent Assembly: N/A  
 Sheet: 12 of 16

Unless Otherwise Specified  
 Dimensions are in Inches.  
 Standard Tolerances are:  
 Fractions: ±1/16  
 Decimal: XX±.05  
 XXX±.015  
 Angles: ±1°


**CONFIDENTIAL**



# Dimensional Data - R Series Steel Supply Fans



## General Notes:

1. This approval is for the structural capacity and impact rating of the exterior housing only; it does not include any interior mechanism or electrical part.
2. These fans have not been wind tested for Wind Driven Rain Test per Florida Building code, TAS100 (A)-95.

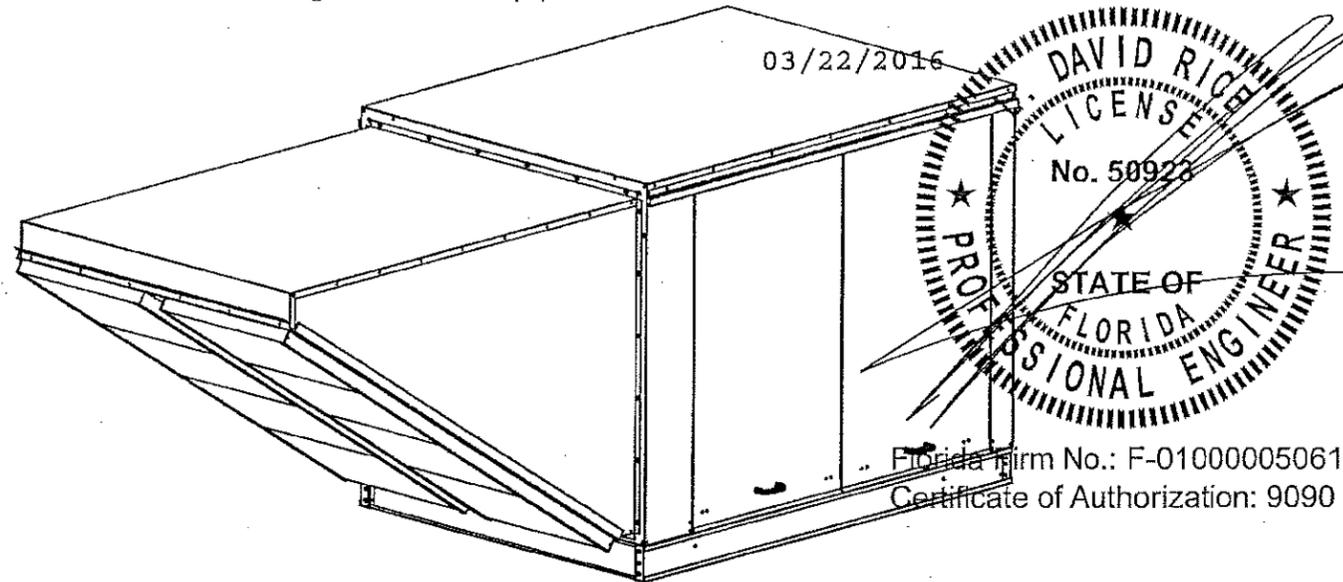

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USB1 Fan To NOA 2	N Perry	2490	10/14/13

HOUSING SIZE		A	B	C	WEIGHT (lbs)
		LENGTH (in)	WIDTH (in)	HEIGHT (in)	
MODULAR	1	76 1/2	27 3/8	26	250
	2	93 3/4	37 3/8	33	425
	3	96 3/4	41 3/8	38	525
	4	140 9/16	48 7/16	46 1/8	945
	5	145 9/16	59 3/16	53 1/8	1330
DIRECT FIRED	1.D	118 3/4	27 3/8	26	595
	2.D	136	37 3/8	33	810
	3.D	139	41 3/8	38	975
	4.D	194 7/8	48 7/16	46 1/8	1635
	5.D	199 7/8	59 3/16	53 1/8	2160
ELECTRIC	1.E	118 3/4	27 3/8	26	550
	2.E	136	37 3/8	33	805
	3.E	139	41 3/8	38	975
	4.E	194 7/8	48 7/16	46 1/8	1665
	5.E	199 7/8	59 3/16	53 1/8	2170
INDIRECT	1.I	149 1/8	36 11/16	48 3/4	925
	2.I	172 3/8	52 11/16	52 3/4	1315
	3.I	210 7/8	52 11/16	54 3/8	1995
STANDARD	1	57 7/8	26	28	210
	2	69 1/4	36	35	290

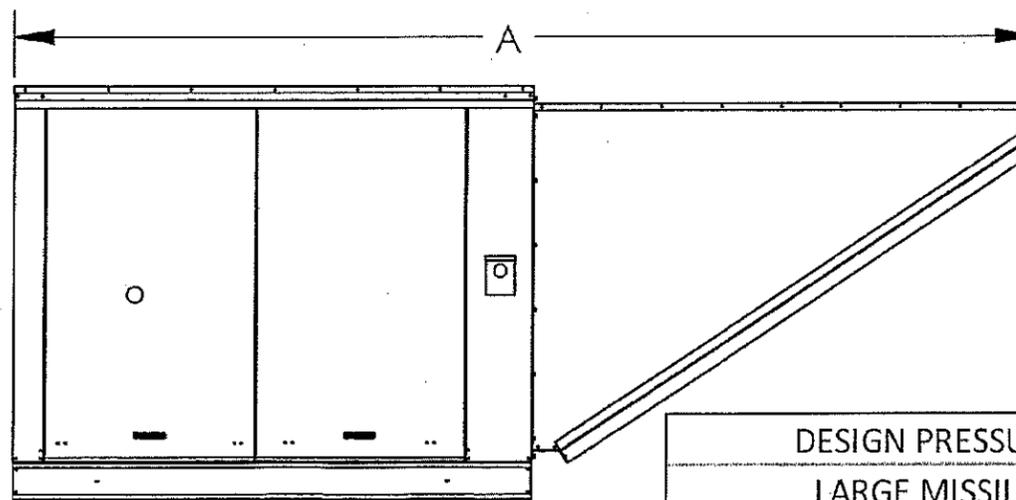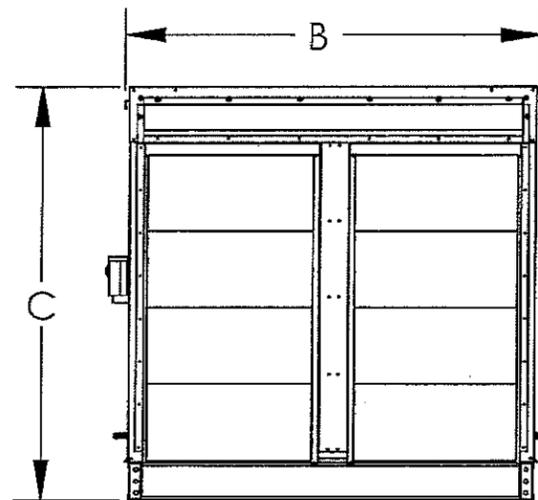

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **16-0407.03**  
Expiration Date **03/04/2019**  
By *[Signature]*  
Miami-Dade Product Control

DESIGN PRESSURE: +30.0 / -130.0 PSF  
LARGE MISSILE IMPACT RESISTANT

**Rupp Air Management Systems**  
101 North Industrial Parkway West  
Union, IA 52175  
P 800.334.9256 / 919.227.5994

## Notes:

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08034.

Material: N/A  
Blank Size: N/A x N/A  
Weight: N/A lbs

Part Number: A5-925  
MACOLA Number: N/A  
Drawing Name: SUPPLY  
Drawn By: N Perry  
Drawing Number: NOA2  
Sheet: 13 of 16


Unless Otherwise Specified  
Dimensions are in inches.  
Standard Tolerances are:  
Fractions: ±1/16  
Decimal: XX±.05  
XXX±.015  
Angles: ±1°



**RUPPAIR**  
MANAGEMENT SYSTEMS®

# Materials - R Series Steel Supply Fans

03/22/2016

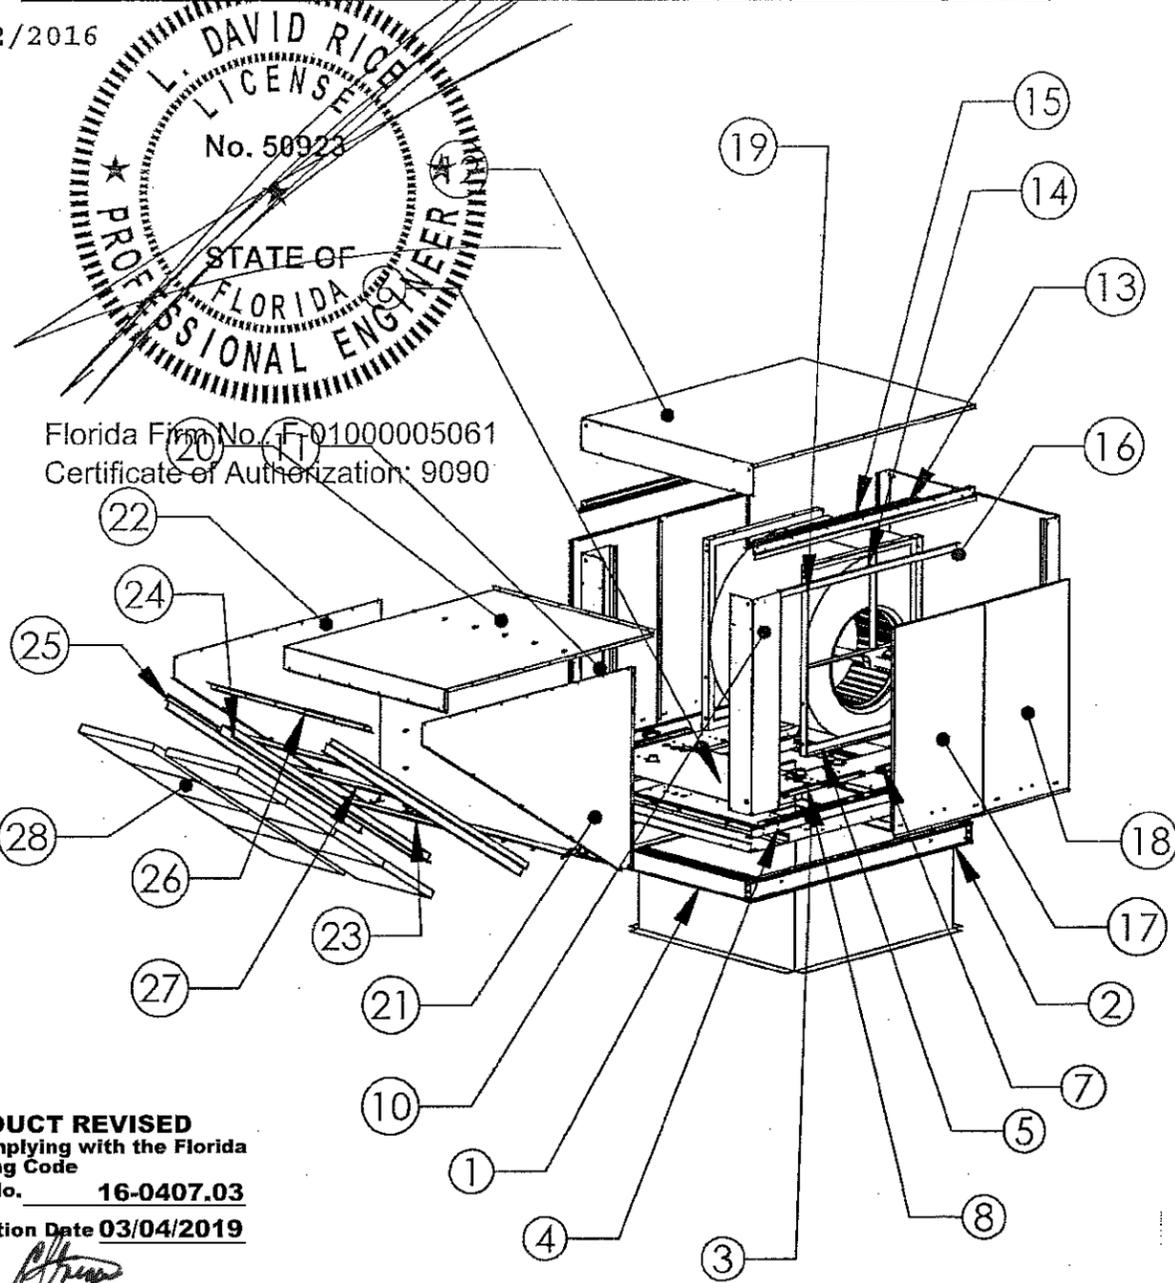

Florida Firm No. F-01000005061  
Certificate of Authorization: 9090

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. **16-0407.03**  
Expiration Date **03/04/2019**  
By *[Signature]*  
Miami-Dade Product Control

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number ATI 08034.

## Revision History

#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

Item Number	Description	Material
1	End Flashing	18 Ga Galvanized G90
2	Main Rail	12 Ga Galvanized G90
3	Bottom	18 Ga Galvanized G90
4	Bottom Side	18 Ga Galvanized G90
5	Horizontal Support	10 Ga Galvanized G90
6	Discharge Cap	18 Ga Galvanized G90
7	Door Hook Back	18 Ga Galvanized G90
8	Door Hook Front	18 Ga Galvanized G90
9	Door Cup	18 Ga Galvanized G90
10	Right Front Post	18 Ga Galvanized G90
11	Left Front Post	18 Ga Galvanized G90
12	Lid	18 Ga Galvanized G90
13	Drip Rail	18 Ga Galvanized G90
14	Door Support	18 Ga Galvanized G90
15	Lid Support	14 Ga Galvanized G90
16	Back	18 Ga Galvanized G90
17	Door	18 Ga Galvanized G90
18	Back Door	18 Ga Galvanized G90
19	Blower	Steel
20	Awning Top	18 Ga Galvanized G90
21	Awning Right Side	18 Ga Galvanized G90
22	Awning Left Side	18 Ga Galvanized G90
23	Awning Bottom	18 Ga Galvanized G90
24	Awning Middle	18 Ga Galvanized G90
25	Awning Outside Rail	18 Ga Galvanized G90
26	Awning Rain Guard	18 Ga Galvanized G90
27	Awning Rail Supports	18 Ga Galvanized G90
28	20 X 25 X 2 Filters	Aluminum Mesh

**Rupp Air Management Systems**  
101 North Industrial Parkway West  
Union, IA 52175  
P 800.334.9256 / 919.227.5994

Material: N/A  
Blank Size: N/A x N/A  
Weight: N/A lbs

Part Number: A5-925  
MACOLA Number: N/A  
Drawing Name: SUPPLY  
Drawn By: N Perry  
Drawing Number: NOA2  
Sheet: 14 of 16


Unless Otherwise Specified  
Dimensions are in Inches.  
Standard Tolerances are:  
Fractions: ±1/16  
Decimal: .XX±.05  
.XXX±.015  
Angles: ±1°





# Installation - R Series Steel Supply Fans

Revision History				
#	Description	Revised by	ECN#	Date
0	Testing TAS - 201, 202, 203	N Perry	1446	8/25/08
1	Changes Per Dade County	N Perry	1446	12/30/08
2	HRE Dim Changes	N Perry	2181	11/19/10
3	Added RE Fan To NOA 2	N Perry	2152	4/27/12
4	Added USBI Fan To NOA 2	N Perry	2490	10/14/13

03/22/2016

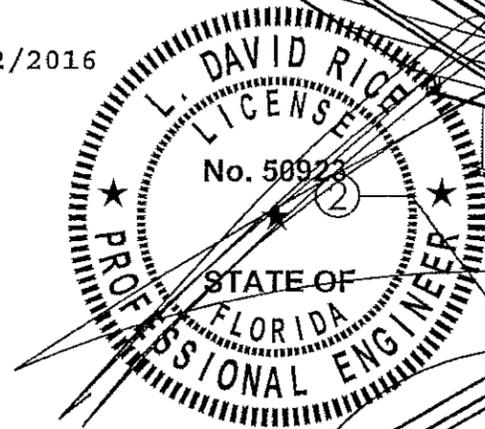


Florida Firm No.: F-0100005061  
Certificate of Authorization: 9090

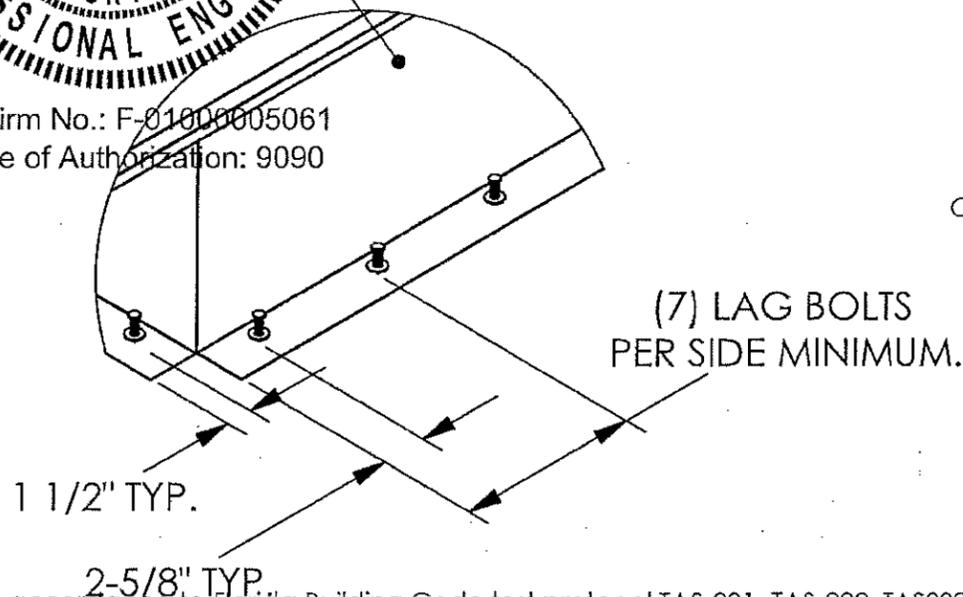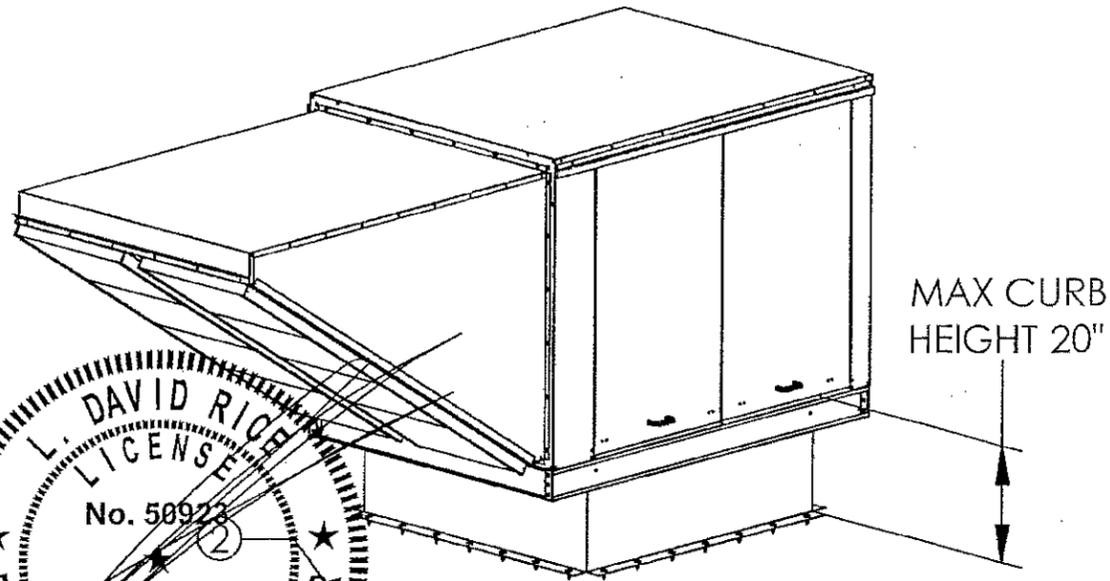

1. SECURE FAN BASE TO TOP OF CURB USING A MINIMUM OF (16) 1/4-14 X 1" SELF DRILLING SCREWS, STEEL ZINC PLATED WITH A MINIMUM OF (4) SCREWS PER SIDE FOR A TOTAL OF (16), THROUGH BOTTOM OF FAN INTO TOP OF CURB.

2. SECURE CURB TO ROOF FRAMING MEMBERS BY DRILLING 1/4" DIA PILOT HOLES IN CURB AT LOCATION SHOWN IN BOTTOM LEFT DIAGRAM AND USING A MINIMUM OF (28) 3/8" X 3" (MINIMUM ENBEDMENT), ZINC PLATED STEEL LAG BOLTS AND ZINC PLATED WASHERS FOR 3/8" SCREW SIZE THROUGH FLANGE AND INTO ROOF FRAMING MEMBERS WITH A MINIMUM OF (7) LAG BOLTS PER SIDE.

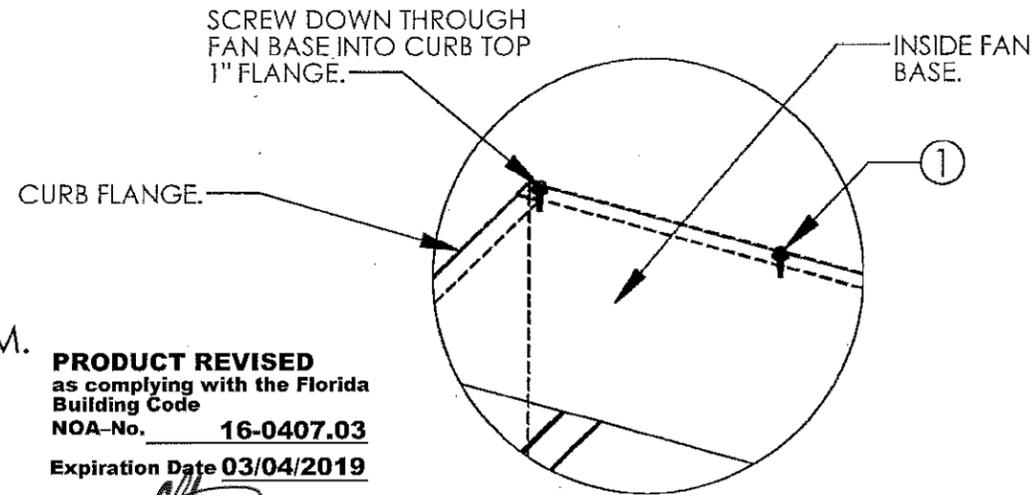

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. **16-0407.03**  
Expiration Date **03/04/2019**  
By *[Signature]*  
Miami-Dade Product Control

**Rupp Air Management Systems**  
101 North Industrial Parkway West  
Union, IA 52175  
P 800.334.9256 / 919.227.5994

- Notes:
1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
  2. Tested for areas including high velocity hurricane zones.
  3. Tested under Miami-Dade County Notification number ATI 08034.



Material: N/A	Part Number: A5-925
Blank Size: N/A x N/A	MACOLA Number: N/A
Weight: N/A lbs	Drawing Name: SUPPLY
	Drawn By: N Perry
	Drawing Number: NOA2
	Sheet: 15 of 16

Unless Otherwise Specified Dimensions are in Inches.
Standard Tolerances are:
Fractions: ±1/16
Decimal: .XX±.05
XXX±.015
Angles: ±1°



# Miami-Dade County - Curb/Rail Installation Guide

Rupp Air Management Systems  
 101 North Industrial Parkway West  
 Union, IA 52175  
 P 800.334.9256 / 919.227.5994

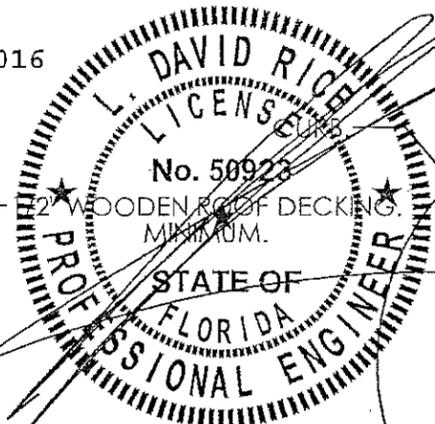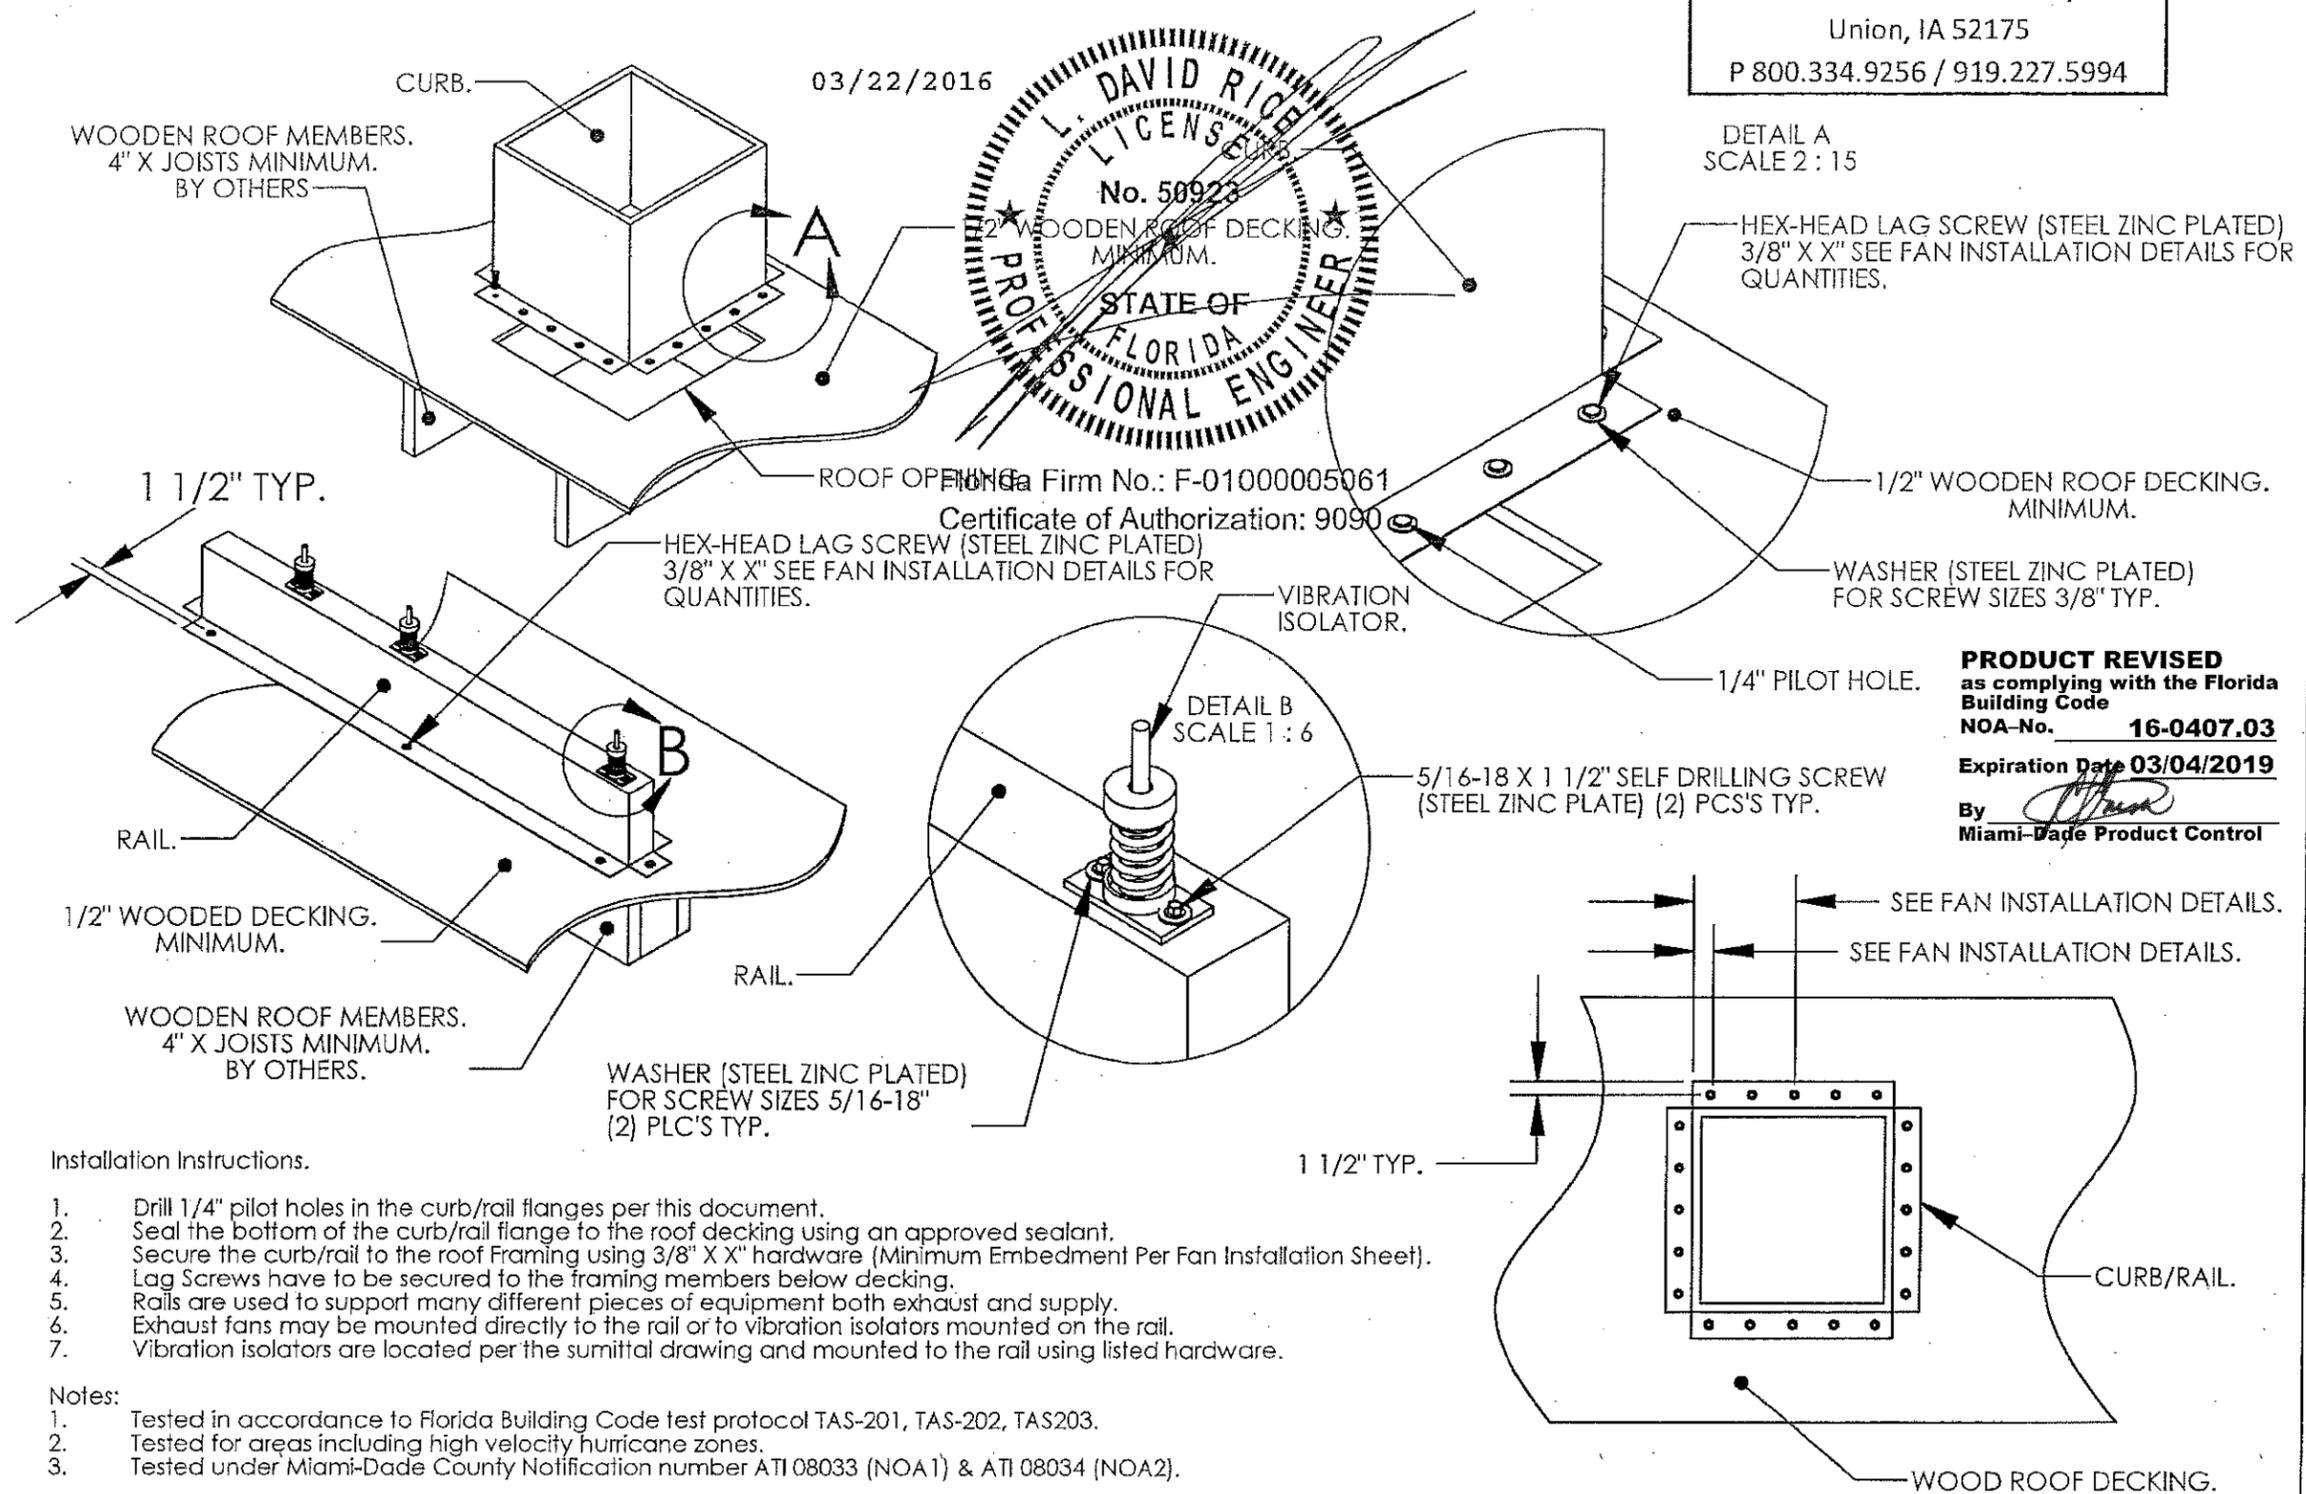

Professional Engineering Firm No.: F-01000005061  
 Certificate of Authorization: 9090

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 NOA-No. **16-0407.03**  
 Expiration Date **03/04/2019**  
 By *[Signature]*  
 Miami-Dade Product Control

**Installation Instructions.**

1. Drill 1/4" pilot holes in the curb/rail flanges per this document.
2. Seal the bottom of the curb/rail flange to the roof decking using an approved sealant.
3. Secure the curb/rail to the roof Framing using 3/8" X X" hardware (Minimum Embedment Per Fan Installation Sheet).
4. Lag Screws have to be secured to the framing members below decking.
5. Rails are used to support many different pieces of equipment both exhaust and supply.
6. Exhaust fans may be mounted directly to the rail or to vibration isolators mounted on the rail.
7. Vibration isolators are located per the submittal drawing and mounted to the rail using listed hardware.

**Notes:**

1. Tested in accordance to Florida Building Code test protocol TAS-201, TAS-202, TAS203.
2. Tested for areas including high velocity hurricane zones.
3. Tested under Miami-Dade County Notification number ATI 08033 (NOA1) & ATI 08034 (NOA2).

Material: N/A	Part Number: N/A	Unless Otherwise Specified Dimensions are in inches.
Blank Size: N/A x N/A	MACOLA Number: N/A	
Weight: N/A lbs	Drawing Name: CURB/RAIL INSTALLATION	
	Drawn By: N Perry	
	Drawing Number: NOA2	
	Sheet: 16 of 16	Standard Tolerances are: Fractions: ±1/16 Decimal: .XX±.05 .XXX±.015 Angles: ±1°

