



MIAMI-DADE COUNTY  
**PRODUCT CONTROL SECTION**  
 11805 SW 26 Street, Room 208  
 Miami, Florida 33175-2474  
 T (786) 315-2590 F (786) 315-2599  
 www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
 BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**Diebold, Incorporated**  
**818 Mulberry Road S.E.**  
**Canton, OH 44707**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION:** Series "SV23185B" Aluminum Horizontal Sliding Window-- **L.M.I.**

**APPROVAL DOCUMENT:** Drawing No. **1909**, titled "HW Aluminum Sliding BR Window (LMI)", sheets 1 through 5 of 5, dated July 07, 2016, prepared by W.W. Schaefer Engineering, P.A., signed and sealed by Warren W. Schaefer, P. E., bearing the Miami-Dade County Product Control Approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING:** Large and Small Missile Impact Resistant

**Limitations:**

1. See Design Pressure and water rating in sheet 1.
2. 1x or 2x buck to be properly secured to sustain imposed load and reviewed by AHJ.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA #15-0609.12** and consists of this page 1 and evidence pages E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



NOA No. 16-0519.09  
 Expiration Date: July 21, 2021  
 Approval Date: July 21, 2016  
 Page 1

4  
 7/14/16

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections (Submitted under files # listed below)
2. Drawing No. **1909**, titled "HW Aluminum Sliding BR Window (LMI)", sheets 1 thru 5 of 5, dated July 07, 2016, prepared by W.W. Schaefer Engineering, P.A., signed & sealed by Warren W. Schaefer, P.E.

**B. TESTS**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of Aluminum Horizontal Slider, prepared by Architectural Testing, Test Reports No(s) F3687-02-201-18, dated 04/14/16, signed and sealed by Joseph A. Reed, P. E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis dated 01/28/16 and last revised on 07/07/16, complying with FBC-2014 (5<sup>th</sup> Edition), prepared by W.W. Schaefer Engineering, P.A., signed & sealed by Warren W. Schaefer, P.E.
2. Glazing complies w/ ASTM E-1300-02, 04 & -09.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **14-0916.10** issued to **Kuraray America, Inc.** (Former E.I. DuPont DeNemours & Co., Inc.) for the "**Kurray Butacite PVB Interlayers**", expiring on 12/11/2016.
2. Test reports for Technoform 18.6mm Flat I-Strut, Test reports No. **ETC-07-1043-19094.0**, dated 02/18/08 and **ETC-07-1043-20048.0** dated 09/19/07, issued by ETC Laboratories for Xenon Arch weathering per ASTM G-26 and tensile test per ASTM D-638, signed by Joseph L. Doldan, P.E. and Test report No. **60520.01-106-18** dated 12/14/05, issued by Architectural Testing for "Technoform I-Strut" for smoke density per ASTM D-2843 and rate of burning per ASTM D-635, signed and sealed by Joseph A. Reed, P.E.

**F. STATEMENTS**

1. Statement letter of conformance to FBC 2014(5<sup>th</sup> edition) and letter of no financial interest, dated 01/28/16, prepared by W.W. Schaefer Engineering, P.A., signed & sealed by Warren W. Schaefer, P.E.
2. Statement letter dated 07/12/16 issued by Schneider-Vetter Glass Company Inc., of business relationship with Diebold, Inc, signed by James Patek, V.P.
3. Lab compliance as part of the above referenced test report.

**G. OTHER**

1. None.


  
\_\_\_\_\_  
**Ishaq I. Chanda, P.E.**  
**Product Control Examiner**  
**NOA No. 16-0519.09**  
**Expiration Date: July 21, 2021**  
**Approval Date: July 21, 2016**

**GENERAL NOTES:**

1. THIS PRODUCT HAS BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S)".
2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE.
3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL FINISH OR STUCCO.
4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCOLS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT PRODUCTS.
5. THIS PRODUCT HAS BEEN DESIGNED IN ACCORDANCE WITH AND MEETS THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).
6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THIS PRODUCT.
7. ALL ANCHORS SECURING PRODUCT FRAMES TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD.
8. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF  $K_d = 0.85$  MAY BE APPLIED PER THE ASCE-7 STANDARD.
9. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD DURATION FACTOR  $C_d = 1.6$  WAS USED FOR WOOD SCREW ANALYSIS ONLY.
10. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE.

**CORNER CONSTRUCTION:**

**FRAME AT HEAD:** HEAD IS BUTTED TO THE SIDE MEMBERS, SEALED WITH SEALANT AND SECURED WITH 4 NO. 10 X 3" & 2 NO. 10 X 2" FL HD PH SMS SCREWS INTO THE HEAD MEMBER SCREW SPLINES.  
**FRAME AT SILL:** SILL IS BUTTED TO THE SIDE MEMBERS, SEALED WITH SEALANT AND SECURED WITH 2 NO. 10 X 3" & 1 NO. 10 X 2" FL HD PH SMS SCREWS INTO THE SILL SCREW SPLINES.  
**SASH:** VERTICAL MEMBERS ARE COPED. HORIZONTAL MEMBERS ARE BUTTED TO THE VERTICAL MEMBERS, SEALED WITH SEALANT, AND SECURED WITH 4 NO. 10 X 3" FL HD PH SMS SCREWS INTO THE HORIZONTAL MEMBER SCREW SPLINES.

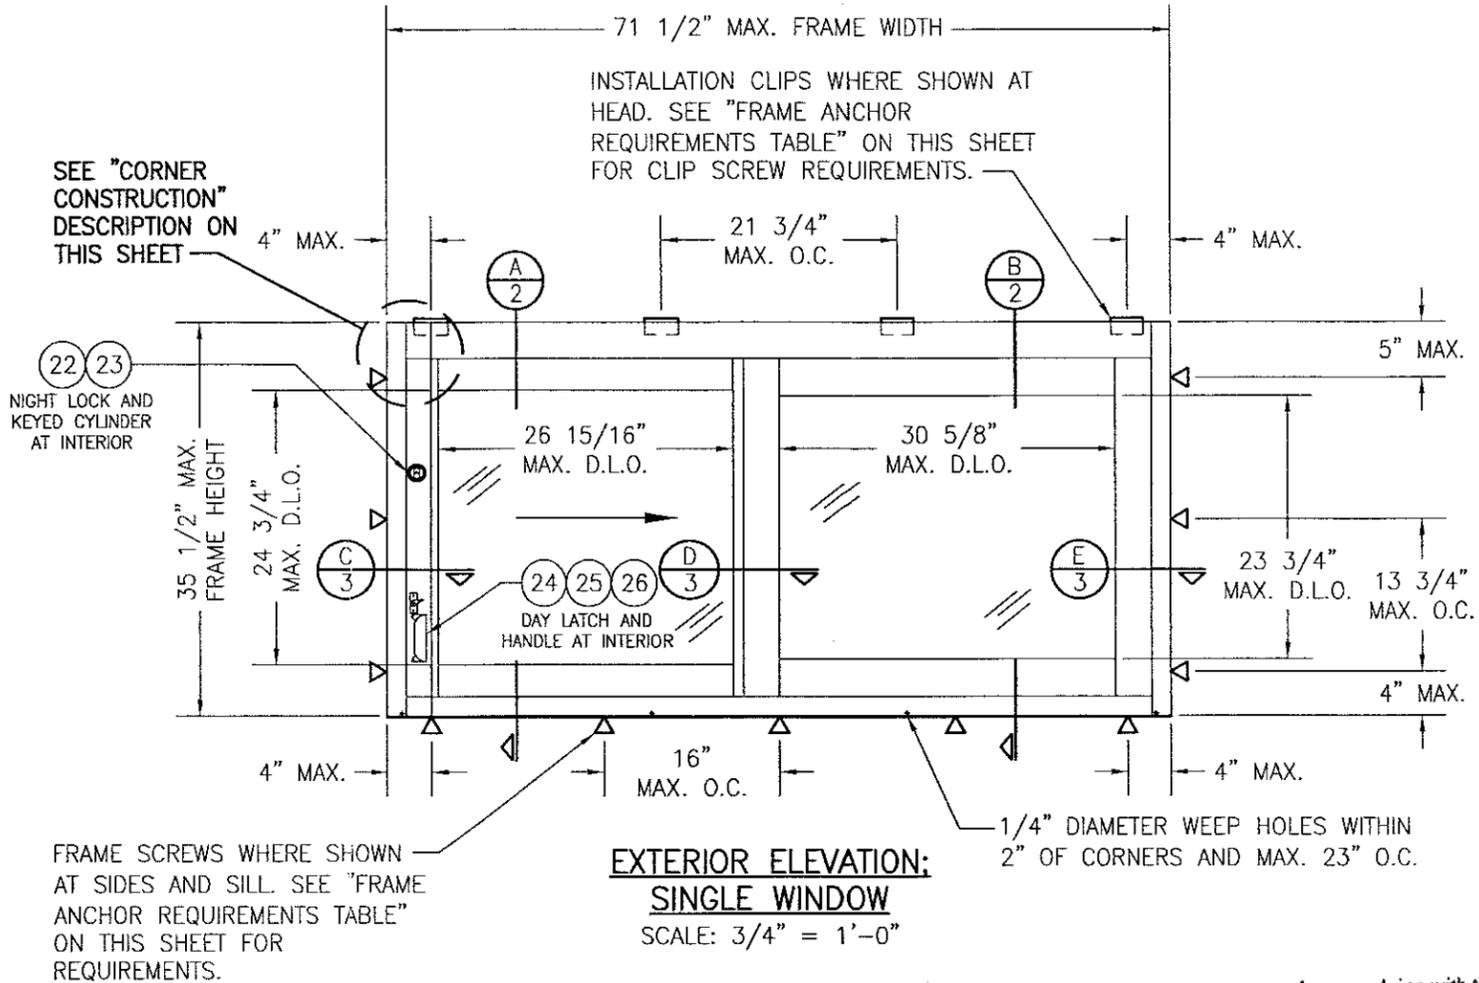

**EXTERIOR ELEVATION:  
SINGLE WINDOW**  
SCALE: 3/4" = 1'-0"

**ALLOWABLE DESIGN PRESSURE**  
+65/-75 PSF

**NOTE:** WHEN THE STANDARD SILL PAN PART NUMBER 11 IS USED, THE WINDOWS ARE NOT APPROVED FOR USE WHERE WATER INFILTRATION RESISTANCE IS REQUIRED BY THE WINDOW UNLESS THE UNITS ARE INSTALLED IN NON-HABITABLE AREAS WHERE THE UNIT & THE AREA ARE DESIGNED TO ACCEPT WATER INFILTRATION OR THE UNITS ARE INSTALLED AT LOCATIONS PROTECTED BY A CANOPY OR OVERHANG WHERE-BY THE OVERHANG(OH) RATIO IS EQUAL TO OR MORE THAN 1.0 PER FBC. WHEN THE TALL SILL PAN PART NUMBER 12 IS USED, THE WINDOW IS WATER RATED.

Approved as complying with the Florida Building Code  
 Date July 21, 2016  
 NOA# 16-0519-09  
 Miami Dade Product Control  
 By Ishag J. Chande

**FRAME ANCHOR REQUIREMENTS TABLE**

OPENING TYPE (SUBSTRATE)	FRAME/CLIP TO OPENING FASTENER TYPE	MINIMUM EMBED	MINIMUM EDGE DIST.
<b>FRAME SCREWS</b>			
(2) MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 12 SMS OR WOOD SCREW	1 1/4"	7/8"
MIN. 18 GA. 33 KSI METAL STUD	NO. 12 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK A36 STEEL	NO. 12 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 12 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. C-90 CMU OR 2500 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/4"	2"
<b>INSTALLATION CLIP SCREWS</b>			
(2) MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 12 SMS OR WOOD SCREW	1 1/4"	7/8"
MIN. 18 GA. 33 KSI METAL STUD	NO. 12 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK A36 STEEL	NO. 12 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. 1/8" THK 6063-T5 ALUM.	NO. 12 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"
MIN. C-90 CMU OR 2500 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/4"	2"

- (1) CONCRETE SCREWS SHALL BE ELCO ULTRACONS (C.S.), ELCO CRETE-FLEX (S.S.), ITW RAMSET/RED HEAD TAPCONS (C.S. OR S.S.) OR HILTI KWIK-CON II (C.S OR S.S.).
- (2) 2X\_ BUCKS SHALL BE OF A MINIMUM DEPTH REQUIRED TO MEET ANCHOR EDGE DISTANCE REQUIREMENTS AND ALLOW NEAR FULL BEARING OF WINDOW FRAME.


THESE DRAWINGS ARE APPLICABLE ONLY TO THE PRODUCT SPECIFIED. THEY MAY NOT BE USED FOR THE ASSEMBLY AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1=16	DATE: 12/15/15
DATE	
BY	
REVISION DESCRIPTION	
NO.	

**DRAWING TITLE**  
 SERIES SV23185B HW ALUMINUM HORIZONTAL SLIDING BR WINDOW (LMI)



**MANUFACTURER**  
 DIEBOLD, INCORPORATED  
 818 MULBERRY ROAD SE  
 CANTON, OH 44707  
 330-489-4114

**CONSULTANTS**  
 W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)  
 7480 150TH COURT NORTH  
 PALM BEACH GARDENS, FL 33418  
 PHONE: 561-744-3424

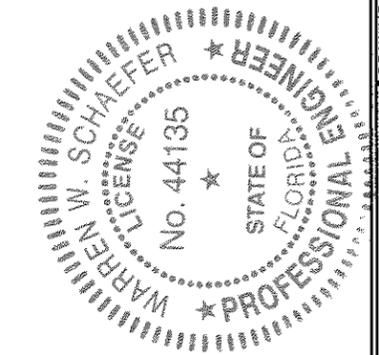


**CERTIFICATION**  
 JUL 07 2016  
 WARREN W. SCHAEFER, P.E.  
 P.E. NO. 44135



DRAWING NO. 1909	REV.
SHEET NO. 1	OF 5

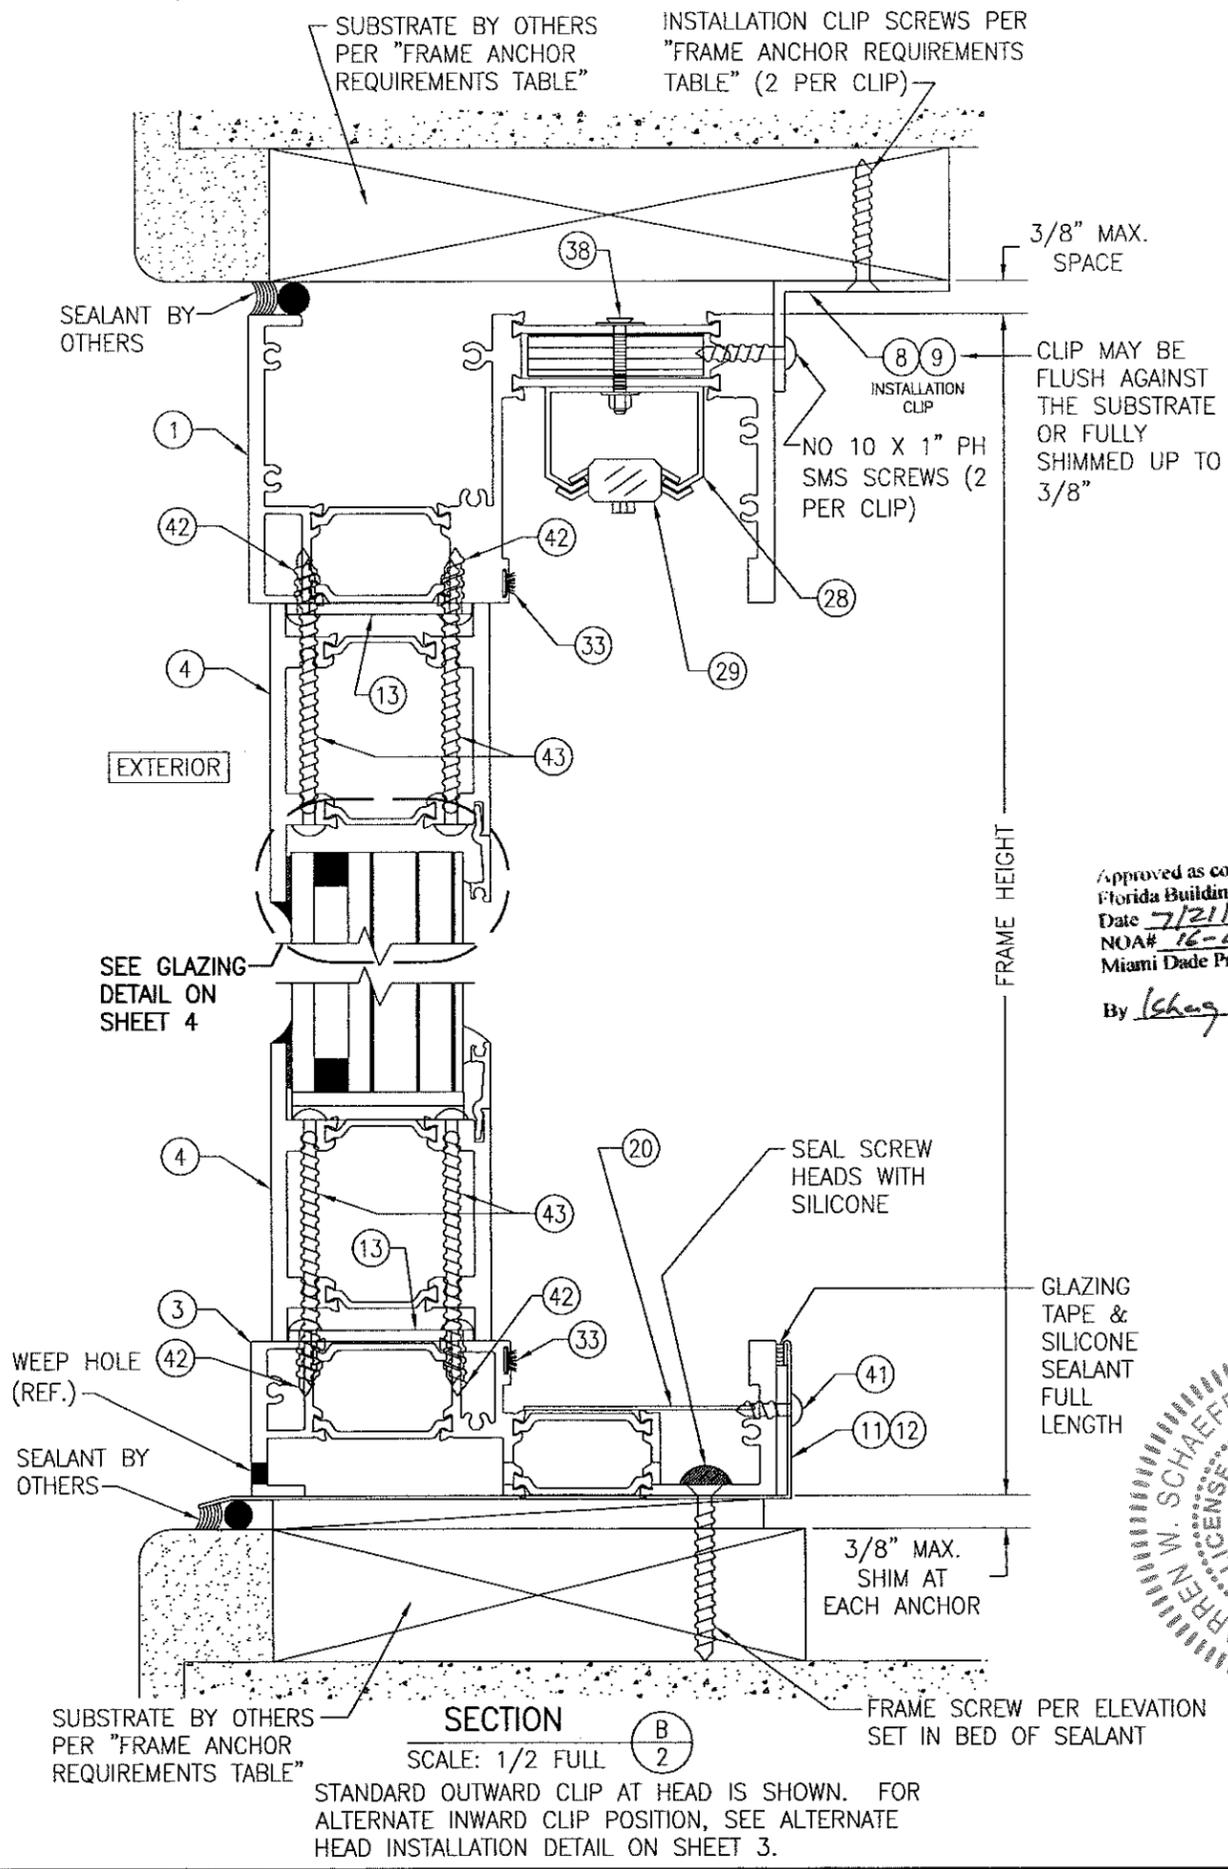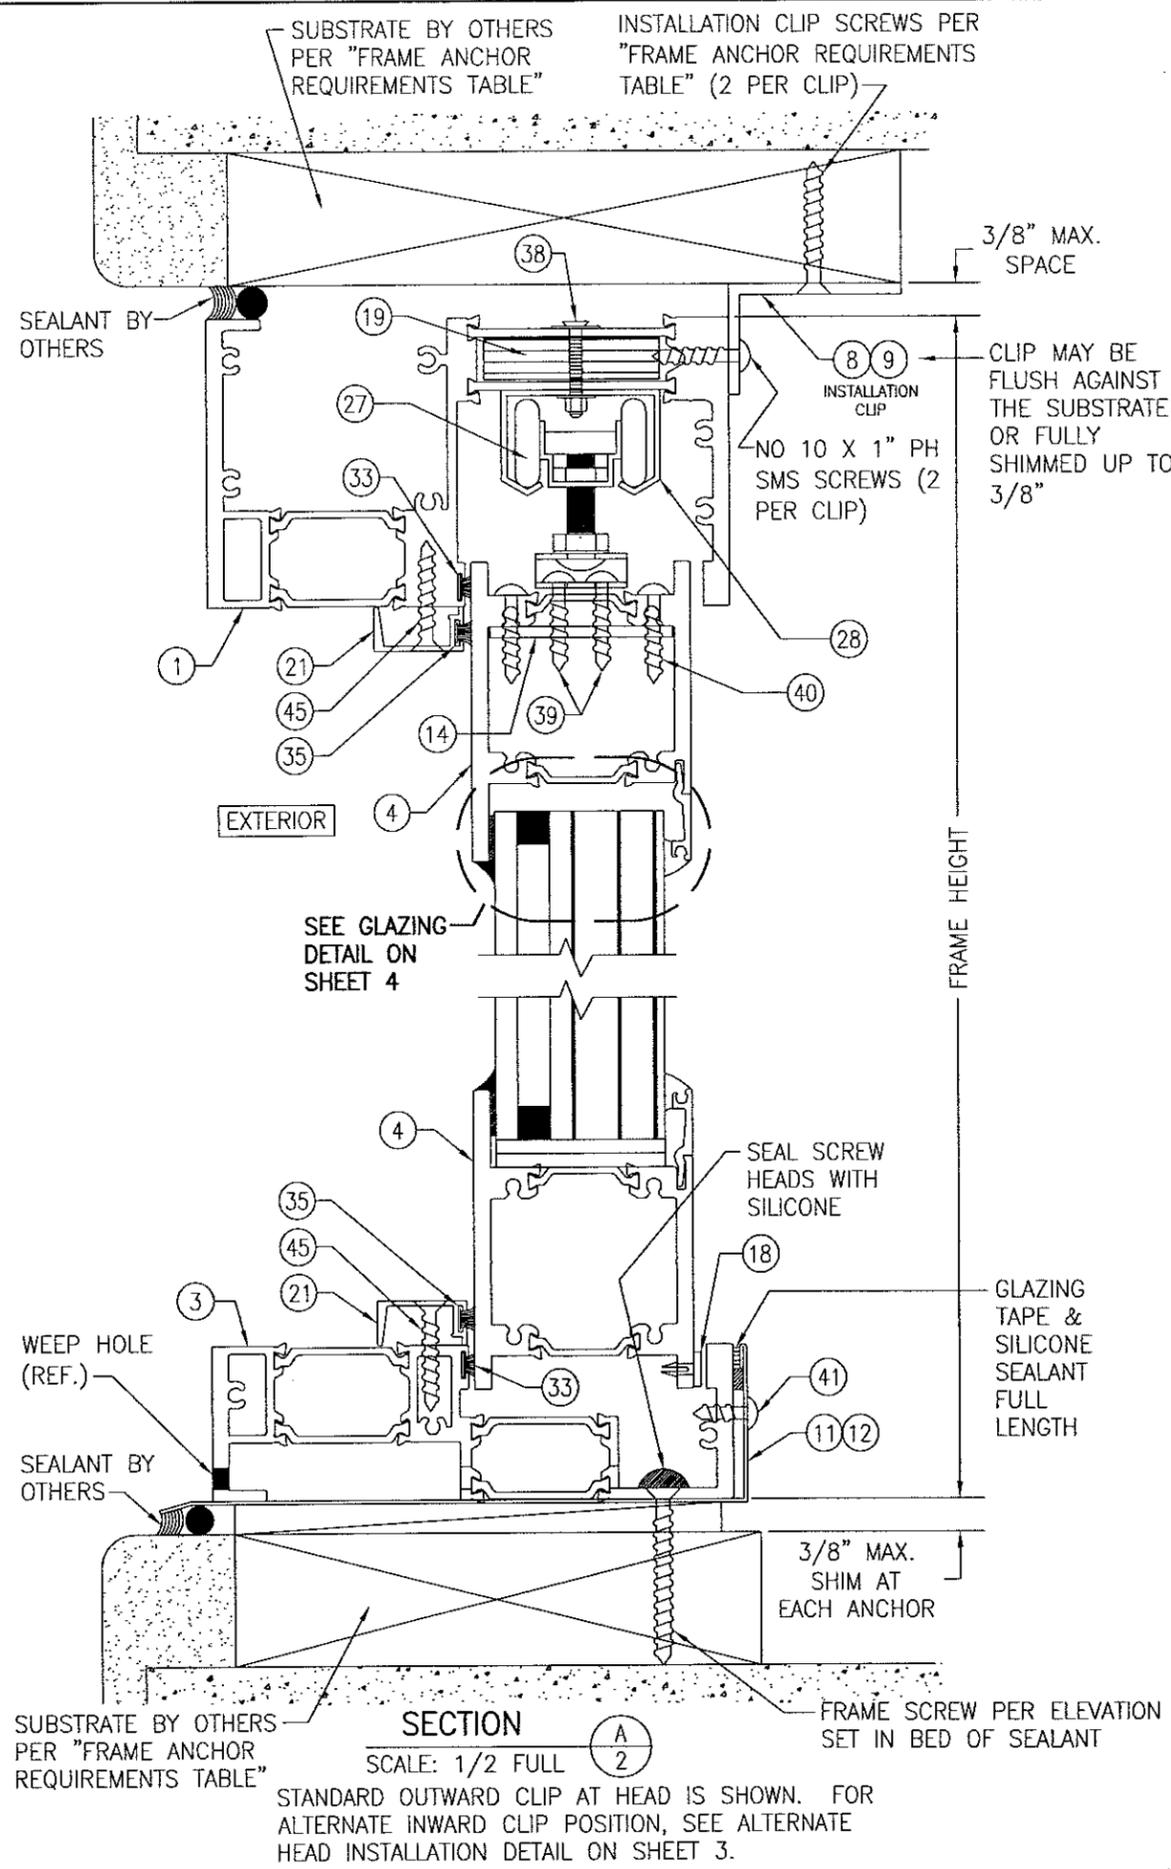


Approved as complying with the Florida Building Code  
 Date 7/21/16  
 NOA# 16-0519.09  
 Miami Dade Product Control  
 By *Isaac J. Ugoide*

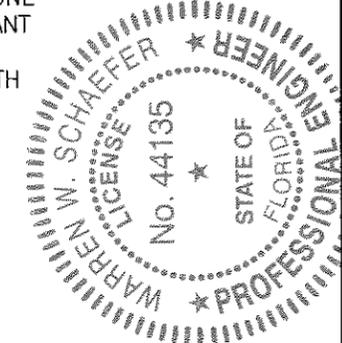

DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-15	DATE: 12/15/15
DATE	
BY	
REVISION DESCRIPTION	
NO.	
DRAWING TITLE SERIES SV23185B HW ALUMINUM HORIZONTAL SLIDING BR WINDOW (LMI)	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	MANUFACTURER DIEBOLD, INCORPORATED 818 MULBERRY ROAD SE CANTON, OH 44707 330-489-4114
CERTIFICATION JUL 07 2016	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1909	REV.
SHEET NO. 2	OF 5

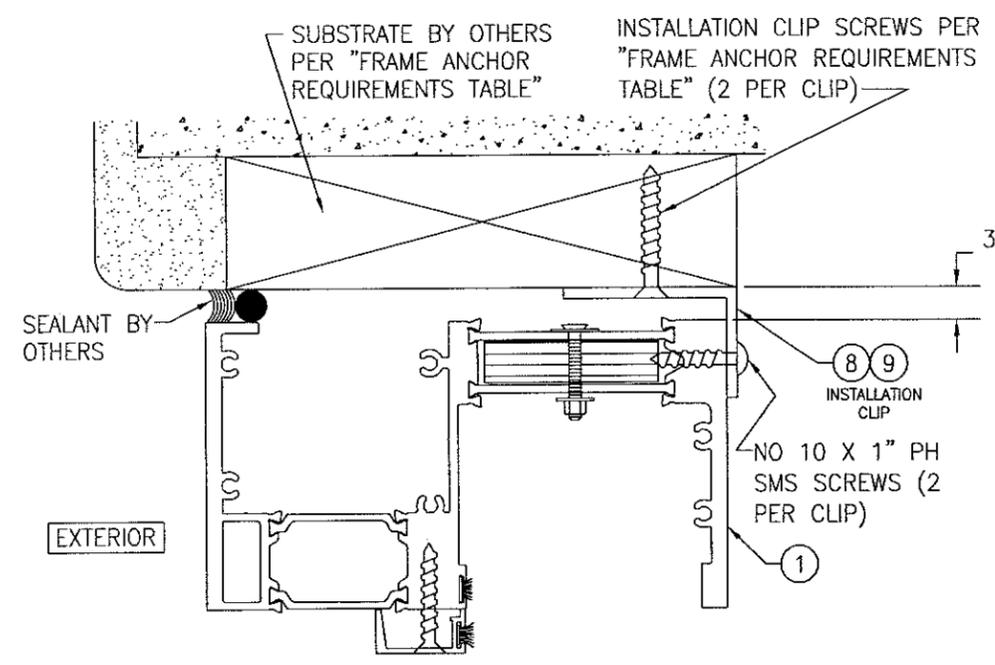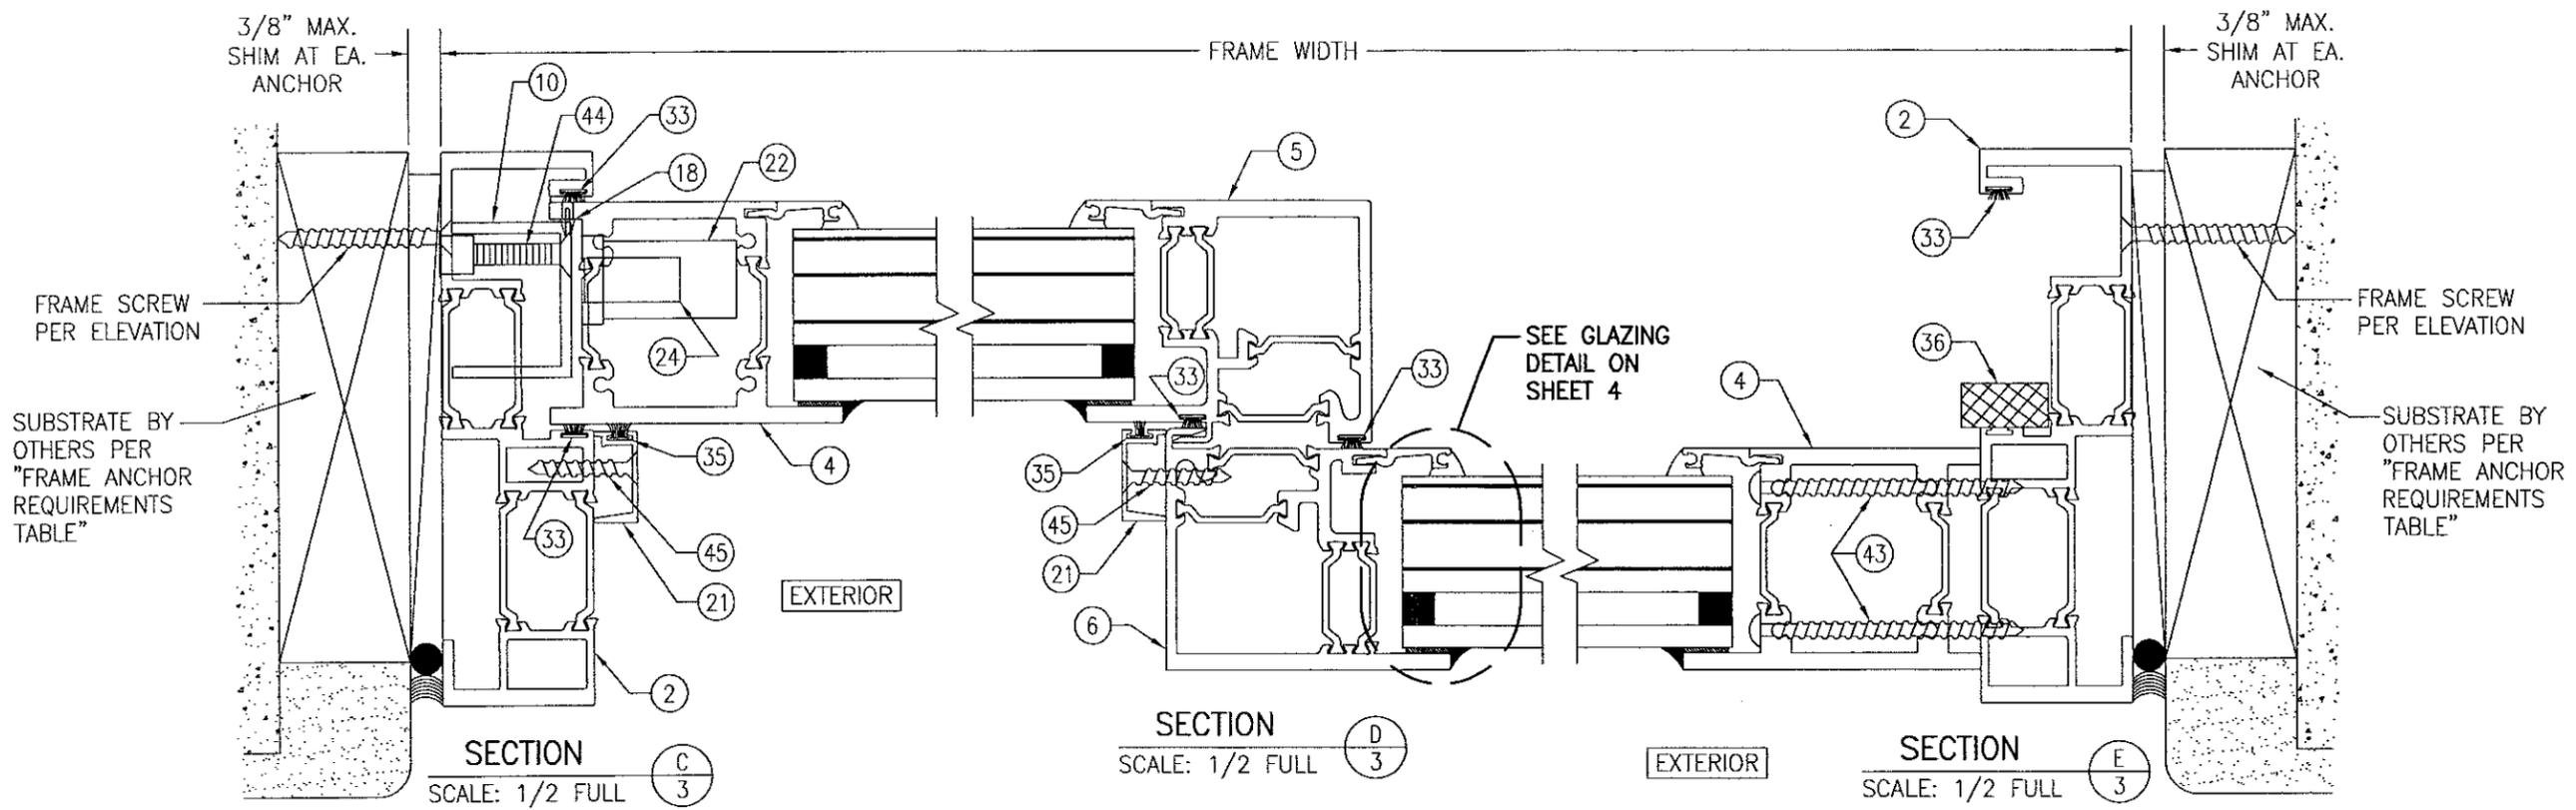


**ALTERNATE HEAD INSTALLATION DETAIL**  
 (CLIP FACING INWARD)  
 (FOR DETAIL NOT SHOWN, SEE SECTIONS A/2 & B/2)

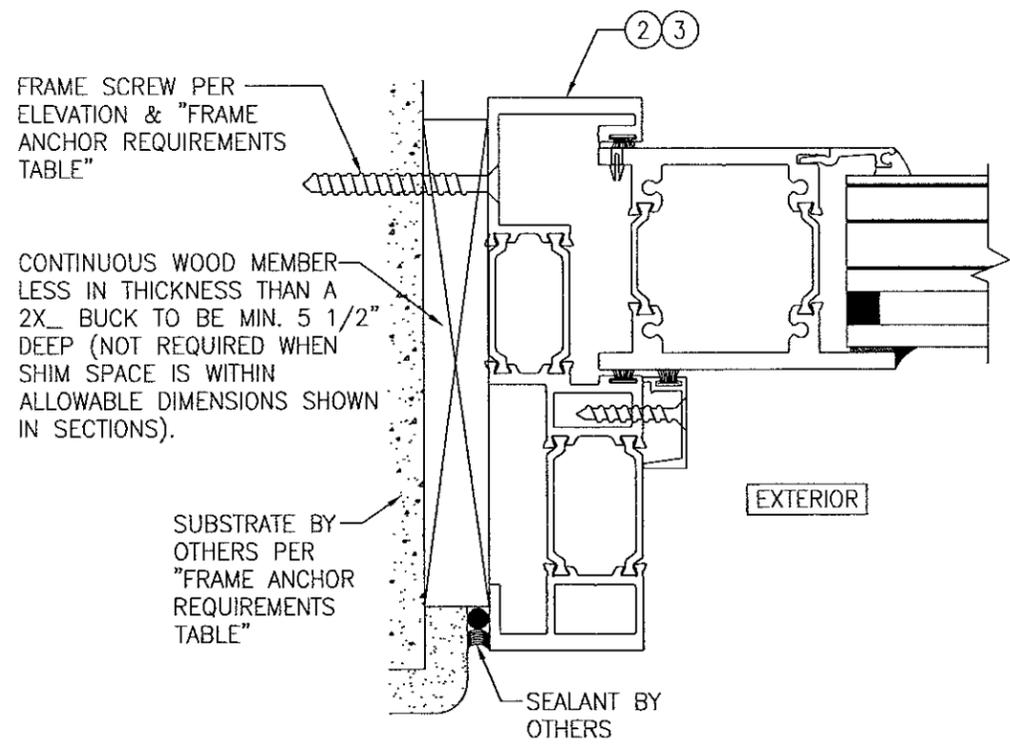


**OPTIONAL DIRECT MOUNT DETAIL TO SUBSTRATE WITH SPACER**  
 (SIDE SECTION SHOWN; SILL IS INSTALLED THE SAME)  
 (DIRECT MOUNT CONDITION IS NOT APPLICABLE AT HEAD)  
 (FOR DETAIL NOT SHOWN, SEE OTHER SECTIONS)

Approved as complying with the Florida Building Code  
 Date 7/21/16  
 NOA# 16-0519-09  
 Miami Dade Product Control  
 By *W. Schaefer*

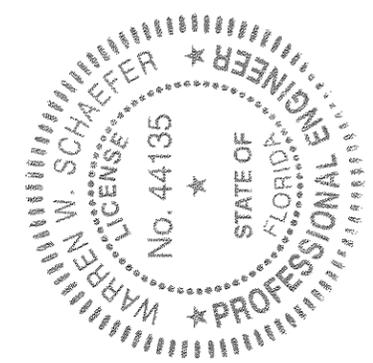





DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-16	DATE: 12/15/15
DATE	BY
REVISION DESCRIPTION	NO.
DRAWING TITLE SERIES SV23185B HW ALUMINUM HORIZONTAL SLIDING BR WINDOW (LMI)	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	MANUFACTURER DIEBOLD, INCORPORATED 818 MULBERRY ROAD SE CANTON, OH 44707 330-489-4114
CERTIFICATION JUL 07 2016	WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1909	REV.
SHEET NO. 3	OF 5

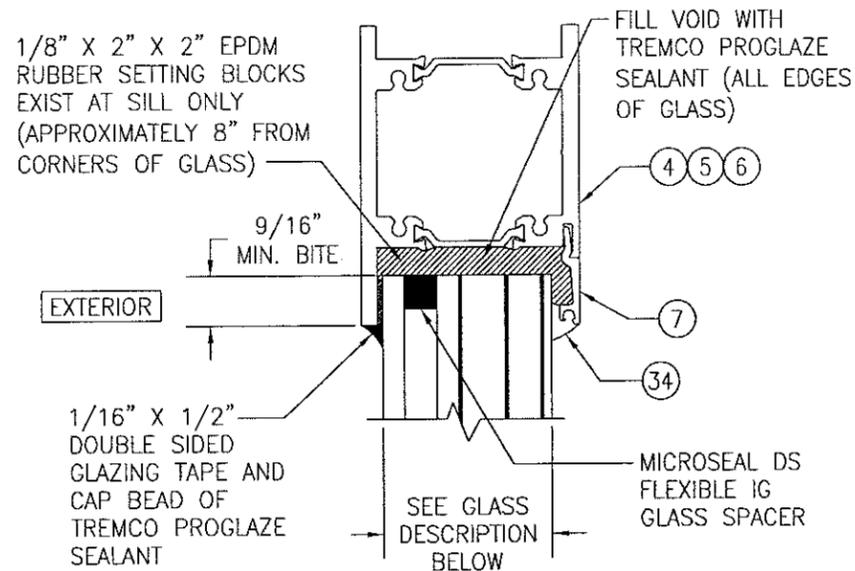








**TYPICAL GLAZING DETAIL**

**GLASS DESCRIPTION:**

1 15/16" OVERALL THICK I.G. LAMINATED GLASS (1/4" AN EXTERIOR; 3/8" SPACER; 1/4" AN/0.03 PVB/1/2" AN/0.03 PVB/3/8" AN/0.03 PVB/3/32" AN INTERIOR)  
 NOTE: PVB IS KURARAY BUTACITE PVB (PREVIOUSLY DUPONT)

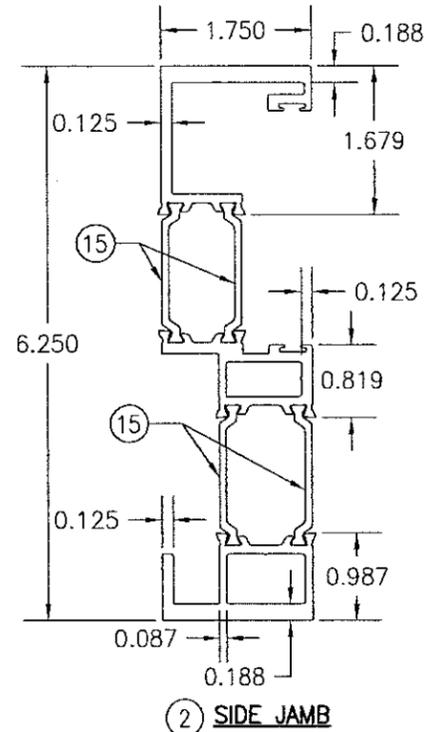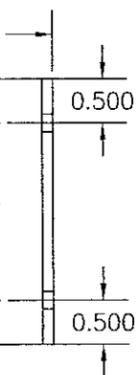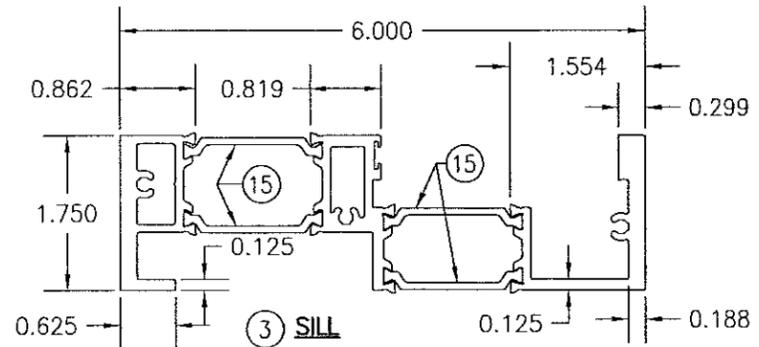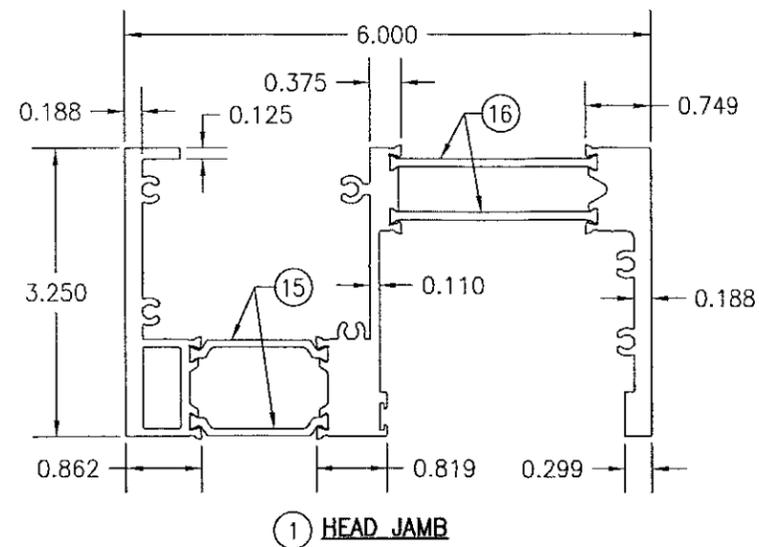


Approved as complying with the Florida Building Code  
 Date 7/21/16  
 NOAH 16-0519.09  
 Miami Dade Product Control  
 By /Sheq. /

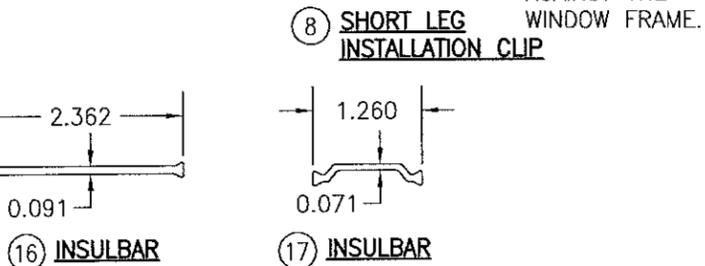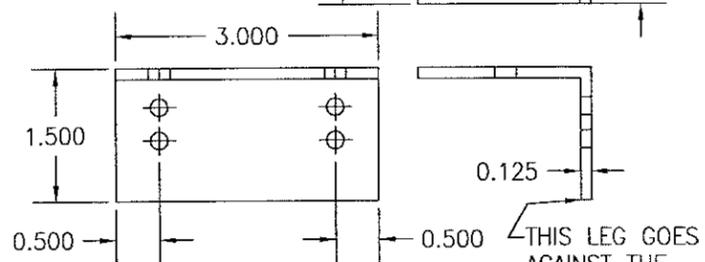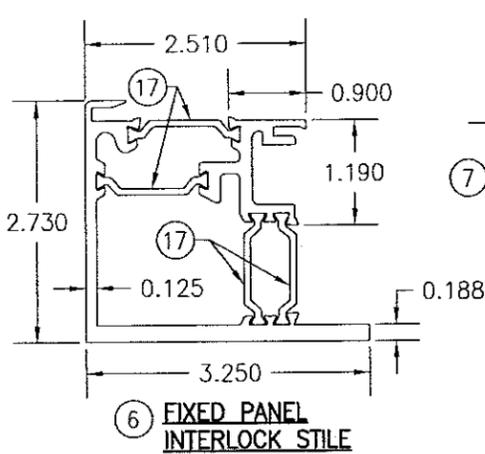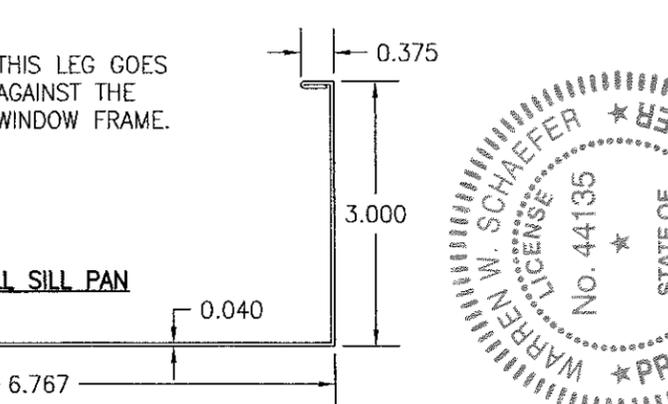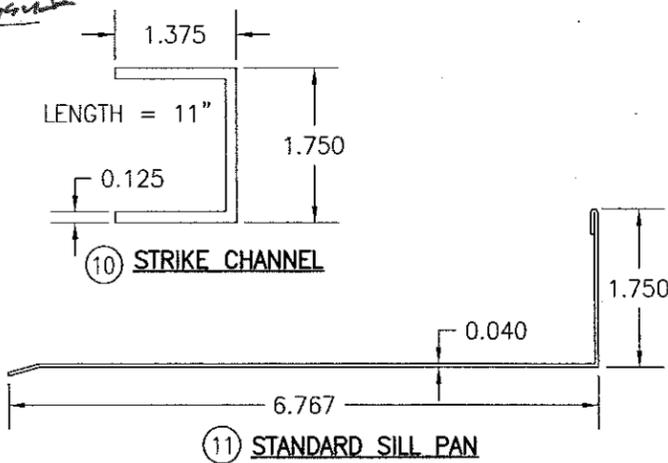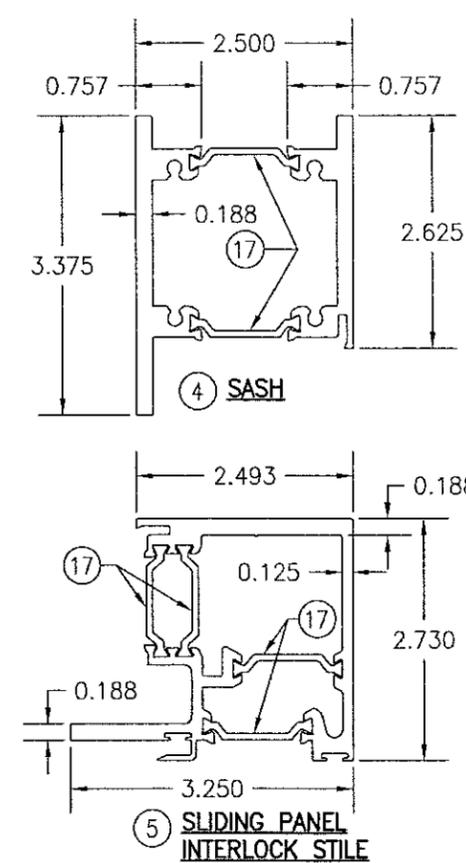

DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-16	DATE: 12/15/15
NO.	REVISION DESCRIPTION
BY	DATE
DRAWING TITLE SERIES SV23185B HW ALUMINUM HORIZONTAL SLIDING BR WINDOW (LMI)	
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH, PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424	MANUFACTURER DIEBOLD, INCORPORATED 818 MULBERRY ROAD SE CANTON, OH 44707 330-489-4114
CERTIFICATION WARREN W. SCHAEFER LICENSE NO. 44135 STATE OF FLORIDA PROFESSIONAL ENGINEER	JUL 07 2016 WARREN W. SCHAEFER, P.E. P.E. NO. 44135
DRAWING NO. 1909	REV.
SHEET NO. 4	OF 5

ITEM #	ITEM DESCRIPTION	MANUFACTURER/NOTES
PARTS		
1	HEAD FRAME	6063-T6 ALUMINUM
2	SIDE JAMB	6063-T6 ALUMINUM
3	SILL	6063-T6 ALUMINUM
4	SASH	6063-T6 ALUMINUM
5	SLIDING PANEL INTERLOCK STILE	6063-T6 ALUMINUM
6	FIXED PANEL INTERLOCK STILE	6063-T6 ALUMINUM
7	GLAZING BEAD	6063-T6 ALUMINUM
8	SHORT LEG INSTALLATION CLIP	6063-T6 ALUMINUM
9	LONG LEG INSTALLATION CLIP	6063-T6 ALUMINUM
10	LOCK STRIKE CHANNEL	6063-T6 ALUMINUM
11	STANDARD SILL PAN	5005-H34Q ALUMINUM
12	TALL SILL PAN	5005-H34Q ALUMINUM
13	1/8" X 2" X 6" BACKER PLATE	6063-T6 ALUMINUM (CENTERED WITH EA. PAIR OF SCREWS)
14	1/8" X 2" X 6" BACKER PLATE	6063-T6 ALUMINUM (1 PER ROLLER)
15	INSULBAR	POLYAMIDE PA 66 GF25 I-STRUT BY TECHNOFORM
16	INSULBAR	POLYAMIDE PA 66 GF25 I-STRUT BY TECHNOFORM
17	INSULBAR	POLYAMIDE PA 66 GF25 I-STRUT BY TECHNOFORM
18	25/64" DIA. X 0.488" LONG DOOR GUIDES	PLASTIC
19	15/32" X 2" WIDE PLYWOOD REINFORCEMENT	FULL LENGTH OF INSULBARS
20	ALUMINUM SILL COVER	ANODIZED ALUMINUM
21	SASH STOP	6063-T6 ALUMINUM
HARDWARE		
22	NIGHT LOCK	GLOBAL DOOR CONTROLS #TH1102
23	KEYED CYLINDER	LESS CORE BEST #B34362-C181-RP2-626
24	DAY LATCH & STRIKE	ADAMS RITE #MS1847-13-630 & MS4808 STRIKE
25	LEVER HANDLE	ADAMS RITE #1000-21-24-130
26	PULL HANDLE	AMEROCK #BP1592-G10 OR EQUAL
27	ROLLER (ONE PAIR PER SLIDING PANEL)	STANLEY #BP250N-41 (405305)
28	SLIDING DOOR TRACK	STANLEY #BP250N-01-72 (405104)
29	DOOR STOP	STANLEY BP250-77 (ZINK & RUBBER)
SEALS & SEALANTS		
33	PILE WEATHERSTRIP	ULTRAFAB #W31175NG0000
34	DENSE EPDM RUBBER GLAZING GASKET	PITTCO #12-524 (DUROMETER = 70 +/-5)
35	PILE WEATHERSTRIP	TUBELITE #P1098A
36	1/2" X 1" X 1" FOAM WEEP HOLE BAFFLE	BY CITADEL
FASTENERS		
38	NO. 10-24 X 1" MS WITH WASHER & LOCK NUT	WITHIN 7 1/2" OF ENDS AND MAX. 11 1/2" O.C.
39	NO. 10 X 1" PH SMS SCREWS	4 PER ROLLER
40	NO. 10 X 1" PH UNDERCUT SMS SCREWS	4 PER ROLLER BACKER PLATE
41	NO. 10 X 1/2" PH UNDERCUT SMS SCREWS	1 AT EACH END OF SILL PAN
42	NO. 10 X 3/4" PH UNDERCUT SMS SCREWS	4 PER BACKER PLATE
43	NO. 10 X 3" PH SMS SCREWS	6" FROM FIXED PANEL CORNERS (HEAD, SILL & SIDE)
44	1/4-20 X 1 1/2" FL HD MS & REV-NUT	3 PER STRIKE CHANNEL
45	NO. 8 X 1 1/4" OVAL HEAD SMS	3 PER SASH STOP (NEAR ENDS AND EQUALLY SPACED)

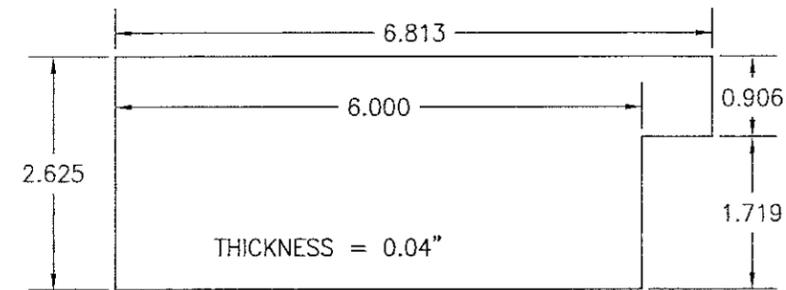

(20) ALUMINUM SILL COVER



(21) SASH STOP

Approved as complying with the  
Florida Building Code  
Date Jul 21, 2016  
NOA# 16-0519.09  
Miami Dade Product Control  
By Shag J. Gandy



DRAWN BY: W.W.S.	CHECKED BY: W.W.S.
PLOT: 1-16	DATE: 12/15/15
DATE	
BY	
REVISION DESCRIPTION	
NO.	
DRAWING TITLE SERIES SV23185B HW ALUMINUM HORIZONTAL SLIDING BR WINDOW (LMI)	MANUFACTURER DIEBOLD, INCORPORATED 818 MULBERRY ROAD SE CANTON, OH 44707 330-489-4114
CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809)	7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 561-744-3424
CERTIFICATION JUL 07 2016	WARREN W. SCHAEFER P.E. P.E. NO. 44135
DRAWING NO. 1909	REV.
SHEET NO. 5 OF 5	