



MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208

Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/building

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

PGT Industries, Inc.
1070 Technology Drive
North Venice, FL 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "SH-5400" PVC Single Hung Window – N.I.

APPROVAL DOCUMENT: Drawing No. **MD-SH5400-01** titled "Single Hung Window Installation - NI", sheets 1 through 12 of 12, dated 05/15/15, with revision **C** dated 03/10/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA No. **17-0630.06** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




7/16/20

NOA No. 20-0401.04
Expiration Date: July 30, 2025
Approval Date: July 23, 2020
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS


1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 15-0519.06)
2. Drawing No. **MD-SH5400-01** titled "Single Hung Window Installation - NI", sheets 1 through 12 of 12, dated 05/15/15, with revision **B** dated 06/06/17, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 17-0630.06)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a PVC sliding glass door, a PVC fixed window and an aluminum sliding glass door, using: Kodispac 4SG TPS spacer system, Duraseal® spacer system, Super Spacer® NXT™ spacer system and XL Edge™ spacer system at insulated glass, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-8717**, **FTL-8968** and **FTL-8970**, dated 11/16/15, 06/07/16 and 06/02/16 respectively, all signed and sealed by Idalmis Ortega, P.E.
(Submitted under previous NOA No. 16-0714.04)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a series 5500 PVC single hung window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7964**, dated 11/15/14, signed and sealed by Idalmis Ortega, P.E.
(Submitted under NOA No. 15-0519.06)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 5th Edition (2014)**, dated 05/15/15 and 08/29/17, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 15-0519.06)
2. Glazing complies with **ASTM E1300-09**


Manuel Pérez, P.E.
Product Control Examiner
NOA No. 20-0401.04
Expiration Date: July 30, 2025
Approval Date: July 23, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **16-0712.03** issued to ENERGI Fenestration Solutions USA for their **"White Rigid PVC Exterior Extrusions for Windows and Doors"** dated 08/10/17, expiring on 02/28/18.
2. Notice of Acceptance No. **16-0712.04** issued to ENERGI Fenestration Solutions USA, Inc. for their **"Bronze and Lighter Shades of Cap Coated White Rigid PVC Exterior Extrusions for Windows and Doors"** dated 09/15/16, expiring on 04/16/20.
3. Notice of Acceptance No. **16-0712.05** issued to ENERGI Fenestration Solutions USA, Inc. for their **"Performance Core Rigid PVC Exterior Extrusions for Windows and Doors"** dated 09/15/16, expiring on 04/16/20.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 5th Edition (2014)** and **FBC 6th Edition (2017)**, dated June 22, 2017, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 17-0630.06)
2. Statement letter of no financial interest, dated June 22, 2017, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
(Submitted under NOA No. 17-0630.06)
3. Proposal No. **16-0125** issued by the Product Control Section, dated March 09, 2016, signed by Ishaq Chanda, P.E.
(Submitted under NOA No. 16-0714.04)
4. Proposal issued by Product Control, dated 6/26/14 and revised on 8/19/14, signed by Jaime Gascon, P.E. Supervisor, Product Control Section.
(Submitted under NOA No. 15-0519.06)

G. OTHERS

1. Notice of Acceptance No. **16-0714.04**, issued to PGT Industries, Inc. for their Series "5400" PVC Single Hung Window - N.I. approved on 08/18/16 and expiring on 07/30/20.


Manuel Pérez, P.E.
Product Control Examiner
NOA No. 20-0401.04
Expiration Date: July 30, 2025
Approval Date: July 23, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **MD-SH5400-01** titled "Single Hung Window Installation - NI", sheets 1 through 12 of 12, dated 05/15/15, with revision **C** dated 03/10/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F588 and TAS 202-94
along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.: **FTL-7897**, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14 **FTL-20-2107.1**, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal) **FTL-20-2107.2**, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal) **FTL-20-2107.3**, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and **FTL-20-2107.4**, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal) dated 07/13/20, all signed and sealed by Idalmis Ortega, P.E

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 5th Edition (2014)**, dated 05/15/15, 08/29/17 and updated on 03/10/20 to the **FBC 7th Edition (2020)**, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)


Manuel Pérez, P.E.
Product Control Examiner
NOA No. 20-0401.04
Expiration Date: July 30, 2025
Approval Date: July 23, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED (CONTINUED)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **18-0122.02**, issued to **ENERGI Fenestration Solutions USA, Inc.**, for their **White Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 03/08/18, expiring on 02/28/23.
2. Notice of Acceptance No. **18-1217.15**, issued to **ENERGI Fenestration Solutions USA, Inc.**, for their **Bronze and Lighter Shades of Cap Coated Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 01/17/19, expiring on 04/16/20.
3. Notice of Acceptance No. **18-1217.16**, issued to **ENERGI Fenestration Solutions USA, Inc.**, for their **Performance Core Rigid PVC Exterior Extrusions for Windows and Doors**, approved on 01/17/19, expiring on 02/04/21.


F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)** and the **FBC 7th Edition (2020)**, dated March 10, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest, dated March 10, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
3. Proposal No. **19-1155 TP** issued by the Product Control Section, dated January 10, 2020, signed by Ishaq Chanda, P.E.


G. OTHERS

1. Notice of Acceptance No. **17-0630.06**, issued to PGT Industries, Inc. for their Series "SH-5400" PVC Single Hung Window - N.I. approved on 11/30/17 and expiring on 07/30/20.



Manuel Perez, P.E.
Product Control Examiner
NOA No. 20-0401.04
Expiration Date: July 30, 2025
Approval Date: July 23, 2020

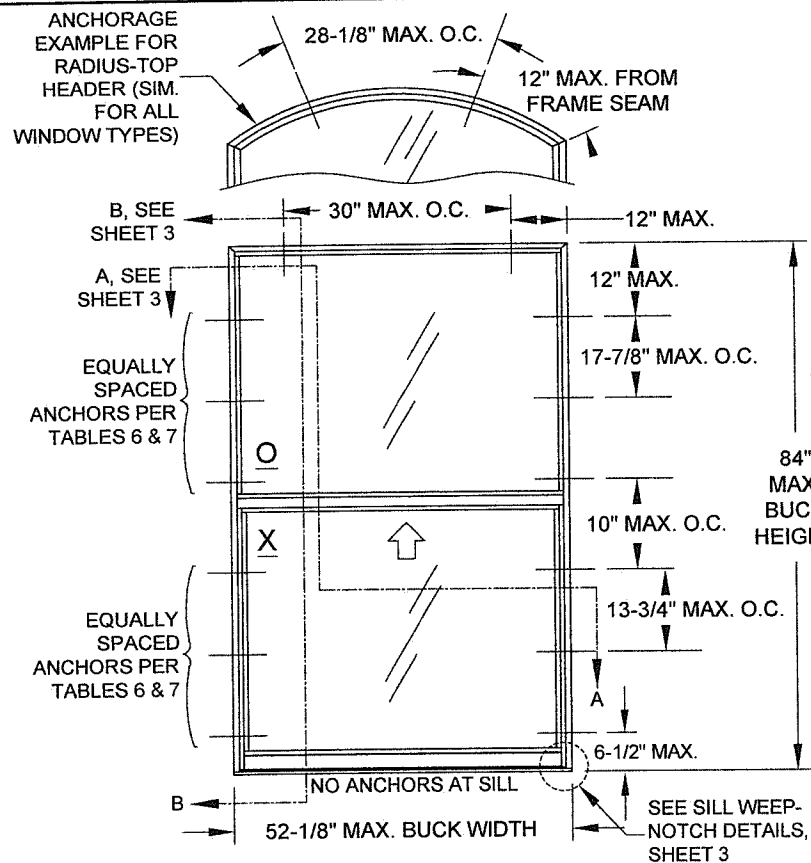


ELEVATION FOR TYP. EQUAL LEG FRAME
SHOWN WITH EQUAL-LITE CONFIGURATION

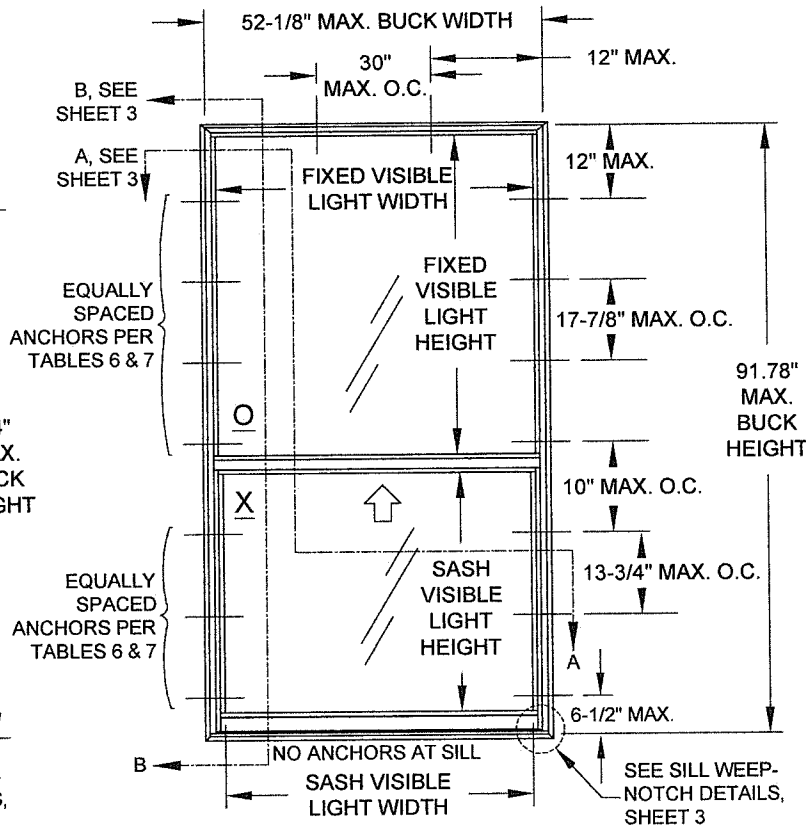

ELEVATION FOR TYP. FLANGE FRAME
SHOWN WITH ORIEL/PROVIEW CONFIGURATION

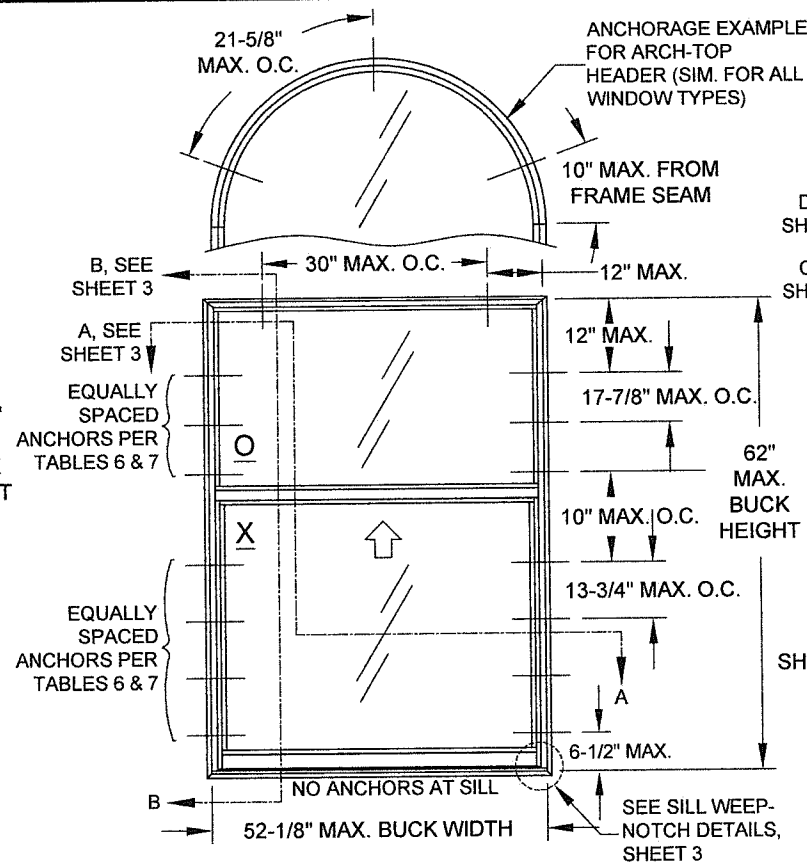

ELEVATION FOR TYP. FLANGE FRAME
SHOWN WITH STANDARD COTTAGE CONFIGURATION
FOR CUSTOM COTTAGE CONFIGURATION UP TO
75\"/>

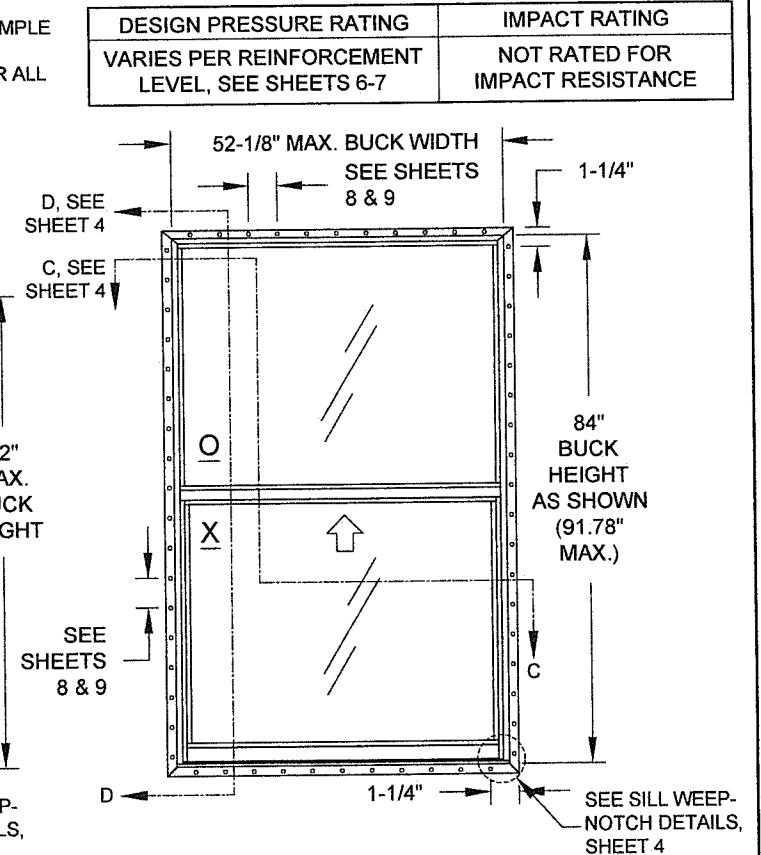

ELEVATION FOR TYP. FIN OR J-CHANNEL FRAME
SHOWN WITH EQUAL-LITE CONFIGURATION
ANCHORED THROUGH THE NAIL-FIN
(SIMILAR ANCHOR DIMENSIONS FOR OTHER CONFIGURATIONS)

GENERAL NOTES: SERIES 5400 NON-IMPACT RESISTANT SINGLE HUNG WINDOW

- THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- SHUTTERS ARE REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS.
- FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.
- ALL WOOD BUCKS LESS THAN 1-1/2\"/>
- ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE REQUIRED MIN. EMBEDMENT. INST. ANCHORS SHOULD BE SEALED. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.
- 1/4\"/>
- DESIGN PRESSURES:
 - NEGATIVE DESIGN LOADS BASED ON STRUCTURAL TESTING AND GLASS PER ASTM E1300.
 - POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL TESTING AND GLASS PER ASTM E1300.
 - DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
- THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE FOR CORROSION RESISTANCE.
- METAL SUBSTRATE TO MEET MIN. STRENGTH AND THICKNESS REQUIREMENTS PER CURRENT FLORIDA BUILDING CODE AND TO BE REVIEWED BY THE AUTHORITY HAVING JURISDICTION.
- REFERENCES: TEST REPORTS FTL-7964; ELCO ULTRA CON NOA; DEWALT ULTRA CON+; ELCO/DEWALT CRETEFLEX NOA; ELCO/DEWALT AGGRE-GATOR NOA; ENERGI WINDOW AND DOOR PROFILES, LTD WHITE & BRONZE/LIGHTER SHADES OF CAP COATED PVC EXTRUSION NOA'S; NATIONAL DESIGN SPECIFICATION FOR WOOD CONSTRUCTION ANSI/AF&PA NDS & ALUMINUM DESIGN MANUAL
- APPLICABLE EGRESS REQUIREMENTS TO BE REVIEWED BY BUILDING OFFICIAL.

USER INSTRUCTIONS:

- DETERMINE THE SITE SPECIFIC, WINDOW OPENING'S DESIGN PRESSURE REQUIREMENT FROM ASCE 7.
- DETERMINE THE MOST SUITABLE ANCHOR GROUP FROM TABLES 2 OR 3 ACCORDING TO THE INSTALLATION CONDITIONS.
- KNOWING YOUR GLAZING OPTION (TABLE 1), WINDOW CONFIGURATION AND SIZE, DETERMINE YOUR WINDOW'S DESIGN PRESSURE FROM TABLES 4 OR 5. IT MUST EQUAL OR EXCEED THE DESIGN PRESSURE REQUIREMENT FOR THE WINDOW OPENING OBTAINED IN STEP 1.
- DETERMINE THE ANCHOR QUANTITY FROM TABLES 6 OR 7. VERIFY THE ANCHOR/SUBSTRATE WILL MEET REQUIREMENTS FOR YOUR OPENING'S CONDITION FROM TABLES 2 OR 3, AND THAT ALL MIN. REQUIREMENTS FROM THIS SHEET-SET ARE MET.
- INSTALL AS PER SHEET 3 FOR THRU-FRAME INSTALLATION OR SHEET 4 FOR INTEGRAL FIN INSTALLATION.

NOTE: DESIGN PRESSURE RATING DETERMINATION IS THE SAME PROCESS FOR ALL FRAME TYPES (J-CHANNEL, FLANGE, INTEGRAL FIN OR EQUAL LEG/BOX).

GENERAL NOTES.....	1
ELEVATIONS.....	1
FRAME, GLASS & ANCHOR OPTIONS.....	2
INSTALLATION, FLANGE & EQUAL LEG/BOX.....	3
INSTALLATION, INTEGRAL FIN & J-CHANNEL.....	4
GLAZING DETAILS.....	5
DESIGN PRESSURES.....	6-7
ANCHOR QUANTITIES.....	8-9
EXTRUSION PROFILES.....	10
ASSEMBLY & PARTS LIST.....	11-12

CODES / STANDARDS USED:

- 2020 FLORIDA BUILDING CODE (FBC), 7TH EDITION
- 2017 FLORIDA BUILDING CODE (FBC), 6TH EDITION
- ASTM E1300-09
- ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2015
- AISI S100-16
- AISC 360-16

Revision:

C) UPDATED TO FBC 2020,
REVISED ANCHOR TYPE TABLE.
AK - 3/10/20

Description:

GENERAL NOTES & ELEVATION

Title:

SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model:

SH-5400

Scale:

NTS

Sheet:

1 OF 12

Drawing No.

MD-SH5400-01

Rev:

C

Drawn By:

J ROSOWSKI

Date:


05/15/15

PRODUCT REVISED
as complying with the Florida
Building Code

NOA-No. **20-0401.04**

Expiration Date: **07/30/2025**

By: *Manuel Perez*
Miami-Dade Product Control

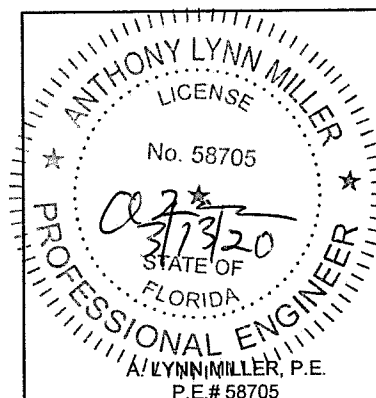

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600

REGISTRATION #29296

TABLE 1: ALLOWABLE GLASS TYPES

Glass Type	Description (Listed from Exterior to Interior)	Design Pressure	
		Table #	Sheet #
1	3/4" I.G.: 1/8" A Exterior Cap + 1/2" Air Space + 1/8" A Exterior Cap	4	6
2	3/4" I.G.: 1/8" T Exterior Cap + 1/2" Air Space + 1/8" T Exterior Cap	4, 5	6, 7
3	3/4" I.G.: 3/16" A Exterior Cap + 3/8" Air Space + 3/16" A Exterior Cap	4, 5	6, 7
4	3/4" I.G.: 3/16" T Exterior Cap + 3/8" Air Space + 3/16" T Exterior Cap	4, 5	6, 7

"A" = ANNEALED; "T" = TEMPERED

TABLE 2: ALLOWABLE ANCHORS THROUGH THE FRAME

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
A	#10 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
		Aluminum, 6063-T5*	3/8"	0.050"
	3/16" steel Ultracon or Ultracon+	P.T. Southern Pine (SG=0.55)	7/16"	1-3/8"
		Concrete (min. 3 ksi)	1"	1-3/8"
	3/16" steel Ultracon	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	3/16" steel Ultracon+	Ungrouted CMU, (ASTM C-90)	1"	1-1/4"
B	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
		Steel, A36*	3/8"	0.050"
		Steel Stud, A653 Gr. 33*	3/8"	0.0451" (18 Ga.)
	1/4" steel Ultracon or Ultracon+	Aluminum, 6063-T5*	3/8"	0.063"
		P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Concrete (min. 3 ksi)	1"	1-3/8"
C	1/4" steel Ultracon	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Concrete (min. 2.85 ksi)	1"	1-3/4"
	1/4" steel Ultracon+	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
		Concrete (min. 3 ksi)	1-3/16"	1-3/4"
D	1/4" steel Ultracon	Ungrouted CMU, (ASTM C-90)	1"	1-1/4"
		Concrete (min. 3.35 ksi)	1"	1-3/4"
	1/4" steel Ultracon+	Concrete (min. 2.85 ksi)	1"	1-3/4"
		Concrete (min. 3 ksi)	2-1/2"	1-3/4"
	1/4" steel Ultracon+	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
		Concrete (min. 3.35 ksi)	2-1/2"	1-3/4"
	1/4" steel Creteflex	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
		Concrete (min. 3.275 ksi)	1-1/2"	1-3/8"
	1/4" steel Aggre-Gator	Grouted CMU, (ASTM C-90)	2"	2"

TABLE 3: ALLOWABLE ANCHORS THROUGH THE INTEGRAL FIN

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment*
E	2-1/2" x .131" Common Nail	P.T. Southern Pine (SG=.55)	3/8"	2-7/16"
F	2-1/2" Ring-shank Roofing Nail	P.T. Southern Pine (SG=.55)	3/8"	2-7/16"
		P.T. Southern Pine (SG=.55)	1/2"	1-3/8"
	#10 Trusshead SMS (steel, 18-8 S.S. or 410 S.S.)	Aluminum, 6063-T5*	3/8"	0.050"
		Steel Stud, Gr. 33*	3/8"	0.0451" (18 Ga.)
		Steel, A36*	3/8"	0.050"
	#12 SMS (steel, 18-8 S.S. or 410 S.S.)	P.T. Southern Pine (SG=.55)	9/16"	1-3/8"
		Aluminum, 6063-T5*	3/8"	0.063"
		Steel Stud, Gr. 33*	3/8"	0.050"
		Steel, A36*	3/8"	0.050"

* MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE.

Material	Min. F _y	Min. F _u
Steel Screw	92 ksi	120 ksi
18-8 Screw	60 ksi	95 ksi
410 Screw	90 ksi	110 ksi
Elco/DeWalt Aggre-Gator®	57 ksi	96 ksi
Elco UltraCon®	155 ksi	177 ksi
3/16" DeWalt UltraCon+®	117 ksi	164 ksi
1/4" DeWalt UltraCon+®	148 ksi	164 ksi
410 SS Elco/DeWalt CreteFlex®	127.4 ksi	189.7 ksi
6063-T5 Aluminum	16 ksi	22 ksi
A36 Steel	36 ksi	58 ksi
Gr. 33 Steel Stud	33 ksi	45 ksi

FIGURE A: FRAME CONFIGURATIONS

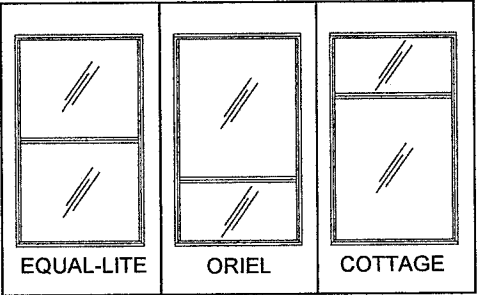


FIGURE B: FRAME TYPES



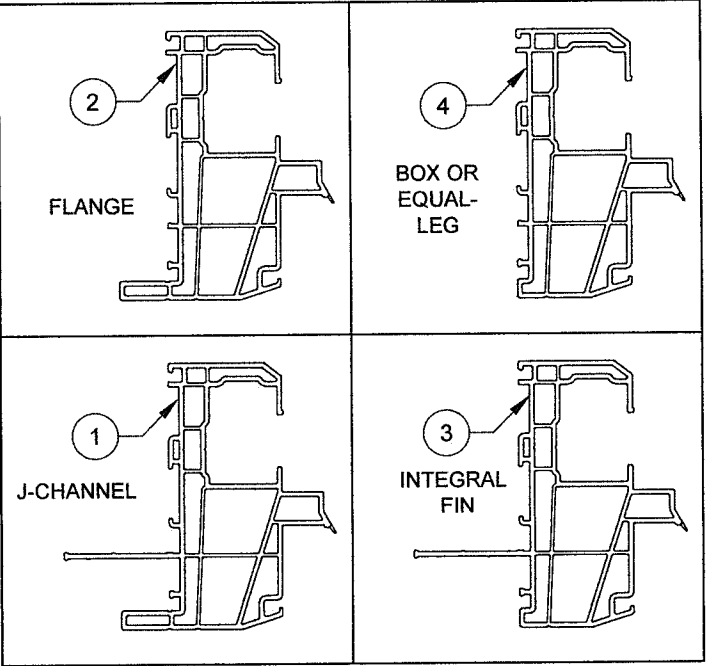


FIGURE C: FRAME SHAPES

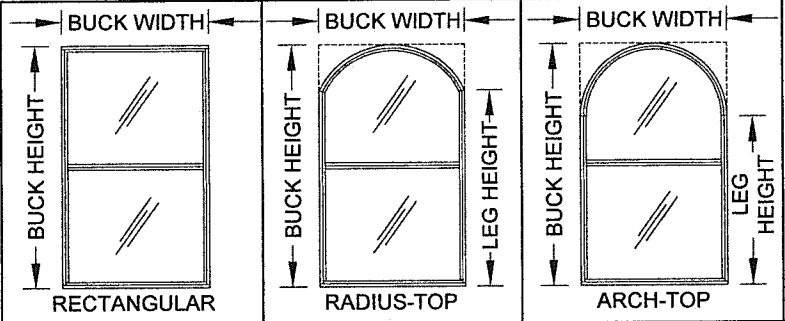

WINDOW SHAPES AS ABOVE OR SIMILAR ARE APPROVED. SHAPES MAY BE USED BY INSCRIBING THE SHAPE IN A BLOCK AND OBTAINING DESIGN PRESSURES AND ANCHORAGE FOR THAT BLOCK SIZE FROM THE TABLES ON SHEETS 6-9.

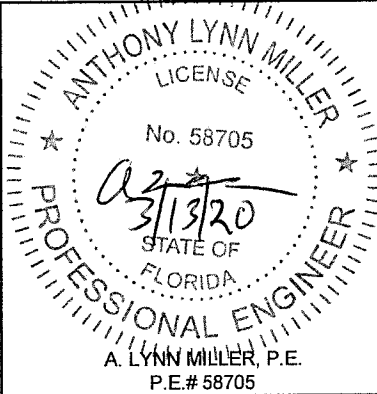

Revision: C) REVISED ANCHOR TYPE TABLE. AK - 3/10/20

Description: GLASS/ANCHORS/FRAME OPTIONS

Title: SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model: SH-5400

Scale: NTS

Sheet: 2 OF 12

Drawing No. MD-SH5400-01

Rev: C


PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. 20-0401.04
Expiration Date: 07/30/2025
By: Manuel Perez
Miami-Dade Product Control

Drawn By: J ROSOWSKI

Date: 05/15/15

INSTALLATION DETAILS FOR FLANGE & EQUAL-LEG/BOX FRAMES

INSTALLATION
OPTION 1
ANCHORED THROUGH
FRAME INTO 2X WOOD
FRAME OR BUCKSTRIP.
SEE NOTE 2, THIS SHEET.

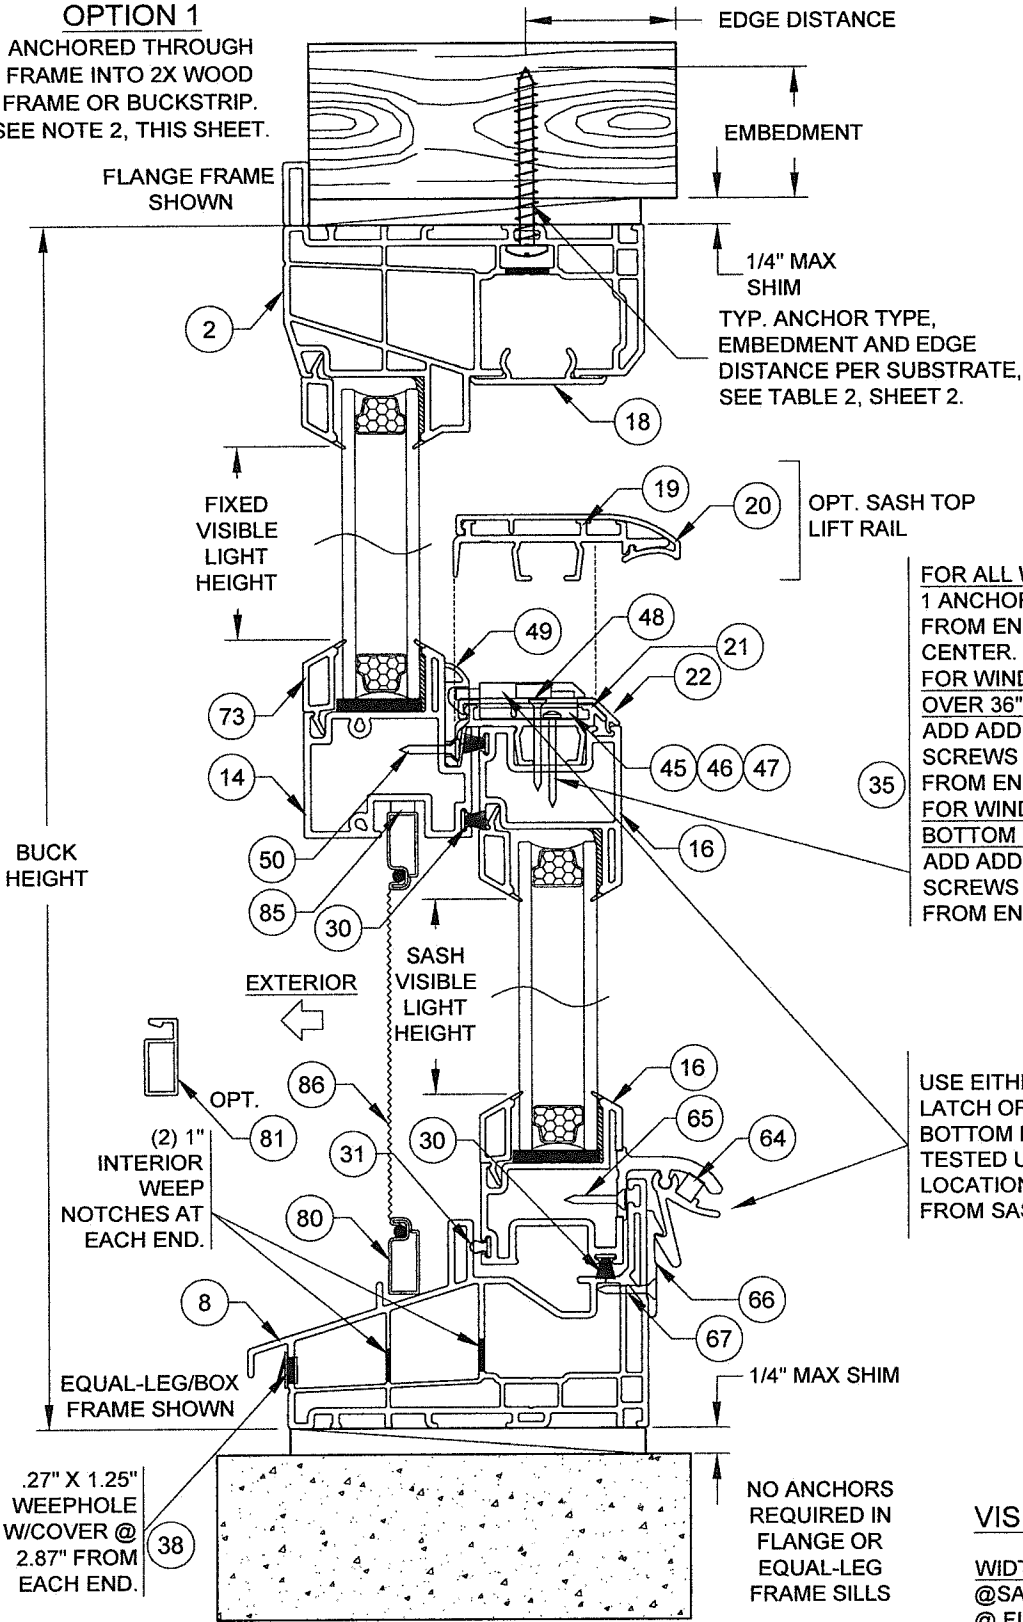

FOR ALL WINDOWS:
1 ANCHOR @ 3.55"
FROM END AND AT
CENTER.
FOR WINDOWS
OVER 36" WIDE:
ADD ADDITIONAL
SCREWS @ 16-3/8"
FROM END.
FOR WINDOWS WITH
BOTTOM LOCKS:
ADD ADDITIONAL
SCREWS @ 8-3/8"
FROM END.

USE EITHER
LATCH OR
BOTTOM LOCK.
TESTED UNIT
LOCATION: 6-5/8"
FROM SASH END.


NO ANCHORS
REQUIRED IN
FLANGE OR
EQUAL-LEG
FRAME SILLS

VISIBLE LIGHT FORMULAS

WIDTH
@ SASH: BUCK WIDTH - 6-1/2"
@ FIXED LITE: BUCK WIDTH - 4-3/8"

HEIGHT (EQUAL-LITE)
BUCK HEIGHT/2 - 3-15/16"

INSTALLATION OPTION 2
ANCHORED THROUGH FRAME
DIRECTLY INTO CONCRETE/CMU.

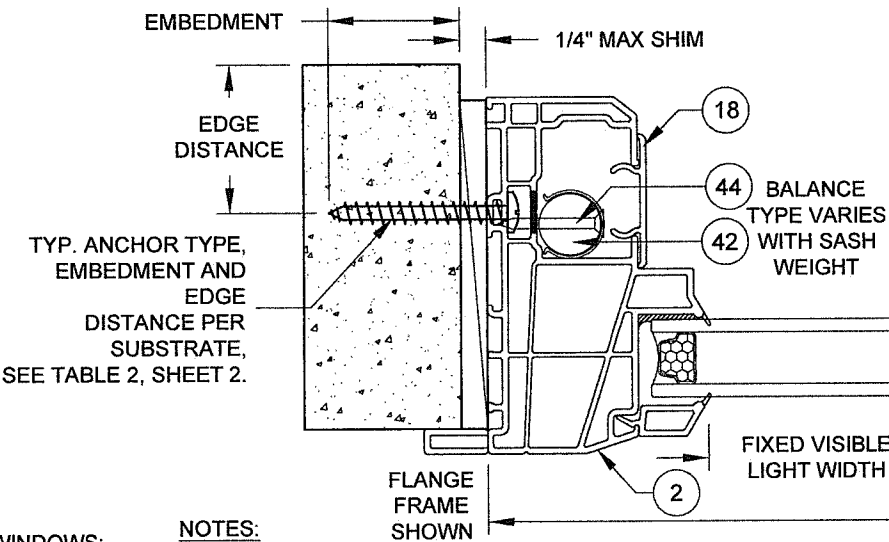


NOTES:

1) USE ONLY
SUBSTRATE-APPROPRIATE
ANCHORS LISTED ON TABLE 2,
SHEET 2. FOLLOW EMBEDMENT AND
EDGE DISTANCE LIMITS. ANY
INSTALLATION OPTION SHOWN MAY
BE USED ON ANY SIDE OF THE
WINDOW.

2) MASONRY ANCHORS MAY BE
USED INTO WOOD AS PER TABLE 2,
SHEET 2. ALL WOOD BUCKS LESS
THAN 1-1/2" THICK ARE TO BE
CONSIDERED 1X INSTALLATIONS. 1X
WOOD BUCKS ARE OPTIONAL IF
UNIT IS INSTALLED DIRECTLY TO
SUBSTRATE. WOOD BUCKS
DEPICTED AS 2X ARE 1-1/2" THICK
OR GREATER. 1X AND 2X BUCKS
(WHEN USED) SHALL BE DESIGNED
TO PROPERLY TRANSFER LOADS TO
THE STRUCTURE. WOOD BUCK
DESIGN AND INSTALLATION IS THE
RESPONSIBILITY OF THE ENGINEER
OR ARCHITECT OF RECORD.


3) VISIBLE LIGHT WIDTH OR HEIGHT
(ALSO REFERRED TO AS DAYLIGHT
OPENING) IS MEASURED FROM
BEADING TO BEADING.

INSTALLATION OPTION 3
ANCHORED THROUGH FRAME AND 1X
BUCKSTRIP INTO CONCRETE/CMU.
SEE NOTE 2, THIS SHEET.

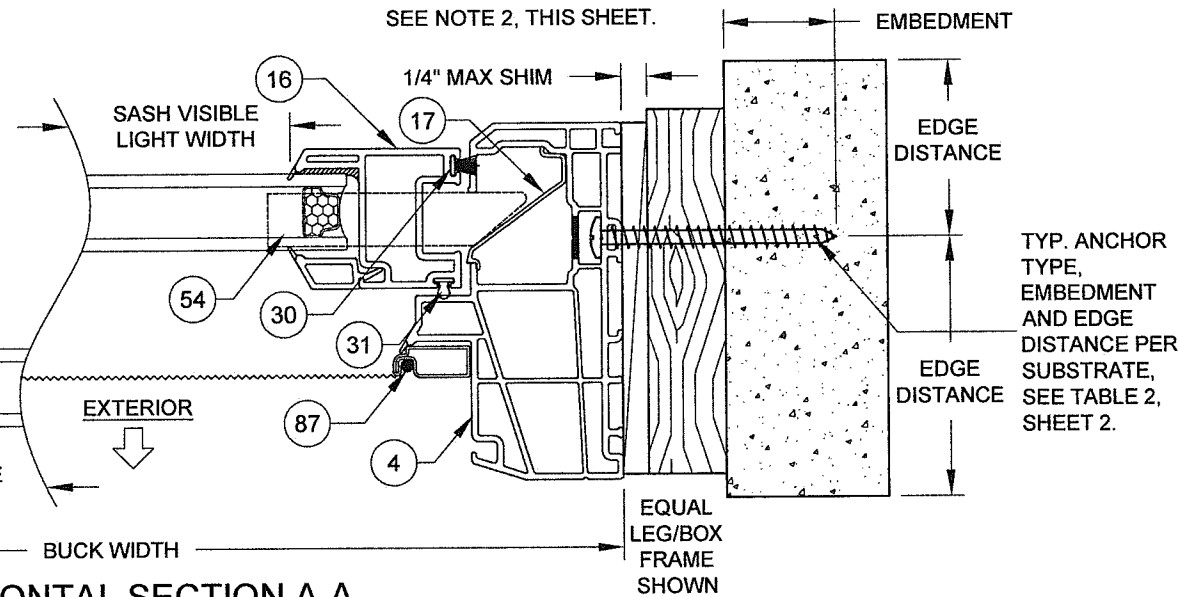

HORIZONTAL SECTION A-A

DADE APPROVED MULLION, FBC COMPLIANT ALUMINUM/STEEL FRAMING OR STEEL STUD.
MAY BE VERTICAL OR HORIZONTAL. SEE SUBSTRATE PROPERTIES, TABLE 2, SHEET 2.

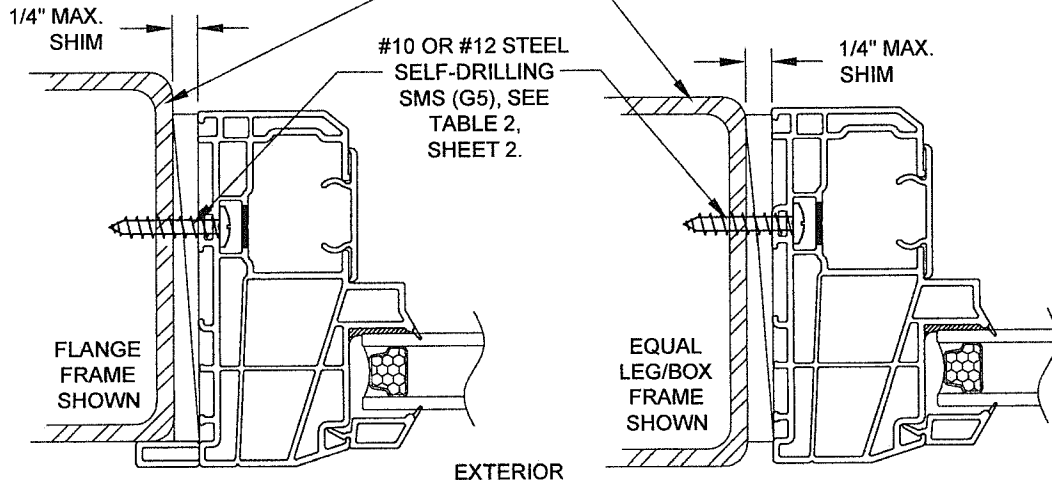

INSTALLATION
OPTION 4
ANCHORED THROUGH
FRAME INTO METAL

INSTALLATION
OPTION 4
ANCHORED THROUGH
FRAME INTO METAL

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 20-0401.04
Expiration Date: 07/30/2025

By: Manuel Perez
Miami-Dade Product Control

Drawn By:
J ROSOWSKI

Date:
05/15/15

Revision:
C) NO CHANGES THIS SHEET.
AK - 3/10/20

Description:
FLANGE & EQUAL-LEG/BOX FRAMES

Title:
SINGLE HUNG WINDOW INSTALLATION - NI


Series/Model:
SH-5400

Scale:
NTS

Sheet:
3 OF 12

Drawing No.
MD-SH5400-01

Rev:
C

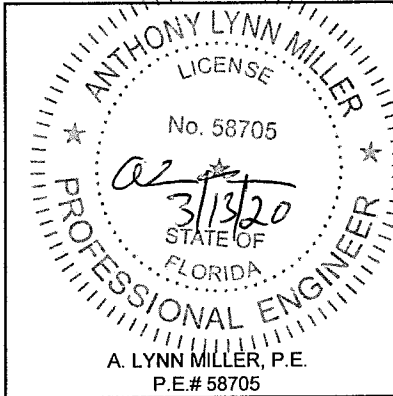


PGT
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

INSTALLATION DETAILS FOR INTEGRAL FIN & J-CHANNEL FRAMES

INSTALLATION OPTION 5
ANCHORED THROUGH INTEGRAL
FIN INTO 2X WOOD FRAME OR
BUCK- STRIP. SEE NOTE 2, THIS
SHEET.

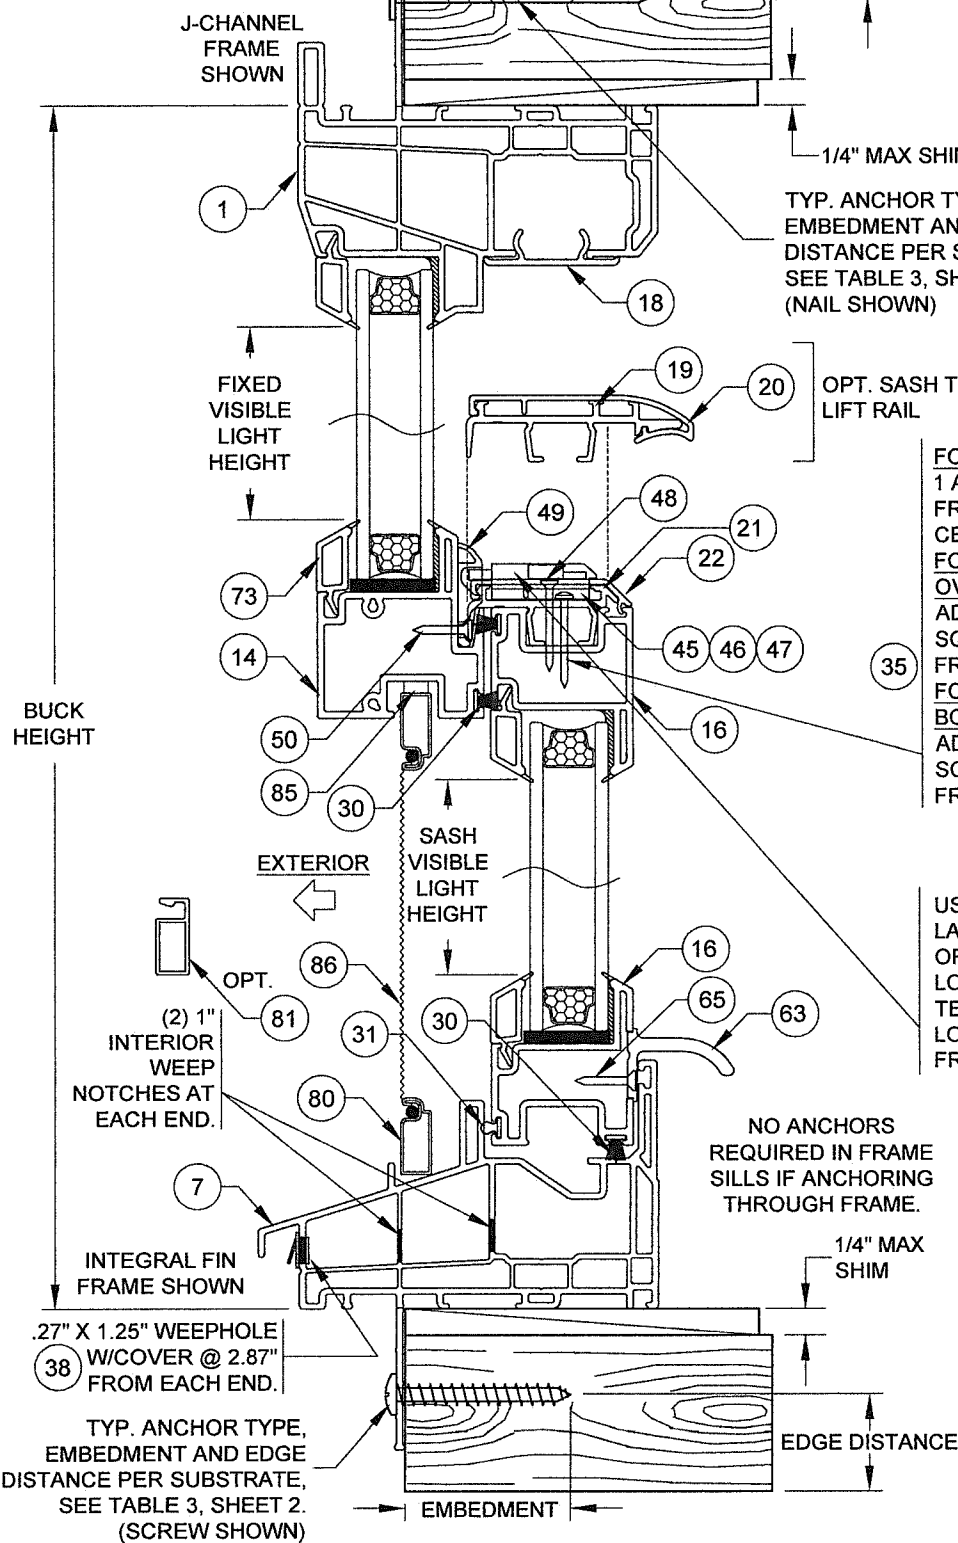

INSTALLATION OPTION 5
ANCHORED THROUGH INTEGRAL FIN
INTO 2X WOOD FRAME OR BUCK-
STRIP. SEE NOTE 2, THIS SHEET.

VERTICAL SECTION D-D

TYP. ANCHOR TYPE,
EMBEDMENT AND EDGE
DISTANCE PER SUBSTRATE,
SEE TABLE 2, SHEET 2.
(SCREW SHOWN)

TYP. ANCHOR TYPE,
EMBEDMENT AND EDGE
DISTANCE PER SUBSTRATE,
SEE TABLE 3, SHEET 2.
(NAIL SHOWN)

FOR ALL WINDOWS:
1 ANCHOR @ 3.55"
FROM END AND AT
CENTER.
FOR WINDOWS
OVER 36" WIDE:
ADD ADDITIONAL
SCREWS @ 16-3/8"
FROM END.
FOR WINDOWS WITH
BOTTOM LOCKS:
ADD ADDITIONAL
SCREWS @ 8-3/8"
FROM END.

USE EITHER
LATCH (SHOWN)
OR BOTTOM
LOCK (SHEET 3).
TESTED UNIT
LOCATION: 6-5/8"
FROM SASH END.


NO ANCHORS
REQUIRED IN FRAME
SILLS IF ANCHORING
THROUGH FRAME.

VISIBLE LIGHT FORMULAS


WIDTH
@SASH: BUCK WIDTH - 6-1/2"
@ FIXED LITE: BUCK WIDTH - 4-3/8"

HEIGHT (EQUAL-LITE)
BUCK HEIGHT/2 - 3-15/16"

INSTALLATION OPTION 6
ANCHORED THROUGH FRAME INTO
2X WOOD FRAME OR BUCKSTRIP. SEE
NOTE 2, THIS SHEET.

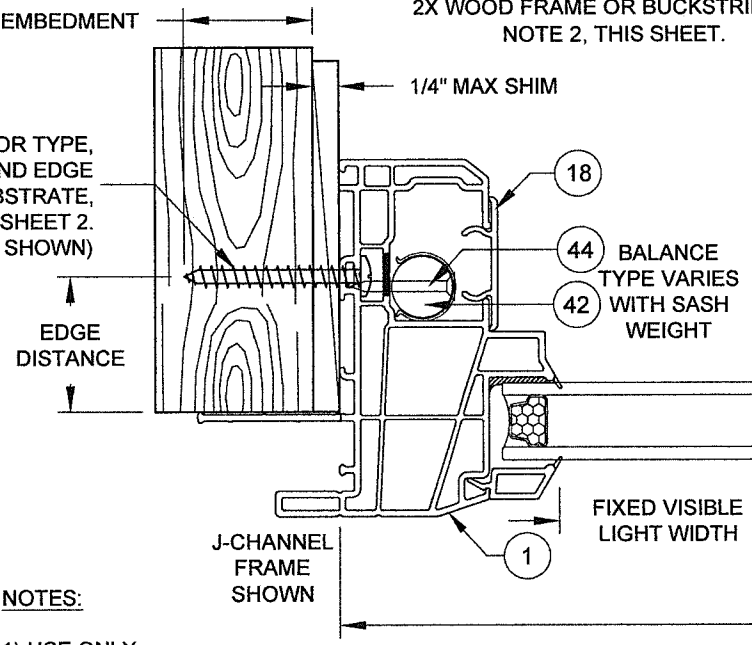


INSTALLATION OPTION 5
ANCHORED THROUGH INTEGRAL FIN
INTO 2X WOOD FRAME OR
BUCKSTRIP. SEE NOTE 2, THIS SHEET.

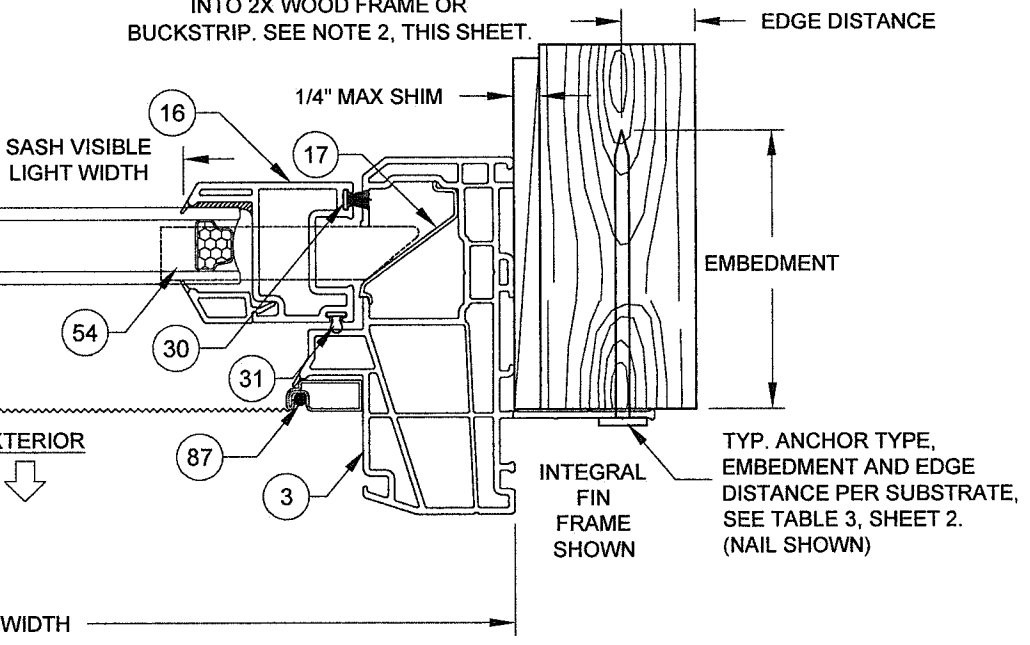

HORIZONTAL SECTION C-C



NOTES:

- 1) USE ONLY
SUBSTRATE-APPROPRIATE
ANCHORS LISTED ON TABLES 2 & 3
OF SHEET 2. FOLLOW EMBEDMENT
AND EDGE DISTANCE LIMITS. ANY
INSTALLATION OPTION SHOWN MAY
BE USED ON ANY SIDE OF THE
WINDOW.
- 2) MASONRY ANCHORS MAY BE
USED INTO WOOD AS PER TABLE 2,
SHEET 2. ALL WOOD BUCKS LESS
THAN 1-1/2" THICK ARE TO BE
CONSIDERED 1X INSTALLATIONS.
1X WOOD BUCKS ARE OPTIONAL IF
UNIT IS INSTALLED DIRECTLY TO
SUBSTRATE. WOOD BUCKS
DEPICTED AS 2X ARE 1-1/2" THICK
OR GREATER. 1X AND 2X BUCKS
(WHEN USED) SHALL BE DESIGNED
TO PROPERLY TRANSFER LOADS
TO THE STRUCTURE. WOOD BUCK
DESIGN AND INSTALLATION IS THE
RESPONSIBILITY OF THE ENGINEER
OR ARCHITECT OF RECORD.
- 3) VISIBLE LIGHT WIDTH OR HEIGHT
(ALSO REFERRED TO AS DAYLIGHT
OPENING) IS MEASURED FROM
BEADING TO BEADING.

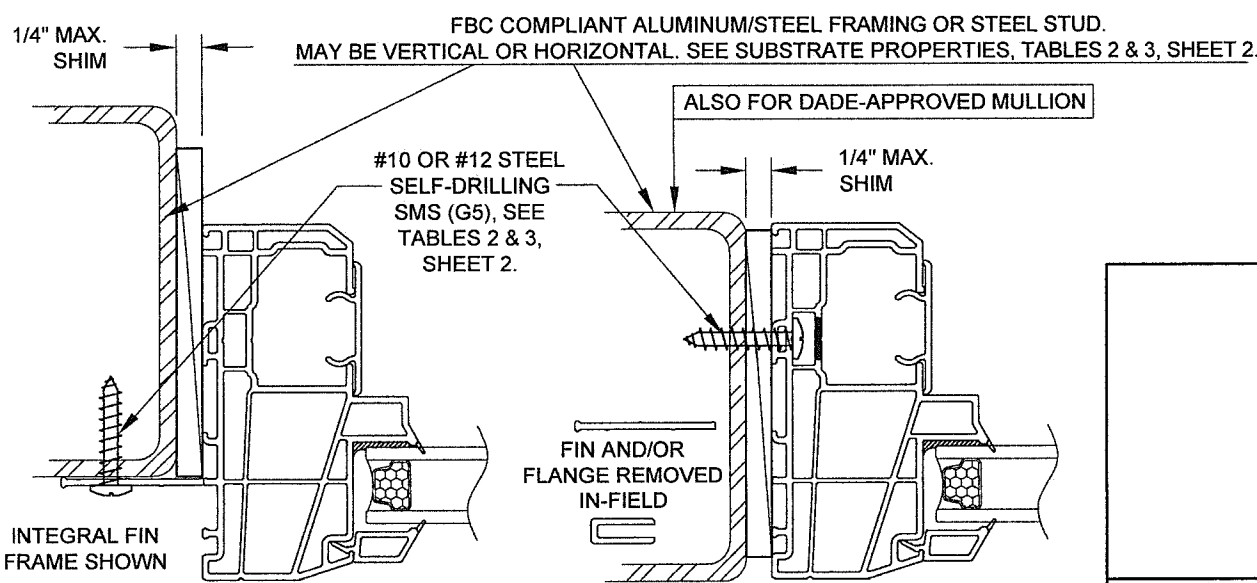

INSTALLATION
OPTION 7
ANCHORED THROUGH
INTEGRAL FIN INTO METAL

INSTALLATION
OPTION 8
ANCHORED THROUGH FRAME INTO
METAL (INTEGRAL FIN/FLANGE REMOVED)

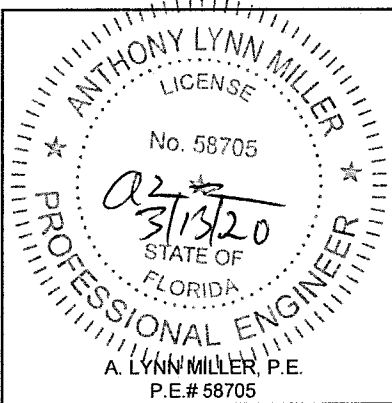

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

Revision:
C) REVISED DADE MULLION
NOTE.
AK - 3/10/20

Description:
J-CHANNEL & INTEGRAL FIN FRAMES


Title:
SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model: SH-5400	Scale: NTS	Sheet: 4 OF 12	Drawing No. MD-SH5400-01	Rev: C
--------------------------	---------------	-------------------	-----------------------------	-----------


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0401.04**
Expiration Date: **07/30/2025**
By: *Manuel Perez*
Miami-Dade Product Control

Drawn By:
J ROSOWSKI


Date:
05/15/15

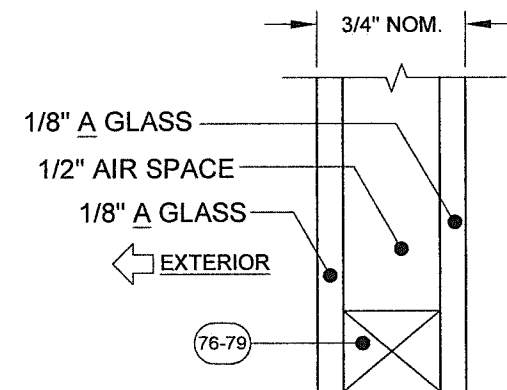


GLASS TYPE 1

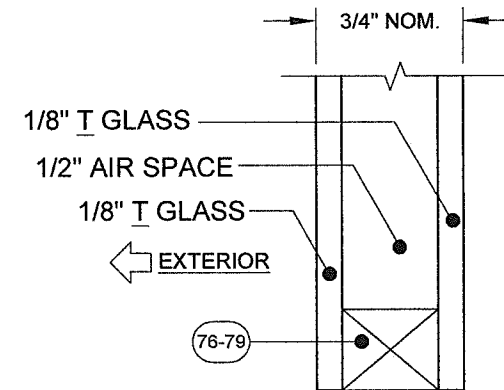


GLASS TYPE 2

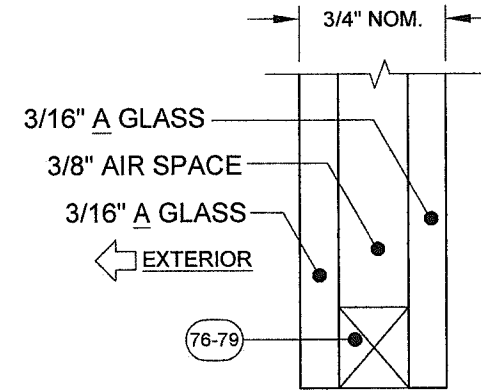


GLASS TYPE 3

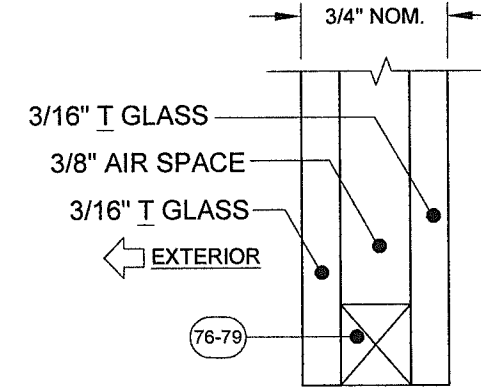

GLASS TYPE 4

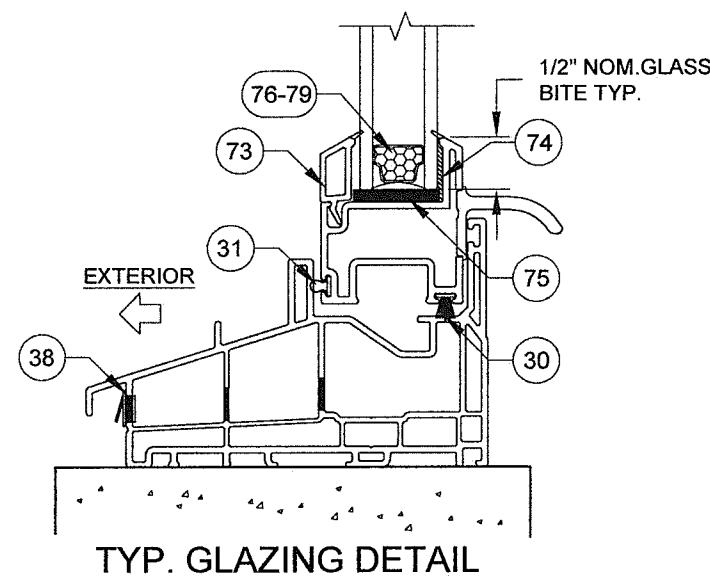

GLAZING NOTES:
"A" = ANNEALED
"T" = TEMPERED

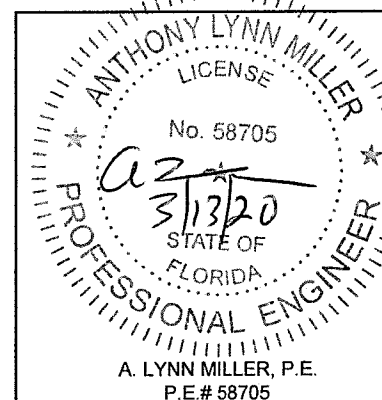

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600

REGISTRATION #29296

Revision:

C) NO CHANGES THIS SHEET.
AK - 3/10/20

Description:

GLAZING DETAILS

Title:

SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model:

SH-5400

Scale:

NTS

Sheet:

5 OF 12

Drawing No.

MD-SH5400-01

Date:

05/15/15

Rev:

C

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0401.04**

Expiration Date: **07/30/2025**

By: *Manuel Perez*
Miami-Dade Product Control

Drawn By:

J ROSOWSKI

TABLE 4:

Glass Types 1 - 4		Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Design Pressure (lbs/ft ²)															
Reinf. Level R1	Window Buck Width (in)																		
	18			24		32		36		40		48		52.125					
Window Buck Height (in)	23.5	Equal-lite	11.394	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-99.0	+50.0	-92.0		
	28	Standard Cottage	14.517 - 15.870	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-97.0	+50.0	-90.0
		Equal-lite	11.583 - 14.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-97.1
		Standard Proview	11.377 - 11.582	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-94.0
	37.375	Tallest	23.517 - 25.286	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-88.0	+50.0	-77.9
		Standard Cottage	20.958 - 23.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-88.6	+50.0	-78.1
		Equal-lite	17.517 - 20.957	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-86.6	+50.0	-78.0
		Standard Proview	14.517 - 17.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-84.2	+50.0	-75.2
	Shortest	11.377 - 14.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-83.0	+50.0	-73.6	
	44	Tallest	27.583 - 31.911	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-97.0	+50.0	-89.0	+50.0	-76.0	+50.0	-71.0
		Custom Size	26.517 - 27.582	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-82.3	+50.0	-73.9
		Standard Cottage	23.517 - 26.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-79.0	+50.0	-70.9
		Equal-lite	20.517 - 23.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-78.3	+50.0	-70.3
		Standard Proview	17.517 - 20.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-78.5	+50.0	-70.4
		Custom Size	14.517 - 17.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-79.5	+50.0	-71.2
	48	Shortest	11.377 - 14.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-94.1	+50.0	-78.8	+50.0	-71.8
		Tallest	31.583 - 35.911	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-90.9	+50.0	-89.3	+50.0	-89.3	+50.0	-74.9	+50.0	-69.1
		Standard Cottage	26.517 - 31.582	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-96.4	+50.0	-73.8	+50.0	-65.8
		Equal-lite	20.517 - 26.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-93.2	+50.0	-71.6	+50.0	-63.9
		Standard Proview	17.517 - 20.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-97.1	+50.0	-74.9	+50.0	-67.0
		Custom Size	14.517 - 17.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-92.0	+50.0	-76.3	+50.0	-68.1
	49.625	Custom Size	12.517 - 14.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-96.7	+50.0	-87.8	+50.0	-73.6	+50.0	-68.9
		Shortest	11.377 - 12.516	+50.0	-100.0	+50.0	-100.0	+50.0	-96.0	+50.0	-93.8	+50.0	-93.8	+50.0	-85.7	+50.0	-72.2	+50.0	-67.3
		Tallest	33.208 - 37.536	+50.0	-100.0	+50.0	-95.4	+50.0	-84.3	+50.0	-82.2	+50.0	-81.9	+50.0	-81.9	+50.0	-71.8	+50.0	-66.8
		Standard Cottage	26.517 - 33.207	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-93.6	+50.0	-71.1	+50.0	-63.3
		Equal-lite	23.517 - 26.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-94.5	+50.0	-72.8	+50.0	-65.1
		Custom Size	20.517 - 23.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-94.6	+50.0	-72.9	+50.0	-65.1
	62	Standard Proview	17.517 - 20.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-96.0	+50.0	-73.7	+50.0	-65.8
		Custom Size	14.517 - 17.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-99.0	+50.0	-89.8	+50.0	-75.1	+50.0	-67.1
		Custom Size	12.517 - 14.516	+50.0	-100.0	+50.0	-100.0	+50.0	-93.7	+50.0	-92.5	+50.0	-92.5	+50.0	-85.7	+50.0	-72.2	+50.0	-67.3
		Shortest	11.377 - 12.516	+50.0	-100.0	+50.0	-100.0	+50.0	-98.7	+50.0	-87.0	+50.0	-87.0	+50.0	-81.9	+50.0	-69.5	+50.0	-64.4
		Tallest	36.517 - 41.644	+50.0	-100.0	+50.0	-82.6	+50.0	-71.2	+50.0	-68.5	+50.0	-68.5	+50.0	-67.1	+50.0	-66.1	+50.0	-58.2
		Standard Cottage	31.517 - 36.516	+50.0	-100.0	+50.0	-99.2	+50.0	-88.3	+50.0	-86.6	+50.0	-86.4	+50.0	-86.4	+50.0	-64.2	+50.0	-56.6
	75	Equal-lite	26.517 - 31.516	+50.0	-100.0	+50.0	-100.0	+50.0	-100.0	+50.0	-96.7	+50.0	-85.7	+50.0	-85.7	+50.0	-63.7	+50.0	-56.3
		Standard Proview	23.517 - 26.516	+50.0	-100.0	+50.0	-98.7	+50.0	-87.8	+50.0	-86.0	+50.0	-86.0	+50.0	-81.9	+50.0	-65.4	+50.0	-57.8
		Custom Size	20.517 - 23.516	+50.0	-100.0	+50.0	-88.3	+50.0	-77.0	+50.0	-74.6	+50.0	-74.6	+50.0	-73.6	+50.0	-64.8	+50.0	-58.8
		Custom Size	17.517 - 20.516	+50.0	-97.3	+50.0	-79.9	+50.0	-68.7	+50.0	-65.8	+50.0	-65.8	+50.0	-64.2	+50.0	-60.5	+50.0	-55.6
		Custom Size	14.517 - 17.516	+50.0	-89.6	+50.0	-73.0	+50.0	-61.9	+50.0	-58.9	+50.0	-58.9	+50.0	-57.0	+50.0	-55.9	+50.0	-52.6
		Custom Size	13.017 - 14.516	+50.0	-86.1	+50.0	-70.0	+50.0	-59.0	+50.0	-56.0	+50.0	-56.0	+50.0	-53.9	+50.0	-52.4	+50.0	-51.5
	84	Shortest	11.864 - 13.016	+50.0	-83.7	+50.0	-67.8	+50.0	-57.0	+50.0	-53.9	+50.0	-53.9	+50.0	-51.8	+50.0	-50.0	+50.0	-50.0
Tallest		39.517 - 41.644	+50.0	-100.0	+50.0	-82.6	+50.0	-71.2	+50.0	-68.5	+50.0	-68.5	+50.0	-67.1	+50.0	-60.6	+50.0	-53.0	
Custom Size		38.517 - 39.516	+50.0	-100.0	+50.0	-88.7	+50.0	-77.5	+50.0	-75.0	+50.0	-74.1	+50.0	-74.1	+50.0	-60.7	+50.0	-53.1	
Equal-lite		35.517 - 38.516	+50.0	-100.0	+50.0	-92.0	+50.0	-80.8	+50.0	-78.5	+50.0	-77.9	+50.0	-77.9	+50.0	-60.0	+50.0	-52.4	
Custom Size		32.517 - 35.516	+50.0	-100.0	+50.0	-85.3	+50.0	-74.0	+50.0	-71.4	+50.0	-70.2	+50.0	-70.2	+50.0	-60.2	+50.0	-52.5	
Standard Proview		29.517 - 32.516	+50.0	-94.6	+50.0	-77.5	+50.0	-66.3	+50.0	-63.3	+50.0	-61.6	+50.0	-61.6	+50.0	-59.2	+50.0	-53.0	
91.78	Custom Size	26.517 - 29.516	+50.0	-87.2	+50.0	-71.0	+50.0	-60.0	+50.0	-56.9	+50.0	-56.9	+50.0	-54.9	+50.0	-53.5	+50.0	-51.5	
	Shortest	24.864 - 26.516	+50.0	-85.0	+50.0	-69.0	+50.0	-58.1	+50.0	-55.0	+50.0	-55.0	+50.0	-53.0	+50.0	-51.4	+50.0	-50.6	
	Equal-lite	38.517 - 41.644	+50.0	-94.6	+50.0	-77.5	+50.0	-66.3	+50.0	-63.3	+50.0	-61.6	+50.0	-61.6	+50.0	-58.4	+50.0	-50.5	
91.78	Custom Size	35.517 - 38.516	+50.0	-87.2	+50.0	-71.0	+50.0	-60.0	+50.0	-56.9	+50.0	-56.9	+50.0	-54.9	+50.0	-53.5	+50.0	-50.8	
	Standard Proview	33.864 - 35.516	+50.0	-83.7	+50.0	-67.8	+50.0	-57.0	+50.0	-53.9	+50.0	-53.9	+50.0	-51.8	+50.0	-50.0	+50.0	-50.0	

SEE TABLE 6, SHEET 8 FOR ANCHOR GROUP AND QUANTITY.

** MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136


(APPLIES TO ANY HEIGHT 91.78" OR LESS)

NOTES:

1) USE THIS TABLE FOR ALL WINDOWS INSTALLED THROUGH THE FRAME OR INTEGRAL FIN.


2) FRAME DIMENSIONS ARE BUCK. SASH HEIGHT IS AS PER THE FIGURE.

3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.

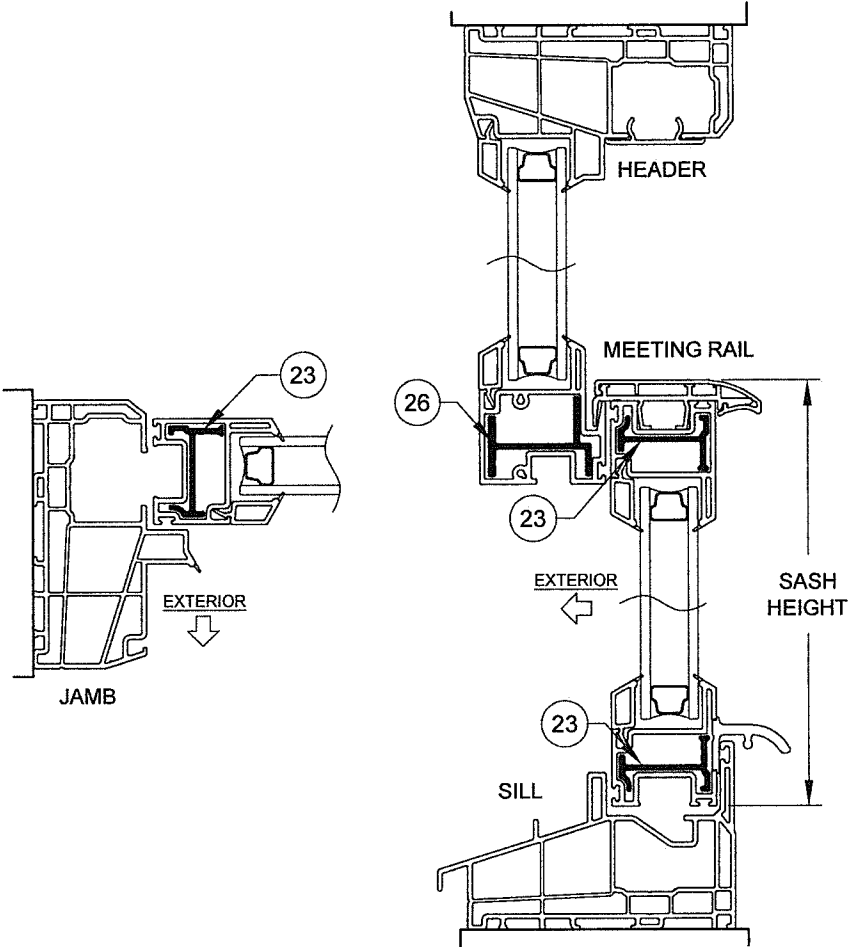

SECTION DETAIL FOR WINDOWS WITH
LEVEL R1 REINFORCEMENT & GLASS TYPES 1-4
(REINFORCEMENTS SHOWN IN FIGURES
ABOVE APPLY TO ALL FRAME TYPES &
CONFIGURATIONS)

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0401.04**
Expiration Date: **07/30/2025**
By: *Manuel Perez*
Miami-Dade Product Control

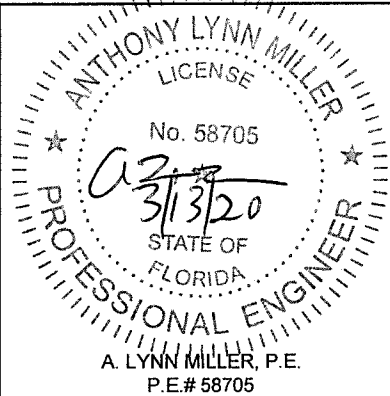

Revision:
C) ADDED MIN. SASH HEIGHT
NOTE.
AK - 3/10/20

Description:
DESIGN PRESSURE TABLE

Title:
SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model:
SH-5400

Scale:
NTS

Sheet:
6 OF 12

Drawing No.
MD-SH5400-01

Rev:
C

Drawn By:
J ROSOWSKI

Date:
05/15/15

TABLE 5:

Glass Types 2 - 4	Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Design Pressure (lbs/ft ²)													
			Window Buck Width (in)													
			18		24		32		36		40		48		52.125	
23.5	Equal-lite	11.394	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-129.0	+65.0	-120.0
	Standard Cottage	14.517 - 15.870	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-127.0	+65.0	-118.0
28	Equal-lite	11.583 - 14.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0
	Standard Preview	11.377 - 11.582	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-123.0
37.375	Tallest	23.517 - 25.286	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-122.0	+65.0	-113.0
	Standard Cottage	20.958 - 23.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-124.6	+65.0	-112.3
	Equal-lite	17.517 - 20.957	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-121.2	+65.0	-109.3
	Standard Preview	14.517 - 17.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-122.2	+65.0	-110.2
	Shortest	11.377 - 14.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-116.0	+65.0	-107.0
44	Tallest	27.583 - 31.911	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-127.0	+65.0	-116.0	+65.0	-93.0
	Custom Size	26.517 - 27.582	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-115.3	+65.0	-103.4
	Standard Cottage	23.517 - 26.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-110.6	+65.0	-99.2
	Equal-lite	20.517 - 23.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-109.6	+65.0	-98.4
	Standard Preview	17.517 - 20.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-109.9	+65.0	-98.6
48	Custom Size	14.517 - 17.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-111.3	+65.0	-99.7
	Shortest	11.377 - 14.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-113.8	+65.0	-101.7
	Tallest	31.583 - 35.911	+65.0	-130.0	+65.0	-130.0	+65.0	-127.2	+65.0	-125.1	+65.0	-116.0	+65.0	-99.0	+65.0	-93.0
	Standard Cottage	26.517 - 31.582	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-103.3	+65.0	-92.1
	Equal-lite	20.517 - 26.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-100.2	+65.0	-89.5
49.625	Standard Preview	17.517 - 20.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-104.8	+65.0	-93.7
	Custom Size	14.517 - 17.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-106.8	+65.0	-95.3
	Custom Size	12.517 - 14.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-110.9	+65.0	-98.8
	Shortest	11.377 - 12.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-114.5	+65.0	-101.8
	Tallest	33.208 - 37.536	+65.0	-130.0	+65.0	-130.0	+65.0	-118.0	+65.0	-115.1	+65.0	-114.7	+65.0	-99.0	+65.0	-93.0
62	Standard Cottage	26.517 - 33.207	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-99.6	+65.0	-88.6
	Equal-lite	23.517 - 26.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-101.9	+65.0	-91.1
	Custom Size	20.517 - 23.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-102.0	+65.0	-91.2
	Standard Preview	17.517 - 20.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-103.2	+65.0	-92.1
	Custom Size	14.517 - 17.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-105.4	+65.0	-93.9
75	Custom Size	12.517 - 14.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-129.5	+65.0	-109.6	+65.0	-97.4
	Shortest	11.377 - 12.516	+65.0	-130.0	+65.0	-130.0	+65.0	-124.2	+65.0	-121.8	+65.0	-121.7	+65.0	-113.2	+65.0	-100.4
	Tallest	36.517 - 41.644	+65.0	-130.0	+65.0	-115.6	+65.0	-99.7	+65.0	-95.9	+65.0	-93.9	+65.0	-84.9	+65.0	-74.2
	Standard Cottage	31.517 - 36.516	+65.0	-130.0	+65.0	-130.0	+65.0	-123.6	+65.0	-121.2	+65.0	-121.0	+65.0	-89.8	+65.0	-79.3
	Equal-lite	26.517 - 31.516	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-130.0	+65.0	-119.9	+65.0	-89.2	+65.0	-78.8
84	Standard Preview	23.517 - 26.516	+65.0	-130.0	+65.0	-130.0	+65.0	-122.9	+65.0	-120.4	+65.0	-120.2	+65.0	-91.6	+65.0	-81.0
	Custom Size	20.517 - 23.516	+65.0	-130.0	+65.0	-123.7	+65.0	-107.9	+65.0	-104.4	+65.0	-103.1	+65.0	-93.4	+65.0	-82.4
	Custom Size	17.517 - 20.516	+65.0	-130.0	+65.0	-111.9	+65.0	-96.1	+65.0	-92.1	+65.0	-89.9	+65.0	-89.3	+65.0	-84.5
	Custom Size	14.517 - 17.516	+65.0	-125.4	+65.0	-102.2	+65.0	-86.7	+65.0	-82.4	+65.0	-79.8	+65.0	-78.2	+65.0	-78.2
	Custom Size	13.017 - 14.516	+65.0	-120.6	+65.0	-98.0	+65.0	-82.6	+65.0	-78.3	+65.0	-75.5	+65.0	-73.4	+65.0	-73.4
91.78	Shortest	11.864 - 13.016	+65.0	-117.1	+65.0	-94.9	+65.0	-79.8	+65.0	-75.4	+65.0	-72.5	+65.0	-70.0	+65.0	-70.0
	Tallest	39.517 - 41.644	+65.0	-130.0	+65.0	-115.6	+65.0	-99.7	+65.0	-95.9	+65.0	-93.9	+65.0	-84.9	+65.0	-74.2
	Custom Size	38.517 - 39.516	+65.0	-130.0	+65.0	-124.2	+65.0	-108.4	+65.0	-105.0	+65.0	-103.7	+65.0	-84.9	+65.0	-74.3
	Equal-lite	35.517 - 38.516	+65.0	-130.0	+65.0	-128.8	+65.0	-113.1	+65.0	-109.9	+65.0	-109.0	+65.0	-84.0	+65.0	-73.4
	Custom Size	32.517 - 35.516	+65.0	-130.0	+65.0	-119.5	+65.0	-103.6	+65.0	-99.9	+65.0	-98.3	+65.0	-84.2	+65.0	-73.6
91.78	Standard Preview	29.517 - 32.516	+65.0	-130.0	+65.0	-108.5	+65.0	-92.8	+65.0	-88.7	+65.0	-86.3	+65.0	-85.2	+65.0	-74.3
	Custom Size	26.517 - 29.516	+65.0	-122.1	+65.0	-99.3	+65.0	-83.9	+65.0	-79.7	+65.0	-76.9	+65.0	-74.9	+65.0	-74.9
	Shortest	24.864 - 26.516	+65.0	-119.1	+65.0	-96.6	+65.0	-81.4	+65.0	-77.1	+65.0	-74.2	+65.0	-71.9	+65.0	-71.9
	Equal-lite	38.517 - 41.644	+65.0	-130.0	+65.0	-108.5	+65.0	-92.8	+65.0	-88.7	+65.0	-86.3	+65.0	-81.8	+65.0	-70.6
	Custom Size	35.517 - 38.516	+65.0	-122.1	+65.0	-99.3	+65.0	-83.9	+65.0	-79.7	+65.0	-76.9	+65.0	-74.9	+65.0	-71.1
91.78	Standard Preview	33.864 - 35.516	+65.0	-117.1	+65.0	-94.9	+65.0	-79.8	+65.0	-75.4	+65.0	-72.5	+65.0	-70.0	+65.0	-70.0
	Tallest	** - 41.644	+65.0	-117.1	+65.0	-94.9	+65.0	-79.8	+65.0	-75.4	+65.0	-72.5	+65.0	-70.0	+65.0	-70.0

SEE TABLE 7, SHEET 9 FOR ANCHOR GROUP AND QUANTITY.

** MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136


(APPLIES TO ANY HEIGHT 91.78" OR LESS)

NOTES:

1) USE THIS TABLE FOR ALL WINDOWS INSTALLED THROUGH THE FRAME OR INTEGRAL FIN.

2) FRAME DIMENSIONS ARE BUCK. SASH HEIGHT IS AS PER THE FIGURE.

3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.

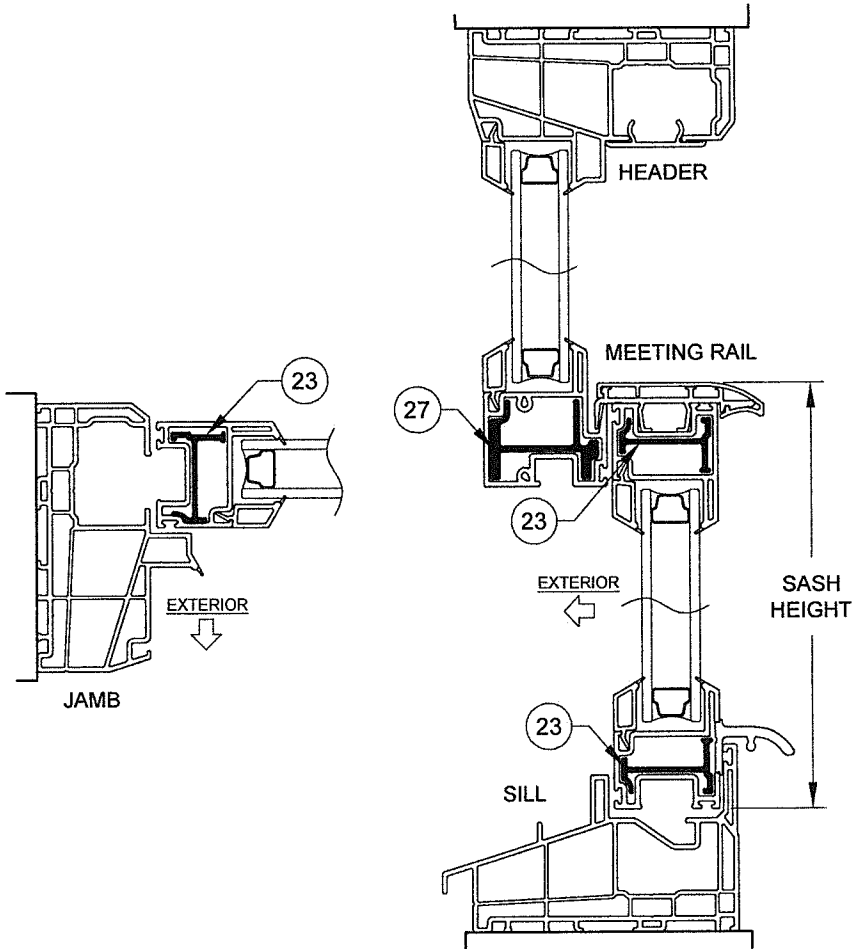

SECTION DETAIL FOR WINDOWS WITH
LEVEL R2 REINFORCEMENT & GLASS TYPES 2-4

(REINFORCEMENTS SHOWN IN FIGURES
ABOVE APPLY TO ALL FRAME TYPES &
CONFIGURATIONS)

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0401.04**
Expiration Date: **07/30/2025**

By: *Manuel Perez*
Miami-Dade Product Control

Drawn By:
J ROSOWSKI

Date:
05/15/15

Revision:
**C) ADDED MIN. SASH HEIGHT
NOTE.
AK - 3/10/20**

Description:
DESIGN PRESSURE TABLE

Title:
SINGLE HUNG WINDOW INSTALLATION - NI


Series/Model:
SH-5400

Scale:
NTS

Sheet:
7 OF 12

Drawing No.
MD-SH5400-01

Rev:
C

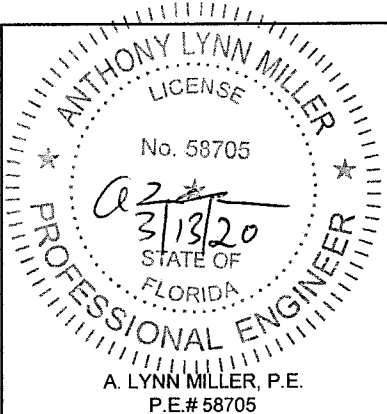

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)480-1600

REGISTRATION #29296

FOR ANCHOR GROUP D, TABLE 7, SHEET 9 MAY BE USED

Max. Anchor O.C. Spacing for "Integral-Fin" Installation	Anchor Group E	Anchor Group F
	2.7'	4'

**** MIN. SASH HEIGHT = WINDOW BUCK HEIGHT - 50.136"**
(APPLIES TO ANY HEIGHT 91.78" OR LESS)

Expiration Date: 07/30/2025

By: Manuel Perez
Miami-Dade Product Control

- 1) USE THE ABOVE "ANCHOR QUANTITIES REQUIRED....." TABLE FOR ANCHORS INSTALLED THROUGH THE FRAME.
- 2) USE THE ABOVE "MAX. ANCHOR O.C. SPACING....." TABLE FOR ANCHORS INSTALLED THROUGH THE INTEGRAL FIN.
- 3) FRAME DIMENSIONS ARE BUCK. "MR" = MEETING RAIL.
- 4) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE WIDTH OR HEIGHT DIMENSION SHOWN ON THE TABLE.
- 5) REFER TO TABLES 2 & 3, SHEET 2 FOR ANCHOR GROUP DESCRIPTIONS.



REGISTRATION #29296

C) ADDED MIN SASH HEIGHT
NOTE.
AK - 3/10/20

ANCHOR QUANTITY TABLE

SINGLE HUNG WINDOW INSTALLATION - NI

Date: 05/15/15

SH-5400

NTS























8 OF 12

MD-SH5400-01



C

TABLE 7:

Anchor Quantities Required for "Through-Frame" Installation			Anchor Group B												Anchor Group C												Anchor Group D																				
			18" Wide			24" Wide			32" Wide			36" Wide			40" Wide			48" Wide			52-1/8" Wide			18" Wide			24" Wide			32" Wide			36" Wide			40" Wide			48" Wide			52-1/8" Wide					
			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb			Jamb		
Glass Types 2, 3 & 4 Reinf. Level R2	Bottom Sash Description for given Range @ Window Height Shown	Sash Height Range (in)	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header	Above MR	Below MR	Header
			23.5	28	37.375	44	48	49.625	62	75	84	91.78																																			
	Equal-lite	11.394	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2
	Standard Cottage	14.517 - 15.870	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	3	2	1	3	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2
	Equal-lite	11.583 - 14.516	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	2	2	2	2	3	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2
	Standard Proview	11.377 - 11.582	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
	Tallest	23.517 - 25.286	1	2	1	1	2	1	1	3	2	1	3	2	1	3	2	1	4	2	1	4	2	1	2	1	1	2	1	1	2	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2
	Standard Cottage	20.958 - 23.516	1	2	1	1	2	1	1	3	2	1	3	2	1	3	2	2	3	2	2	3	2	1	2	1	1	2	1	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2	1	2	2
	Equal-lite	17.517 - 20.957	2	2	1	2	2	1	2	2	2	2	3	2	2	3	2	2	3	2	2	3	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
	Standard Proview	14.517 - 17.516	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	3	3	2	3	3	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
	Shortest	11.377 - 14.516	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	3	2	2	3	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
	Tallest	27.583 - 31.911	1	3	1	1	3	1	1	3	2	1	4	2	1	4	2	1	4	2	1	4	2	1	3	1	1	3	1	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2
	Custom Size	26.517 - 27.582	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	4	2	2	4	2	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Standard Cottage	23.517 - 26.516	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Equal-lite	20.517 - 23.516	2	2	1	2	2	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
	Standard Proview	17.517 - 20.516	2	2	1	2	2	1	2	2	2	2	3	2	2	3	2	2	3	2	2	3	3	2	2	1	2	2	1	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
	Custom Size	14.517 - 17.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	3	3	2	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Shortest	11.377 - 14.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	3	3	2	3	3	2	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Tallest	31.583 - 35.911	1	3	1	1	3	1	1	4	2	1	4	2	1	4	2	1	4	2	1	4	2	1	3	1	1	3	1	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2	1	3	2
	Standard Cottage	26.517 - 31.582	2	3	1	2	3	1	2	3	2	2	4	2	2	4	2	2	4	2	2	4	2	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Equal-lite	20.517 - 26.516	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	3	2	2	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Standard Proview	17.517 - 20.516	3	2	1	3	2	1	3	2	2	3	3	2	3	3	2	3	3	3	3	3	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Custom Size	14.517 - 17.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	3	3	2	3	3	3	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Custom Size	12.517 - 14.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	3	3	2	3	3	2	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Shortest	11.377 - 12.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	3	3	2	3	3	2	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Tallest	33.208 - 37.536	1	3	1	1	3	1	1	3	2	1	4	2	1	4	2	1	4	2	1	4	2	1	3	1	1	3	1	1	4	2	1	4	2	1	4	2	1	4	2	1	4	2	1	4	2
	Standard Cottage	26.517 - 33.207	2	3	1	2	3	1	2	3	2	2	4	2	2	4	2	2	4	2	2	4	2	2	3	1	2	3	1	2	4	2	2	4	2	2	4	2	2	4	2	2	4	2	2	4	2
	Equal-lite	23.517 - 26.516	2	3	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	3	2	2	1	2	3	1	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2
	Custom Size	20.517 - 23.516	3	2	1	3	2	1	3	3	2	3	3	2	3	3	2	3	3	3	3	3	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Standard Proview	17.517 - 20.516	3	2	1	3	2	1	3	2	2	3	3	2	3	3	2	3	3	3	3	3	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Custom Size	14.517 - 17.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	3	3	2	3	3	3	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Custom Size	12.517 - 14.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2	3	3	2	3	3	2	3	3	2	1	3	2	1	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2	3	2	2
	Shortest	11.377 - 12.516	3	2	1	3	2	1	3	2	2	3	2	2	3	2																															

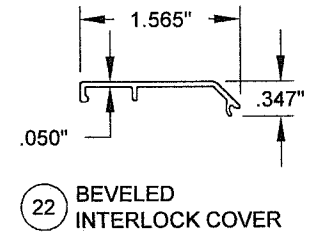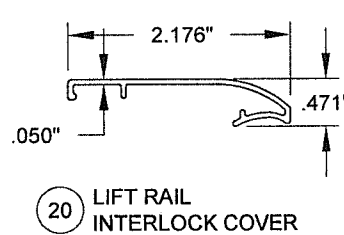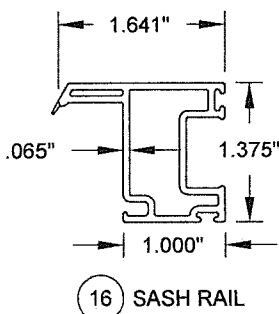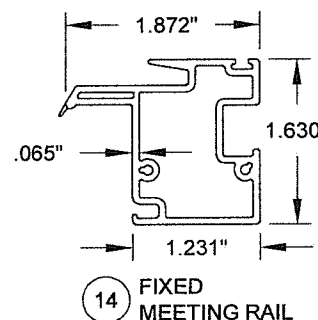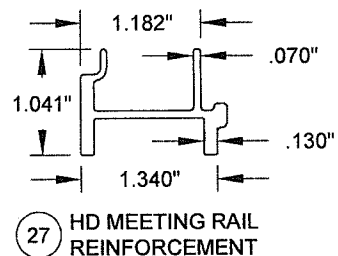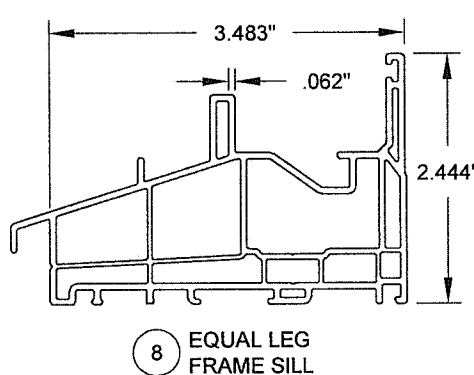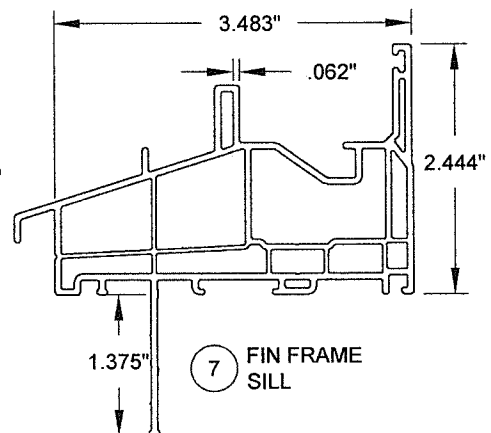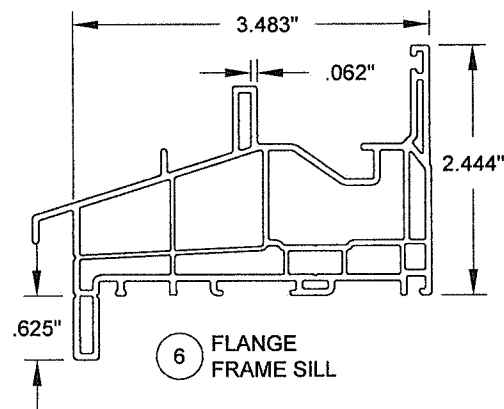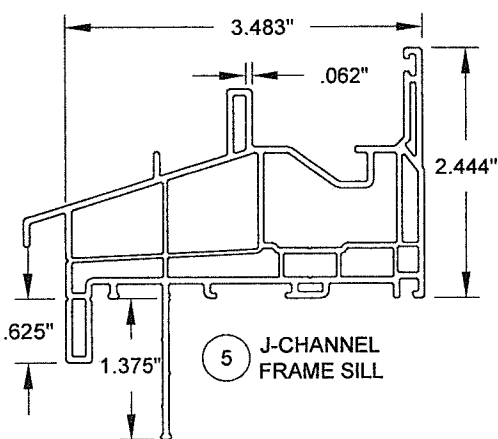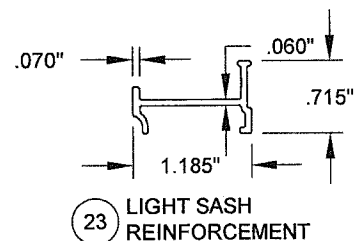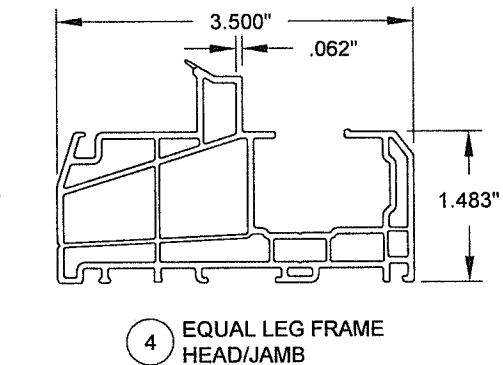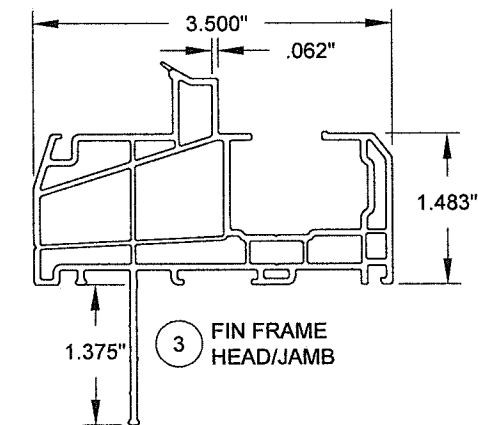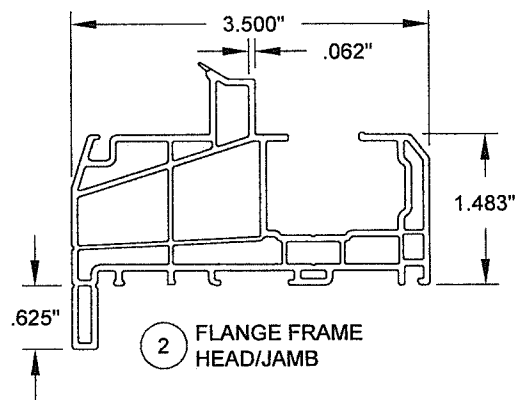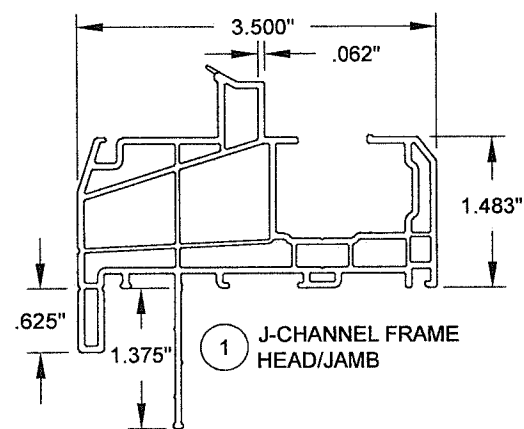

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0401.04**
Expiration Date: **07/30/2025**
By: *Manuel Perez*
Miami-Dade Product Control

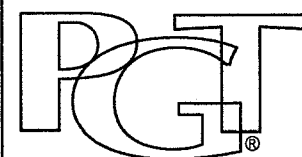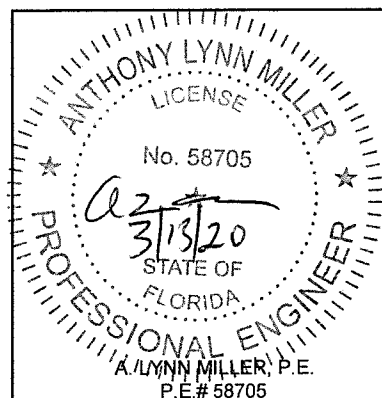

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

Revision:
C) NO CHANGES THIS SHEET.
AK - 3/10/20

Description:
WINDOW EXTRUSIONS

Title:
SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model:
SH-5400

Scale:
NTS

Sheet:
10 OF 12

Drawing No.
MD-SH5400-01

Date:
05/15/15

Rev:
C


Drawn By:
J ROSOWSKI

TABLE 8:


Bill of Material			
#	Part #	Description	Material
1	620101	Single Hung Frame Head & Jambs - J-Channel	PVC
2	620102	Single Hung Frame Head & Jambs - Flange	PVC
3	620103	Single Hung Frame Head & Jambs - Fin	PVC
4	620104	Single Hung Frame Head & Jambs - Equal Leg/Box	PVC
5	620105	SH/DH Frame Sill - J-Channel	PVC
6	620106	SH/DH Frame Sill - Flange	PVC
7	620107	SH/DH Frame Sill - Fin	PVC
8	620108	SH/DH Frame Sill - Equal Leg/Box	PVC
14	620131	Fixed Meeting Rail	PVC
16	620129	Sash Rail (Sides, Top & Bottom)	PVC
17	620134	Balance Cover	PVC
18	620133	Sash Stop/Screw Cover	PVC
19	620156	Pull Rail Interlock	6005 T5 Al
20	620144	Pull Rail Interlock Cover	PVC
21	620157	Beveled Interlock	6005 T5 Al
22	620145	Beveled Interlock Cover	PVC
23	620150	Light Sash Reinforcement	6063 T6 Al
26	620153	Standard Meeting Rail Reinforcement	6005 T5 Al
27	620154	HD Meeting Rail Reinforcement	6005 T5 Al
30	61644	Weatherstrip, .187" x .270" Fin Pile	
31	6Q300	Weatherstrip, .190" x .300" Foam Bulb	Flex PVC
32	61719	Weatherstrip, .187" x .220" PolyPile	
33	61825	Weatherstrip Plug, .220" Finseal	
35	78X1MTT	#8 x 1" Ph. PH SDS (Interlock Mounting Screw)	
36	78X3THPX	#8 x 3" Ph. PH SMS (Meeting Rail Screw)	410 SS
37	71669SP	Meeting Rail Screw Support Plate	6063 T6 Al
38	720210	Weep Hole Cover	PVC
40	720XXXX	Constant Force Balance	
41		#8 x 3/4" Ph. FH SMS (Con. Force Balance Screw)	SS
42		Spiral Balance	
43	720205	Spiral Balance Shoe	Nylon
44	78X114FPAX	#8 x 1-1/4" Ph. FH SMS (Spiral Balance Screw)	410 SS

TABLE 8, CONT.:


Bill of Material, cont.			
#	Part #	Description	Material
45	720197	Auto Lock Mechanism	C Steel
46	720198&9	Sweep Lock	Cast Zinc
47	720195&6	Auto Lock Cover Assembly	Cast Zinc
48	76X1180PTX	#6 x 1-1/8" Ph. FH SDS (Auto and Sweep Lock Screw)	SS
49	720200	Auto and Sweep Lock Keeper	Cast Zinc
50	76X34PPA	#6 x 3/4" PH. PH SDS (Keeper Screw)	SS
51	420181 L/R	Beveled Tilt Latch Corner Key	PVC
52	420182 L/R	Pull Rail Tilt Latch Corner Key	PVC
53	7634PHFL	#6 x 3/4" Ph. FH SDS (Corner Key Screw)	SS
54	420183	Tilt Latch	PVC
55	420184	Tilt Latch Retainer	PVC
56	720207	1" Tilt Latch Spring	SS
57	420186	Plastic Tilt Latch Finger Pull	PVC
58	720192	Metal Tilt Latch Finger Pull	Cast Zinc
59	420180	Pivot Bar Corner Key	PVC
60	720206	Pivot Bar	SS
63	720191	Sash Pull Handle	Cast Zinc
64	720194	Sash Pull Handle With Latch Assembly	Cast Zinc
65	7834FPT	#8 x 3/4" Ph. FH SDS (Pull Handle Screw)	SS
66	420188	Bottom Latch Strike Plate	Cast Zinc
67	7858B	#8 x 5/8" Ph. FH SMS (Strike Plate Screw)	SS
73	720136	I.G. Bead	PVC
74		Backbedding, GE 7700 or Dow 791 or Dow 983	Silicone
75	71646N	Setting Block (7/8" x 1" x 1/8"), 85 +/- 5 duro.	EPDM
80	61012	Extruded Screen Frame	Alum
81	61011	Roll-Formed Screen Frame	Alum
82	7CKGLB21	Screen Corner Key for Extruded Frame	PVC
83	47042	Screen Corner Key with Pull Ring	PVC
84	47041	Screen Corner Key without Pull Ring	PVC
85	7CASP	Tension Spring	SS
86	61816C48	Screen Cloth	Fiberglass
87	61635/61614	.140" Screen Spline (Machine/Hand Rolled)	Vinyl

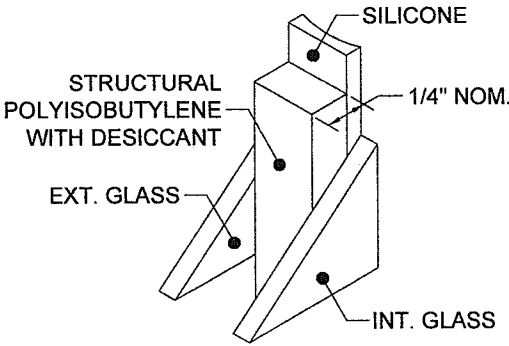


76 **KODISPACE**
4SG TPS

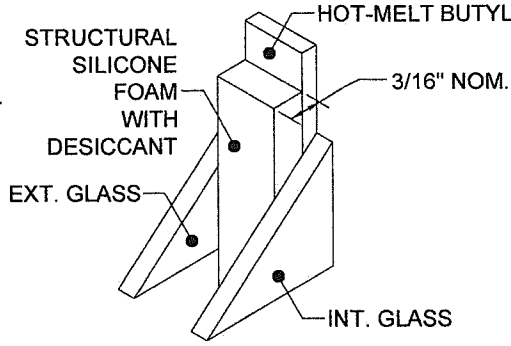

77 **SUPER**
SPACER® NXT™

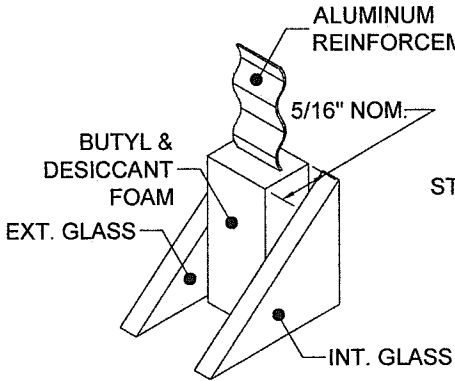

78 **DURASEAL®**
SPACER

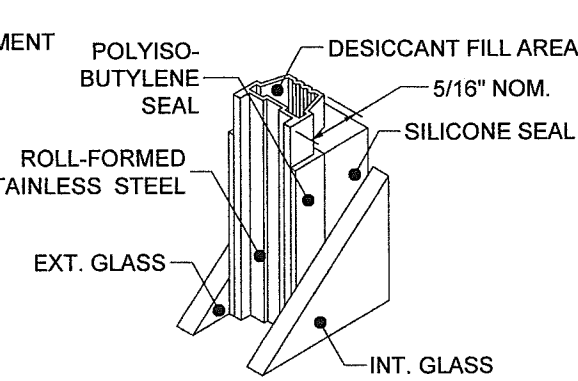



79 **XL EDGE™**
SPACER

Part #	Description	Material
76	Kommerling 4SG TPS Spacer System	See this Sheet for Materials
77	Quanex Super Spacer nXT with Hot Melt Butyl	
78	Quanex Duraseal Spacer	
79	Cardinal XL Edge Spacer	

REFERENCE TEST REPORTS: FTL-8717, 8968 & 8970

NOTES:

- 1) PVC BY ENERGI WINDOW AND DOOR PROFILES, LTD., TO BE LABELED FOR AAMA EXTRUDER CODE.
2) ITEMS # 9-13, 15, 24, 25, 28, 29, 34, 39, 61, 62, & 68-72 ARE NOT USED AND ARE NOT PART OF THIS APPROVAL.

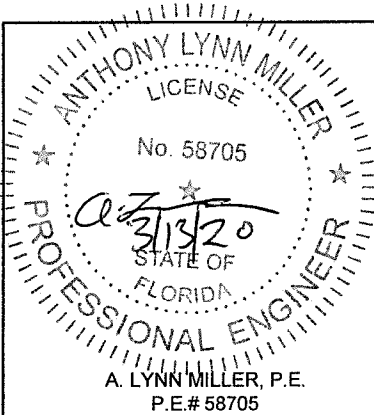

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600

REGISTRATION #29296

Revision:
C) ADDED BACKBEDDING
AK - 3/10/20

Description:
BILL OF MATERIAL (BOM)

Title:
SINGLE HUNG WINDOW INSTALLATION - NI

Series/Model:
SH-5400

Scale:
NTS

Sheet:
11 OF 12

Drawing No.
MD-SH5400-01

Rev:
C

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0401.04**
Expiration Date: **07/30/2025**
By: *Manuel Perez*
Miami-Dade Product Control

Drawn By:
J ROSOWSKI

Date:
05/15/15

