



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY, FLORIDA
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

PGT Industries, Inc.
1070 Technology Drive
North Venice, Fl. 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "FD-5455" Outswing PVC French Door w/ & w/o Sidelite and Transom – N.I.

APPROVAL DOCUMENT: Drawing No. MD-455.1 Rev D, Series titled "Vinyl French Door and SLT/TR", sheets 1 through 12 of 12, dated 05/07/13 and last revised on 04/20/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 18-1108.04** and consists of this page 1 and evidence pages E-1, E-2, E-4 and E-5, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



Ishaq I. Chanda

NOA No. 20-0427.06
Expiration Date: January 23, 2024
Approval Date: September 03, 2020
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under previous NOA

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 13-0815.04)
2. Drawing No. **MD-455.1**, titled "Vinyl French Door and SLT/TR", sheets 1 through 12 of 12, dated 05/07/13, with revision **C** dated 04/10/17, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94
5) Large Missile Impact Test per FBC, TAS 201-94
6) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of a Series FD-5570/FD-2770 PVC double entrance outswing doors, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-8717**, dated 11/16/15, signed and sealed by Idalmis Ortega, P.E.*(Submitted under previous NOA No. 16-0126.06)*
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of an outswing PVC French door, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7370**, dated 05/23/13, signed and sealed by Jorge A. Naya, Jr., P.E.
(Submitted under NOA No. 13-0815.04)
3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
along with marked-up drawings and installation diagram of a PVC fixed window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-7338**, dated 05/25/13, signed and sealed by Jorge A. Naya, Jr., P.E.*(Submitted under NOA No. 13-0815.04)*

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 5th Edition (2014)**, dated 03/30/15, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.*(Submitted under NOA No. 15-0409.01)*
2. Glazing complies with **ASTM E1300-09**.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-0427.06
Expiration Date: January 23, 2024
Approval Date: September 03, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **14-0820.11** issued to Vision Extrusions Limited for their “**White Rigid PVC Exterior Extrusions for Windows and Doors**”, dated 11/06/14, expiring on 09/30/19.
(Submitted under NOA No. 15-0409.01)
2. Notice of Acceptance No. **14-0820.12** issued to Vision Extrusions Limited for their “**Brown Coated (Painted or Laminated) White Rigid PVC Exterior Extrusions for Windows and Doors**”, dated 11/06/14, expiring on 09/30/19.
(Submitted under NOA No. 15-0409.01)
3. Notice of Acceptance No. **13-1121.01** issued to Vision Extrusions Limited for their series “**VE 2000 Tan 202 and lighter shades (Non-White) Rigid Cellular PVC Exterior Extrusions for Windows and Doors**” dated 01/23/14, expiring on 01/23/19.
(Submitted under NOA No. 15-0409.01)
4. Notice of Acceptance No. **13-1121.02** issued to Vision Extrusions Limited for their series “**White Rigid Cellular PVC Exterior Extrusions for Windows and Doors**” dated 01/23/14, expiring on 01/23/19.
(Submitted under NOA No. 15-0409.01)
5. Notice of Acceptance No. **11-0902.10** issued to Vision Extrusions Limited for their series “**VE 1000 Tan 202 (Non-White) Rigid PVC Exterior Extrusions for Windows and Doors**” dated 12/29/11, expiring on 12/29/16.
(Submitted under NOA No. 15-0409.01)
6. Quanex Part **Super Spacer Standard** complying with ASTM C518 Thermal Conductivity 0.881 BTU-in/ hr.-ft²-°F, ASTM F 1249 WVTR-Pass, ASTM D3985 Oxygen-Pass, ASTM E 2190 I.G. Durability-No Fog-Pass.
(Submitted under NOA No. 13-0815.04)
7. Quanex Part **Duraseal** complying with ASTM C518 Thermal Conductivity 2.22 BTU-in/ hr.-ft²-°F, ASTM F 1249 WVTR-Pass, ASTM D 1434 Argon Permeance-Pass, ASTM E 2189 I.G. Durability-No Fog, ASTM E 546 Dew Point Development -20°F in 48 hrs.
(Submitted under NOA No. 13-0815.04)
8. Vision Extrusions, Ltd. Parts complying with PVC-AAMA 303-13.
(Submitted under NOA No. 13-0815.04)
9. PVC-AAMA 303-13, Voluntary Specification for Rigid Polyvinyl Chloride (PVC) Exterior Profiles for Vision Extrusions, Ltd.-VEX-1 by AAMA Fenestration Exterior Profile Certification Program.
(Submitted under NOA No. 13-0815.04).
10. Vision Extrusions, Ltd. Parts complying with PVC-AAMA 303-13.
(Submitted under NOA No. 13-0815.04)
11. PVC-AAMA 303-13, Voluntary Specification for Rigid Polyvinyl Chloride (PVC) Exterior Profiles for Vision Extrusions, Ltd.-VEX-1 by AAMA Fenestration Exterior Profile Certification Program.
(Submitted under NOA No. 13-0815.04)

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-0427.06
Expiration Date: January 23, 2024
Approval Date: September 03, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

1. Statement letter of conformance to and of complying with **FBC 5th Edition (2014)** and **FBC 6^h Edition (2017)** dated 08/16/17, issued by manufacturer, signed and sealed by A. Lynn Miller, P.E.
2. Statement letter of no financial interest and of independence, issued by manufacturer, dated 04/28/17, signed and sealed by Anthony Lynn Miller, P.E.
3. Laboratory compliance letter for Test Reports No. **FTL-7370** and **FTL-7338**, issued by Fenestration Testing Laboratory, Inc., dated 05/23/13, signed and sealed by Jorge A. Naya, Jr., P.E. *(Submitted under NOA No. 13-0815.04)*

G. OTHERS

1. Notice of Acceptance No. **17-0504.06**, issued to PGT Industries, Inc. for their Series “FD-5455” Outswing PVC French Door w/ & w/o Sidelite and Transom - N.I., approved on 12/14/17 and expiring on 01/23/19.

2. New Evidence Submitted

A. DRAWINGS

1. Drawing No. **MD-455.1 Rev D**, Series titled “Vinyl French Door and SLT/TR”, sheets 1 through 12 of 12, dated 05/07/13 and last revised on 04/20/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Forced Entry Test, per ASTM F588 and TAS 202-94

along with marked-up drawings and installation diagram of all PGT Industries, Inc. representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.:

FTL-7897, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14

FTL-20-2107.1, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal) **FTL-20-2107.2**, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal) **FTL-20-2107.3**, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and **FTL-20-2107.4**, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal) dated 07/13/20, all signed and sealed by Idalmis Ortega, P.E.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-0427.06
Expiration Date: January 23, 2024
Approval Date: September 03, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 7th Edition (2020)**, dated 04/20/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Glazing complies w/ ASTM E-1300-02, -04 -09 & -16.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **19-0305.02** issued to **Kuraray America, Inc.** for their **“Trosifol® Ultraclear, Clear, and Color PVB Glass Interlayers”**, expiring on 07/08/24.
2. Notice of Acceptance No. **17-0808.02** issued to **Kuraray America, Inc.** for their **“SentryGlas® (Clear and White) Glass Interlayers”**, expiring on 07/04/23.
3. Notice of Acceptance No. **18-1106.10** issued to Vision Extrusions Limited for their **“Brown Coated (Painted or Laminated) White Rigid PVC Exterior Extrusions for Windows and Doors”**, expiring on 09/30/24.
4. Notice of Acceptance No. **18-1106.11** issued to Vision Extrusions Limited for their series **“VE 1000 Tan 202 and lighter shades (Non-White) Rigid Cellular PVC Exterior Extrusions for Windows and Doors”**, expiring on 12/29/21.
5. Quanex Part **Super Spacer Standard** complying with ASTM C518 Thermal Conductivity 0.881 BTU-in/ hr.-ft²-°F, ASTM F 1249 WVTR-Pass, ASTM D3985 Oxygen-Pass, ASTM E 2190 I.G. Durability-No Fog-Pass.
(Submitted under previous NOA No. 15-0409.05)
6. Quanex Part **Duraseal** complying with ASTM C518 Thermal Conductivity 2.22 BTU-in/ hr.-ft²-°F, ASTM F 1249 WVTR-Pass, ASTM D 1434 Argon Permeance-Pass, ASTM E 2189 I.G. Durability-No Fog, ASTM E 546 Dew Point Development -20°F in 48 hrs.***(Submitted under NOA No. 15-0409.05)***
7. Vision Extrusions, Ltd. Parts complying with PVC-AAMA 303-13, Voluntary Specification for Rigid Polyvinyl Chloride (PVC) Exterior Profiles for Vision Extrusions, Ltd.-VEX-1 by AAMA Fenestration Exterior Profile Certification Program.***(Submitted under NOA No. 15-0409.05)***
4. Vision Extrusions, Ltd. Parts complying with PVC-AAMA 303-13.
(Submitted under NOA No. 15-0409.05)
5. PVC-AAMA 303-13, Voluntary Specification for Rigid Polyvinyl Chloride (PVC) Exterior Profiles for Vision Extrusions, Ltd.-VEX-1 by AAMA Fenestration Exterior Profile Certification Program.
10. Notice of Acceptance No. **18-1217.14** issued to Energi Fenestration Solution, USA, Inc. for their **“Tan 3040 & light shade (non-white) White Rigid PVC Exterior Extrusions for Windows and Doors”**, expiring on 02/04/21.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-0427.06
Expiration Date: January 23, 2024
Approval Date: September 03, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS(continue)

11. Notice of Acceptance No. **18-1217.14** issued to Energi Fenestration Solution, USA, Inc. for their “**Tan 3040 & light shade (non-white) White Rigid PVC Exterior Extrusions for Windows and Doors**”, expiring on 02/04/21.
12. Notice of Acceptance No. **18-0122.02** issued to Energi Fenestration Solution, USA, Inc, for their series “**White Rigid PVC Exterior Extrusions for Windows and Doors**”, expiring on 02/28/23.
13. Notice of Acceptance No. **20-0203.03** issued to Energi Fenestration Solution, USA, Inc. for their “**Bronze & light shade cap coated White Rigid PVC Exterior Extrusions for Windows and Doors**”, expiring on 04/16/25.

F. STATEMENTS

1. Statement letter of conformance to **FBC 7th Edition (2020)**, dated 04/09/20, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest and of independent, issued by manufacturer, dated 04/09/20, signed and sealed by Anthony Lynn Miller, P.E.

G. OTHERS

1. This NOA **revises NOA# 18-1108.04** and updates to **FBC 2020 (7th Edition)**, expiring 01/23/24.
2. RER Test proposals **#19-1155** dated 01/10/20 approved by Ishaq I. Chanda, P.E.

Ishaq I. Chanda

Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 20-0427.06
Expiration Date: January 23, 2024
Approval Date: September 03, 2020

SERIES FD-5455,
NON-IMPACT-RESISTANT, VINYL, REINFORCED, OUTSWING
FRENCH DOOR & SIDELITE/TRANSOM (SLT/TR)

DESIGN PRESSURE RATING	IMPACT RATING
VARIES, SEE SHEETS 4 & 5	NOT RATED FOR MISSILE IMPACT RESISTANCE

- 1) THIS PRODUCT HAS BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ).
- 2) SHUTTERS ARE REQUIRED WHEN USED IN WIND-BORNE DEBRIS REGIONS.
- 3) FOR MASONRY APPLICATIONS IN MIAMI-DADE COUNTY, USE ONLY MIAMI-DADE COUNTY APPROVED MASONRY ANCHORS. MATERIALS USED FOR ANCHOR EVALUATIONS WERE SOUTHERN PINE, ASTM C90 CONCRETE MASONRY UNITS (CMU'S) OF NORMAL WEIGHT AND OF COMPRESSIVE STRENGTH OF MIN. 1.9 KSI AND CONCRETE WITH MIN. KSI PER ANCHOR TYPE.
- 4) MASONRY ANCHORS MAY BE USED INTO WOOD AS PER TABLE 1, THIS SHEET. ALL WOOD BUCKS LESS THAN 1-1/2" THICK ARE TO BE CONSIDERED 1X INSTALLATIONS. 1X WOOD BUCKS ARE OPTIONAL IF UNIT IS INSTALLED DIRECTLY TO SUBSTRATE. WOOD BUCKS DEPICTED AS 2X ARE 1-1/2" THICK OR GREATER. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED TO PROPERLY TRANSFER LOADS TO THE STRUCTURE. WOOD BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ENGINEER OR ARCHITECT OF RECORD.
- 5) IF SILL IS TIGHT TO SUBSTRATE, GROUT IS NOT REQUIRED. IF USED, NON-SHRINK, NON-METALLIC GROUT AT 3.4 KSI MIN. PER ASTM C1107, (DONE BY OTHERS). MAX. 1/4" SHIM SPACE FOR GROUT WHICH MUST FULLY SUPPORT THE ENTIRE LENGTH OF THE SILL THAT IS NOT TIGHT TO THE SUBSTRATE, AND TRANSFER SHEAR LOAD TO SUBSTRATE. IF SUBSTRATE IS WOOD, 30# FELT PAPER OR MASTIC IS REQUIRED BETWEEN THE GROUT AND WOOD SUBSTRATE, OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION, COMPLYING WITH THE FBC.
- 6) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. USE ANCHORS OF SUFFICIENT LENGTH TO ACHIEVE THE EMBEDMENT SHOWN ON TABLE 1, THIS SHEET. NARROW JOINT SEALANT IS USED ON ALL FOUR CORNERS OF THE FRAME. EXTERIOR INSTALLATION ANCHORS SHOULD BE SEALED. OVERALL SEALING/FLASHING STRATEGY FOR WATER RESISTANCE OF INSTALLATION SHALL BE DONE BY OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.
- 7) MAX. 1/4" SHIMS ARE REQUIRED AT EACH ANCHOR LOCATION WHERE THE PRODUCT IS NOT FLUSH TO THE SUBSTRATE. USE SHIMS CAPABLE OF TRANSFERRING APPLIED LOADS. WOOD BUCKS, BY OTHERS, MUST BE SUFFICIENTLY ANCHORED TO RESIST LOADS IMPOSED ON THEM BY THE DOOR, SIDELITE OR TRANSOM.
- 8) DESIGN PRESSURES:
A. NEGATIVE DESIGN LOADS BASED ON STRUCTURAL TEST PRESSURE, FRAME ANALYSIS AND GLASS PER ASTM E1300.
B. POSITIVE DESIGN LOADS BASED ON WATER TEST PRESSURE, STRUCTURAL TEST PRESSURE, FRAME ANALYSIS AND GLASS PER ASTM E1300.
C. DESIGN LOADS ARE BASED ON ALLOWABLE STRESS DESIGN, ASD.
- 9) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. THE 33-1/3% STRESS INCREASE HAS NOT BEEN USED IN THE DESIGN OF THIS PRODUCT. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF ANCHORS INTO WOOD. ANCHORS THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (INCLUDING ADOPTED STANDARDS) FOR CORROSION RESISTANCE.
- 10) ALL RIGID PVC AND RIGID CELLULAR PVC MANUFACTURED BY ENERGI FENESTRATION SOLUTIONS USA, INC. O R VISION EXTRUSIONS, LTD. HAS BEEN TESTED TO COMPLY WITH THE FLORIDA BUILDING CODE FOR PLASTICS.
- 11) SIZES MUST BE VERIFIED FOR COMPLIANCE WITH EGRESS REQUIREMENTS PER THE FLORIDA BUILDING CODE.
- 12) REFERENCES:
TEST REPORTS: FTL-7339 & 7371
NOA'S: ELCO ULTRACON, DEWALT ULTRACON+, DEWALT CRETEFLEX & DEWALT AGGREGATOR ANCHOR NOA'S, ENERGI FENESTRATION SOLUTIONS USA, INC. OR VISION EXTRUSION, LTD. WHITE RIGID PVC NOA, VE 1000 TAN 202 AND LIGHTER SHADES (NON-WHITE) RIGID PVC NOA AND BROWN COATED (PAINTED OR LAMINATED) WHITE RIGID PVC NOA
- 13) THE 5455 SERIES IS ALSO KNOWN AS THE 455 SERIES.

GUIDE TO SHEETS:

GENERAL NOTES.....	1
ELEVATIONS.....	2
GLAZING DETAILS.....	3
DESIGN PRESSURES.....	4-5
ANCHORS.....	4-6
INSTALLATION.....	7-9
EXTRUSION PROFILES.....	10
PARTS LIST.....	11-12
CORNER DETAILS.....	11
HARDWARE DETAILS.....	12

CODES / STANDARDS USED:

- 2020 FLORIDA BUILDING CODE (FBC), 7TH EDITION
- 2017 FLORIDA BUILDING CODE (FBC), 6TH EDITION
- ASTM E1300-09
- ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2015
- AISI S100-16
- AISC 360-16

TABLE 1:

Group	Anchor	Substrate	Min. Edge Distance	Min. Embedment
A	3/16" Ultracon	Concrete (min. 2.85 ksi)	1"	1-3/8"
		Ungrouted CMU, (ASTM C-90)	1"	1-1/4"
	3/16" Ultracon+	Concrete (min. 3 ksi)	1-1/8"	1-3/4"
		Ungrouted CMU, (ASTM C-90)	1"	1-1/4"
B	#10 Steel SMS (G5) #10 410 S.S. SMS #10 18-8 S.S. SMS	P.T. Southern Pine (SG=0.55)	1/2"	1-3/8"
		Aluminum, 6063-T5*	5/16"	0.063"
		Steel, A36*	5/16"	0.063"
		Steel Stud, A653 Gr. 33*	5/16"	0.063"
	3/16" Ultracon	P.T. Southern Pine (SG=0.55)	1/2"	1-3/8"
		Grouted CMU, (ASTM C-90)	2-1/2"	2-1/4"
		Concrete (min. 2.85 ksi)	1"	1-3/8"
	3/16" Ultracon+	P.T. Southern Pine (SG=0.55)	1/2"	1-3/8"
		Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
		Concrete (min. 3 ksi)	1-1/8"	1-3/4"
	1/4" Ultracon	Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" Ultracon+	Ungrouted CMU, (ASTM C-90)	1-1/16"	1-1/4"
C	#12 Steel SMS (G5) #12 410 S.S. SMS #12 18-8 S.S. SMS	P.T. Southern Pine (SG=0.55)	9/16"	1-3/8"
		Aluminum, 6063-T5*	3/8"	0.071"
		Steel, A36*	3/8"	0.071"
		Steel Stud, A653 Gr. 33*	3/8"	0.071" (14 Ga)
	1/4" Ultracon	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Grouted CMU, (ASTM C-90)	2-1/2"	1-3/4"
		Concrete (min. 2.85 ksi)	1"	1-3/8"
	1/4" Ultracon+	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Grouted CMU, (ASTM C-90)	1-1/8"	1-3/4"
		Concrete (min. 3 ksi)	1-1/4"	1-3/8"
	1/4" 410 S.S. CreteFlex	Concrete (min. 3.35 ksi)	1"	1-3/4"
		Ungrouted CMU, (ASTM C-90)	2-1/2"	1-1/4"
	1/4" 18-8 S.S. Aggre-Gator	P.T. Southern Pine (SG=0.55)	1"	1-3/8"
		Concrete (min. 3.27 ksi)	1-1/2"	1-3/8"
		Ungrouted CMU, (ASTM C-90)	4"	1-1/4"
D	1/4" Ultracon	Concrete (min. 2.85 ksi)	2-1/2"	1-3/8"
	1/4" Ultracon+	Concrete (min. 3 ksi)	2-1/2"	1-3/8"
	1/4" 410 S.S. CreteFlex	Concrete (min. 3.35 ksi)	2-1/2"	1-3/4"

- 1) * MIN. OF 3 THREADS BEYOND THE METAL SUBSTRATE.
- 2) UNGROUTED CMU VALUES MAY BE USED FOR GROUTED CMU APPLICATIONS.
- 3) ANY ANCHOR FROM THE ABOVE TABLE IS ACCEPTABLE TO BE USED ALONG A DOOR JAMB, REGARDLESS OF ANCHOR GROUP CHOSEN.
- 4) SEE ANCHOR/SUBSTRATE MATERIAL PROPERTIES ON SHEET 11 FOR Fy & Fu.


TABLE 2:


Type #	Description
1	1/8" Tempered - 5/8" Airspace - 1/8" Tempered
2	3/16" Tempered - 1/2" Airspace - 3/16" Tempered

SEE SHEET 3 FOR SPACER INFORMATION.


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Ismael I. Chan
Miami-Dade Product Control

Revision
D) UPDATED TO FBC 2020,
REVISED ANCHOR TYPE TABLE.
AK - 4/9/20


1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941)-480-1600	5/7/13 Date	J ROSOWSKI By	D Rev.
 REGISTRATION #29296	VINYL FRENCH DOOR AND SLT/TR	GENERAL NOTES	MD-455.1
1 OF 12	Sheet	NTS	FD-5455
Scale	Title	Series	Desc.

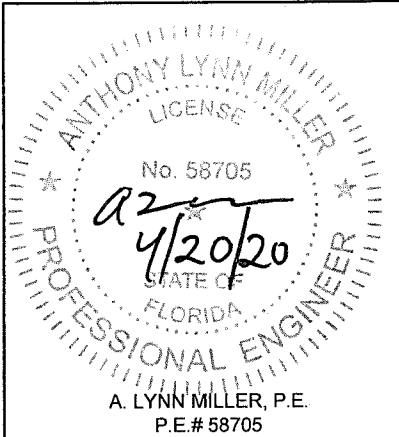


EXAMPLE CONFIGURATIONS

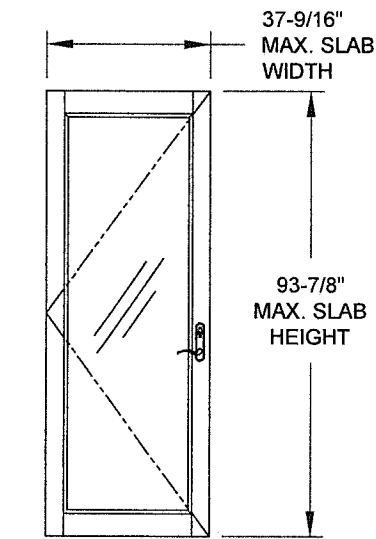


TYP. DOOR SLAB

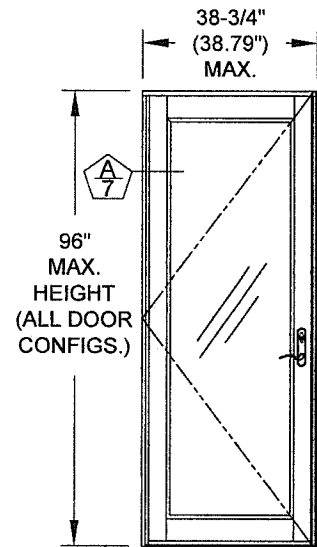


X

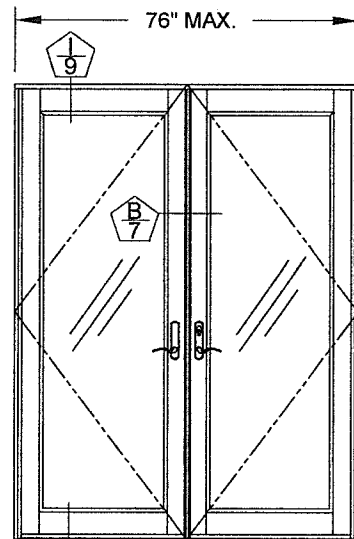


XX

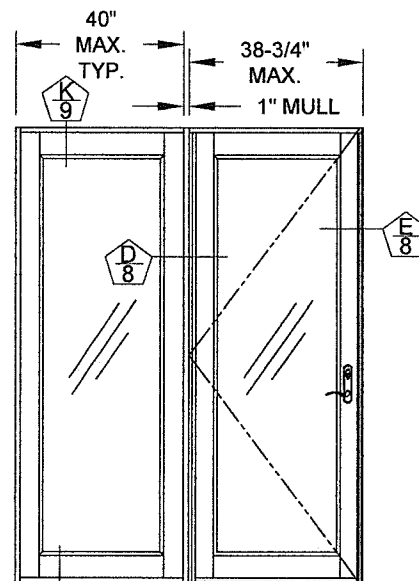


OIX (SHOWN) OR XIO
(WIDE STILES AND WIDE RAILS
SHOWN ON SIDELITES)

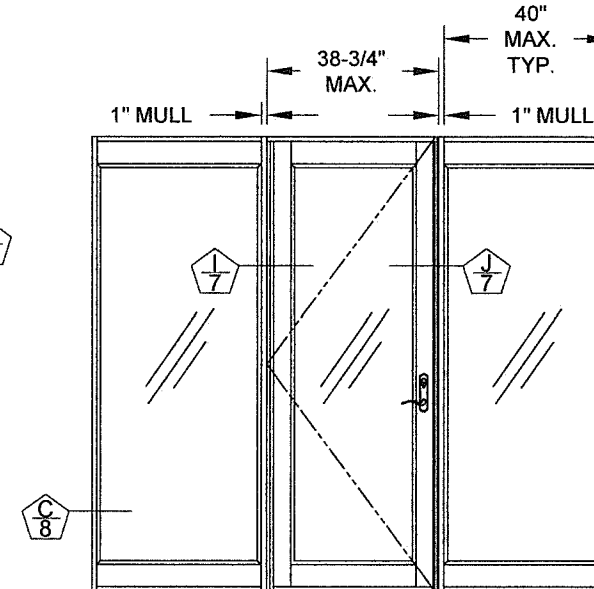


OIXIO
(NARROW STILES AND WIDE
RAILS SHOWN ON SIDELITES)

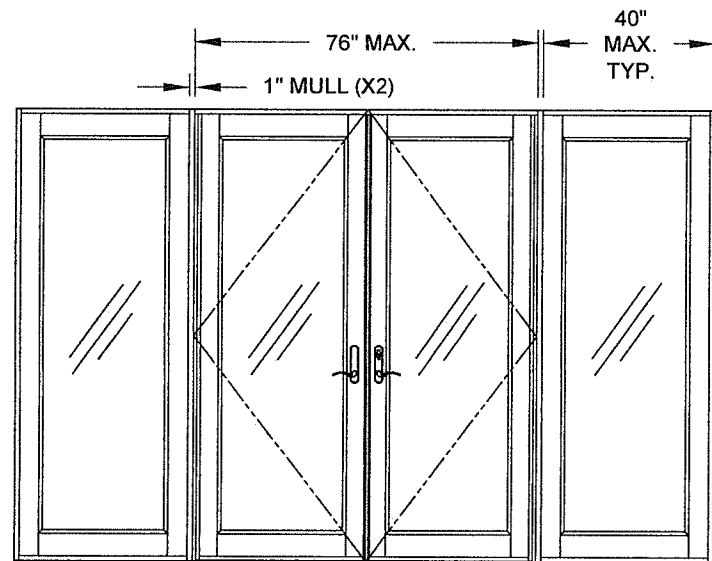


OIXXIO
(WIDE STILES AND WIDE
RAILS SHOWN ON SIDELITES)

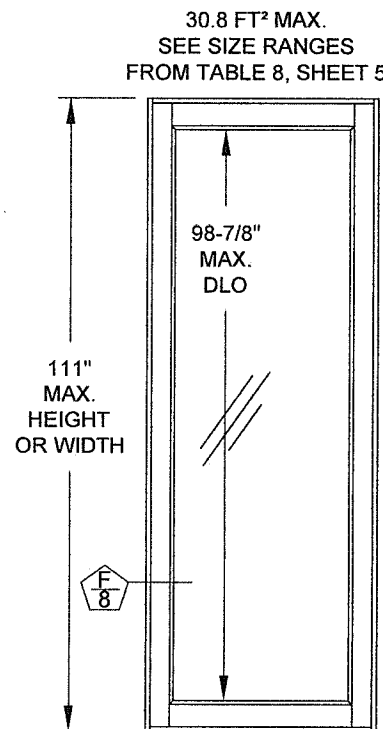


SINGLE O
(WIDE STILES AND WIDE
RAILS SHOWN ON SIDELITES)

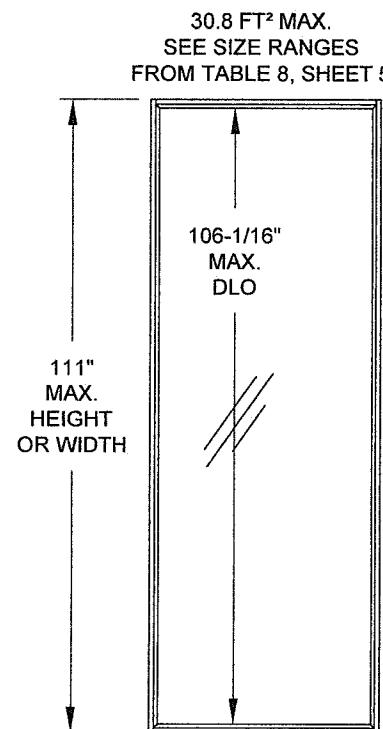


SINGLE O
(NARROW STILES AND NARROW
RAILS SHOWN ON SIDELITES)

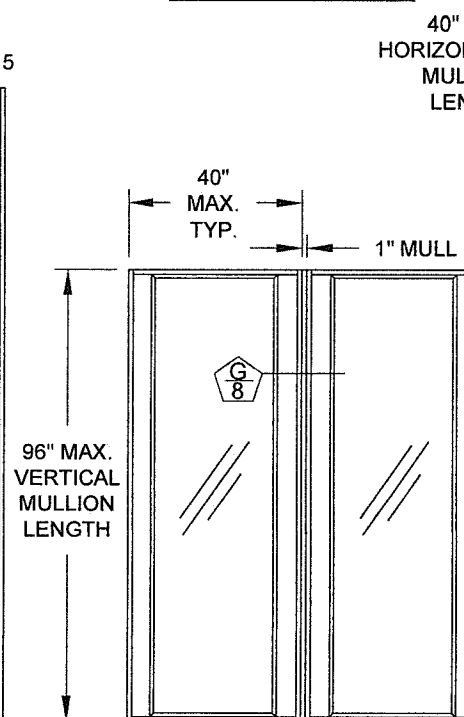

OIO (MAXIMUM OF 2
MULLED SIDELITES)
(WIDE STILES AND NARROW
RAILS SHOWN ON SIDELITES)

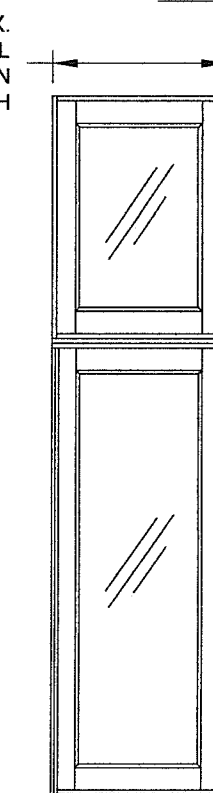

O/O WITH
HORIZONTAL
MULLION
(WIDE STILES AND
WIDE RAILS SHOWN
ON SIDELITE &
TRANSOM)

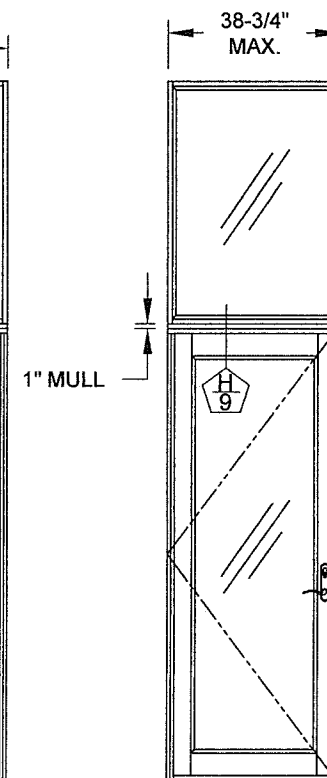

OIX WITH
HORIZONTAL
MULLION
(NARROW STILES
AND NARROW
RAILS SHOWN ON
TRANSOM)


NOTES:

- 1) SINGLE DOORS MAY BE LEFT OR RIGHT-HANDED.
- 2) MULLIONS SHOWN ARE STANDARD 1" FRENCH DOOR MULLIONS PER THIS NOA.
- 3) MULLED CONFIGURATIONS NOT SHOWN MAY BE POSSIBLE USING OTHER MULLION TYPES, SEE SEPARATE NOA.
- 4) FRENCH DOOR MULLION IS LIMITED TO 96" IN VERTICAL APPLICATIONS AND 40" IN HORIZONTAL APPLICATIONS.
- 5) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SLT/TR OR MULLED ASSEMBLY.
- 6) ADDITIONAL CONFIGURATIONS USING THE 1" FRENCH DOOR MULLION ARE POSSIBLE. USE THE ABOVE DRAWINGS AS A REFERENCE FOR SIZE LIMITATIONS.


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Isaac I. Chande
Miami-Dade Product Control

Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20


1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600




VINYL FRENCH DOOR AND SLT/TR				Date	5/7/13
EXAMPLE CONFIGURATIONS				Drawn By	J ROSOWSKI
Series	FD-5455	Scale	NTS	Sheet	2 OF 12
			DWG No.	MD-455.1	Rev.
			D		

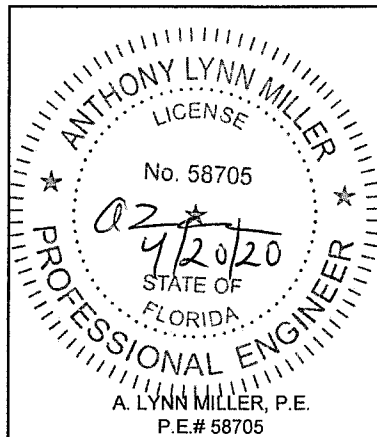


DOOR, SIDELITE & TRANSOM
GLAZING DETAILS

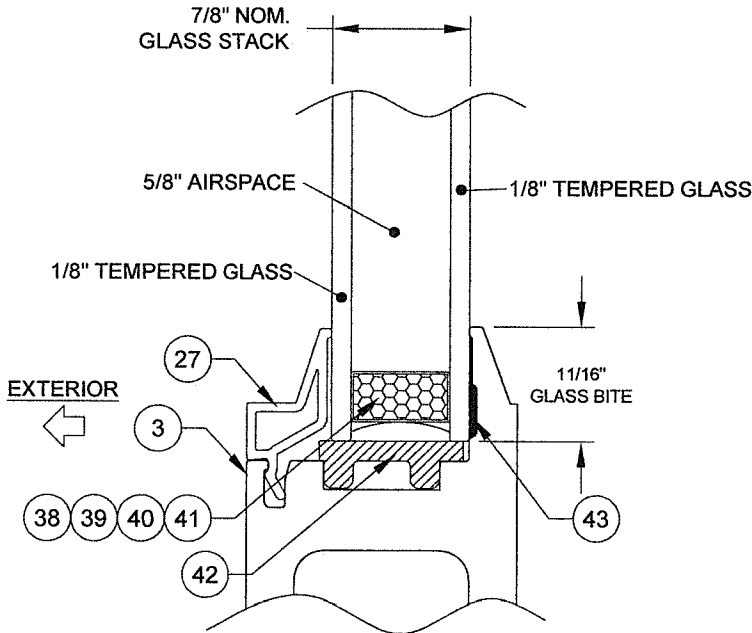


GLASS TYPE 1

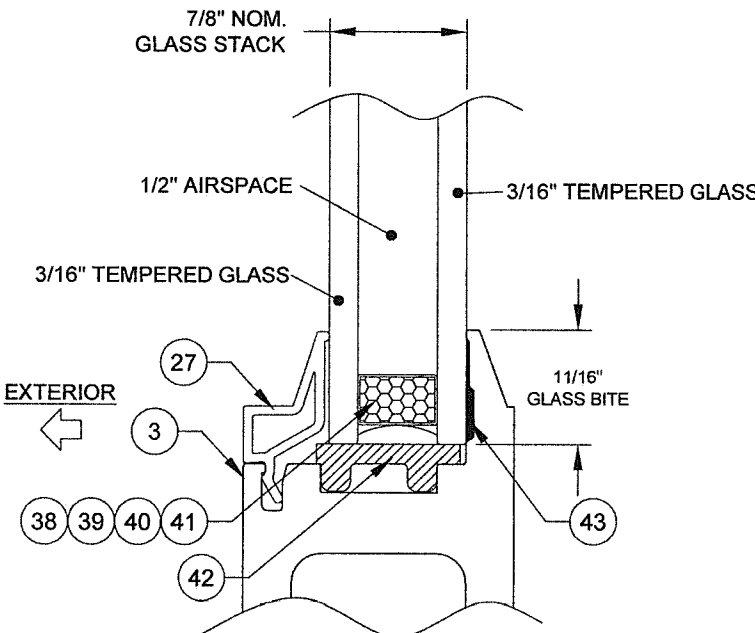


GLASS TYPE 2

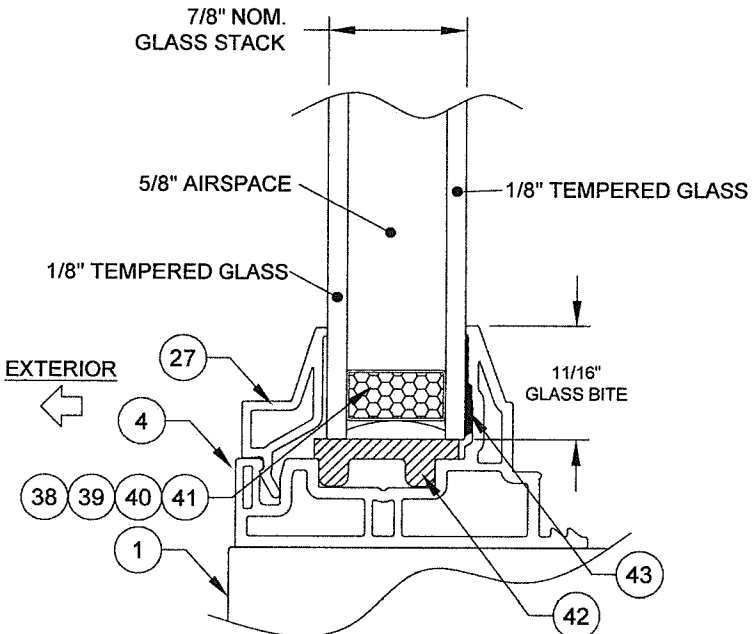


GLASS TYPE 1
SHOWN IN SIDELITE ADAPTER

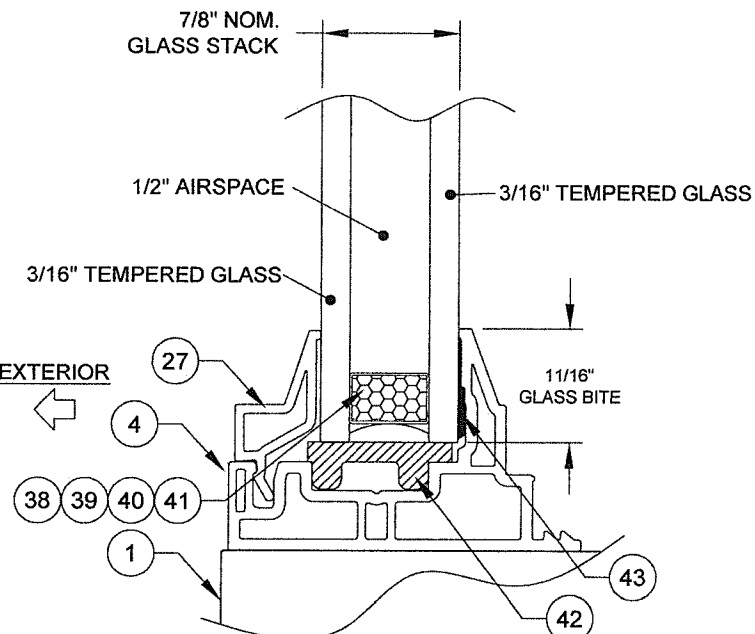


GLASS TYPE 2
SHOWN IN SIDELITE ADAPTER

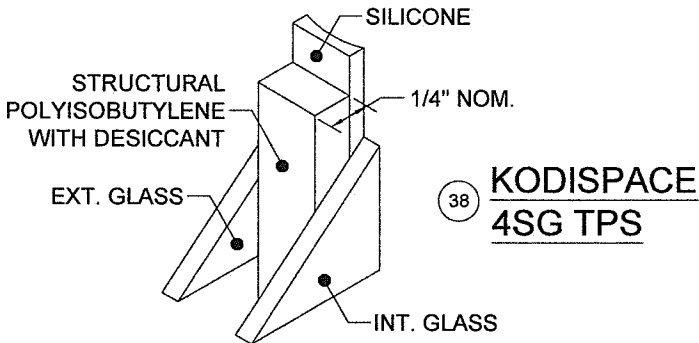


38 KODISPACE
4SG TPS

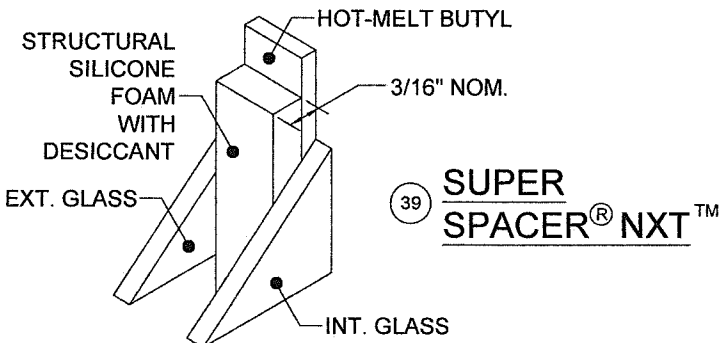

39 SUPER
SPACER[®] NXT[™]

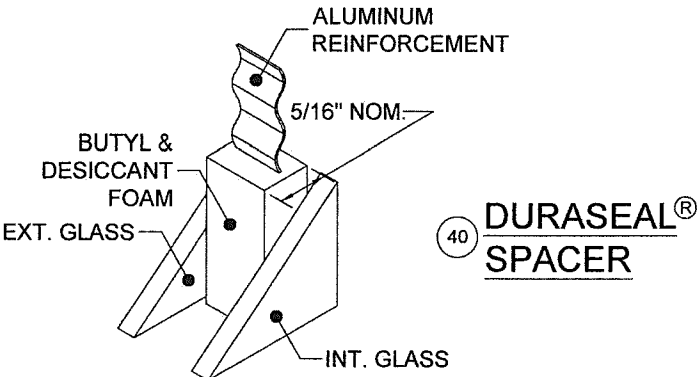

40 DURASEAL[®]
SPACER

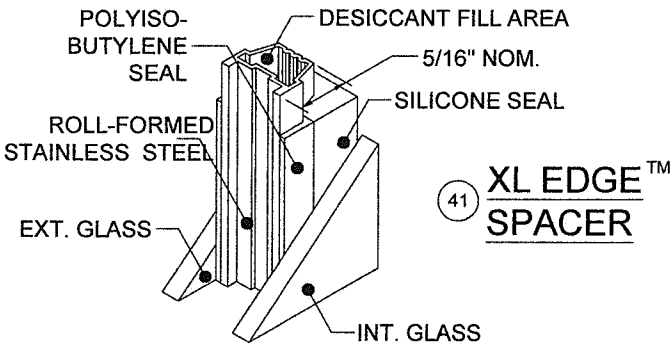

41 XL EDGE[™]
SPACER


Part #	Description	Material
38	Kommerling 4SG TPS Spacer System	See this Sheet for Materials
39	Quanex Super Spacer nXT with Hot Melt Butyl	
40	Quanex Duraseal Spacer	
41	Cardinal XL Edge Spacer	

REFERENCE TEST REPORTS: FTL-8717, 8968 & 8970


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: *Shay L. Chandra*
Miami-Dade Product Control

Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600



Rev	Date	By	No.	DWG	Sheet	Scale	Series
D	5/7/13	J ROSOWSKI	MD-455.1	3 OF 12	NTS	FD-5455	
VINYL FRENCH DOOR AND SLT/TR GLAZING DETAILS							

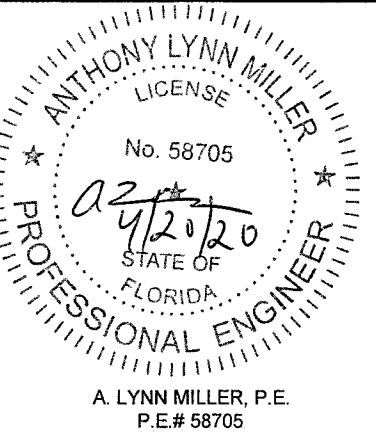

**SINGLE DOOR
INSTALLATION
(X)**

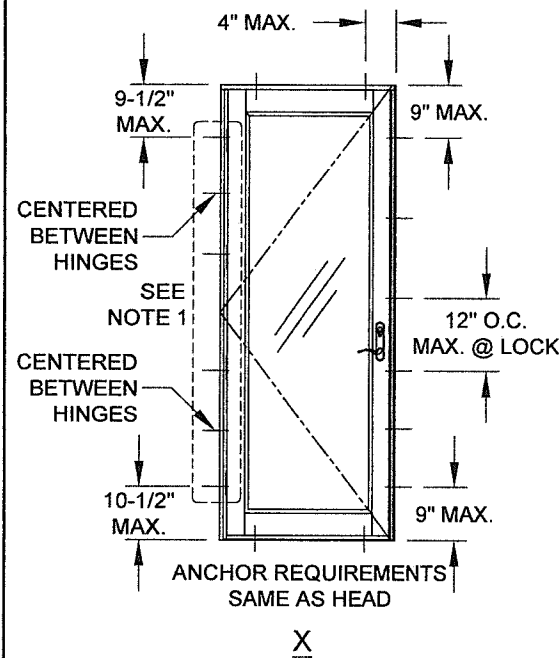


TABLE 3:
DOOR DESIGN PRESSURE

+/-50.0 PSF	Glass Type 1
+/-70.0 PSF	Glass Type 2

**DOUBLE DOOR
INSTALLATION
(XX)**

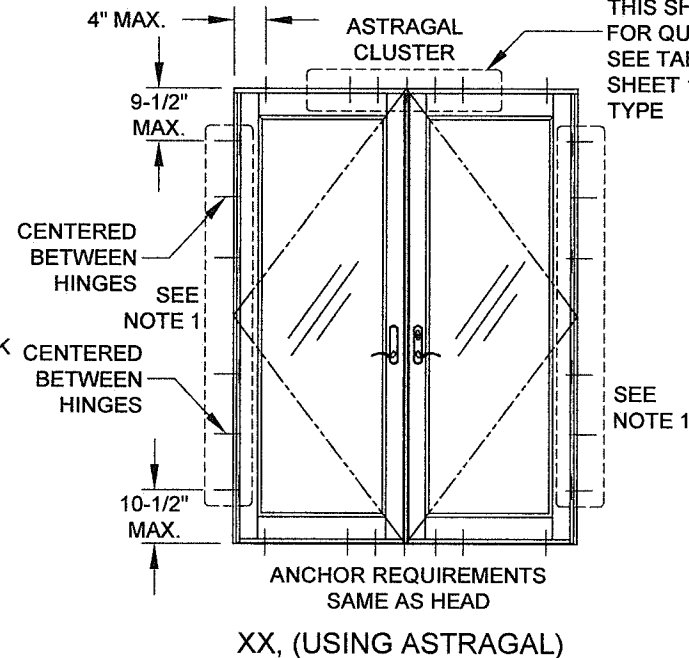


TABLE 4:
XX Door: Astragal Cluster Anchors Required @ Head & Sill

Door Height (in)	Door Width (in)							
	48	60	72	76	80	84	88	92
80	4	4	4	5	4	5	4	4
96	4	5	4	6	4	6	5	4

4" O.C. MIN., SEE TABLE 4, THIS SHEET, FOR QUANTITY, SEE TABLE 1, SHEET 1 FOR TYPE

**SIDELITE-TO-SIDELITE
MULLION INSTALLATION
(O/O)**

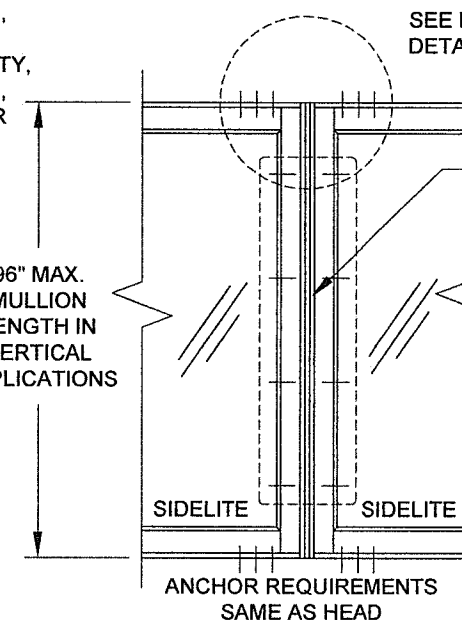


TABLE 5:
VERTICAL MULLION
DESIGN PRESSURE

+/-70.0 PSF

**SIDELITE-TO-DOOR
MULLION INSTALLATION
(X|O, O|X, X|X, O|X|O, X|O|X, O|XX|O, ETC)**

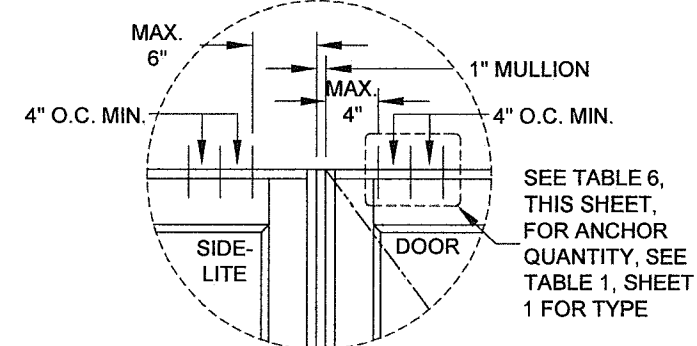
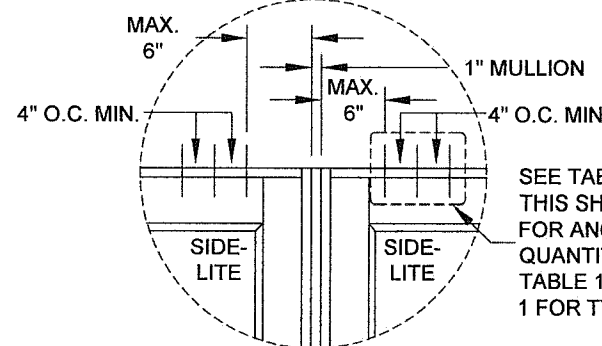
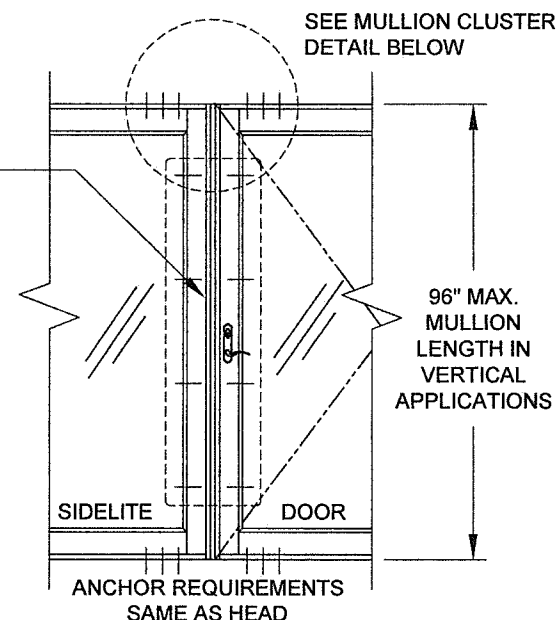


TABLE 6:
Anchors Required for a Vertical Mullion (each mullion end)

Mullion Height (in)	Door or Sidelite/Transom Width (in)											
	12	24	32	38-3/4	40	48	60	72	84	96	108	120
80	N/A	2	1	2	2	1	3	2	1	N/A	N/A	N/A
96	1	2	1	2	2	1	3	2	1	3	2	1

FOR "O|XX|O" AND SIMILAR CONFIGURATIONS CONTAINING A DOUBLE DOOR (XX), USE ONLY HALF OF THE FRAME WIDTH OF THE DOUBLE DOOR WHEN USING THIS TABLE.

**TRANSOM-TO-DOOR (X/O) OR TRANSOM-TO-SIDELITE (O/O)
MULLION ATTACHMENT & INSTALLATION**

ATTACH DOORS, SIDELITES & TRANSOMS TO THE MULLION AS PER THE INSTRUCTION OF THE INDIVIDUAL PRODUCT

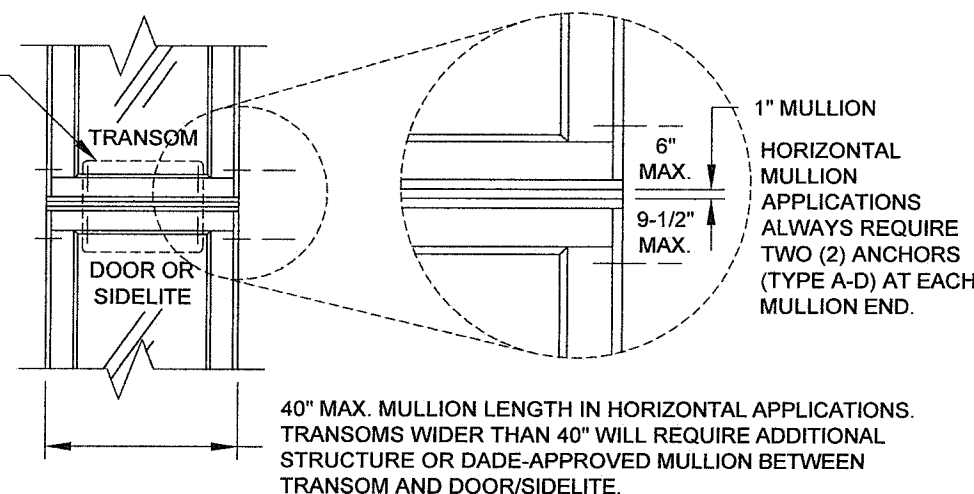


TABLE 7:
HORIZONTAL MULLION
DESIGN PRESSURE

+/-70.0 PSF

INSTRUCTIONS:

- 1) DOOR HINGE JAMBS OF ALL HEIGHTS TO ALWAYS BE ANCHORED WITH SIX ANCHORS. SEE TABLE 1, SHEET 1, FOR ALL APPROVED ANCHORS. FOUR OF THE SIX ANCHORS MUST BE INSTALLED THROUGH THE HINGES, ONE AT EACH HINGE LOCATION (RECOMMENDED #10 FLATHEAD SMS OR 3/16" FLATHEAD ULTRACON FOR EACH HINGE ANCHOR).
- 2) FOR A MULLED UNIT, DETERMINE THE DESIGN PRESSURE OF EACH COMPONENT IN THAT CONFIGURATION. FOR EXAMPLE, ON AN "X|O" CONFIGURATION, THE DP FOR THE DOOR, THE MULLION AND THE SIDELITE MUST EACH BE DETERMINED. THE LOWEST DP APPLIES TO THE ENTIRE ASSEMBLY.


NOTES:

- 1) SINGLE DOOR MAY BE LEFT OR RIGHT-HANDED.
- 2) MULLIONS SHOWN ARE STANDARD 1" FRENCH DOOR MULLIONS.
- 3) MULLED CONFIGURATIONS NOT SHOWN MAY BE POSSIBLE USING OTHER MULLION TYPES, SEE SEPARATE NOA. THE LOWEST COMPONENT DP IS TO BE THE OVERALL ASSEMBLY DP.
- 4) FRENCH DOOR MULLION IS LIMITED TO 96" IN VERTICAL APPLICATIONS AND 40" IN HORIZONTAL APPLICATIONS.
- 5) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SIDELITE/TRANSOM OR MULLED ASSEMBLY.
- 6) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Shay L. Chan
Miami-Dade Product Control

Revision: D) ADDED ANCHOR GROUP A TO
TABLES 4 & 6.
AK - 4/9/20

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600



5/7/13	J ROSOWSKI	D
Date	By	Rev.
1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941)-480-1600	DESIGN PRESSURE 1	MD-455.1
VINYL FRENCH DOOR AND SLT/TR	4 OF 12	
FD-5455	NTS	
Scale	Sheet	



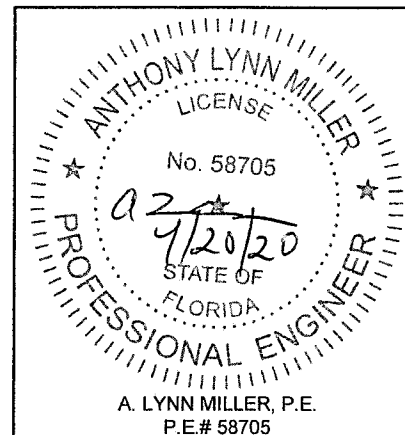


TABLE 8:

		Sidelite/Transom Design Pressure (+/-, psf) for Glass Types 1 & 2															
		Long Side (in)															
		63-3/16	66-5/8	68	70	72	76	78	82	84	88	92	96	98	104	108	111
Short Side (in)	24	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	28	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	32	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	36	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	38-3/4	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	40	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70
	42	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.6	+/-68.5	
	44	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.6	+/-68.6	+/-67.7	+/-67.3			
	46	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.4	+/-68.7	+/-67.6	+/-66.5	+/-65.6				
	48	+/-70	+/-70	+/-70	+/-70	+/-70	+/-69.9	+/-69.1	+/-67.6	+/-67	+/-65.8	+/-64.7					
	50	+/-70	+/-70	+/-70	+/-70	+/-70	+/-68.4	+/-67.6	+/-66	+/-65.4	+/-64.1						
	52	+/-70	+/-70	+/-70	+/-70	+/-69.1	+/-67.1	+/-66.2	+/-64.6	+/-63.9							
	54	+/-70	+/-70	+/-70	+/-69.2	+/-68	+/-65.9	+/-65	+/-63.4								
	56	+/-70	+/-70	+/-69.7	+/-68.3	+/-67.1	+/-64.9	+/-63.9									
	58	+/-70	+/-70	+/-69	+/-67.6	+/-66.3	+/-64										
	60	+/-70	+/-69.6	+/-68.5	+/-67	+/-65.6											
	62	+/-70	+/-69.2	+/-68	+/-66.5												
	63-3/16	+/-70	+/-69.1	+/-67.9	+/-66.2												
	66-5/8	+/-69.1	+/-68.9														

SIDELITE/TRANSOM INSTALLATION (O)

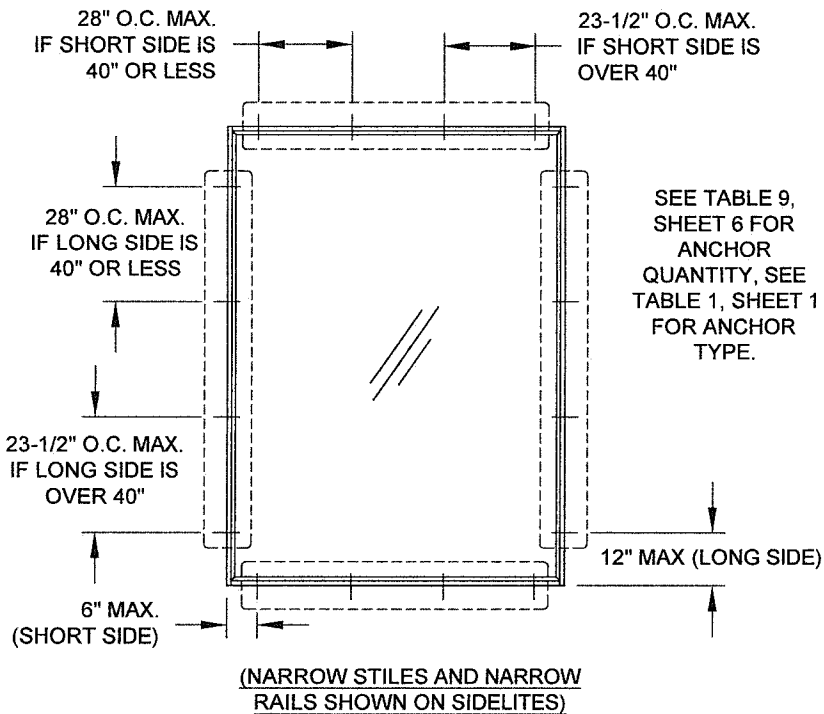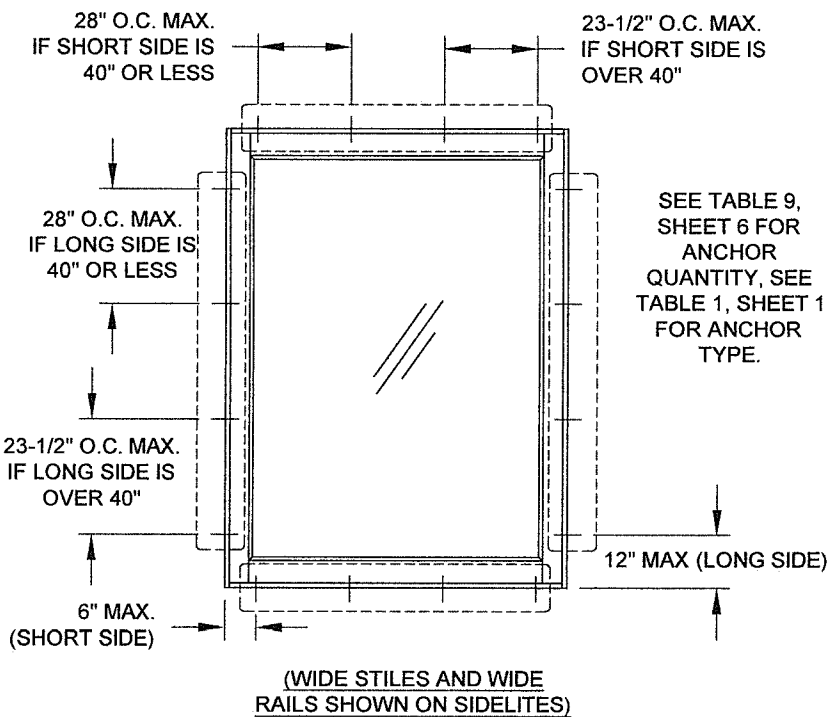


- NOTES:
- 1) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SIDELITE/TRANSOM OR MULLED ASSEMBLY.
 - 2) SIDELITE/TRANSOM MAY BE A SINGLE, STAND-ALONE UNIT.
 - 3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Ishaq I. Chandra
Miami-Dade Product Control

Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600



5/7/13

Date

J ROSOWSKI

By

Rev.

MD-455.1

No.

5 OF 12

Sheet

NTS

Scale

FD-5455

Series

Desc.

Title

VINYL FRENCH DOOR AND SLT/TR

DESIGN PRESSURE 2

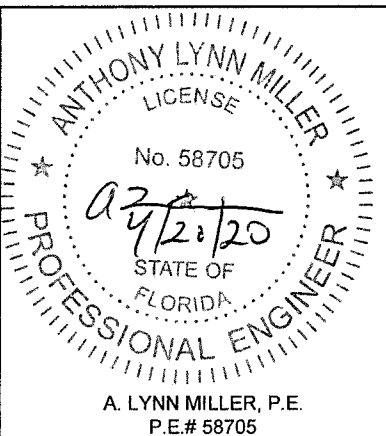


TABLE 9:


			Sidelite/Transom Anchor Quantity																																
			Long Side (in)																																
			63-3/16		66-5/8		68		70		72		76		78		82		84		88		92		96		98		104			108		111	
			Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Group B	Anchor Groups C-D	Anchor Group A	Anchor Groups B-D	Anchor Group A	Anchor Groups B-D
Short Side (in)	24	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	4	4	4	4	4	4	4	4	4	4	4	4	4	5	5	5	5	5	5	5	5	5	5	6	5	5	6	6	6	6	
	28	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	4	4	4	4	4	4	4	4	5	4	5	4	5	4	5	5	5	5	6	5	6	5	6	5	5	5	7	6	7	6	
	32	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	4	4	4	4	4	4	4	5	4	5	4	5	4	6	5	6	5	6	5	6	5	7	5	7	5	5	7	6	8	6	
	36	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	
		Long Side	4	4	5	4	5	4	5	4	5	4	5	4	5	4	6	4	6	5	6	5	7	5	7	5	7	5	8	5	5	7	6	8	6
	38-3/4	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
		Long Side	4	4	5	4	5	4	5	4	5	4	6	4	6	4	6	4	6	5	7	5	7	5	7	5	8	5	8	5	5	8	6	9	6
	40	Short Side	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2	2
		Long Side	4	4	5	4	5	4	5	4	5	4	6	4	6	4	6	4	6	5	7	5	7	5	8	5	8	5	8	5	5	9	6	9	6
	42	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3				
		Long Side	5	4	5	4	5	4	5	4	5	4	6	4	6	4	6	4	7	5	7	5	7	5	8	5	8	5	8	6	5				
	44	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3							
		Long Side	5	4	5	4	5	4	5	4	6	4	6	4	6	4	7	4	7	5	7	5	7	5	8	5	8	5							
	46	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3									
		Long Side	5	4	5	4	5	4	6	4	6	4	6	4	6	4	7	4	7	5	7	5	7	5	8	5									
	48	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3											
		Long Side	5	4	5	4	5	4	6	4	6	4	6	4	6	4	7	4	7	5	7	5	7	5											
	50	Short Side	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3	3												
		Long Side	5	4	5	4	5	4	6	4	6	4	6	4	6	4	7	4	7	5	7	5													
	52	Short Side	4	3	4	3	4	3	4	3	4	3	3	3	3	3	3	3	3	3															
		Long Side	5	4	5	4	6	4	6	4	6	4	6	4	6	4	7	4	7	5															
	54	Short Side	4	3	4	3	4	3	4	3	4	3	4	3	4	3	4	3																	
		Long Side	5	4	5	4	6	4	6	4	6	4	6	4	6	4	7	4																	
	56	Short Side	4	3	4	3	4	3	4	3	4	3	4	3	4	3																			
		Long Side	5	4	6	4	6	4	6	4	6	4	6	4	6	4																			
	58	Short Side	4	3	4	3	4	3	4	3	4	3	4	3																					
		Long Side	5	4	6	4	6	4	6	4	6	4	6	4																					
	60	Short Side	5	4	5	4	5	4	4	4	4	4																							
		Long Side	5	4	6	4	6	4	6	4	6	4																							
	62	Short Side	5	4	5	4	5	4	5	4																									
		Long Side	5	4	6	4	6	4	6	4																									
	63-3/16	Short Side	5	4	5	4	5	4																											
		Long Side	5	4	6	4	6	4																											
	66-5/8	Short Side	5	4	6	4																													
		Long Side	6	4	6	4																													

NOTES:
1) NARROW OR WIDE STILES AND RAILS MAY BE MIXED WITHIN THE SAME SIDELITE/TRANSOM OR MULLED ASSEMBLY.
2) SIDELITE/TRANSOM MAY BE A SINGLE, STAND-ALONE UNIT.
3) FOR SIZES NOT SHOWN, ROUND UP TO THE NEXT AVAILABLE SHORT OR LONG DIMENSION.

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Ismael L. Chan
Miami-Dade Product Control

Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600



REGISTRATION #29296

VINYL FRENCH DOOR AND SLT/TR

SLT/TR ANCHOR QUANTITIES

FD-5455

5/7/13

Date

J ROSOWSKI

By

6 OF 12

Sheet

NTS


Scale






Rev.

D

MD-455.1

No. DWG

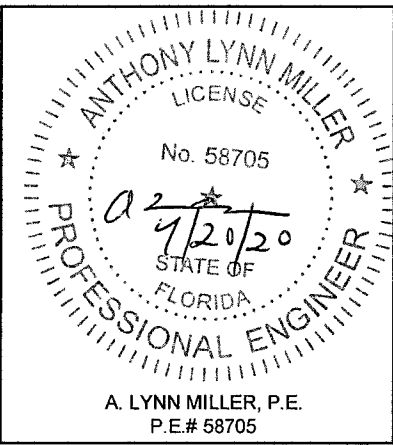

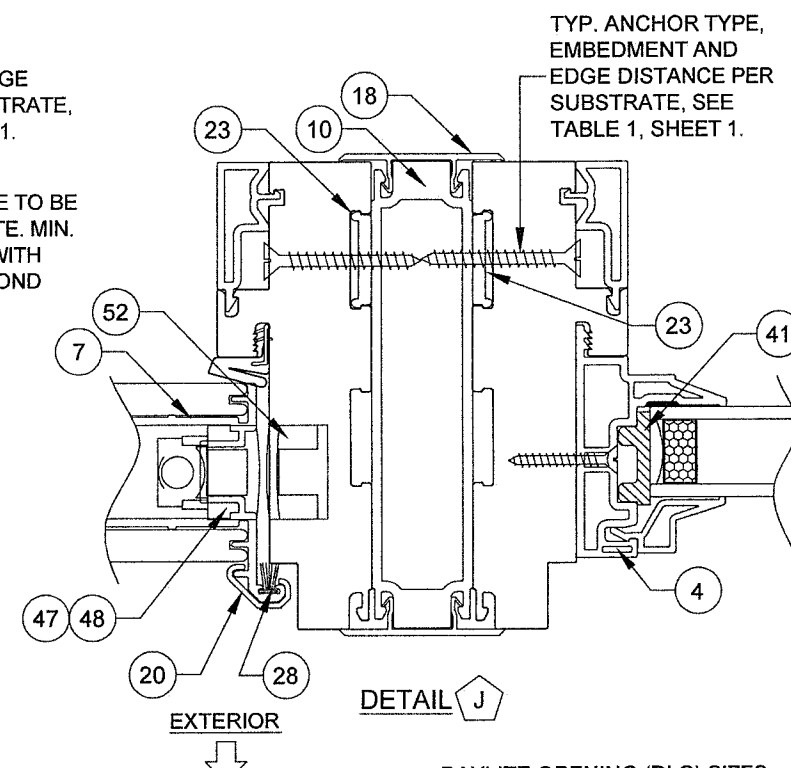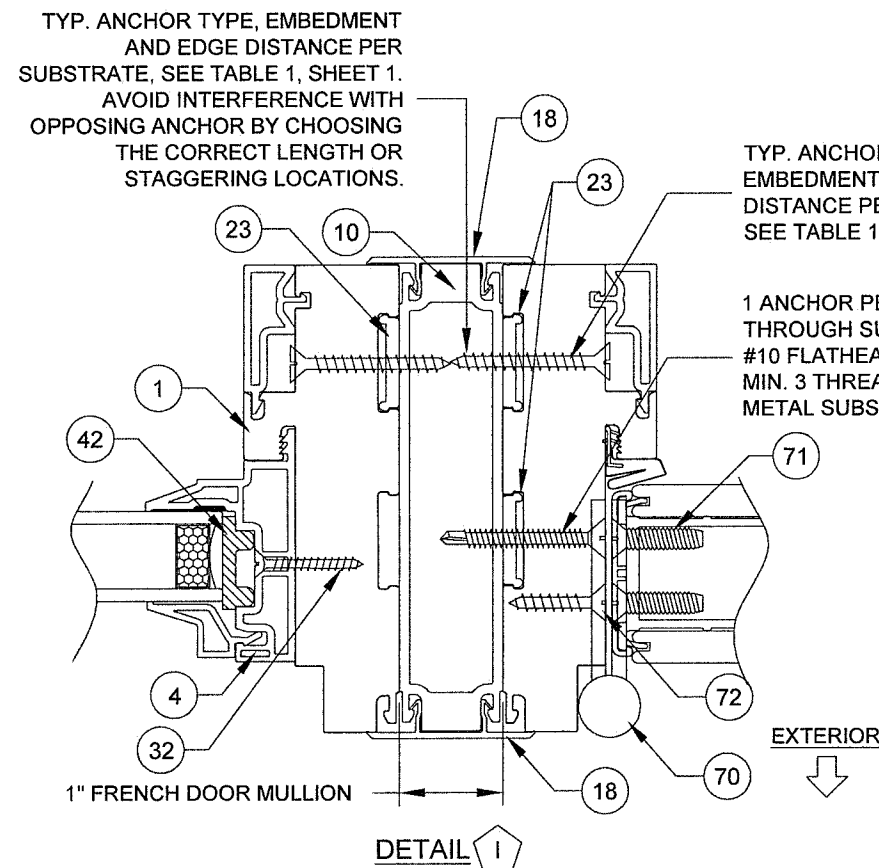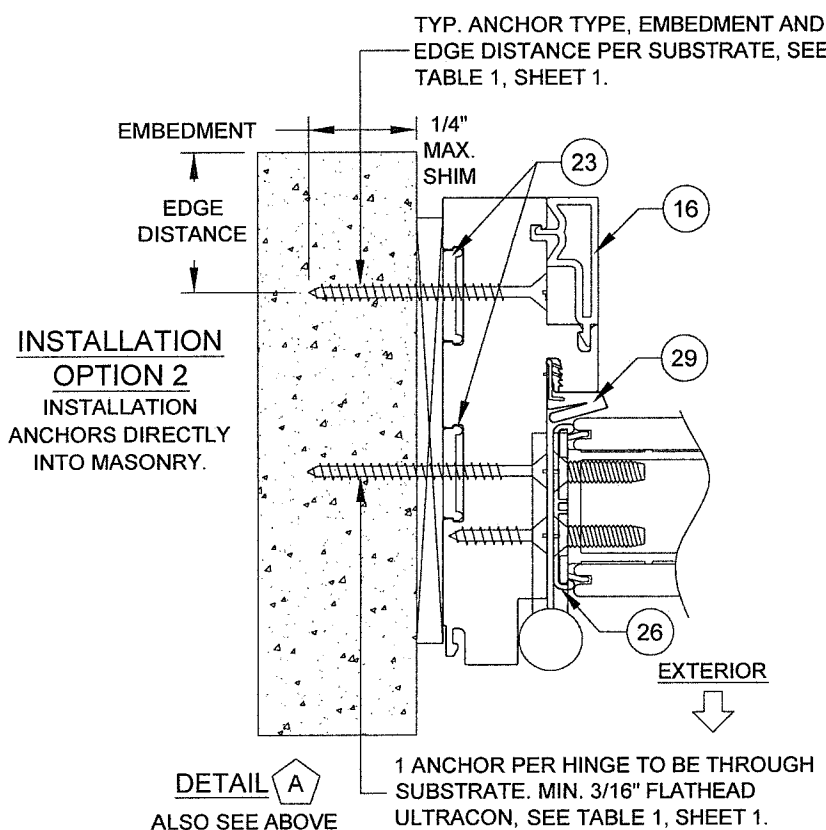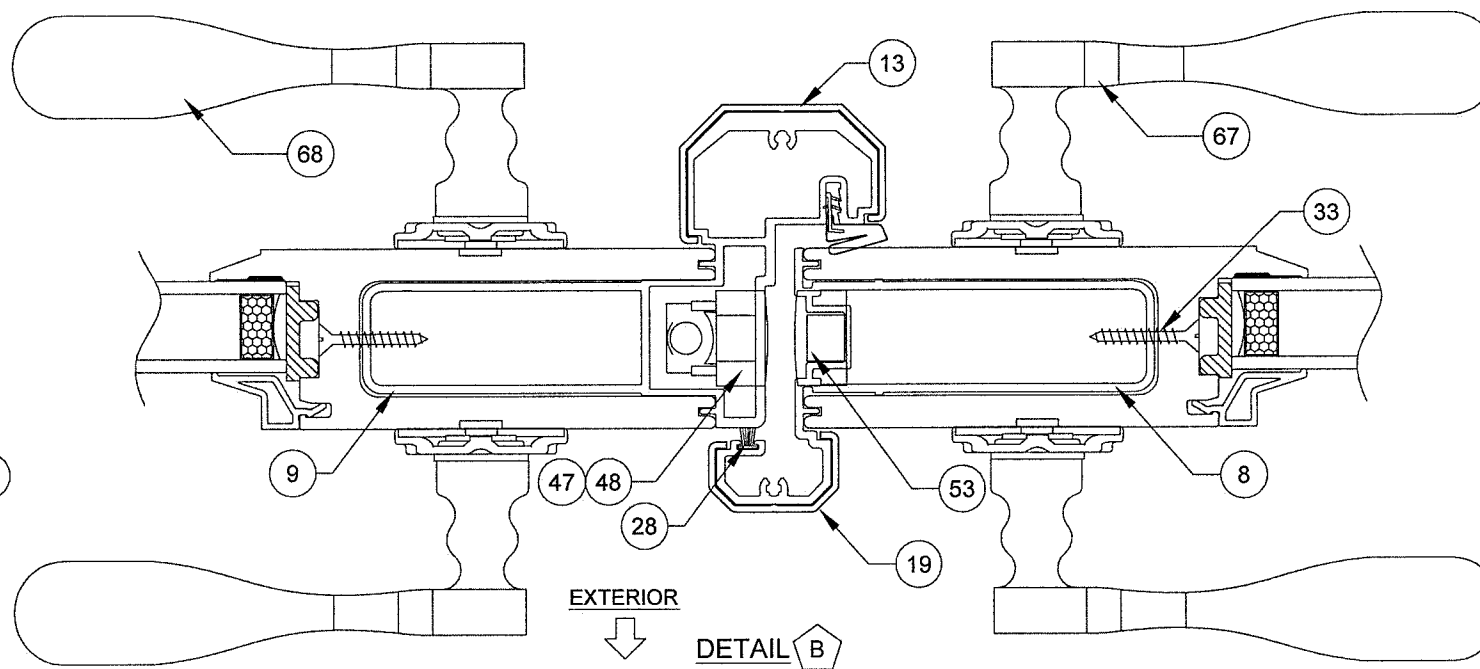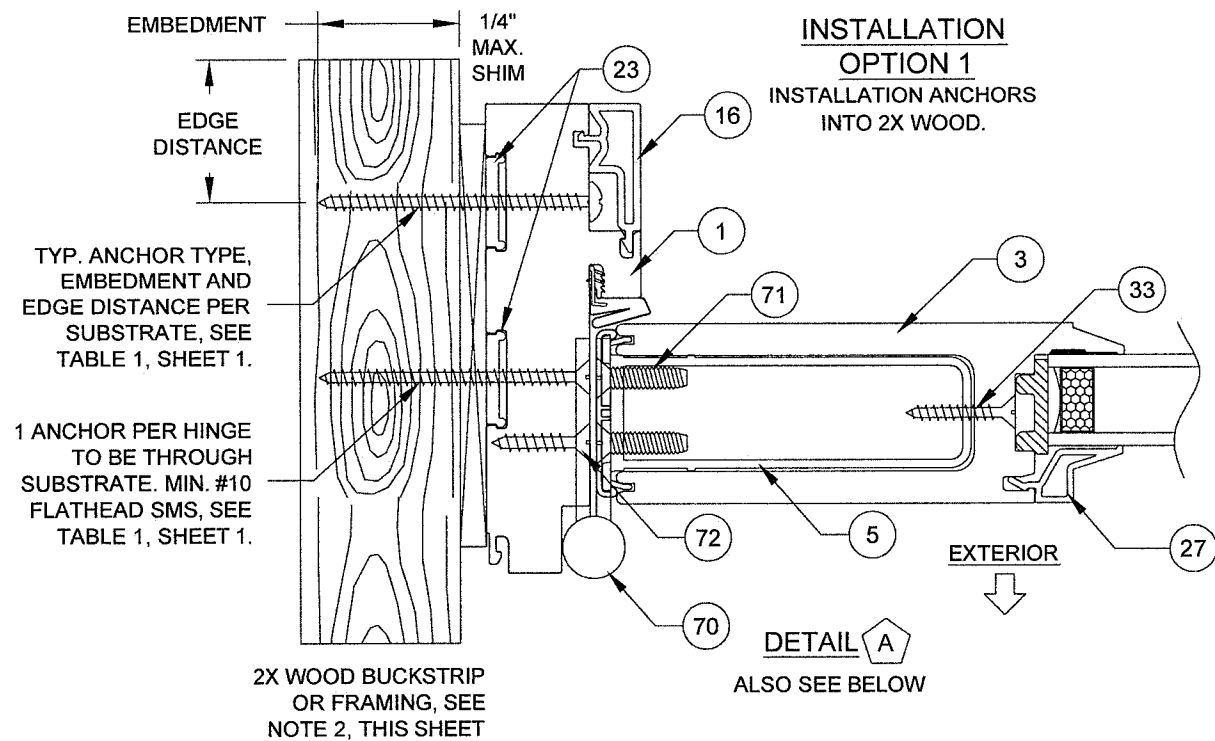

INSTALLATION NOTES:

- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 1, SHEET 1. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE DOOR, SIDELITE OR TRANSOM.
- 2) WOOD BUCKS DEPICTED ON THIS SHEET AS "1X", ARE BUCKS WHOSE TOTAL THICKNESS IS LESS THAN 1-1/2". 1X WOOD BUCKS ARE OPTIONAL IF UNIT CAN BE INSTALLED DIRECTLY TO MASONRY. WOOD BUCKS DEPICTED AS "2X" ARE 1-1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- 3) FOR ATTACHMENT TO METAL: THE STRUCTURAL MEMBER SHALL BE OF A SIZE TO PROVIDE FULL SUPPORT TO THE FRAME OF THE DOOR, SIDELITE OR TRANSOM.
- 4) IF APPLICABLE, LOWEST DESIGN PRESSURE FROM DOOR, SIDELITE, TRANSOM OR MULLION APPLIES TO THE WHOLE SYSTEM.


DAYLITE OPENING (DLO) SIZES

- WHEN USING PART # 3: (WIDE RAILS OR STILES)
- X DOOR FRAME HEIGHT - 12.1 = DLO HEIGHT
 - X DOOR FRAME WIDTH - 12.3 = DLO WIDTH
 - (XX DOOR FRAME HEIGHT / 2) - 12.1 = DLO HEIGHT
 - (XX DOOR FRAME WIDTH / 2) - 11.7 = DLO WIDTH
 - SLT/TR FRAME HEIGHT - 12.1 = DLO HEIGHT
 - SLT/TR FRAME WIDTH - 12.1 = DLO WIDTH
- WHEN USING PART # 4: (NARROW RAILS OR STILES)
- SLT/TR FRAME HEIGHT - 4.9 = DLO HEIGHT
 - SLT/TR FRAME WIDTH - 4.9 = DLO WIDTH


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Ismael I. Chandra
Miami-Dade Product Control


Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600

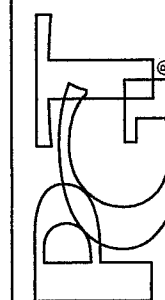


Series	Desc.	Scale	Sheet	No.	Rev.
FD-5455	NTS	7 OF 12	DWG	MD-455.1	D
VINYL FRENCH DOOR AND SLT/TR					
INSTALLATION 1					
J ROSOWSKI					
5/7/13					

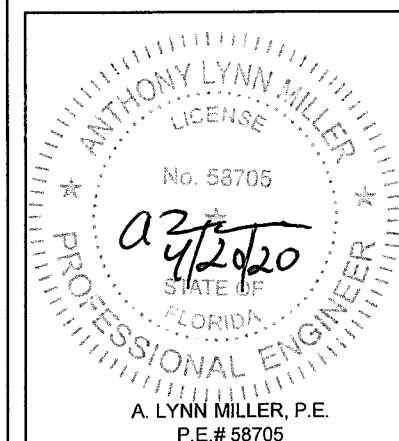

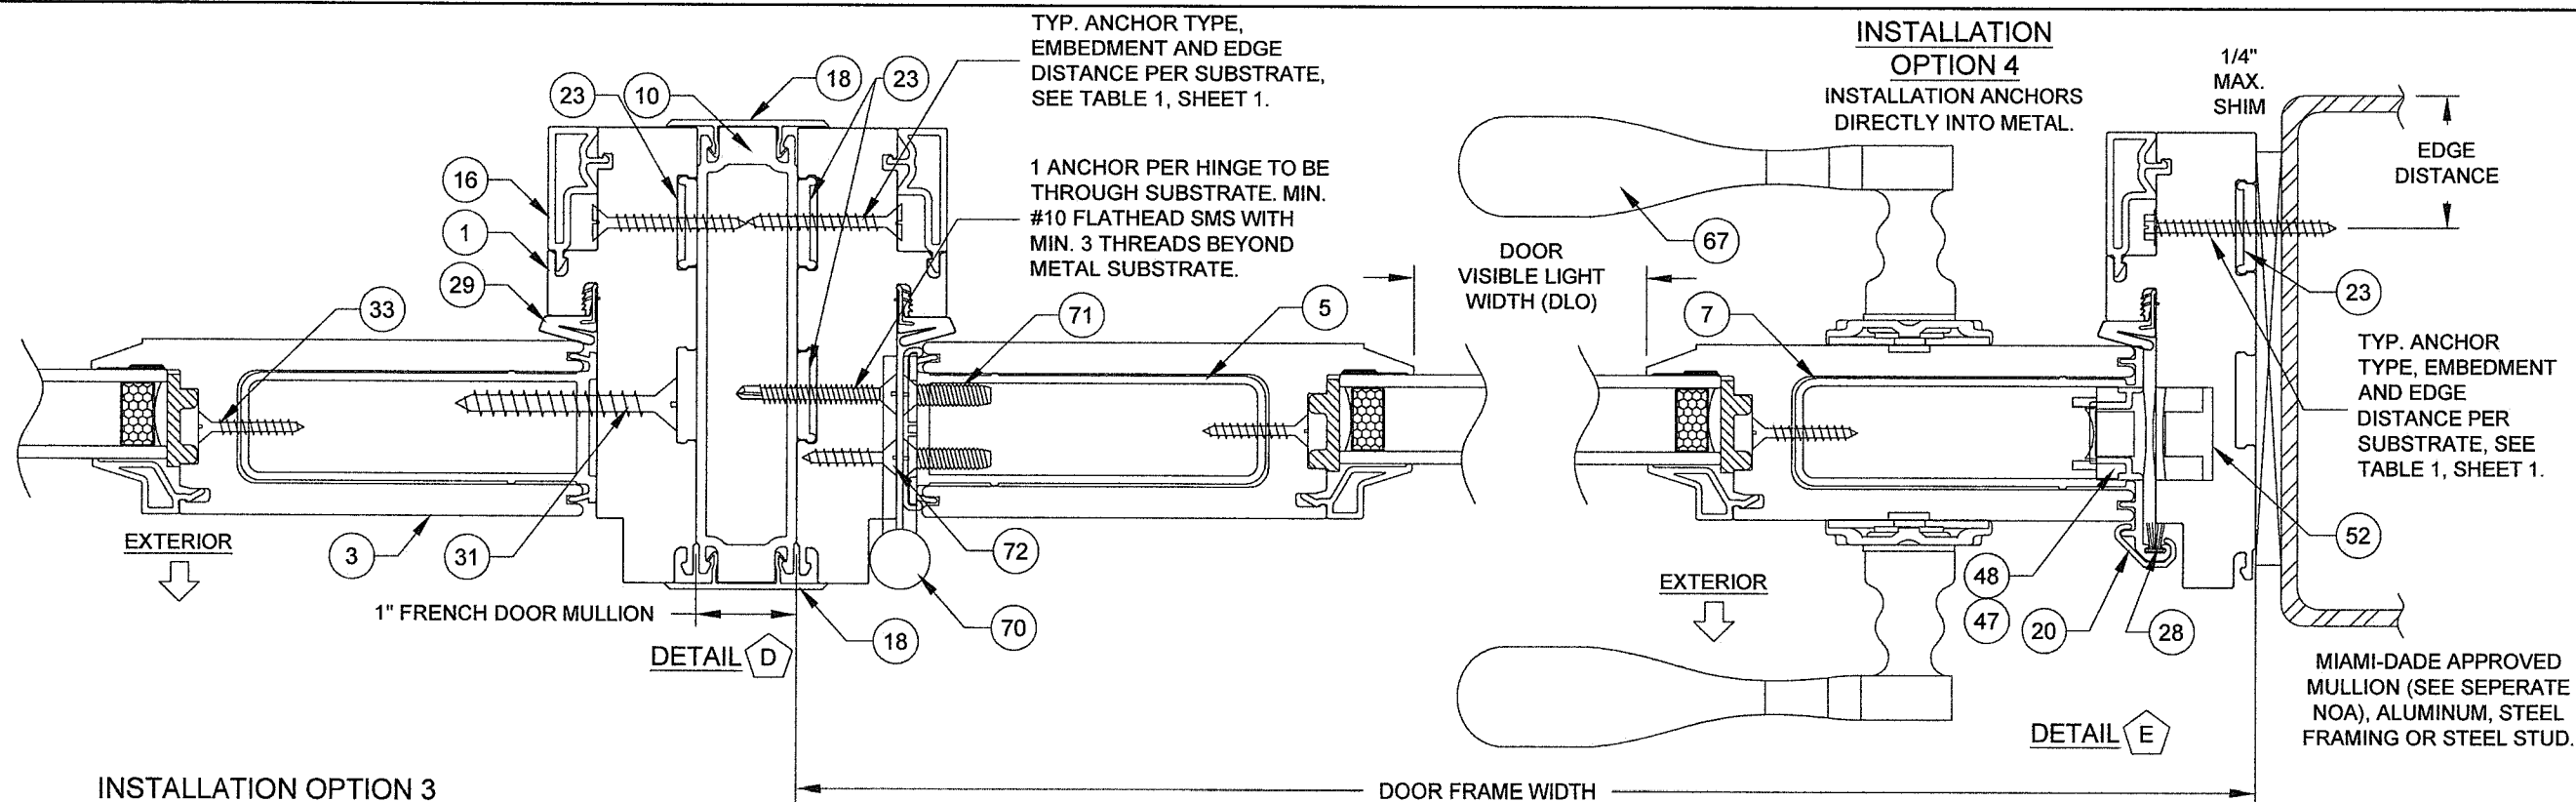


INSTALLATION OPTION 3

INSTALLATION ANCHORS THROUGH 1X BUCKSTRIP INTO MASONRY.

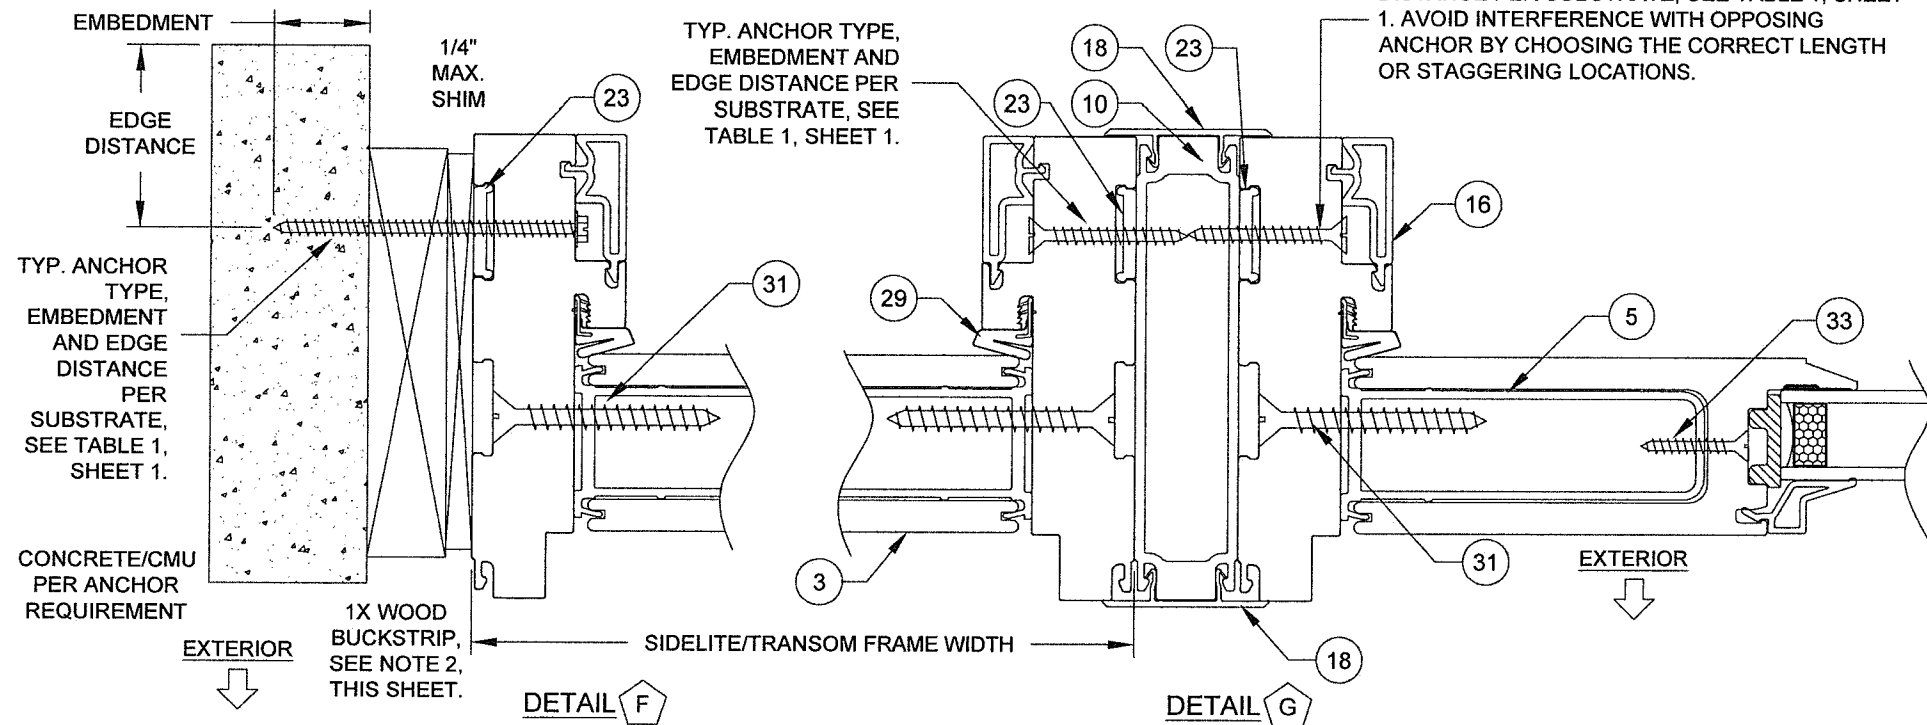

INSTALLATION NOTES:


- 1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 1, SHEET 1. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE DOOR, SIDELITE OR TRANSOM.
- 2) WOOD BUCKS DEPICTED ON THIS SHEET AS "1X", ARE BUCKS WHOSE TOTAL THICKNESS IS LESS THAN 1-1/2". 1X WOOD BUCKS ARE OPTIONAL IF UNIT CAN BE INSTALLED DIRECTLY TO MASONRY. WOOD BUCKS DEPICTED AS "2X" ARE 1-1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.
- 3) FOR ATTACHMENT TO METAL: THE STRUCTURAL MEMBER SHALL BE OF A SIZE TO PROVIDE FULL SUPPORT TO THE FRAME OF THE DOOR, SIDELITE OR TRANSOM.
- 4) IF APPLICABLE, LOWEST DESIGN PRESSURE FROM DOOR, SIDELITE, TRANSOM OR MULLION APPLIES TO THE WHOLE SYSTEM.

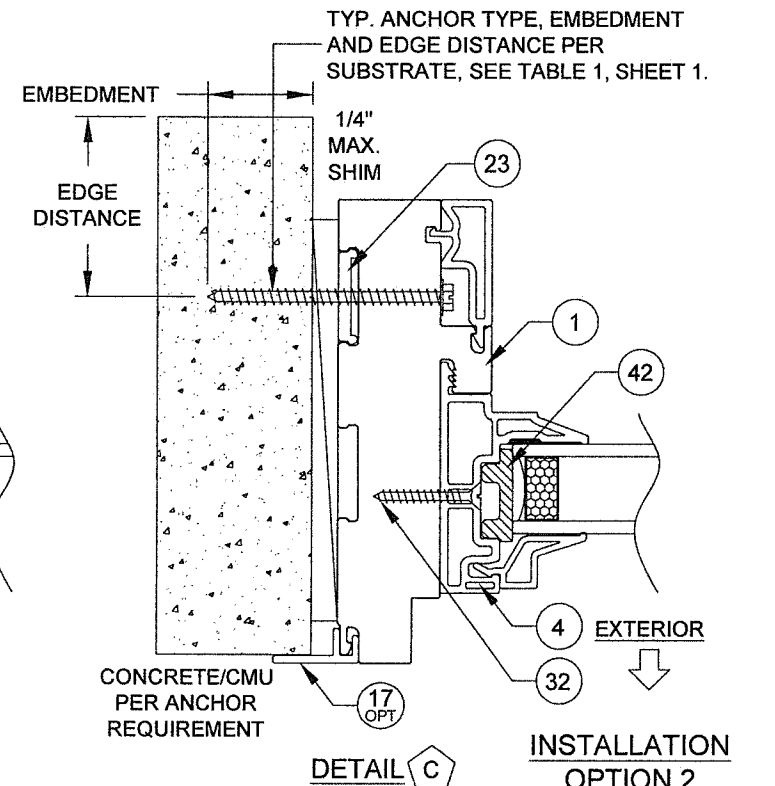

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: *Isaac L. Chan*
Miami-Dade Product Control


Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20




1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600

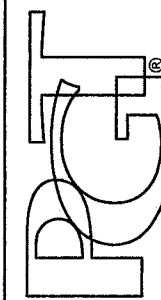

REGISTRATION #29296

VINYL FRENCH DOOR AND SLTTR	Date	5/7/13	By	J ROSOWSKI	DWC No.	MD-455.1	D
INSTALLATION 2	Sheet	8 OF 12	Scale	NTS	FD-5455		

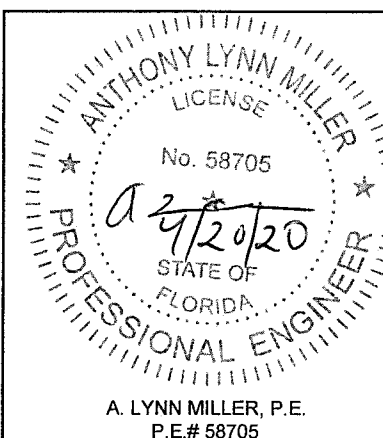

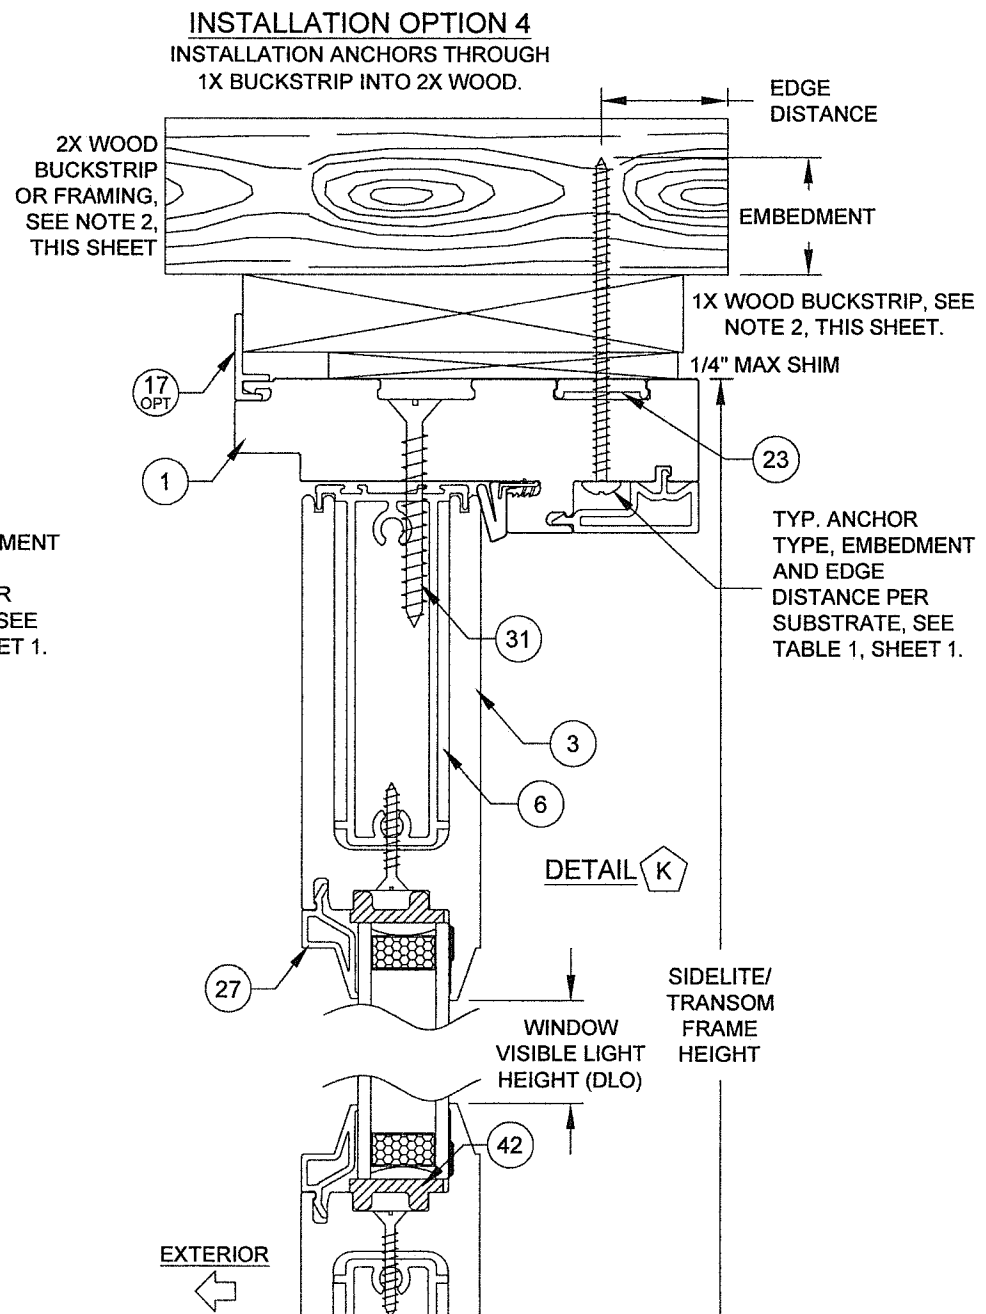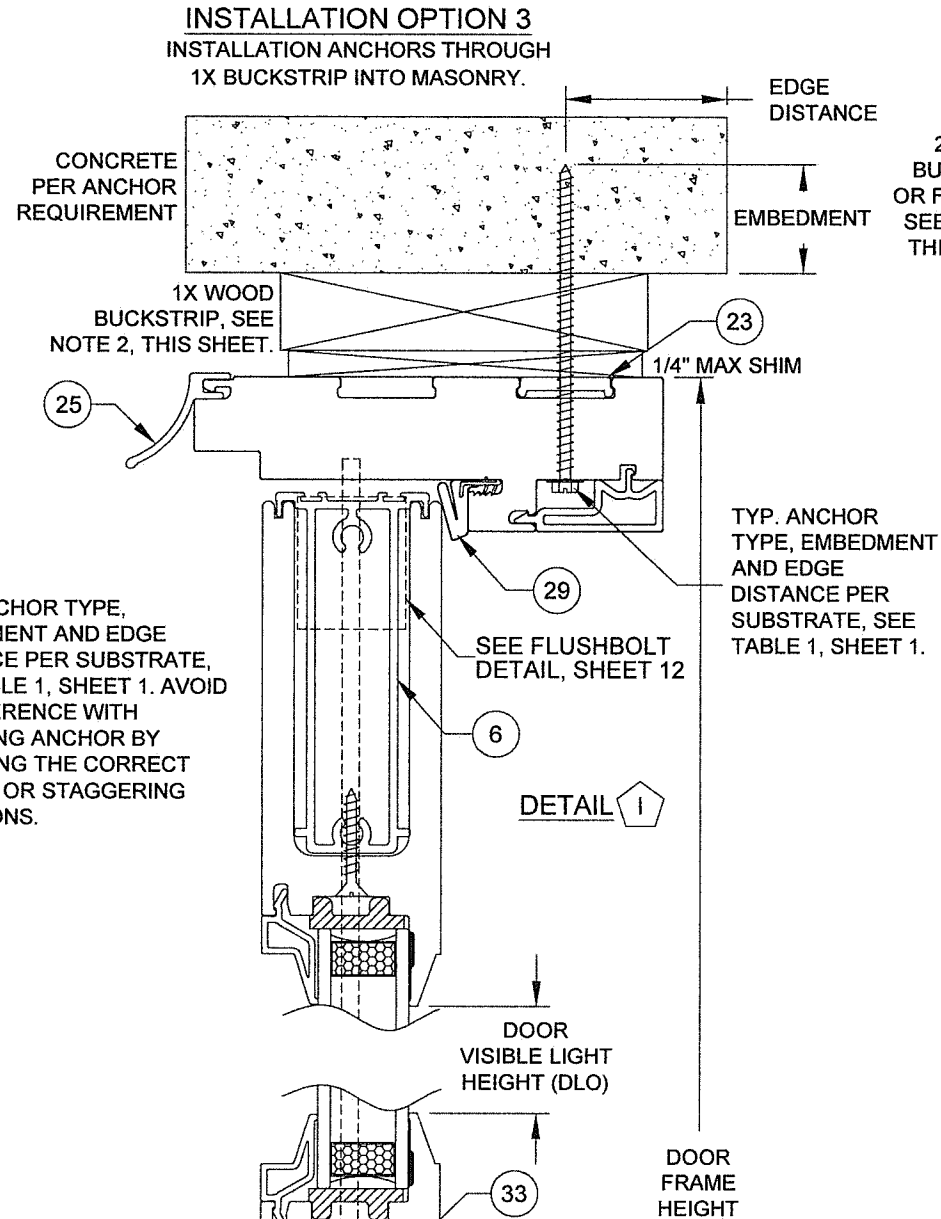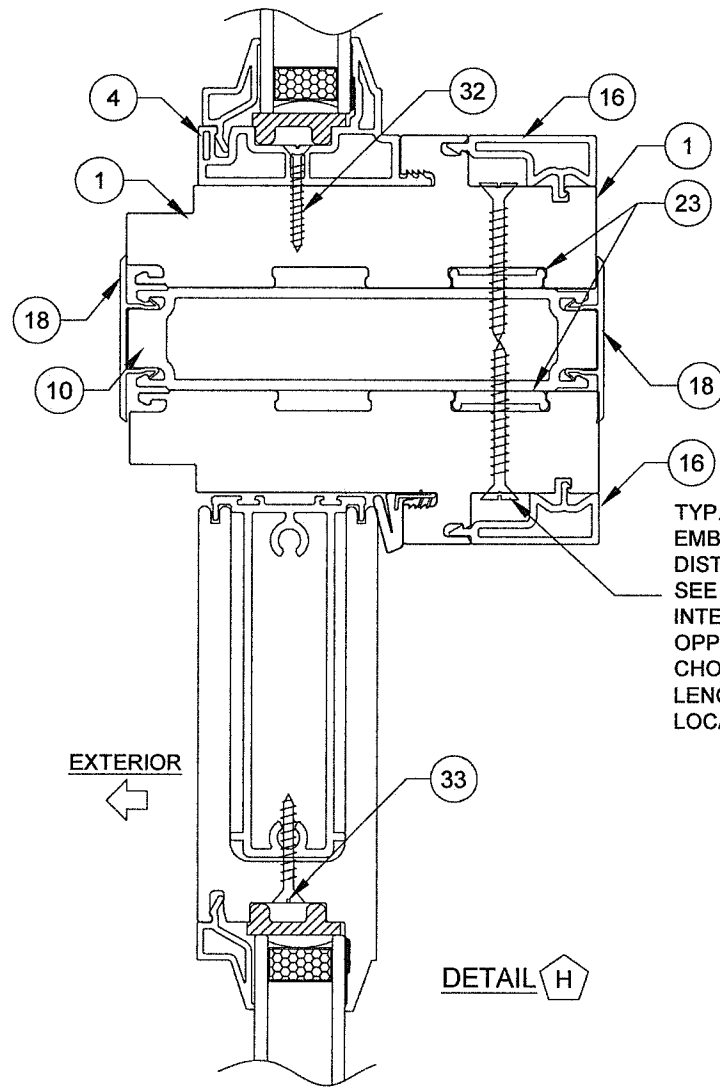



INSTALLATION NOTES:

1) USE ONLY SUBSTRATE-APPROPRIATE ANCHORS LISTED ON TABLE 1, SHEET 1. FOLLOW EMBEDMENT AND EDGE DISTANCE LIMITS. ANY INSTALLATION OPTION SHOWN MAY BE USED ON ANY SIDE OF THE DOOR, SIDELITE OR TRANSOM.

2) WOOD BUCKS DEPICTED ON THIS SHEET AS "1X", ARE BUCKS WHOSE TOTAL THICKNESS IS LESS THAN 1-1/2". 1X WOOD BUCKS ARE OPTIONAL IF UNIT CAN BE INSTALLED DIRECTLY TO MASONRY. WOOD BUCKS DEPICTED AS "2X" ARE 1-1/2" THICK OR GREATER. INSTALLATION TO THE SUBSTRATE OF WOOD BUCKS TO BE ENGINEERED BY OTHERS OR AS APPROVED BY THE AUTHORITY HAVING JURISDICTION.

3) FOR ATTACHMENT TO METAL: THE STRUCTURAL MEMBER SHALL BE OF A SIZE TO PROVIDE FULL SUPPORT TO THE FRAME OF THE DOOR, SIDELITE OR TRANSOM.


4) IF APPLICABLE, LOWEST DESIGN PRESSURE FROM DOOR, SIDELITE, TRANSOM OR MULLION APPLIES TO THE WHOLE SYSTEM.

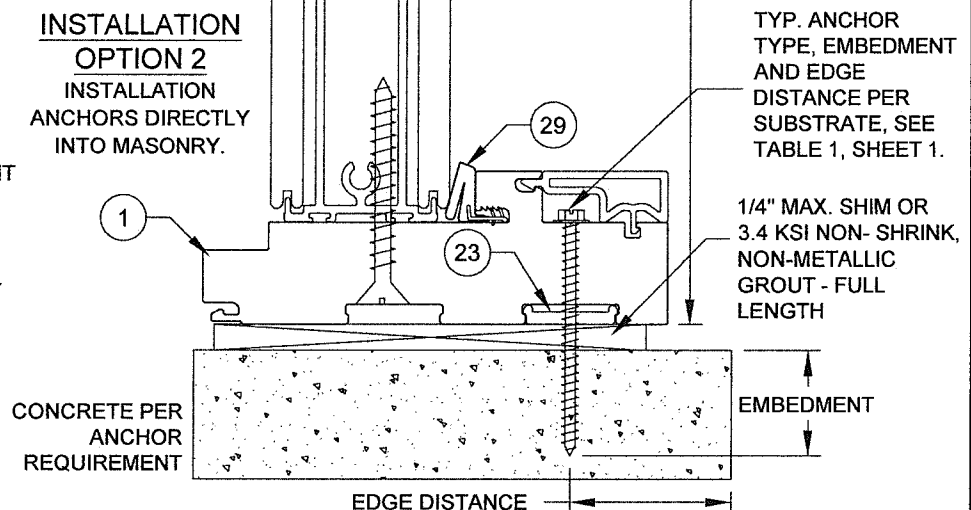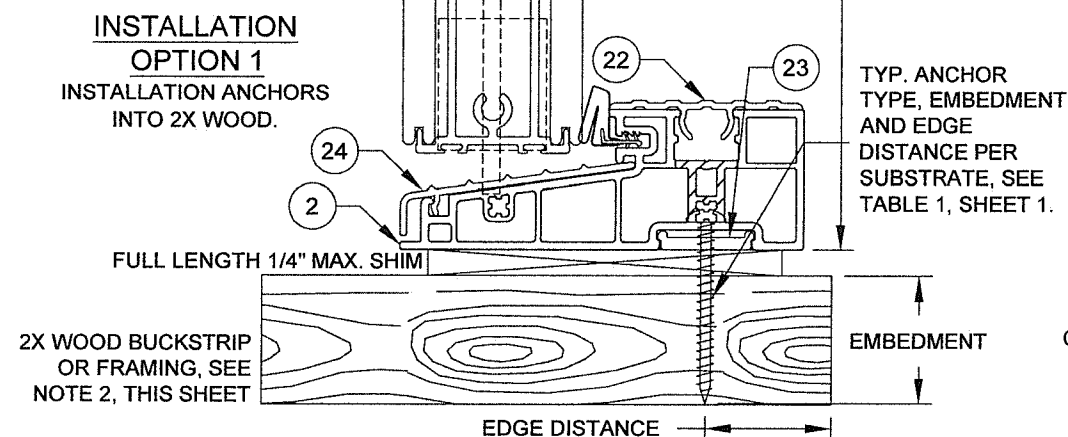


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Ismael I. Chandra
Miami-Dade Product Control























Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20

1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600



Series	Desc.	Title	Scale	Sheet	No.	By	Date	Rev.
FD-5455	NTS	9 OF 12	MD-455.1	D	J ROSOWSKI	5/7/13		
VINYL FRENCH DOOR AND SLT/TRANSOM								
INSTALLATION 3								

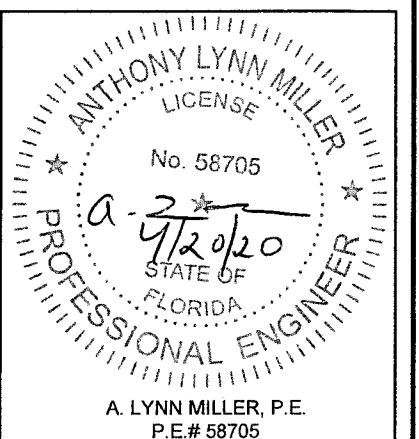


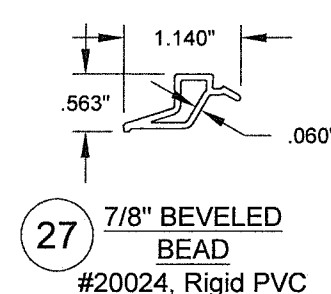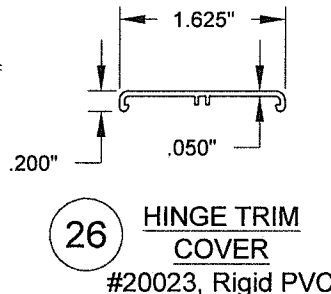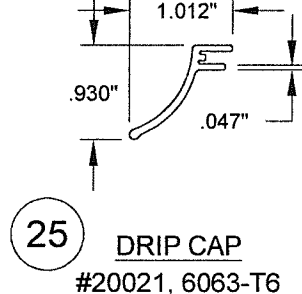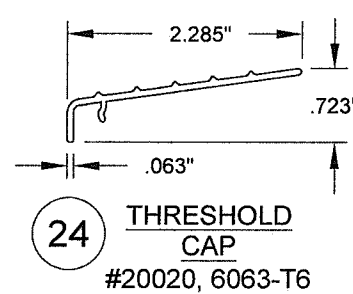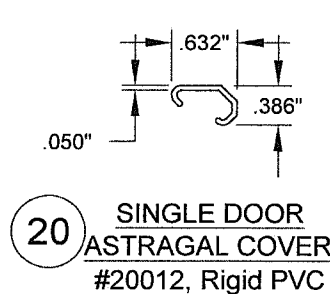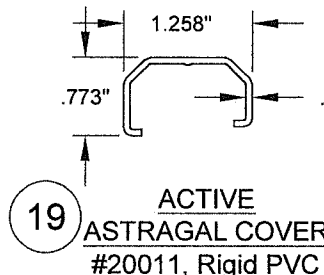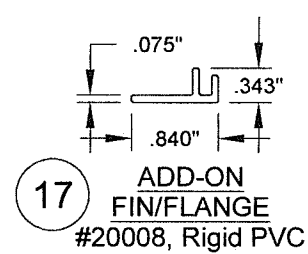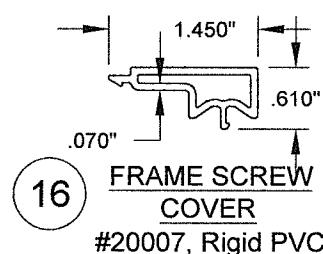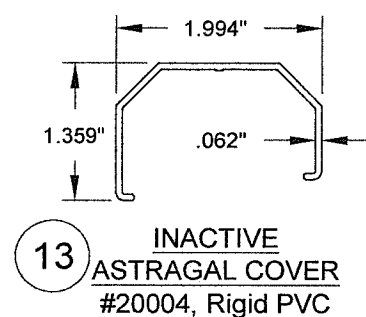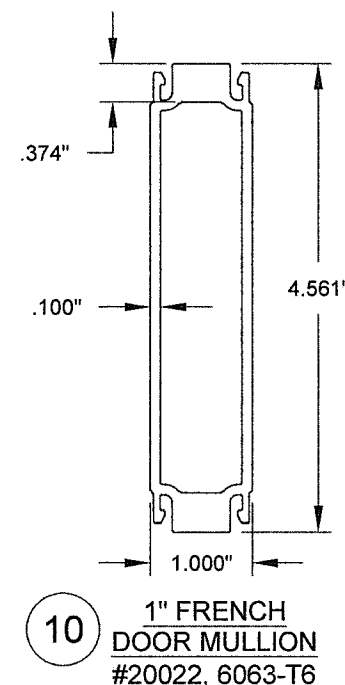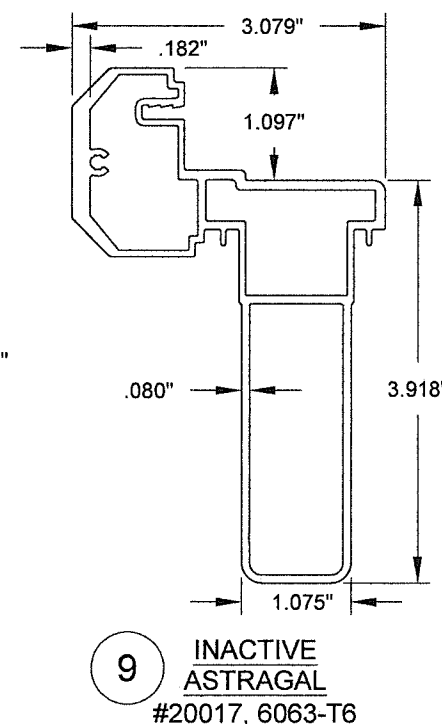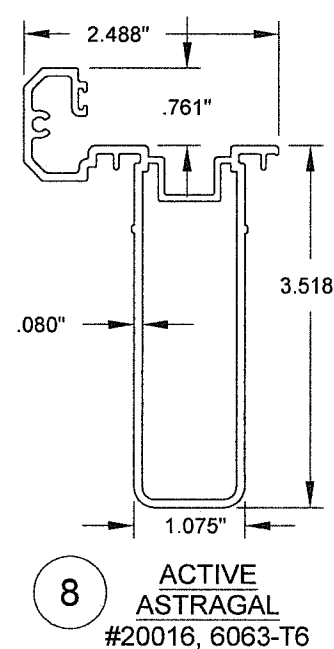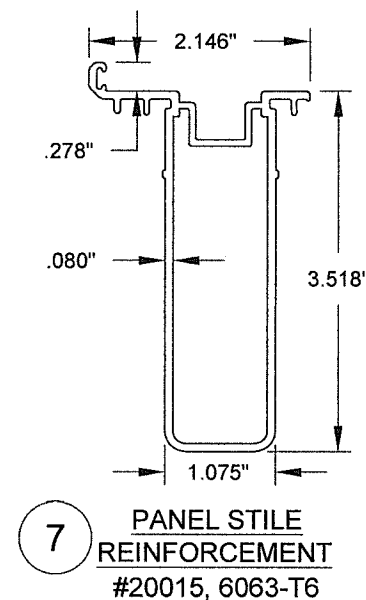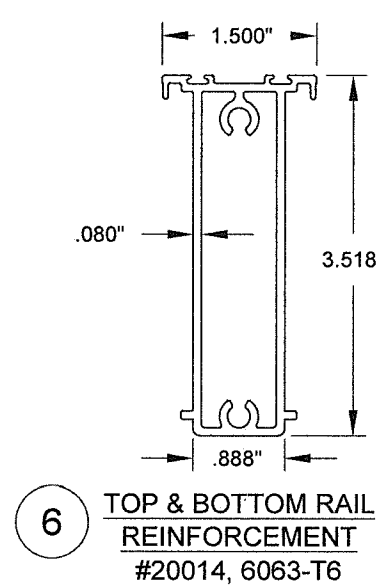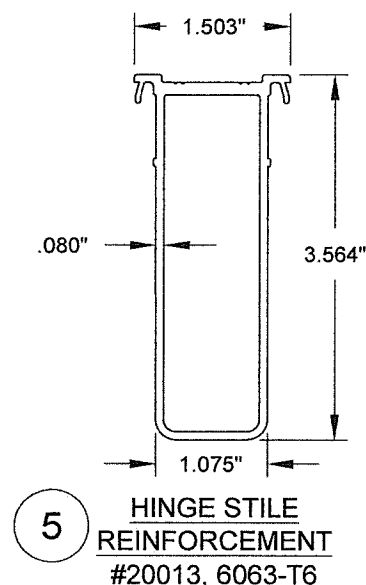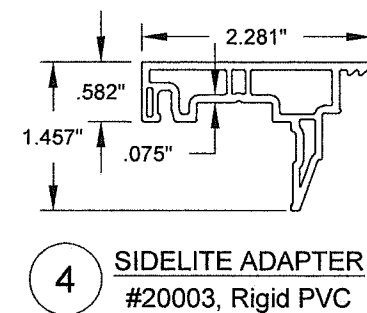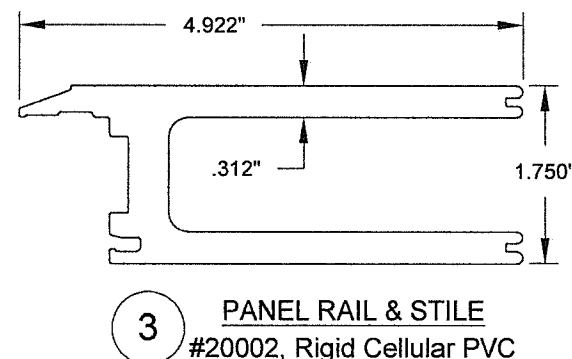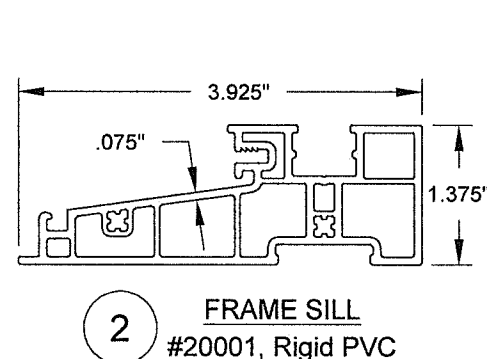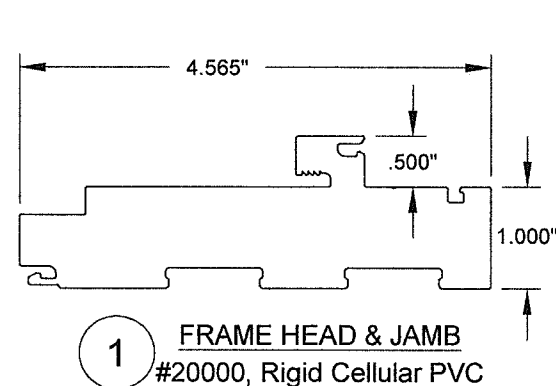


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Ishag I. Chande
Miami-Dade Product Control

Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20



1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941)-480-1600

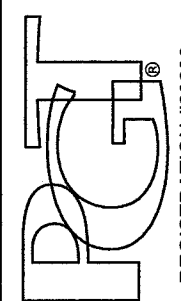

VINYL FRENCH DOOR AND SLT/TR	5/7/13	J ROSOWSKI	D
EXTRUSIONS	Date	By	Rev
FD-5455	10 OF 12	MD-455.1	D
Sheet	Scale	NTS	NTS

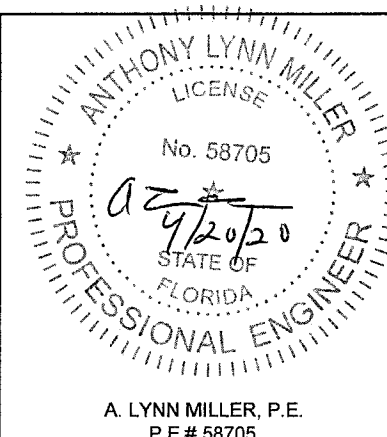

HARDWARE DETAILS & LOCATIONS

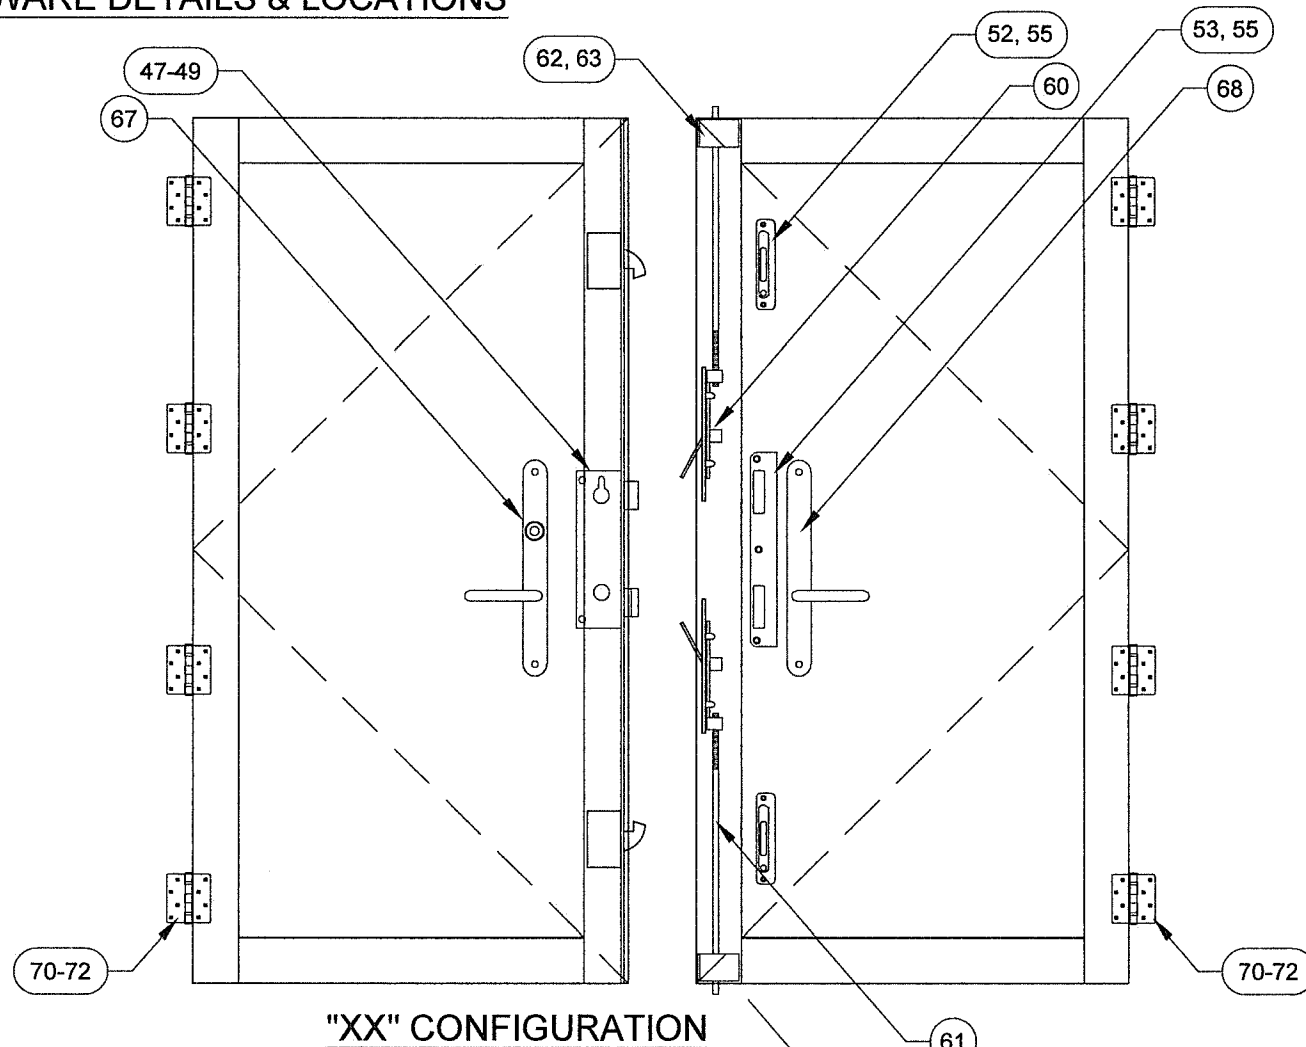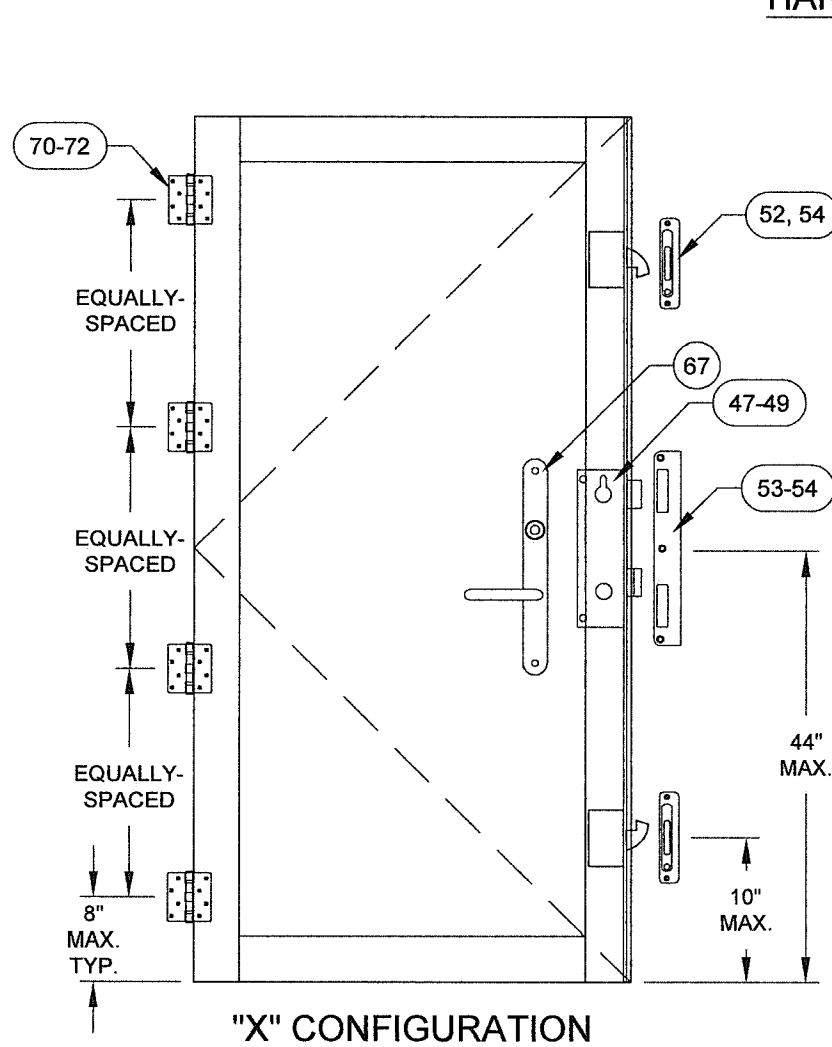


SEE DETAIL,
TOP LOCK
SIMILAR

TABLE 11:


#	PGT Part #	Description	Material
47	666032701	P3000 3-PT Rhino Lock (6'8"), Amesbury Inc.	Stainless Steel
48	666032702	P3000 3-PT Rhino Lock (over 6'8"), Amesbury Inc.	Stainless Steel
49	71032X1FPFX	Rhino Lock Screw: 10-32 X 1" Phil. FH	Stainless Steel
52	20027	Adjustable Strike Plate Assembly, Amesbury Inc.	Stainless Steel
53	20028	Center Strike Plate Assembly, Amesbury Inc.	Stainless Steel
54	7S101X	Strike Plate Screw, (X): #10 X 1" Phil. FH	410 S.S.
55	78X12PFHUX	Strike Plate Screw, (XX): #8 X 1/2" Phil. FH	410 S.S.
60	7SB1202	Flush Bolt (XX)	
61	7803725	Flush Bolt Rod (XX)	
62	420034	Flush Bolt Guide (XX)	
63	7832X12FPXP	Flush Bolt Guide Screw: 8-32 X 1/2" Phil. FH	
64	48033N	Guide Pin (XX)	
65	78036	Flush Bolt Strike Plate (XX), Amesbury Inc.	Stainless Steel
66	7832X12FPXP	Flush Bolt Strike Plate Screw, (XX): #8 X 3/4" Phil. FH	410 S.S.
67	varies	Handle/Lever	
68	varies	Dummy Handle/Lever	
70	20025	Butt Hinge, Amesbury Inc.	Stainless Steel
71	71032X1FPFX	Hinge, Slab Screw: #10-32 X 1" Phil FH	Stainless Steel
72	7S101X	Hinge, Frame Screw: #10 X 1" Phil. FH	Stainless Steel

HINGE DETAIL:

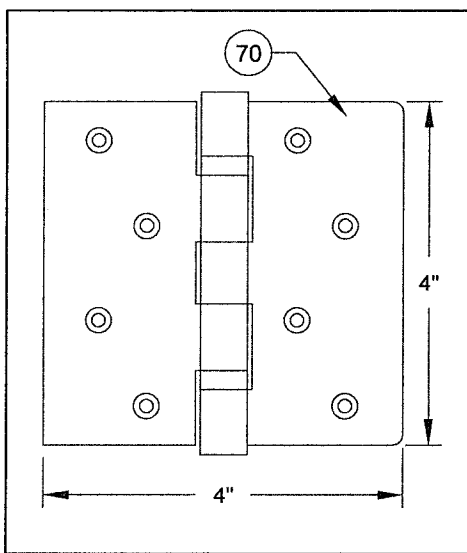


9/16"
BEYOND
PANEL


FLUSH BOLT DETAIL:

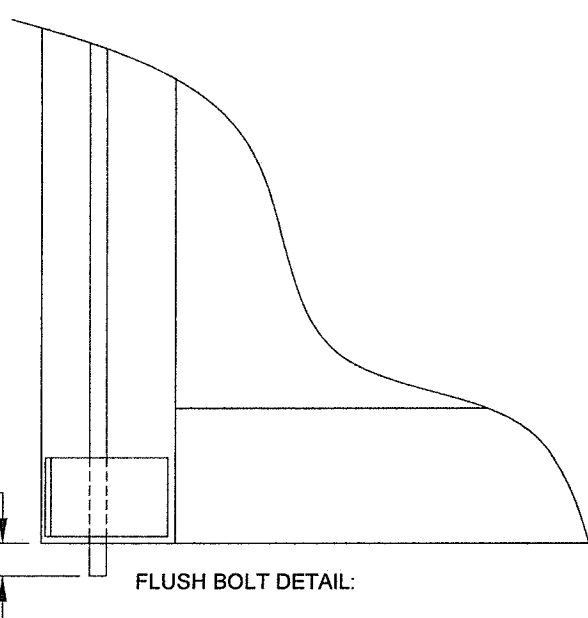

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0427.06**
Expiration Date: **01/23/2024**
By: Isaac L. Chan
Miami-Dade Product Control

Revision
D) NO CHANGES THIS SHEET.
AK - 4/9/20

1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941)-480-1600	Date	By J ROSOWSKI	DWG No.	Rev.	D
 REGISTRATION #29296	VINYL FRENCH DOOR AND SLT/TR	DESIGN PRESSURE TABLES 3	12 OF 12	NTS	MD-455.1
FD-5455	Scale	Sheet	12 OF 12	NTS	MD-455.1

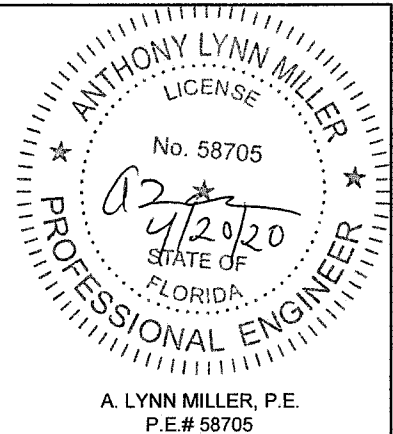

A. LYNN MILLER, P.E.
P.E.# 58705