

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Air Balance, a division of Mestek, Inc. 450 Riverside Drive Wyalusing, PA 18853

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model A520 5" Aluminum Louver System

APPROVAL DOCUMENT: Drawing No. **1686**, titled "A520 Impact Louver System", sheets 1 through 10 of 10, dated 07/23/2009, with revision C1 dated 03/14/2019, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren. W. Schaefer, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 19-0401.03** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.

MIAMI-DADE COUNTY
APPROVED

Hum

NOA No. 20-0622.24 Expiration Date: January 6, 2025 Approval Date: August 27, 2020 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 1. Evidence submitted under previous NOAs
- A. DRAWINGS "Submitted under NOA # 12-0105.02"
 - Drawing No. **1686**, titled "A-520 Impact Louver System", sheets 1 through 10 of 10, dated 07/23/2009, with revision A1 dated 11/08/2011, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.
- B. TESTS "Submitted under NOA # 09-1015.09"
 - 1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram, of "EA-52 Aluminum Louver Systems", prepared by Hurricane Test Laboratory, Inc., Report No. **0198-0305-09**, dated 09/29/2009, signed and sealed by Vinu J. Abraham, P.E.

- 2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram, of "EA-52 Aluminum Louver Systems", prepared by Hurricane Test Laboratory, Inc., Report No. **0198-0715-09**, dated 09/30/2009, signed and sealed by Vinu J. Abraham, P.E.

- C. CALCULATIONS "Submitted under NOA # 14-0513.09"
 - 1. Wood screw calculations prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 04/14/2014, signed and sealed by Warren W. Schaefer, P.E. "Submitted under NOA # 09-1015.09"
 - 2. Structural calculations prepared by W.W. Schaefer Engineering & Consulting, P.A., dated 10/06/2009, signed and sealed by Warren W. Schaefer, P.E.
- D. QUALITY ASSURANCE
 - 1. Miami-Dade Department of Regulatory and Economic Resources (RER)
- E. MATERIAL CERTIFICATIONS
 - 1. None.
- F. STATEMENTS "Submitted under NOA # 14-0513.09"
 - 1. Statement letter of code conformance to 2010 and 5th edition (2014) FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 04/14/2014, signed and sealed by Warren W. Schaefer, P.E.
 - 2. No financial interest letter issued by W. W. Schaefer Engineering & Consulting, P.A, dated 04/14/2014, signed and sealed by Warren W. Schaefer, P.E. "Submitted under NOA # 12-0105.02"

3. Private label agreement dated 12/21/2011.

Carlos M. Utrera, P.E. Product Control Examiner NOA No. 20-0622.24 Expiration Date: January 6, 2025

Approval Date: August 27, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. Evidence submitted under NOA # 17-0713.16

A. DRAWINGS

- 1. Drawing No. 1686, titled "A520 Impact Louver System", sheets 1 through 10 of 10, dated 07/23/2009, with revision B1 dated 07/05/2017, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.
- B. TESTS
 - 1. None.
- C. CALCULATIONS
 - 1. None.
- D. QUALITY ASSURANCE
 - 1. Miami-Dade Department of Regulatory and Economic Resources (RER)
- E. MATERIAL CERTIFICATIONS
 - 1. None.

F. STATEMENTS

- 1. Statement letter of code conformance to the 5th Edition (2014) and 6th Edition (2017) FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 07/05/2017, signed and sealed by Warren W. Schaefer, P.E.
- 2. Company name change request letter issued by W.W. Schaefer Engineering & Consulting, P.A., dated 07/05/2017, signed by Warren W. Schaefer, P.E.

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 20-0622.24
Expiration Date: January 6, 2025


Approval Date: August 27, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

- 3. New evidence submitted
- A. DRAWINGS "Submitted under NOA # 19-0401.03"
 - 1. Drawing No. 1686, titled "A520 Impact Louver System", sheets 1 through 10 of 10, dated 07/23/2009, with revision C1 dated 03/14/2019, prepared by W. W. Schaefer Engineering & Consulting, P.A., signed and sealed by Warren W. Schaefer, P.E.
- B. TESTS
 - 1. None.
- C. CALCULATIONS
 - 1. None.
- D. QUALITY ASSURANCE
 - 1. Miami-Dade Department of Regulatory and Economic Resources (RER)
- E. MATERIAL CERTIFICATIONS
 - 1. None.
- F. STATEMENTS
 - 1. Statement letter of code conformance to the 6th edition (2017) and 7th edition (2020) of the FBC issued by W. W. Schaefer Engineering & Consulting, P.A., dated 06/03/2020, signed and sealed by Warren W. Schaefer, P.E.
 - "Submitted under NOA # 19-0401.03"
 - 2. Statement letter of no financial interest issued by W. W. Schaefer Engineering & Consulting, P.A., dated 03/14/2019, signed and sealed by Warren W. Schaefer, P.E.

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 20-0622.24
Expiration Date: January 6, 2025

Approval Date: August 27, 2020

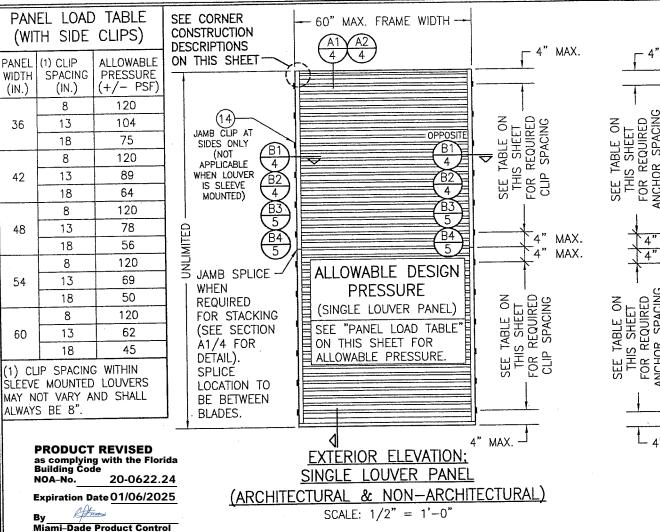

JAMB ANCHORS TO SUBSTRATE PER ANCHOR REQUIREMENTS TABLE ON SHEET 1. SEE ANCHOR SPACING TABLE ON THIS SHEET FOR SPACING & END DISTANCE. 4" MAX. 20(21) CONTINUOUS: SEE TABLE ON THIS SHEET FOR REQUIRED ANCHOR SPACING SUPPORT ANGLE $\overline{\nabla}$ 4. JAMB SPLICE WHEN REQUIRED FOR STACKING 4" MAX (SEE SECTION 4" MAX A1/4 FOR DETAIL). SPLICE LOCATION TO BE SEE TABLE ON THIS SHEET FOR REQUIRED ANCHOR SPACING BETWEEN BLADES. =LOUVER= -LOUVER (REF. FRAME ELEVATIONS ON SHEET 1 & 2) (33) - 4" MAX. SUPPORT ANGLE TO LOUVER FRAME CONNECTION SCREW. SEE ANCHOR SPACING TABLE ON THIS SHEET FOR SPACING & END DISTANCE.

INTERIOR ELEVATION; (OPTIONAL SIDE JAMB INSTALLATION WITH CONTINUOUS SIDE ANGLES)

SCALE: 1/2" = 1'-0" (FOR DETAIL NOT SHOWN, SEE OTHER ELEVATIONS)

HILTI KWIK-CON II (C.S OR S.S.). 2) WEDGE ANCHORS SHALL BE HILTI STAINLESS STEEL KWIK BOLT 3

(3) CMU IS APPLICABLE AT SIDES ONLY.

ANCHOR REQUIREMENTS TABLE				
OPENING TYPE (SUBSTRATE)	FRAME CLIP TO OPENING FASTENER TYPE		EDGE DIST.	
JAMB & NON-REI	JAMB & NON-REINFORCED MULLION END CLIP ANCHORS			
MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 14 SMS OR WOOD SCREW	1 3/8"	3/4"	
MIN. 16 GA. 33 KSI METAL STUD	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"	
MIN. 1/8" THK A36 STEEL	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"	
MIN. 1/8" THK 6063-T5 ALUM.	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"	
(3) MIN. C-90 CMU	(1) 1/4" CONCRETE SCREW	1 1/4"	2"	
MIN. 3000 PSI CONCRETE	(1) 1/4" CONCRETE SCREW	1 1/2"	2"	
TUBE MULLION END CLIP ANCHORS				
MIN. 2X_ WOOD FRAME OR BUCK (MIN. GR. 3 & G=0.55)	NO. 14 SMS OR WOOD SCREW	1 3/8"	3/4"	
MIN. 16 GA. 33 KSI METAL STUD	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"	
MIN. 1/8" THK A36 STEEL	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"	
MIN. 1/8" THK 6063-T5 ALUM.	1/4-14 GR. 5 SELF TAP/DRILL SCREW	FULL	1/2"	
3000 PSI CONCRETE	(2) 1/2" WEDGE ANCHOR	3 1/2"	3"	
(1) CONCRETE SCREWS SHALL BE	ELCO ULTRACONS (C.S.), ELCO CRETE-	FLEX (S.S	S.) OR	

(WITH CONTINUOUS SIDE SUPPORT ANGLE)				Pl		
ANGLE PANEL SUBSTRATE		IGLE TO ANGLE TO LOUVE			ALLOWABLE PRESSURE	
WIDTH (IN.)	SPACING (IN.)	END DIST. (IN.)	SPACING (IN.)	END DIST. (IN.)	(+/- PSF)	BY LAATE
	8	4	4	2	120	╟
36	13	7 1/2	7 1/2	3 3/4	104	1
	18	9	9	4 1/2	75	, Oltroid
	8	4	4	2	120	
42	13	7 1/2	7 1/2	3 3/4	89	H
	18	9	9	4 1/2	64	
	8"	4	4	2	120	ľ
48	13	7 1/2	7 1/2	3 3/4	78	ŀ
	18	9	9	4 1/2	56	╟
	8	4	4	2	120	۱
54	13	7 1/2	7 1/2	3 3/4	69	
	18	9	9	4 1/2	50	
	8	4	4	2	120	
60	13	7 1/2	7 1/2	3 3/4	62	1
	18	9	9	4 1/2	45	$\ $

PANEL ANCHOR SPACING/PRESSURE TABLE

NOTE: SINGLE LOUVER PANELS MAY BE STACKED/SPLICED VERTICALLY OR THE LOUVER PANEL MAY RUN VERTICALLY TO INFINITE HEIGHT PROVIDING OPENING IS PROPERLY DESIGNED BY OTHERS TO SUPPORT THE LOUVER PANELS.

SLEEVE SPLICING NOTE FOR SLEEVE MOUNTED LOUVERS: SLEEVE MAY BE SPLICED ALONG HORIZONTAL OR VERTICAL RUNS PROVIDING SPLICE DOES NOT OCCUR WITHIN 12" OF ANY VERTICAL MULLION CENTERLINE.

CORNER & BLADE END CONSTRUCTION:


FRAME HEAD: HORIZONTAL MEMBER IS SQUARE CUT, BUTTED TO VERTICAL MEMBERS & FASTENED WITH TWO(2) NO. 7 X 1 1/4" SMS HEX HEAD SCREWS INTO THE HORIZONTAL MEMBERS SCREW

FRAME SILL: VERTICAL MEMBERS ARE ANGLE CUT, BUTTED TO HORIZONTAL MEMBER & FASTENED WITH TWO(2) NO. 7 X 1 1/4" SMS SCREWS INTO THE VERTICAL MEMBERS SCREW SPLINES. BLADE END: HORIZONTAL BLADES ARE SQUARE CUT, BUTTED TO VERTICAL MEMBERS & FASTENED WITH TWO(2) NO. 7 OR NO. 8 X 1 1/4" SMS SCREWS INTO THE BLADE SCREW SPLINES.

PRODUCT RENEWED as complying with the Florida **Building Code** 19-0401.03 NOA-No.

Expiration Date 01/06/2025

(Theres Miami-Dade Product Control

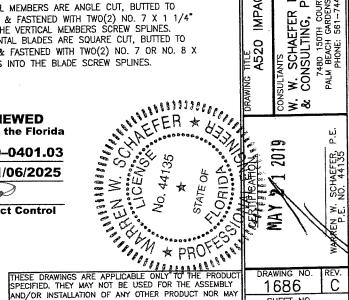

AND/OR INSTALLATION OF ANY OTHER PRODUCT NOR MAY THEY BE USED FOR RATIONAL AND/OR LOCAL APPROVAL OF ANY PRODUCT NOT PRODUCED BY THE MANUFACTURER STATED ON THESE DRAWINGS.

1686 SHEET NO. 10 1 OF

DATE: 07/23/09

E 2

S S

FR AIR BALANCE;
DIVISION OF MESTEK, INC
450 RIVERSIDE DRIVE
WYALUSING, PA 18853
570-746-1888

⋖

R ENGINEERING P.A. (CA 6809) URIN NORTH ENS. FL. 33418

SYSTEM

LOUVER

IMPACT

TITLE A520

1×24

THOSE SHOWN IN THE "ALLOWABLE DESIGN PRESSURE TABLE(S).

2. OPENINGS, BUCKING & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER WIND LOADS TO THE STRUCTURE. IT SHALL BE THE RESPONSIBILITY OF THE PERMIT HOLDER TO VERIFY THE STRUCTURAL

GENERAL NOTES:

1. THESE LOUVER SYSTEMS HAVE BEEN TESTED, ANALYZED & APPROVED FOR DESIGN PRESSURES NOT TO EXCEED

INTEGRITY OF THE EXISTING STRUCTURE TO SUPPORT THE LOADS SUPERIMPOSED BY THE LOUVERS. 3. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & SHALL NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS. SPECIFIED ANCHOR EMBED TO BASE MATERIAL SHALL BE BEYOND WALL

4. THE DETAILS & SPECIFICATIONS SHOWN HEREIN REPRESENT THE PRODUCTS TESTED & PROPOSED FOR IMPACT, CYCLIC & UNIFORM STATIC AIR PRESSURE TESTING IN CONFORMANCE WITH THE FLORIDA BUILDING CODE PROTOCALS TAS-201, 202 & 203 FOR LARGE MISSILE IMPACT LOUVERS.

5. THESE LOUVER SYSTEMS HAVE BEEN DESIGNED IN ACCORDANCE WITH AND MEET THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (FBC) INCLUDING HIGH VELOCITY HURRICANE ZONES (HVHZ).

6. IMPACT SHUTTERS ARE NOT REQUIRED WITH THESE LOUVER SYSTEMS.

ALL ANCHORS SECURING LOUVER FRAME TO PRESSURE TREATED BUCKS OR WOOD FRAMING SHALL BE CAPABLE OF

RESISTING CORROSION CAUSED BY THE PRESSURE TREATING CHEMICALS IN THE WOOD. 8. DETERMINE THE POSITIVE & NEGATIVE DESIGN LOADS TO USE WHEN REFERENCING THESE DOCUMENTS IN

ACCORDANCE WITH THE GOVERNING CODE AND GOVERNING WIND VELOCITY. FOR WIND LOAD CALCULATIONS IN ACCORDANCE WITH THE FLORIDA BUILDING CODE, A DIRECTIONALITY FACTOR OF Kd = 0.85 MAY BE APPLIED PER THE

9. NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE CERTIFICATION OF THIS PRODUCT. WIND LOAD

DURATION FACTOR Cd = 1.6 WAS USED FOR WOOD SCREW ANALYSIS ONLY.

10. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF FLORIDA BUILDING CODE CHAPTER 20. 11. EACH LOUVER ASSEMBLY SHALL BE PERMANENTLY LABELED AS FOLLOWS:

AIR BALANCE INC.

WYALLISING PA

MIAMI-DADE COUNTY PRODUCT CONTROL APPROVED


12. THESE LOUVERS ARE NOT TESTED FOR WATER INFILTRATION RESISTANCE, THEREFORE THE LOUVERS ARE TO BE INSTALLED IN A LOCATION WHERE THE ROOM BEHIND THE LOUVER IS DESIGNED TO DRAIN WATER PENETRATING INTO THE ROOM, AND THE ROOM WILL HOUSE WATER RESISTANT/WATER PROOF EQUIPMENT, COMPONENTS OR SUPPLIES. 13. MULLED PANELS MAY BE HORIZONTALLY INSTALLED TO AN UNLIMITED NUMBER. VERTICAL STACKING OF MULLED PANELS MAY OCCUR PROVIDING A STRUCTURAL SUPPORT IS DESIGNED & INSTALLED BY OTHERS TO SUPPORT ALL LOADS TRANSFERED FROM THE LOUVER ASSEMBLY (SINGLE PANELS MAY RUN TO UNLIMITED HEIGHT PER ELEVATION IF NO MULLION EXISTS)

•	(N	ON-ARCHITEC	TURAL LOUVERS	S) .
MAXIMUM MULLION	MAXIMUM LOAD	ALLOWABLE PRESSURE (+/- PSF)		
SPAN (IN.)	WIDTH (IN.)	WITH NO TUBE MULLION	WITH 4"X3"X3/16" TUBE MULLION	TUBE MULLION
	60	30.6	46.1	61.4
	54	34.0	51.2	68.3
•	48	38.3	57.6	76.8
400	42	43.7	65.8	87.8
120	36	51.0	76.8	102.4
	30	61.2	92.2	120.0
	24	76.5	115.2	120.0
	18	102.0	120.0	120.0
	60	42.0	63.2	84.3
	54	46.6	70.2	93.6
	48	52.5	79.0	105.3
108	42	60.0	90.3	120.0
	36	70.0	105.3	120.0
	30	84.0	120.0	120.0
	24	104.9	120.0	120.0
	18	120.0	120.0	120.0
	60	56.3	90.0	120.0
	54	62.5	100.0	120.0
	48	70.3	112.5	120.0
96	42	80.4	120.0	120.0
	36	93.8	120.0	120.0
	30	112.5	120.0	120.0
	24	120.0	120.0	120.0
	60	64.3	120.0	120.0
	54	71.4	120.0	120.0
	48	80.4	120.0	120.0
84	42	91.8	120.0	120.0
	36	107.1	120.0	120.0
<i>t</i>	30	120.0	. 120.0	120.0
	60	75.0	120.0	120.0
	54	83.3	120.0	120.0
	48	93.8	120.0	120.0
72	42	107.1	120.0	120.0
	36	120.0	120.0	120.0
	60	90.0	120.0	120.0
60	54	100.0	120.0	120.0
	48	112.5	120.0	120.0
	42	120.0	120.0	120.0
	60	112.5	120.0	120.0
48	54	120.0	120.0	120.0
42	60	120.0	120.0	120.0

MULLION ALLOWABLE DESIGN PRESSURE

NOTES: 1. SEE ELEVATION FOR DIMENSIONING OF LOAD WIDTH.

2. ALLOWABLE UNIT PRESSURE SHALL BE THE LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT SPECIFIED FOR THE INDIVIDUAL LOUVER PANEL.

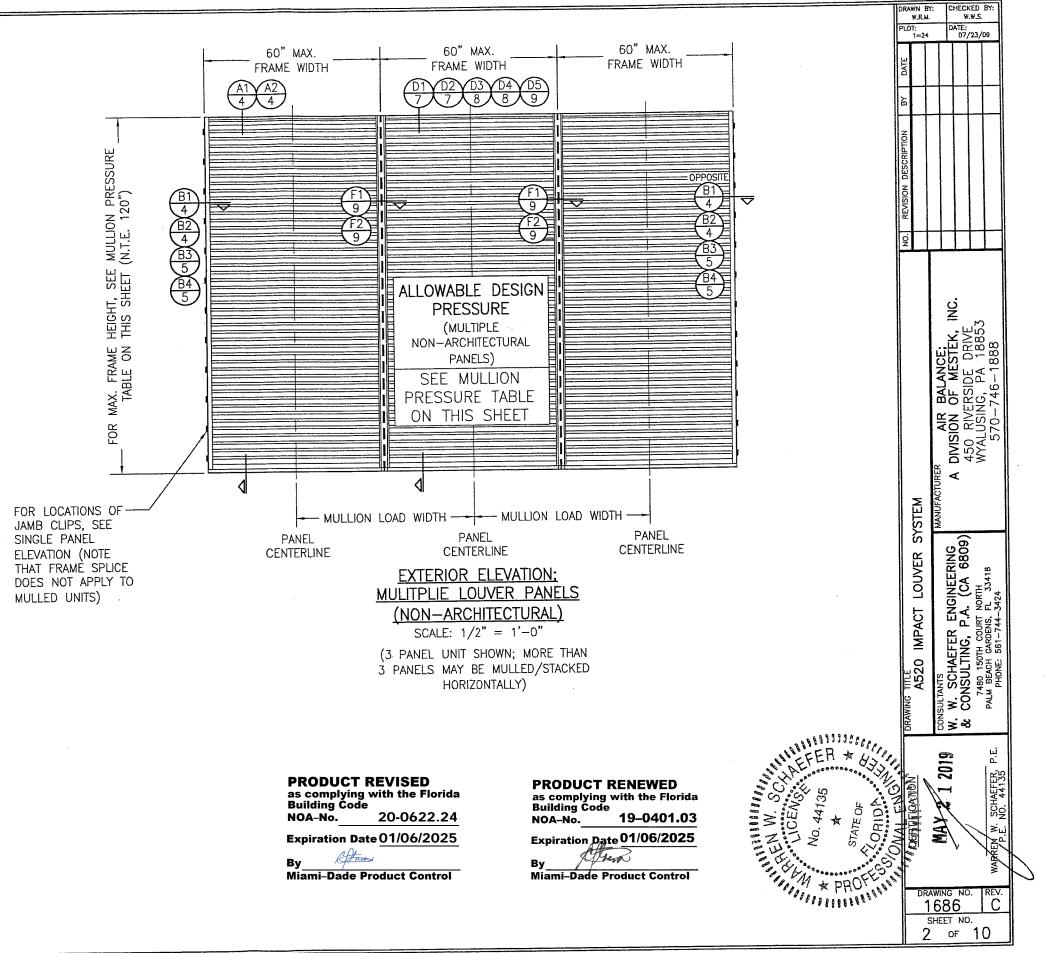


MULLION ALLOWABLE DESIGN PRESSURE (ARCHITECTURAL LOUVERS)

MAXIMUM MULLION SPAN (IN.)	MAXIMUM LOAD WIDTH (IN.)	ALLOWABLE PRESSURE (+/- PSF)
120	60	61.4
	54	68.3
	48	76.8
	42	87.8
	36	102.4
	30	120.0
108	60	84.3
	54	93.6
	48	105.3
	42	120.0
96	60	120.0

I. SEE ELEVATION FOR DIMENSIONING OF LOAD WIDTH.

2. ALLOWABLE UNIT PRESSURE SHALL BE THE LESSER OF THE PRESSURE SHOWN IN THIS TABLE & THAT SPECIFIED FOR THE INDIVIDUAL LOUVER PANEL.

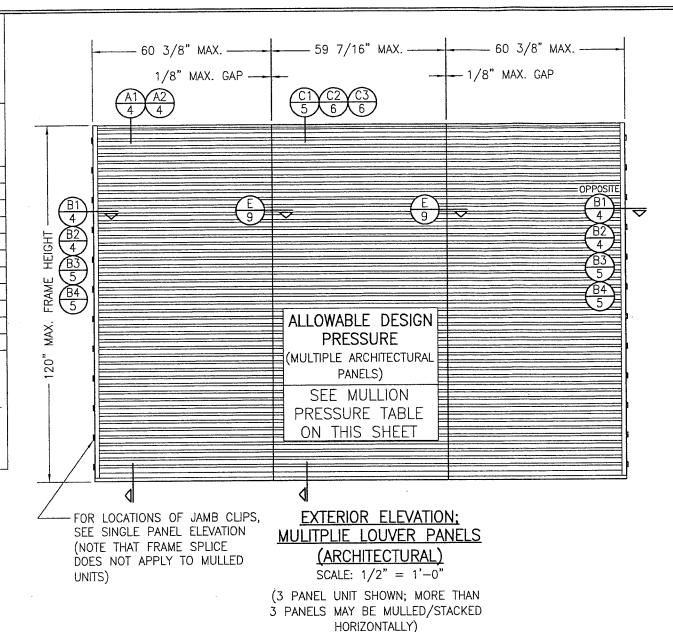

PRODUCT REVISED as complying with the Florida Building Code 20-0622.24 NOA-No.


Expiration Date 01/06/2025

Miami-Dade Product Control

PRODUCT RENEWED as complying with the Florida Building Code 19-0401.03 NOA-No.

Expiration Date 01/06/2025

Mun Miami-Dade Product Control



	MANUFACTURER A DIVISION OF MESTEK, INC. 450 RIVERSIDE DRIVE WYALUSING, PA 18853 570-746-1888
ASZO IMPACI LOUVER SISIEM	CONSULTANTS W. W. SCHAEFER ENGINEERING & CONSULTING, P.A. (CA 6809) 7480 150TH COURT NORTH PALM BEACH GARDENS, FL 33418 PHONE: 581-744-3424
	2 1 2019 SCHAEFER P.E.

OT: 1=24

D7/23/09

1686 SHEET NO. 3 of 10

