



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, FL 33175
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

WinDoor, Inc.
104 Triple Diamond Blvd.
North Venice, FL 34275

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "360" Aluminum Single Hung Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. SH360LM-NOA, titled Series "360" Alum Single Hung WDW. (L.M.I./S.M.I.), sheets 1 through 14 of 14, dated 01/10/20, prepared by manufacturer, signed and sealed by Lynn Miller, P.E., bearing the Miami-Dade County Product Control **Revision** stamp with the Notice of Acceptance number and **expiration** date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises** # 20-0213.05 PLA consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Sifang Zhao, P.E.



S.Z.

11/05/2020

NOA No. 20-0722.20
Expiration Date: May 05, 2025
Approval Date: November 05, 2020
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Manufacturer's die drawings and sections (*See NOA #20-0722.13*)
2. Drawing No. **SH360LM-NOA**, titled Series "360" Alum Single Hung WDW. (L.M.I./S.M.I.), sheets 1 through 14 of 14, dated 01/10/20, prepared by the manufacturer, signed and sealed by Lynn Miller, P.E.

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Forced Entry Test, per ASTM F588 and TAS 202-94

along with marked-up drawings and installation diagram of all PGT Industries, Inc. CGI Windows and Doors, Inc., representative units listed below and tested to qualify **Dowsil 791** and **Dowsil 983** silicones, per Proposal #**19-1155TP**, prepared by Fenestration Testing Laboratory, Inc., Test Reports No.:

PGT Industries, Inc. test specimens:

FTL-7897, PGT PW5520 PVC Fixed Window (unit 6 in proposal), dated 09/03/14
FTL-20-2107.1, PGT SGD780 Aluminum Sliding Glass Door (unit 7 in proposal)
FTL-20-2107.2, PGT CA740 Alum. Outswing Casement Window (unit 8 in proposal)
FTL-20-2107.3, PGT PW7620A Aluminum Fixed Window (unit 9 in proposal) and
FTL-20-2107.4, PGT PW7620A Aluminum Fixed Window (unit 10 in proposal)
all dated 07/13/20 and signed and sealed by Idalmis Ortega, P.E.

CGI Windows and Doors Inc. test specimens:

FTL-20-2108.1, CGI SH360 Aluminum Single Hung Window (unit 1 in proposal)
FTL-20-2108.2, CGI CA238 Alum. Outswing Casement Window (unit 2 in proposal)
FTL-20-2108.3, CGI SGD560 Aluminum Sliding Glass Door (unit 3 in proposal)
FTL-20-2108.4, CGI PW410 Aluminum Fixed Window (unit 4 in proposal) and
FTL-20-2108.5, CGI SH360 Aluminum Single Hung Window (unit 5 in proposal)
all dated 08/24/20 and signed and sealed by Idalmis Ortega, P.E.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with **FBC 7th Edition (2020)**, dated 06/30/20, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)



Sifang Zhao, P.E.
Product Control Examiner
NOA No. 20-0722.20

Expiration Date: May 05, 2025
Approval Date: November 05, 2020

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **18-0725.11** issued to **Kuraray America, Inc.** for their “**Kuraray SentryGlas® Xtra™ (SGX™) Clear Glass Interlayer**” dated 05/23/19, expiring on 05/23/24.
2. Notice of Acceptance No. **19-0305.02** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**” dated 05/09/19, expiring on 07/08/24.
3. Notice of Acceptance No. **20-0622.03** issued to **Eastman Chemical Company (MA)** for their “**Saflex Storm - Saflex and Saflex HP Composite Glass Interlayers with PET Core**” dated 08/06/20, expiring on 12/11/23.
4. Notice of Acceptance No. **20-0622.02** issued to **Eastman Chemical Company (MA)** for their “**Saflex HP Clear or Color Glass Interlayers**” dated 08/06/20, expiring on 04/14/23.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)** and the **FBC 7th Edition (2020)**, dated June 30, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
2. Statement letter of no financial interest, dated June 30, 2020, issued by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.
3. Proposal No. **19-1155 TP** issued by the Product Control Section, dated January 10, 2020, signed by Ishaq Chanda, P.E.


G. OTHERS

1. Private labeling agreement between WinDoor, Inc. and CGI Windows and Doors, Inc. document in conformance of RER guideline dated 09/12/2018.
(Submitted under NOA #18-1001.19)
2. Notice of Acceptance No. **20-0213.05**, issued to WinDoor, Inc. for their Series “360” Aluminum Single Hung Window – L.M.I., approved on 03/05/2020 and expiring on 05/05/2025.
3. Notice of Acceptance No. **20-0722.13**, issued to CGI Windows and Doors, Inc. for their Series “360” Aluminum Single Hung Window – L.M.I., approved on 10/08/2020 and expiring on 05/05/2020.



Sifang Zhao, P.E.
Product Control Examiner
NOA No. 20-0722.20
Expiration Date: May 05, 2025
Approval Date: November 05, 2020

General Window Sections

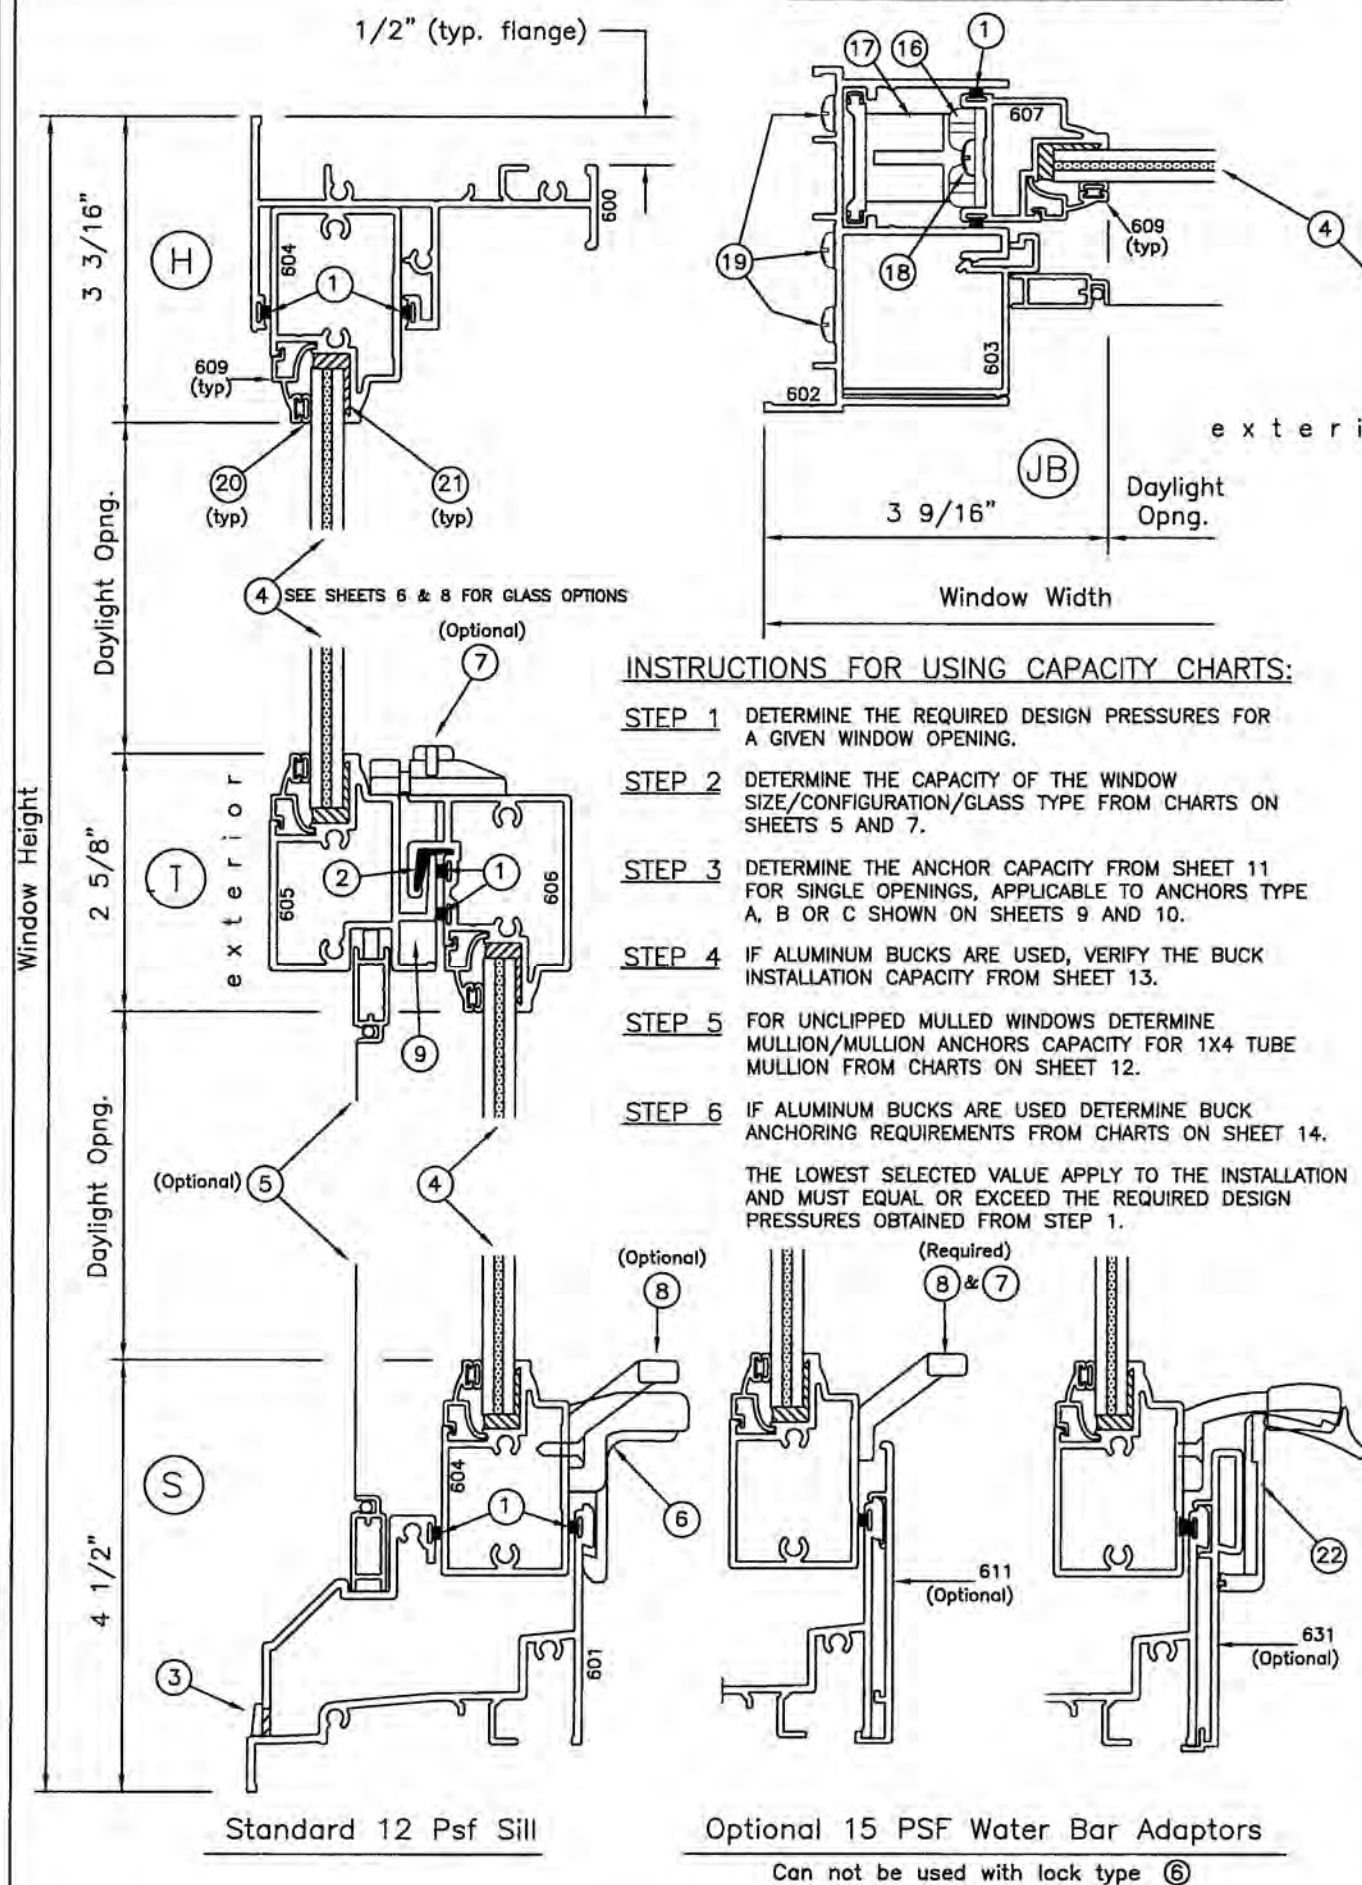

INSTRUCTIONS FOR USING CAPACITY CHARTS:

- STEP 1 DETERMINE THE REQUIRED DESIGN PRESSURES FOR A GIVEN WINDOW OPENING.
 - STEP 2 DETERMINE THE CAPACITY OF THE WINDOW SIZE/CONFIGURATION/GLASS TYPE FROM CHARTS ON SHEETS 5 AND 7.
 - STEP 3 DETERMINE THE ANCHOR CAPACITY FROM SHEET 11 FOR SINGLE OPENINGS, APPLICABLE TO ANCHORS TYPE A, B OR C SHOWN ON SHEETS 9 AND 10.
 - STEP 4 IF ALUMINUM BUCKS ARE USED, VERIFY THE BUCK INSTALLATION CAPACITY FROM SHEET 13.
 - STEP 5 FOR UNCLIPPED MULLED WINDOWS DETERMINE MULLION/MULLION ANCHORS CAPACITY FOR 1X4 TUBE MULLION FROM CHARTS ON SHEET 12.
 - STEP 6 IF ALUMINUM BUCKS ARE USED DETERMINE BUCK ANCHORING REQUIREMENTS FROM CHARTS ON SHEET 14.
- THE LOWEST SELECTED VALUE APPLY TO THE INSTALLATION AND MUST EQUAL OR EXCEED THE REQUIRED DESIGN PRESSURES OBTAINED FROM STEP 1.

SERIES '360' ALUMINUM SINGLE HUNG WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF S.H./S.H. OR SINGLE HUNG WITH OTHER MIAMI-DADE COUNTY APPROVED WINDOWS USING MIAMI-DADE COUNTY APPROVED MULLIONS IN BETWEEN. LOWER DESIGN PRESSURE FROM WINDOWS OR MULLION APPROVAL WILL APPLY TO ENTIRE SYSTEM.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2017 (6TH EDITION)/2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

1BY OR 2BY WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY. ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2017/2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS. THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, I.E. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL

FRAME AND VENT DETAILS FOR GLASS TYPES 1 & 2. SEE SHEETS 5 & 7 FOR CAPACITIES.

THESE WINDOWS ARE RATED FOR LARGE & SMALL MISSILE IMPACT. SHUTTERS ARE NOT REQUIRED.

Installation Screws
(Refer to sheets
9, 10 & 11 for
spacing information)

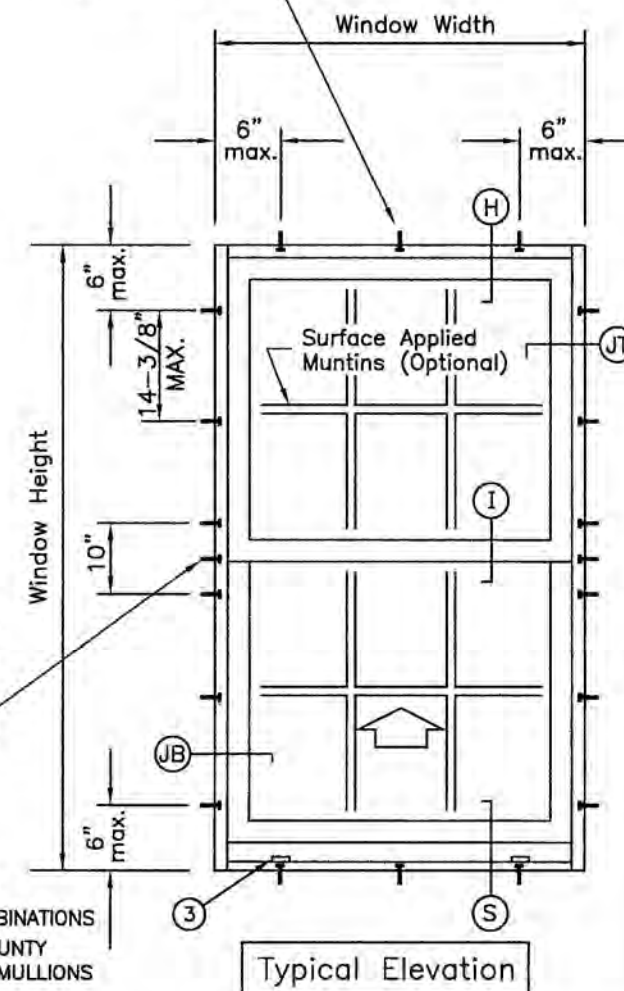


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By **Miami-Dade Product Control**


A) UPDATED TO FBC 2020.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296	DATE 1/10/2020	BY ALAN KINNE	DWG SH360LM-NOA	Rev. A
WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432	SERIES '360' ALUM SINGLE HUNG WDW (LM/SMI)	SECTIONS/INSTRUCTIONS	1 OF 14	SH360



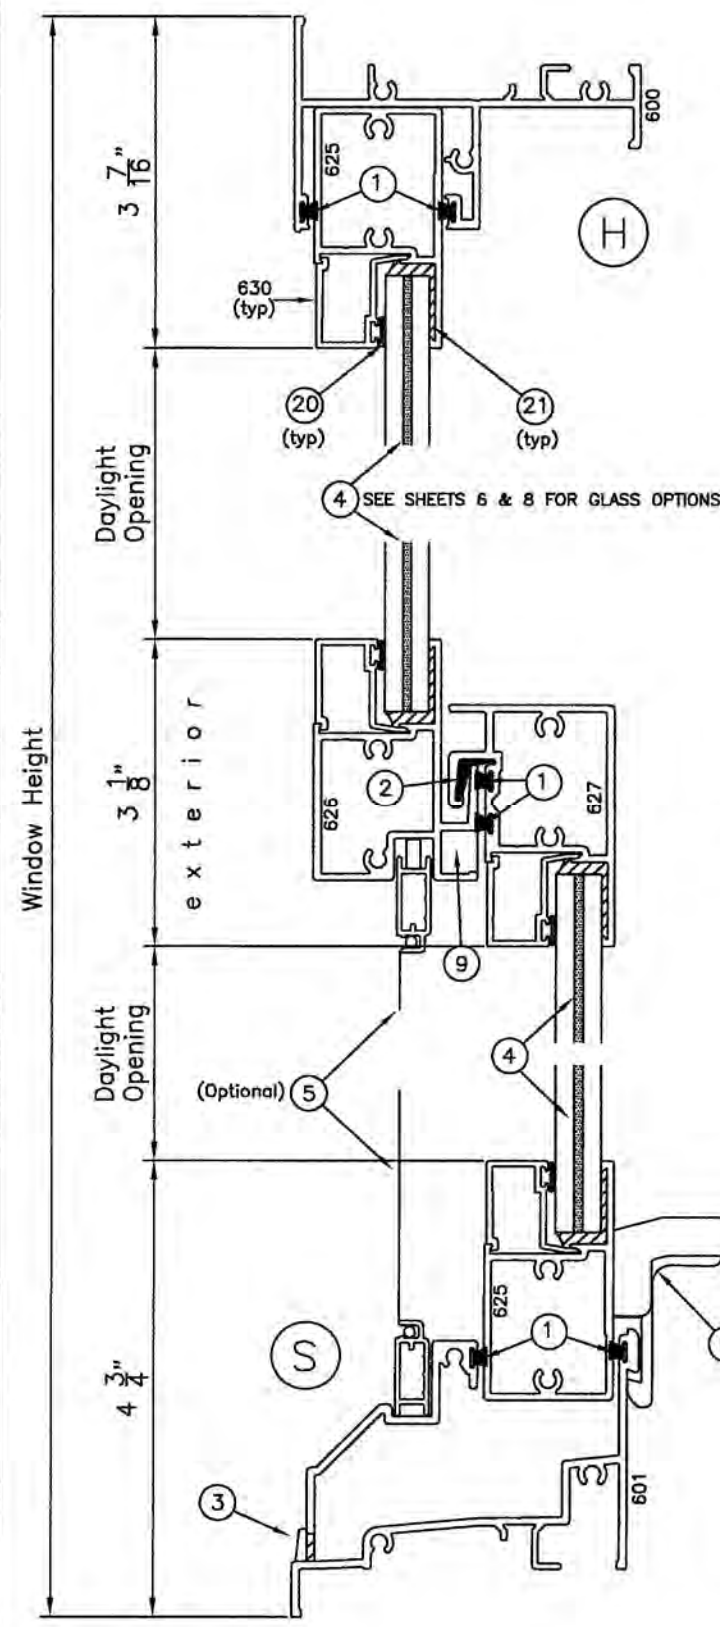


Standard 12 Psf Sill

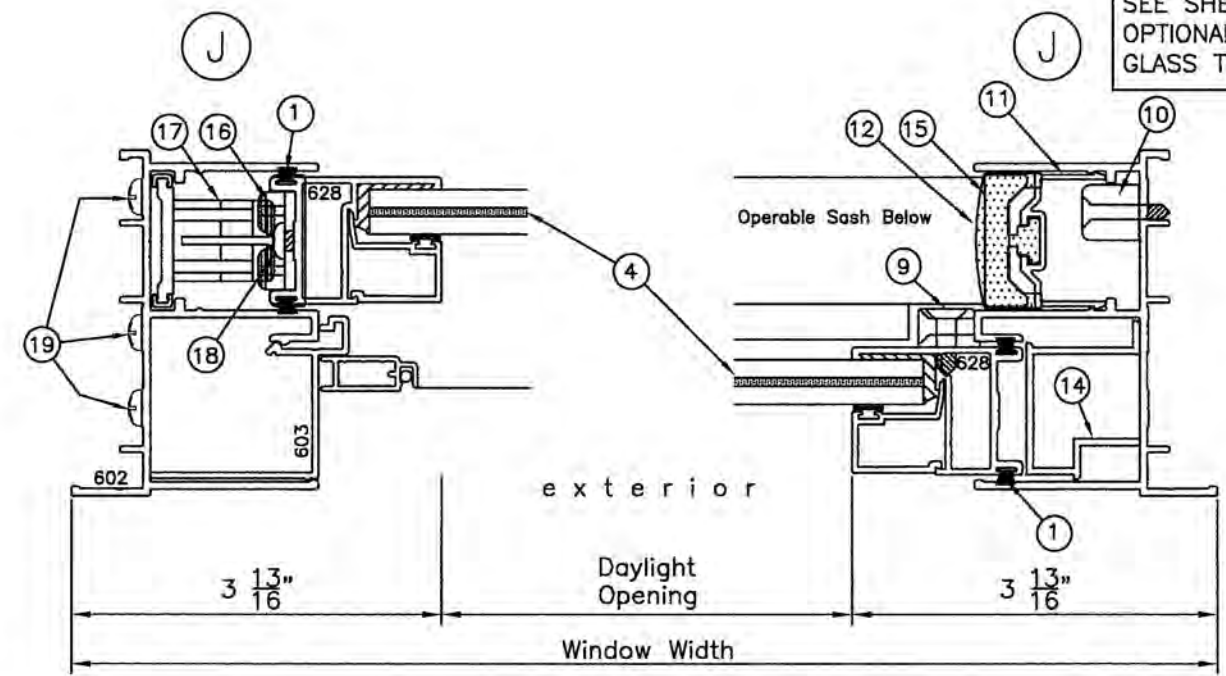

FRAME AND VENT DETAILS FOR GLASS TYPES 3, 3A, 4 AND 4A.
SEE SHEETS 6 & 8 FOR CAPACITIES.
OPTIONAL TOP RAIL SWEEP LOCK NOT AVAILABLE WITH THESE GLASS TYPES.

Installation Screws
(Refer to sheets
9, 10 & 11 for
spacing information)

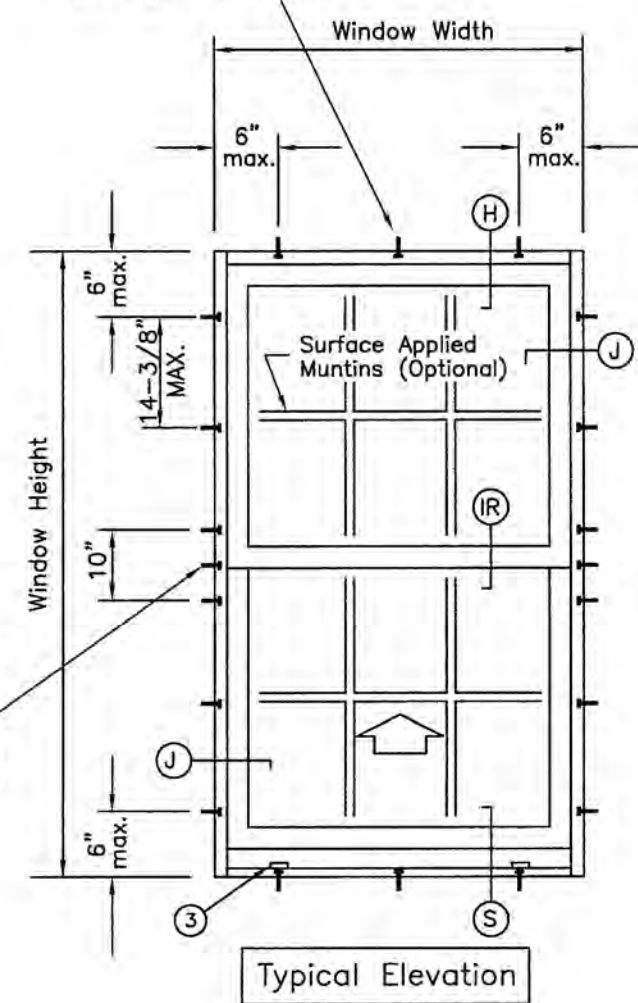


Typical Elevation



Glazing at Insulated Laminated

Addl. Anchor
At Mtg. Stile Ends
Reqd. For Higher Loads
(if Applicable)
See Chart On Sheet 11
For Capacity

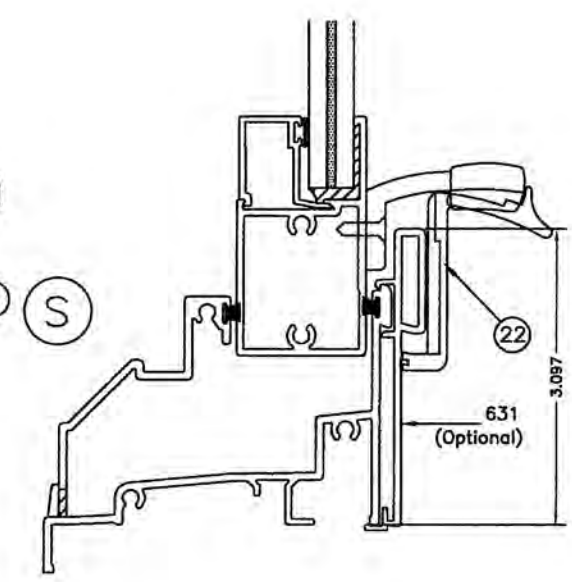


Optional 15 PSF Water Bar Adaptor
Can not be used with lock type ⑥

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By **Miami-Dade Product Control**

Revision: A) NO CHANGES THIS SHEET.
AK - 06/29/20

WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432	PREPARED BY A LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296		1/10/2020 Date By ALAN KINNE SH360LM-NOA Rev. A	
	SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)		2 OF 14 Sheet	
	SECTIONS SH360		DWG No.	
	104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		1/10/2020 Date	

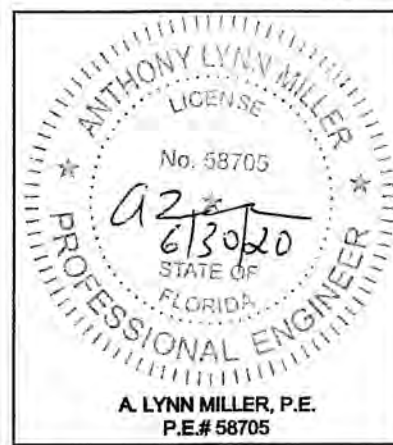


Bill of Materials


ITEM	PART #	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER	REMARKS
1	W23201NG	AS REQD.	WOOL PILE WITH CENTER SOFT FIN (GRAY)	PILE	ULTRAFAB/SCHLEGEL	
2	CGI-612P	AS REQD.	PLASTIC BUMPER GUIDE	PVC	PROTOTYPE PLASTIC EXTRUSIONS	CONTINUOUS AT INTERLOCK
3	#146-4	2	WEEP HOLE COVER	NYLON	BUILDERS PLASTIC COMPANY	
4	N/A	AS REQD.	GLAZING	GLASS	VARIES	
5	N/A	1	COMPLETE SCREEN	ALUM/MESH		
6	CGI-615C & 616C	1 OR 2	COMBINATION EGRESS LOCK AND LIFT/PULL ATTACHED W/(2) #8 X 5/8" FH SMS	ZINC	CUSTOM CASTING	1 @ WDWS. 28" WIDE & SMALLER 2 @ WDWS. OVER 28" WIDE
7	A30700 & C30705	1 OR 2	OPTIONAL SWEEP LOCK & KEEPER (replaces item 6) ATTACHED W/(4) #6 X 5/8" FH SMS	ZINC	TRUTH HARDWARE OR EQUIV.	1 @ WDWS. 28" WIDE & SMALLER 2 @ WDWS. OVER 28" WIDE
8	18-11-XX-100	1 OR 2	LIFT/PULL	ZINC	TRUTH HARDWARE OF EQUIV.	1 @ WDWS. 28" WIDE & SMALLER 2 @ WDWS. OVER 28" WIDE
9	CGI-614C	2	TIE DOWN BLOCK	ZINC	CUSTOM CASTING	
10	VARIES	2	BALANCES (B&T OR SPIRAL)	VARIES	VARIES	BOTH BALANCES CAN BE USED
11	CGI-617P	2	BALANCE COVER	PVC	PROTOTYPE PLASTIC EXTRUSIONS	LOCATED AT TOP HALF OF EACH JAMB
12	CGI-618P	2	VENT STOP	PVC	PROTOTYPE PLASTIC EXTRUSIONS	LOCATED AT TOP OF JAMBS
14	CGI-613P	2	FIXED VENT SHIM	PVC	PROTOTYPE PLASTIC EXTRUSIONS	LOCATED AT TOP OF FIXED VENT
15	CGI-619P	2	TOP GUIDE AT OPERABLE VENT	NYLON	CUSTOM CASTING	
16	CGI-622N	2	BOTTOM GUIDE/CLIP AT OPERABLE VENT	NYLON	CUSTOM CASTING	
17	CGI-620C & 621N	2	CARRIER SYSTEM	ZINC	CUSTOM CASTING	OPTIONAL - BALANCE ATTACHES TO IT
18	N/A	16	VENT ASSEMBLY SCREWS	S/S	VARIES	#10 X 1 1/4" PH SMS (2 PER CORNER)
19	N/A	12	FRAME ASSEMBLY SCREWS	S/S	VARIES	#10 X 1 1/4" PH SMS (2 PER CORNER)
20	CGI-382V	AS REQD.	VINYL BULB	PVC	PROTOTYPE PLASTIC EXTRUSIONS	
21	VARIES	AS REQD.	STUCTURAL SILICONE	SILICONE	3 SILICONES	GE-1200, GE-2000, & DOW 995
22	CGI-632	1 OR 2	COMBINATION EGRESS WB LOCK & LIFT/PULL ATTACHED W/(2) #8 X 5/8" FH SMS	ZINC	CUSTOM CASTING (FOR USE WITH WATERBAR)	1 @ WDWS. 28" WIDE & SMALLER 2 @ WDWS. OVER 28" WIDE
23	-	2/ LITE	SETTING BLOCKS	EPDM	-	DUROMETER 85±5 SHORE A

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By 
Miami-Dade Product Control


Revision: A) NO CHANGES THIS SHEET.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	REGISTRATION #29296	Date	1/10/2020
		Drawn By	ALAN KINNE
		DWG No.	SH360LM-NOA
		Sheet	3 OF 14
WinDoor® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (888) 554-5432		SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)	
BILL OF MATERIALS		SH360	

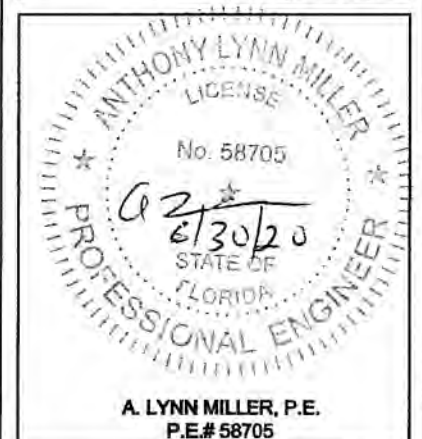


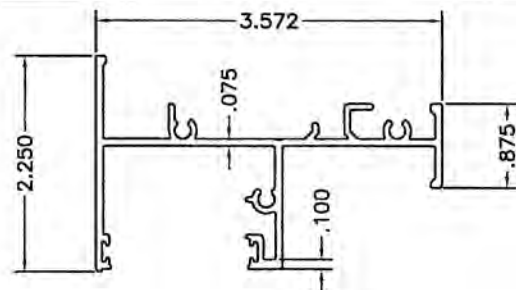


600-Frame Head
6063-T6

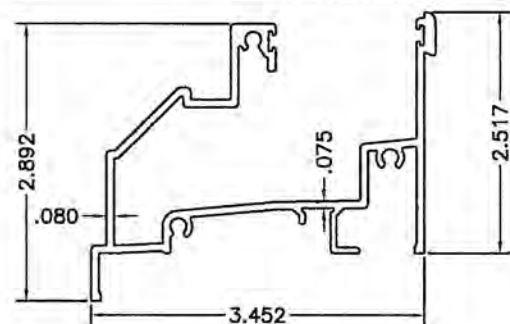


601-Frame Sill
6063-T6

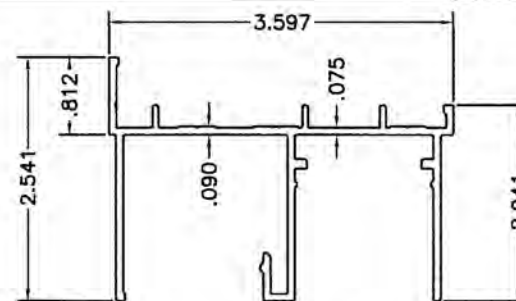


602-Frame Jamb
6063-T6




604-Horiz. Rail
6063-T6




605-Fixed Intlck.
6063-T6



606-Moving Intlck.
6063-T6




607-Side Rail
6063-T6




609-Glzg. Bead
6063-T5


VENT SHAPES FOR GLASS TYPES 1 & 2

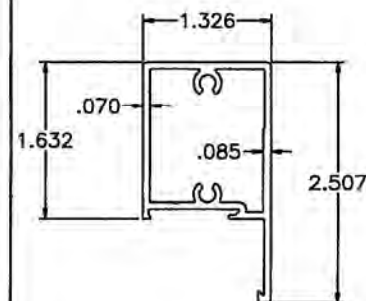


625-Horiz. Rail
6063-T6

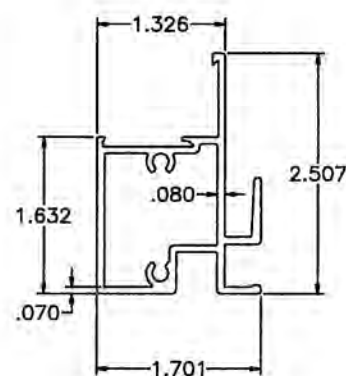


626-Fixed Intlck.
6063-T6

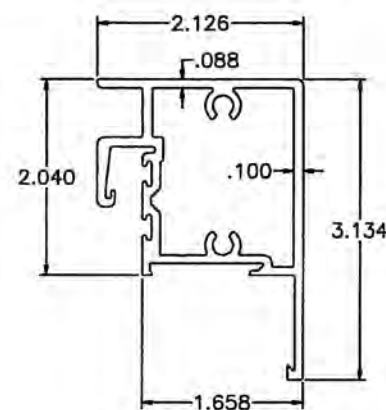


627-Moving Intlck.
6063-T6



628-Side Rail
6063-T6




629-Glzg. Bead
6063-T6
For Glass Types 4 & 4A




630-Glzg. Bead
6063-T6
For Glass Types 3 & 3A

VENT SHAPES FOR GLASS TYPES 3, 3A, 4 & 4A

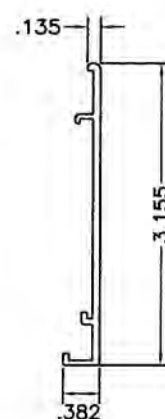

611-Waterbar
6063-T5

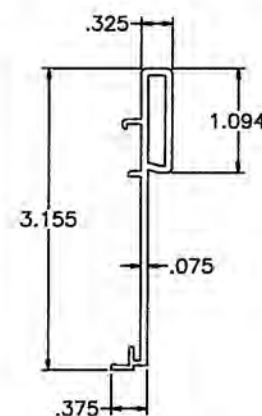

631-Waterbar
6063-T5

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**

By 
Miami-Dade Product Control

Revision: A) NO CHANGES THIS SHEET.
AK - 06/29/20

PREPARED BY A. LYNN MILLER
1070 TECHNOLOGY DRIVE
N. VENICE, FL 34275
(941) 480-1600


WinDoor®
INCORPORATED
104 TRIPLE DIAMOND BLVD
NORTH VENICE, FL 34275
(833) 554-5432

REGISTRATION #29296


SERIES "360" ALUM SINGLE HUNG WDW (LM/SMI)

EXTRUSIONS

Rev.	A
Date	1/10/2020
Drawn By	ALAN KINNE
DWG No.	SH360LM-NOA
Sheet	4 OF 14
Series	SH360

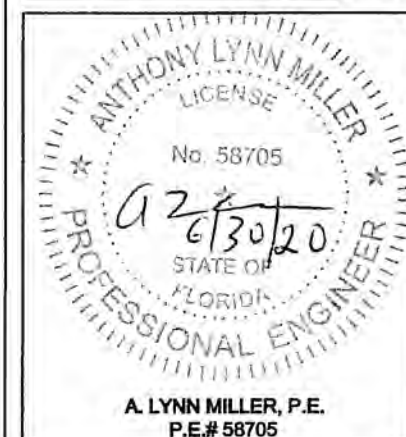


A. LYNN MILLER, P.E.
P.E.# 58705

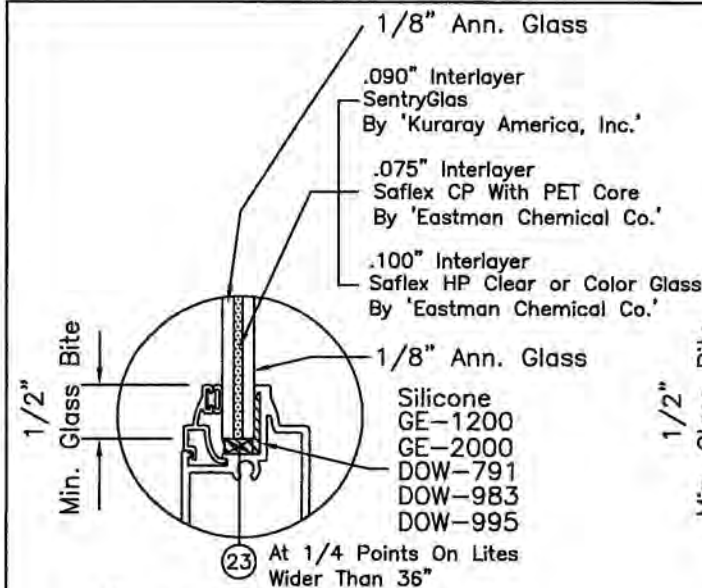

Glass Type "1"

5/16" Nominal Glass
Annealed/Annealed

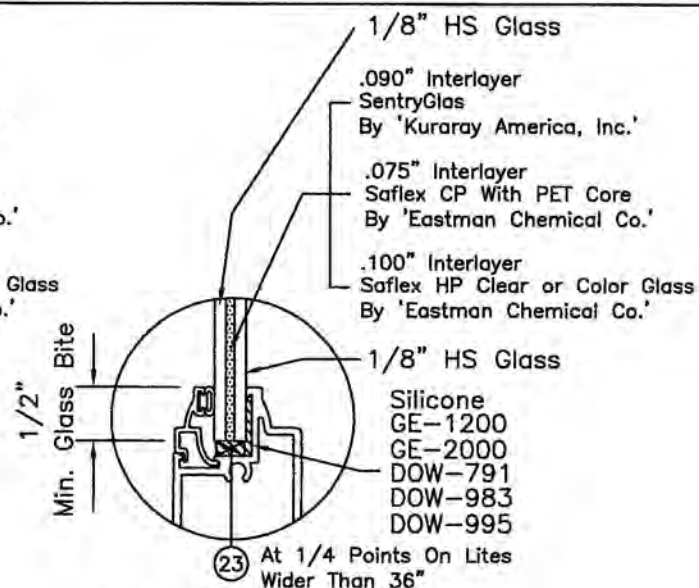

Glass Type "2"

5/16" Nominal Glass
HS/HS


Supplemental Test Results for:
Air Infiltration – Water Leakage Resistance – Forced Entry

Test Type and Method	Results
Air Infiltration Test (ASTM-E283) @ 1.57 psf pressure differential @ 6.24 psf pressure differential	PASSED (.044 C.F. / Min / Sq Ft) PASSED (.076 C.F. / Min / Sq Ft)
Water Leakage Test (ASTM-E331) without waterbar adaptor with waterbar adaptor	No leakage allowed PASSED @ 12.0 PSF PASSED @ 15.0 PSF
Forced Entry Resistance test (ASTM F588 & Grade 10)	PASSED

EQUAL LITES WINDOWS					
DESIGN LOAD CAPACITY – PSF					
WINDOW DIMS.		GLASS TYPE '1'		GLASS TYPE '2'	
WIDTH	HEIGHT	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
24"	48"	100.0	210.0	100.0	210.0
30"		100.0	210.0	100.0	210.0
32"		100.0	210.0	100.0	210.0
36"		100.0	180.0	100.0	210.0
42"		100.0	144.0	100.0	210.0
48"		100.0	120.0	100.0	200.0
54"		100.0	102.9	100.0	171.4
24"	60"	100.0	210.0	100.0	210.0
30"		100.0	199.7	100.0	210.0
32"		100.0	190.3	100.0	210.0
36"		100.0	164.3	100.0	210.0
42"		100.0	128.0	100.0	210.0
48"		100.0	104.7	100.0	120.0
54"		88.6	88.6	100.0	120.0
24"	72"	100.0	201.1	100.0	210.0
30"		100.0	162.1	100.0	210.0
32"		100.0	167.6	100.0	210.0
36"		100.0	150.7	100.0	210.0
42"		100.0	120.0	100.0	120.0
48"		96.0	96.0	100.0	120.0
54"		80.0	80.0	100.0	120.0
24"	84"	100.0	179.1	100.0	210.0
30"		100.0	143.4	100.0	210.0
32"		100.0	135.3	100.0	210.0
36"		100.0	120.0	100.0	120.0
42"		100.0	106.1	100.0	120.0
48"		85.6	85.6	100.0	120.0
54"		74.8	74.8	100.0	120.0

EQUAL LITES WINDOWS					
DESIGN LOAD CAPACITY – PSF					
WINDOW DIMS.		GLASS TYPE '1'		GLASS TYPE '2'	
WIDTH	HEIGHT	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
24"	96"	100.0	161.9	100.0	210.0
30"		100.0	118.8	100.0	120.0
32"		100.0	111.9	100.0	120.0
36"		100.0	101.5	100.0	120.0
42"		85.4	85.4	100.0	120.0
48"		76.2	76.2	100.0	120.0
54"		68.9	68.9	100.0	120.0
24"	108"	100.0	142.4	100.0	210.0
30"		100.0	102.2	100.0	120.0
32"		94.9	94.9	100.0	120.0
36"		85.9	85.9	100.0	120.0
42"		75.3	75.3	100.0	120.0
48"		68.6	68.6	100.0	120.0
24"	120"	100.0	120.0	100.0	120.0
30"		90.7	90.7	100.0	120.0
32"		83.6	83.6	100.0	120.0
36"		75.9	75.9	100.0	120.0
42"		66.4	66.4	100.0	120.0

EQUAL LITES WINDOWS					
DESIGN LOAD CAPACITY – PSF					
WINDOW DIMS.		GLASS TYPE '1'		GLASS TYPE '2'	
WIDTH	HEIGHT	EXT.(+)	INT.(–)	EXT.(+)	INT.(–)
19-1/8"	26"	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0
37"		100.0	210.0	100.0	210.0
53-1/8"		100.0	171.1	100.0	210.0
19-1/8"	38-3/8"	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0
37"		100.0	197.2	100.0	210.0
53-1/8"		100.0	124.1	100.0	206.9
19-1/8"	50-5/8"	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0
37"		100.0	168.3	100.0	210.0
53-1/8"		100.0	101.2	100.0	168.7
19-1/8"	63"	100.0	210.0	100.0	210.0
26-1/2"		100.0	207.5	100.0	210.0
37"		100.0	154.9	100.0	210.0
53-1/8"		88.1	88.1	100.0	120.0
19-1/8"	72"	100.0	210.0	100.0	210.0
26-1/2"		100.0	181.5	100.0	210.0
37"		100.0	146.8	100.0	210.0
53-1/8"		82.0	82.0	100.0	120.0
19-1/8"	76"	100.0	210.0	100.0	210.0
26-1/2"		100.0	171.4	100.0	210.0
37"		100.0	136.6	100.0	210.0
53-1/8"		80.0	80.0	100.0	120.0

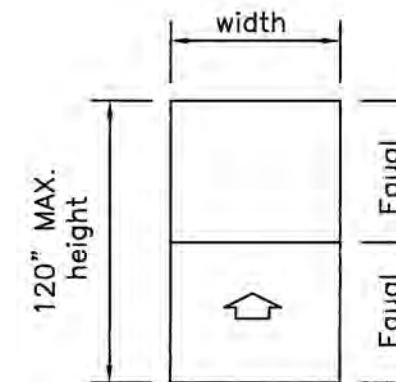

Equal Lite Window

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219


All values shown are Design PSF (Pounds per Square Foot)

VALUES FOR EXTERIOR LOADS(+) SHOWN ARE
FOR SILL WITH WATERBAR ADAPTER
FOR WINDOWS WITHOUT WATERBAR ADAPTER
LIMIT EXTERIOR(+) LOADS TO 80.0 PSF

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By
Miami-Dade Product Control

Revision:
A) ADDED BACKBEDDING.
AK - 06/29/20

WinDoor® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)		1/10/2020	
		Date			
		By		ALAN KINNE	
		Design			
		Drawn			
SH360		5 OF 14		DWG No.	
Sheet		SH360LM-NOA		Rev.	
				A	


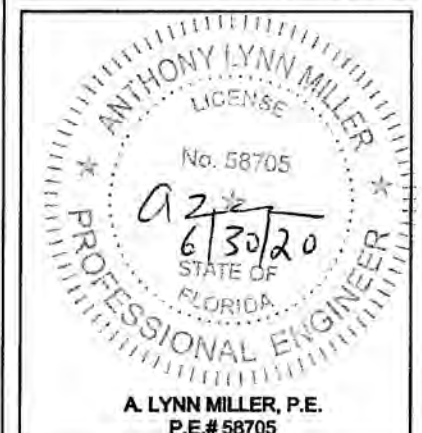


NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

EQUAL LITES WINDOWS

DESIGN LOAD CAPACITY - PSF

WINDOW DIMS.		GLASS TYPE '3'		GLASS TYPE '3A'		GLASS TYPE '4'		GLASS TYPE '4A'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	48"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	209.0
30"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	209.0
32"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	209.0
36"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	203.0
42"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	171.0
48"	60"	100.0	200.0	100.0	200.0	100.0	200.0	100.0	148.0
54"		100.0	171.4	100.0	171.4	100.0	171.4	100.0	131.0
24"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	209.0
30"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	200.0
32"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	188.0
36"	72"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	156.0
42"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	135.0
48"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	117.0
54"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	101.0
24"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	205.0
30"	84"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	155.0
32"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	147.0
36"		100.0	210.0	100.0	198.4	100.0	210.0	100.0	137.0
42"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	119.0
48"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	102.0
54"	96"	100.0	120.0	100.0	120.0	100.0	120.0	88.5	88.5
24"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	180.0
30"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	136.0
32"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	129.0
36"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	117.0
42"	108"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	105.0
48"		100.0	120.0	100.0	120.0	100.0	120.0	92.7	92.7
54"		100.0	120.0	100.0	120.0	100.0	120.0	80.4	80.4
24"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	157.0
30"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	117.0
32"	120"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	109.0
36"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	102.0
42"		100.0	120.0	100.0	120.0	100.0	120.0	90.8	90.6
48"		100.0	120.0	100.0	120.0	100.0	120.0	80.9	83.7
54"		100.0	120.0	100.0	112.6	100.0	120.0	73.2	74.5
24"	108"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	140.0
30"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	103.0
32"		100.0	120.0	100.0	120.0	100.0	120.0	97.6	97.6
36"		100.0	120.0	100.0	120.0	100.0	120.0	88.9	88.9
42"		100.0	120.0	100.0	120.0	100.0	120.0	79.4	79.4
48"	120"	100.0	120.0	100.0	112.2	100.0	120.0	72.8	72.8
24"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	129.0
30"		100.0	120.0	100.0	120.0	100.0	120.0	94.7	94.7
32"		100.0	120.0	100.0	120.0	100.0	120.0	88.9	88.9
36"		100.0	120.0	100.0	120.0	100.0	120.0	80.2	80.2
42"	120"	100.0	120.0	100.0	114.1	100.0	120.0	70.3	70.3

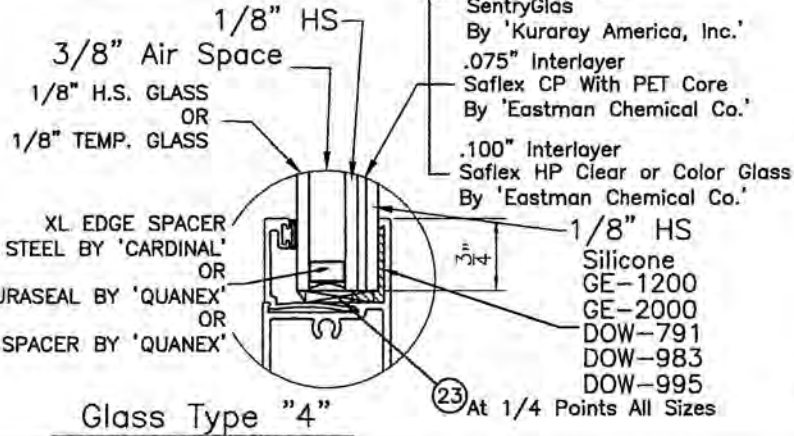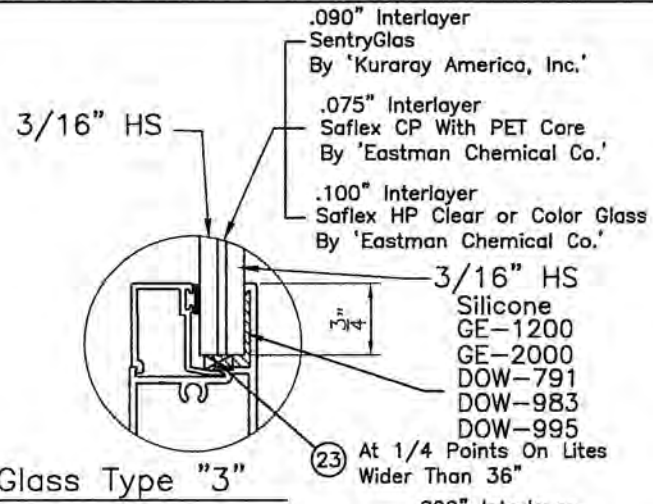


EQUAL LITES WINDOWS

DESIGN LOAD CAPACITY - PSF

WINDOW DIMS.		GLASS TYPE '3'		GLASS TYPE '3A'		GLASS TYPE '4'		GLASS TYPE '4A'	
WIDTH	HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	26"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
37"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
53-1/8"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
19-1/8"	38-3/8"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
37"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
53-1/8"		100.0	206.9	100.0	206.9	100.0	206.9	100.0	180.0
19-1/8"	50-5/8"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
37"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	183.0
53-1/8"		100.0	168.7	100.0	168.7	100.0	168.7	100.0	123.0
19-1/8"	63"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
37"		100.0	210.0	100.0	191.9	100.0	210.0	100.0	145.0
53-1/8"		100.0	120.0	100.0	120.0	100.0	120.0	100.0	99.0
19-1/8"	72"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	184.0
37"		100.0	210.0	100.0	196.5	100.0	210.0	100.0	134.0
53-1/8"		100.0	120.0	100.0	120.0	100.0	120.0	94.6	90.0
19-1/8"	76"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	210.0
26-1/2"		100.0	210.0	100.0	210.0	100.0	210.0	100.0	169.0
37"		100.0	210.0	100.0	194.8	100.0	210.0	100.0	124.0
53-1/8"		100.0	120.0	100.0	120.0	100.0	120.0	88.3	85.0

NOTE:
TO QUALIFY FOR SMALL MISSILE IMPACT RATING
THE EXTERIOR PANE FOR GLASS TYPES "4"
AND "4A" MUST BE TEMPERED.
(INSTALLATIONS ABOVE 30 FT. OF GRADE)

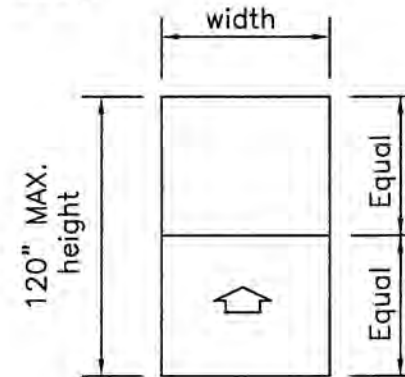

Equal Lite Window


All values shown are Design PSF (Pounds per Square Foot)


VALUES FOR EXTERIOR LOADS(+) SHOWN ARE
FOR SILL WITH WATERBAR ADAPTER
FOR WINDOWS WITHOUT WATERBAR ADAPTER
LIMIT EXTERIOR(+) LOADS TO 80.0 PSF

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By **Miami-Dade Product Control**


Revision: A) ADDED BACKBEDDING.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296	1/10/2020 Date	ALAN KINNE By	SH360LM-NOA Rev.	A
WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432	SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)	DESIGN LOAD TABLES/GLASS	6 OF 14 Sheet	SH360 Series

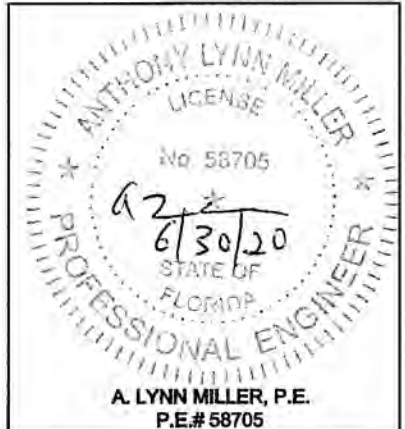

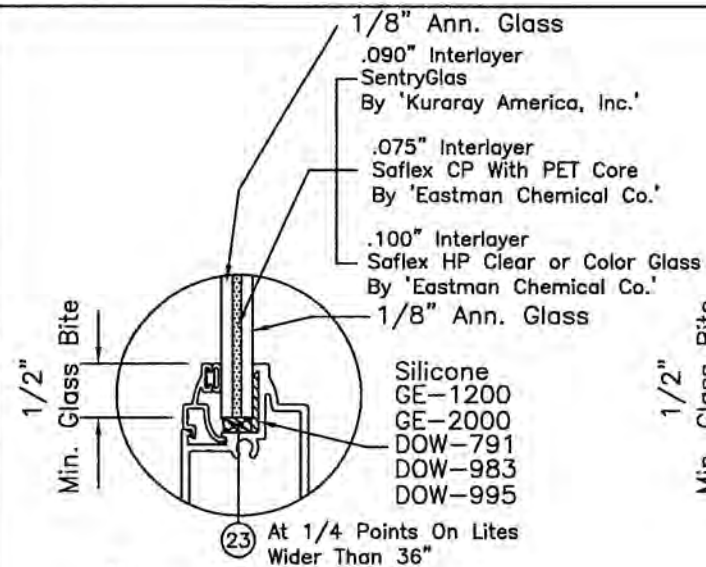

Glass Type "1"
5/16" Nominal Glass
Annealed/Annealed

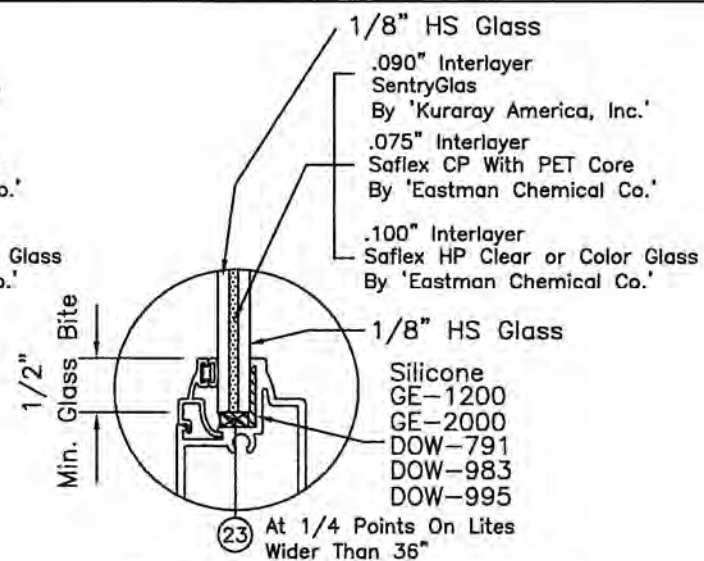

Glass Type "2"
5/16" Nominal Glass
HS/HS

UNEQUAL LITES WINDOWS (ORIEL)						
DESIGN LOAD CAPACITY - PSF						
WINDOW DIMS.		TOP VENT HEIGHT	GLASS TYPE '1'		GLASS TYPE '2'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	96" (MAX.)	48"	100.0	161.9	100.0	210.0
30"			100.0	118.8	100.0	120.0
32"			100.0	111.9	100.0	120.0
36"			100.0	101.5	100.0	120.0
42"			85.4	85.4	100.0	120.0
48"			76.2	76.2	100.0	120.0
54"			68.9	68.9	100.0	120.0
24"	108" (MAX.)	54"	100.0	142.4	100.0	210.0
30"			100.0	102.2	100.0	120.0
32"			94.9	94.9	100.0	120.0
36"			85.9	85.9	100.0	120.0
42"			75.3	75.3	100.0	120.0
48"			68.6	68.6	100.0	120.0
24"	120" (MAX.)	60"	100.0	120.0	100.0	120.0
30"			90.7	90.7	100.0	120.0
32"			83.6	83.6	100.0	120.0
36"			75.9	75.9	100.0	120.0
42"			66.4	66.4	100.0	120.0
48"			61.7	61.7	100.0	120.0
24"	120" (MAX.)	66"	100.0	113.6	100.0	120.0
30"			77.1	77.1	100.0	120.0
32"			70.1	70.1	100.0	120.0
36"			60.3	60.3	100.0	120.0
42"			100.0	120.0	100.0	120.0
48"			71.2	71.2	100.0	120.0
24"	120" (MAX.)	72"	100.0	120.0	100.0	120.0
30"			63.8	63.8	100.0	120.0
32"			100.0	120.0	100.0	120.0
36"			66.6	66.6	100.0	120.0
42"			100.0	120.0	100.0	120.0
48"			100.0	120.0	100.0	120.0

UNEQUAL LITES WINDOWS (ORIEL)						
DESIGN LOAD CAPACITY - PSF						
WINDOW DIMS.		TOP VENT HEIGHT	GLASS TYPE '1'		GLASS TYPE '2'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	96" (MAX.)	48"	100.0	210.0	100.0	210.0
26-1/2"			100.0	138.5	100.0	210.0
37"			99.3	99.3	100.0	120.0
53-1/8"			69.8	69.8	100.0	120.0
19-1/8"		54"	100.0	210.0	100.0	210.0
26-1/2"			100.0	120.0	100.0	120.0
37"			83.6	83.6	100.0	120.0
19-1/8"	108" (MAX.)	60"	100.0	210.0	100.0	210.0
26-1/2"			100.0	108.6	100.0	120.0
37"			73.7	73.7	100.0	120.0
19-1/8"		66"	100.0	210.0	100.0	210.0
26-1/2"			99.5	99.5	100.0	120.0
37"			65.7	65.7	100.0	120.0
19-1/8"	120" (MAX.)	72"	100.0	210.0	100.0	210.0
26-1/2"			93.9	93.9	100.0	120.0
37"			100.0	120.0	100.0	120.0
19-1/8"		78"	100.0	120.0	100.0	120.0
26-1/2"			88.0	88.0	100.0	120.0
37"			100.0	120.0	100.0	120.0
19-1/8"	120" (MAX.)	84"	100.0	120.0	100.0	120.0
26-1/2"			79.8	79.8	100.0	120.0
37"			100.0	120.0	100.0	120.0


NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

All values shown are Design PSF (Pounds per Square Foot)

Supplemental Test Results for:
Air Infiltration - Water Leakage Resistance - Forced Entry

Test Type and Method	Results
Air Infiltration Test (ASTM-E283) @ 1.57 psf pressure differential @ 6.24 psf pressure differential	PASSED (.044 C.F. / Min / Sq Ft) PASSED (.076 C.F. / Min / Sq Ft)
Water Leakage Test (ASTM-E331) without waterbar adaptor with waterbar adaptor	No leakage allowed PASSED @ 12.0 PSF PASSED @ 15.0 PSF
Forced Entry Resistance test (ASTM F588 & Grade 10)	PASSED

VALUES FOR EXTERIOR LOADS(+) SHOWN ARE
FOR SILL WITH WATERBAR ADAPTER
FOR WINDOWS WITHOUT WATERBAR ADAPTER
LIMIT EXTERIOR(+) LOADS TO 80.0 PSF

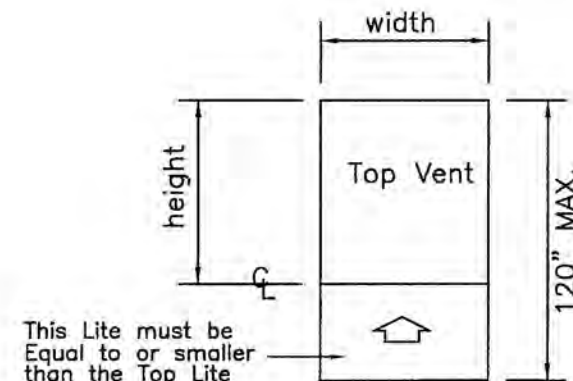


Unequal Lite Window

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By
Miami-Dade Product Control

Revision: A) ADDED BACKBEDDING.
AK - 06/29/20

WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		PREPARED BY A. LYNN MILLER	
		1070 TECHNOLOGY DRIVE	
		N. VENICE, FL 34275	
		(941) 480-1600	
		REGISTRATION #29296	
SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)		Date	1/10/2020
DESIGN LOAD TABLES/GLASS		ALAN KINNE	
		Drawn By	
SH360	7 OF 14	DWG No.	SH360LM-NOA
Sheet			A
Series Desc.			Rev.

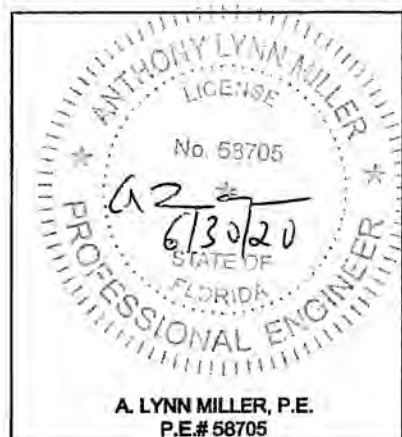


A. LYNN MILLER, P.E.
P.E.# 58705

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

UNEQUAL LITES WINDOWS (ORIEL)										
DESIGN LOAD CAPACITY - PSF										
WINDOW DIMS.		TOP VENT HEIGHT	GLASS TYPE '3'		GLASS TYPE '3A'		GLASS TYPE '4'		GLASS TYPE '4A'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
24"	96" (MAX.)	48"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	154.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	100.0	114.0
32"			100.0	120.0	100.0	120.0	100.0	120.0	100.0	114.0
36"			100.0	120.0	100.0	120.0	100.0	120.0	99.9	99.9
42"			100.0	120.0	100.0	120.0	100.0	120.0	88.8	88.8
48"			100.0	120.0	100.0	120.0	100.0	120.0	82.3	82.3
54"			100.0	120.0	100.0	112.6	100.0	120.0	73.7	73.7
24"	108" (MAX.)	54"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	138.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	100.0	101.0
32"			100.0	120.0	100.0	120.0	100.0	120.0	100.0	101.0
36"			100.0	120.0	100.0	120.0	100.0	120.0	87.4	87.4
42"			100.0	120.0	100.0	120.0	100.0	120.0	78.2	78.2
48"			100.0	120.0	100.0	112.2	100.0	120.0	71.5	71.5
24"	120" (MAX.)	60"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	127.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	93.4	93.4
32"			100.0	120.0	100.0	120.0	100.0	120.0	93.4	93.4
36"			100.0	120.0	100.0	120.0	100.0	120.0	79.0	79.0
42"			100.0	120.0	100.0	114.1	100.0	120.0	69.1	69.1
24"	120" (MAX.)	66"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	120.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	83.7	83.7
32"			100.0	120.0	100.0	120.0	100.0	120.0	83.7	83.7
36"			100.0	120.0	100.0	120.0	100.0	120.0	70.0	70.0
24"	120" (MAX.)	72"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	117.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	76.2	76.2
32"			100.0	120.0	100.0	120.0	100.0	120.0	76.2	76.2
36"			100.0	120.0	100.0	120.0	100.0	115.2	61.9	61.9
24"	120" (MAX.)	78"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	120.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	72.2	72.2
32"			100.0	120.0	100.0	120.0	100.0	120.0	72.2	72.2
24"	120" (MAX.)	84"	100.0	120.0	100.0	120.0	100.0	120.0	100.0	118.0
30"			100.0	120.0	100.0	120.0	100.0	120.0	68.9	68.9


All values shown are Design PSF (Pounds per Square Foot)

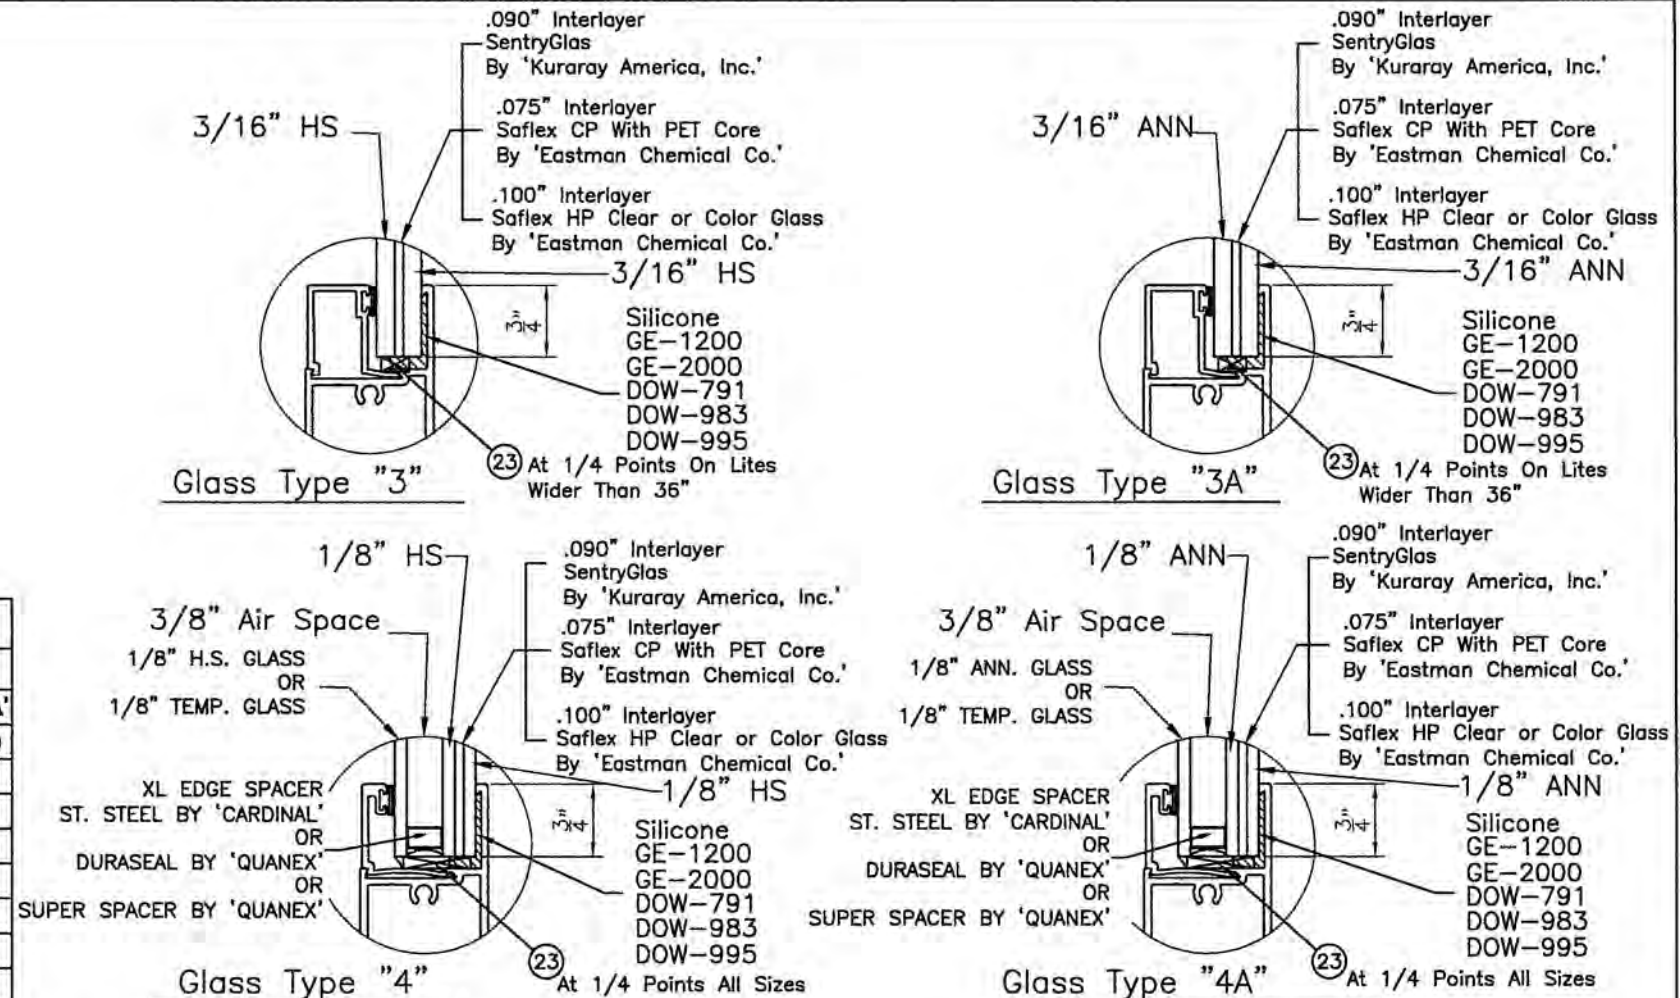

UNEQUAL LITES WINDOWS (ORIEL)										
DESIGN LOAD CAPACITY - PSF										
WINDOW DIMS.		TOP VENT HEIGHT	GLASS TYPE '3'		GLASS TYPE '3A'		GLASS TYPE '4'		GLASS TYPE '4A'	
WIDTH	HEIGHT		EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
19-1/8"	96" (MAX.)	48"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	209.0
26-1/2"			100.0	210.0	100.0	210.0	100.0	210.0	100.0	136.0
37"			100.0	120.0	100.0	120.0	100.0	120.0	97.8	97.8
53-1/8"	108" (MAX.)	54"	100.0	120.0	100.0	114.4	100.0	120.0	75.4	75.4
19-1/8"			100.0	210.0	100.0	210.0	100.0	210.0	100.0	204.0
26-1/2"			100.0	120.0	100.0	120.0	100.0	120.0	85.4	85.4
37"	120" (MAX.)	60"	100.0	210.0	100.0	204.2	100.0	210.0	100.0	205.0
26-1/2"			100.0	120.0	100.0	120.0	100.0	120.0	100.0	107.0
37"			100.0	120.0	100.0	120.0	100.0	120.0	77.1	77.1
19-1/8"	120" (MAX.)	66"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	207.0
26-1/2"			100.0	120.0	100.0	120.0	100.0	120.0	99.7	99.7
37"			100.0	120.0	100.0	120.0	100.0	120.0	68.4	68.4
19-1/8"	120" (MAX.)	72"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	199.0
26-1/2"			100.0	120.0	100.0	120.0	100.0	120.0	94.5	94.5
37"			100.0	120.0	100.0	120.0	100.0	120.0	91.3	91.3
19-1/8"	120" (MAX.)	78"	100.0	210.0	100.0	210.0	100.0	210.0	100.0	192.0
26-1/2"			100.0	120.0	100.0	120.0	100.0	120.0	91.3	91.3
37"			100.0	120.0	100.0	120.0	100.0	120.0	89.2	89.2

VALUES FOR EXTERIOR LOADS(+) SHOWN ARE
FOR SILL WITH WATERBAR ADAPTER
FOR WINDOWS WITHOUT WATERBAR ADAPTER
LIMIT EXTERIOR(+) LOADS TO 80.0 PSF


NOTE:
TO QUALIFY FOR SMALL MISSILE IMPACT RATING
THE EXTERIOR PANE FOR GLASS TYPES "4"
AND "4A" MUST BE TEMPERED.
(INSTALLATIONS ABOVE 30 FT. OF GRADE)

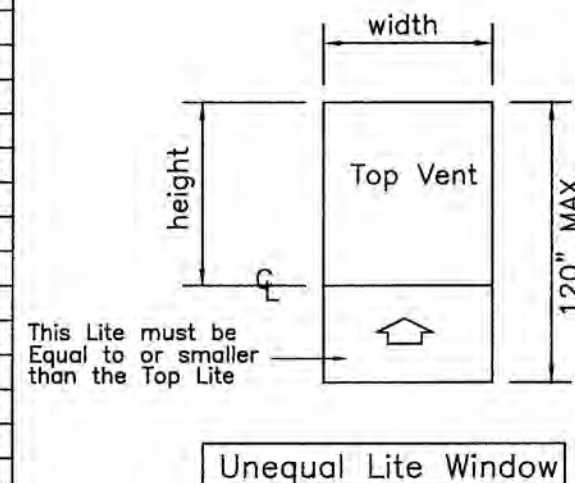

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By **Miami-Dade Product Control**




Revision: A) ADDED BACKBEDDING.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296		1/10/2020	
WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)			
DESIGN LOAD TABLES/GLASS		ALAN KINNE		Date	
SH360		SH360LM-NOA		Rev.	
8 OF 14		No.		A	
Sheet		DWG		By	
Series Desc.		Drawn		Title	

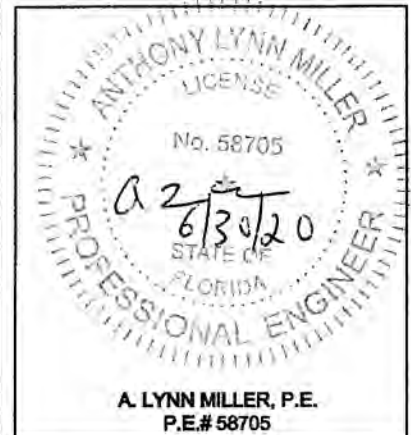

Installation Type "A"

w/ 1 x 4 Beveled P.T. Wood Buck

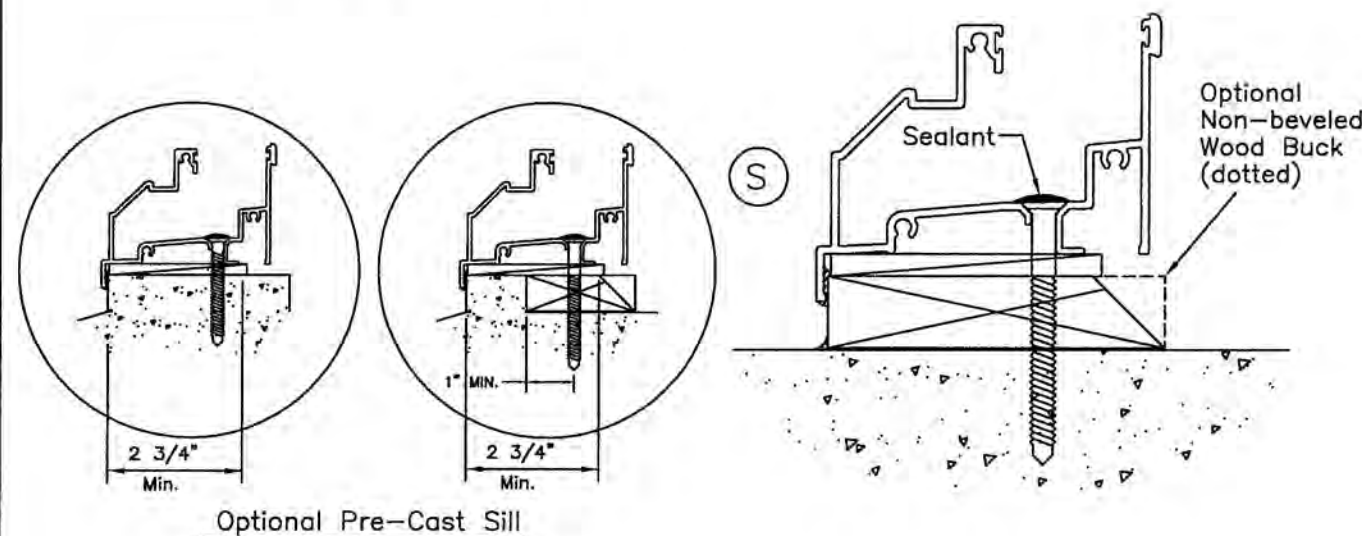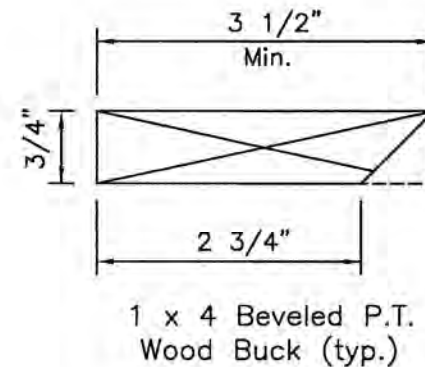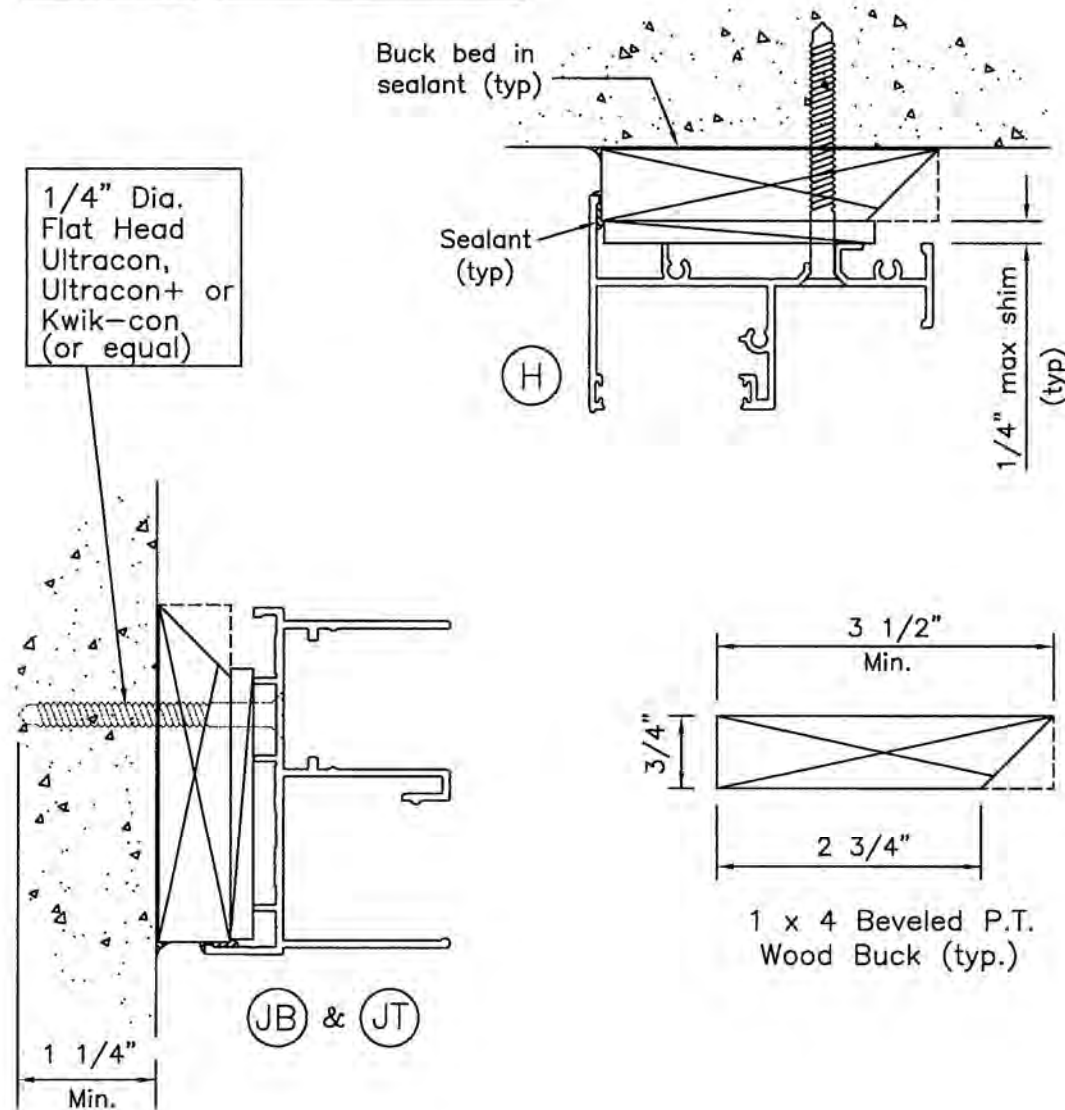

IMPORTANT NOTE:

Wood Bucks must sustain loads imposed by glazing system and transfer them to the building structure.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

1/4" DIA. ULTRACON BY 'ELCO' (Fu=177 KSI, Fy=155 KSI)

1/4" DIA. ULTRACON+ BY 'DEWALT' (Fu=164 KSI, Fy=148 KSI)

1/4" DIA. HILTI KWIK-CON II (Fu=163 KSI, Fy=157 KSI)

INTO 2BY WOOD BUCKS OR WOOD STRUCTURES

1-1/2" MIN. PENETRATION INTO WOOD

THRU 1BY BUCKS INTO CONC. OR BUCKS

1-1/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-1/4" MIN. EMBED INTO BLOCKS (JAMBS)

DIRECTLY INTO CONCRETE OR BLOCKS

1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL/JAMBS)

1-3/4" MIN. EMBED INTO FILLED BLOCKS (JAMBS)

1/4" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)

INTO METAL STRUCTURES (HEAD/SILL/JAMBS)

(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS

ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)

STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

#14 SMS (GRADE 2 CRS)

INTO MIAMI-DADE COUNTY APPROVED MULLIONS

(3) THREADS MIN. TO EXTEND BEYOND METAL THICKNESS

ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.) (NO SHIMS)

STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)

(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE

INTO CONCRETE AND MASONRY = 2-1/2" MIN.

INTO WOOD STRUCTURE = 1" MIN.

INTO METAL STRUCTURE = 3/4" MIN.

WOOD AT HEAD, SILL OR JAMBS SG = 0.55 MIN.

CONCRETE AT HEAD, SILL OR JAMBS f'c = 3000 PSI MIN.

C-90 FILLED BLOCK AT JAMBS f'm = 2000 PSI MIN.

Values for Installation Type "A" apply to the following installation types, with maximum shim space 1/4":

- 1- Using 1by P.T. wood bucks, min. 3/4" thick,
- 2- Directly into masonry, without the use of wood bucks.
- 3- Directly into a steel or aluminum structure
Min. 1/8" thick and using #14 Tekes or Self drilling screws.
Structure must be designed by others to sustain the loads imposed by the window.

PRODUCT REVISED
as complying with the Florida
Building Code


NOA-No. **20-0722.20**

Expiration Date **05/05/2025**

By **Miami-Dade Product Control**



Revision: A) ADDED ULTRACON+
ANCHORS.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1800	REGISTRATION #29296	1/10/2020	ALAN KINNE	A
WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432	SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)	9 OF 14	SH360LM-NOA	Rev.
ANCHORS	SH360	9 OF 14	SH360LM-NOA	Rev.

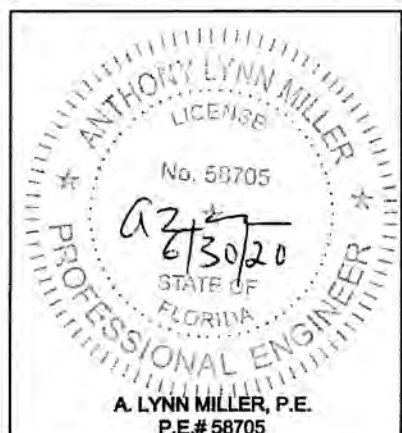


Installation Type "B"

w/ 2 x 4 Beveled P.T. Wood Buck

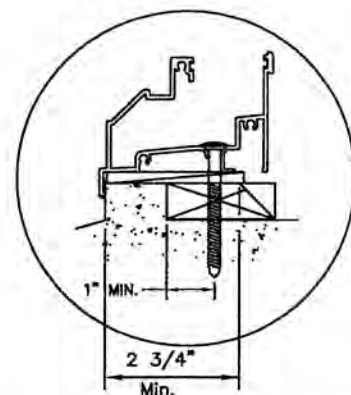
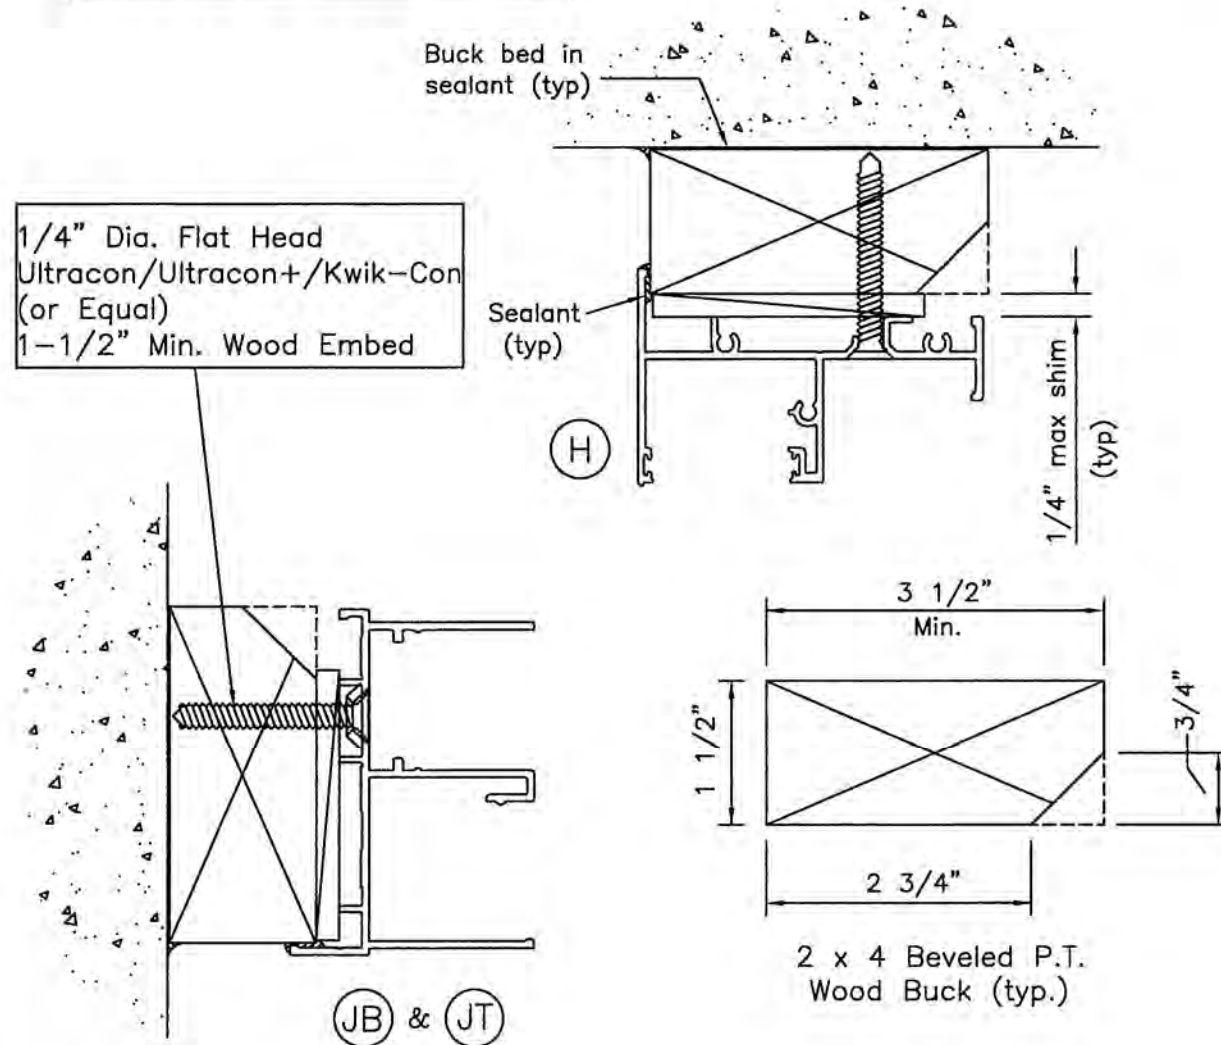


Optional Pre-Cast Sill

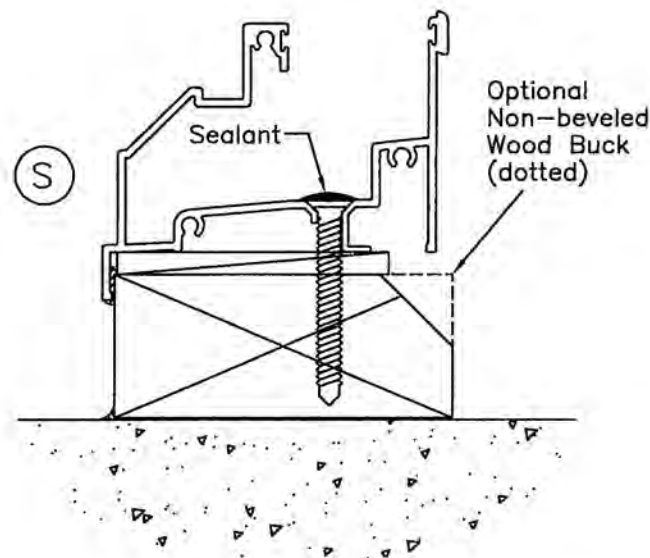

Installation Type "C"


based on wood penetration only
using 1 x 4 or 2 x 4 wood bucks

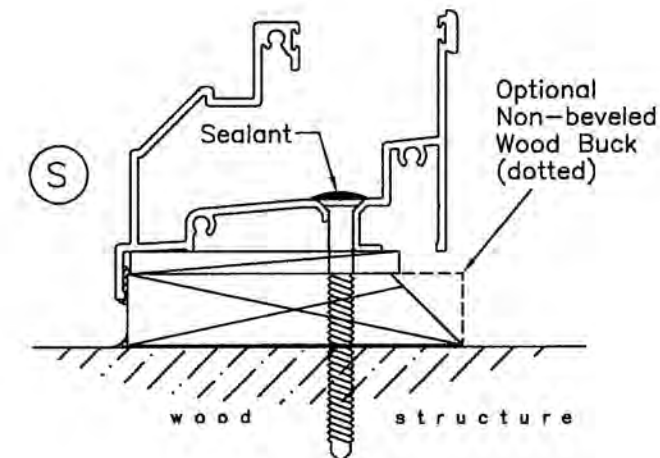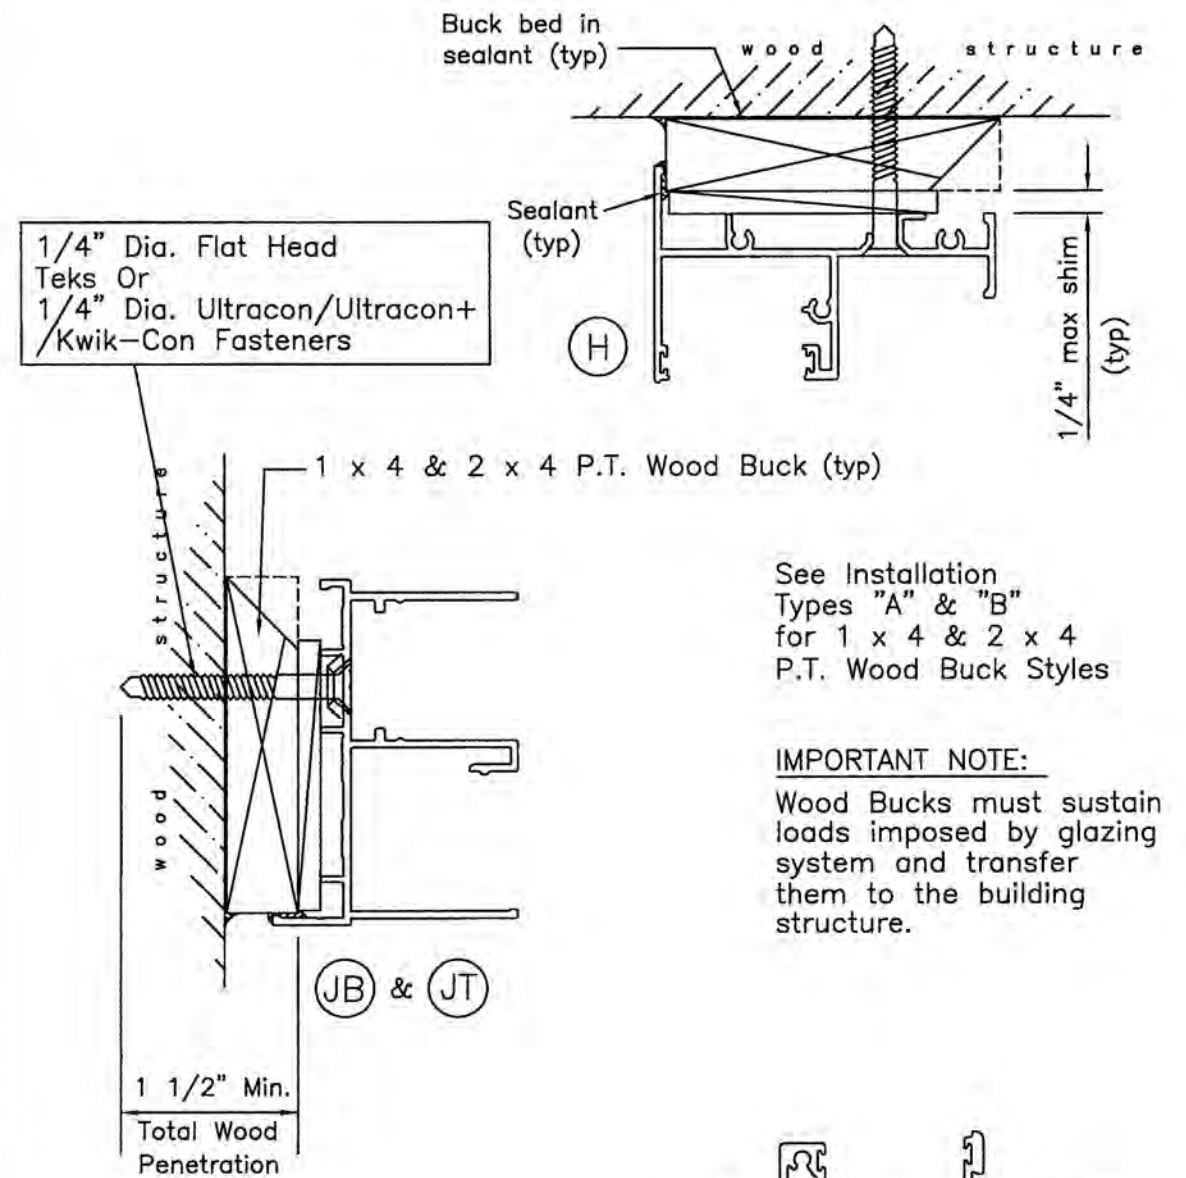

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By **Miami-Dade Product Control**

Revision: A) NO CHANGES THIS SHEET.
AK - 06/29/20


WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600	
REGISTRATION #29296			
SERIES "360" ALUM SINGLE HUNG WDW (LM/SMI)		Date	1/10/2020
ANCHORS		By ALAN KINNE	
SH360	10 OF 14	DWG No.	SH360LM-NOA
Sheet		Rev.	A

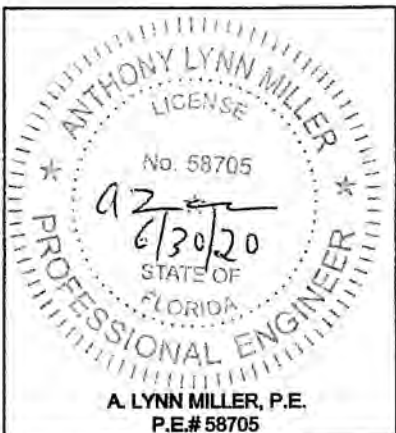

ANCHORS				
DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.		NO. OF ANCHORS AT JAMB	STD. HOLE PATTERN W/O ADDL. ANCHOR	STD. HOLE PATTERN WITH ADDL. ANCHOR
WIDTH	HEIGHT		EXT.(+) & INT.(-)	EXT.(+) & INT.(-)
24"	48"	4	210.0	210.0
30"			210.0	210.0
32"			210.0	210.0
36"			196.0	210.0
42"			174.2	210.0
48"			151.7	196.0
54"			127.1	178.2
24"	60"	6	210.0	210.0
30"			210.0	210.0
32"			210.0	210.0
36"			210.0	210.0
42"			171.1	210.0
48"			134.4	201.6
54"			110.7	166.0
24"	72"	8	210.0	210.0
30"			210.0	210.0
32"			210.0	210.0
36"			210.0	210.0
42"			165.1	210.0
48"			125.4	188.2
54"			101.2	151.7
24"	84"	8	210.0	210.0
30"			210.0	210.0
32"			207.5	210.0
36"			190.1	210.0
42"			164.9	192.0
48"			122.2	175.3
54"			96.0	144.0
24"	96"	8	210.0	210.0
30"			185.8	209.1
32"			176.4	198.5
36"			160.8	180.9
42"			143.4	161.3
48"			122.1	147.0
54"			94.1	135.7
24"	108"	10	210.0	210.0
30"			202.3	210.0
32"			191.7	210.0
36"			174.2	191.6
42"			154.5	169.9
48"			122.1	154.0
24"	120"	10	210.0	210.0
30"			179.2	197.1
32"			169.6	186.6
36"			153.7	169.1
42"			135.8	149.3

ANCHORS				
DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.		NO. OF ANCHORS AT JAMB	STD. HOLE PATTERN W/O ADDL. ANCHOR	STD. HOLE PATTERN WITH ADDL. ANCHOR
WIDTH	HEIGHT		EXT.(+) & INT.(-)	EXT.(+) & INT.(-)
19-1/8"	26"	4	210.0	210.0
26-1/2"			210.0	210.0
37"			210.0	210.0
53-1/8"			208.6	210.0
19-1/8"	38-3/8"	4	210.0	210.0
26-1/2"			210.0	210.0
37"			210.0	210.0
53-1/8"			152.7	210.0
19-1/8"	50-5/8"	4	210.0	210.0
26-1/2"			210.0	210.0
37"			179.6	210.0
53-1/8"			125.7	169.5
19-1/8"	63"	6	210.0	210.0
26-1/2"			210.0	210.0
37"			203.8	210.0
53-1/8"			110.7	166.1
19-1/8"	72"	8	210.0	210.0
26-1/2"			210.0	210.0
37"			210.0	210.0
53-1/8"			104.1	156.1
19-1/8"	76"	8	210.0	210.0
26-1/2"			210.0	210.0
37"			210.0	210.0
53-1/8"			102.1	153.1

LOADS APPLY TO INSTALLATION TYPES A, B & C AND INTO ALUMINUM BUCKS FOR ALUMINUM BUCK INSTALLATION SEE SHEETS 13 AND 14.

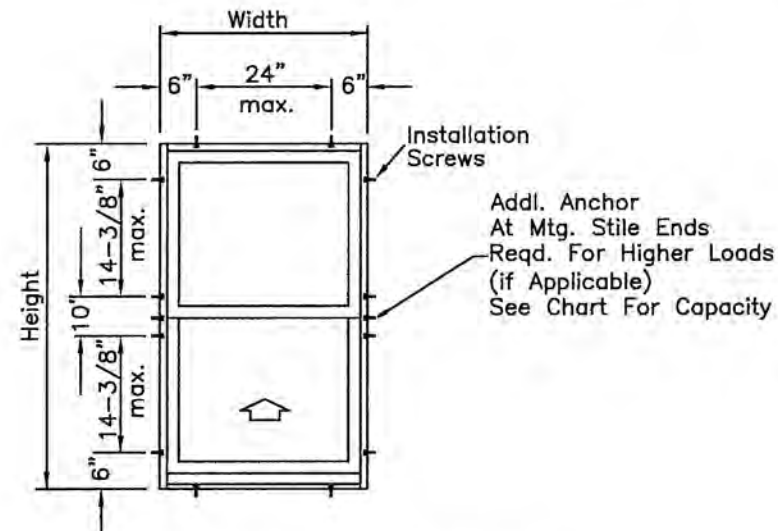

WinDoor Standard Hole Pattern

Refer to sheets 9 & 10 of 14 for description of installation types A - B - C

PRODUCT REVISED
as complying with the Florida Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By
Miami-Dade Product Control

Revision: A) NO CHANGES THIS SHEET.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29296	1/10/2020	ALAN KINNE	SH360LM-NOA	A
WinDoor® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432	SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)	DESIGN LOAD TABLES	11 OF 14	SH360

ANTHONY LYNN MILLER
LICENSE
No. 58705
6/30/20
STATE OF FLORIDA
PROFESSIONAL ENGINEER
A. LYNN MILLER, P.E.
P.E.# 58705

$$\text{Tributary Width} = \frac{W1 + W2}{2}$$

120" maximum span

W1 W2

6" max typ

Installation Screws (typ)

MV

Multiple Opening (2 or more windows)

w/ 1 screw on each side of mullion

Standard Installation

120" maximum span

W1 W2

3" 3"

MV


Multiple Opening (2 or more windows)

w/ 2 or 3 screws on each side of mullion

High Load Installation

(* = additional holes to be drilled by installer)


#14 x 3/4" FH SMS
SEE SHEETS 1 & 2
FOR SPACING

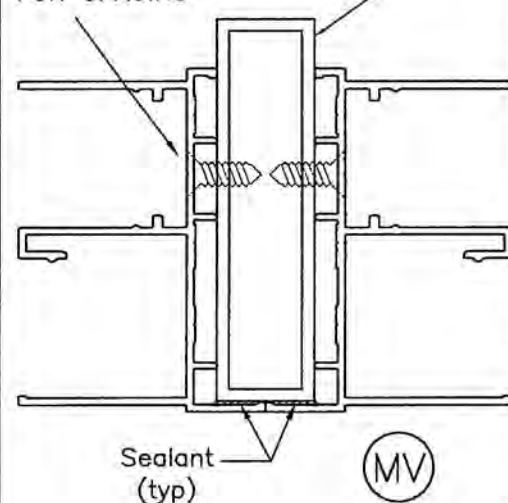

MULLION DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.		ONE ANCHOR EACH SIDE	TWO ANCHORS EACH SIDE	THREE ANCHORS EACH SIDE
WIDTH	HEIGHT	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)
24"	48"	150.0	210.0	210.0
30"		130.9	210.0	210.0
32"		126.6	210.0	210.0
36"		120.0	210.0	210.0
42"		114.5	210.0	210.0
48"		112.5	210.0	210.0
54"		112.5	210.0	210.0
24"	60"	112.5	210.0	210.0
30"		96.0	192.0	210.0
32"		92.0	184.1	210.0
36"		85.7	171.4	210.0
42"		79.1	158.2	210.0
48"		75.0	150.0	210.0
54"		72.7	145.5	210.0
24"	72"	90.0	180.0	210.0
30"		75.8	151.6	210.0
32"		72.3	144.6	210.0
36"		66.7	133.3	197.9
42"		60.5	121.0	175.4
48"		56.3	112.5	159.8
54"		53.3	106.7	149.0
24"	84"	75.0	150.0	202.2
30"		62.6	125.2	164.2
32"		59.6	119.1	154.8
36"		54.5	109.1	139.5
42"		49.0	98.0	122.4
48"		45.0	90.0	110.0
54"		42.1	84.2	101.2


MULTIION DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.		ONE ANCHOR EACH SIDE	TWO ANCHORS EACH SIDE	THREE ANCHORS EACH SIDE
WIDTH	HEIGHT	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)
24"	96"	64.3	128.6	142.1
30"		53.3	106.7	115.3
32"		50.6	101.2	108.7
36"		46.2	92.3	97.8
42"		41.1	82.3	85.6
48"		37.5	75.0	76.8
54"		34.8	69.6	70.3
24"	108"	56.3	99.3	99.3
30"		46.5	80.3	80.3
32"		44.0	75.6	75.6
36"		40.0	67.8	67.8
42"		35.5	59.1	59.1
48"		32.1	52.8	52.8
24"	120"	50.0	72.1	72.1
30"		41.1	58.2	58.2
32"		38.9	54.7	54.7
36"		35.3	49.0	49.0
42"		31.2	42.6	42.6

For Window Performance, refer to sheets 5 or 7

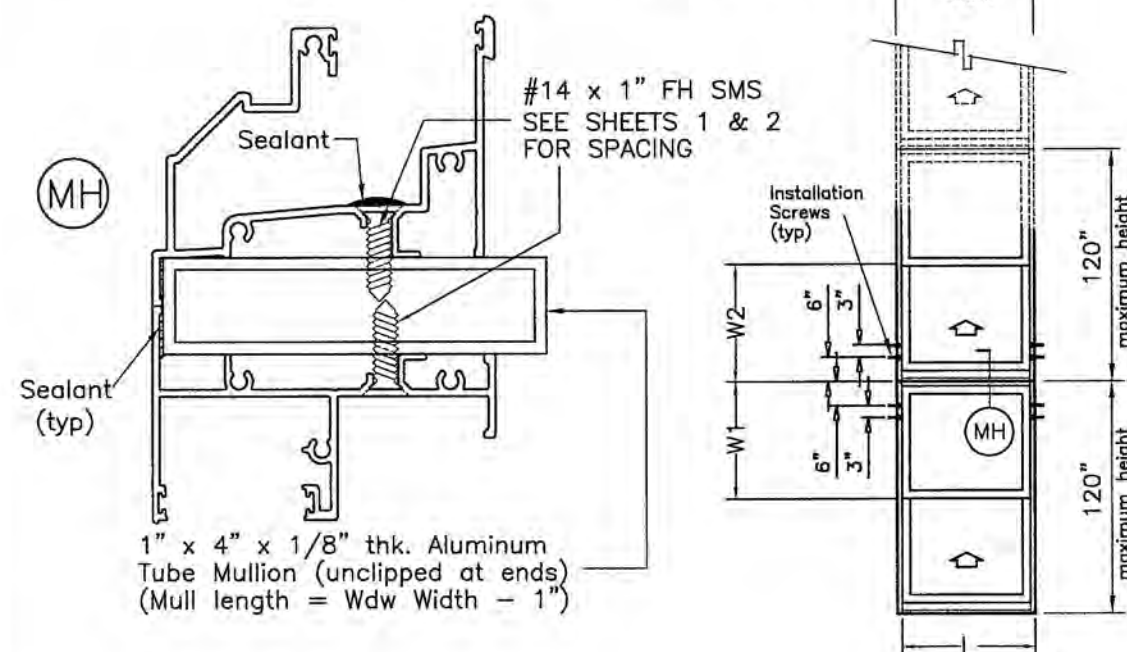

MULLION DESIGN LOAD CAPACITY - PSF				
WINDOW DIMS.		ONE ANCHOR EACH SIDE	TWO ANCHORS EACH SIDE	THREE ANCHORS EACH SIDE
WIDTH	HEIGHT	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)	EXT.(+) & INT.(-)
53-1/8"	26"	210.0	210.0	210.0
19-1/8"	38-3/8"	210.0	210.0	210.0
26-1/2"		194.6	210.0	210.0
37"		176.2	210.0	210.0
53-1/8"		176.0	210.0	210.0
19-1/8"	50-5/8"	165.0	210.0	210.0
26-1/2"		130.9	210.0	210.0
37"		109.0	210.0	210.0
53-1/8"		101.1	202.3	210.0
19-1/8"	63"	126.8	210.0	210.0
26-1/2"		98.3	196.6	210.0
37"		78.7	157.4	210.0
53-1/8"		67.0	133.9	200.9
19-1/8"	72"	108.5	210.0	210.0
26-1/2"		83.2	166.5	210.0
37"		65.5	130.9	193.5
53-1/8"		53.7	107.4	150.3
19-1/8"	76"	102.0	204.0	210.0
26-1/2"		77.9	155.9	210.0
37"		60.9	121.8	170.9
53-1/8"		49.3	98.7	131.1

WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296	
SERIES "360" ALUM SINGLE HUNG WDW (LMI/SMI)		Date		1/10/2020	
MULLION DESIGN LOAD TABLES		Drawn By		ALAN KINNE	
SH360	12 OF 14	12 OF 14	SH360LM-NOA	A	A

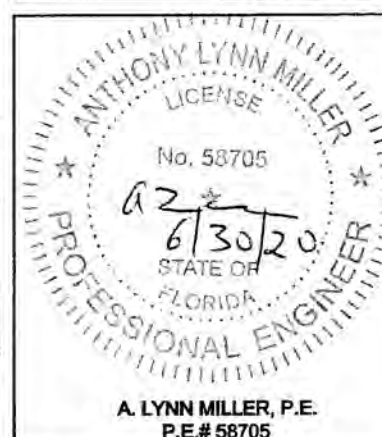

**PERFORMANCE VALUES
OF ALUMINUM BUCK
INSTALLATION ANCHORS**
EXT.(+) & INT.(-)


WINDOW DIMS.		ANCHOR SPACING INTO CONC.		ANCHOR SPACING INTO HOLLOW BLOCK		ANCHOR SPACING INTO WOOD	
WIDTH	HEIGHT	16" O.C.	8" O.C.	16" O.C.	8" O.C.	16" O.C.	8" O.C.
24"	48"	210.0	210.0	178.7	210.0	210.0	210.0
30"		210.0	210.0	155.9	210.0	210.0	210.0
32"		210.0	210.0	150.8	210.0	210.0	210.0
36"		210.0	210.0	142.9	210.0	210.0	210.0
42"		205.7	210.0	131.3	204.2	176.3	210.0
48"	60"	205.7	210.0	131.3	201.0	180.0	210.0
54"		168.0	210.0	107.2	187.6	144.0	210.0
24"		210.0	210.0	134.0	210.0	210.0	210.0
30"		179.2	210.0	114.3	200.1	210.0	210.0
32"		171.8	210.0	109.6	191.9	210.0	210.0
36"	72"	160.0	210.0	102.1	178.7	210.0	210.0
42"		147.7	210.0	94.2	164.9	176.3	210.0
48"		140.0	210.0	89.3	156.3	180.0	210.0
54"		135.8	210.0	86.6	151.6	142.2	210.0
24"		210.0	210.0	134.0	210.0	210.0	210.0
30"	84"	176.8	210.0	112.8	203.1	210.0	210.0
32"		168.8	210.0	107.7	193.8	210.0	210.0
36"		155.6	210.0	99.3	178.7	210.0	210.0
42"		141.2	210.0	90.1	162.2	176.3	210.0
48"		131.3	210.0	83.8	150.8	180.0	210.0
54"	96"	124.4	210.0	79.4	142.9	142.2	210.0
24"		210.0	210.0	134.0	210.0	210.0	210.0
30"		175.3	210.0	111.9	186.4	210.0	210.0
32"		166.8	210.0	106.4	177.4	210.0	210.0
36"		152.7	210.0	97.5	162.4	210.0	210.0
42"	108"	137.1	210.0	87.5	145.9	176.3	210.0
48"		126.0	210.0	80.4	134.0	180.0	210.0
54"		117.9	196.5	75.2	125.4	142.2	210.0
24"		210.0	210.0	134.0	210.0	210.0	210.0
30"		174.2	210.0	111.2	190.6	210.0	210.0
32"	120"	165.4	210.0	105.5	180.9	210.0	210.0
36"		150.8	210.0	96.2	164.9	210.0	210.0
42"		134.4	210.0	85.8	147.0	176.3	210.0
48"		122.5	210.0	78.2	134.0	180.0	210.0
54"		113.6	194.8	72.5	124.3	142.2	210.0
24"	108"	183.8	210.0	117.3	210.0	210.0	210.0
30"		151.7	210.0	96.8	179.8	210.0	210.0
32"		143.8	210.0	91.8	170.4	210.0	210.0
36"		130.7	210.0	83.4	154.8	210.0	210.0
42"		115.9	210.0	73.9	137.3	176.3	210.0
48"	120"	105.0	195.0	67.0	124.4	180.0	210.0
24"		186.7	210.0	119.1	210.0	210.0	210.0
30"		153.6	210.0	98.0	183.8	210.0	210.0
32"		145.4	210.0	92.8	173.9	210.0	210.0
36"		131.8	210.0	84.1	157.6	210.0	210.0
42"		116.4	210.0	74.3	139.2	176.3	210.0

**PERFORMANCE VALUES
OF ALUMINUM BUCK
INSTALLATION ANCHORS**
EXT.(+) & INT.(-)

WINDOW DIMS.		ANCHOR SPACING INTO CONC.		ANCHOR SPACING INTO HOLLOW BLOCK		ANCHOR SPACING INTO WOOD	
WIDTH	HEIGHT	16" O.C.	8" O.C.	16" O.C.	8" O.C.	16" O.C.	8" O.C.
19-1/8"	26"	210.0	210.0	210.0	210.0	210.0	210.0
26-1/2"		210.0	210.0	210.0	210.0	210.0	210.0
37"		210.0	210.0	185.5	210.0	210.0	210.0
53-1/8"	38-3/8"	210.0	210.0	148.0	210.0	198.8	210.0
19-1/8"		210.0	210.0	210.0	210.0	210.0	210.0
26-1/2"		210.0	210.0	173.9	210.0	210.0	210.0
37"	50-5/8"	210.0	210.0	157.4	210.0	210.0	210.0
53-1/8"		185.8	210.0	118.5	207.4	159.2	210.0
19-1/8"		210.0	210.0	196.6	210.0	210.0	210.0
26-1/2"	63"	210.0	210.0	155.9	210.0	210.0	210.0
37"		203.5	210.0	129.9	194.8	210.0	210.0
53-1/8"		171.8	210.0	109.6	180.7	147.3	210.0
19-1/8"	72"	210.0	210.0	188.8	210.0	210.0	210.0
26-1/2"		210.0	210.0	146.4	210.0	210.0	210.0
37"		183.7	210.0	117.2	187.5	210.0	210.0
53-1/8"	76"	156.2	210.0	99.7	159.5	146.9	210.0
19-1/8"		210.0	210.0	161.6	210.0	210.0	210.0
26-1/2"		194.2	210.0	123.9	210.0	210.0	210.0
37"		152.8	210.0	97.5	175.5	210.0	210.0
53-1/8"		125.3	210.0	79.9	143.9	146.9	210.0
19-1/8"		210.0	210.0	151.9	210.0	210.0	210.0
26-1/2"		181.9	210.0	116.0	208.9	210.0	210.0
37"		142.1	210.0	90.7	163.3	210.0	210.0
53-1/8"		115.1	207.3	73.5	132.2	146.9	210.0



ALUMINUM BUCK FRAMING DETAILS

REFER TO SHEETS 3 THRU 9 FOR WINDOW CAPACITIES
USE LOWER APPLICABLE VALUES.

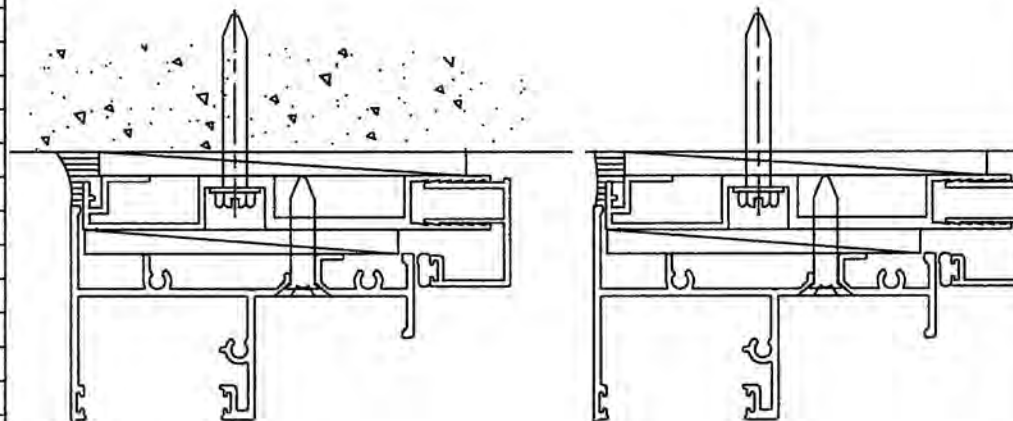


#14 SMS
AT 6" FROM ENDS
AND 24" O.C. MAX. AT
HEAD & SILL AND 14-3/8"
O.C. MAX AT JAMBS

#14 SMS
AT 6" FROM ENDS
AND 24" O.C. MAX. AT
HEAD & SILL AND 14-3/8"
O.C. MAX AT JAMBS

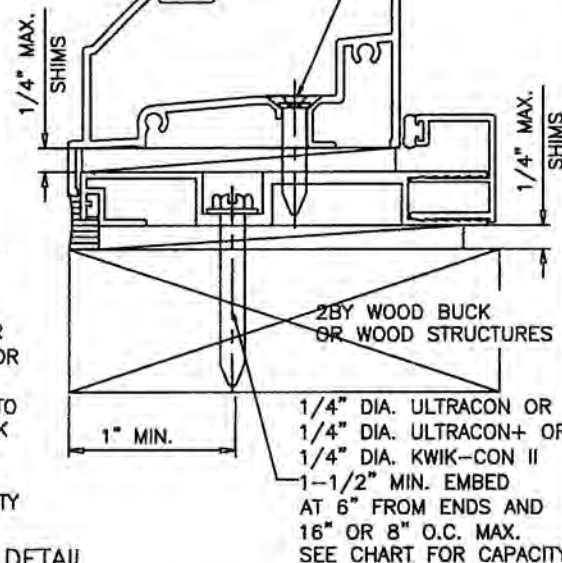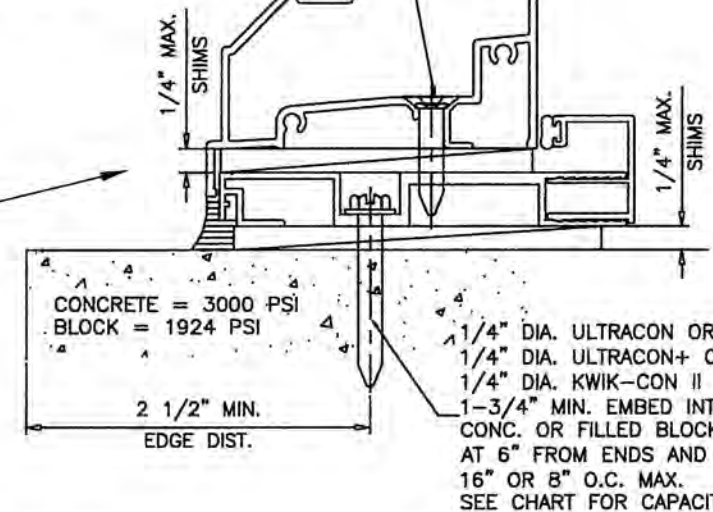

**TYPICAL INSTALLATION DETAIL
ON ALL FOUR SIDES/USING ALUMINUM BUCK SYSTEM**

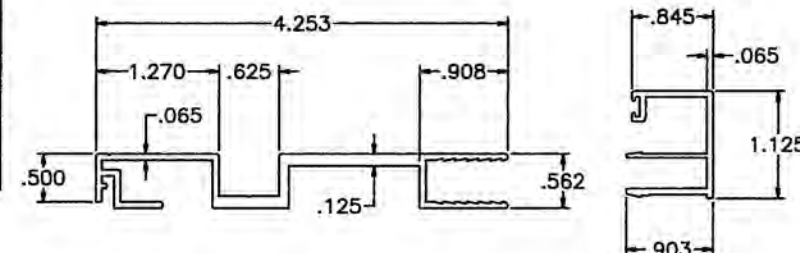

ALUMINUM BUCK
6063-T6

OPTIONAL COVER
6063-T6


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**

Expiration Date **05/05/2025**

By
Miami-Dade Product Control

Revision: A) NO CHANGES THIS SHEET.
AK - 06/29/20

WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432	PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600 REGISTRATION #29286	1/10/2020 Date	ALAN KINNE Drawn By	SH360LM-NOA DWG No.	13 OF 14 Sheet	SH360 Series Desc. Title

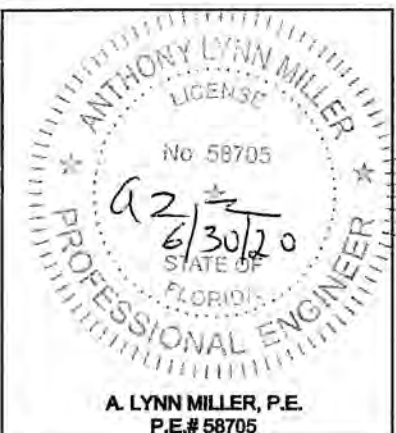

A. LYNN MILLER, P.E.
P.E.# 58705

**PERFORMANCE VALUES
OF ALUMINUM BUCK
INSTALLATION ANCHORS**
EXT.(+) & INT.(-)


WINDOW DIMS.		ANCHORS INTO HOLLOW BLOCK				ANCHORS INTO CONC.				ANCHORS INTO WOOD			
WIDTH	HEIGHT	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8
24"	48"	89.3	178.7	210.0	210.0	140.0	210.0	210.0	210.0	120.0	210.0	210.0	210.0
30"		78.0	155.9	210.0	210.0	122.2	210.0	210.0	210.0	104.7	209.5	210.0	210.0
32"		75.4	150.8	210.0	210.0	118.1	210.0	210.0	210.0	101.3	202.5	210.0	210.0
36"		71.5	142.9	210.0	210.0	112.0	210.0	210.0	210.0	96.0	192.0	210.0	210.0
42"		68.1	136.1	204.2	210.0	106.7	210.0	210.0	210.0	91.4	182.9	210.0	210.0
48"		67.0	134.0	201.0	210.0	105.0	210.0	210.0	210.0	90.0	180.0	210.0	210.0
54"		67.0	134.0	201.0	210.0	105.0	210.0	210.0	210.0	90.0	180.0	210.0	210.0
24"		67.0	134.0	201.0	210.0	105.0	210.0	210.0	210.0	90.0	180.0	210.0	210.0
30"	60"	57.2	114.3	171.5	210.0	89.6	179.2	210.0	210.0	76.8	153.6	210.0	210.0
32"		54.8	109.6	164.5	210.0	85.9	171.8	210.0	210.0	73.6	147.3	210.0	210.0
36"		51.0	102.1	153.1	204.2	80.0	160.0	210.0	210.0	68.6	137.1	205.7	210.0
42"		47.1	94.2	141.4	188.5	73.8	147.7	210.0	210.0	63.3	126.6	189.9	210.0
48"		44.7	89.3	134.0	178.7	70.0	140.0	210.0	210.0	60.0	120.0	180.0	210.0
54"		43.3	86.6	129.9	173.3	67.9	135.8	203.6	210.0	58.2	116.4	174.5	210.0
24"		53.6	107.2	160.8	210.0	84.0	168.0	210.0	210.0	72.0	144.0	210.0	210.0
30"		45.1	90.3	135.4	180.5	70.7	141.5	210.0	210.0	60.6	121.3	181.9	210.0
32"	72"	43.1	86.1	129.2	172.3	67.5	135.0	202.5	210.0	57.9	115.7	173.6	210.0
36"		39.7	79.4	119.1	158.8	62.2	124.4	186.7	210.0	53.3	106.7	160.0	210.0
42"		36.0	72.1	108.1	144.1	56.5	112.9	169.4	210.0	48.4	96.8	145.2	193.6
48"		33.5	67.0	100.5	134.0	52.5	105.0	157.5	210.0	45.0	90.0	135.0	180.0
54"		31.8	63.5	95.3	127.1	49.8	99.6	149.3	199.1	42.7	85.3	128.0	170.7
24"		44.7	89.3	134.0	178.7	70.0	140.0	210.0	210.0	60.0	120.0	180.0	210.0
30"		37.3	74.6	111.9	149.1	58.4	116.9	175.3	210.0	50.1	100.2	150.3	200.3
32"		35.5	70.9	106.4	141.9	55.6	111.2	166.8	210.0	47.6	95.3	142.9	190.6
36"	84"	32.5	65.0	97.5	129.9	50.9	101.8	152.7	203.6	43.6	87.3	130.9	174.5
42"		29.2	58.3	87.5	116.7	45.7	91.4	137.1	182.9	39.2	78.4	117.6	156.7
48"		26.8	53.6	80.4	107.2	42.0	84.0	126.0	168.0	36.0	72.0	108.0	144.0
54"		25.1	50.2	75.2	100.3	39.3	78.6	117.9	157.2	33.7	67.4	101.1	134.7
24"		38.3	76.6	114.9	153.1	60.0	120.0	180.0	210.0	51.4	102.9	154.3	205.7
30"		31.8	63.5	95.3	127.1	49.8	99.6	149.3	199.1	42.7	85.3	128.0	170.7
32"		30.1	60.3	90.4	120.6	47.2	94.5	141.7	189.0	40.5	81.0	121.5	162.0
36"		27.5	55.0	82.5	109.9	43.1	86.2	129.2	172.3	36.9	73.8	110.8	147.7
42"	96"	24.5	49.0	73.5	98.0	38.4	76.8	115.2	153.6	32.9	65.8	98.7	131.7
48"		22.3	44.7	67.0	89.3	35.0	70.0	105.0	140.0	30.0	60.0	90.0	120.0
54"		20.7	41.4	62.1	82.9	32.5	64.9	97.4	129.9	27.8	55.7	83.5	111.3
24"		33.5	67.0	100.5	134.0	52.5	105.0	157.5	210.0	45.0	90.0	135.0	180.0
30"		27.7	55.3	83.0	110.7	43.4	86.7	130.1	173.4	37.2	74.3	111.5	148.6
32"		26.2	52.4	78.7	104.9	41.1	82.2	123.3	164.3	35.2	70.4	105.7	140.9
36"		23.8	47.6	71.5	95.3	37.3	74.7	112.0	149.3	32.0	64.0	96.0	128.0
42"		21.1	42.2	63.4	84.5	33.1	66.2	99.3	132.4	28.4	56.7	85.1	113.5
48"	108"	19.1	38.3	57.4	76.6	30.0	60.0	90.0	120.0	25.7	51.4	77.1	102.9
24"		29.8	59.6	89.3	119.1	46.7	93.3	140.0	186.7	40.0	80.0	120.0	160.0
30"		24.5	49.0	73.5	98.0	38.4	76.8	115.2	153.6	32.9	65.8	98.7	131.7
32"		23.2	46.4	69.6	92.8	36.3	72.7	109.0	145.4	31.2	62.3	93.5	124.6
36"		21.0	42.0	63.1	84.1	32.9	65.9	98.8	131.8	28.2	56.5	84.7	112.9
42"		18.6	37.1	55.7	74.3	29.1	58.2	87.3	116.4	24.9	49.9	74.8	99.7

**ANCHORS AT
ALUMINUM BUCK FRAMING
(AT MULLION ENDS)**


FOR WINDOW ANCHORING TO
ALUMINUM BUCKS USE #14 SCREWS
SPACED AS PER SHEETS 11 & 12.

**PERFORMANCE VALUES
OF ALUMINUM BUCK
INSTALLATION ANCHORS**
EXT.(+) & INT.(-)

WINDOW DIMS.		ANCHORS INTO HOLLOW BLOCK				ANCHORS INTO CONC.				ANCHORS INTO WOOD			
WIDTH	HEIGHT	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8	CLUSTER OF 2	CLUSTER OF 4	CLUSTER OF 6	CLUSTER OF 8
19-1/8"	26"	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0
26-1/2"		210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0
37"		210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0
53-1/8"		210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0	210.0
19-1/8"	38-3/8"	140.1	210.0	210.0	210.0	210.0	210.0	210.0	210.0	188.2	210.0	210.0	210.0
26-1/2"		115.9	210.0	210.0	210.0	181.7	210.0	210.0	210.0	155.7	210.0	210.0	210.0
37"		105.0	209.9	210.0	210.0	164.5	210.0	210.0	210.0	141.0	210.0	210.0	210.0
53-1/8"		104.8	209.6	210.0	210.0	164.3	210.0	210.0	210.0	140.8	210.0	210.0	210.0
19-1/8"	50-5/8"	98.3	196.6	210.0	210.0	154.0	210.0	210.0	210.0	132.0	210.0	210.0	210.0
26-1/2"		77.9	155.9	210.0	210.0	122.1	210.0	210.0	210.0	104.7	209.4	210.0	210.0
37"		64.9	129.9	194.8	210.0	101.8	203.5	210.0	210.0	87.2	174.5	210.0	210.0
53-1/8"		60.2	120.5	180.7	210.0	94.4	188.8	210.0	210.0	80.9	161.8	210.0	210.0
19-1/8"	63"	75.5	151.0	210.0	210.0	118.4	210.0	210.0	210.0	101.4	202.9	210.0	210.0
26-1/2"		58.5	117.1	175.6	210.0	91.7	183.5	210.0	210.0	78.6	157.3	210.0	210.0
37"		46.9	93.8	140.6	187.5	73.5	146.9	210.0	210.0	63.0	125.9	188.9	210.0
53-1/8"		39.9	79.7	119.6	159.5	62.5	125.0	187.5	210.0	53.6	107.1	160.7	210.0
19-1/8"	72"	64.6	129.3	193.9	210.0	101.3	202.6	210.0	210.0	86.8	173.7	210.0	210.0
26-1/2"		49.6	99.2	148.7	198.3	77.7	155.4	210.0	210.0	66.6	133.2	199.8	210.0
37"		39.0	78.0	117.0	156.0	61.1	122.2	183.3	210.0	52.4	104.8	157.1	209.5
53-1/8"		32.0	64.0	95.9	127.9	50.1	100.2	150.3	200.4	43.0	85.9	128.9	171.8
19-1/8"	76"	60.7	121.5	182.2	210.0	95.2	190.4	210.0	210.0	81.6	163.2	210.0	210.0
26-1/2"		46.4	92.8	139.2	185.7	72.7	145.5	210.0	210.0	62.3	124.7	187.0	210.0
37"		36.3	72.6	108.8	145.1	56.9	113.7	170.6	210.0	48.7	97.5	146.2	194.9
53-1/8"		29.4	58.8	88.2	117.6	46.1	92.1	138.2	184.2	39.5	79.0	118.4	157.9

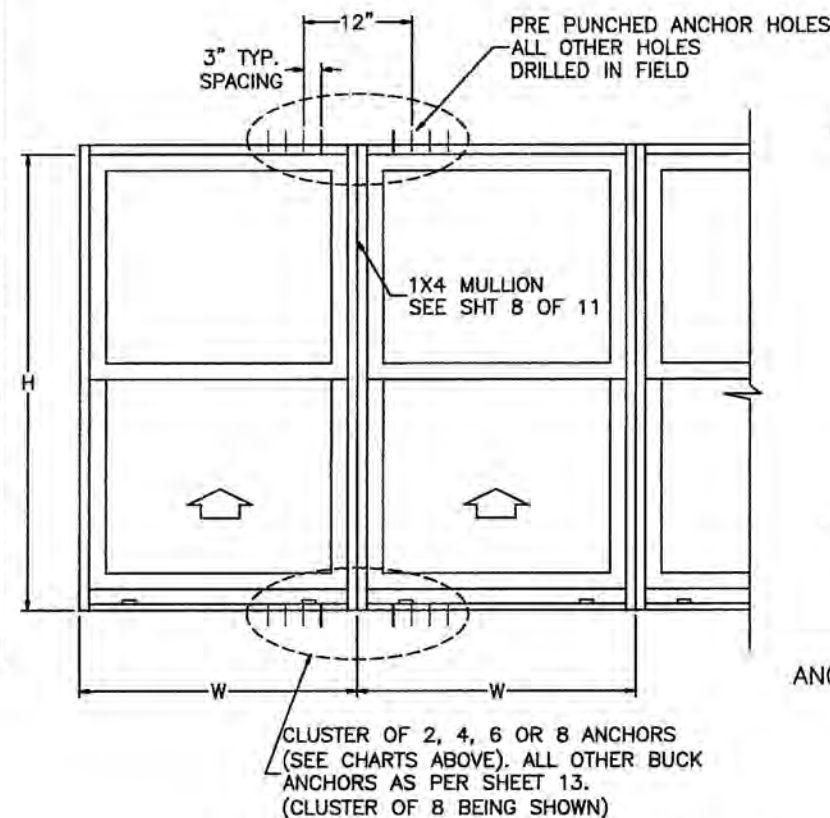

NOTE: ALUMINUM BUCKS ARE SUPPLIED WITH
CLUSTER OF 2 (1 SCREW HOLE PER SIDE) STANDARD.
EXTRA HOLES MUST BE FIELD DRILLED IF REQUIRED.

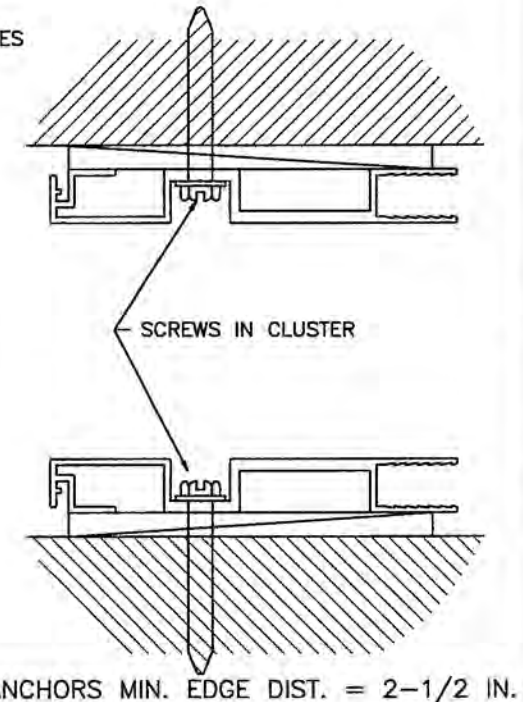

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **20-0722.20**
Expiration Date **05/05/2025**
By 
Miami-Dade Product Control

A) NO CHANGES THIS SHEET.
AK - 06/29/20

PREPARED BY A. LYNN MILLER 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 (941) 480-1600		REGISTRATION #29296		1/10/2020		A	
WINDOOR® INCORPORATED 104 TRIPLE DIAMOND BLVD NORTH VENICE, FL 34275 (833) 554-5432		SERIES "360" ALUM SINGLE HUNG WDW (LM/SMI)		ALUMINUM BUCK		SH360LM-NOA	
14 OF 14		14 OF 14		14 OF 14		14 OF 14	
14 OF 14		14 OF 14		14 OF 14		14 OF 14	

