



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
 BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**Stanley Access Technologies, LLC**  
**65 Scott Swamp Road**  
**Farmington, CT 06032**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Dura Storm" Aluminum Automatic Sliding Glass Door: O-Sx-Sx-O, O-Sx and So-Sx-Sx-So, So-Sx w/ Operable Panels w/ Full Breakout-LMI**

**APPROVAL DOCUMENT:** Drawing No. **33189** (former **14-1856**), titled "Series Dura-Storm 2000/3000 Auto SGD, Bi-Parting/Single Slide (LMI)", sheets 1 thru 14 of 14 prepared by Engineering Express, dated 07/01/12, and last revised on 11/24/2020, signed and sealed by Frank L. Bennardo, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact**

**LIMITATIONS:**

1. See elevation for anchors requirements in sheet **1** and Header clusters details in sheet **5** and Threshold clusters in sheet **9**. See sheets **2 & 3** for concealed 3-point locking (active panel) & 2-point (in-active). Also see applicable 2-point **G-86** CVR panic devices (active/inactive panels) for series **3000** in sheets **3 & 4** to be used w/ Horizontal muntin bars (detail V, sheet 12) and DLO height not to exceed 36-3/4" max.
2. Not approved where water infiltration is required. Fixed glass more than 36" wide must be supported with approved setting blocks per FBC requirements.
3. Electrical devices, functions and installation are not part of this approval and are to be reviewed and approved by Authority Having Jurisdiction (AHJ).

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.



*Ishag I. Chande*

**Stanley Access Technologies, LLC**

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises #18-0221.11** and consists of page 1, this page 2 and evidence pages E-1, E-2, E-3 & E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.** *Ishaq I. Chanda*



**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA'S**

**A. DRAWINGS**

1. Manufacturer's die drawings and sections (submitted under file see below).
2. Drawing No. **14-1856** (former **12-SAT-13**), titled "Dura-Storm 2000/3000 Auto SGD, Bi-Parting/Single Slide-LMI", sheets 1 thru 14 of 14 prepared by Engineering Express, dated 07-01-12 and last revised on 10/15/2014, signed and sealed by Frank L. Bennardo, P.E.

**B. TESTS (submitted under files #13-0529.23/#12-0807.03)**

1. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94 (Not conducted)
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with installation diagram of aluminum automatic entrance doors Sx-So w/ G-86 CVR Panic (TAS 202, 201/203-94) and So-Sx-Sx-So w/ Transom & G-86 CVR Panic (TAS 202), prepared by Fenestration Testing Laboratory, Inc. Test Report No. **FTL-7247**, dated 3/08/13, signed and sealed by Marlin D. Brinson, P. E

2. Test reports on:
  - 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94 (Not conducted)
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with installation diagram of aluminum automatic entrance doors, prepared by Fenestration Testing Laboratory, Inc. Test Report No. **FTL-6803**, dated 05/11/12 and last revised on 03/21/13, signed and sealed by Marlin D. Brinson, P. E.

Note: This test report has been revised by an addendum letter dated Nov 21, 2012, issued by Fenestration Testing Lab, signed and sealed by Marlin D. Brinson, P. E.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with FBC-2014 (5<sup>th</sup> Edition), prepared by Engineering Express, dated 05-13-15, signed and sealed by Frank L. Bennardo, P.E.
2. Glazing complies w/ ASTM E-1300-02, -04 & -09.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 20-1216.27**  
**Expiration Date: April 04, 2023**  
**Approval Date: February 04, 2021**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **13-1105.10** issued to SAF-GLAS, L.L.C. for “**SAF GLAS, Polycarbonate laminate**”, expiring on 12/16/17.
2. Notice of Acceptance No. **11-0624.01** issued to E.I. DuPont DeNemours & Co., Inc. for their “**DuPont PVB Butacite ®**”, expiring on 12/11/16.
3. Technical strength data of Trelleborg EPDM per ASTM C864.

**F. STATEMENTS**

1. Statement letter of conformance to FBC 2014(5<sup>th</sup> Edition), prepared by Engineering Express, dated May 13, 2015, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter of no financial interest, prepared by Engineering Express, dated 08-02-12, signed and sealed by Frank L. Bennardo, P.E. (submitted under file # **12-0807.03**)
3. Lab compliance as part of the above referenced test report.

**G. OTHER**

1. This NOA **revises** NOA #**13-0529.23**, expiring 04/04/18.
2. Test proposals # 13-0006 dated 01/14/13 approved by RER and # 11-1016, dated NOV 11, 2011 approved by PERA and Test proposal # 11-1016, dated NOV 11, 2011 approved by PERA.
3. Manufacture supplied Adam Rites deadbolt/hook & bolts mechanism and G-86 CVR Panic exit brochures.

**2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 17-0828.11**

**A. DRAWINGS**

1. Drawing No. **14-1856**, titled “Series Dura-Storm 2000/3000 Auto SGD, Bi-Parting/Single Slide (LMI)”, sheets 1 thru 14 of 14 prepared by Engineering Express, dated 07/01/12 and last revised on 08/23/17, signed and sealed by Frank L. Bennardo, P.E.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. Anchor verification calculations and structural analysis, complying with **FBC 6<sup>th</sup> Edition (2017)**, prepared by Engineering Express, dated 08/07/17, signed and sealed by Frank L. Bennardo, P.E.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **16-1117.01** issued Kuraray America, Inc. (formerly DuPont) for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**”, expiring on 07/08/19.

*Ishaq I. Chanda*

---

Ishaq I. Chanda, P.E.  
Product Control Unit Supervisor  
NOA No. 20-1216.27  
Expiration Date: April 04, 2023  
Approval Date: February 04, 2021

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

**F. STATEMENTS**

1. Statement letter of conformance with **FBC 6<sup>th</sup> Edition (2017)**, prepared by Engineering Express, dated 07/31/17, signed and sealed by Frank L. Bennardo, P.E.

**G. OTHER**

1. This NOA **revises** NOA #15-0127.07, expiring on 04/04/18.

**3. NEW EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. None.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **17-1026.04** issued to SAF-GLAS, L.L.C. for “**SAF GLAS, Polycarbonate laminate**”, expiring on 12/16/22.
2. Notice of Acceptance No. **17-1114.14** issued Kuraray America, Inc. (formerly DuPont) for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**”, expiring on 07/08/19.

**F. STATEMENTS**

1. None.

**G. OTHER**

1. This NOA **renews** NOA #17-0828.11, expiring on 04/04/18.

**4. New EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Drawing No. **33189** (former **14-1856**), titled “Series Dura-Storm 2000/3000 Auto SGD, Bi-Parting/Single Slide (LMI)”, sheets 1 thru 14 of 14 prepared by Engineering Express, dated 07/01/12, and last revised on 11/24/2020, prepared by Engineering Express, signed and sealed by Frank L. Bennardo, P.E.

**B. TESTS**

1. None.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 20-1216.27**  
**Expiration Date: April 04, 2023**  
**Approval Date: February 04, 2021**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **17-1026.04** issued to SAF-GLAS, L.L.C. for “**SAF GLAS, Polycarbonate laminate**”, expiring on 12/16/22.
2. Notice of Acceptance No. **19-0305.02** issued to **Kuraray America, Inc.** for their “**Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers**”, expiring on 07/08/24.

**F. STATEMENTS**

1. Statement letter of conformance to FBC 2020 (7<sup>th</sup> Edition), prepared by Engineering Express, dated 11/11/20, signed and sealed by Frank L. Bennardo, P.E.
2. Statement letter dated 11/25/20 referenced to general updated code note change only, prepared by Engineering Express, dated 11/25/20, signed and sealed by Frank L. Bennardo, P.E.

**G. OTHER**

1. This NOA revises NOA #**18-0221.11**, expiring 04/04/23.

*Ishaq I. Chanda*



---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 20-1216.27**  
**Expiration Date: April 04, 2023**  
**Approval Date: February 04, 2021**


# DURA-STORM SERIES 2000/3000 TYPICAL ELEVATIONS (MISSILE LEVEL D)

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. 20-1216.27  
 Expiration Date 04/04/2023


FRANK BENNARDI, P.E.  
 PE# 0046549 CA. 9885

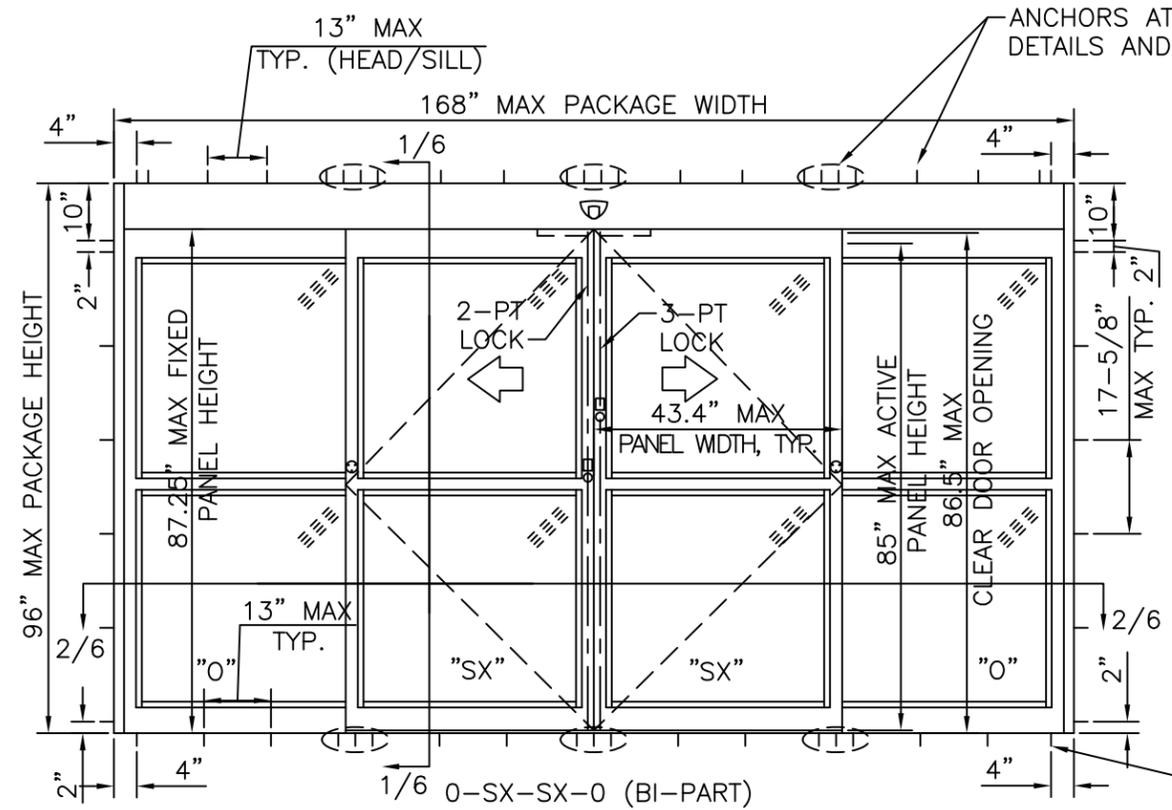


**DURA-STORM 2000 TYPICAL ELEVATIONS**

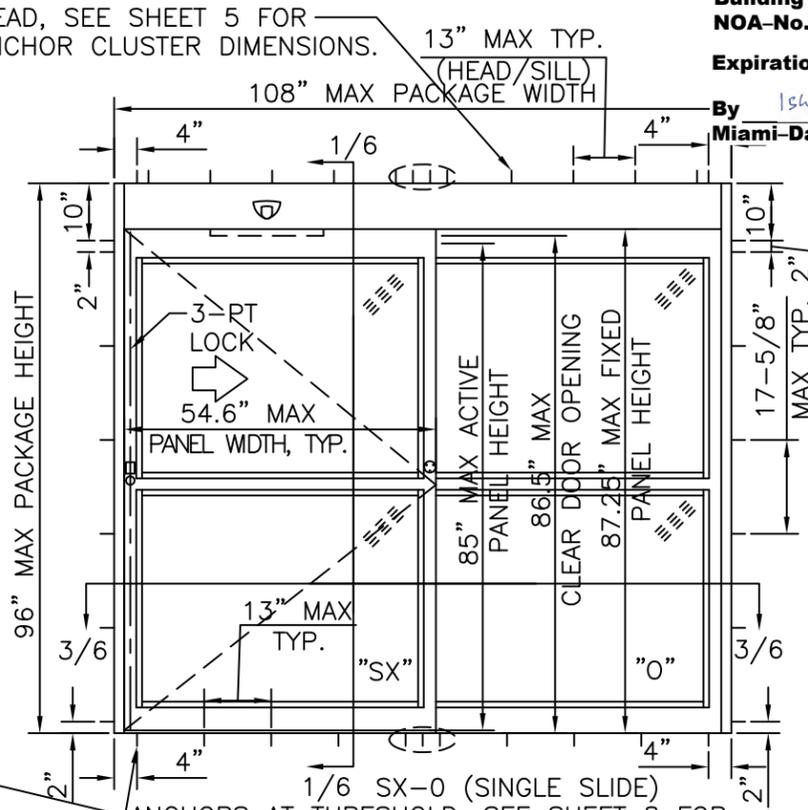

**DURA-STORM 2000 TYPICAL ELEVATIONS**

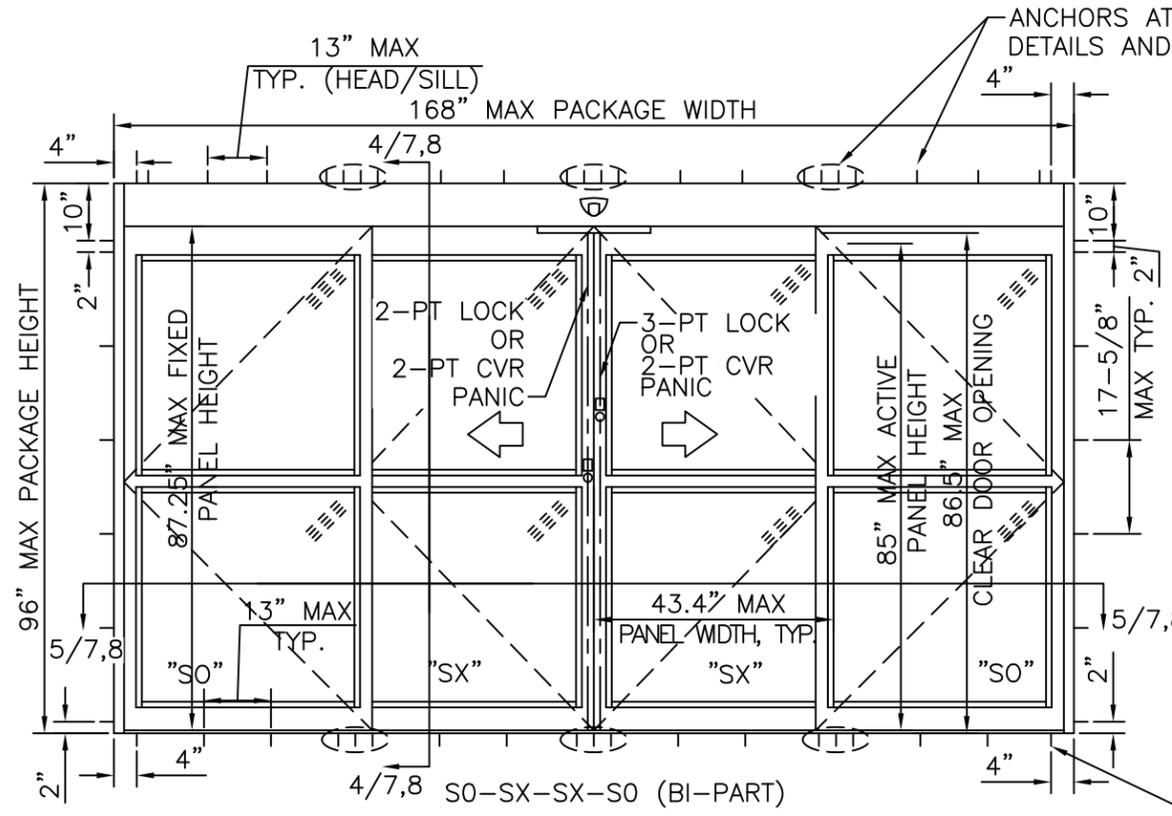

**DURA-STORM 3000 TYPICAL ELEVATIONS**

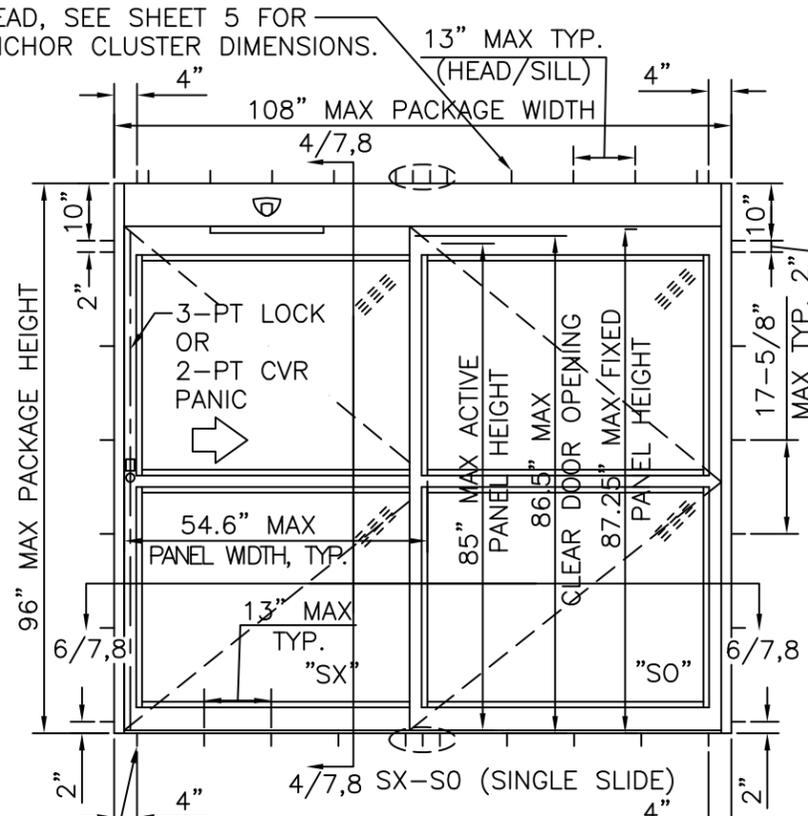

**DURA-STORM 3000 TYPICAL ELEVATIONS**

By *Shay L. Chanik*  
**Miami-Dade Product Control**

**GENERAL NOTES**

- DOORS HAVE BEEN TESTED & DESIGNED IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE SEVENTH EDITION (2020) HIGH VELOCITY HURRICANE ZONE (HVHZ) AND MIAMI-DADE COUNTY PROTOCOLS TAS 201 FOR LARGE MISSILE IMPACT, TAS 202 FOR UNIFORM STATIC AIR PRESSURE AND TAS 203 FOR CYCLIC WIND LOADING.
- PERMIT HOLDER SHALL VERIFY THE ADEQUACY OF THE EXISTING STRUCTURE TO WITHSTAND ADDITIONAL IMPOSED LOADS. 1X OR 2X WOOD BUCKS BY OTHERS SHALL BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE EXISTING STRUCTURE.
- NO INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THESE PRODUCTS. WIND LOAD DURATION FACTOR Cd = 1.6 WAS USED FOR WOOD ANCHOR DESIGN.
- POSITIVE AND NEGATIVE DESIGN PRESSURES CALCULATED FOR USE WITH THIS SYSTEM SHALL BE DETERMINED PER SEPARATE ENGINEERING IN ACCORDANCE WITH THE GOVERNING CODE. PRESSURE REQUIREMENTS AS DETERMINED IN ACCORDANCE WITH ASCE 7 AND CHAPTER 1609 OF THE FLORIDA BUILDING CODE SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.
- DESIGN PRESSURES NOTED HEREIN ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
- DOORS DETAILED HEREIN HAVE BEEN DESIGNED AND TESTED TO THE MAXIMUM SPANS AND LOADS SHOWN ON THESE DRAWINGS REFERENCE FENESTRATION TESTING LAB REPORTS 6803 & 7247.
- ANCHORS SHALL BE INSTALLED PER MANUFACTURER'S SPECIFICATIONS, SPACED AS NOTED HEREIN. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- WOOD HOST STRUCTURE SHALL BE "SOUTHERN PINE" G=0.55 OR GREATER DENSITY.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT INTO PLYWOOD.
- THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT FOR INSTALLATIONS OUTSIDE THE HVHZ; WITHIN THE HVHZ, A ONE-TIME APPROVAL FROM MIAMI-DADE COUNTY SHALL BE OBTAINED.
- ALL BOLTS AND WASHERS SHALL BE ZINC COATED, GALVANIZED, OR STAINLESS STEEL WITH A MINIMUM TENSILE STRENGTH OF 60 KSI, EXCEPT INSTALLATION ANCHORS.
- ALL SINGLE SLIDE ENTRANCES ARE SHOWN "RIGHT HAND"; "LEFT HAND" IS MIRROR IMAGE.

**SYSTEM NOTES**

- ALL ALUMINUM PARTS SHALL BE 6063-T6 ALUMINUM ALLOY AND TEMPER, UNLESS OTHERWISE NOTED.
- GLAZING 9/16" LAMINATED IMPACT RATED (SEE GLAZING DETAILS SHEET 12)
- CORNER PANEL CONSTRUCTION: PANEL CORNERS ARE BUTT JOINED, SECURED WITH FOUR (4) FULL WIDTH 5/16" THREADED TIE RODS AT TOP RAIL, INTERMEDIATE HORIZONTAL MUNTIN BAR, AND BOTTOM RAIL. ALL JOINTS ARE WELDED. EXCEPTION: WHEN PANIC EXIT DEVICE IS INSTALLED, CORRESPONDING 4 1/4" MUNTIN BAR IS SECURED BY APPROVED CLIPS. (ITEM #79, SHEET 12, DETAIL V)
- THE GLAZING MATERIAL IN BOTH FIXED AND SLIDING PANELS OF ALL SLIDING DOORS MUST COMPLY WITH THE REQUIREMENTS IN THE PERFORMANCE SPECIFICATIONS AND METHODS OF TEST FOR SAFETY GLAZING MATERIALS USED IN BUILDINGS, PER FBC REQUIREMENTS.
- CVR = CONCEALED VERTICAL ROD.

**ENGINEERING EXPRESS**  
 CORPORATE OFFICE:  
 160 SW 12th AVE, SUITE 106  
 DEERFIELD BEACH, FL 33442  
 (954) 354-0660 | (866) 396-9999  
 TEAM@ENGINEERINGEXPRESS.COM  
 ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
 FARMINGTON, CT 06032

**STANLEY Security**  
 ACCESS TECHNOLOGIES  
 SERIES "DURA-STORM 2000/3000" AUTO SGD  
 BI-PARTING / SINGLE SLIDE (LMI)  
 MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DATE
REV. FBC 6TH EDITION	08/23/17
REV. FBC 7TH EDITION	11/17/20

20-33189

SCALE: NTS UNLESS NOTED


VISIT [ECALC.IO/33189](http://ECALC.IO/33189) SCAN HERE:  
 FOR HELPFUL RESOURCES, SITE SPECIFIC JOB ORDERING & MORE INFORMATION ABOUT THIS PRODUCT & RELATED SERVICES

# DURA-STORM SERIES 2000 ELEVATION AND PLAN

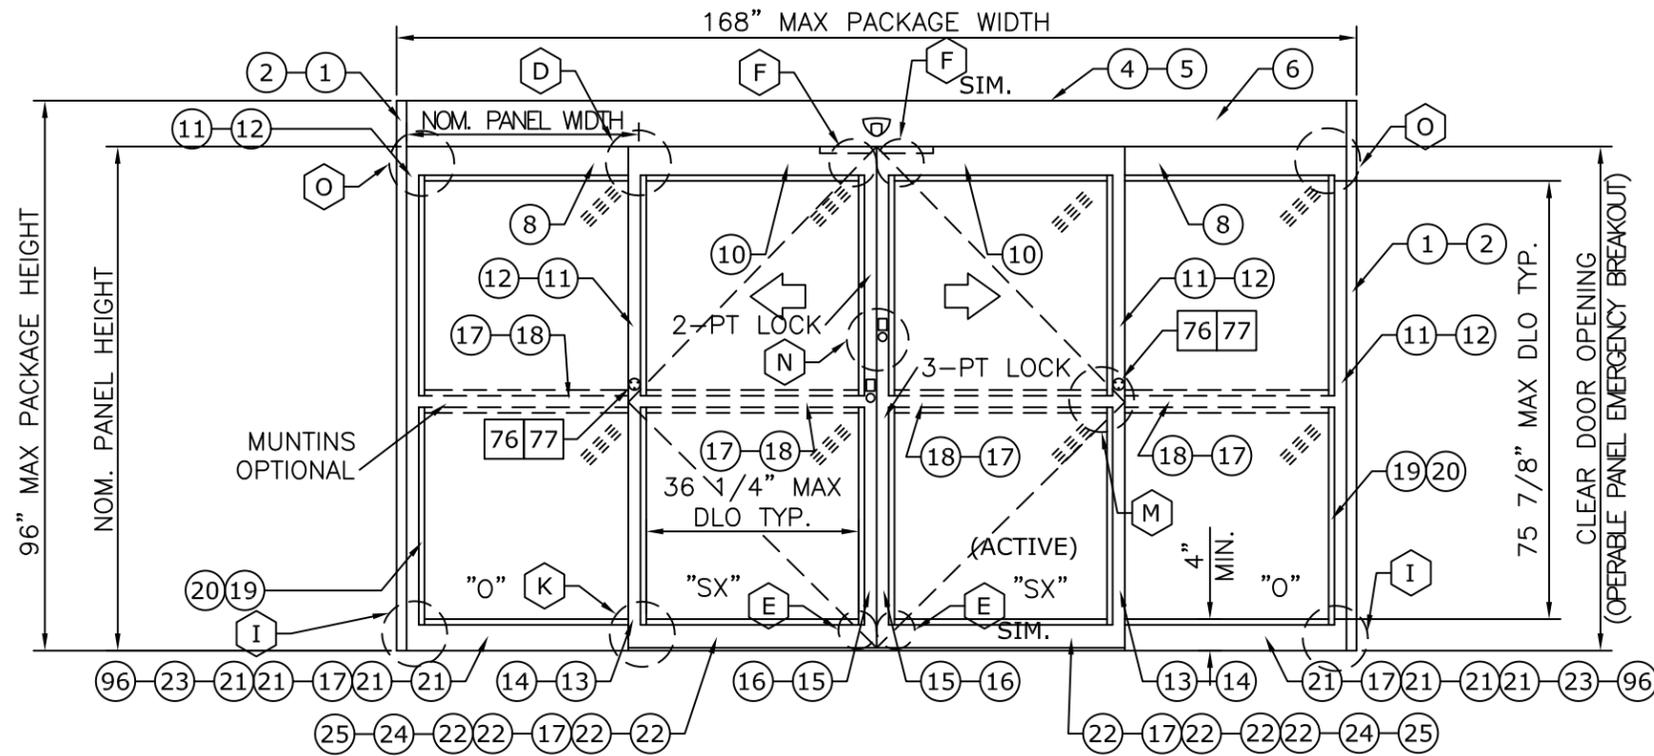

**EXTERIOR ELEVATION**

- (XX) : EXTRUSION
- (XX)(XX) : EXTRUSION, MULTI-PIECE
- (XX)-(XX) : EXTRUSION, OPTION
- (XX) : PART
- (XX)(XX) : PART, MULTI-PIECE
- (XX)-(XX) : PART, OPTION
- (XX) : DETAIL
- (XX)-(XX) : DETAIL, OPTION

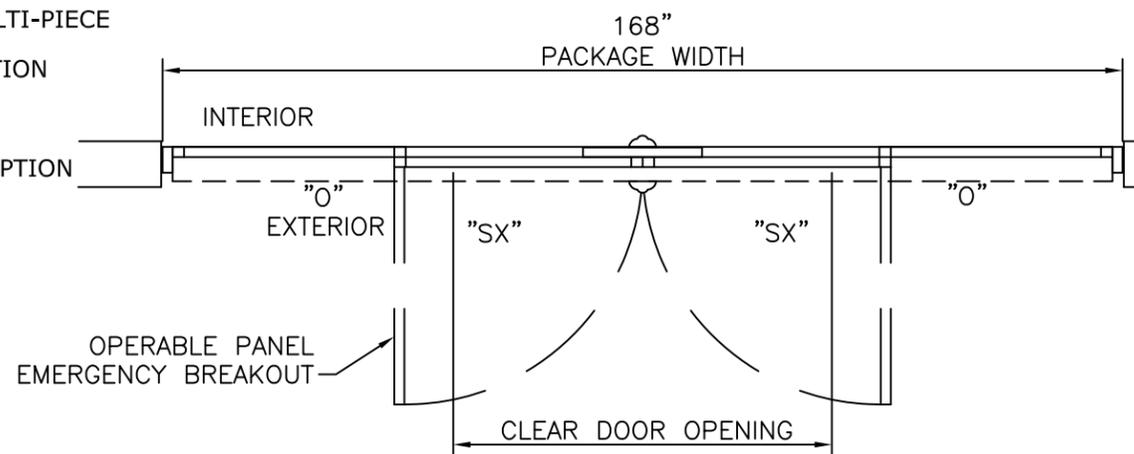

**PLAN**

**NOTES**

1. TYPICAL DOOR SHOWN. STILE, RAIL AND MUNTIN OPTIONS AVAILABLE AS INDICATED.
2. HORIZONTAL MUNTIN BAR NOT REQUIRED AS INDICATED BY DASHED LINES. MAX DLO: 36 1/4" W X 75 3/4" H AS SHOWN
3. 5-POINT LOCKING STANDARD (3-PT ACTIVE & 2-PT). SEE SHEET 13.
4. PRODUCT SHALL BE MANUFACTURED AND INSTALLED IN ACCORDANCE WITH PRODUCT APPROVALS.
5. SEE SHEETS 5, 6 AND 9 FOR REQUIRED ANCHORAGE.
6. SEE SHEET 12 FOR GLAZING DETAILS.

DESIGN RATINGS		
MISSILE IMPACT RATING		
<input checked="" type="checkbox"/>	LARGE AND SMALL MISSILE IMPACT	
DESIGN PRESSURE RATING (PSF[Pa])		
	WHERE WATER INFILTRATION RATING IS REQUIRED	WHERE WATER INFILTRATION RATING IS NOT REQUIRED
POSITIVE	NOT APPROVED	75 PSF
NEGATIVE	NOT APPROVED	75 PSF

SERIES 2000 BI-PART AVAILABLE PACKAGE WIDTH INFORMATION						
PACKAGE WIDTH	ROUGH OPENING	STILE TYPE	NOMINAL CLEAR DOOR OPENING	NOMINAL PANEL WIDTH (SX)	NOMINAL PANEL WIDTH (O)	CAULKING ALLOWANCE
168.0"	168.5"	NARROW	70.6"	42.7"	42.7"	1/4" / SIDE
168.0"	168.5"	MEDIUM	66.3"	43.4"	43.4"	1/4" / SIDE


SERIES 2000 BI-PART AVAILABLE PACKAGE HEIGHT INFORMATION			
PACKAGE HEIGHT	ROUGH OPENING	NOMINAL CLEAR DOOR OPENING	CAULKING ALLOWANCE
96.0"	96.3"	86.5"	1/4" TOP

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 20-1216.27

Expiration Date 04/04/2023

By *Ishay L. Chandra*  
Miami-Dade Product Control

FRANK BENNARDO, P.E.  
PE# 0046549 CA, 9885



**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20


COPYRIGHT ENGINEERING EXPRESS®

20-33189

SCALE: NTS UNLESS NOTED


02 OF 14

# DURA-STORM SERIES 3000 ELEVATION AND PLAN

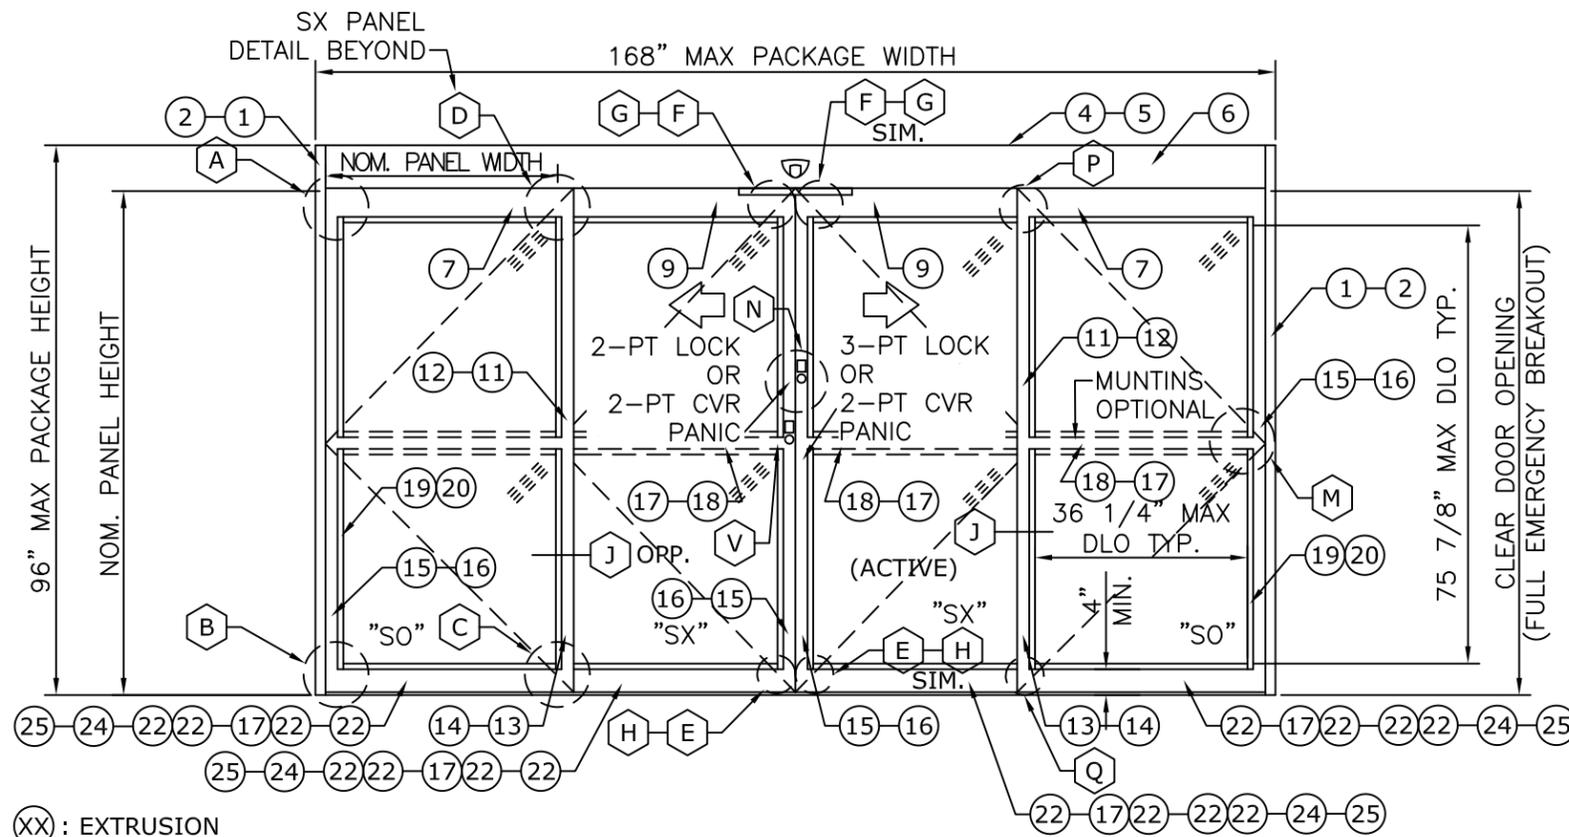

EXTERIOR ELEVATION

- (XX) : EXTRUSION
- (XX)(XX) : EXTRUSION, MULTI-PIECE
- (XX)-(XX) : EXTRUSION, OPTION
- XX : PART
- XXXX : PART, MULTI-PIECE
- XX-XX : PART, OPTION
- XX : DETAIL
- XX-XX : DETAIL, OPTION

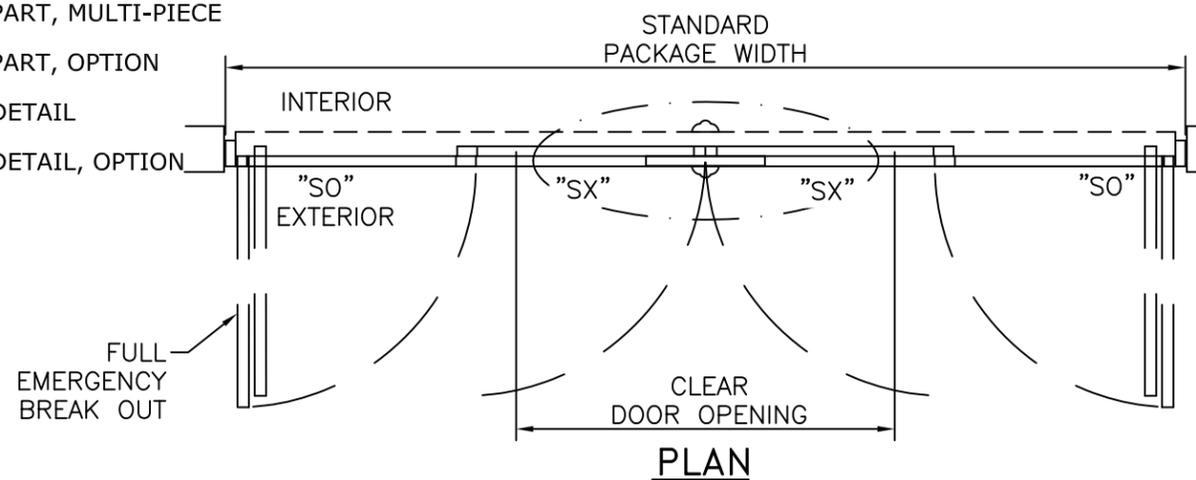

PLAN

**NOTES**

1. TYPICAL DOOR SHOWN. STILE, RAIL AND MUNTIN OPTIONS AVAILABLE AS INDICATED.
2. HORIZONTAL MUNTIN BAR NOT REQUIRED EXCEPT AT PANIC DEVICE, AS INDICATED BY DASHED LINES. MAX DLO: 36 1/4" W X 75 3/4" H AS SHOWN; 36 3/4" H WITH PANIC DEVICE MUNTIN.
3. 4-POINT CVR LOCKING WITH G86 PANIC RELEASE (2-PT CVR ACTIVE & 2-PT CVR) AND 5-POINT LOCKING (3-PT ACTIVE & 2-PT) AVAILABLE. SEE SHEET 13.
4. PRODUCT SHALL BE MANUFACTURED AND INSTALLED IN ACCORDANCE WITH PRODUCT APPROVALS.
5. SEE SHEETS 5, 7, 8, AND 9 FOR REQUIRED ANCHORAGE.
6. SEE SHEET 12 FOR GLAZING DETAILS.

DESIGN RATINGS		
MISSILE IMPACT RATING		
<input checked="" type="checkbox"/>	LARGE AND SMALL MISSILE IMPACT	
DESIGN PRESSURE RATING (PSF[Pa])		
	WHERE WATER INFILTRATION RATING IS REQUIRED	WHERE WATER INFILTRATION RATING IS NOT REQUIRED
POSITIVE	NOT APPROVED	75 PSF
NEGATIVE	NOT APPROVED	75 PSF

SERIES 3000 BI-PART AVAILABLE PACKAGE WIDTH INFORMATION						
PACKAGE WIDTH	ROUGH OPENING	STILE TYPE	NOMINAL CLEAR DOOR OPENING	NOMINAL PANEL WIDTH (SX)	NOMINAL PANEL WIDTH (O)	CAULKING ALLOWANCE
168.0"	168.5"	NARROW	70.6"	42.7"	42.7"	1/4" / SIDE
168.0"	168.5"	MEDIUM	66.3"	43.4"	43.4"	1/4" / SIDE

SERIES 3000 BI-PART AVAILABLE PACKAGE HEIGHT INFORMATION			
PACKAGE HEIGHT	ROUGH OPENING	NOMINAL CLEAR DOOR OPENING	CAULKING ALLOWANCE
96.0"	96.3"	86.5"	1/4" TOP


**PRODUCT REVISED**  
as complying with the Florida Building Code

NOA-No. 20-1216.27

Expiration Date 04/04/2023

By Ishay I. Chandra  
Miami-Dade Product Control

FRANK BENNARDI, P.E.  
PE# 0046549 CA, 9885



**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE


REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20

20-33189


SCALE: NTS UNLESS NOTED

03 OF 14


# DURA-STORM SERIES 2000/3000 SINGLE SLIDES, ELEVATION AND PLAN

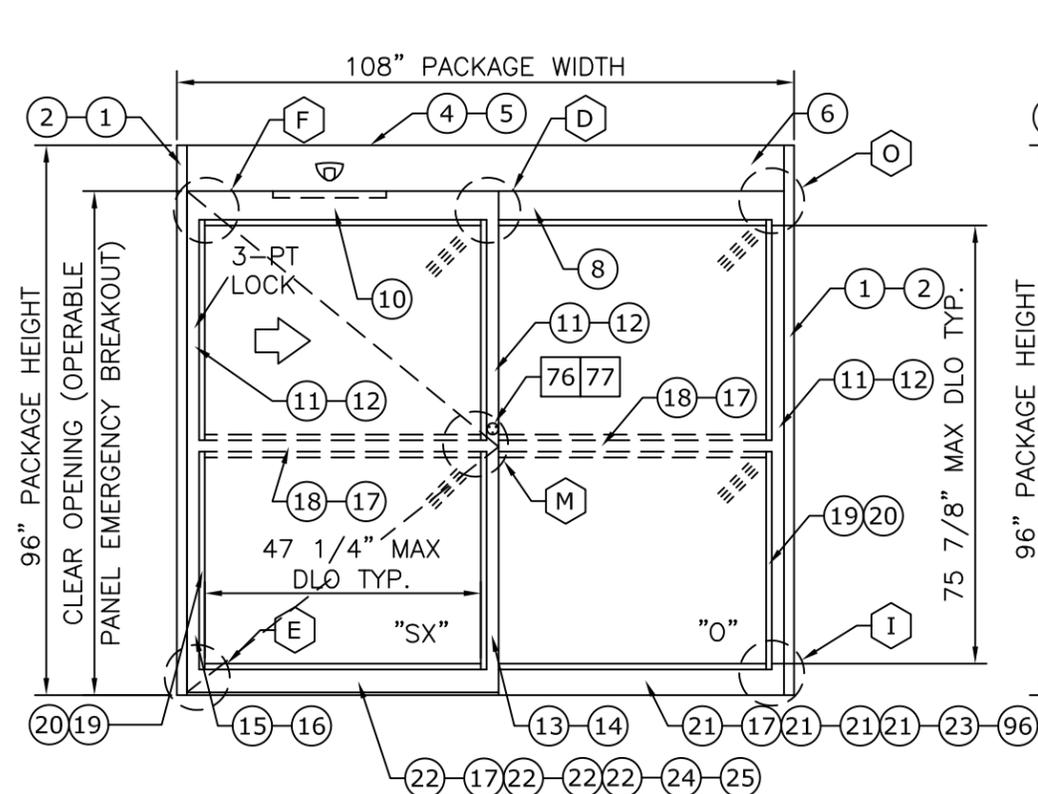


SERIES 2000 (SX-O) SINGLE SLIDE  
**EXTERIOR ELEVATION**

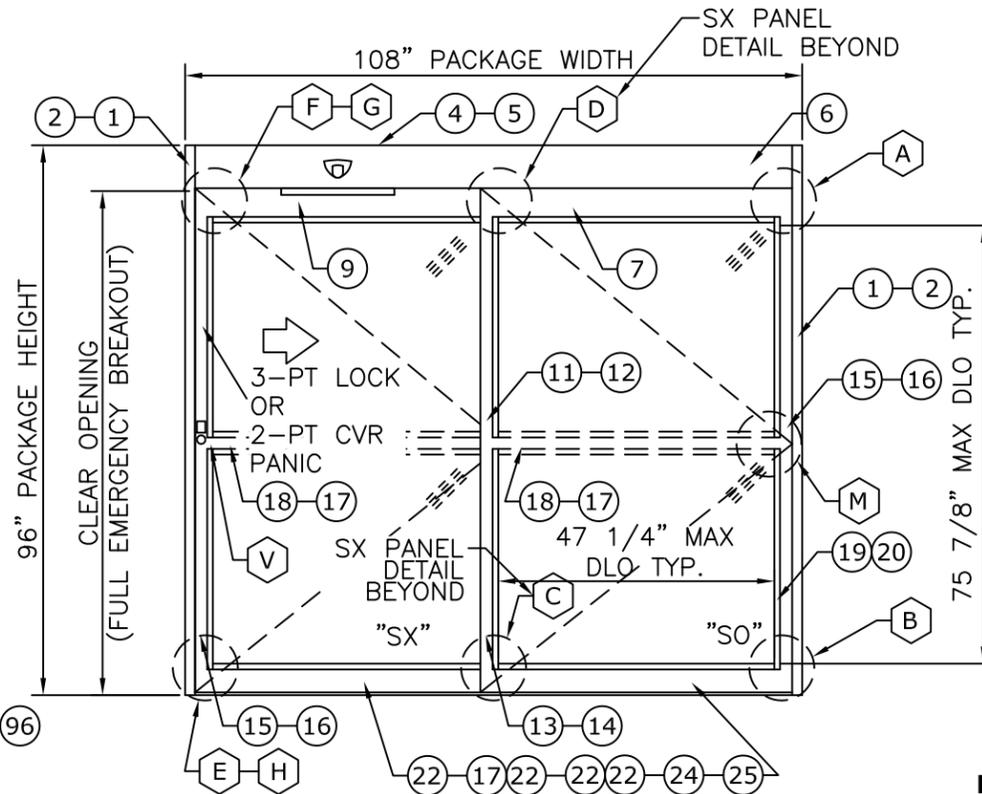

SERIES 3000 (SX-SO) SINGLE SLIDE  
**EXTERIOR ELEVATION**

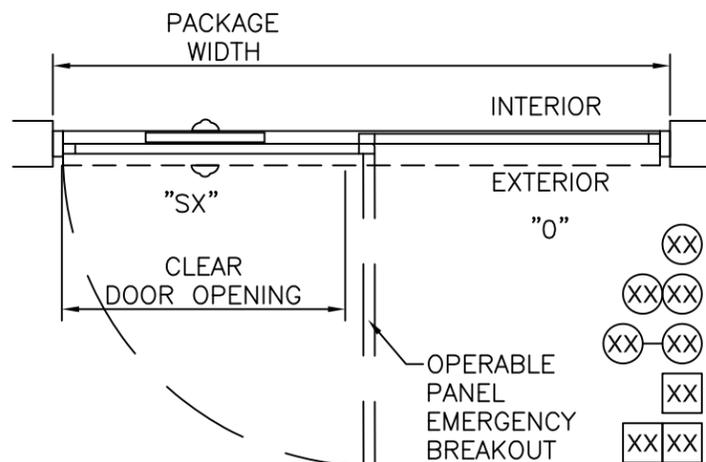

SERIES 2000 (SX-O) SINGLE SLIDE  
**PLAN**

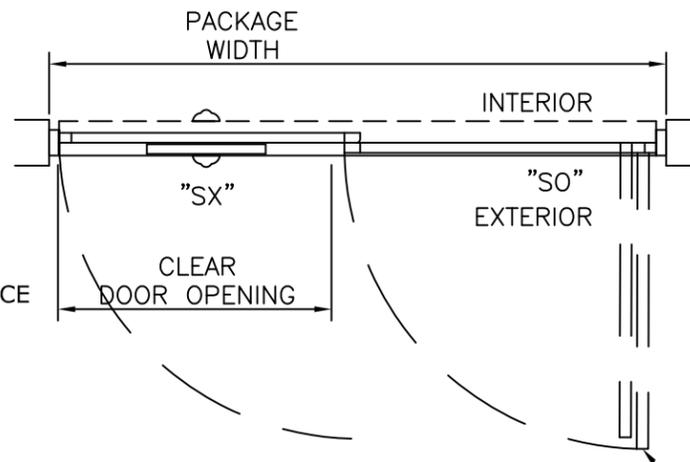

SERIES 3000 (SX-SO) SINGLE SLIDE  
**PLAN**

- (XX) : EXTRUSION
- (XX)(XX) : EXTRUSION, MULTI-PIECE
- (XX)-(XX) : EXTRUSION, OPTION
- (XX) : PART
- (XX)(XX) : PART, MULTI-PIECE
- (XX)-(XX) : PART, OPTION
- (XX) : DETAIL
- (XX)-(XX) : DETAIL, OPTION

DESIGN RATINGS		
MISSILE IMPACT RATING		
<input checked="" type="checkbox"/>	LARGE AND SMALL MISSILE IMPACT	
DESIGN PRESSURE RATING (PSF[Pa])		
	WHERE WATER INFILTRATION RATING IS REQUIRED	WHERE WATER INFILTRATION RATING IS NOT REQUIRED
POSITIVE	NOT APPROVED	75 PSF
NEGATIVE	NOT APPROVED	75 PSF


SERIES 2000 AND 3000 SINGLE SLIDE AVAILABLE PACKAGE WIDTH INFORMATION						
PACKAGE WIDTH	ROUGH OPENING	STILE TYPE	NOMINAL CLEAR DOOR OPENING	NOMINAL PANEL WIDTH (SX)	NOMINAL PANEL WIDTH (O)	CAULKING ALLOWANCE
108.0"	108.5"	NARROW	46.4"	53.8"	53.8"	1/4" / SIDE
108.0"	108.5"	MEDIUM	44.3"	54.6"	54.6"	1/4" / SIDE

SERIES 2000 AND 3000 SINGLE SLIDE AVAILABLE PACKAGE HEIGHT INFORMATION			
PACKAGE HEIGHT	ROUGH OPENING	NOMINAL CLEAR DOOR OPENING	CAULKING ALLOWANCE
96.0"	96.3"	86.5"	1/4" TOP

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 20-1216.27  
Expiration Date 04/04/2023  
By Ishag I. Chank  
Miami-Dade Product Control

**NOTES**

- TYPICAL DOOR SHOWN. STILE, RAIL AND MUNTIN OPTIONS AVAILABLE AS INDICATED.
- HORIZONTAL MUNTIN BAR NOT REQUIRED EXCEPT AT PANIC DEVICE AS INDICATED BY DASHED LINES. MAX DLO: 47 1/4" W X 76" H AS SHOWN; 36 3/4" H WITH PANIC DEVICE MUNTIN.
- 2-POINT CVR LOCKING WITH G86 PANIC RELEASE AND 3-POINT LOCKING AVAILABLE ON SERIES 3000. 3-POINT ONLY ON SERIES 2000. SEE SHEET 13.
- PRODUCT SHALL BE MANUFACTURED AND INSTALLED IN ACCORDANCE WITH PRODUCT APPROVALS.
- SEE SHEETS 5, 7, 8 AND 9 FOR REQUIRED ANCHORAGE.
- SEE SHEET 12 FOR GLAZING DETAILS.



**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20

COPYRIGHT ENGINEERING EXPRESS®



20-33189

SCALE: NTS UNLESS NOTED

04 OF 14

# DURA-STORM SERIES 2000/3000 HEADER ANCHORING

FRANK BENNARDI, P.E.  
PE# 0046549 CA. 9885

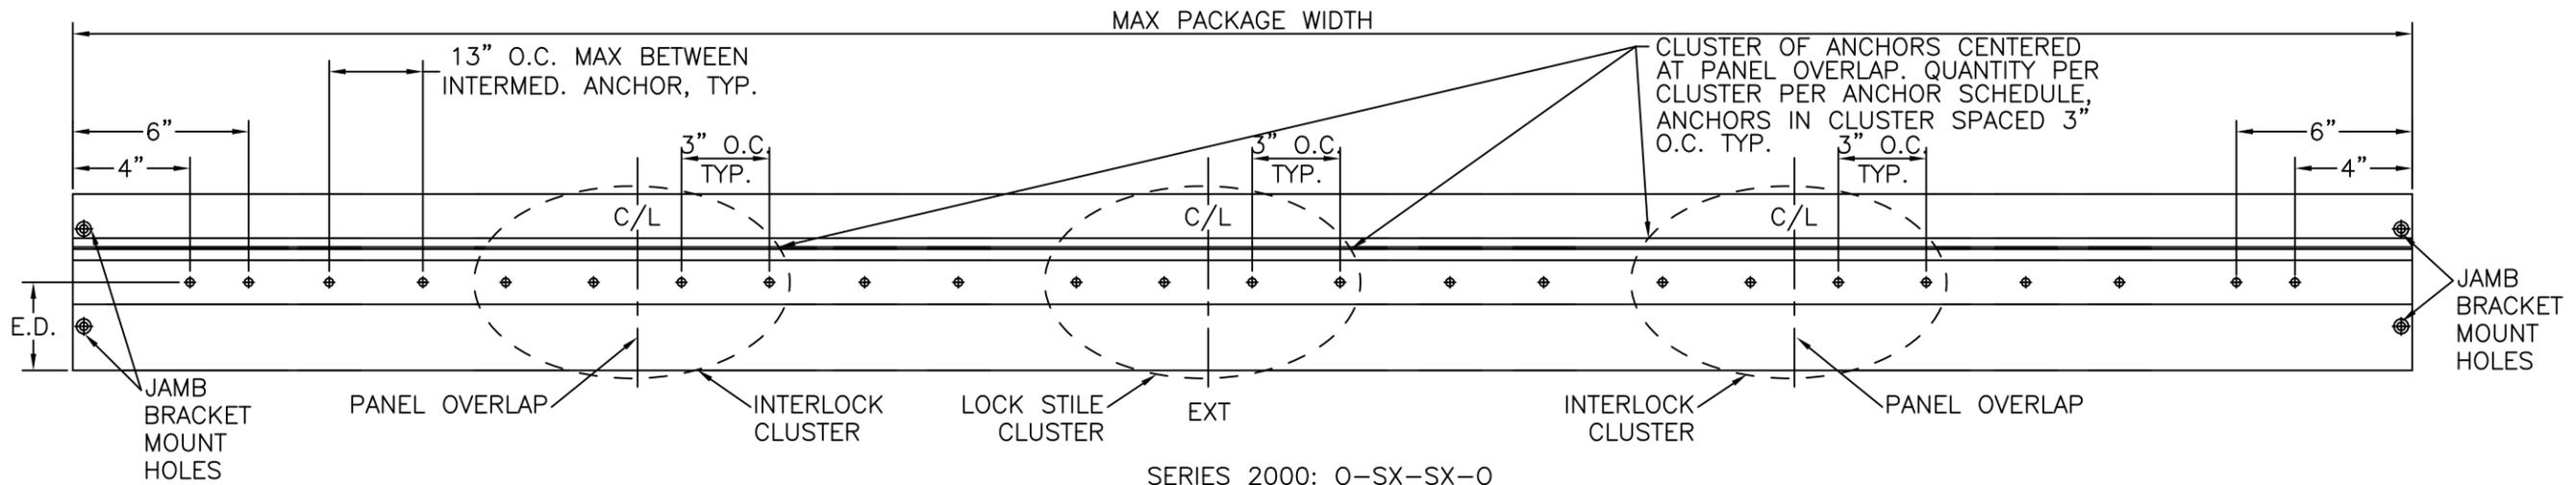


SERIES 2000: O-SX-SX-O  
SERIES 3000: SO-SX-SX-SO

## HEADER ANCHORING

N.T.S. BI-PARTING

**PRODUCT REVISED**  
as complying with the Florida  
**Building Code**  
**NOA-No.** 20-1216.27  
**Expiration Date** 04/04/2023  
**By** *Isheq I. Chandra*  
**Miami-Dade Product Control**

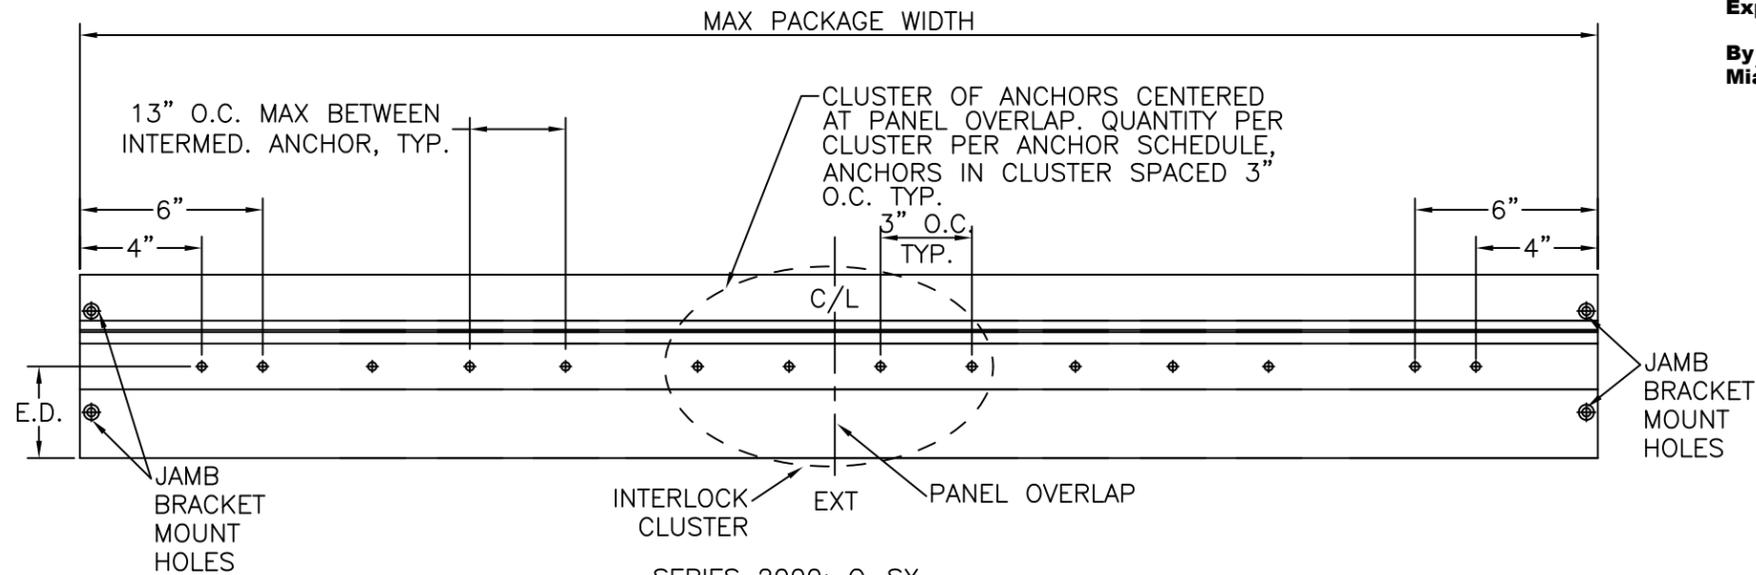

SERIES 2000: O-SX  
SERIES 3000: SO-SX

## HEADER ANCHORING

N.T.S. SINGLE SLIDE

SEE JAMB ANCHORS SHEETS 6 THROUGH 8, AND THRESHOLD ANCHORS SHEET 8. THRESHOLD ANCHORS APPLICABLE ONLY TO 3KSI CONCRETE.

### ANCHOR SCHEDULE

HOST STRUCTURE	ANCHOR	EMBEDMENT	EDGE DISTANCE	NUMBER OF ANCHORS PER INTERLOCK/LOCK STILE CLUSTER				MAX INTERMEDIATE ANCHOR SPACING ALONG HEAD & THRESHOLD	MAX ANCHOR SPACING ALONG JAMBS
				HEAD		THRESHOLD			
				SINGLE SLIDE	BI-PART	SINGLE SLIDE	BI-PART		
3KSI MIN. CONCRETE	1/4" POWERS/RAWL PERMASEAL TAPPER	1-1/2"	3"	4	4	6	6	13" O.C. MAX	17-5/8" O.C. MAX
3/16" MIN. A36 STEEL	1/4-20 SAE GR. 5 SMS	FULL THREAD ENGAGEMENT	1/2"	4	4	N/A	N/A	13" O.C. MAX	17-5/8" O.C. MAX
G=0.55 MIN. WOOD	#14 WOOD SCREW	2"	3/4"	4	4	N/A	N/A	13" O.C. MAX	17-5/8" O.C. MAX
0.090" MIN. 6063-T5 ALUM.	#14 SAE GR. 5 SDS	FULL THREAD ENGAGEMENT	1/2"	4	4	N/A	N/A	13" O.C. MAX	17-5/8" O.C. MAX

**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. 6TH EDITION	JMP	FLB	08/23/17
REV. 7TH EDITION	JEM	AJP	11/17/20

COPYRIGHT ENGINEERING EXPRESS®

20-33189

SCALE: NTS UNLESS NOTED

05 OF 14





# DURA-STORM SERIES 2000 SECTIONS & ANCHORING, STANDARD 5-PT LOCKS

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 20-1216.27

Expiration Date 04/04/2023

By *Ishtay I. Chank*  
Miami-Dade Product Control

FRANK BENNARDO, P.E.  
PE# 0046549 CA. 9885

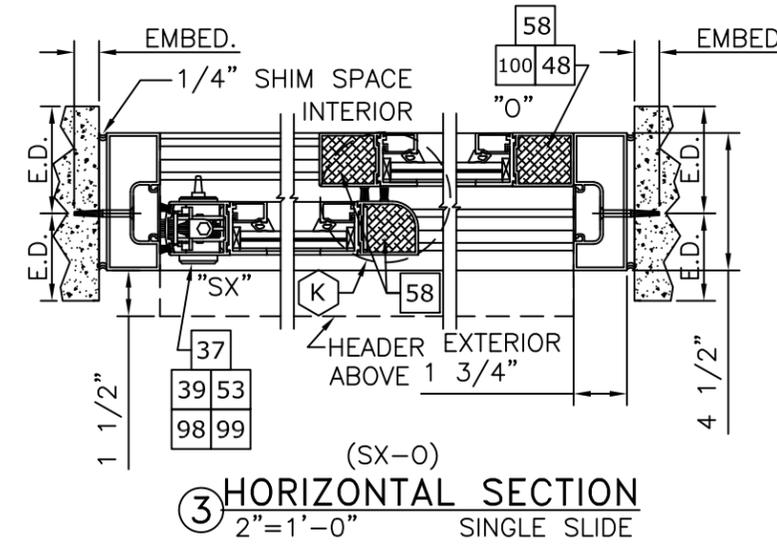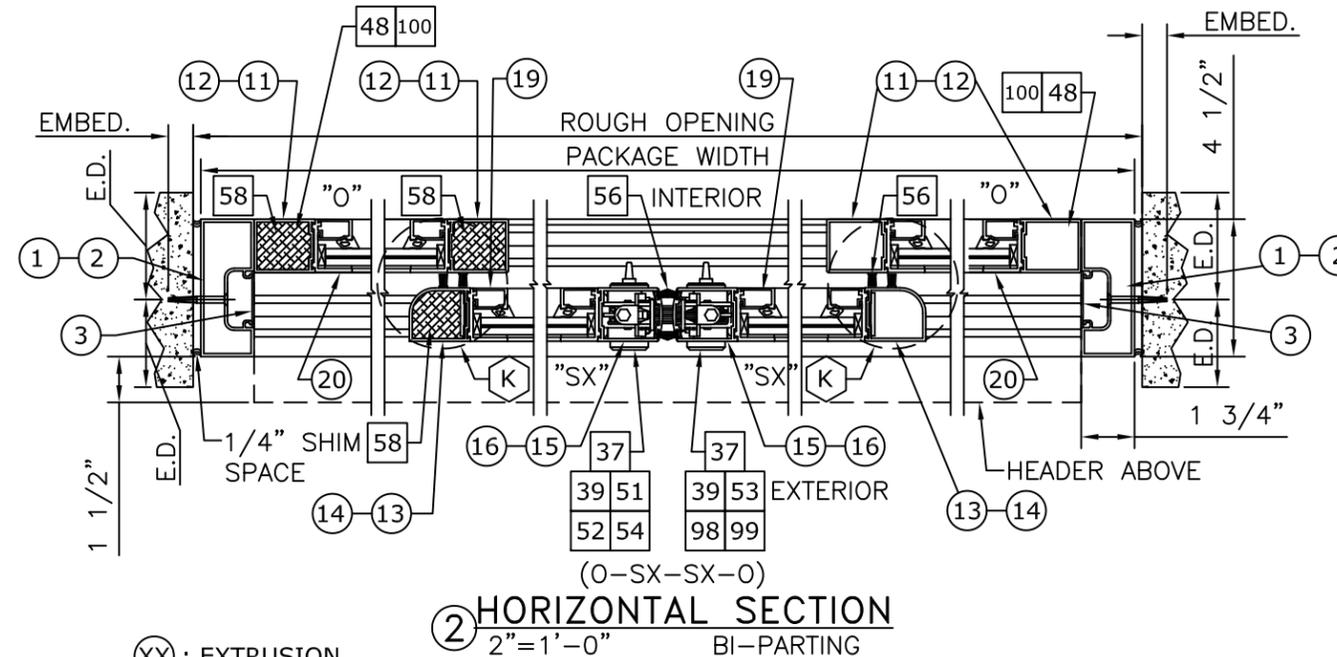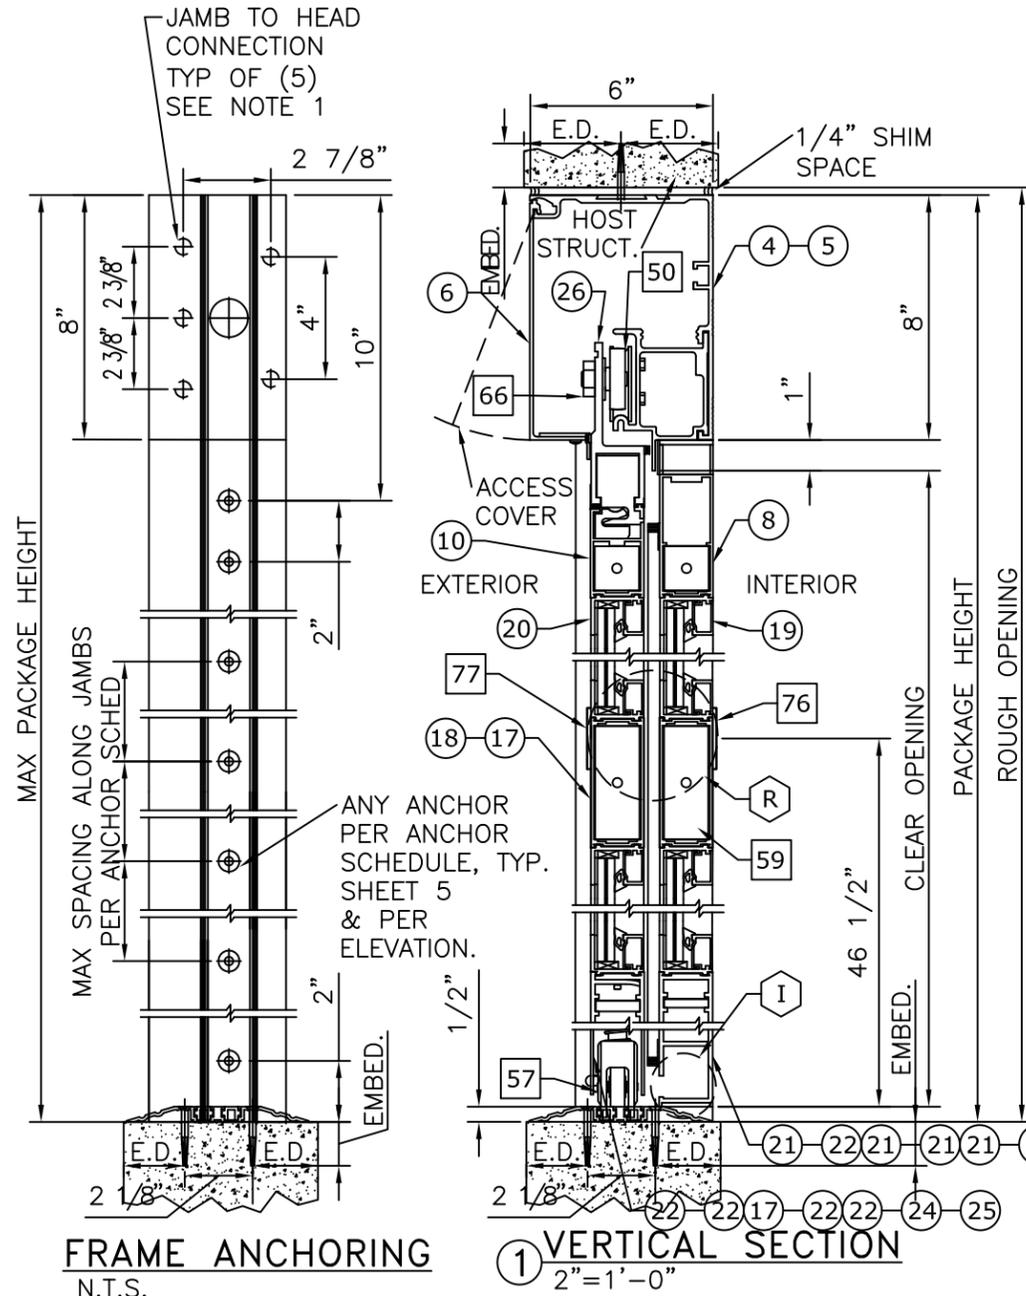

- ⊗ : EXTRUSION
- ⊗⊗ : EXTRUSION, MULTI-PIECE
- ⊗-⊗ : EXTRUSION, OPTION
- ⊞ : PART
- ⊞⊞ : PART, MULTI-PIECE
- ⊞-⊞ : PART, OPTION
- ⬡ : DETAIL
- ⬡⬡ : DETAIL, OPTION

SEE HEAD ANCHORS SHEET 5,  
AND THRESHOLD ANCHORS  
SHEET 9. THRESHOLD  
ANCHORS APPLICABLE ONLY  
TO 3KSI CONCRETE.

**FRAME ANCHORING**  
N.T.S.

**1 VERTICAL SECTION**  
2"=1'-0"

**2 HORIZONTAL SECTION**  
2"=1'-0" BI-PARTING

**3 HORIZONTAL SECTION**  
2"=1'-0" SINGLE SLIDE

NOTE: ITEM 58 "FOAM BLOCK" INSTALLED  
IN ALL STILES, EXCEPT LOCKING STILES.  
NOT SHOWN IN ALL STILES FOR CLARITY

- NOTES**
- JAMB TO HEAD CONNECTION FASTENERS; 5/16-18 HHMS WITH WASHER.
  - SEE SHEET 11 FOR STACKED BOTTOM RAIL OPTIONS.

**NOTE: SEE SHEET 5 FOR ANCHOR SCHEDULE  
AND ALLOWABLE ANCHOR TYPES**

**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES  
SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20

20-33189

SCALE: NTS UNLESS NOTED

OF 14  
**06**

# DURA-STORM SERIES 3000 SECTIONS & ANCHORING, STANDARD 5-PT LOCKS

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 20-1216.27

Expiration Date 04/04/2023

By *Ishaq I. Chank*  
Miami-Dade Product Control



**ENGINEERING EXPRESS®**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE



REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20

COPYRIGHT ENGINEERING EXPRESS®


20-33189

SCALE: NTS UNLESS NOTED

07 OF 14

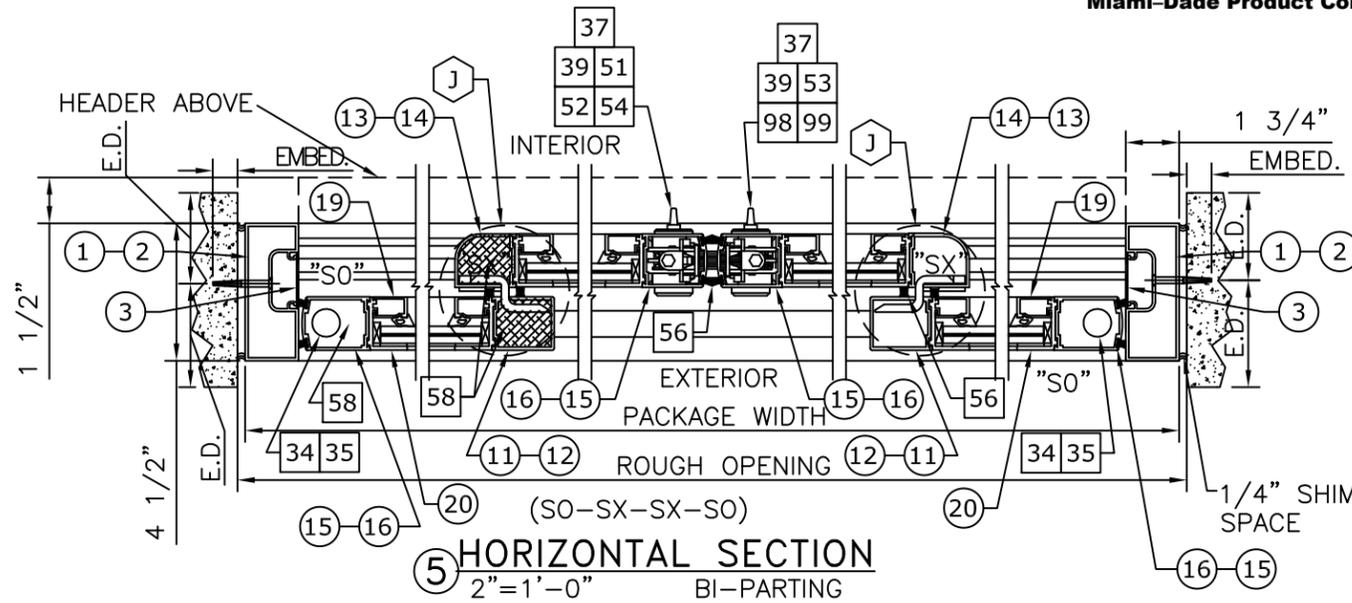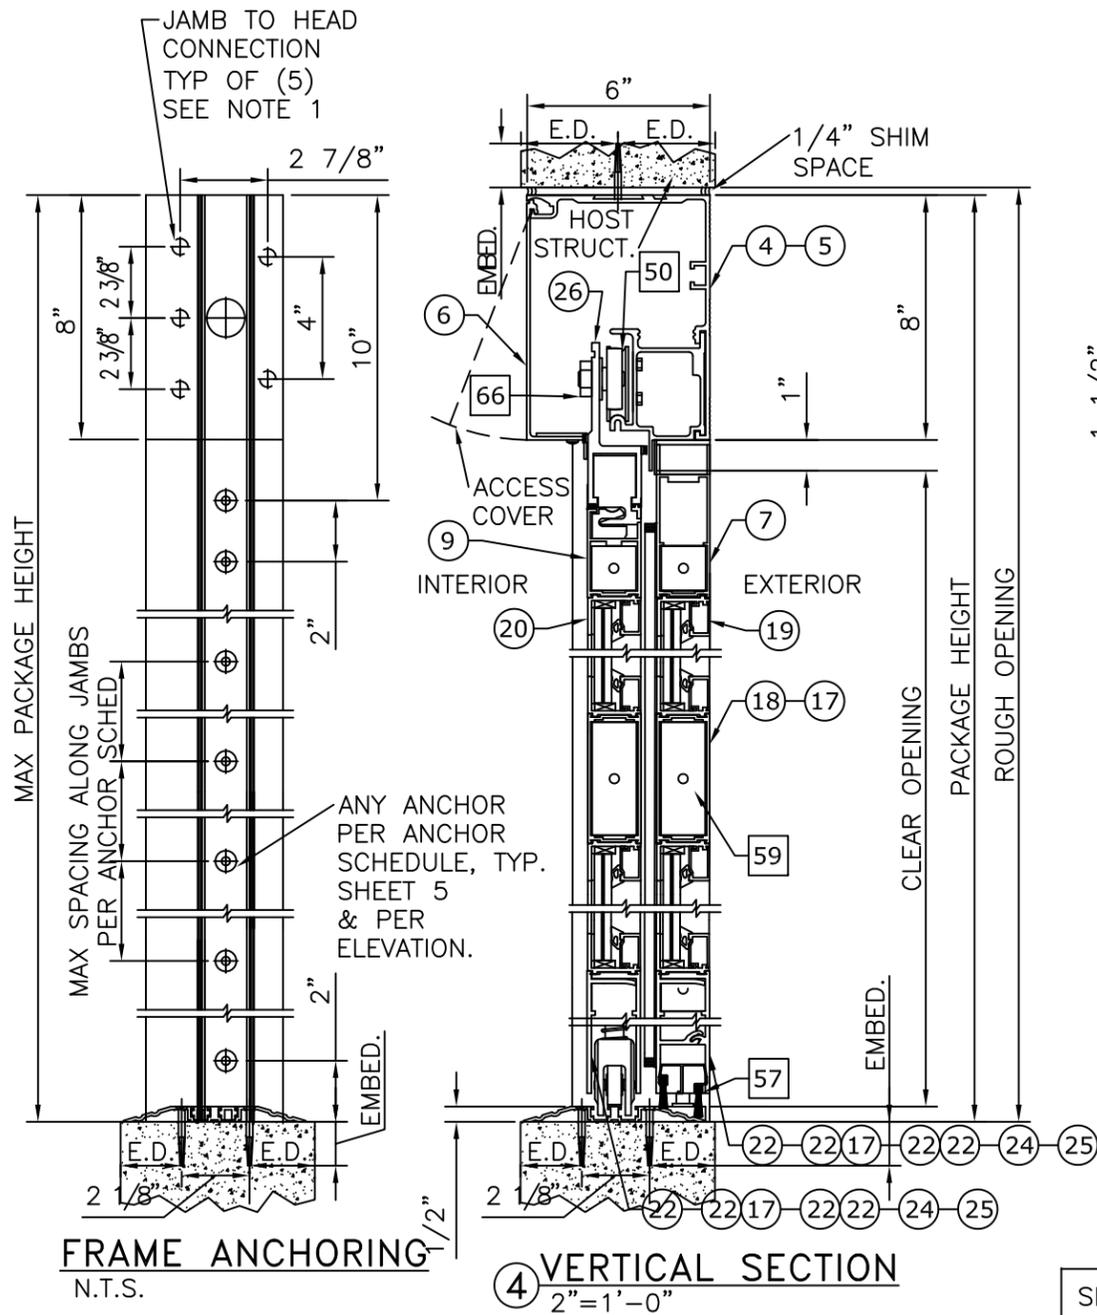

- XX : EXTRUSION
- XX-XX : EXTRUSION, MULTI-PIECE
- XX-XX : EXTRUSION, OPTION
- XX : PART
- XX-XX : PART, MULTI-PIECE
- XX-XX : PART, OPTION
- XX : DETAIL
- XX-XX : DETAIL, OPTION

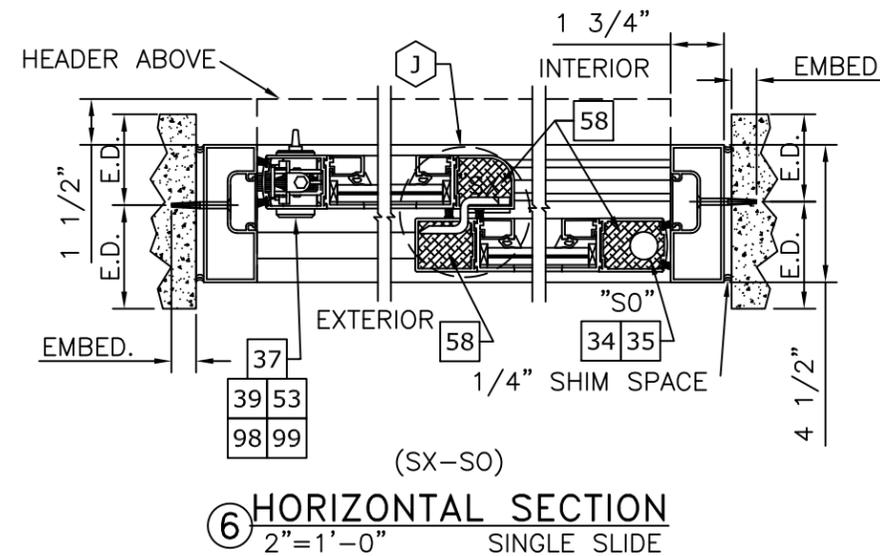

NOTE: ITEM 58 "FOAM BLOCK" INSTALLED  
IN ALL STILES, EXCEPT LOCKING STILES.  
NOT SHOWN IN ALL STILES FOR CLARITY

SEE HEAD ANCHORS SHEET 5,  
AND THRESHOLD ANCHORS  
SHEET 9. THRESHOLD  
ANCHORS APPLICABLE TO 3KSI  
CONCRETE ONLY.

NOTE: SEE SHEET 5 FOR ANCHOR SCHEDULE  
AND ALLOWABLE ANCHOR TYPES

**NOTES**

1. JAMB TO HEAD CONNECTION FASTENERS; 5/16-18 HHMS WITH WASHER.
2. SEE SHEET 11 FOR STACKED BOTTOM RAIL OPTIONS.


# DURA-STORM SERIES 3000 SECTIONS & ANCHORING, PANIC RELEASE 4-PT LOCKS

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 20-1216.27

Expiration Date 04/04/2023

By Ishag I. Chank  
Miami-Dade Product Control

FRANK BENNARDI, P.E.  
PE# 0046549 CA, 9885






**ENGINEERING EXPRESS®**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

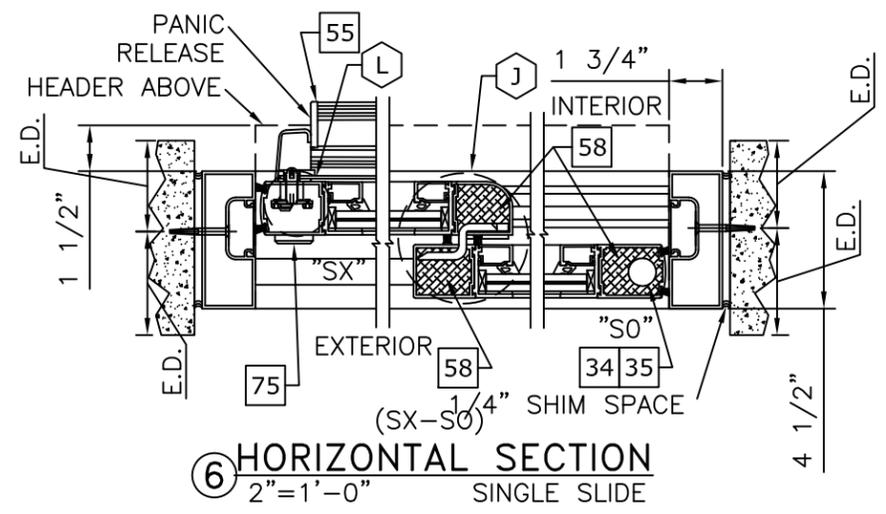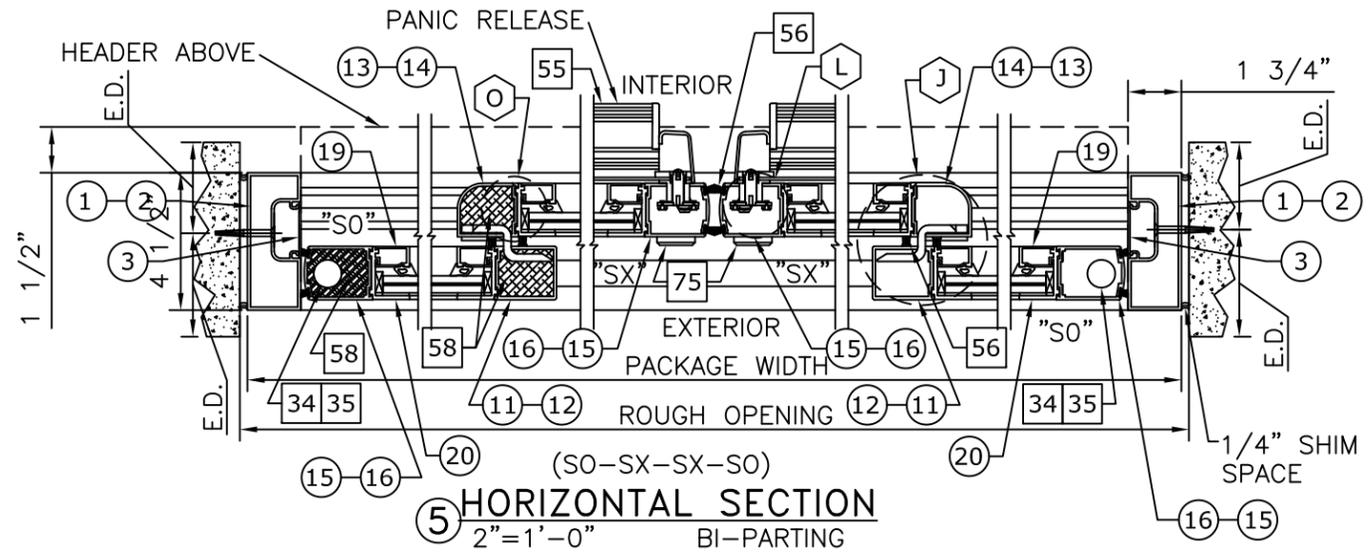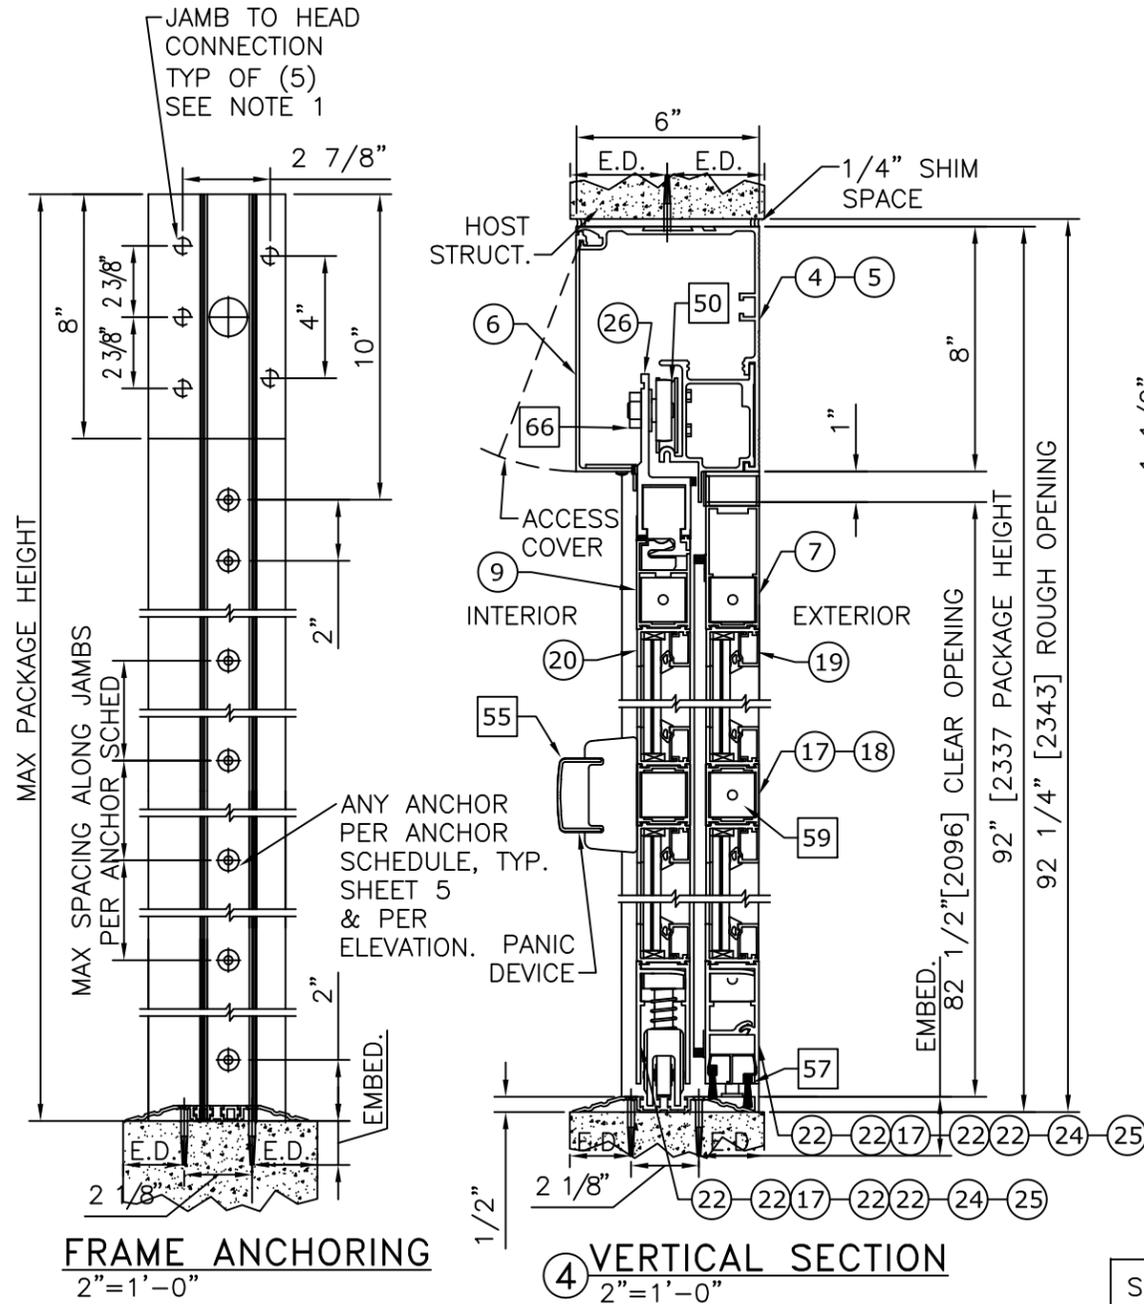

- ⊗ : EXTRUSION
- ⊗⊗ : EXTRUSION, MULTI-PIECE
- ⊗⊗⊗ : EXTRUSION, OPTION
- ⊠ : PART
- ⊠⊠ : PART, MULTI-PIECE
- ⊠⊠⊗ : PART, OPTION
- ⊠ : DETAIL
- ⊠⊗ : DETAIL, OPTION

SEE HEAD ANCHORS SHEET 5,  
AND THRESHOLD ANCHORS  
SHEET 9. THRESHOLD  
ANCHORS APPLICABLE TO 3KSI  
CONCRETE ONLY.

NOTE: SEE SHEET 5 FOR ANCHOR SCHEDULE  
AND ALLOWABLE ANCHOR TYPES

NOTE: ITEM 58 "FOAM BLOCK" INSTALLED  
IN ALL STILES, EXCEPT LOCKING STILES.  
NOT SHOWN IN ALL STILES FOR CLARITY

NOTES  
1. JAMB TO HEAD CONNECTION FASTENERS; 5/16-18 HHMS WITH WASHER.  
2. SEE SHEET 11 FOR STACKED BOTTOM RAIL OPTIONS.


REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20

20-33189  
SCALE: NTS UNLESS NOTED


# DURA-STORM SERIES 2000/3000 THRESHOLDS & ANCHORING

**NOTE: USE CONCRETE ANCHOR PER ANCHOR SCHEDULE FOR ALL THRESHOLD ANCHORAGE DETAILS SHOWN HEREIN. SEE SHEET 5 FOR ANCHOR SCHEDULE AND ALLOWABLE CONCRETE ANCHOR TYPES**


**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 NOA-No. 20-1216.27  
 Expiration Date 04/04/2023  
 By *Isaac L. Chan*  
 Miami-Dade Product Control

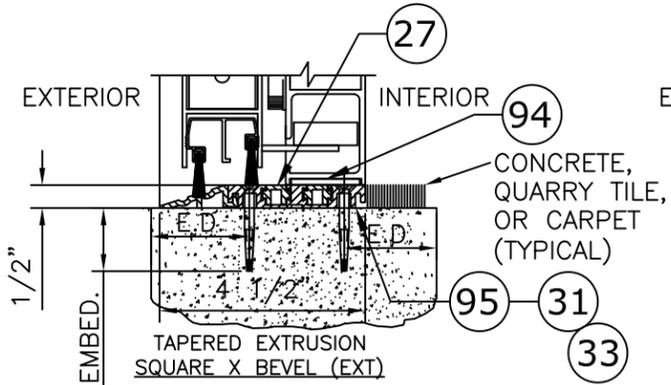


**THRESHOLD-TAPERED EXT**  
 3"=1'-0" 2000

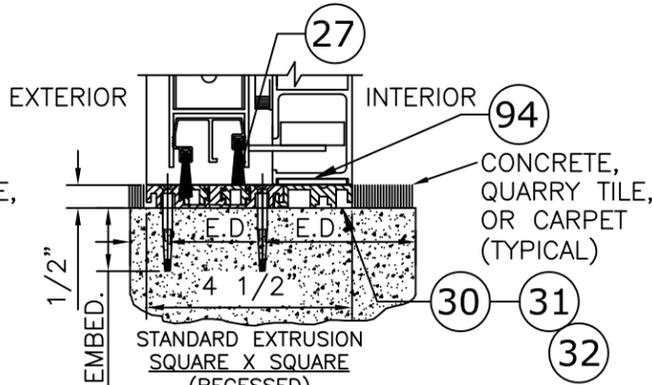


**THRESHOLD-SQUARE**  
 3"=1'-0" 2000

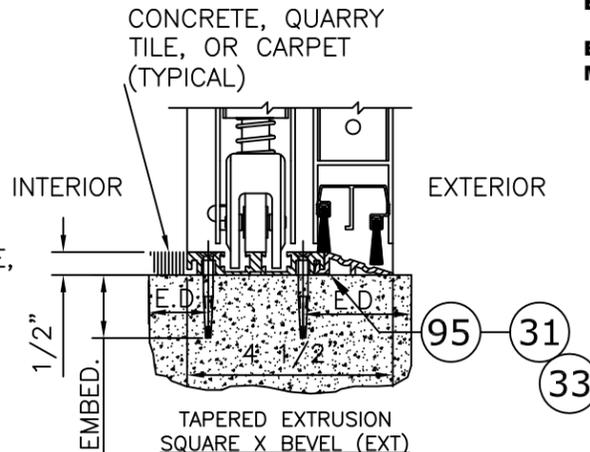


**THRESHOLD-TAPERED EXT**  
 3"=1'-0" 3000

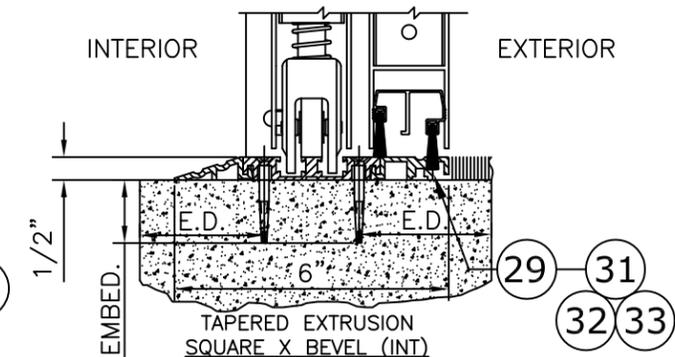


**THRESHOLD-TAPERED INT**  
 3"=1'-0" 3000

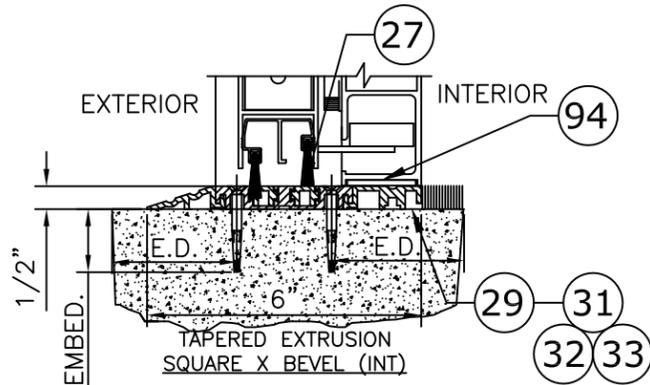


**THRESHOLD-TAPERED INT**  
 3"=1'-0" 2000

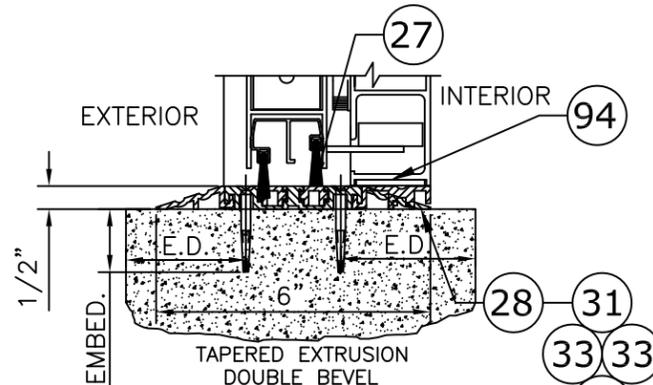

**THRESHOLD-TAPERED**  
 3"=1'-0" 2000

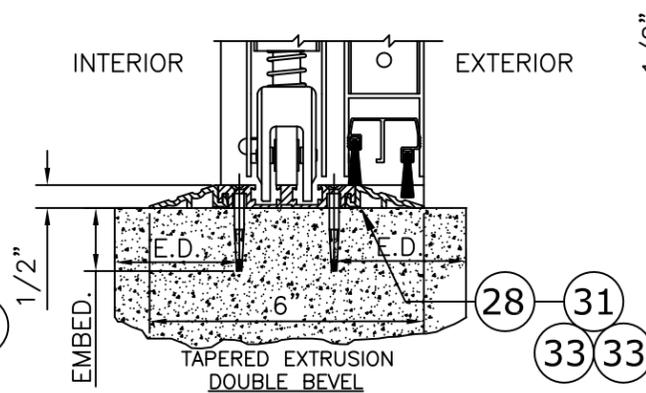


**THRESHOLD-TAPERED**  
 3"=1'-0" 3000

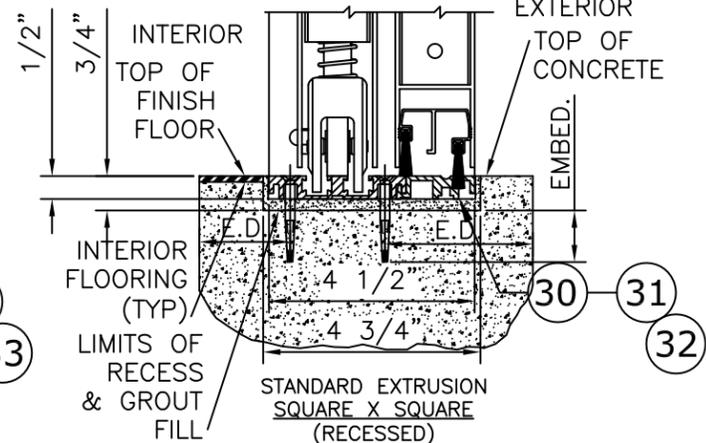

**THRESHOLD-SQUARE**  
 3"=1'-0" 3000

CLUSTER OF ANCHORS IN (2) ROWS CENTERED AT PANEL OVERLAP. QUANTITY PER CLUSTER PER ANCHOR SCHEDULE, ANCHORS IN CLUSTER SPACED 3" O.C. ALONG ROW, TYP.

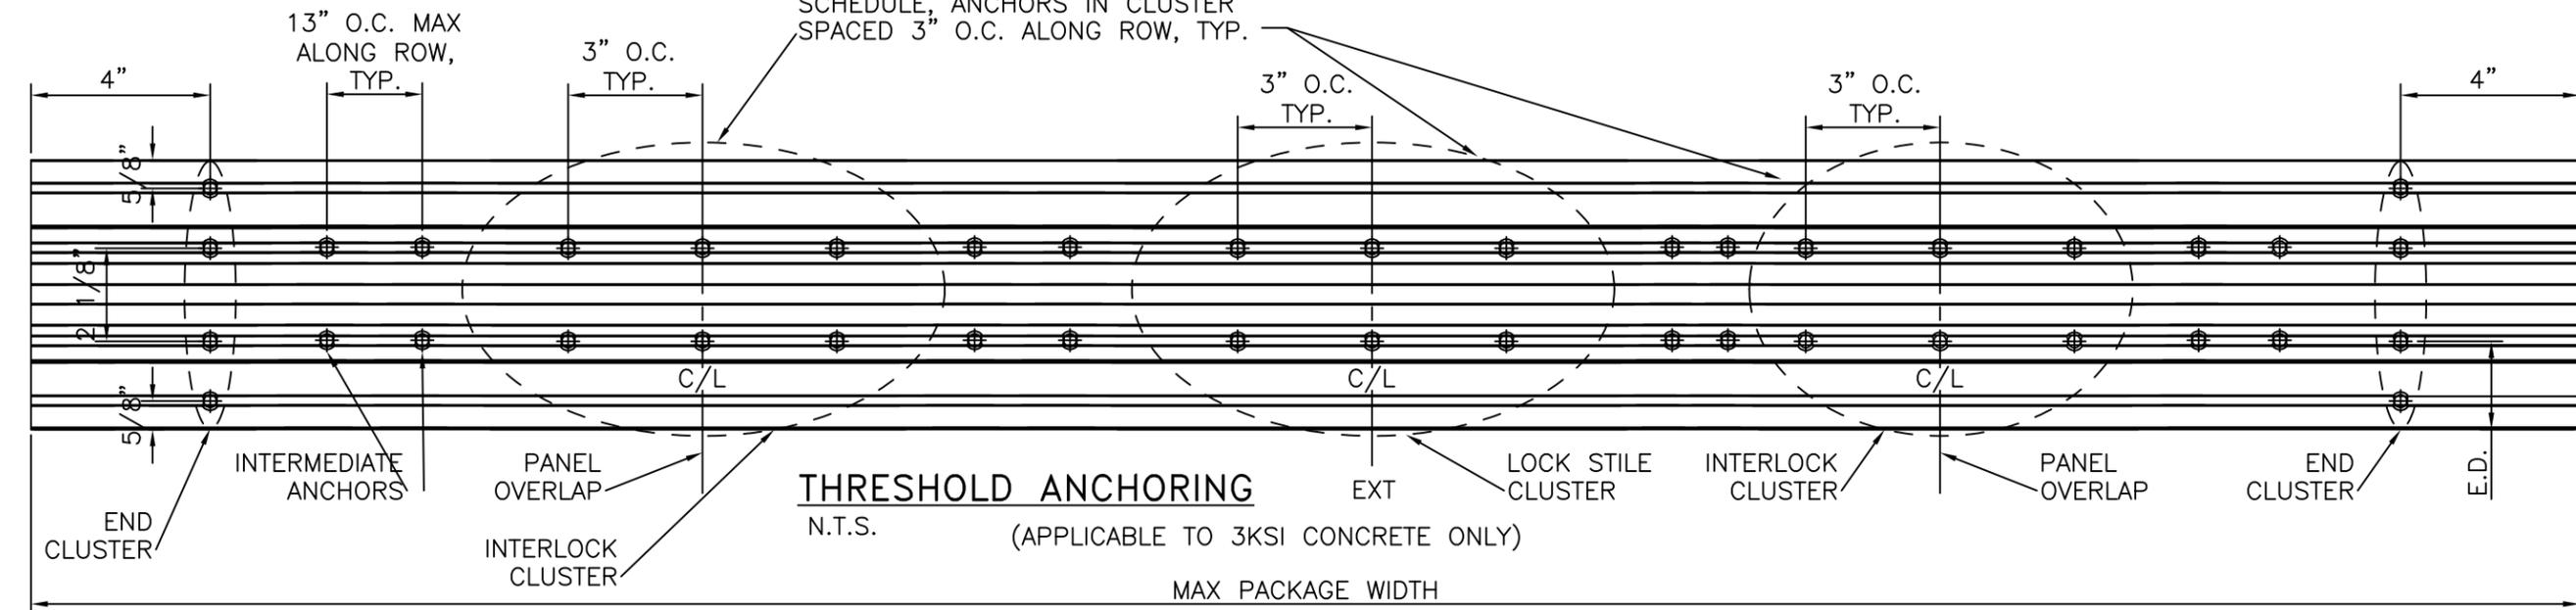

**THRESHOLD ANCHORING**  
 N.T.S. (APPLICABLE TO 3KSI CONCRETE ONLY)

**ENGINEERING EXPRESS**  
 CORPORATE OFFICE:  
 160 SW 12th AVE, SUITE 106  
 DEERFIELD BEACH, FL 33442  
 (954) 354-0660 | (866) 396-9999  
 TEAM@ENGINEERINGEXPRESS.COM  
 ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
 FARMINGTON, CT 06032

**STANLEY Security**  
 ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
 BI-PARTING / SINGLE SLIDE (LMI)  
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. 6TH EDITION	JMP	FLB	08/23/17
REV. 7TH EDITION	JEM	AJP	11/17/20

20-33189



SCALE: NTS UNLESS NOTED

09 OF 14


# DURA-STORM SERIES 2000/3000 EXTRUSIONS

**PRODUCT REVISED**  
 as complying with the Florida  
 Building Code  
 NOA-No. 20-1216.27  
 Expiration Date 04/04/2023  
 By *Isaac L. Chanik*  
 Miami-Dade Product Control


FRANK BENNARDO, P.E.  
 PE# 0046549 CA. 9885




**18** MUNTIN BAR  
 N.T.S. 6063-T6




**9** TOP RAIL, SX  
 (3000)  
 N.T.S. 6063-T6




**10** TOP RAIL, SX  
 (2000)  
 N.T.S. 6063-T6

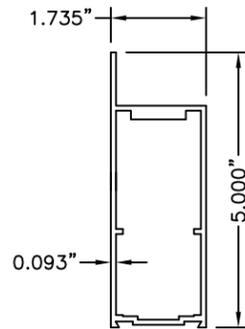


**7** TOP RAIL, SO  
 (3000)  
 N.T.S. 6063-T6

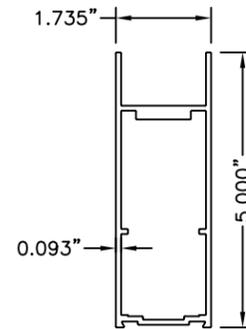


**8** TOP RAIL, O  
 (2000)  
 N.T.S. 6063-T6

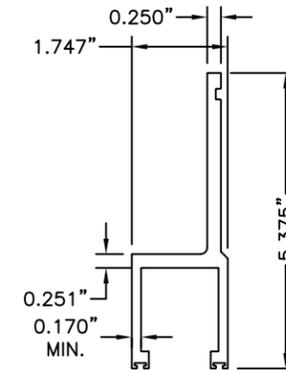


**26** HANGER  
 N.T.S. 6063-T6




**74** STEEL PANIC  
 REINFORCING  
 N.T.S. ASTM A-36




**79** PANIC  
 MUNTIN CLIP  
 N.T.S. 6063-T6




**15** STILE LEAD  
 (NARROW)  
 N.T.S. 6063-T6




**11** STILE FIXED  
 (NARROW)  
 N.T.S. 6063-T6




**13** STILE PIVOT  
 (NARROW)  
 N.T.S. 6063-T6




**12** STILE LEAD  
 (MEDIUM)  
 N.T.S. 6063-T6




**16** STILE LOCK  
 (MEDIUM)  
 N.T.S. 6063-T6




**14** STILE PIVOT  
 (MEDIUM)  
 N.T.S. 6063-T6

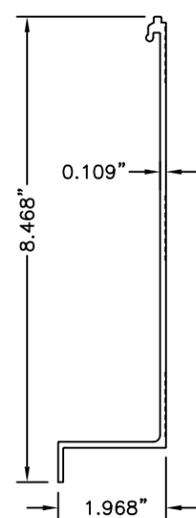


**6** HEADER COVER  
 N.T.S. 6063-T6

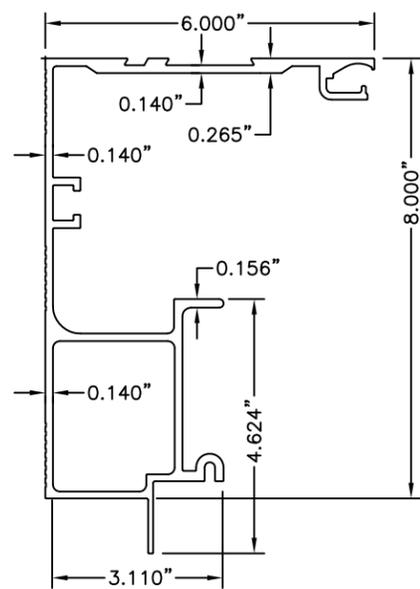


**4** HEADER  
 N.T.S. 6063-T6

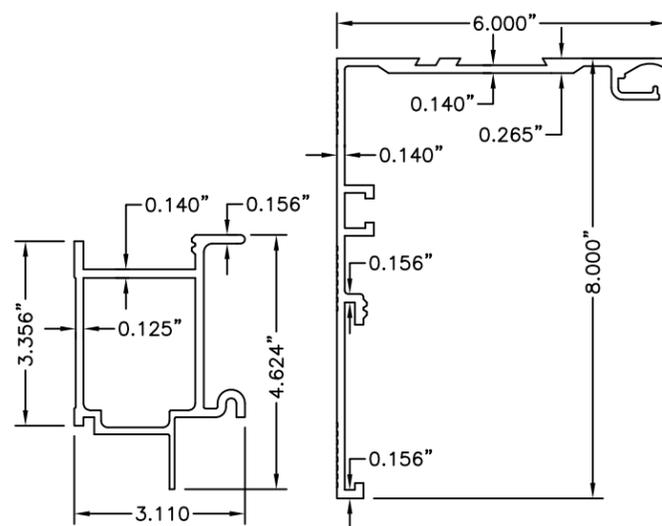


**5** HEADER (2 PC.)  
 N.T.S. 6063-T6




**20** GUTTER  
 N.T.S. 6063-T6




**19** GLASS STOP  
 N.T.S. 6063-T6

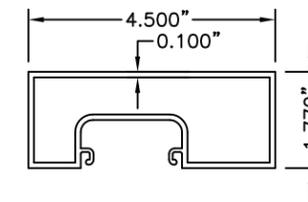

**1** JAMB 4 1/2  
 N.T.S. 6063-T6

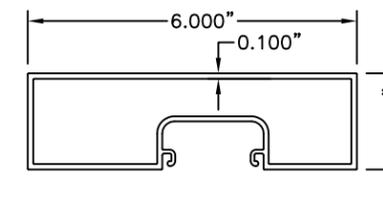

**2** JAMB 6  
 N.T.S. 6063-T6



**3** JAMB INSERT  
 N.T.S. 6063-T6

**ENGINEERING EXPRESS®**  
 CORPORATE OFFICE:  
 160 SW 12th AVE, SUITE 106  
 DEERFIELD BEACH, FL 33442  
 (954) 354-0660 | (866) 396-9999  
 TEAM@ENGINEERINGEXPRESS.COM  
 ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
 FARMINGTON, CT 06032

**STANLEY Security**  
 ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
 BI-PARTING / SINGLE SLIDE (LMI)  
 MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. 6TH EDITION	JMP	FLB	08/23/17
REV. 7TH EDITION	JEM	AJP	11/17/20

20-33189

SCALE: NTS UNLESS NOTED

# DURA-STORM SERIES 2000/3000 EXTRUSIONS



**PRODUCT REVISED**  
as complying with the Florida  
Building Code

NOA-No. 20-1216.27


Expiration Date 04/04/2023

By *Shay L. Chan*  
Miami-Dade Product Control


FRANK BENNARDO, P.E.  
PE# 0046549 CA. 9885

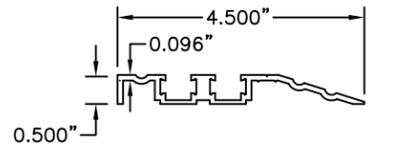

95 COMPONENT THRESHOLD  
N.T.S. 6063-T6

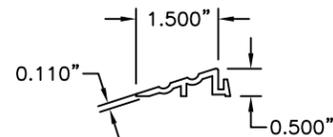


33 COMPONENT THRESHOLD  
N.T.S. 6063-T6

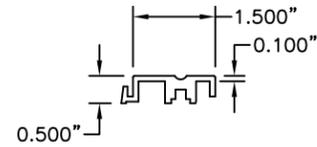


32 COMPONENT THRESHOLD  
N.T.S. 6063-T6




31 COMPONENT THRESHOLD  
N.T.S. 6063-T6




27 THRESHOLD FILLER  
N.T.S. 6063-T6

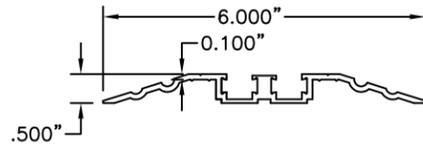


28 ALT THRESHOLD  
N.T.S. 6063-T6

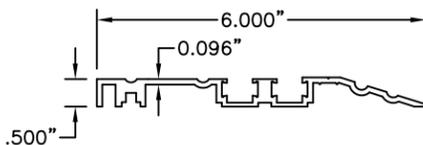


29 ALT THRESHOLD  
N.T.S. 6063-T6

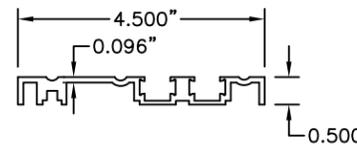


30 THRESHOLD  
N.T.S. 6063-T6




94 KEY STRIP  
N.T.S. 6063-T6




48 BRACKET  
N.T.S. 6063-T6




100 ANGLE  
N.T.S. 6063-T6




17 MUNTIN BAR  
N.T.S. 6063-T6



21 BOTTOM RAIL, O  
N.T.S. 6063-T6




22 BOTTOM RAIL, SX/SO  
N.T.S. 6063-T6

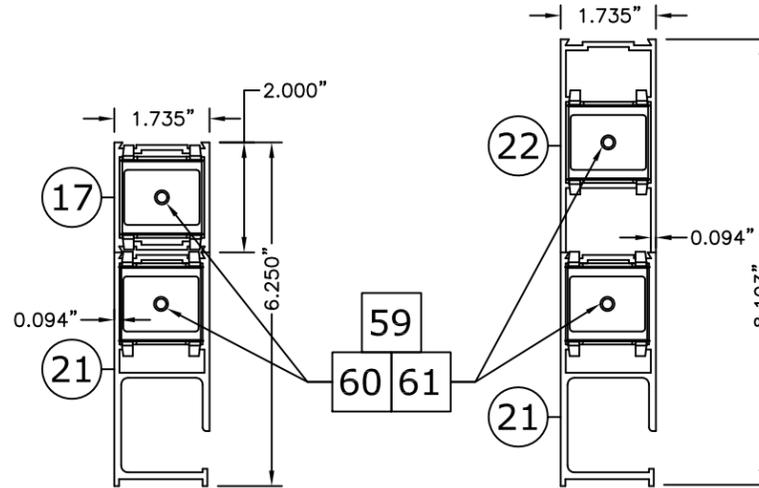


17 21 22 59 60 61  
STACKED BOTTOM RAIL, O  
N.T.S. 6063-T6

22 21 22 59 60 61  
STACKED BOTTOM RAIL, O  
N.T.S. 6063-T6

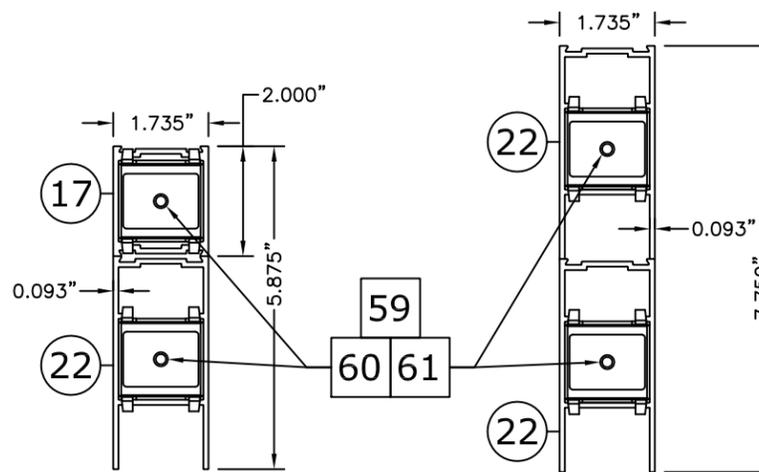


17 22 22 59 60 61  
STACKED BOTTOM RAIL, SX/SO  
N.T.S. 6063-T6


22 22 22 59 60 61  
STACKED BOTTOM RAIL, SX/SO  
N.T.S. 6063-T6

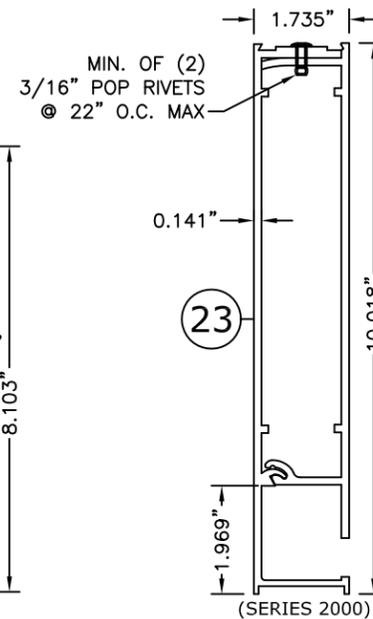


23 BOTTOM RAIL, O  
N.T.S. 2-PIECE 6063-T6

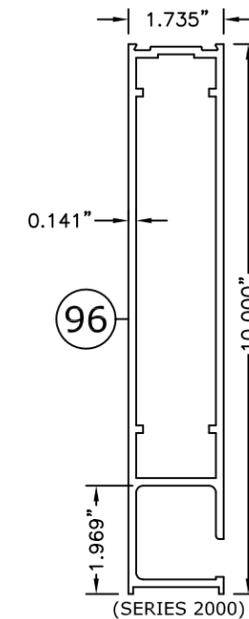

96 BOTTOM RAIL, O  
N.T.S. 1-PIECE 6063-T6

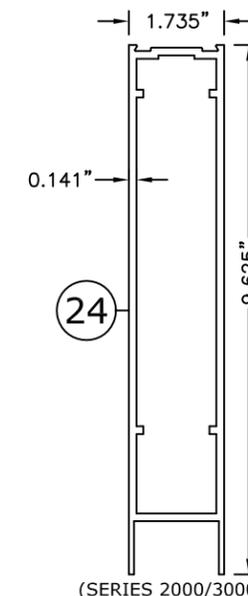

24 BOTTOM RAIL, SX/SO  
N.T.S. 1-PIECE 6063-T6

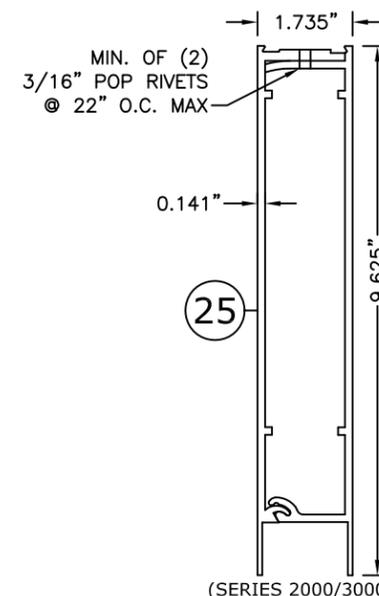

25 BOTTOM RAIL, SX/SO  
N.T.S. 2-PIECE 6063-T6

**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE




REMARKS	DRWN	CHKD	DATE
REV. 6TH EDITION	JMP	FLB	08/23/17
REV. 7TH EDITION	JEM	AJP	11/17/20

COPYRIGHT ENGINEERING EXPRESS®




20-33189

SCALE: NTS UNLESS NOTED

# DURA-STORM SERIES 2000/3000 DETAILS

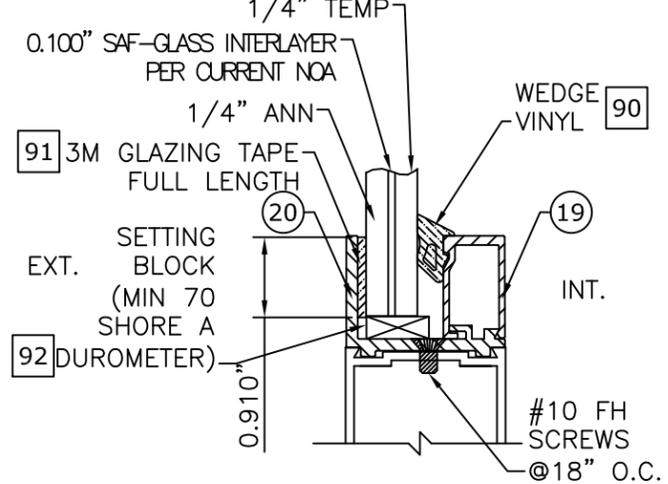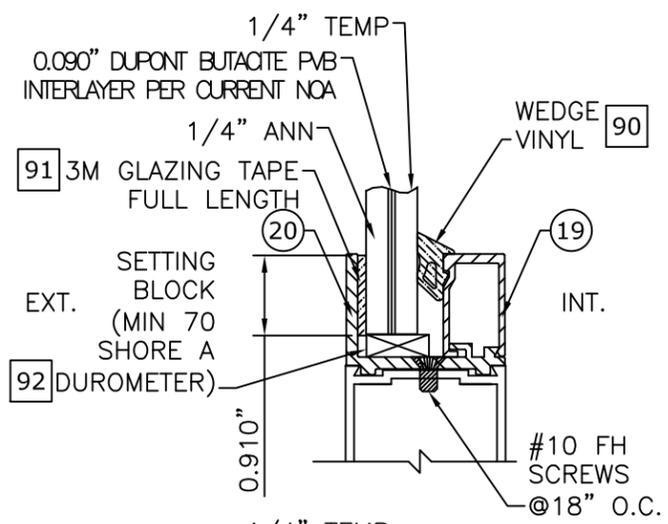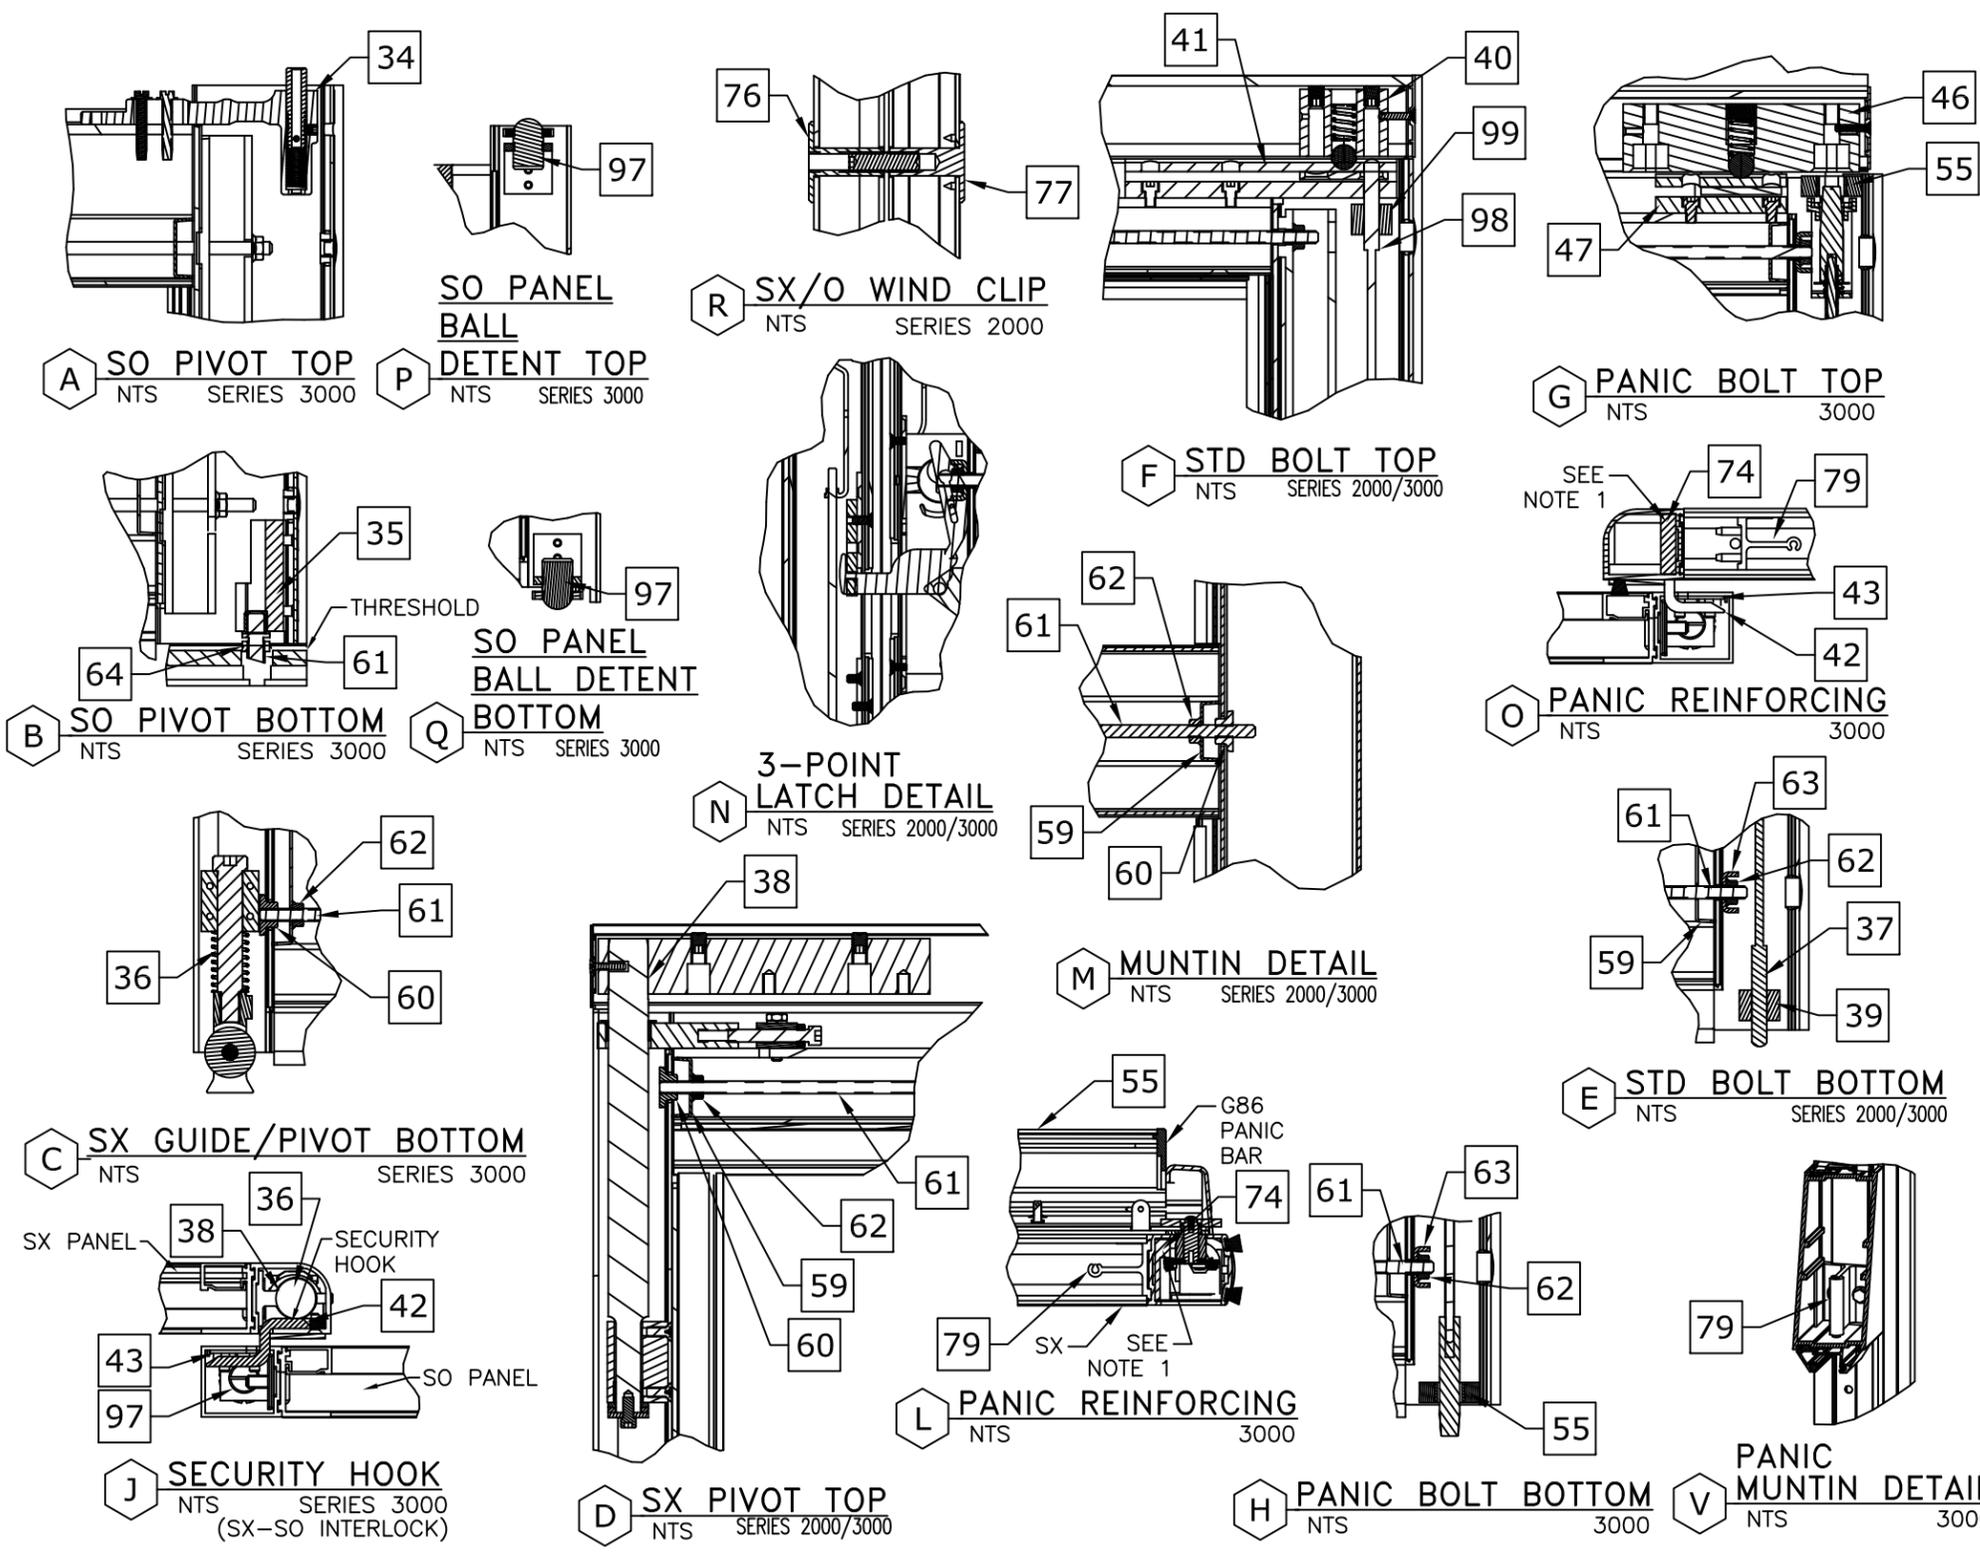

## 9/16" LAMINATED GLAZING DETAILS

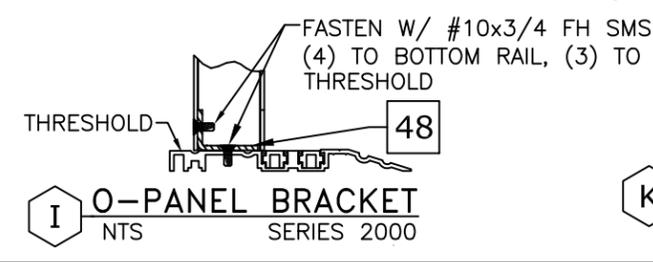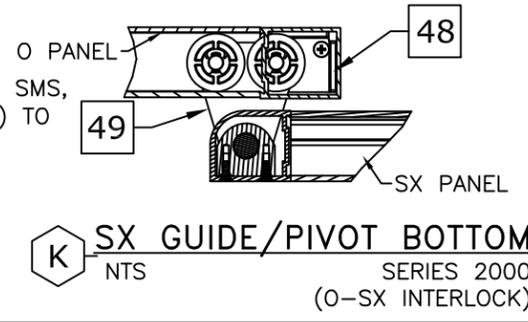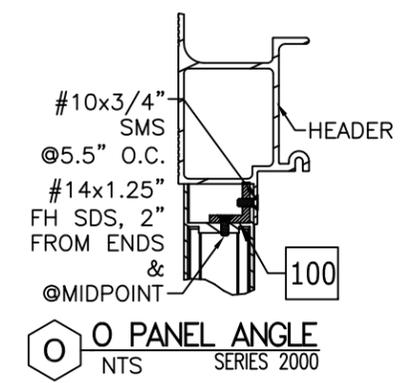

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 20-1216.27  
Expiration Date 04/04/2023  
By Ishag I. Chand  
Miami-Dade Product Control

**NOTES**  
1. ITEM 74, "STEEL PLATE-PANIC REINFORCING", IS CONTAINED WITHIN VERTICAL STILE, HAS A MINIMUM LENGTH OF 48", AND IS CENTERED VERTICALLY ABOUT CENTERLINE OF HORIZONTAL MUNTIN. ITEM 74 IS FASTENED AS FOLLOWS: SINGLE ROW #10 X 32 X 1/2" FHTCMS @ 6" OC.



**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032


**STANLEY Security**  
ACCESS TECHNOLOGIES  
SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DATE
REV. 6TH EDITION	08/23/17
REV. 7TH EDITION	11/17/20


20-33189

SCALE: NTS UNLESS NOTED


# DURA-STORM SERIES 2000/3000 LOCKING ARRANGEMENTS

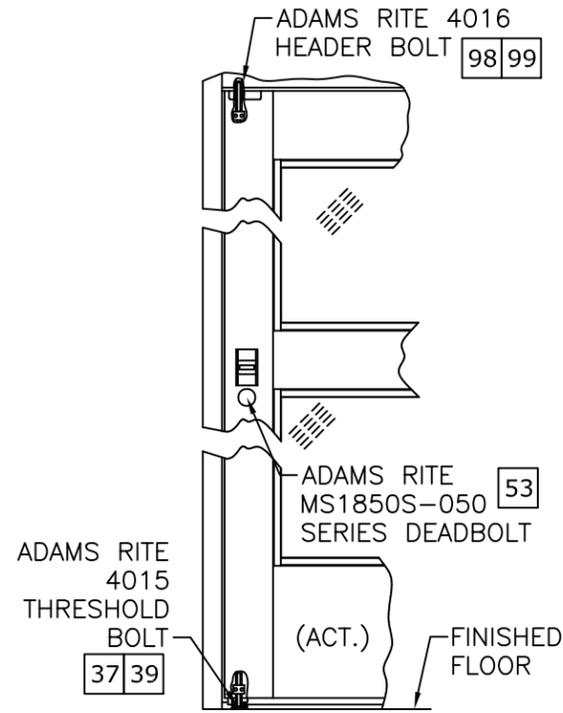


3-PT CONCEALED LOCKING SYSTEM  
SERIES 2000/3000  
SINGLE SLIDE

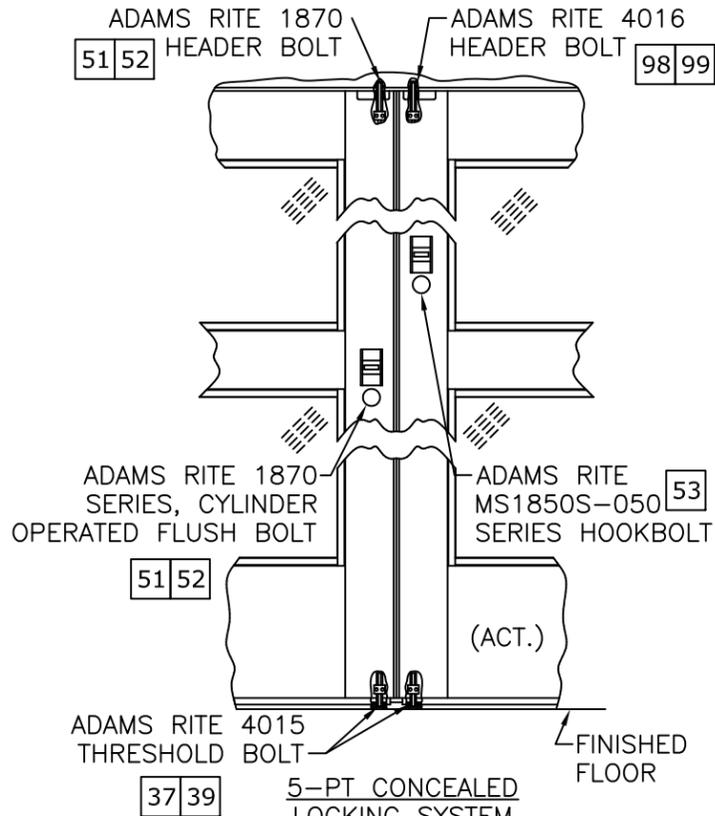


5-PT CONCEALED LOCKING SYSTEM  
SERIES 2000/3000  
BI-PARTING

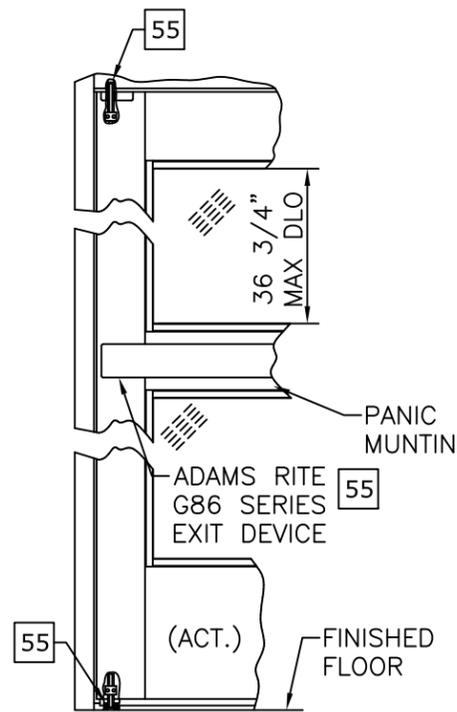

2-PT CONCEALED VERTICAL ROD WITH PANIC RELEASE LOCKING SYSTEM  
SERIES 3000  
SINGLE SLIDE

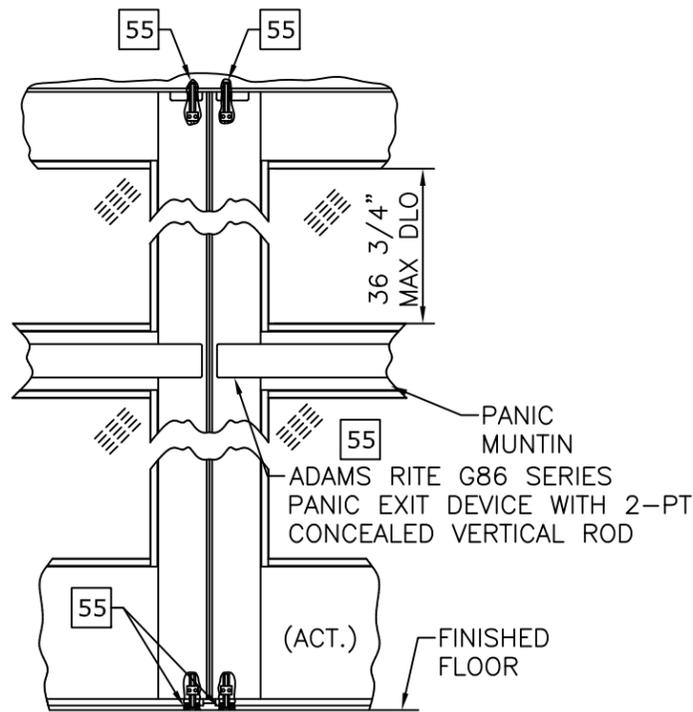

4-PT CONCEALED VERTICAL ROD WITH PANIC RELEASE LOCKING SYSTEM  
SERIES 3000  
BI-PARTING

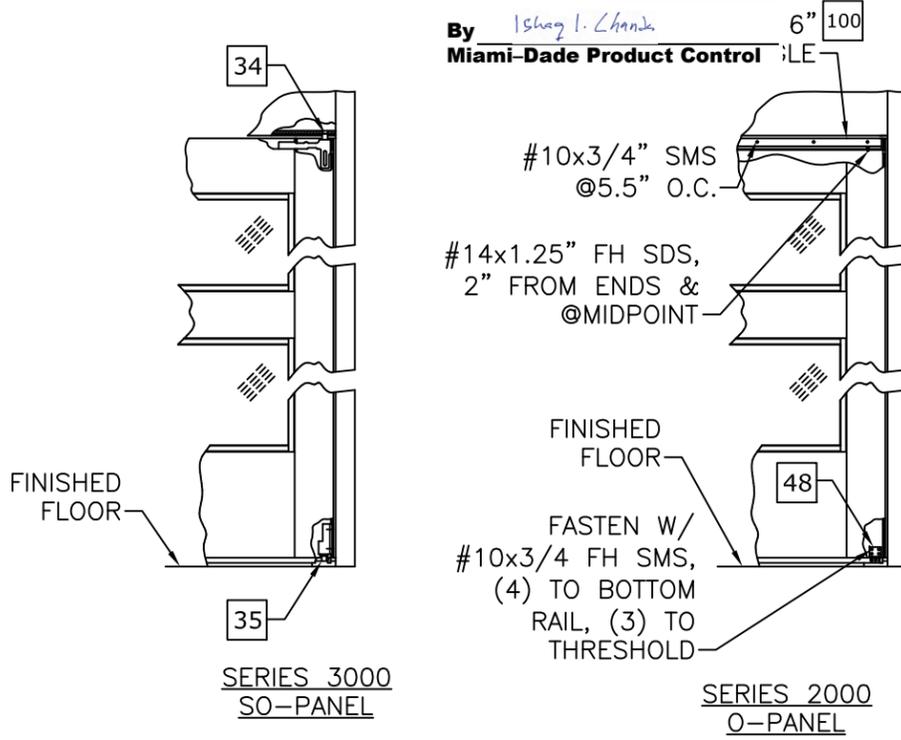

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 20-1216.27  
Expiration Date 04/04/2023  
By *Isaac L. Chan*  
Miami-Dade Product Control



**ENGINEERING EXPRESS**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES

SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. FBC 6TH EDITION	JMP	FLB	08/23/17
REV. FBC 7TH EDITION	JEM	AJP	11/17/20

20-33189

SCALE: NTS UNLESS NOTED

# DURA-STORM SERIES 2000/3000 BILL OF MATERIALS


REFERENCE	DESCRIPTION
1	Extrusion - Jamb - 4 1/2"
2	Extrusion - Jamb - 6"
3	Extrusion - Jamb - Insert
4	Extrusion - Header - 1 PC
5	Extrusion - Header - 2 PC
6	Extrusion - Header Cover -
7	Extrusion - Top Rail - SO
8	Extrusion - Top Rail - O
9	Extrusion - Top Rail - SX
10	Extrusion - Top Rail - SX
11	Extrusion - Stile, Narrow - Fixed
12	Extrusion - Stile, Medium - Lead
13	Extrusion - Stile, Narrow - Pivot
14	Extrusion - Stile, Medium - Pivot
15	Extrusion - Stile, Narrow - Lead
16	Extrusion - Stile, Medium - Lock
17	Extrusion - Muntin Bar/Stacked Bottom Rail Part - 2"
18	Extrusion - Muntin Bar - 4.25"
19	Extrusion - Glass Stop
20	Extrusion - Glass Gutter
21	Extrusion - Bottom Rail O - 4"
22	Extrusion - Bottom Rail SO/SX - 4"
23	Extrusion - Bottom Rail O - 10" - 2 PC
24	Extrusion - Bottom Rail SX/SO - 1 PC - 10"
25	Extrusion - Bottom Rail SX/SO - 2 PC - 10"
26	Extrusion - Hanger -
27	Extrusion - Threshold - Filler
28	Extrusion - Threshold - Dbl bevel - 6"
29	Extrusion - Threshold - Sq/Bvl - 6"
30	Extrusion - Threshold - Recessed - 4.5"
31	Extrusion - Threshold - Core
32	Extrusion - Threshold - Square
33	Extrusion - Threshold - Bevel
34	Component - Top Pivot - SO - 3000
35	Component - Bottom Pivot - SO - 3000
36	Component - Bottom Guide - SX- 3000
37	Component - Throw Bolt - Std - Adams Rite 4015
38	Component - Top pivot - SX
39	Component - Guide - Throw Bolt - Adams Rite 4015
40	Component - Ball Detent - Std
41	Component - Detent Block - Std
42	Component - Security Hook - Std
43	Component - Backing Plate - Security Hook

REFERENCE	DESCRIPTION
46	Component - Ball Detent
47	Component - Detent Block
48	Component - Bracket - O Panel
49	Component - Bottom Guide - SX - 2000
50	Component - Load Wheel - Steel/Aluminum/Plastic
51	Component - 2-PT Lock - Cylinder - Adams Rite 1870 Flushbolt, to be used with A.R. 4015 bottom bolt.
52	Component - 2-PT Lock - Thumb Turn - Adams Rite 1870 Flushbolt, to be used with A.R. 4015 bottom bolt.
53	Component - 8 Ply Hookbolt Lock - Single Action - Adams Rite MS1850S-050 (Deadbolt), Used w/ Adams Rite 4015 and 4016 Bolts
54	Component - Exit Indicator -
55	Component - 2-Pt Panic Device - Adams Rite G86 with concealed vertical rod (top/bottom) and latch assembly.
56	Component - Pile - Adhesive/non Adhesive backed
57	Component - Brush - Sweep
58	Component - Foam Block -
59	Hardware - Tie Rod - Plate
60	Hardware - Tie Rod - Nut - 5/16-18 - Steel
61	Hardware - Threaded Rod - 5/16-18 - Steel
62	Hardware - 5/16 - 18 - Nut - Steel
63	Hardware - Tie Rod / Rail - Plate - Steel
64	Hardware - 7/16-20 Jamb Nut - Steel
65	Hardware - 7/16 SO Pivot Pin - Steel
66	Hardware - 5/8-11 Nut - Steel
74	Component - Steel Plate - Panic Reinforcing (48" Min.)
75	Component - Key Operator - Adams Rite
76	Component - Lock Flange (Int) - "Wind Clip"
77	Component - Lock Flange (Ext) - "Wind Clip"
79	Component - Muntin Clip (with Panic)
90	Glazing - Wedge Vinyl - RM270864 by Trelleborg
91	Glazing - 3M Tape -
92	Glazing - Setting Block -
94	Extrusion - Key Strip
95	Extrusion - Threshold - Sq/Bvl - 4.5"
96	Extrusion - Bottom Rail O - 10"
97	Component - Ball Detent - SO
98	Component - Throw Bolt - Std - Adams Rite 4016
99	Component - Guide - Throw Bolt - Adams Rite 4016
100	Extrusion - 1"x1"x3/16" Angle

NON-CALL OUT PART #S FROM 44,45, 67-73, 78, 80-89 ARE NOT PART OF BOM

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 20-1216.27  
Expiration Date 04/04/2023  
By Isaac I. Chank  
Miami-Dade Product Control

FRANK BENNARDI, P.E.  
PE# 0046549 CA, 9885



**ENGINEERING EXPRESS®**  
CORPORATE OFFICE:  
160 SW 12th AVE, SUITE 106  
DEERFIELD BEACH, FL 33442  
(954) 354-0660 | (866) 396-9999  
TEAM@ENGINEERINGEXPRESS.COM  
ENGINEERINGEXPRESS.COM

65 SCOTT SWAMP ROAD  
FARMINGTON, CT 06032

**STANLEY Security**  
ACCESS TECHNOLOGIES  
SERIES "DURA-STORM 2000/3000" AUTO SGD  
BI-PARTING / SINGLE SLIDE (LMI)  
MIAMI-DADE NOTICE OF ACCEPTANCE

REMARKS	DRWN	CHKD	DATE
REV. 6TH EDITION	JMP	FLB	08/23/17
REV. 7TH EDITION	JEM	AJP	11/17/20

COPYRIGHT ENGINEERING EXPRESS®

20-33189

SCALE: NTS UNLESS NOTED

14 OF 14

14