



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Atlas Roofing Corporation
2000 Riveredge Parkway, Ste 800
Atlanta, GA. 30328

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: GlassMaster® 30, Tough-Glass® 20 and Legend® Shingles, Pro-Cut® Hip & Ridge Shingles, StormMaster Hip & Ridge Shingles, StormMaster Slate® Shingles, and Pro-Cut® Starter Strip

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 19-0109.03 and consists of pages 1 through 12.

The submitted documentation was reviewed by ***Freddy Semino***



NOA No.: 21-0112.01
Expiration Date: 04/22/24
Approval Date: 03/18/21
Page 1 of 12

ROOFING ASSEMBLY APPROVAL

<u>Category:</u>	Roofing
<u>Sub-Category:</u>	Asphalt Shingles
<u>Materials</u>	3-Tab
<u>Deck Type:</u>	Wood

SCOPE

This approves **GlassMaster® 30, Tough-Glass® 20, Legend®, Pro-Cut® Hip & Ridge, StormMaster® Hip & Ridge, StormMaster Slate® and Pro-Cut® Starter Strip** shingles manufactured by Atlas Roofing Corp. as described in this Notice of Acceptance, designed to comply with Florida Building Code, High Velocity Hurricane Zone.

PRODUCT DESCRIPTION

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
GlassMaster® 30 <i>Manufacturing Locations: 1, 2</i>	12" x 36"	TAS 110	A heavyweight, fiberglass reinforced. Three tab asphalt shingle with algae resistant granules.
Tough-Glass® 20 <i>Manufacturing Locations: 1, 2</i>	12" x 36"	TAS 110	A heavyweight, fiberglass reinforced. Three tab asphalt shingle.
Legend® <i>Manufacturing Location: 2</i>	12" x 36"	TAS 110	A heavyweight, fiberglass reinforced. Three tab asphalt shingle.
Pro-Cut® Hip and Ridge <i>Manufacturing Locations: 1, 2</i>	12" x 36"	TAS 110	A heavyweight, fiberglass reinforced shingle with Scotchgard™ Protector for hip and ridge applications. Perforations location at 12" o.c. along the length of the shingle.
StormMaster® Hip and Ridge <i>Manufacturing Locations: 2</i>	12" x 36"	TAS 110	A heavyweight, fiberglass reinforced shingle with Scotchgard™ Protector for hip and ridge applications. Perforations location at 12" o.c. along the length of the shingle.
Pro-Cut® Starter Strip <i>Manufacturing Locations: 1</i>	12" x 36"	TAS 110	A heavyweight fiberglass reinforced shingle used for started courses prior to installing first course of shingles.
Pro-Cut® Starter Strip <i>Manufacturing Locations: 2</i>	10 5/8" x 36"	TAS 110	A heavyweight fiberglass reinforced shingle used for started courses prior to installing first course of shingles
StormMaster Slate® <i>Manufacturing Locations: 2</i>	18-1/2" x 22-11/16"	TAS 110	A heavyweight, fiberglass reinforced, laminated three tab asphalt shingle with Scotchgard™ Protector.



NOA No.: 21-0112.01
Expiration Date: 04/22/24
Approval Date: 03/18/21
Page 2 of 12

MANUFACTURING LOCATIONS:

1. Hampton, GA.
2. Ardmore, OK.

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Asphalt Technologies.	TAS 100	Wind driven rain.	07/09/03
	ASTM D 3161	ATL-079-02-01	02/17/12
	ASTM D 3161	ATL-079-02-01 Addendum Letter	02/22/21
	TAS 100	ATL-083-02-01	05/29/12
	ASTM D 3462	ATL-086-02-01Rev2	03/30/15
	ASTM D 3462	ATL-151-02-01	05/15/14
	ASTM D 3462	ATL-151-02-01 Addendum Letter	10/06/20
	TAS 100	ATL-162-02-01	05/22/14
	TAS 100	ATL-162-02-01 Addendum Letter	02/22/21
	ASTM D 3161	ATL-167-02-01	01/26/15
	ASTM D 3161	ATL-168-02-01	01/26/15
	ASTM D 3462	ATL-169-02-01	01/26/15
	ASTM D 3462	ATL-170-02-01	01/26/15
	ASTM D 3462	ATL-171-02-01	01/26/15
	ASTM D 3462	ATL-171-02-01 Addendum Letter	09/10/20
	ASTM D 3462	ATL-172-02-01	01/23/15
	ASTM D 3462	ATL-174-02-01	01/26/15
	TAS 100	ATL-179-02-01	03/04/15
	TAS 100	Letter for most critical product	03/03/15
	TAS 100	ATL-188-02-01	05/12/15
	ASTM D 3462	ATL-225-02-01	08/28/18
	TAS 100	ATL-225-02-02	09/13/18
	ASTM D 3462	117T0021	02/09/21
	ASTM D 3462	117T0026	02/09/21
	TAS 100	117T0027	02/09/21
	ASTM D 3161	117T0028	02/09/21
	TAS 107	ATL-225-02-03	06/14/17
	TAS 100	ATL-186-02-01	06/18/15
	TAS 107	ATL-184-02-01	06/18/15
	ASTM D 3462	ATL-187-02-01	06/18/15
Underwriters Laboratories, Inc.	TAS 107	02NK6989	03/04/02
Underwriters Laboratories, Inc.	ASTM 3462	Physical Properties 02NK30679	09/17/02
	Letter	UL 790	04/08/14
	R4052	UL790	06/09/15

LIMITATIONS

1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. Shall not be installed on roof mean heights in excess of 33 ft.
3. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.

INSTALLATION

1. Shingles shall be installed in compliance with Roofing Application Standard RAS 115.
2. Flashing shall be in accordance with Roofing Application Standard RAS 115
3. The manufacturer shall provide clearly written application instructions.
4. Exposure and course layout for all shingles except StormMaster Slate® shall be in compliance with Detail 'A', attached.
5. Exposure and course layout for StormMaster Slate® shall be in compliance with Detail 'B', attached.
6. GlassMaster 30® & Tough-Glass 20® Shingles fastening pattern shall be in compliance with Detail 'C', attached.
7. Pro-Cut® Hip & Ridge and StormMaster® Hip and Ridge fastening pattern shall be in compliance with Detail 'D' attached.
8. Pro-Cut® Starter Strip fasteneing pattern shall be in compliance with Detail 'E' attached.
9. Legend fasteneing pattern shall be in compliance with Detail 'F' attached.
10. StormMaster Slate® fasteneing pattern shall be in compliance with Detail 'G' attached.

LABELING

Shingles shall be permanently labeled with the manufacturer's name and/or logo, city and state of manufacturing facility, and the following statement: "Miami-Dade County Product Control Approved" or with the Miami-Dade County Product Control Seal as seen below:



BUILDING PERMIT REQUIREMENTS


Application for building permit shall be accompanied by copies of the following:

1. This Notice of Acceptance.
2. Any other documents required by the Building Official or the applicable code in order to properly evaluate the installation of this system.




NOA No.: 21-0112.01
Expiration Date: 04/22/24
Approval Date: 03/18/21
Page 4 of 12


Profile Drawings

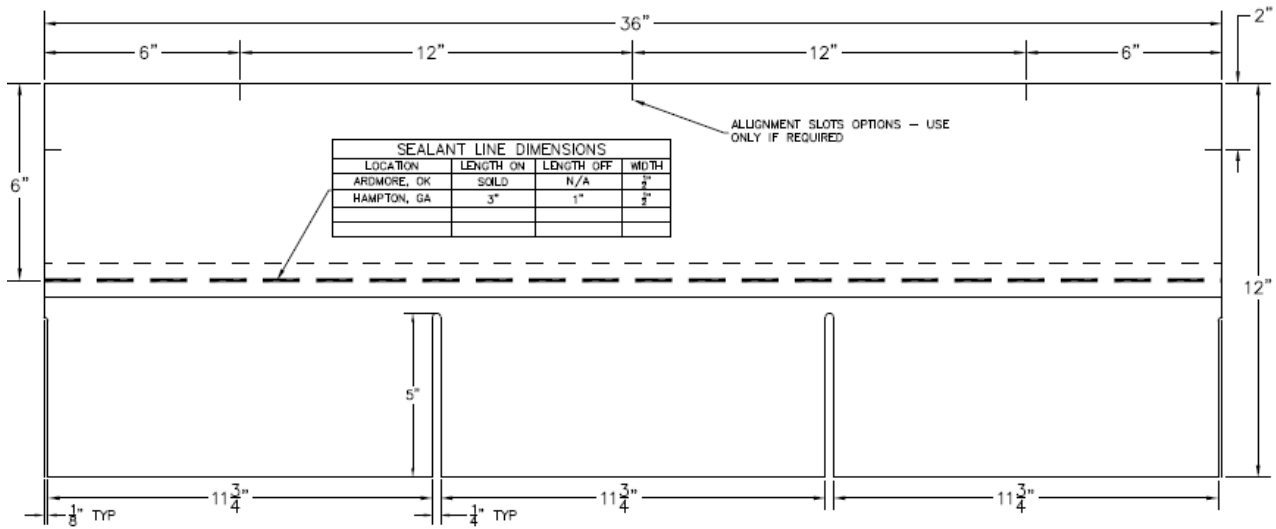


GlassMaster 30® Shingles

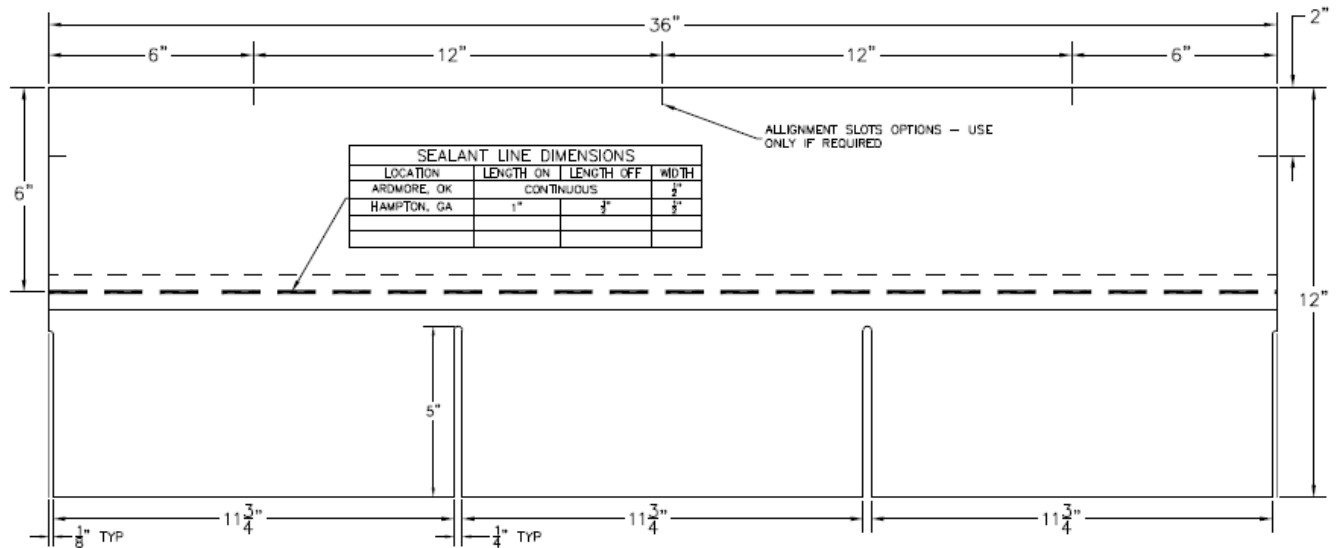


Tough-Glass 20® Shingles

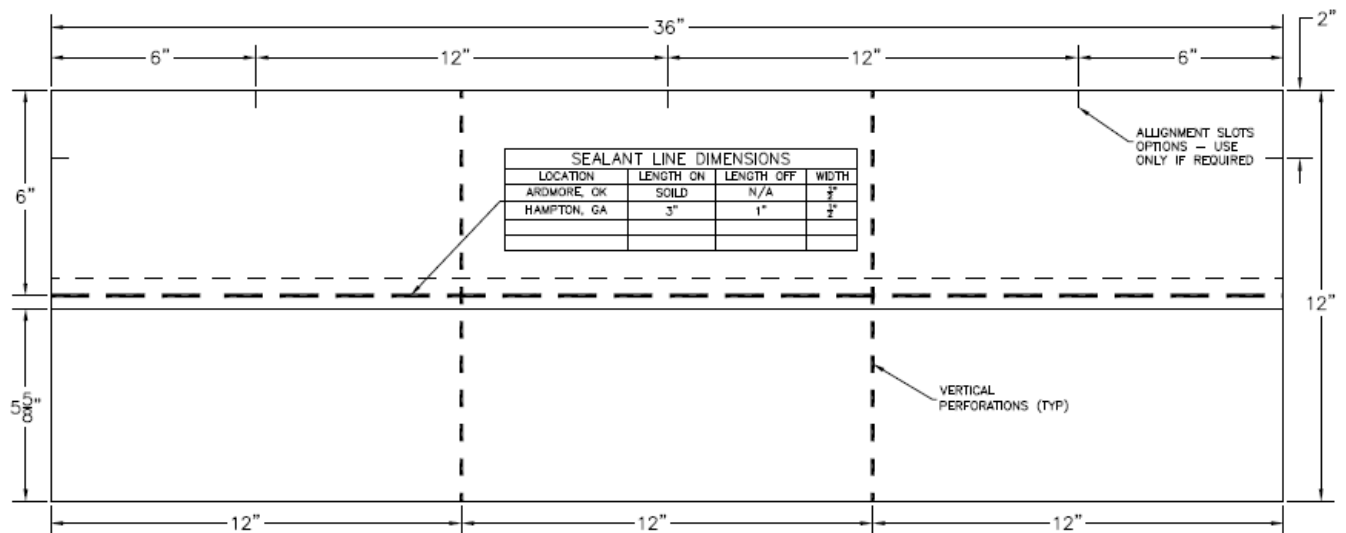


Pro-Cut® Hip & Ridge and StormMaster® Hip & Ridge Shingles

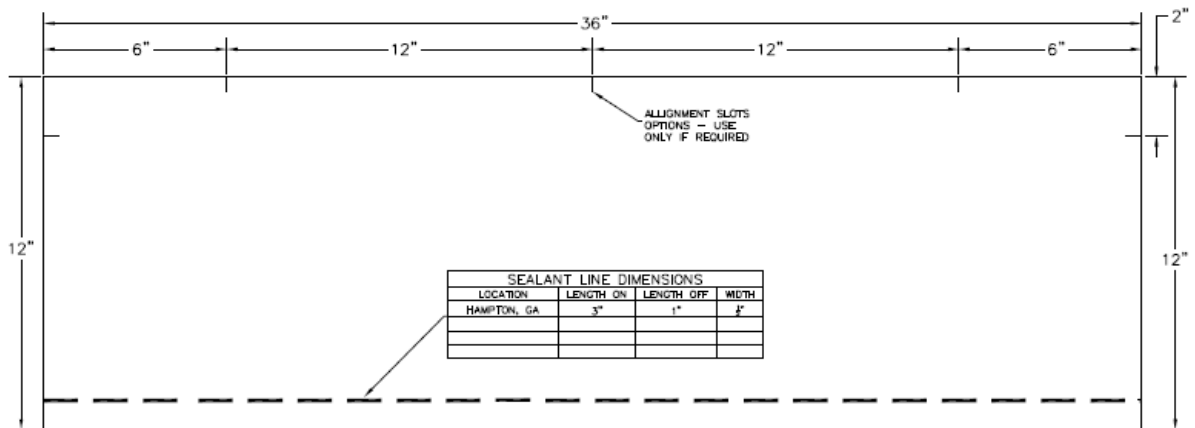

Pro-Cut® Starter Strip-Hampton, GA

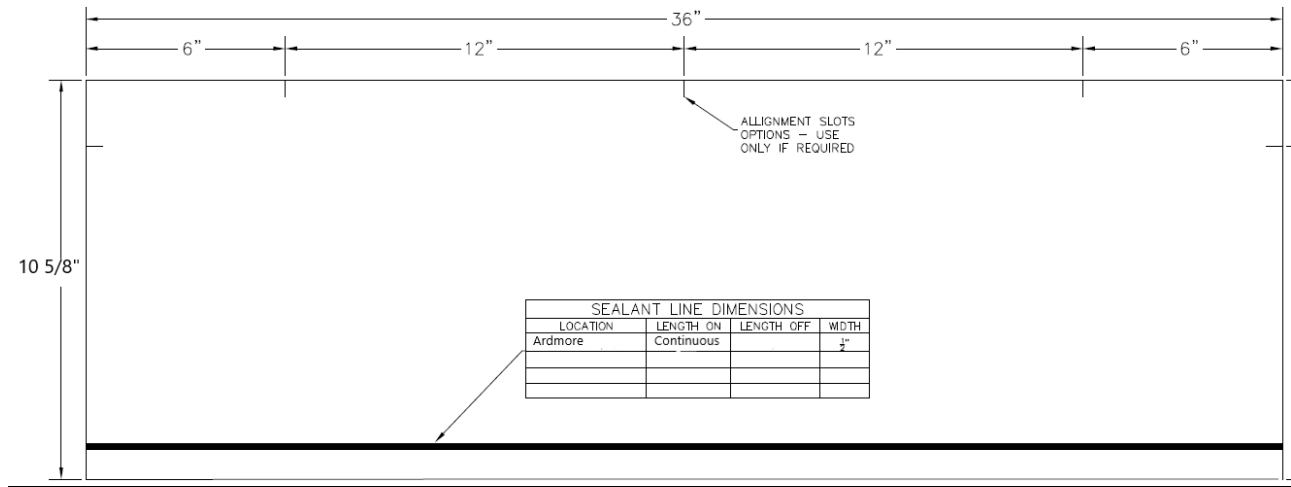


Pro-Cut® Starter Strip – Ardmore, OK

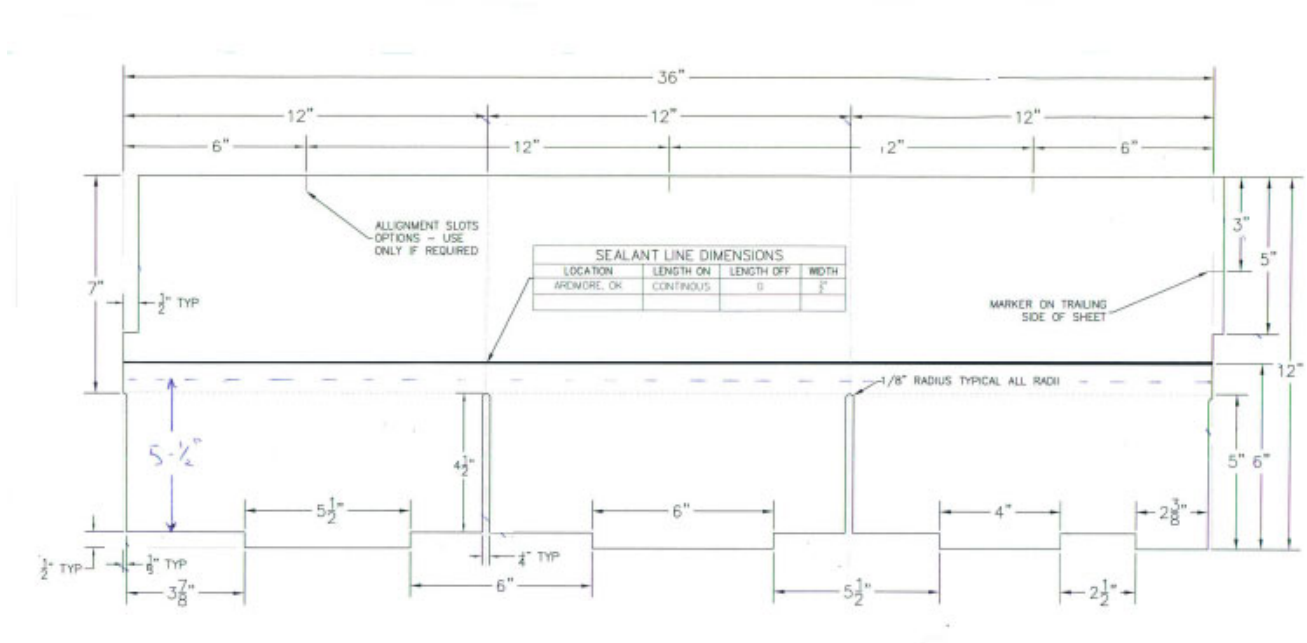


Legend® Shingles

DETAIL A **COURSE LAYOUT**

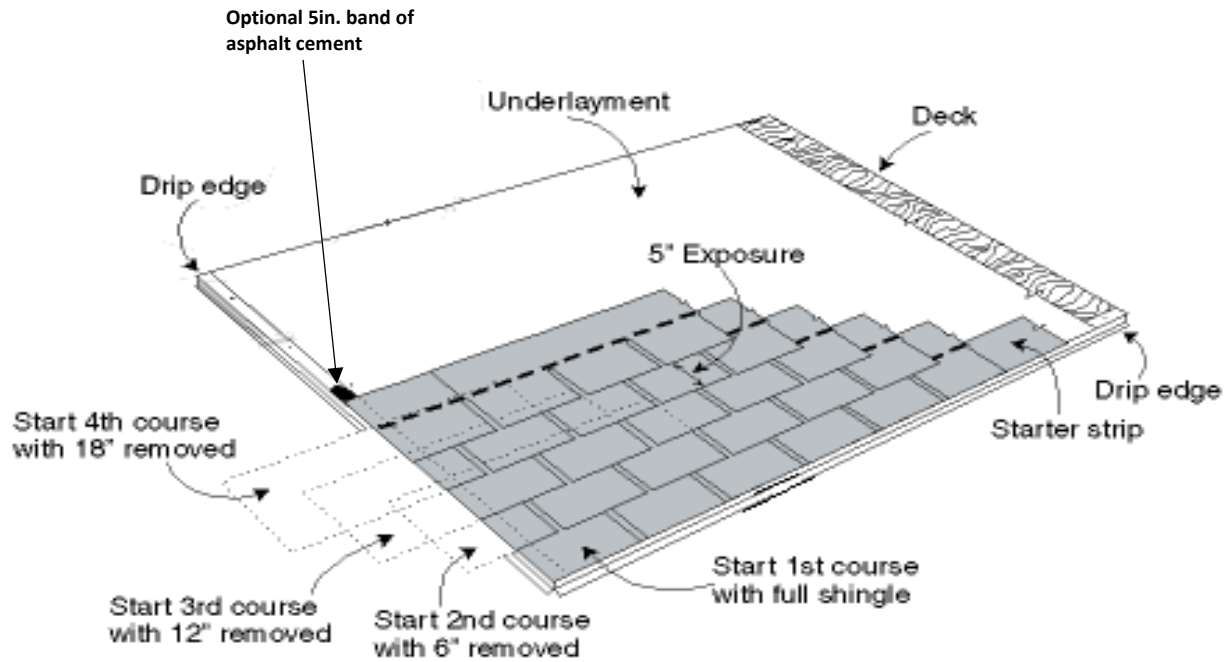


DETAIL B


STORMMASTER SLATE® SHINGLE COURSE LAYOUT

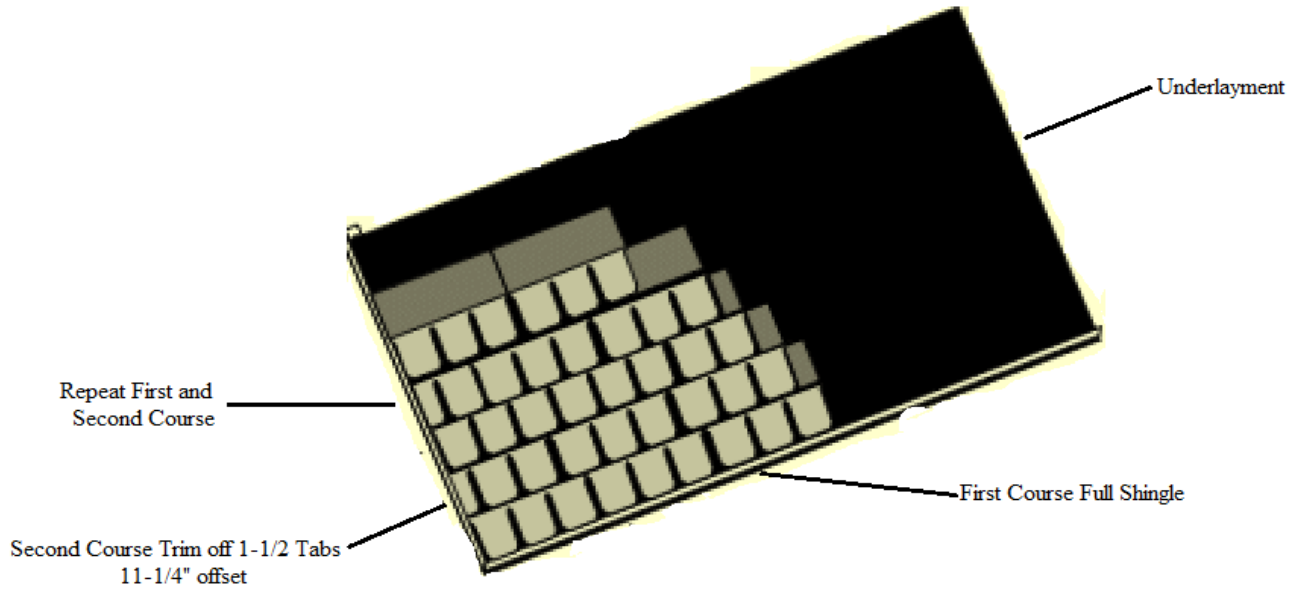


DETAIL C
FASTENING PATTERN
GLASSMASTER 30® & TOUGH-GLASS 20® Shingles

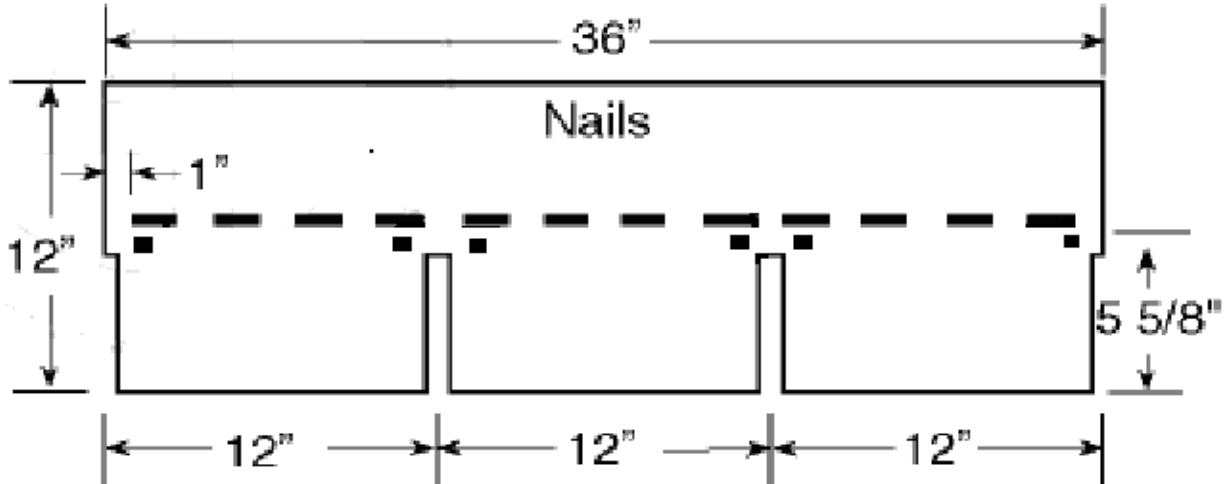


DETAIL D
FASTENING PATTERN
PRO-CUT® HIP & RIDGE AND STORMMASTER® HIP & RIDGE SHINGLES

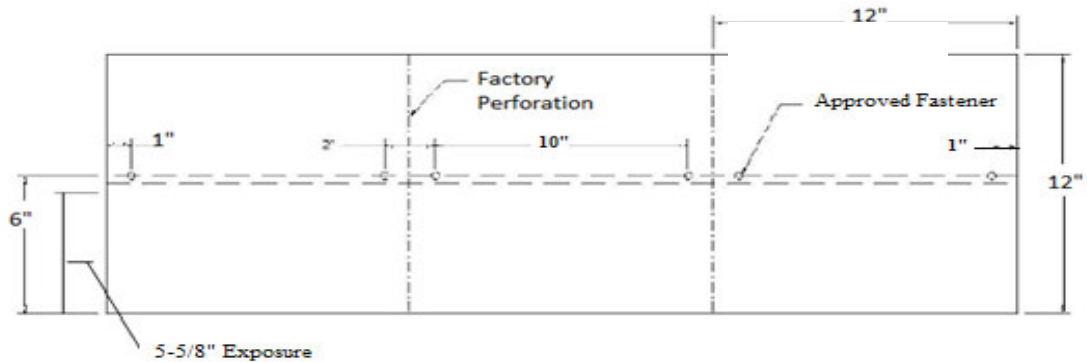


DETAIL E
FASTENING PATTERN
PRO-CUT® STARTER STRIP

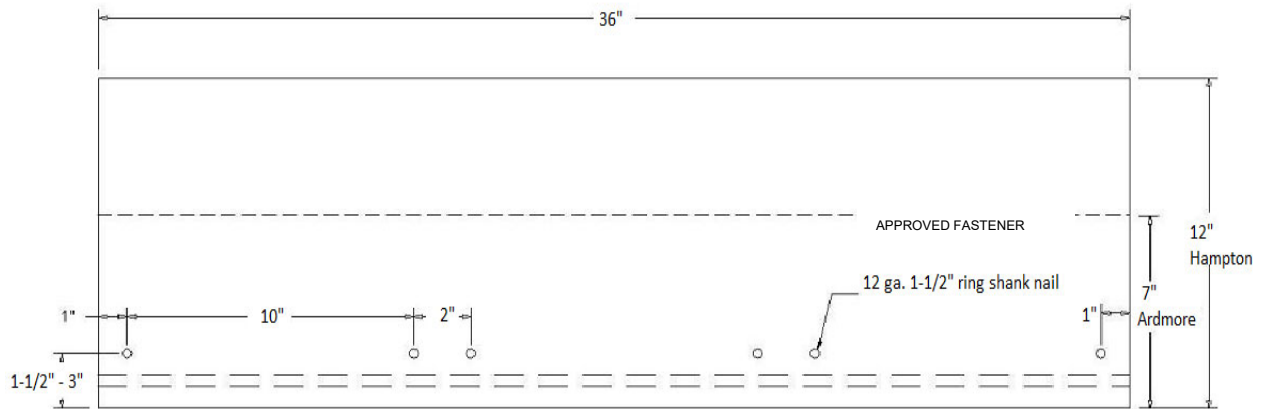

DETAIL F
FASTENING PATTERN
LEGEND SHINGLES

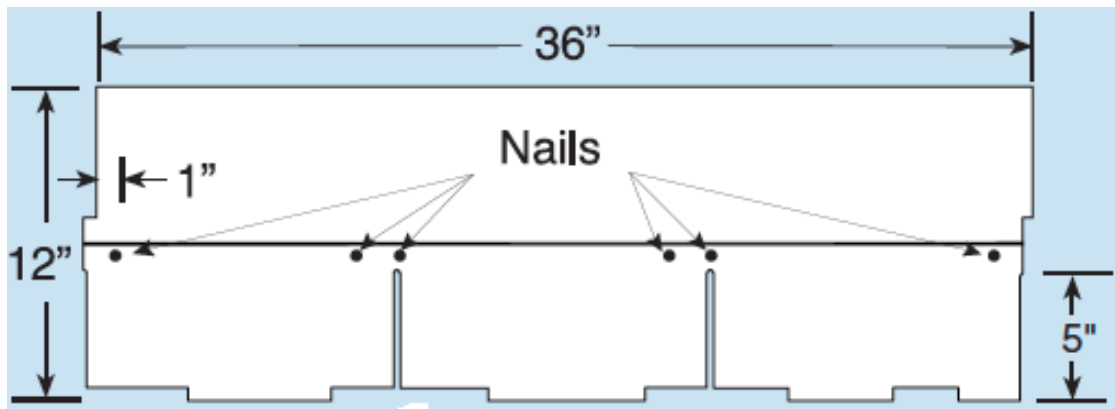

DETAIL G
FASTENER PATTERN
StormMaster Slate® Shingle
Six (6) Fasteners Per Shingle

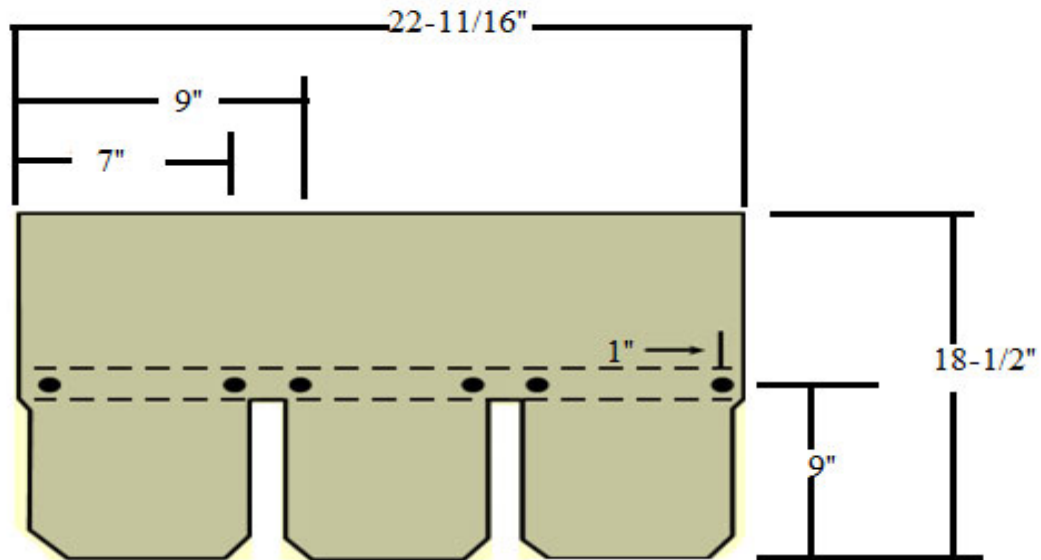

END OF THIS ACCEPTANCE