

Tecnoglass, LLC 3550 NW 49 Street Miami, FL 33142

Scope:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami–Dade County RER–Product Control Section to be used in Miami–Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami–Dade County Product Control Section (In Miami–Dade County) and/or the AHJ (in areas other than Miami–Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami–Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "PH 3050" Aluminum Project–Out/In Window – S.M.I.

APPROVAL DOCUMENT: Drawing No. **W09-18**, titled "PH3050 Alum. Project Out/In Wdw. (S.M.I.)", sheets 1 through 10 of 10, dated 03/20/09, with revision A dated 11/23/20, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami–Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami–Dade County Product Control Section.

MISSILE IMPACT RATING: Small Missile Impact Resistant.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Barranquilla**, **Colombia S.A.**, series and following statement: "Miami–Dade County Product Control Approved" unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami–Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA No. 18-0206.02** and consists of this page 1, evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by Manuel Perez, P.E.



4/21/21

NOA No. 21-0225.03 Expiration Date: April 26, 2023 Approval Date: April 29, 2021 Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

- 1. Manufacturer's die drawings and sections. *(Submitted under NOA No. 09-1203.03)*
- Drawing No W09-18, titled "PH3050 Alum. Project Out/ In Wdw. (S.M.I.)", sheets 1 through 10 of 10, dated 03/20/09, with revision B dated 01/05/18, prepared by Al–Farooq Corporation, signed and sealed by Javad Ahmad, P.E. (Submitted under NOA No. 18-0206.02)

B. TESTS

- 1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Small Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94
 - 7) Drop Test per FBC, ANSI Z97.1-04/ 16 CFR 1201,

along with marked-up drawings and installation diagram of a series PH 3050 aluminum projected window, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5579**, dated 09/16/08, signed and sealed by Michael R. Wenzel, P.E. (Submitted under NOA No.09-1203.03)

C. CALCULATIONS

 Anchor verification calculations and structural analysis, complying with FBC 6th Edition (2017), dated 11/18/17, prepared by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E. (Submitted under NOA No. 18-0206.02)

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. 17-0808.02 issued to Kuraray America, Inc. for their "SentryGlas® (Clear and White) Glass Interlayers" dated 12/28/17, expiring on 07/04/23.
- 2. Notice of Acceptance No. 17-1114.14 issued to Kuraray America, Inc. for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 01/18/18, expiring on 07/08/19.

ann

Manuel Perez, P.E. Product Control Examiner NOA No. 21-0225.03 Expiration Date: April 26, 2023 Approval Date: April 29, 2021

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

F. STATEMENTS

- Statement letter of conformance, complying with FBC 5th Edition (2014), with FBC 6th Edition (2017), and of no financial interest, dated December 18, 2017, issued by Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E. (Submitted under NOA No. 18-0206.02)
- 2. Distribution agreement dated 02/07/17 between Tecnoglass, Inc. and Energia Solar SA, Colombia, signed by Evelyn Daes (Gen MGR) and Carlos Garcia (Sales MGR), respectively on behalf of their companies. *(Submitted under NOA No. 18-0206.02)*
- 3. Bill of Sale –between Tecnoglass, LLC ("Purchaser") and RC Aluminum Industries, Inc. ("Seller") dated and notarized on the 19th day of June, 2013, signed by Raul Casares, President, RC Aluminum Industries, Inc., listing all purchased assets under Exhibit A of Asset Purchase Agreement dated November 19, 2013 (Submitted under NOA No. 18-0206.02)
- 4. Statement letter dated July 15, 2014, issued by RC Aluminum Industries, Inc., stating RC Aluminum Industries, Inc. has legally sold to Tecnoglass, LLC, all the NOA's per schedule 1 and gave-up all rights to NOA(s) and request to rescind all NOA's under RC Aluminum Industries, Inc. signed by Raul Casares, President, RC Aluminum. *(Submitted under NOA No. 18-0205.02)*
- 5. Laboratory compliance letter for Test Report No. FTL-5587, issued by Fenestration Testing Laboratory, Inc., dated June 06, 2009, signed and sealed by Michael R. Wenzel, P. E.

(Submitted under NOA No.09-1203.03)

G. OTHERS

1. Notice of Acceptance No. 13-0328.14, issued to R. C. Aluminum Industries, Inc. for their Series "PH 3050" Aluminum Project-Out/In Window System – S.M.I.", approved on 05/16/13 and expiring on 03/24/15.

Manu

Manuel Perez, P.E. Product Control Examiner NOA No. 21-0225.03 Expiration Date: April 26, 2023 Approval Date: April 29, 2021

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No **W09-18**, titled "PH3050 Alum. Project Out/ In Wdw. (S.M.I.)", sheets 1 through 10 of 10, dated 03/20/09, with revision **A** dated 11/23/20, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None

C. CALCULATIONS

- Anchor verification calculations and structural analysis, complying with FBC 6th Edition (2017), dated 11/18/17 and updated on 02/02/21 to comply with FBC 7th Edition (2020), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
- 2. Glazing complies with ASTM E 1300-09

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. 18-0725.11 issued to Kuraray America, Inc. for their "Kuraray SentryGlas[®] Xtra[™] (SGX[™]) Clear Glass Interlayer" dated 05/23/19, expiring on 05/23/24.
- 2. Notice of Acceptance No. 19-0305.02 issued to Kuraray America, Inc. for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 05/09/19, expiring on 07/08/24.

F. STATEMENTS


1. Statement letter of conformance, complying with **FBC** 7th **Edition (2020)**, and of no financial interest, dated February 02, 2021, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.


G. OTHERS

1. Notice of Acceptance No. **18-0206.02**, issued to Tecnoglass, LLC for their Series "PH 3050" Aluminum Project-Out/In Window System – S.M.I.", approved on 04/26/18 and expiring on 04/26/23.

Nanu

Manuel Perez, P.E. Product Control Examiner NOA No. 21-0225.03 Expiration Date: April 26, 2023 Approval Date: April 29, 2021

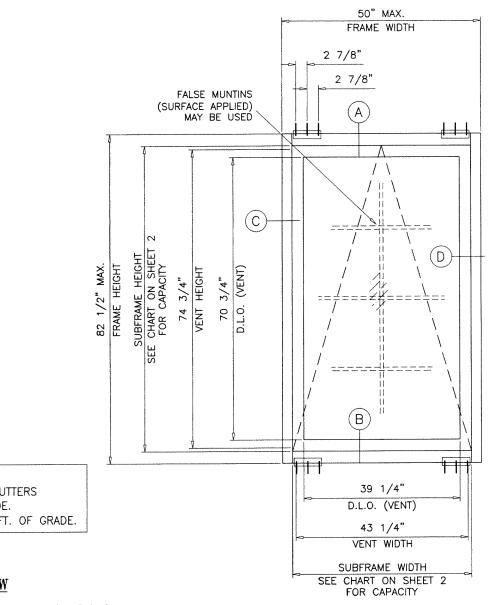

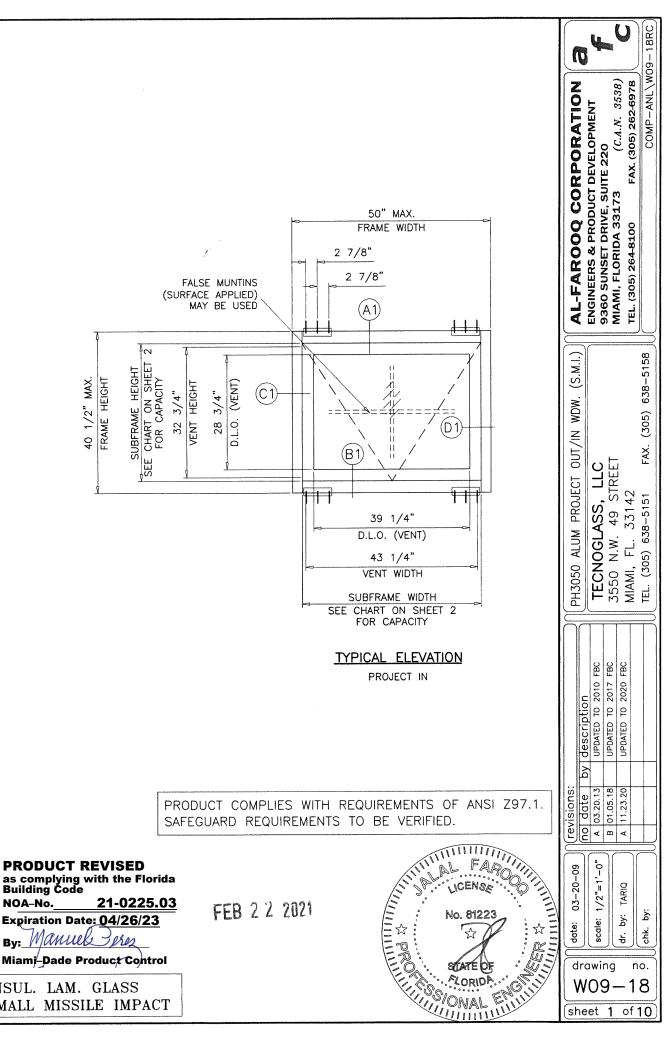

THIS SYSTEM IS RATED FOR SMALL MISSILE IMPACT. MIAMI-DADE COUNTY APPROVED IMPACT RESISTANT SHUTTERS REQUIRED FOR INSTALLATIONS UP TO 30 FT. OF GRADE. SHUTTERS NOT REQD. FOR INSTALLATIONS ABOVE 30 FT. OF GRADE.

SERIES PH3050

ALUMINUM PROJECT OUT/IN WINDOW

APPROVAL APPLIES TO SINGLE UNITS OR SIDE BY SIDE COMBINATIONS OF PROJECTED WINDOWS IN MODULES OF TWO OR MORE WINDOWS FOR WINDOWS CAPACITY SEE CHARTS ON SHEET 2. ALSO PROJECTED WINDOWS WITHIN PH3050 WINDOW WALL SYSTEM SEE SEPARATE NOA FOR PH3050 WINDOW WALL MULLION, GLASS AND ANCHOR CAPACITIES.

LOWER DESIGN PRESSURES FROM WINDOW CAPACITY CHARTS OR WINDOW WALL NOA WILL APPLY TO ENTIRE SYSTEM

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ)

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.


ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'



TYPICAL ELEVATION

PROJECT OUT

1			
	PRODUCT	С	OMPLIES
	SAFEGUAR	D	REQUIRE

PRODUCT REVISED as complying with the Florida Building Code NOA-No.

Expiration Date: 04/26/23 By: Manuel Peres

INSUL. LAM. GLASS SMALL MISSILE IMPACT

PROJECT OUT WINDOW			PROJECT OUT WINDOW				
	V DIMS.	DESIGN CAPACITY			V DIMS.	DESIGN CAPACITY	
SUBFRAME WIDTH	SUBFRAME HEIGHT	EXT.(+)	1NT.(-)	SUBFRAME WIDTH	SUBFRAME HEIGHT	EXT.(+)	1NT.(-
24"		120.0	120.0	24"		120.0	120.0
30"		120.0	120.0	30"		120.0	120.0
36"		120.0	120.0	36"		120.0	120.0
42"		120.0	120.0	42"		120.0	120.0
45"	24"	120.0	120.0	45"	54"	120.0	120.0
48"		120.0	120.0	48"		92.7	92.7
54"		90.1	90.1	54"		57.9	57.9
60"		64.7	64.7	60"		38.5	38.5
66"		48.0	48.0	24"		120.0	120.0
72"		36.7	36.7	30"		120.0	120.0
24"		120.0	120.0	36"		120.0	120.0
24 30"		120.0	120.0	42"	60"	120.0	120.0
36"		120.0	120.0	45"		120.0	120.0
36 42"		120.0	120.0	43		92.7	92.7
	30"	120.0	120.0	40 54"		57.9	57.9
45" 48"		111.7	111.7	24"		120.0	120.0
		75.7	75.7	24 30"		120.0	120.0
54"						120.0	120.0
60"		53.8	53.8	36"	66"	120.0	120.0
66"		39.6	39.6	42"			
72"		30.1	30.1	45"		120.0	120.0 92.7
24"		120.0	120.0	48"		92.7	
30"		120.0	120.0	24"		120.0	120.0
36"		120.0	120.0	30"		120.0	120.0
42"	36"	120.0	120.0	36"	72"	120.0	120.0
45"		120.0	120.0	42"		120.0	120.0 120.0
48"		100.6	100.6	45"		120.0 92.7	92.7
54"		67.0	67.0	48"		120.0	120.0
60"		47.0	47.0	24"			120.0
66"		34.4	34.4	30"	76-1/2"	120.0	
72"		25.9	25.9	36"		120.0	120.0
24"		120.0	120.0	42"		120.0	120.0
30"		120.0	120.0	45"		116.5	116.5
36"		120.0	120.0			_	
42"	42"	120.0	120.0				
45"		120.0	120.0				/ \
48"		94.7	94.7				/ \
54"		61.7	61.7				/ 剡 \
60"		42.7	42.7			/	١
66"		30.9	30.9				
72"		23.1	23.1				
24"		120.0	120.0			Li	
30"		120.0	120.0				
36"		120.0	120.0				
42"	48"	120.0	120.0				
45"		120.0	120.0				
48"		92.7	92.7				
54"		58.9	58.9				
60"		40.0	40.0				
66"		28.6	28.6				
72"		21.2	21.2	1			

FRAME	WIDTH =	=	SUBFRAME	WIDTH +	⊦	6"	
FRAME	HEIGHT	=	SUBFRAME	HEIGHT	4	ł	6"

PROJECT IN WINDOW						
WINDOW DIMS.		DESIGN LOAD CAPACITY - PSF				
SUBFRAME WIDTH	SUBFRAME HEIGHT	EXT.(+)	1NT.(-)			
24"		120.0	120.0			
30"		120.0	120.0			
36"	34-1/2"	120.0	120.0			
42"		120.0	120.0			
45"		120.0	120.0			





PRODUCT REVISED as complying with the Florida Building Code NOA-No. 21-0225.03


Expiration Date: 04/26/23 By: Manuel Pres


Miamj-Dade Product Control

NOTE: GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219 FEB 2 2 2021

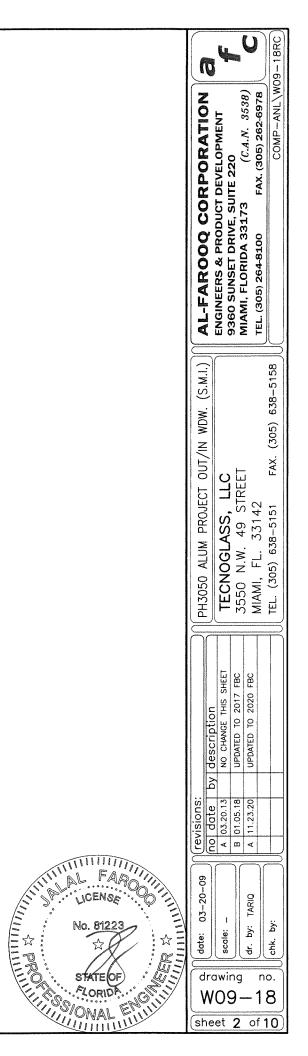









1---










APPROVED CONFIGURATIONS PROJECT OUT


(E '






(H1)



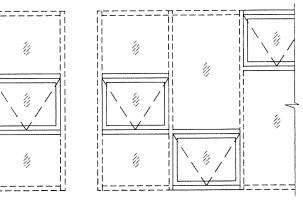





APPROVED CONFIGURATIONS PROJECT IN

SEE SEPARATE NOA FOR PH3050 WINDOW WALL SYSTEM DESIGN LOADS AND ANCHORS.


LOWER VALUES FROM PROJECTED WINDOW CAPACITY CHART OR WINDOW WALL SYSTEM NOA WILL APPLY TO ENTIRE SYSTEM.

> PRODUCT REVISED as complying with the Florida FEB 2 2 2021 Building Code 21-0225.03 NOA-No. Expiration Date: 04/26/23 By: Manuel Peres Miami-Dade Product Control

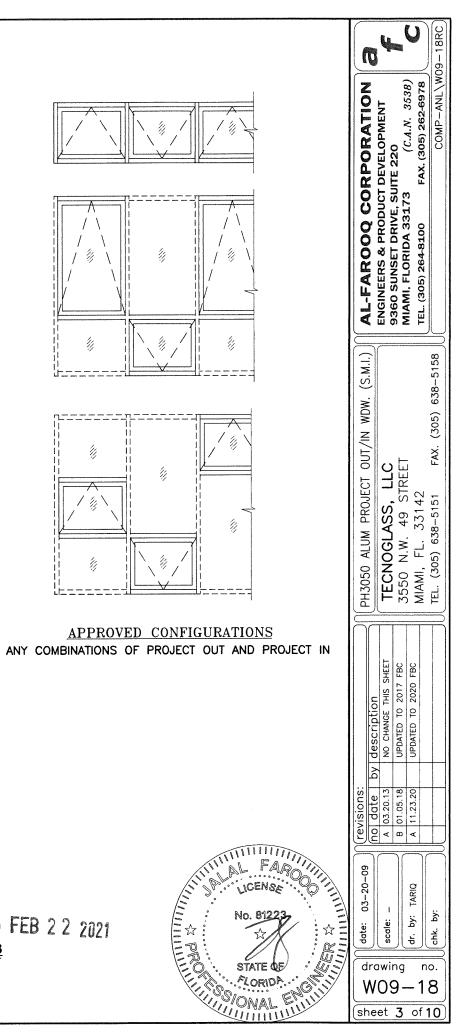

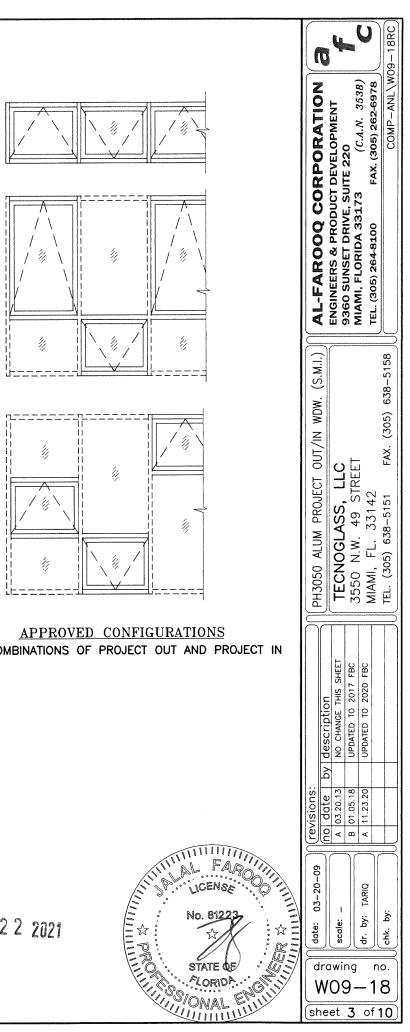



ITEM NO.	PART NUMBER	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
E1	PH3050-017	CLOSED JAMB	6063-T6	-
E2	PH3050-004	HEAD, SILL & INTERMIDIATE HORIZONTAL	6063-T6	
E3	PH3050-005	HORIZONTAL GLAZING COVER HEAD & SILL	6063-T6	
E4	PH3050-006	HORIZONTAL GLAZING COVER INTERMIDIATE	6063-T6	-
E5	PH3050-007	INTERIOR HORIZONTAL COVER	6063-T6	
E6	PH3050-008	ANCHOR HEAD & SILL	6005-T5	-
E7	PH3050-009	HORIZONTAL GLAZING COVER HEAD & SILL (VENT)	6063-T6	
E8	PH3050-010	HORIZONTAL COVER INTERMIDIATE, HEAD & SILL (VENT)	6063-T6	
E9	PH3050-011	VENT FRAME SILL	6063-T6	_
E10	PH3050-012	VENT FRAME HEAD & JAMBS	6063-T6	
E10	PH3050-012	VENT VENT	6063-T6	
			6063-T6	
E12	PH3050-014	HORIZONTAL GLAZING COVER INTERMIDIATE (VENT)	6005-T5	·
E13	PH3050-015	MALE MULLION		
E14	PH3050-016	FEMALE MULLION	6005-T5	
E15	FX345-007	INTERIOR COVER	-	
E16	500Y-007	GLAZIND BEAD		
			-	
V1	V-003	MARINE GLAZING	VINYL	DUROMETER 60 SHORE 'A'
V3	V-013	VENT WSTP.	SPONGE NEOPRENE	
V4	V-032	OFFSET BULB GASKET	VINYL	DUROMETER 65 SHORE 'A'
V5	V-033A	MOLDED COMPRESSION GASKET	SPONGE NEOPRENE	
V6	V-047	BULB GASKET	VINYL	DUROMETER 60 ±5
V7	V-053	S.M.I WEDGE	VINYL	DUROMETER 70 ±5 SHORE 'A
	,	Ø 0.187 SPLINE	_	
V11	V-038	OFFSET GASKET	VINYL	DUROMETER 70 ±5 SHORE 'A
VII	V=038	UFFSET GASKET	-	_
<u></u>				
S1		#14 X 1 1/4" LG.PH.PHL.SMS.POINT"B".ST/ST (ASSEMBLY)	_	
S2		1/4-20 X 1 1/2" LG. HEXHEAD FULL THREAD(LEVELING SCREW)	-	
		-	-	
S4		#12-24 X 1/2" LG. FH MS		
S5		#12 X 1/2" LG. ROUNDHEAD SMS. POINT "B" ST/ST (VENT)		
S6		#10 X 3/8" LG. FH. SMS. ST/ST(HANDLE & KEEPER)	-	-
S7		#10 X 1/2" PH. SMS. POINT"B" ST/ST(HINGE SCREW)	-	
S8		#6 X 1/2" LG. PH. SMS. ST/ST(ALUM. SNUBBER)	-	-
S9		#14 X 3/4" FH. SMS. ST/ST	-	-
			-	
H1	851-116-8046	26" PROJECTED HINGE	-	-
H2		16" PROJECTED HINGE	_	-
H3	162-201	RIGHT HAND HANDLE		AT 8" FROM ENDS
H4	162-201	LEFT HAND HANDLE	_	AT 8" FROM ENDS
				AT LOCK LOCATIONS
H5	208-043		-	
H6		3" X 3" X 1/4"-1.720" LG. ALUM ANGLE	6063-T6	
H7		3" X 3" X 1/4"-1.125" LG. ALUM ANGLE	6063-T6	
H8	316	30" GH VENT. P.I & P.O	-	-
	328SG	72" GH VENT. P.O	-	-
H9	02000			
H9 H10	716-10-8	KEYED LIMITED DEVICE	-	
		KEYED LIMITED DEVICE		
		KEYED LIMITED DEVICE 1/8" X 1" X 4" LG. SETTING BLOCK	- - NEOPRENE	
H10			- NEOPRENE NEOPRENE	· · · · · · · · · · · · · · · · · · ·
H10 M1		1/8" X 1" X 4" LG. SETTING BLOCK	+	-
H10 M1 M2		1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK	NEOPRENE	
H10 M1 M2 M3 M5	716-10-8	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK	NEOPRENE NEOPRENE	- - -
H10 M1 M2 M3 M5 M7	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER	NEOPRENE NEOPRENE NEOPRENE	- - -
H10 M1 M2 M3 M5 M7 M8	716-10-8	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER	NEOPRENE NEOPRENE NEOPRENE ALUMINUM	- - - -
H10 M1 M2 M3 M5 M7 M8 M9	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER 1/2" X 3/4" WEEP ROD	NEOPRENE NEOPRENE NEOPRENE ALUMINUM	- - - - - -
H10 M1 M2 M3 M5 M7 M8 M9 M10	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER 1/2" X 3/4" WEEP ROD STRUCTURAL SILICONE BLACK	NEOPRENE NEOPRENE ALUMINUM NYLON - -	- - - - - - -
H10 M1 M2 M3 M5 M7 M8 M9 M10 M11	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER 1/2" X 3/4" WEEP ROD STRUCTURAL SILICONE BLACK 3/8" X 3/16" DOUBLE FACE TAPE V2100	NEOPRENE NEOPRENE NEOPRENE ALUMINUM	- - - - - - - - - -
H10 M1 M2 M3 M5 M7 M8 M9 M10 M11 M12	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER 1/2" X 3/4" WEEP ROD STRUCTURAL SILICONE BLACK 3/8" X 3/16" DOUBLE FACE TAPE V2100 1" X 1" X 1" LG. SETTING BLOCK	NEOPRENE NEOPRENE ALUMINUM NYLON - -	- - - - - - - - - - - -
H10 M1 M2 M3 M5 M7 M8 M9 M10 M11	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER 1/2" X 3/4" WEEP ROD STRUCTURAL SILICONE BLACK 3/8" X 3/16" DOUBLE FACE TAPE V2100 1" X 1" X 1" LG. SETTING BLOCK 5/16" X 5/16" SINGLE FACE TAPE	NEOPRENE NEOPRENE ALUMINUM NYLON - -	
H10 M1 M2 M3 M5 M7 M8 M9 M10 M11 M12	716-10-8 HC200-M07	1/8" X 1" X 4" LG. SETTING BLOCK 1/4" X 1" X 4" LG. SETTING BLOCK 3/4" X 3/4" X 4" LG. SETTING BLOCK 7/8" X 7/8" X 4" LG. SETTING BLOCK SNUBBER SNUBBER 1/2" X 3/4" WEEP ROD STRUCTURAL SILICONE BLACK 3/8" X 3/16" DOUBLE FACE TAPE V2100 1" X 1" X 1" LG. SETTING BLOCK	NEOPRENE NEOPRENE ALUMINUM NYLON - -	- - - - - - - - - - - -

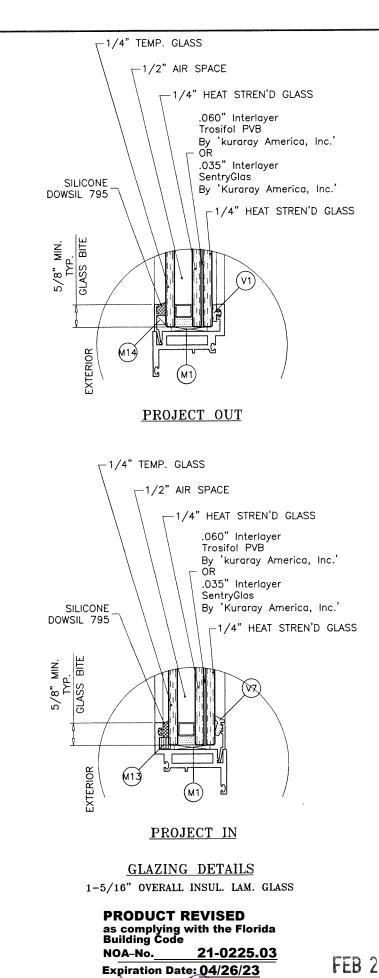



By: Manuel Perez


Miami-Dade Product Control

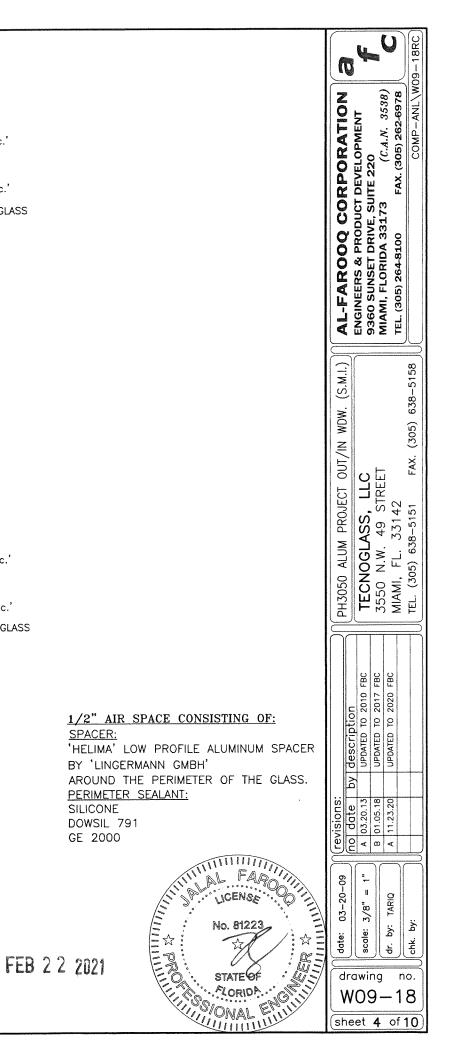


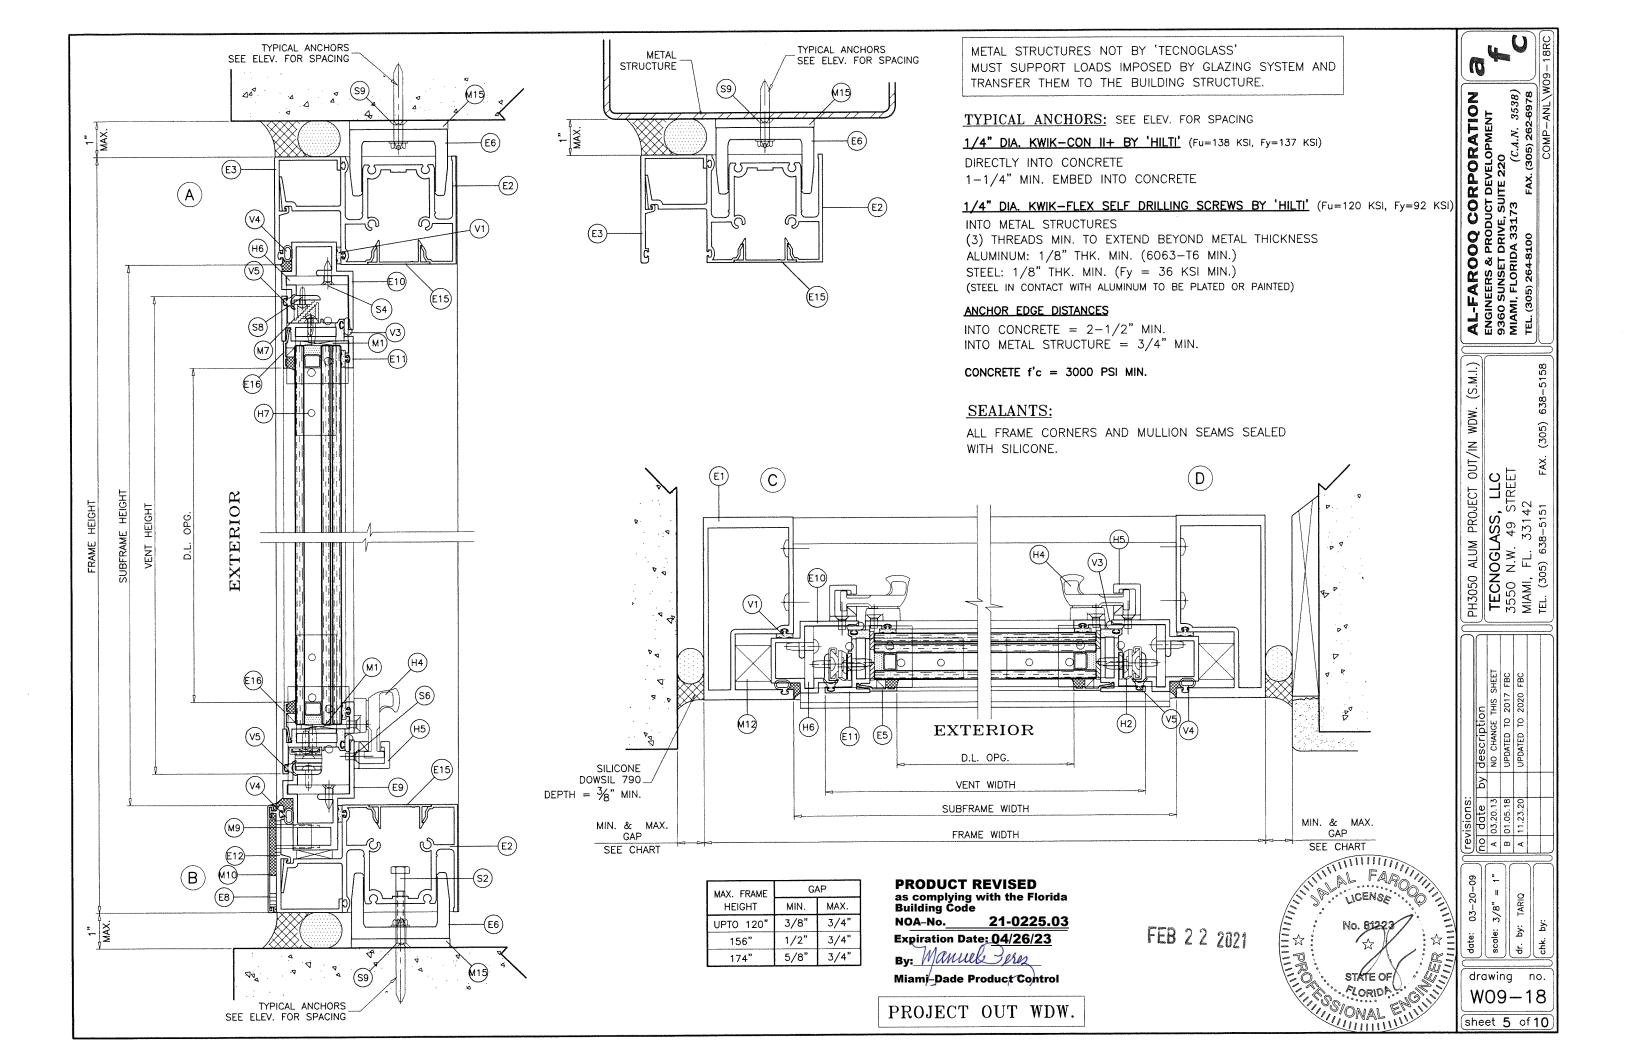


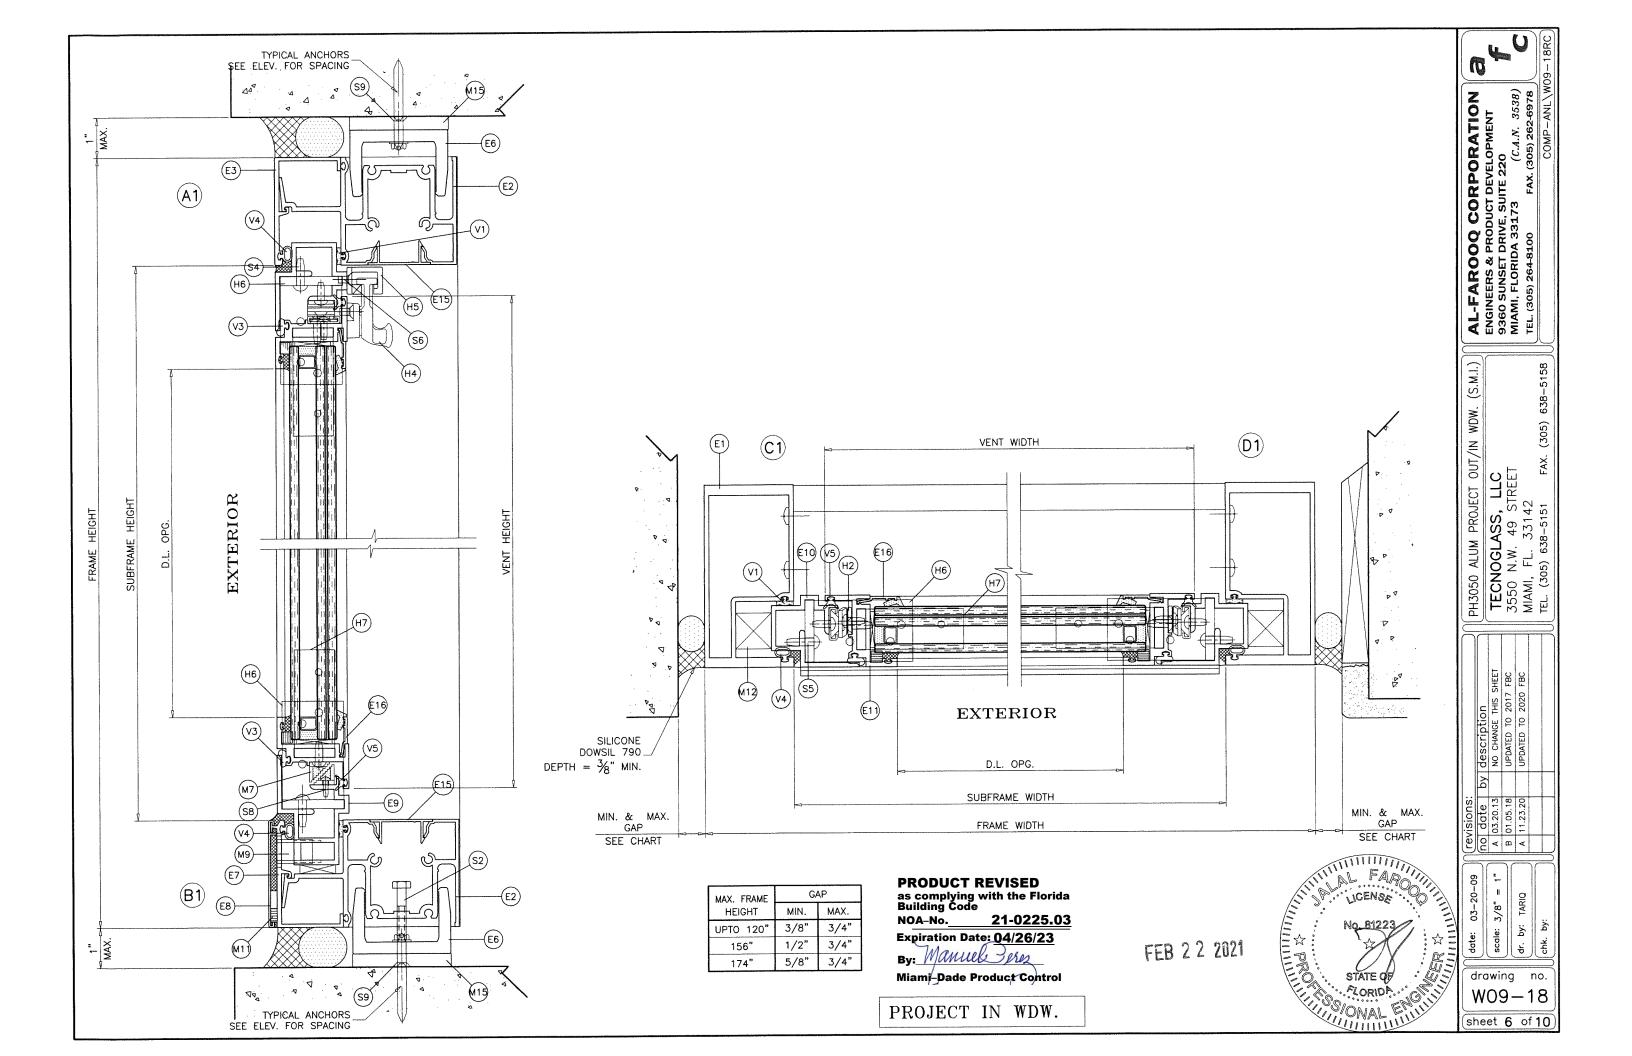


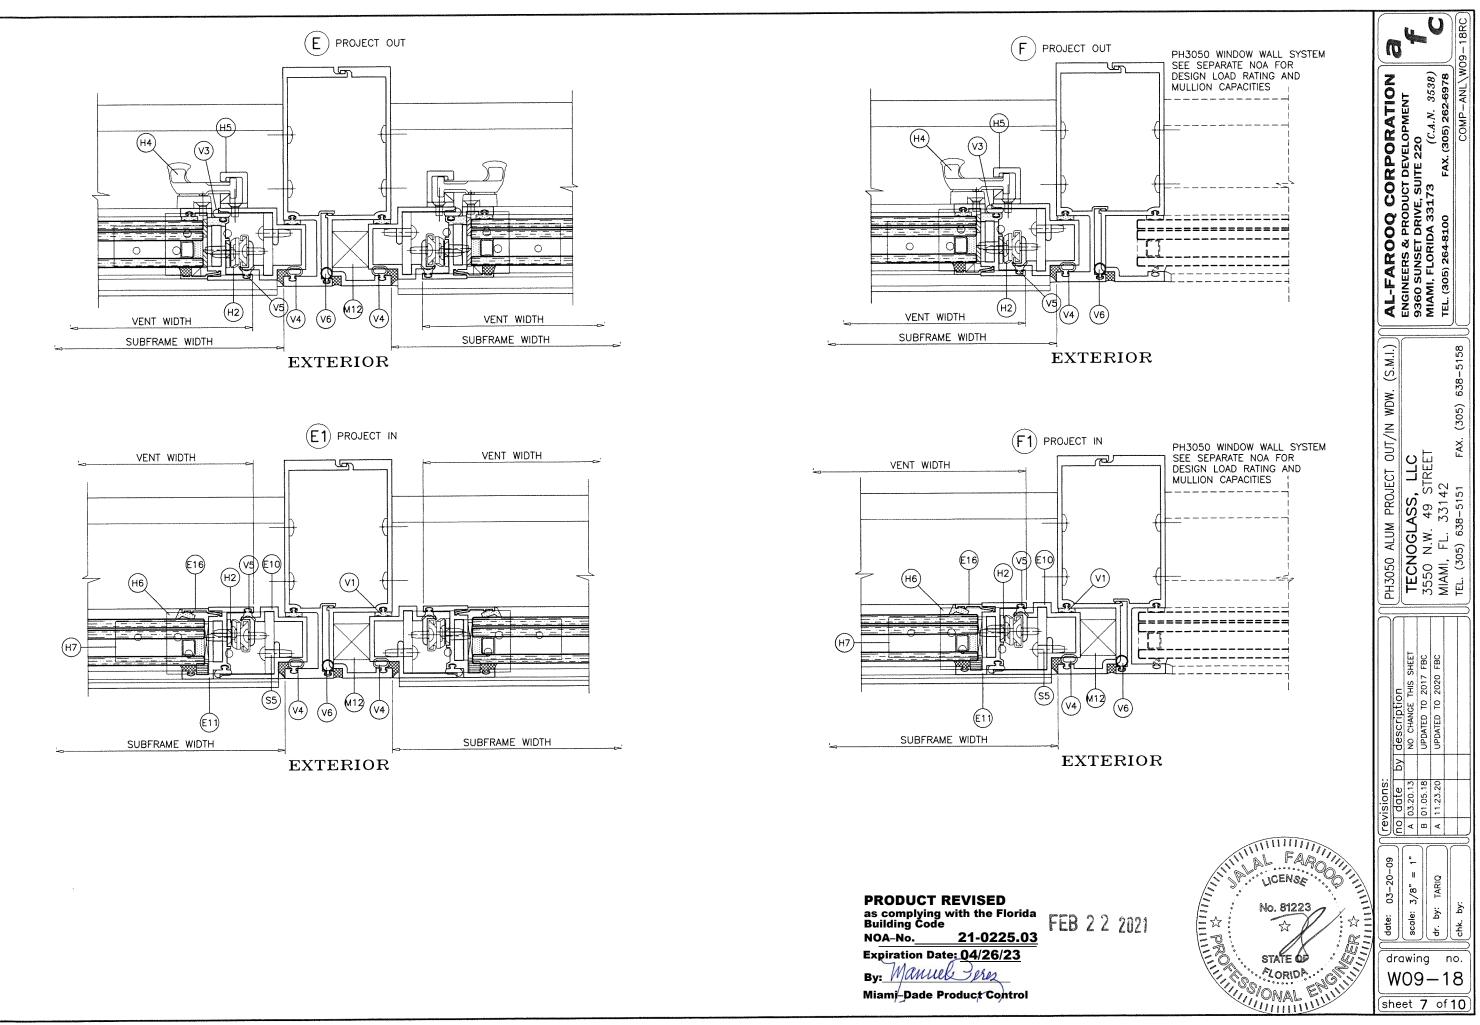

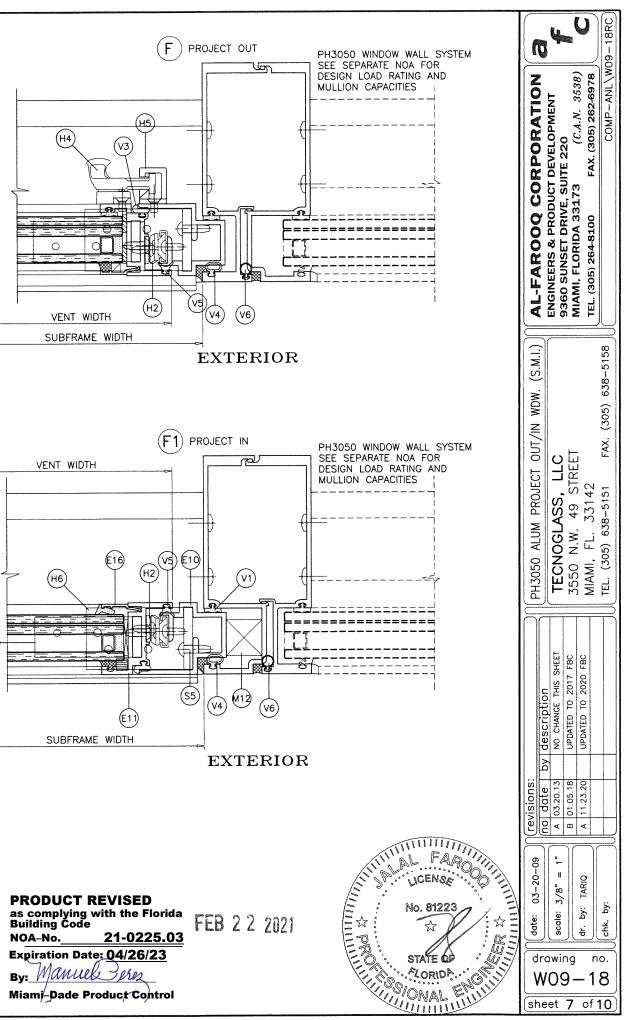

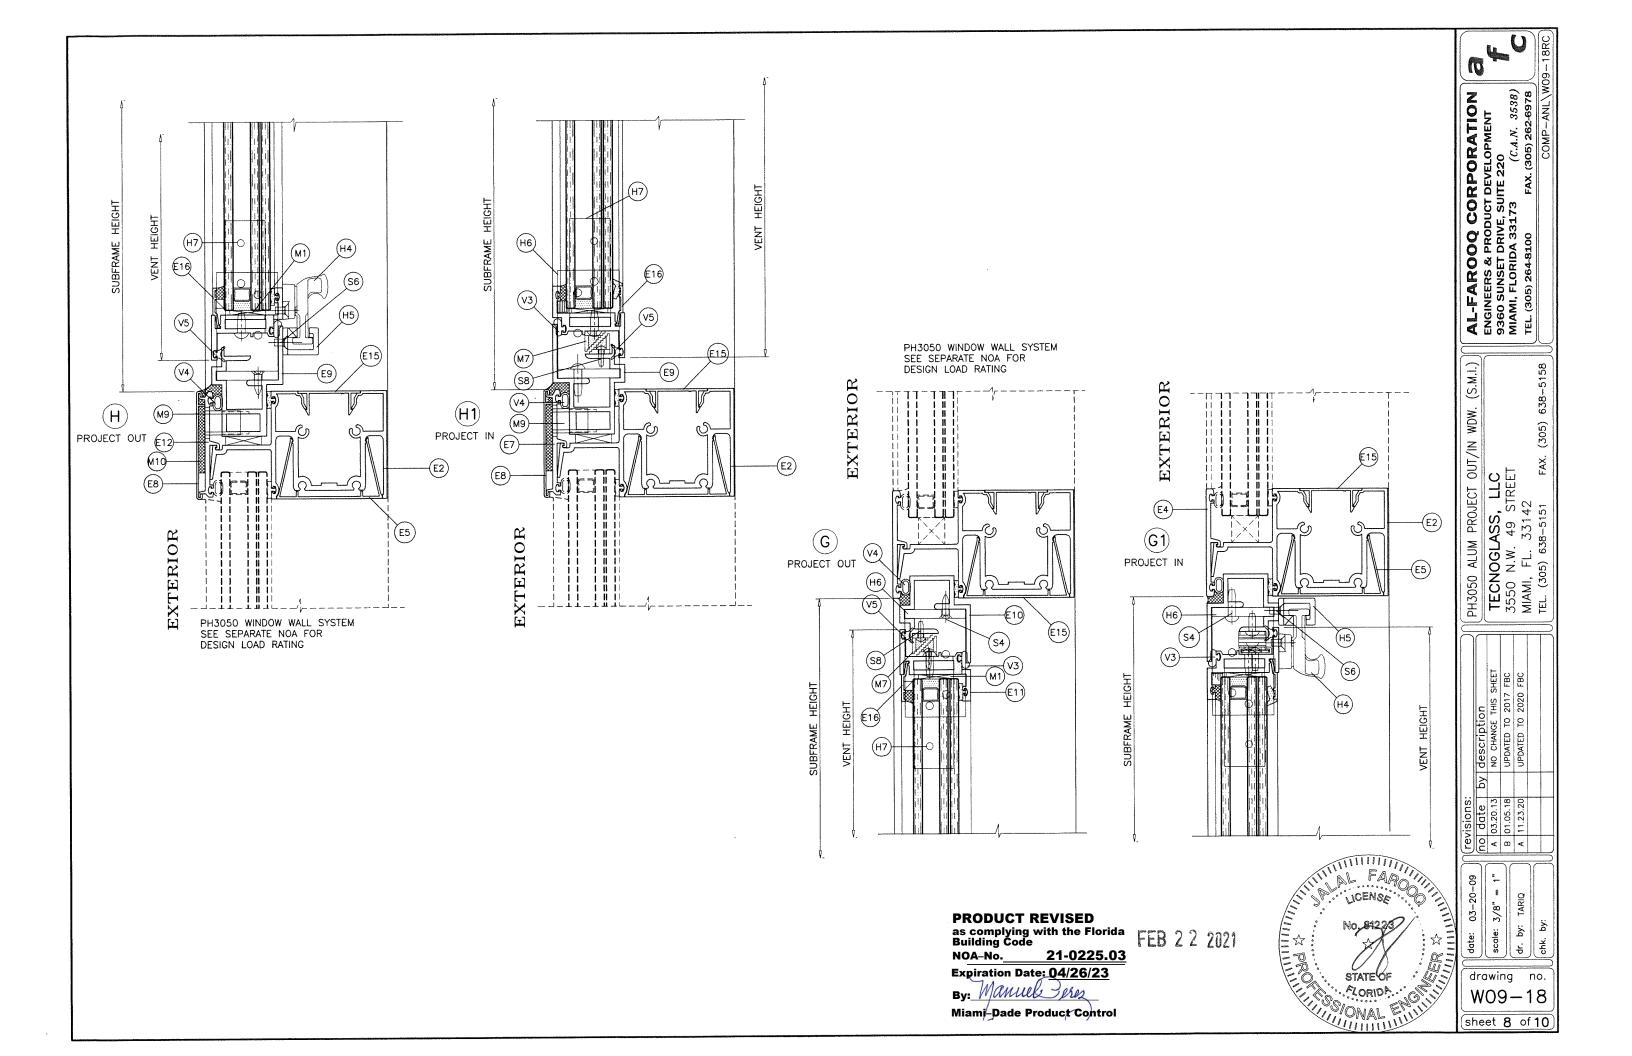

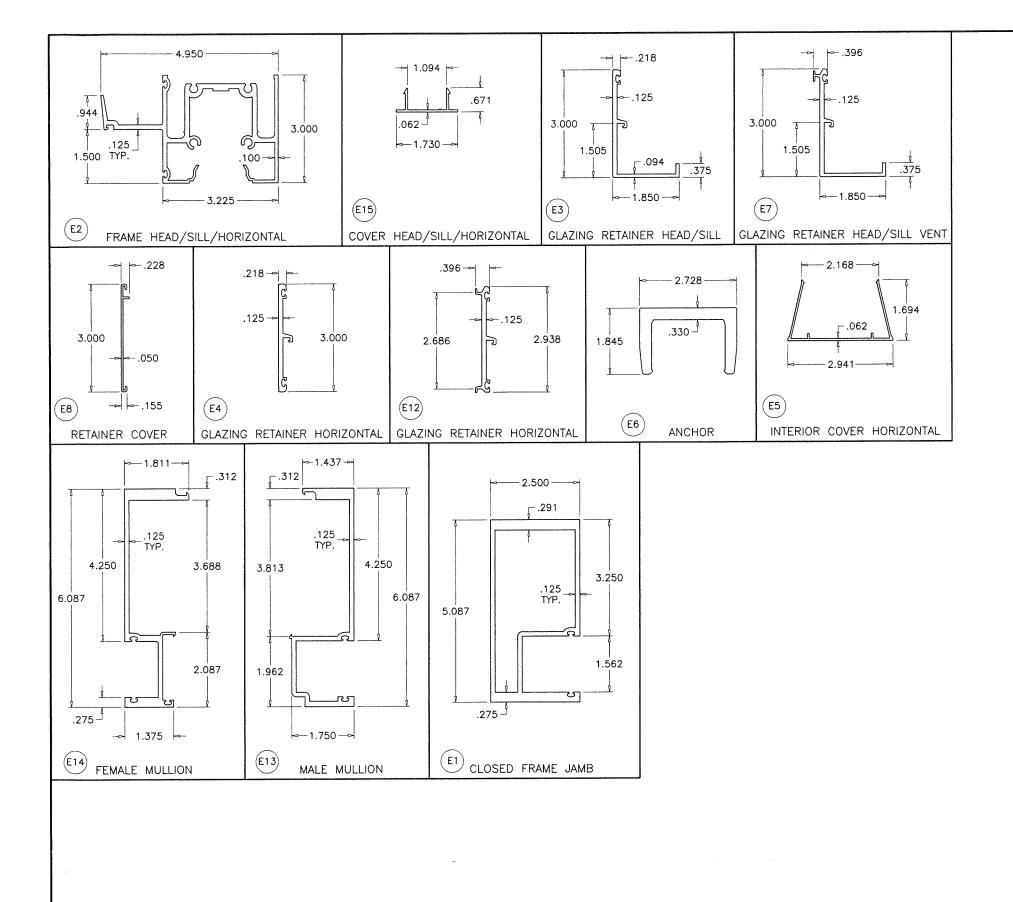

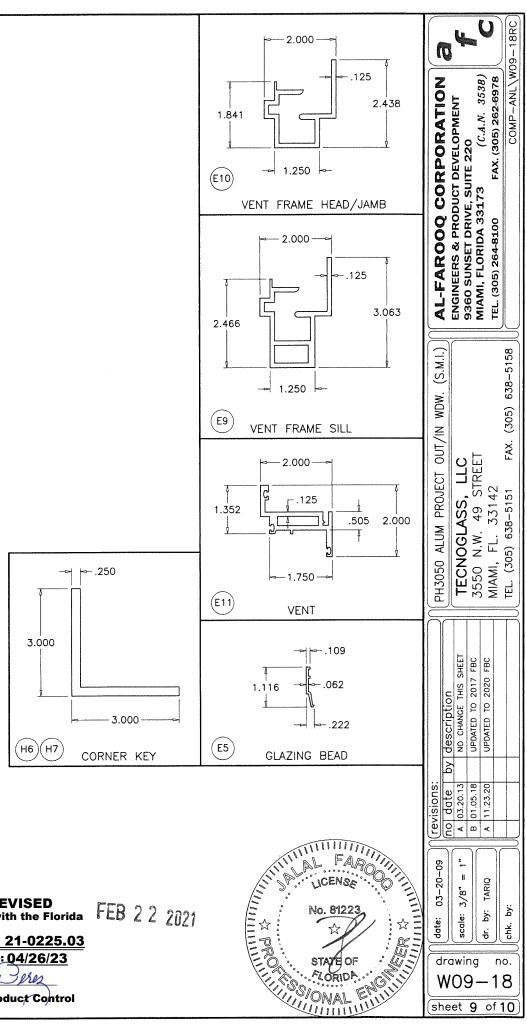

PRODUCT REVISED as complying with the Florida Building Code NOA-No. Expiration Date: 04/26/23 By: Manuel Peres

Miami-Dade Product Control

