



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786)315-2590 F (786) 31525-99
www.miamidade.gov/economy

BASF Corporation
1703 Crosspoint Avenue
Houston, TX 77054

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Skytite C2 over Steel Decks.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 5.

The submitted documentation was reviewed by Alex Tigera.



NOA No.: 21-0309.03
Expiration Date: 07/21/27
Approval Date: 07/21/22
Page 1 of 5

ROOFING SYSTEM APPROVAL

Category: Roofing
Sub-Category: Spray Applied Polyurethane Roof System
Materials: Polyurethane
Deck Type Steel
Maximum Design Pressure -82.5 psf

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
SKYTITE C2-2.5	2.5 lbs./ft ³ density	TAS 110	HFC-blown, Zero Ozone-Depleting (Zero-ODP), spray polyurethane foam (SPF) system designed for roofing applications.
SKYTITE C2-2.8	2.8 lbs./ft ³ density	TAS 110	HFC-blown, Zero Ozone-Depleting (Zero-ODP), spray polyurethane foam (SPF) system designed for roofing applications.
SKYTITE C2-3.0	3.0 lbs./ft ³ density	TAS 110	HFC-blown, Zero Ozone-Depleting (Zero-ODP), spray polyurethane foam (SPF) system designed for roofing applications.

TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>	<u>Manufacturer</u>
Any Miami-Dade County Approved Roof Coating	N/A	As Required by Miami-Dade County PCA	Roof coating for application over polyurethane spray applied foam.	Generic. (with current NOA)



EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Construction Materials Technologies, LLC	131T0005	TAS 114 App J	06/03/20
	131T0008	FM 4470	06/11/20
Intertek	103937625MID-008AR0	ASTM D 2842-19	09/26/19
	103937625MID-006A	ASTM D 2126	09/20/19
	103937625MID-001A	ASTM D 1621	07/30/19
	103937625MID-007AR0	ASTM D 1623	11/19/19
	131T0021	ASTM C 273	01/19/22
	103937625MID-009A	ASTM D 6226	06/24/19
	103937625MID-008B	ASTM D 2842-19	09/26/19
	103937625MID-006B	ASTM D 2126	09/20/19
	103937625MID-003B	ASTM E 96	08/28/19
	103937625MID-007BR0	ASTM D 1623	11/19/19
	131T0021	ASTM C 273	01/19/22
	103937625MID-009B	ASTM D 6226	06/24/19
	103937625MID-008CR0	ASTM D 2842-19	11/01/19
	103937625MID-006C	ASTM D 2126	09/20/19
	103937625MID-001C	ASTM D 1621	07/30/19
	103937625MID-007CR0	ASTM D 1623	11/19/19
	131T0021	ASTM C 273	01/19/22
	103937625MID-009C	ASTM D 6226	06/24/19
QAI Laboratories	TJ6913-4	ASTM E 96	02/07/20
	TJ6913-7 Rev 1	ASTM D 1621	03/11/20
	TJ6913-6	ASTM E 96	02/07/20
	RJ6452F-17	ASTM E 108	09/28/18
	RJ6452F-13	ASTM E 108	09/27/18
	RJ6452F-12	ASTM E 108	09/27/18
	RJ6452F-11	ASTM E 108	09/27/18
	RJ6452F-7	ASTM E 108	09/27/18
	RJ6452F-5	ASTM E 108	09/27/18
	RJ6379-8	ASTM E 108	06/13/17
	RJ6379F-7	ASTM E 108	06/19/18
	RJ6379-6	ASTM E 108	07/16/18
	RJ6379F-5	ASTM E 108	07/19/18
	RJ6379-4	ASTM E 108	07/19/18
	RJ6379F-3	ASTM E 108	07/19/18
	RJ6019F-3	ASTM E 108	04/04/18
	RJ6379F-1	ASTM E 108	07/18/18
	RJ6452F-18	ASTM E 108	09/28/18

DECK STRESS ANALYSIS CALCULATIONS/REPORTS

<u>Engineer/Agency</u>	<u>Identifier</u>	<u>Assemblies:</u>	<u>Date</u>
PRI Construction Materials Technologies, LLC.	131T0005	A(1)	06/30/20



APPROVED ASSEMBLIES:


Deck Type 2:	Steel
Deck Description:	Minimum 22 ga. ASTM A 653 Grade 33 G90, Type B Steel Deck with maximum 6' spans secured to the min. ¼" thick steel deck supports at a maximum spacing of 6" o.c. (every rib) with one (1) #12-24 HWH fasteners. Side laps secured with #1/4-14 X 7/8" HWH screws at 24" o.c. This Tested Assembly has been analyzed for allowable deck stress. See Evidence Submitted Table
System Type A(1):	Sprayed polyurethane foam applied directly to steel deck and covered with an Approved Miami-Dade County roof coating.

All General and System Limitations apply.

Surface Preparation:	<p>Metal surfaces if required; should be primed according to BASF Corporation and coating manufacturers' recommendations. Primer shall be thoroughly cured prior to application of foam.</p> <p>For ferrous metal, remove loose rust and unsound primer from shop-primed iron and steel surfaces by scraping, wire brushing or sandblasting. Prime according to BASF Corporation and coating manufacturer's recommendations. For non-ferrous metals, clean and prime aluminum, copper and stainless steel surfaces as recommended by BASF Corporation</p> <p>Primers shall be applied if required; in accordance with their manufacturer's instructions. All primers must be thoroughly dry and cured prior to foam application.</p>
Polyurethane Foam Application:	The polyurethane foam shall be applied uniformly over the entire surface at the minimum thickness of 1 to 6" over the top of the deck flange in compliance with the requirements set forth in Roofing Application Standard RAS 109. The sprayed polyurethane foam shall be feathered at the edges to produce a smooth transition.
Protective Coating Application:	<p>Shall apply a Miami-Dade County approved roof coating with a current NOA applied in accordance with the guidelines listed in the NOA.</p> <p>Polyurethane foam surface shall be free of moisture, dust, debris, oils, tars, grease or other materials that will as recommended by BASF Corporation impair adhesion of the protective coverings. Any damage or defects to the polyurethane foam surface shall be repaired prior to the coating application. The coating shall be applied the same day as the foam when possible. If more than 72 hours elapse prior to the application of the coatings, the polyurethane foam shall be inspected for UV degradation.</p>
Maximum Design Pressure:	-82.5 psf. (See General Limitation # 7)



TABLE 1
AMBIENT HUMIDITY APPLICATION LIMITS SPRAYED POLYURETHANE FOAM

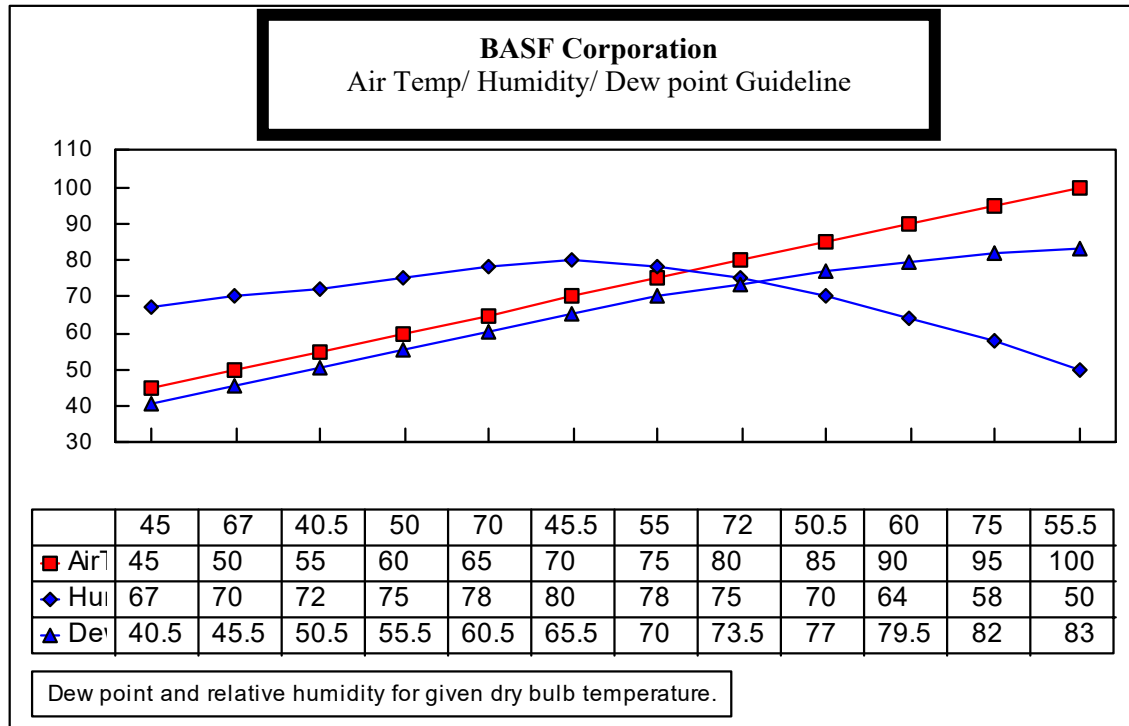

GENERAL LIMITATIONS:

1. Fire classification is not part of this acceptance, refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. Spray polyurethane foam shall not be sprayed when ambient temperature is within 5 degrees of the dew point. Ambient humidity applications limits shall be as listed in Table 1 herein. Contractor shall monitor and record environmental conditions in the Job Log in compliance with RAS 109. Job Log shall be maintained at the job site and accessible to The Building Official.
3. Flashings and waterproof coverings for expansion joints shall be of compatible materials and in accordance with BASF Corporation published literature.
4. Miscellaneous materials such as adhesives, elastomeric caulking compounds, metal, vents and drains shall be a composite part of the roof system and shall be compatible with the foam and coating.
5. All attachment and sizing of perimeter nailers, metal profile, and/or flashing termination designs shall conform to Roofing Application Standard RAS 111 and the wind load requirements of applicable building code.
6. The maximum designed pressure limitation listed shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners). **(When this limitation is specifically referred within this NOA, General Limitation #7 below will not be applicable.)**
7. Perimeter and corner areas shall comply with the enhanced uplift pressure requirements of these areas. Fastener densities shall be increased for both insulation and base sheet as calculated in compliance with Roofing Application Standard RAS 117. Calculations prepared, signed and sealed by a Florida registered Professional Engineer, Registered Architect, or Registered Roof Consultant **(When this limitation is specifically referred within this NOA, General Limitation #6 above will not be applicable.)**

END OF THIS ACCEPTANCE