



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

IKO Industries Inc.
6 Denny Road, Suite 200
Wilmington, Delaware 19809

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: IKO Asphalt Accessory Products

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 22-0209.03 and consists of pages 1 through 7.
The submitted documentation was reviewed by Alex Tigera.



NOA: 22-0920.05
Expiration Date: 05/12/26
Approval Date: 07/06/23
Page 1 of 7

ROOFING ASSEMBLY APPROVAL

<u>Category:</u>	Roofing
<u>Sub-Category:</u>	Asphalt Shingles
<u>Materials:</u>	Asphalt
<u>Deck Type:</u>	Wood

SCOPE

This approves a roofing component, **Leading Edge Plus, Armour Starter, Hip & Ridge 12, and Hip & Ridge Class 4** manufactured by IKO Industries Inc. as described in Section 2 of this Notice of Acceptance, designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

PRODUCT DESCRIPTION

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Leading Edge Plus <i>Manufacturing Loc. #1</i>	7 7/8" x 40 7/8"	TAS 100	Fiberglass reinforced mono-layer shingle strip.
Armour Starter <i>Manufacturing Loc. #4</i>	13 1/4" x 39 3/8"	TAS 100	Fiberglass reinforced mono-layer shingle strip.
Hip & Ridge 12 <i>Manufacturing Loc. # 2, 3, 4, 5</i>	13 1/4" x 36"	TAS 100	Ridge cap shingle
Hip & Ridge Class 4 <i>Manufacturing Loc. # 2, 4</i>	13 1/4" x 36"	TAS 100	Ridge cap shingle

MANUFACTURING LOCATION

1. Hawkesbury, ON
2. Kankakee, IL
3. Sylacauga, AL
4. Calgary, AB
5. Toronto, ON



NOA: 22-0920.05
Expiration Date: 05/12/26
Approval Date: 07/06/23
Page 2 of 7

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
FM Approvals	3040947	ASTM D3161 (TAS-107)	08/02/11
PRI Construction Materials Technologies, LLC	IKO-009-02-04	TAS 100	03/05/19
	IKO-009-02-01	ASTM D3462 & E108	03/04/19
	IKO-171-02-03	TAS 100	08/31/18
	IKO-171-02-01.1	ASTM D3462	08/15/17
	KO-171-02-02	ASTM D3161	01/04/18
	IKO-171-02-03 Addendum	TAS 100	12/12/18
	IKO-208-02-01	ASTM D3462	12/12/18
	IKO-171-02-02 Addendum	ASTM D3161	12/12/18
	476T0107	ASTM D3462	04/13/22
	476T0108	ASTM D3161	10/29/21
	476T0142	TAS 100	12/07/21
	476T0158	ASTM D 3462	07/21/22
	476T0159	TAS 107	07/21/22
	476T0160	ASTM E 108	07/21/22
	476T0161	TAS 100	07/21/22
	476T0163	ASTM D 3462	09/07/22
	476T0164	TAS 107	07/11/22
	476T0165	ASTM E 108	07/11/22
	476T0166	TAS 100	07/11/22
	476T0207	ASTM D 3463	01/26/23
	476T0208	TAS 107	01/26/23
	476T0209	ASTM E 108	01/26/23
	476T0210	TAS 100	01/26/23
	476T0111.1	ASTM D3462	04/26/2023
	476T0112.1	ASTM D3161	04/26/2023
	476T0113	ASTM E108	04/26/2023



LIMITATIONS

1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. Shall not be installed on roof mean heights in excess of 33 ft.
3. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.

INSTALLATION

1. Starter Strip Shingles shall be installed in compliance with Roofing Application Standard RAS 115.
2. Ridge cap shingles shall be installed in compliance with Roofing Application Standard RAS 115.
3. The manufacturer shall provide clearly written application instructions

LABELING

1. Shingles shall be labeled with the Miami-Dade Seal as seen below, or the wording “Miami-Dade County Product Control Approved”.



BUILDING PERMIT REQUIREMENTS

1. Application for building permit shall be accompanied by copies of the following:
 - 1.1 This Notice of Acceptance.
 - 1.2 Any other documents required by the Building Official or the applicable code in order to properly evaluate the installation of this system.




[illegible]




Diagram illustrating the bottom view of the perforated plate. The plate features a central rectangular area with a dashed line labeled "PERFORATIONS". The dimensions and features are as follows:

- Overall width: 1.250" (31.8) TYP.
- Overall height: 13.875" (352.4)
- Perforation pitch: 0.813" (20.6) TYP.
- Perforation gap: 0.313" (7.9)
- Perforation slit width: 0.500" (12.7)
- Bottom edge dimensions: 0.938" (23.8) TYP. C/L and 0.938" (23.8) TYP. C/L.




END VIEW

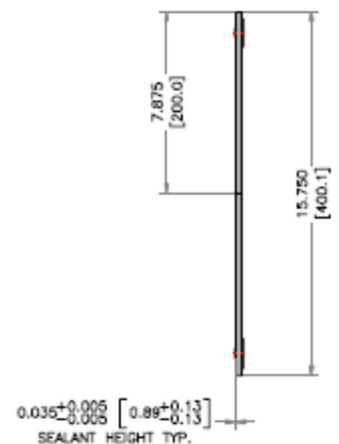

HIP & RIDGE 12 AND HIP & RIDGE CLASS 4 (ALL DIMENSIONS INDICATED IN INCHES)

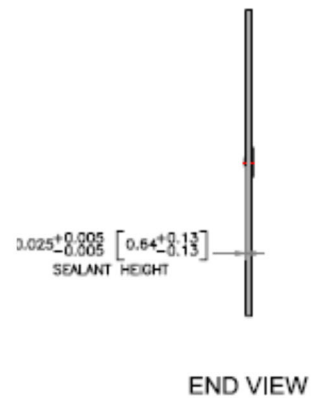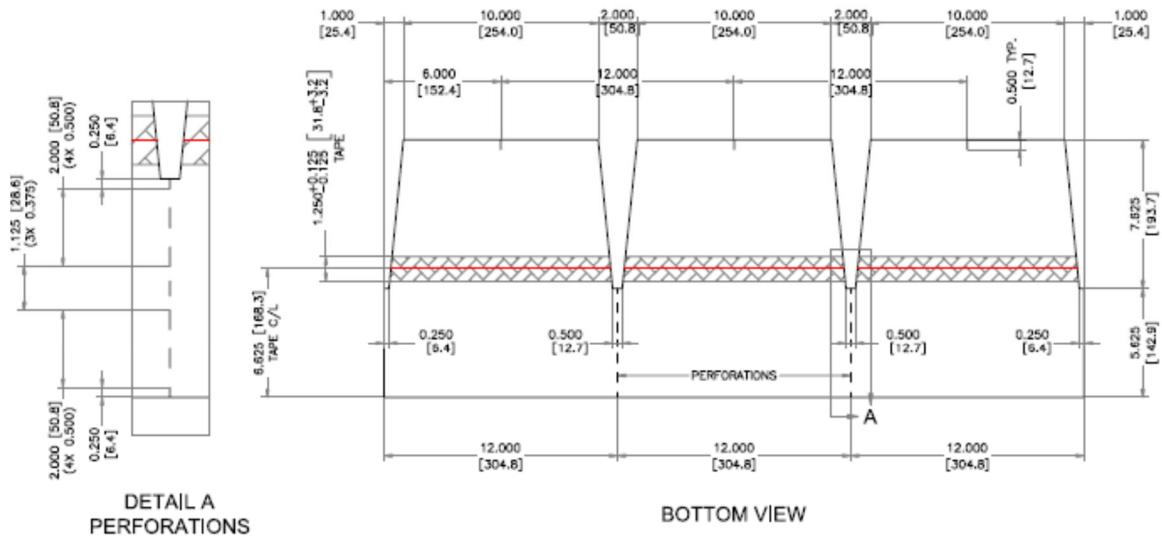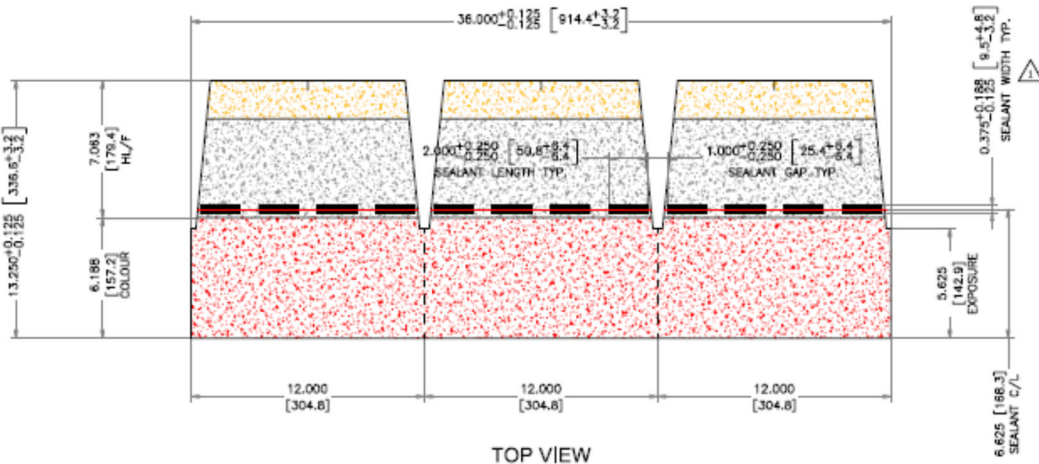

ARMOUR STARTER (ALL DIMENSIONS INDICATED IN INCHES)

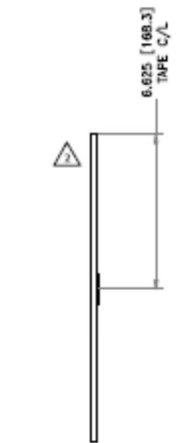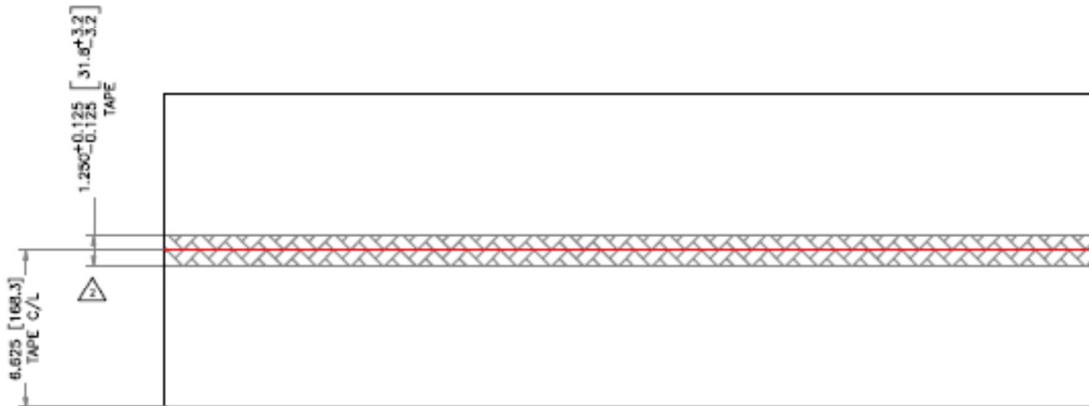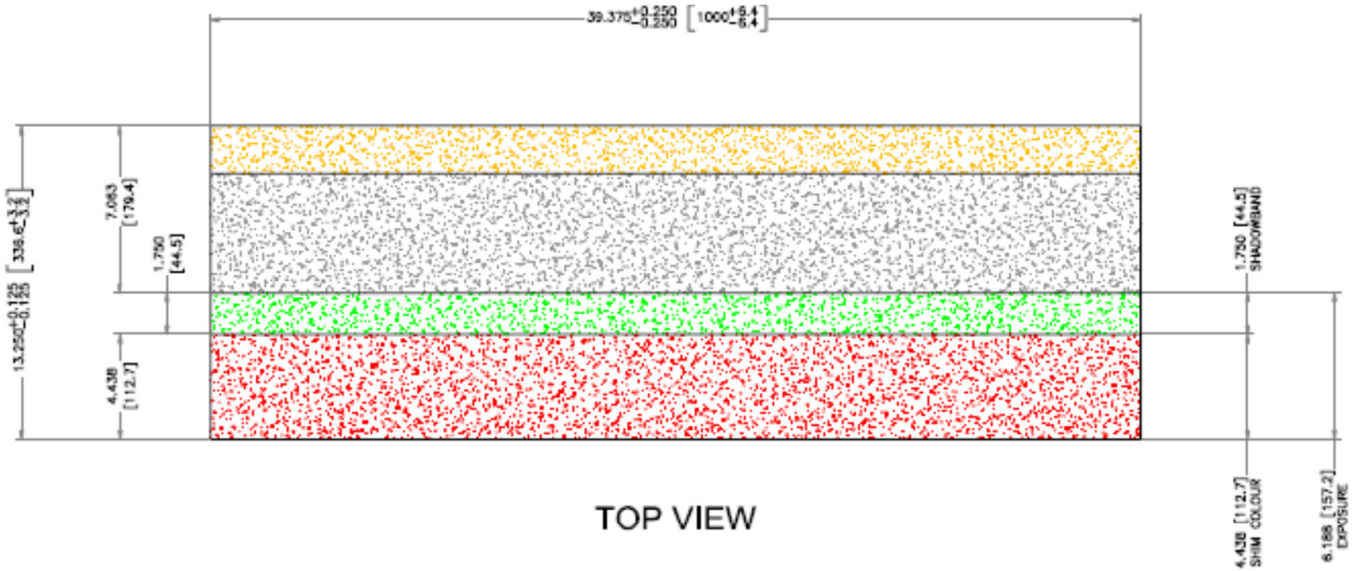

END OF THIS ACCEPTANCE