

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, Florida 33175-2474 T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

Doralum Corporation 7040 N. W. 77 Terrace Miami, FL 33166

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series 100 Outswing Aluminum Doors w/wo Sidelites – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W13-03, Rev G**, titled "Series-100 Alum Swing Door w/ Sidelites (L.M.I.)", sheets 1 through 10 of 10 (inclusive 3.1, 7.1), prepared by Al-Farooq Corp., dated 01/30/13 and last revised 06/21/2023, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

Limitations: 1. See DP tables for X or XX in sheet $\underline{\mathbf{1}}$, Door w/ sidelites (w/wo reinforcement) in sheet $\underline{\mathbf{3.1}}$. See Single sidelite (standalone) DP capacity in sheet $\underline{\mathbf{3}}$.

- 2. See allowable mulled configuration in sheet 3.1, not to exceed (5) panels w/ max two mulled sidelites.
- 3. Max <u>door</u> leaf width mulled with sidelites in sheet <u>3.1</u>, shall not exceed = 36-7/8". See active panel 4-point locking or active panel dead lock w/ manual bolts option in sheet **4.**
- 4. Glass lites wider than 36" shall have two setting blocks per FBC requirements.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA #23-0221.05 consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Sifang Zhao, P.E.



9,2. 08/31/2023

NOA No. 23-0710.14 Expiration Date: July 04, 2028 Approval Date: August 31, 2023

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA'S

A. DRAWINGS

- 1. Manufacturer's die drawings and sections. (Submitted under previous NOA #13-0219.07)
- 2. Drawing No. **W13-03, Rev F**, titled "Series-100 Alum Swing Door w/ Sidelites", sheets 1 through 10 of 10 (inclusive 3.1, 7.1), prepared by Al-Farooq Corp., dated 01/30/13 and last revised 09/11/20, signed and sealed by Jalal Farooq, P.E.

B. TESTS

- 1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 6) Forced Entry Test, per FBC 2411 3.2.1, TAS 202-94

Along with installation diagram of an outswing doors w/ sidelites prepared by Fenestration Testing Laboratory Inc, dated January 14, 2013, Test Report No **7086** (**FTL-12087**), signed and sealed by Marlin D. Brinson, P. E. (*Submitted under previous NOA #13-0219.07*)

C. CALCULATIONS

- 1. Anchor verification calculations and structural analysis, complying with **FBC-2014**, 5th **edition**, prepared by Al-Farooq Corporation, dated 06/19/15 and 12/11/15, signed and sealed by Javad Ahmad, P.E.
- 2. Anchor verification calculations and structural analysis, complying with **FBC** 6th **Edition** (2017), prepared by Al–Farooq Corporation, dated 01/15/18 and revised 04/20/18, signed and sealed by Javad Ahmad, P. E.
- 3. Anchor verification calculations and structural analysis, complying with **FBC 7th Edition** (2020), prepared by Al–Farooq Corporation, dated 09/11/20, signed and sealed by Jalal Farooq, P. E.
- **4.** Glazing complies w/ ASTME-1300-09

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. **17-0808.02** issued to Kuraray America, Inc. for their "Sentry Glas ® (Clear and White) Interlayer", expiring on 07/04/2023.
- 2. Notice of Acceptance No. 20-0915.02 issued to Kuraray America, Inc. for their "Trosifol ® Ultraclear, Clear and Color PVB Glass Interlayers", expiring on 07/08/24.
- 3. Notice of Acceptance No. **21-0216.01** issued to Eastman Chemical Company, (MA) for "Saflex Clear and Color Glass Interlayers", expiring on 05/21/26.

Sifang Zhao, P.E. Product Control Examiner NOA No. 23-0710.14 Expiration Date: July 04, 2028 Approval Date: August 31, 2023

Doralum Corporation

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

F. STATEMENTS

- 1. Statement letter of conformance FBC 2014 (6th Edition) and letter of no financial interest, prepared by Al-Farooq Corporation, dated 06/20/15, signed and sealed by Javad Ahmad, P.E.
- 2. Statement letter of conformance to FBC 2020 (7th Edition) and request renewal with no change, prepared by Al-Farooq Corporation, dated 02/16/23, signed and sealed by Jalal Farooq, P.E.
- **3.** Lab compliance as part of the above referenced test report.

G. OTHER

- 1. Test proposal, dated 08/21/12 approved by Jaime D. Gascon, P.E.
- **2.** RER e-mail correspondence dated FEB 14, 2023.

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W13-03, Rev F**, titled "Series-100 Alum Swing Door w/ Sidelites", sheets 1 through 10 of 10 (inclusive 3.1, 7.1), prepared by Al-Farooq Corp., dated 01/30/13 and last revised 06/21/2023, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None.

- **C. CALCULATIONS** (submitted under previous approval)
 - 1. None.

D. QUALITY ASSURANCE

1. Miami Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. **17-0808.02** issued to Kuraray America, Inc. for their "**Sentry Glas** ® (**Clear and White**) **Interlayer**", expiring on 07/04/2023.
- 2. Notice of Acceptance No. **20-0915.02** issued to Kuraray America, Inc. for their "**Trosifol** ® **Ultraclear, Clear and Color PVB Glass Interlayers**", expiring on 07/08/24.
- 3. Notice of Acceptance No. **21-0216.01** issued to Eastman Chemical Company, (MA) for "Saflex Clear and Color Glass Interlayers", expiring on 05/21/26.

F. STATEMENTS


1. Statement letter of conformance to FBC 2020 (7th Edition) and FBC 2023 (8th Edition) and no financial interest, prepared by Al-Farooq Corporation, dated 06/21/23, signed and sealed by Jalal Farooq, P.E.

G. OTHER

1. This NOA revises NOA #23-0221.05, expiring on 07/04/2028.

00

Sifang Zhao, P.E.
Product Control Examiner
NOA No. 23-0710.14
Expiration Date: July 04, 2028
Approval Date: August 31, 2023

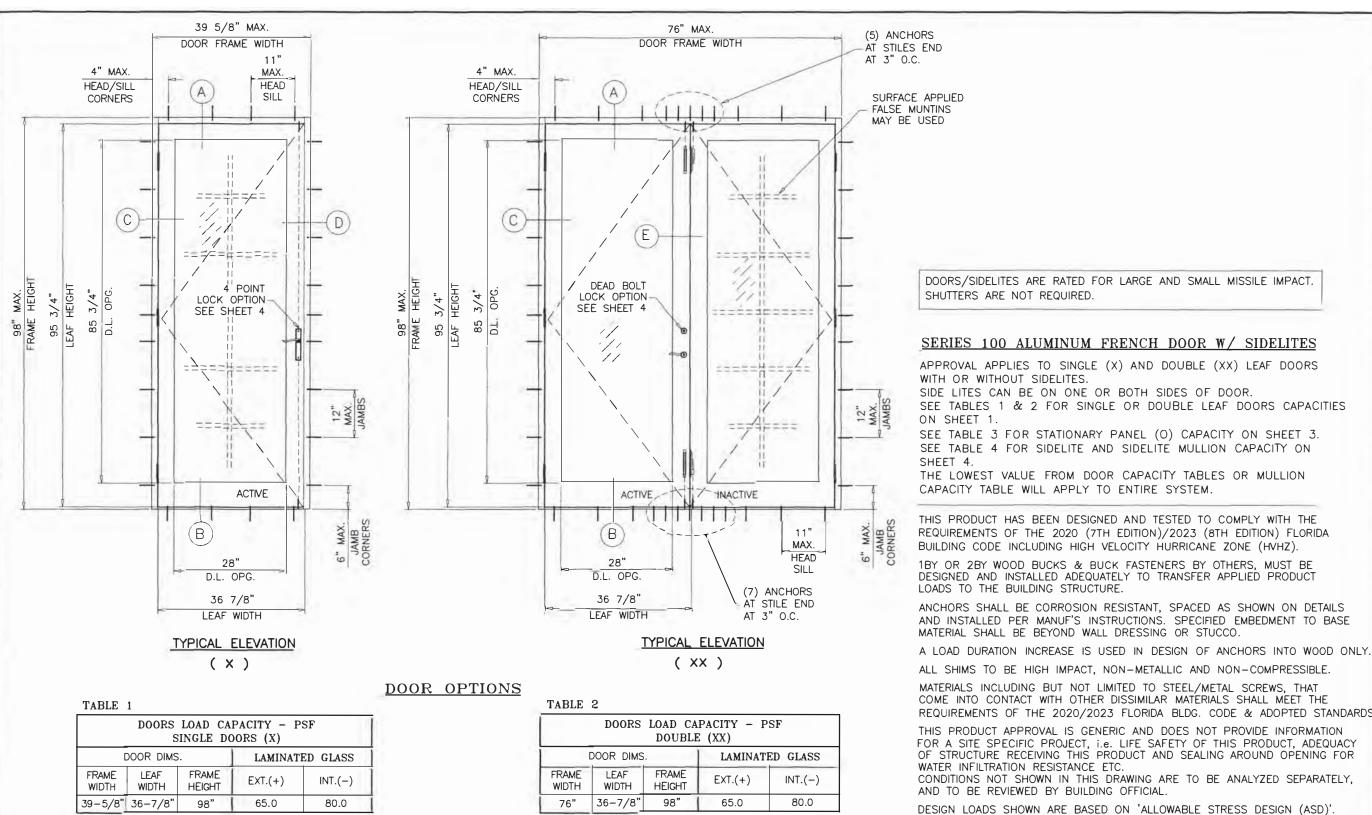

COMPLIANCE WITH EGRESS REQUIREMENTS TO BE REVIEWED BY BLDG. OFFICIAL PER FBC, AS APPLICABLE.

> FLUSH BOLTS AND LOCKS MUST BE ENGAGED TO HEAD AND SILL DURING PERIODS OF HURRICANE WARNING.

GLASS CAPACITIES ON THIS SHEET ARE BASED ON ASTM E1300-09 (3 SEC. GUSTS) AND FLORIDA BUILDING COMMISSION DECLARATORY STATEMENT DCA05-DEC-219

DOORS LOAD CAPACITY - PSF DOUBLE (XX)						
DOOR DIMS.			LAMINATED GLASS			
FRAME WIDTH	LEAF WIDTH	FRAME HEIGHT	EXT.(+)	INT.(-)		
76"	36-7/8"	98"	65.0	80.0		

as complying with the Florida Building Code 23-0710.14 NOA-No. **Expiration Date** <u>07/04/2028</u>

PRODUCT REVISED

DOORS/SIDELITES ARE RATED FOR LARGE AND SMALL MISSILE IMPACT.

SHUTTERS ARE NOT REQUIRED.

Miami-Dade Product Control
JUN 2 2023

DOOR LEAF WIDTH (XX DOORS) = (FRAME WIDTH - 2.250")/2D.L.O. HEIGHT = FRAME HEIGHT - 12.250"

(C.A.N. 3 FAX. (305) 262-

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

SIDELITES (

DORALUM CORPORATION 7040 N.W. 77 TERRACE MIAMI, FL. 33166 TEL. (305) 884–3922 FAX (305) SERIES-100 ALUM SWING DOOR W/

by description
REV. PER RER (
UPDATED TO 20
NO CHANGE THIS
UPDATED TO 20
UPDATED TO 20 REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS C 12.11.15
D 01.09.18
E 04.16.18
F 09.04.20

9 1/2"=1


by: å.


drawing no. W13-03


sheet 1 of 10

DOOR LEAF HEIGHT = FRAME HEIGHT - 2.250" DOOR LEAF WIDTH (X DOORS) = FRAME WIDTH _ 2.750"

D.L.O. WIDTH (X DOORS) = FRAME WIDTH - 11.625" D.L.O. WIDTH (XX DOORS) = (FRAME WIDTH - 20")/2

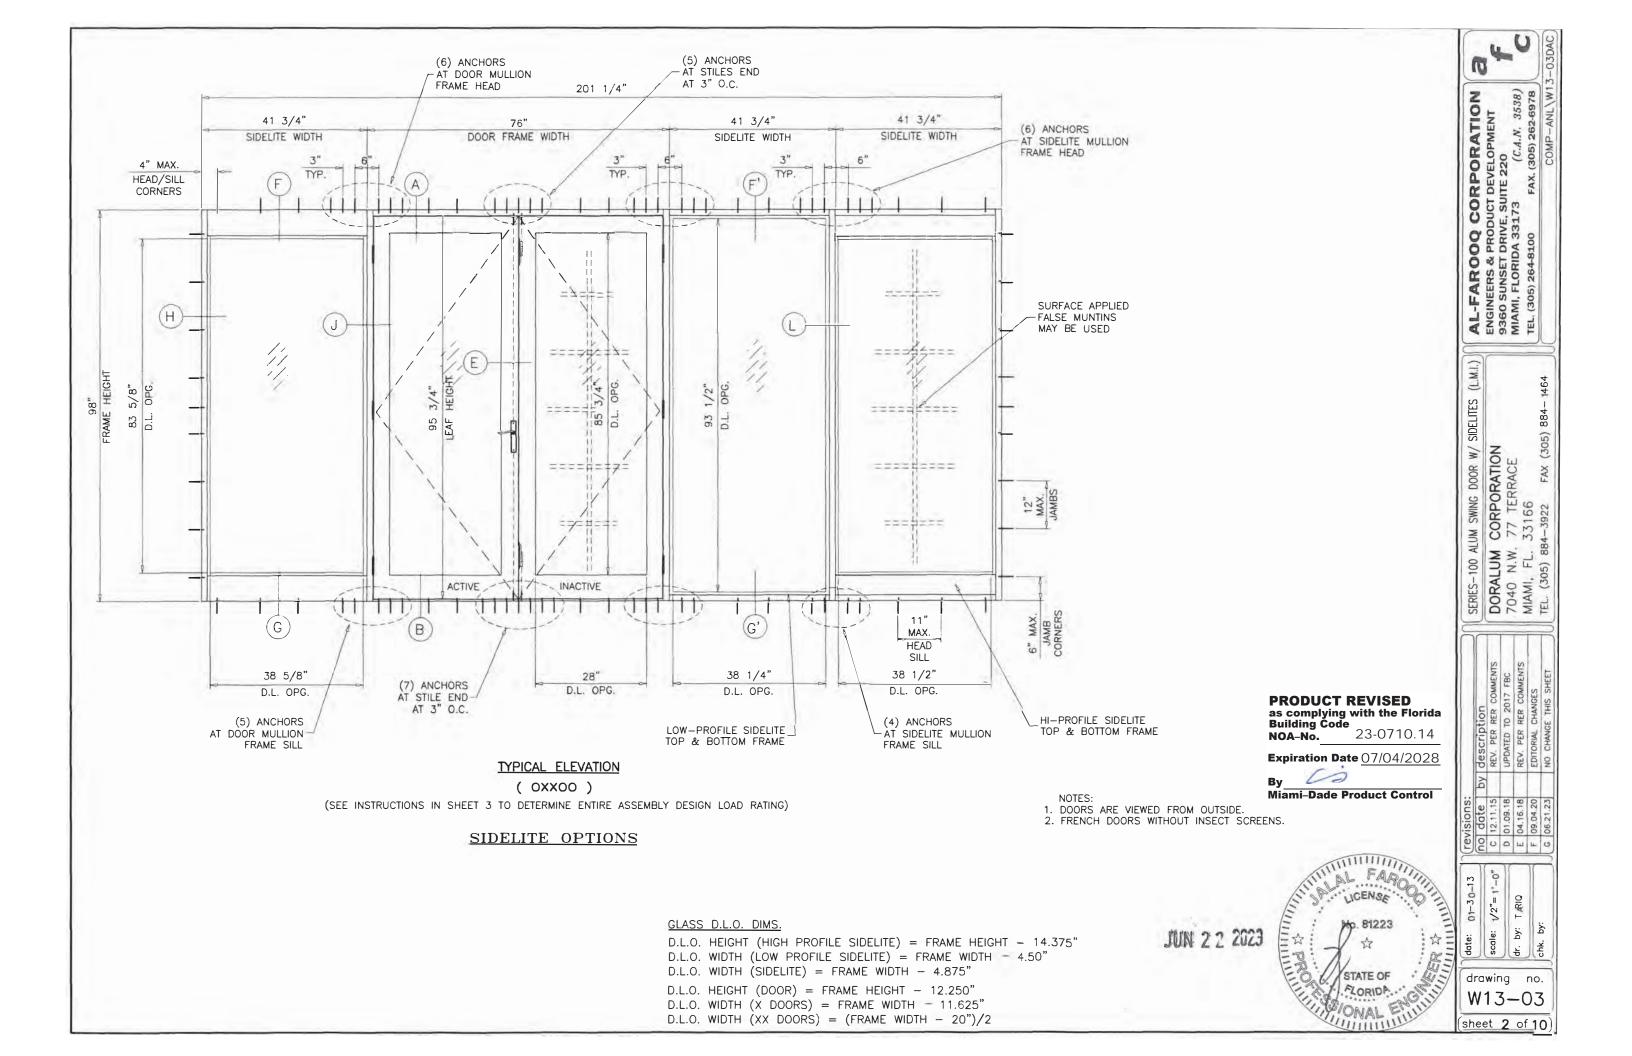

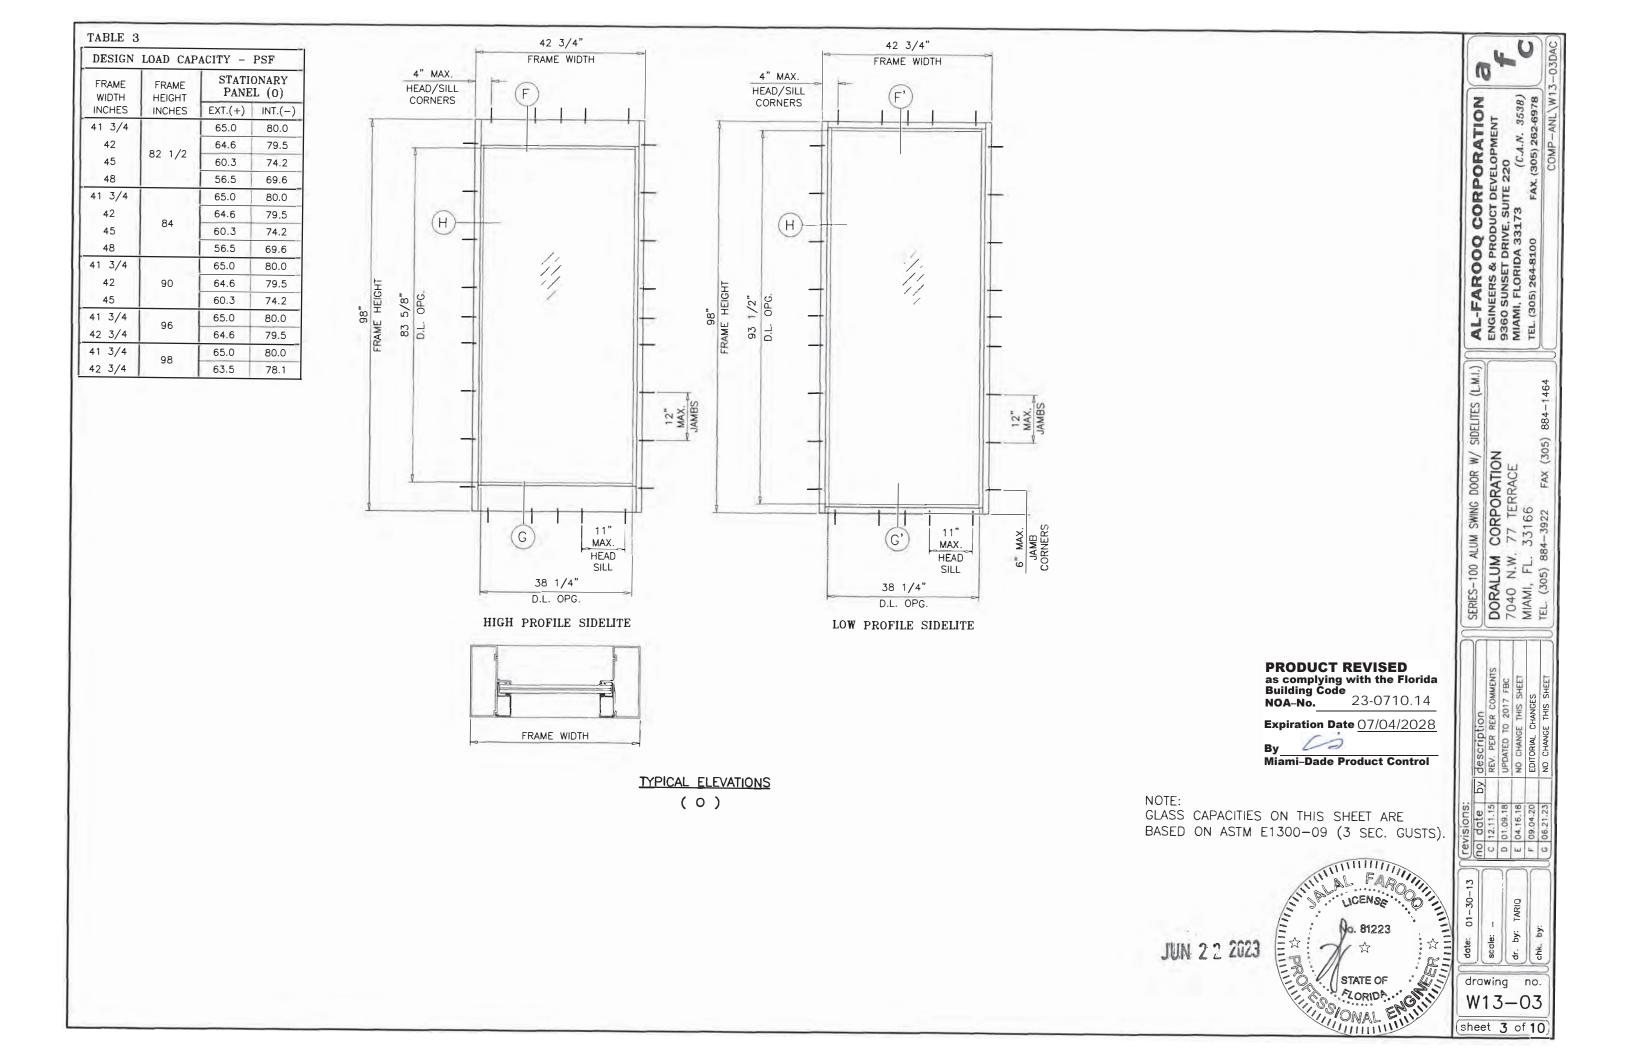

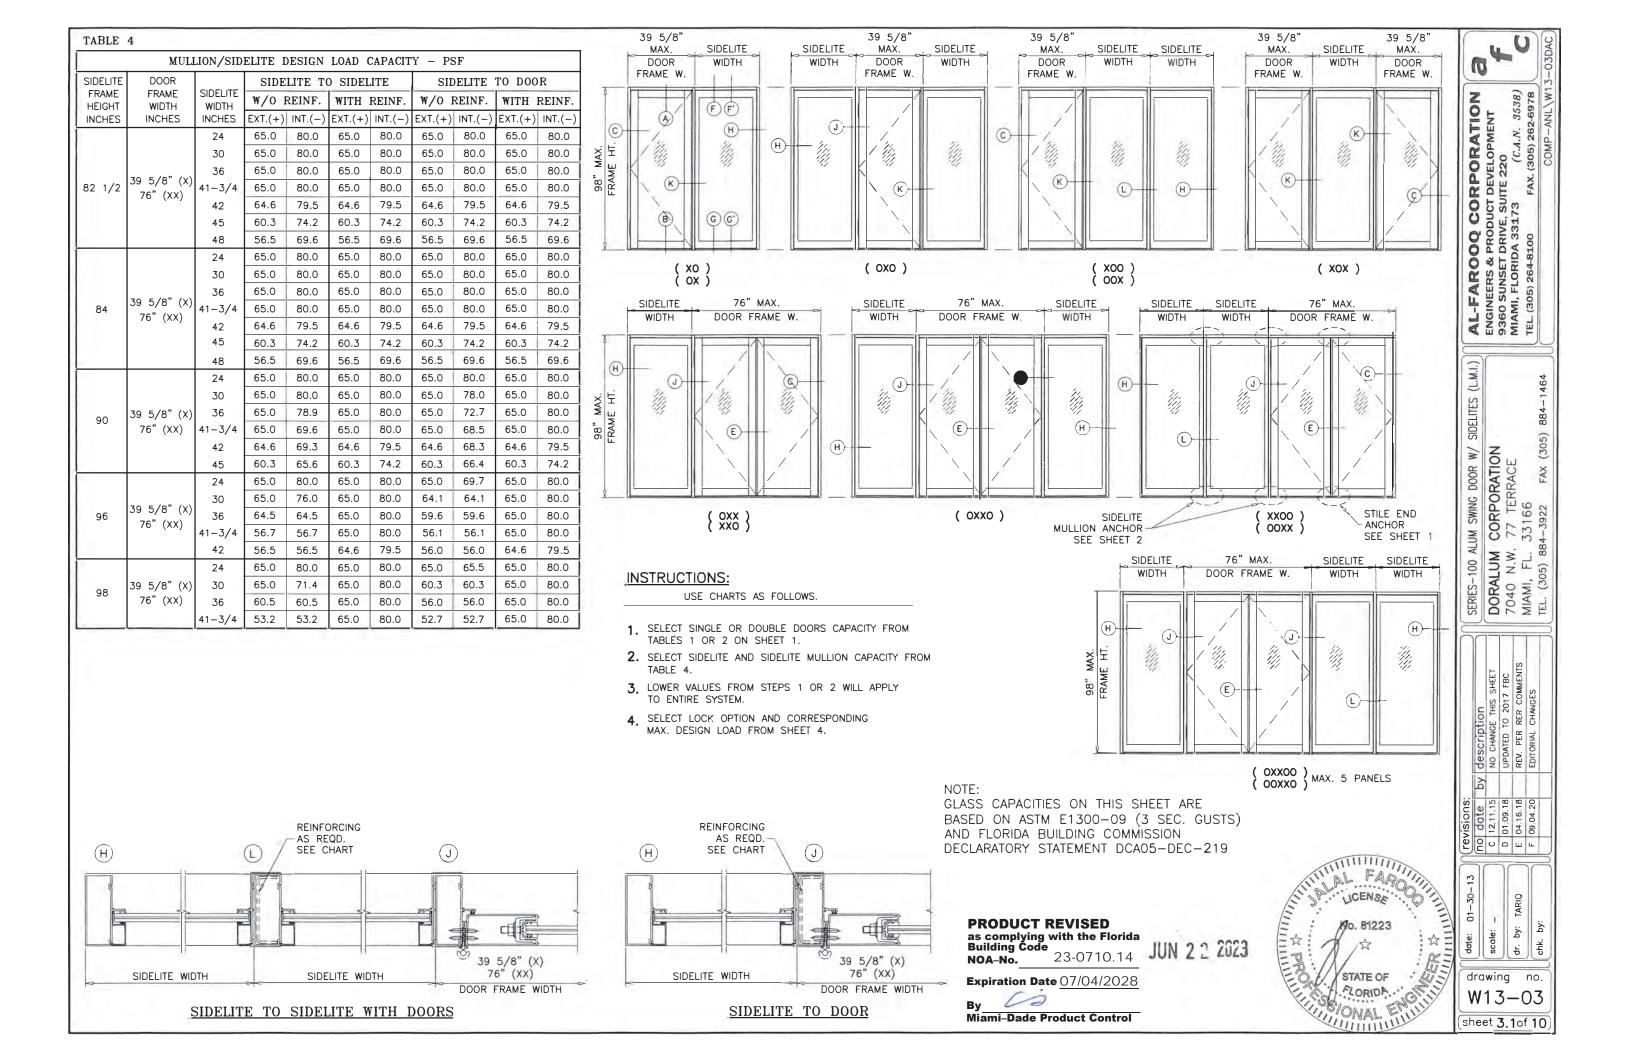

LOCK OPTIONS:

ACTIVE LEAF:

SURFACE MOUNT DEAD BOLT LOCK AT 44-3/4" FROM BOTTOM, KEY OPERATED ON EXTERIOR AND THUMB TURN ON INTERIOR FASTENED TO ACTIVE LEAF LOCK STILE WITH (2) #10-32 X 2" OH MS(2) #8-32 X 1/2" FH MS LEVER TYPE METALLIC HANDLE AT 38-3/4" FROM BOTTOM, FASTENED TO ACTIVE LEAF LOCK STILE WITH (2) $\#8-32 \times 1-1/4$ " PH MS. AND (2) #8-32 X 1/2" FH MS

CONCEALED FLUSH BOLTS BY 'REGENT' MANUALLY OPERATED LEVERS MOUNTED ON STILE FACE, LOCATED AT 11-1/2" AND 87-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH #8-32 X 1/2" FH MS (2) SCREWS PER BOLT

INACTIVE LEAF

CONCEALED FLUSH BOLTS BY 'REGENT' MANUALLY OPERATED LEVERS MOUNTED ON INSIDE FACE OF LEAF STILE LOCATED AT 11-1/2" AND 87-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH #8-32 X 1/2" FH MS (2) PER BOLT

3/16" HEAT STREN'D GLASS

.090" Interlayer

GLASS TYPE 'G1'

SILICONE

GE 2800

TYP.

BITE

N

-Saflex Clear And Color Glass

-3/16" HEAT STREN'D GLASS

SILICONE


GE 2800

SILICONE

GE 2800

BITE

By 'Eastman Chemical Co.'

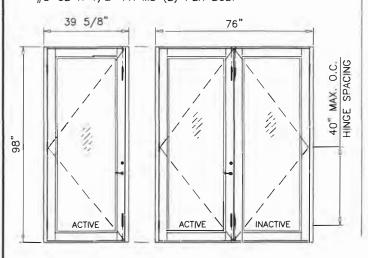


ACTIVE LEAF:

4 POINT LOCK SYSTEM BY 'INTERLOCK' AT 38-3/4" FROM BOTTOM HANDLE ACTIVATES DEAD BOLT AND SHOOT BOLTS ENGAGING AT HEAD AND SILL KEY OPERATED ON EXTERIOR AND THUMB TURN ON HANDLE FASTENED TO LOCK STILE WITH (2) #8-32 X 2" OH MS CENTER LOCK FASTENED TO LOCK STILE WITH (2) #12-24 X 1/4" FH MS

INACTIVE LEAF:

CONCEALED FLUSH BOLTS BY 'REGENT' MANUALLY OPERATED LEVERS MOUNTED ON INSIDE FACE OF STILE LOCATED AT 11-1/2" AND 87-1/2" FROM BOTTOM FASTENED TO LOCK STILE WITH #8-32 X 1/2" FH TC MS (2) SCREWS PER BOLT

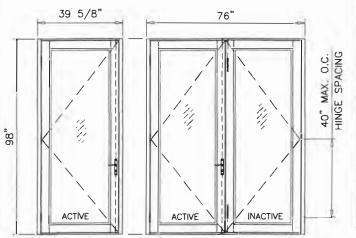

-3/16" HEAT STREN'D GLASS

SentryGlas

GLASS TYPE 'G3'

.090" Interlayer

By 'Kuraray America, Inc.'


3/16" HEAT STREN'D GLASS

SILICONE

GE 2800

HINGES:

3-1/2" X 7-5/8" X ...122" THK. EXTRUDED ALUM HINGE PART #FD-107 BY SULLIVAN & ASSOC. 3 HINGES PER LEAF AT 9" FROM TOP AND BOTTOM AND AT MIDSPAN (SPACING NOT TO EXCEED 40" O.C.) HINGES FASTENED WITH #10 X 1" FH SMS (5) SCREWS AT HINGE STILE (6) SCREWS AT FRAME JAMB



JUN 2 2 2023


PRODUCT REVISED as complying with the Florida Building Code

23-0710.14

Expiration Date 07/04/2028

00 Miami-Dade Product Control

NOA-No.



500 m m

GLAZING DETAIL AT SIDELITE

GLAZING OPTIONS

3/16" HEAT STREN'D GLASS

.090" Interlayer

By 'kuraray America, Inc.'

3/16" HEAT STREN'D GLASS

SILICONE

GE 2800

SILICONE GE 2800

Trosifol PVB

GLASS TYPE 'G2'

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978 SIDELITES


(C.A.N. 3538) FAX. (305) 262-6978


SERIES-100 ALUM SWING DOOR W/ SI DORALUM CORPORATION 7040 N.W. 77 TERRACE MIAMI, FL. 33166 DORALUM C 7040 N.W. 7 MIAMI, FL. 3. TEL. (305) 884-


escription
CHANGE THIS SHEET
POATED TO 2017 FBC
CHANGE THIS SHEET
OTORIAL CHANGES date 12.11.15 01.09.18 04.16.18 09.04.20


by: P. drawing


W13 - 03sheet 4 of 10

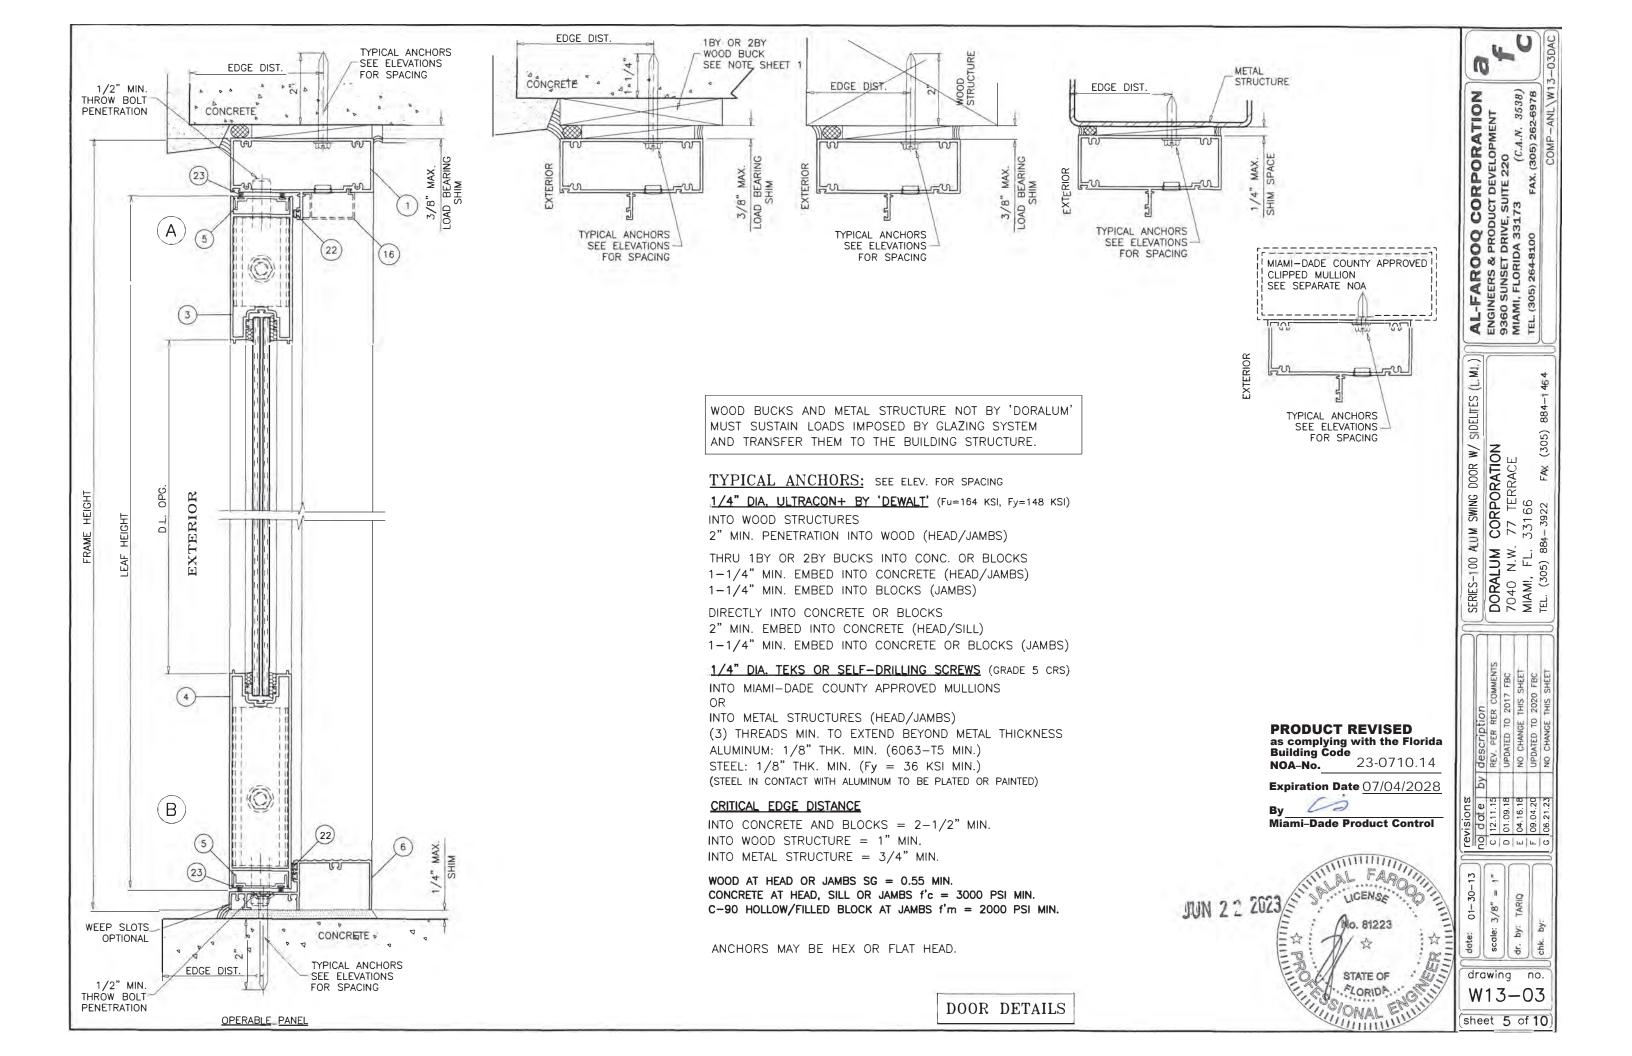


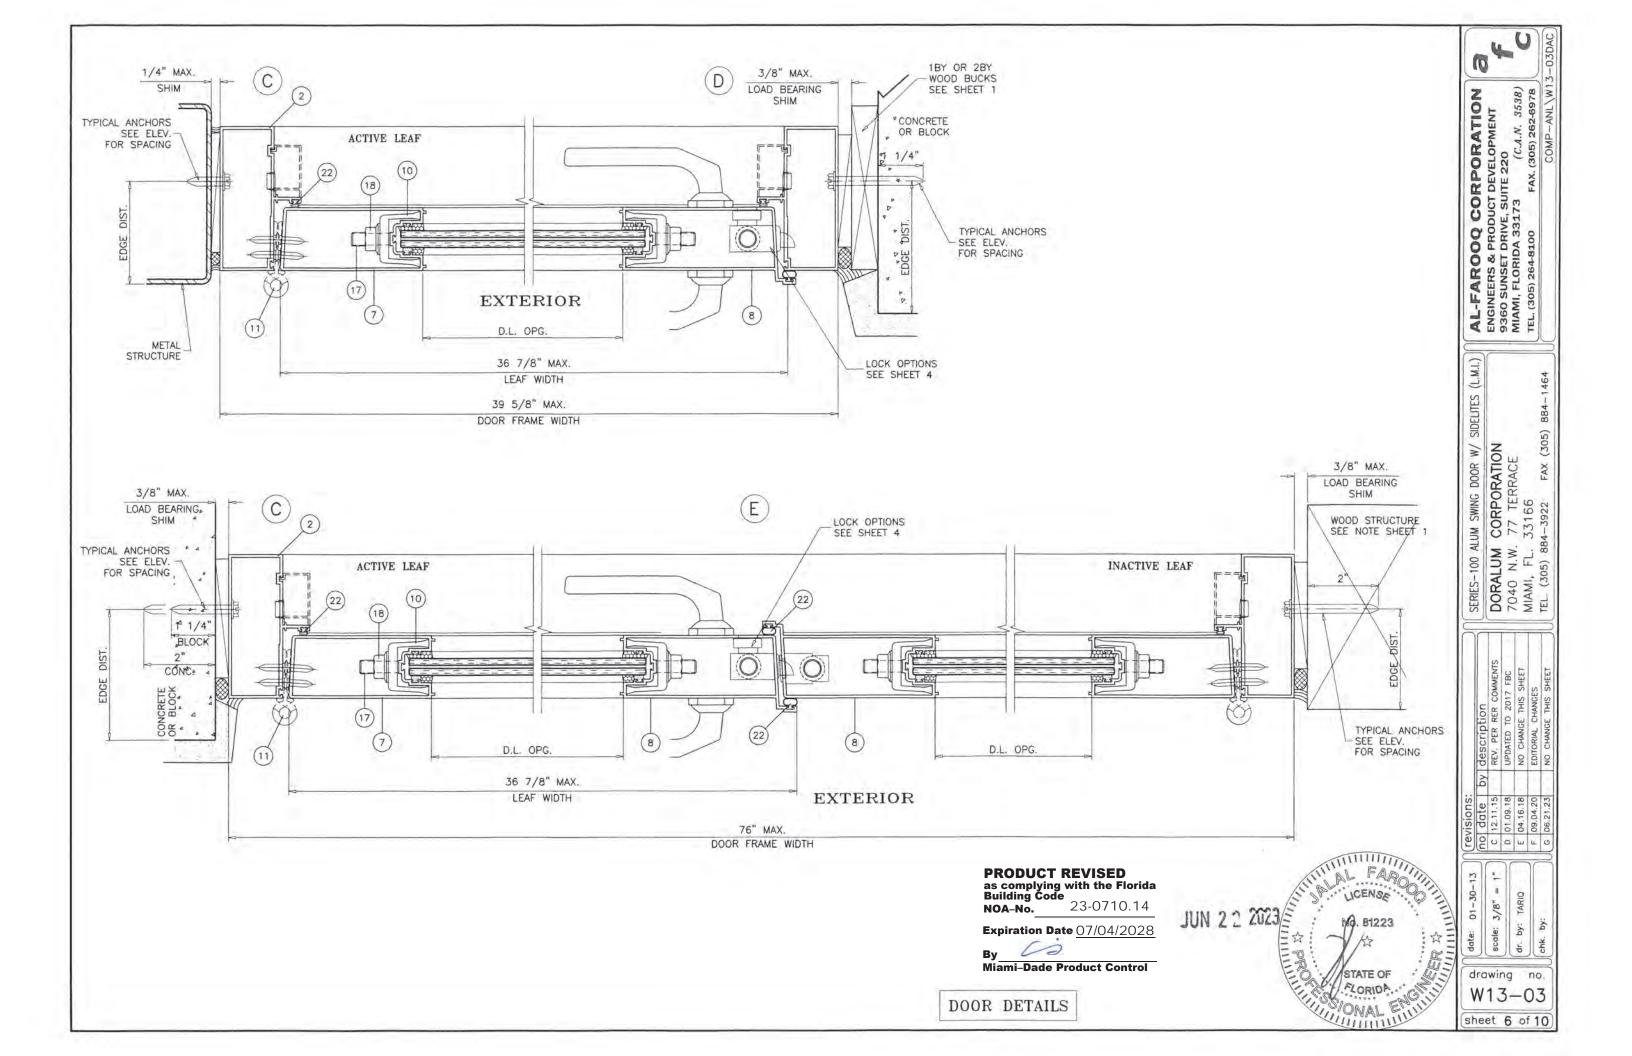

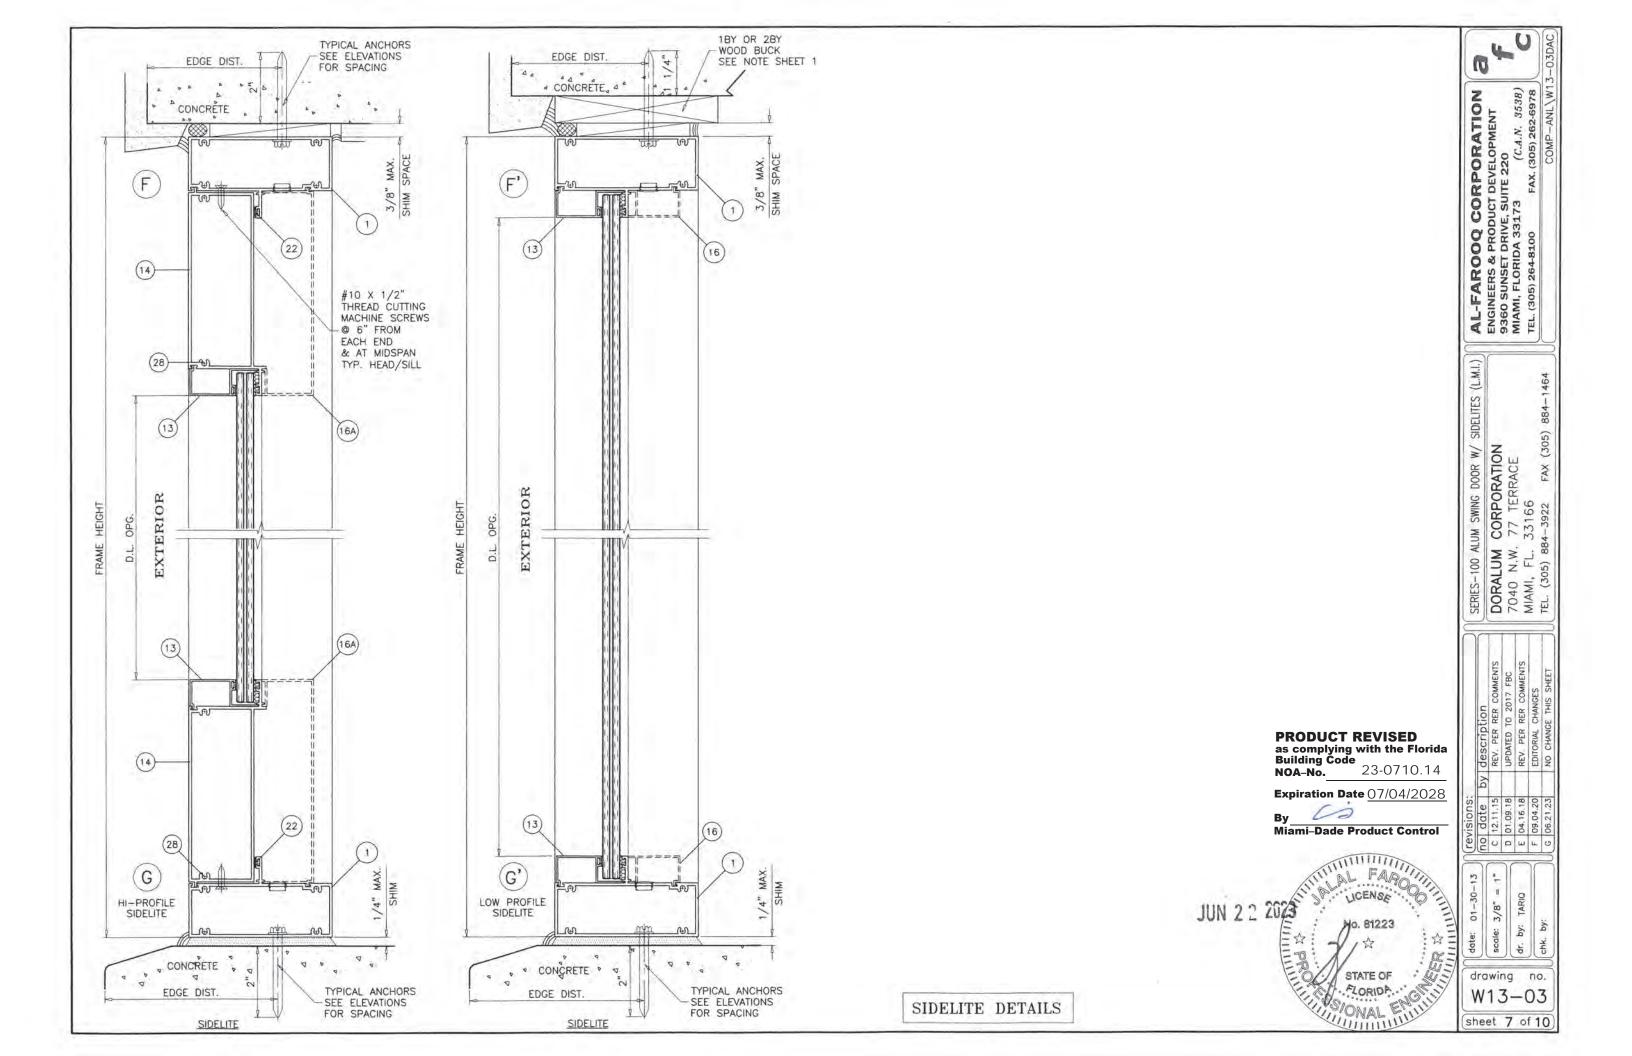

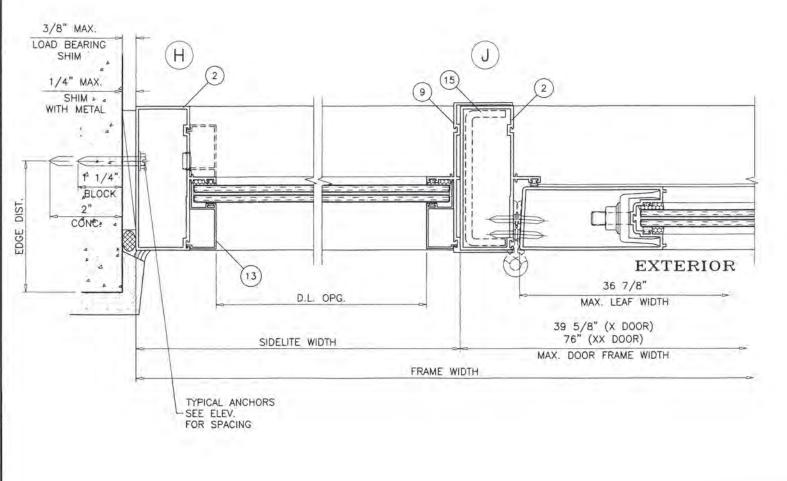

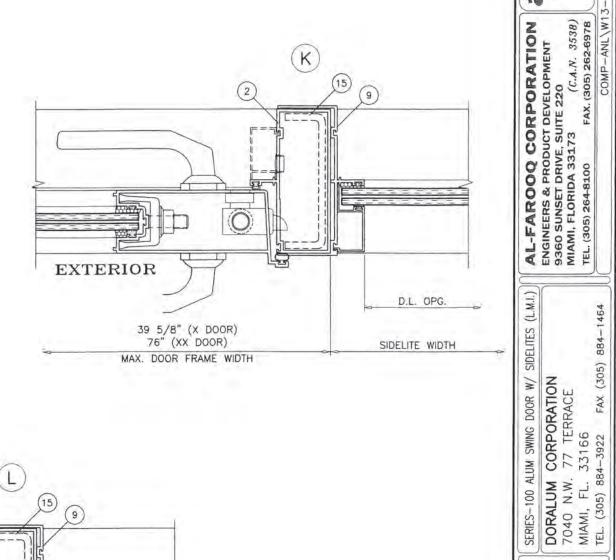

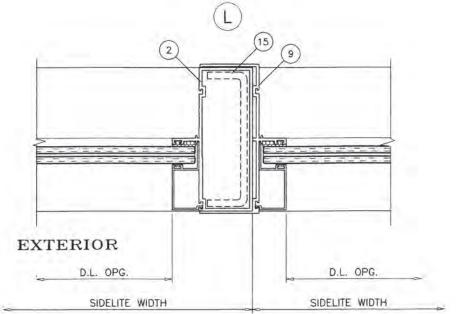


PRODUCT REVISED
as complying with the Florida
Building Code

23-0710.14 NOA-No.

Expiration Date <u>07/04/2028</u>

By Miami-Dade Produ

JUN 2 2 2023



uct Control	1
FAROURING ENSE	200
81223 ☆ ☆ ☆	
TE OF)
AL ELLIS	(

dr. by: chk. by: drawing no. W13 - 03sheet 7.1of 10

SIDELITE DETAILS

TEM #	PART #	REQD.	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	T-51493	1/DOOR	FRAME HEAD	6063-T6	-
2	T-51494	2/DOOR	FRAME JAMB	6063-T6	5
3	T-51503	1/LEAF	DOOR TOP RAIL	6061-T6	-
4	T-51492	1/LEAF	DOOR BOTTOM RAIL	6061-T6	-
5	T-11502	2/ LEAF	WEATHERSTRIP ADAPTER	6063-T6	-
6	SW-28898	1/DOOR	THRESHOLD	6063-T6	-
7	T-51520	1/LEAF	HINGE STILE	6063-T6	-
8	T-51496	1/LEAF	LOCK STILE	6063-T6	-
9	T-11500	AS REQD.	SIDELITE SLIP ON JAMB	6063-T6	-
10	T-11501	1/CORNER	ASSEMBLY STIFFENER	6063-T6	-
11	FD-107	3/LEAF	BUTT HINGES (.122" THK.)	ALUMINUM	SULLIVAN & ASSOC.
13	T-11499	AS REQD.	SIDELITE GLAZING BEAD	6063-T6	-
14	T-51504	AS REQD.	SIDELITE BASE ADAPTER	6063-T5	-
15	E E	AS REQD.	SIDELITE REINF. CHANNEL	3003-H14	
16	T-11498	AS REQD.	SCREW CAP (OPTIONAL)	6063-T5	2 :
16A	-	AS REQD.	SCREW CAP (OPTIONAL)	6063-T5	
17		2/LEAF	3/8" X 16 THREADED ROD	STEEL	7
18	-	2/LEAF	3/8" X 16 NUT	0-0	5
19		AS REQD.	PVC INSERT		÷
20		AS REQD.	ULTRAFAB		-
22	PW-101	AS REQD.	BULB WEATHERSTRIPPING	VINYL	8
23	PB-8400	AS REQD.	PILE WITH INTEGRAL FIN W'STRIPPING		SCHLEGEL
24	5025	AS REQD.	FLUSH BOLTS		DELTA IND.
25	CP-B111	-	ENTRY LOCKSET		KWIKSET
26	#8 X 1"	4/ CORNER	ASSEMBLY SCREWS, FH SELF DRILLING		AT ALL FRAME JOINTS
27	#8 X 2-1/2"	3/ CORNER	ASSEMBLY SCREWS, PH SMS		-
28	#8 X 1-1/2"	2/ CORNER	SIDELITE ASSEMBLY SCREWS, FH SELF DRILLING		-
29		AS REQD.	SETTING BLOCKS	EPDM	DUROMETER 80±5 SHORE

SEALANTS:

FRAME AND LEAF CORNERS, INSTALLATION SCREWS AT SILL AND ALL METAL PARTS CONNECTIONS SEALED WITH CLEAR COLORED SEALANT.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-0710.14

Expiration Date $\underline{07/04/2028}$

By Miami-Dade Product Control

JUN 2 2 2023



AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264*8100 FAX. (305) 262-6978

| SERIES-100 ALUM SWING DOOR W/ SIDELITES (L.M.I.) | DORALUM CORPORATION | 7040 N.W. 77 TERRACE | MIAMI, FL. 33166 | TEL. (305) 884-3922 FAX (305) 884-1464 | |

dr. by: TARIO

drawing no.

W13-03 sheet 8 of 10

