



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

**Daybar Industries Limited**  
**50 West Drive**  
**Brampton, Ontario, Canada L6T2J4**

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "LS-18" Outswing Louvered Commercial Steel Doors w/ 16 ga Frames & w/wo Panic Exit Device-LM Impact**

**APPROVAL DOCUMENT:** Drawing No **23-172** (former #**20-142**), titled "Double & Single LS18 Outswing Commercial Steel Doors w/ 16 ga Steel frames-louvered assemblies", sheets 1 through 3, 3A and 4 thru 19 of 19 prepared by Tilteco Inc., dated 07/06/20 and last revised on 08/09/23, signed and sealed by Walter A. Tillit Jr., P. E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**Limitations:**

1. See Design Pressure Ratings in sheets **1** and **3A**.
2. This door is not approved where Air infiltration requirements is needed This door is not approved where water infiltration requirements is needed, unless complies with overhang requirements per FBC.
3. Min edge distance required for ITW 3/16" Tapcon (item #22) is 2-5/8" & Power 5/16-18 caulk-in anchor is 3-3/4."

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, Brampton, Ontario and series and following statement: "Miami-Dade County Product Control Approved", noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA # 21-0203.06** and consists of this page 1 and evidence pages E-1, E-2, E-3 & E-4 as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



*Ishaq I. Chanda*

NOA No. 23-0823.11  
Expiration Date: April 22, 2026  
Approval Date: October 05, 2023  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**1. Evidence submitted under previous approvals**

**A. DRAWINGS**

1. Manufacturer's parts and sections drawings (see below).
2. Drawing No **15-051 Rev 2** (former **#12-013 REV 1**), titled "Double & Single LS18 Outswing Commercial Steel Doors w/ 16 ga Steel frames-louvered assemblies", sheets 1 through 3, 3A and 4 thru 19 of 19 prepared by Tilteco Inc., dated 04/07/15, signed and sealed by Walter A. Tillit Jr., P. E.

**B. TESTS (submitted under file #16-0330.10)**

1. Test reports on
  - 1) Air Infiltration Test, per FBC, TAS 202-94 (except sp# 7 louver)
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistant Test, per FBC, TAS 202-94 (except sp# 7 louver)
  - 4) Large Missile Impact Test per FBC, TAS 201-94
  - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
  - 6) Forced Entry Test, per FBC 2411.3.2.1 (b) and TAS 202-94

Along with marked-up drawings and installation diagram of Single louvered outswing steel door, prepared by Certified Testing Lab., Test Report No. **CTLA 3079W-1R** dated 02/20/16, signed and sealed by Ramesh Patel, P.E. (Addendum letter dated APR 07, 2016, issued by CTLA, signed & sealed by Ramesh Patel, P.E.)

Along with marked-up drawings and installation diagram of outswing steel door, prepared by Hurricane Testing Laboratory, LLC, Test Report No. **HTL-0279-0719-03** dated 07-16 thru 08-18-2003 for specimen 1, 2, 3, 7 & 7EMB, signed and sealed by Vinu J. Abraham, P.E.

Note: The above test report has been revised with addendum letters dated Dec 16, 2004 & a revised marked-up drawing issued on 12/15/04 by Fenestration testing lab, signed & sealed by Vinu J. Abraham, P.E. Submitted under files **#15-0123.01/#12-0216.07/# 10-0217.04/05-0620.07**, original test conducted per SFBC PA 201, 202 and 203-94, now termed as TAS 201, 202 and 203-94.

**C. CALCULATIONS (Submitted under files #15-0427.01)**

1. Anchor Verification Calculations, complying w/ FBC-2014, dated 12-02-15, prepared by Tilteco, Inc., signed and sealed by Walter A. Tillit Jr., P. E.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Tensile Test report No. Job#0279-0719-03, dated March 02, 2004, issued by Q C Metallurgical, Inc, per ASTM E-8, signed & sealed by Frank E. Grate, P.E. (transferred from file **# 10-0217.04**)
2. Notice of Acceptance No. **11-0920.07** issued to Dyplast Product, LLC (Former Apache Products Company) for "EPS-Expanded Polystyrene Insulation", expiring on 01/11/17.

**F. STATEMENTS**

1. Statement letter of compliance to FBC-2014, dated APR 07, 2015, issued by Tilteco Inc., signed and sealed by Walter A. Tillit Jr., P. E.
2. Facsimile correspondence dtd Nov. 14, 2005 from DAYBAR, requesting substitution of Stainless Steel in lieu of Galvanneal Steel & BCCO response dated 11/23/05.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-0823.11**  
**Expiration Date: April 22, 2026**  
**Approval Date: October 05, 2023**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**G. OTHER**

1. This NOA, conditionally **renews** NOA # **15-0427.01**, expiring 04/22/21.
2. Manufacturer/Distributor agreement between Daybar Industries Limited, Canada and Daybar Southeast Manufacturing, N. Key Largo, USA, signed by Mark Dodson and David Ball, respective officials of the companies.

**2. Evidence submitted under previous approval.**

**A. DRAWINGS**

1. Drawing No **17-085 Rev 1** (former #**15-051 REV 2**), titled “Double & Single LS18 Outswing Commercial Steel Doors w/ 16 ga Steel frames-louvered assemblies”, sheets 1 through 3, 3A and 4 thru 19 of 19 prepared by Tilteco Inc., dated 07/21/17, signed and sealed by Walter A. Tillit Jr., P. E.  
Note: The revision consists of general notes #1, 4, 5 and 12 in compliance of FBC 2017 edition.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **16-1129.05** issued to Dyplast Product, LLC (Former Apache Products Co.) for “E and R Board Expanded Polystyrene Rigid Foam Insulation”, expiring on 01/11/22.

**F. STATEMENTS**

1. Statement letters of conformance to FBC 2017(6th Edition), prepared by Tilteco Inc., dated 07/21/17, signed & sealed by Walter A. Tillit Jr., P. E.
2. Statement letter of general notes revision only, in compliance of FBC 2017 edition, prepared by Tilteco Inc., dated 07/21/17, signed & sealed by Walter A. Tillit Jr., P. E.

**G. OTHER**

1. This NOA **revises** NOA # **16-0330.10**, expiring 04/22/2021.

**3. Evidence submitted under previous submittal**

**A. DRAWINGS**

1. Drawing No **20-142** (former #**17-085 Rev 1**), titled “Double & Single LS18 Outswing Commercial Steel Doors w/ 16 ga Steel frames-louvered assemblies”, sheets 1 through 3, 3A and 4 thru 19 of 19 prepared by Tilteco Inc., dated 07/06/20, signed and sealed by Walter A. Tillit Jr., P. E.  
Note: The revision consists of FBC 2020 update notes only.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-0823.11**  
**Expiration Date: April 22, 2026**  
**Approval Date: October 05, 2023**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**4. Evidence submitted under previous submittal**

**A. DRAWINGS**

1. Drawing No **20-142** (former **#17-085 Rev 1**), titled “Double & Single LS18 Outswing Commercial Steel Doors w/ 16 ga Steel frames-louvered assemblies”, sheets 1 through 3, 3A and 4 thru 19 of 19 prepared by Tilteco Inc., dated 07/06/20, signed and sealed by Walter A. Tillit Jr., P. E.

**B. TESTS**

1. None

**C. CALCULATIONS**

1. None

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **16-1129.05** issued to Dyplast Product, LLC (Former Apache Products Company) for “E and R Board Expanded Polystyrene Rigid Foam Insulation”, expiring on 01/11/22.

**F. STATEMENTS**

1. Statement letters of renewal without change and conformance to FBC 2020 (**7th** Edition), prepared by Tilteco Inc., dated 01/21/21, signed & sealed by Walter A. Tillit Jr., P.E.
2. Noa Renewal request without change, dated 01/25/21, issued by Daybar Industries, signed by Mark Dodson, President.
3. Statement letters of conformance to FBC 2020 (**7th** Edition), prepared by Tilteco Inc., dated 07/06/20, signed & sealed by Walter A. Tillit Jr., P.E. (submitted under file # **20-0813.10**)

**G. OTHER**

1. This NOA **renews NOA # 20-0813.10**, expiring 04/22/2026.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-0823.11**  
**Expiration Date: April 22, 2026**  
**Approval Date: October 05, 2023**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**5. New Evidence submitted**

**A. DRAWINGS**

1. Drawing No **23-172** (former #**20-142**), titled “Double & Single LS18 Outswing Commercial Steel Doors w/ 16 ga Steel frames-louvered assemblies”, sheets 1 through 3, 3A and 4 thru 19 of 19 prepared by Tilteco Inc., dated 07/06/20 and last revised on 08/09/23, signed and sealed by Walter A. Tillit Jr., P. E.

**B. TESTS**

1. None.

**C. CALCULATIONS**

1. None.

**D. QUALITY ASSURANCE**

1. Miami Dade Department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **22-0627.04** issued to King Insulation, LLC (Former Dyplast Product, LLC) for “E and R Board Expanded Polystyrene Rigid Foam Insulation”, expiring on 01/11/27.

**F. STATEMENTS**

1. Statement letters of conformance to FBC 2023 (**8th** Edition), prepared by Tilteco Inc., dated 08/09/23, signed & sealed by Walter A. Tillit Jr., P.E.
2. Statement letters of conformance to FBC 2020 (**7th** Edition), prepared by Tilteco Inc., dated 07/06/20, signed & sealed by Walter A. Tillit Jr., P.E. (submitted under file # # **20-0813.10**)

**G. OTHER**

1. This NOA **revises NOA # 23-0823.11** and updates to FBC 2023, expiring 04/22/2026.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-0823.11**  
**Expiration Date: April 22, 2026**  
**Approval Date: October 05, 2023**



SHEETS CONTENT:

- SHEET #1 INDEX, COVER SHEET & GENERAL NOTES  
SHEET #2 ASSEMBLY ELEVATIONS No 1, 2, 3.  
SHEET #3 ASSEMBLY ELEVATIONS No 7, 7-EMB.  
SHEET #3A MAX. DESIGN PRESSURE RATING SCHEDULE (PSF)  
SHEET #4 OPTIONAL EMBOSSED DOOR SHEET CONFIGURATIONS.  
SHEET #5 HORIZONTAL SECTIONS A-A & B-B.  
SHEET #6 HORIZONTAL SECTIONS C-C & C'-C'.  
SHEET #7 VERTICAL SECTIONS D-D, E, F, G, H, I AND HORIZONTAL SECTION J-J  
SHEET #8 MODEL 1500-A AIR LOUVER DETAILS.  
SHEET #9 FRAME SECTIONS, & REINFORCING DETAILS AND THRESHOLD DETAIL  
SHEET #10 TYPICAL DOOR SECTION, "Z" ASTRAGAL & ASA STRIKE REINFORCING  
SHEET #11 MULLION INSTALLATION DETAILS.  
SHEET #12 SURFACE BOLT INSTALLATION AND DETAILS.  
SHEET #13 DOOR TOP AND BOTTOM TYPICAL END CHANNEL DETAIL.  
DOOR SURFACE CLOSER REINFORCEMENT DETAIL.  
DOOR SURFACE CLOSER AND END CHANNEL ASSEMBLY.  
SHEET #14 DOOR SNAP IN TOP CAP DETAILS.  
SHEET #15 HINGE BAR REINFORCING FOR DOOR  
ANSI #A115.1 #86 MORTISE LOCK/RIM PANIC REINFORCING  
DOOR SURFACE BOLT REINFORCING DETAIL.  
SHEET #16 #161 CYLINDRICAL LOCK AND DEAD BOLT REINFORCEMENT DETAIL.  
SHEET #17 ANCHOR DETAILS.  
SHEET #18 ANCHOR SCHEDULE.  
WIRE ANCHOR DETAIL.  
2 PIECES COMBINATION STUD ANCHOR DETAIL.  
EMA BUTTERFLY ANCHOR DETAIL.  
SHEET #19 BILL OF MATERIALS.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By Ishag I. Chank  
Miami-Dade Product Control

MAX. A.S.D. DESIGN PRESSURE RATINGS (psf) REQUIREMENTS FOR  
ASSEMBLIES. \* \* SEE SHEETS 2 & 3 FOR ASSEMBLY DEFINITIONS

ASSEMBLY #	WHERE WATER INFILTRATION REQUIREMENT IS NEEDED **	WHERE WATER INFILTRATION REQUIREMENT IS <u>NOT</u> NEEDED
1	+ 65, - 65	+ 65, - 65
2	+ 65, - 65	+ 65, - 65
3	+ 65, - 65	+ 65, - 65
7	+ 65, - 53.3	+ 65, - 53.3
7-EMB	+ 65, - 53.3	+ 65, - 53.3

\*\* APPROVED ONLY WHEN CANOPY IS PROVIDED IMMEDIATELY  
ABOVE THE DOOR LOCATION COVERING THE ENTIRE WIDTH OF  
DOOR AND PROJECTING OUT A DISTANCE EQUAL OR LARGER  
THAN THE DOORS HEIGHT.  
NOT APPROVED IF THE ABOVE CONDITION IS NOT COMPLIED WITH.

THIS DOOR WAS NOT TESTED FOR AIR INFILTRATION

THIS DRAWING SHALL ONLY BE USED TO  
OBTAIN PERMITS IN THE STATE OF FLORIDA

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

GENERAL NOTES AND SPECIFICATIONS:

1. DOUBLE & SINGLE SERIES LS18 FLUSH/EMBOSSED OUTSWING COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE STEEL FRAME LOUVERED ASSEMBLIES, SHOWN ON THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) HAS BEEN VERIFIED FOR CODE COMPLIANCE IN ACCORDANCE WITH THE 2020 (7th EDITION) AND 2023 (8th EDITION) OF THE FLORIDA BUILDING CODE. DOOR MAY BE INSTALLED AT HIGH VELOCITY HURRICANE ZONES (MIAMI-DADE / BROWARD COUNTIES).
- DESIGN WIND LOADS SHALL BE DETERMINED AS PER SECTIONS 1620 OF THE ABOVE MENTIONED CODE, USING ASCE 7-16 (FBC 2020) & ASCE 7-22 (FBC 2023) AND SHALL NOT EXCEED THE MAXIMUM (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON SHEETS 1 & 3A.
- IN ORDER TO VERIFY THE ABOVE CONDITION, ULTIMATE DESIGN WIND LOADS DETERMINED PER ASCE 7-16 & ASCE 7-22 SHALL BE FIRST REDUCED TO A.S.D. DESIGN WIND LOADS BY MULTIPLYING THEM BY 0.6 IN ORDER TO COMPARE THESE W/ MAX. (A.S.D.) DESIGN PRESSURE RATINGS INDICATED ON SHEETS 1 & 3A.
- IN ORDER TO VERIFY THAT COMPONENTS AND ANCHORS ON THIS P.A.D., AS TESTED, WERE NOT OVER STRESSED, A 33% INCREASE IN ALLOWABLE LOADS FOR WIND LOADS WAS NOT USED IN THEIR ANALYSIS. HOWEVER, FASTENERS SPACING TO WOOD HAS BEEN DETERMINED IN ACCORDANCE WITH N.D.S. 2018.
- THIS DOOR'S ADEQUACY FOR WIND AND IMPACT LOAD HAS BEEN VERIFIED IN ACCORDANCE WITH SECTION 1626 OF THE ABOVE MENTIONED CODE AS PER PROTOCOLS TAS-201, TAS-202, TAS-203 AS PER HURRICANE TEST LABORATORY REPORT #0279-0719-03 AND AS PER SUBMITTED STRUCTURAL CALCULATIONS, PERFORMED AS PER SECTION 1616 OF THE FLORIDA BUILDING CODE.
2. ALL COMPONENTS SHALL BE AS SPECIFIED ON APPLICABLE DETAIL SHEETS AND AT BILL OF MATERIALS (SHEET 19) OF THIS DRAWING.
3. COMPLIANCE OF EGRESS / ESCAPE REQUIREMENTS OF THESE DOORS PER FBC TO BE DETERMINED BY BUILDING OFFICIALS ON A CASE-BY-CASE BASIS.
4. ALL SCREWS USED FOR ASSEMBLY CONNECTIONS (METAL TO METAL) TO BE STAINLESS STEEL 304 OR 316 AISI SERIES OR CORROSION RESISTANT COATED CARBON STEEL AS PER DIN 50018 WITH 50 ksi YIELD POINT AND 90 ksi TENSILE STRENGTH & SHALL COMPLY W/ FLORIDA BUILDING CODE SECTION 2411.3.3.4.
5. ALL WELDING TO CONFORM W/AMERICAN WELDING SOCIETY A.W.S. D.1.3 AND D-19.0 REGULATIONS. USE E 60XX ELECTRODES
6. ALL ANCHORS FOR DOOR FRAME CONNECTIONS TO EXISTING STRUCTURE SHALL BE AS SPECIFIED ON SHEET 17 OF THIS DRAWING. MAXIMUM ANCHORS SPACINGS SHALL BE AS PER SCHEDULE ON SHEET 18 AND ELEVATIONS ON SHEETS 2 & 3 OF THIS DRAWING. SEE SHEET 2, 3 & 7 FOR THRESHOLD ANCHORS, AND SHEET 11 FOR MULLION ANCHORS.
7. PROVIDE MAX. LOAD BEARING SHIM SPACE AS INDICATED ON SHEETS 5, 6, 7 & 17 OF 19.
8. THIS DOOR WILL NOT REQUIRE A HURRICANE PROTECTION DEVICE.
9. SEE MAX. A.S.D. DESIGN PRESSURE RATING REQUIREMENTS FOR WATER INFILTRATION AND LIMITATIONS FOR AIR INFILTRATION FOR ASSEMBLIES ON THIS SHEET.
10. PROVIDE SPECIFIED SEALANT AT ALL DOOR FRAME, THRESHOLD AND VISION LITE COMPONENTS INDICATED ON THIS DRAWING.
11. (a) THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) PREPARED BY THIS ENGINEER IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT; i.e. WHERE THE SITE CONDITIONS DEVIATE FROM THE P.A.D.
- (b) CONTRACTOR TO BE RESPONSIBLE FOR THE SELECTION, PURCHASE AND INSTALLATION INCLUDING LIFE SAFETY OF THIS PRODUCT, BASED ON THIS P.A.D., PROVIDED HE/SHE DOES NOT DEVIATE FROM THE CONDITIONS DETAILED ON THIS DOCUMENT. CONSTRUCTION SAFETY AT SITE IS THE CONTRACTOR'S RESPONSIBILITY.
- (c) THIS PRODUCT APPROVAL DOCUMENT (P.A.D.) WILL BE CONSIDERED INVALID IF ALTERED BY ANY MEANS.
- (d) SITE SPECIFIC PROJECTS SHALL BE PREPARED BY A FLORIDA REGISTERED ENGINEER OR ARCHITECT WHICH WILL BECOME THE ENGINEER OF RECORD (E.O.R.) FOR THE PROJECT AND WHO WILL BE RESPONSIBLE FOR THE PROPER USE OF THE P.A.D.
- (e) ORIGINAL P.A.D. SHALL BEAR THE DATE, SEAL AND SIGNATURE OF THE PROFESSIONAL ENGINEER OF RECORD THAT PREPARED IT.
- PRODUCT MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION AT PROJECT IN ACCORDANCE WITH SECTION 1709.5 OF THE FLORIDA BUILDING CODE.  
ONE LABEL SHALL BE PLACED FOR EVERY OPENING.

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 - Fax : (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr., P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY

8/9/2023  
DATE

23-172  
DRAWING No

SHEET 1 OF 19

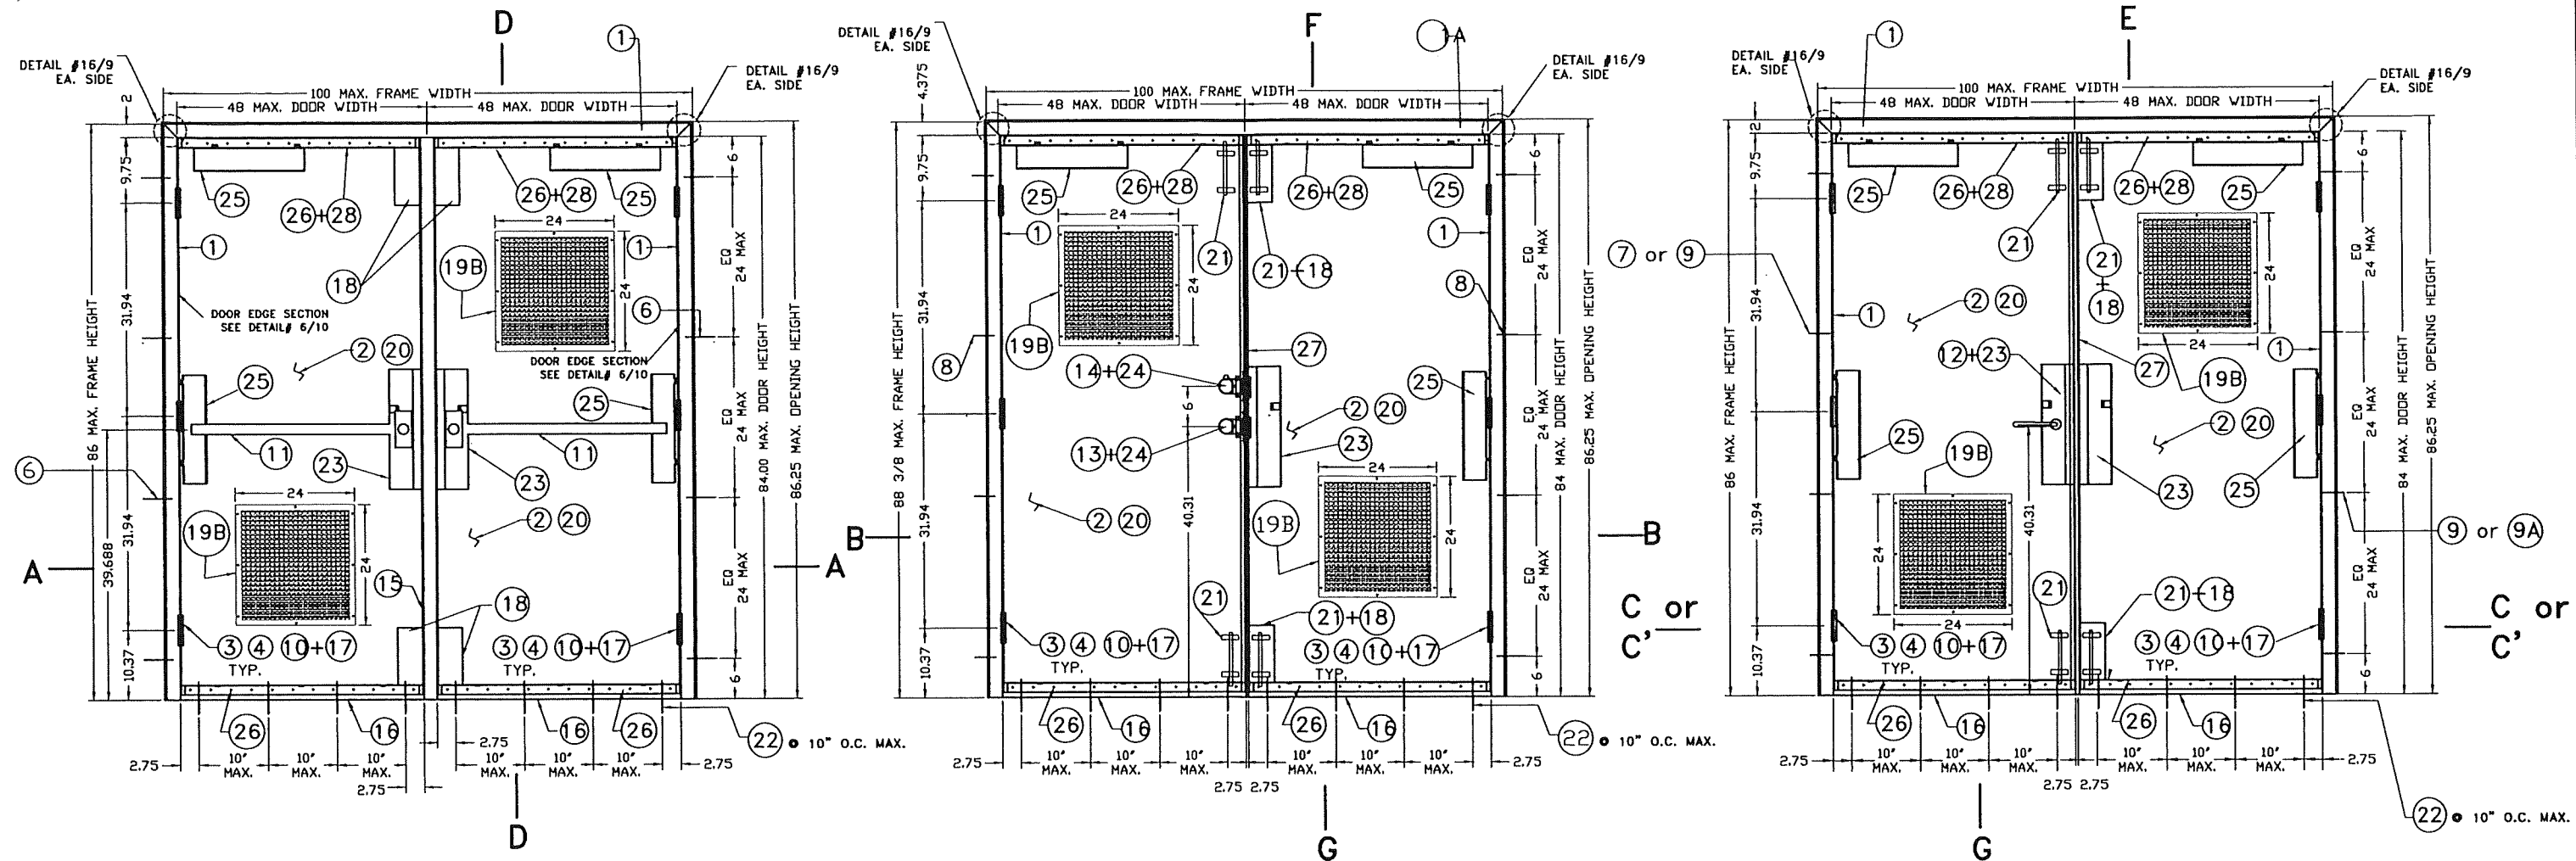

#### ASSEMBLY #1. \* INTERIOR ELEVATION

PAIR OF OUTSWING DOORS

WALL CONDITION : MASONRY

ANCHORS: WIRE 6 DETAIL #21

VON DUPRIN 98/99L TRIM SERIES RIM EXIT 11

AT BOTH DOORS

4 1/2" HAGER MODEL #BB1168 STEEL BUTT HINGE AND

4 1/2" STANLEY MODEL #FBB168 STEEL BUTT HINGE 10

VON DUPRIN 9954 REMOVABLE MULLION 15

(FOR DOUBLE DOOR ONLY)

DOOR CORE ITEM 20 : EXPANDED POLYSTYRENE OR HONEYCOMB PAPER FULL FLUSH

AIR LOUVER INC. METAL LOUVER #1500A 19B, W/24"x24"

(DOOR CUTOUT) AND LOCATED AT 12" CLEAR FROM TOP OR

BOTTOM OF DOOR AND CENTERED W/ DOOR

OUTSWING SINGLE & DOUBLE DOORS  
W/ VON DUPRIN RIM PANIC DEVICES

#### ASSEMBLY #2. \* INTERIOR ELEVATION

PAIR OF OUTSWING DOORS

WALL CONDITION : MASONRY

ANCHORS: EMA EXISTING MASONRY ANCHOR DET. #22

SCH-D SERIES CYLINDRICAL LOCK 13 + SCH-B SERIES DEAD BOLT 14

HAGER #275D SURFACE BOLTS 21 (TOP & BOTTOM) AT TWO DOORS

4 1/2" HAGER MODEL #BB1279 STEEL BUTT HINGE AND

4 1/2" STANLEY MODEL #FB179 STEEL BUTT HINGE 10

"Z" ASTRAGAL 27 W/ ASA STRIKE

FOR CYLINDRICAL LOCK AND DEAD BOLT STRIKE

DOOR CORE 20 : EXPANDED POLYSTYRENE OR HONEYCOMB PAPER

FULL FLUSH

AIR LOUVER INC. METAL LOUVER #1500A 19B, W/24"x24"

(DOOR CUTOUT) AND LOCATED AT 12" CLEAR FROM TOP OR

BOTTOM OF DOOR AND CENTERED W/ DOOR

OUTSWING SINGLE DOOR W/ TWO SURFACE BOLTS  
& DOUBLE DOORS W/ FOUR SURFACE BOLTS

#### ASSEMBLY #3. \* INTERIOR ELEVATION

PAIR OF OUTSWING DOORS

WALL CONDITION : WOOD STUDS

ANCHORS: 2 PIECE COMBINATION STUD ANCHOR 7 DETAIL #20

OR CARRIAGE BOLT 9A W/ EMA (DET. #22A) OR WOOD SCREW

LAG BOLT 9 W/ EMA (DETAIL #22B)

SCH-L9000 SERIES #86 MORTISE LOCK 12 (W/ DEAD BOLT INCLUDED)

HAGER #275D SURFACE BOLTS 21 (TOP & BOTTOM) AT TWO DOORS

4 1/2" HAGER MODEL #BB1279 STEEL BUTT HINGE AND

4 1/2" STANLEY MODEL #FB179 STEEL BUTT HINGE 10

"Z" ASTRAGAL 27 W/ ASA STRIKE FOR MORTISE LOCK.

DOOR CORE 20: EXPANDED POLYSTYRENE OR HONEYCOMB PAPER

FULL FLUSH

AIR LOUVER INC. METAL LOUVER #1500A 19B, W/24"x24"

(DOOR CUTOUT) AND LOCATED AT 12" CLEAR FROM TOP OR

BOTTOM OF DOOR AND CENTERED W/ DOOR

OUTSWING SINGLE DOOR W/ TWO SURFACE BOLTS  
& DOUBLE DOORS W/ FOUR SURFACE BOLTS

### ASSEMBLY ELEVATIONS #1, 2, & 3

SEE SECTIONS ON SHEETS 5, 6 & 7

- SEE SHEET 1 FOR MAXIMUM A.S.D. DESIGN PRESSURE RATING FOR EACH ASSEMBLY, BASED ON WATER INFILTRATION REQUIREMENTS AND AIR INFILTRATION LIMITATIONS.
- SEE SHEET 3A FOR MAXIMUM A.S.D. DESIGN PRESSURE RATING SCHEDULE FOR ASSEMBLY COMBINATIONS, BASED ON WATER INFILTRATION REQUIREMENTS AND AIR INFILTRATION LIMITATIONS.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11

Expiration Date 04/11/2026

By Ishag I. Chanda  
Miami-Dade Product Control

MIAMI-DADE COUNTY

No. 44167

STATE OF

FLORIDA

PROFESSIONAL ENGINEER

P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.

**TILTECO Inc.**

TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33186  
Phone : (305)871-1530 - Fax : (305)871-1531  
e-mail: [tilteco@aol.com](mailto:tilteco@aol.com)  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

### FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

Y.M.  
DRAWN BY


8/9/2023  
DATE

23-172  
DRAWING No

SHEET 2 OF 19

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		



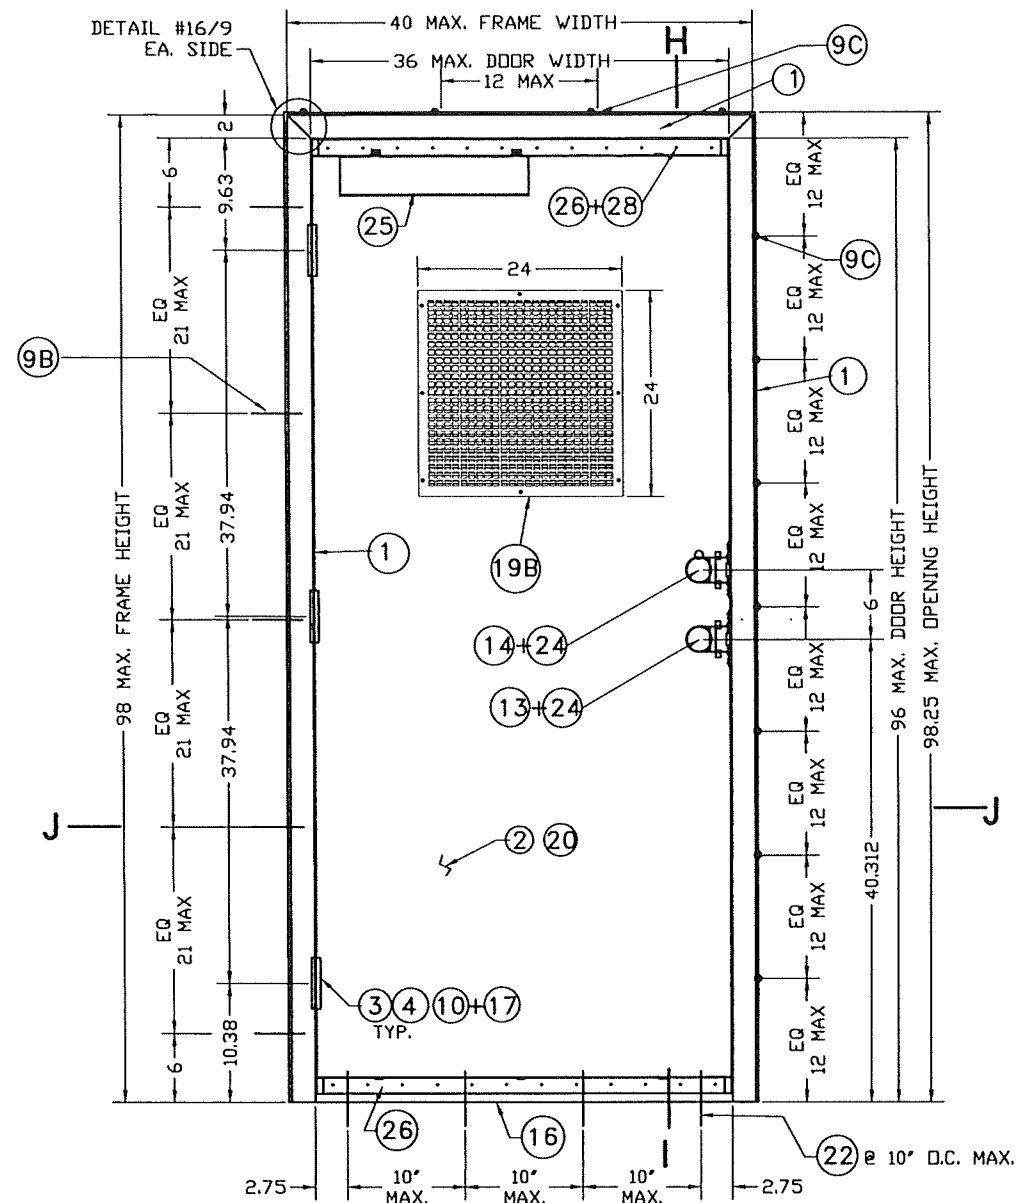

**ASSEMBLY #7 \* EXTERIOR ELEVATION**  
SINGLE DOOR OUTSWING

WALL CONDITION - WELDED HOT ROLLED

3/8" MIN. THICK STRUCTURAL STEEL CHANNEL FRAME JAMB AND HEAD.  
ANCHORS: 3/8"x3 1/2" FLAT HEAD MACHINE SCREW, LOCK WASHER & NUT W/ EMA (DET #23A), OR FRAME (1) WELDED @ 12" O.C. AT JAMB AND HEAD INCLUDING TOP & BOTTOM OF JAMB (DET #23B).  
SCH-D SERIES CYLINDRICAL LOCK (13)+ SCH-B SERIES DEAD BOLT (14)  
4 1/2" HAGER MODEL # BB1279 STEEL BUTT HINGE (10).  
DOOR CORE (20) EXPANDED POLYSTYRENE OR HONEYCOMB PAPER.  
FULL FLUSH


AIR LOUVER INC., METAL LOUVER #1500-A (19B) W/ 24"x24" DOOR CUT-OFF,  
AND LOCATED AT 12" FROM TOP OF DOOR TO TOP OF LOUVER

OUTSWING SINGLE DOORS WITHOUT SURFACE BOLTS

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11

Expiration Date 04/11/2026

By *Ishag I. Chanda*  
Miami-Dade Product Control

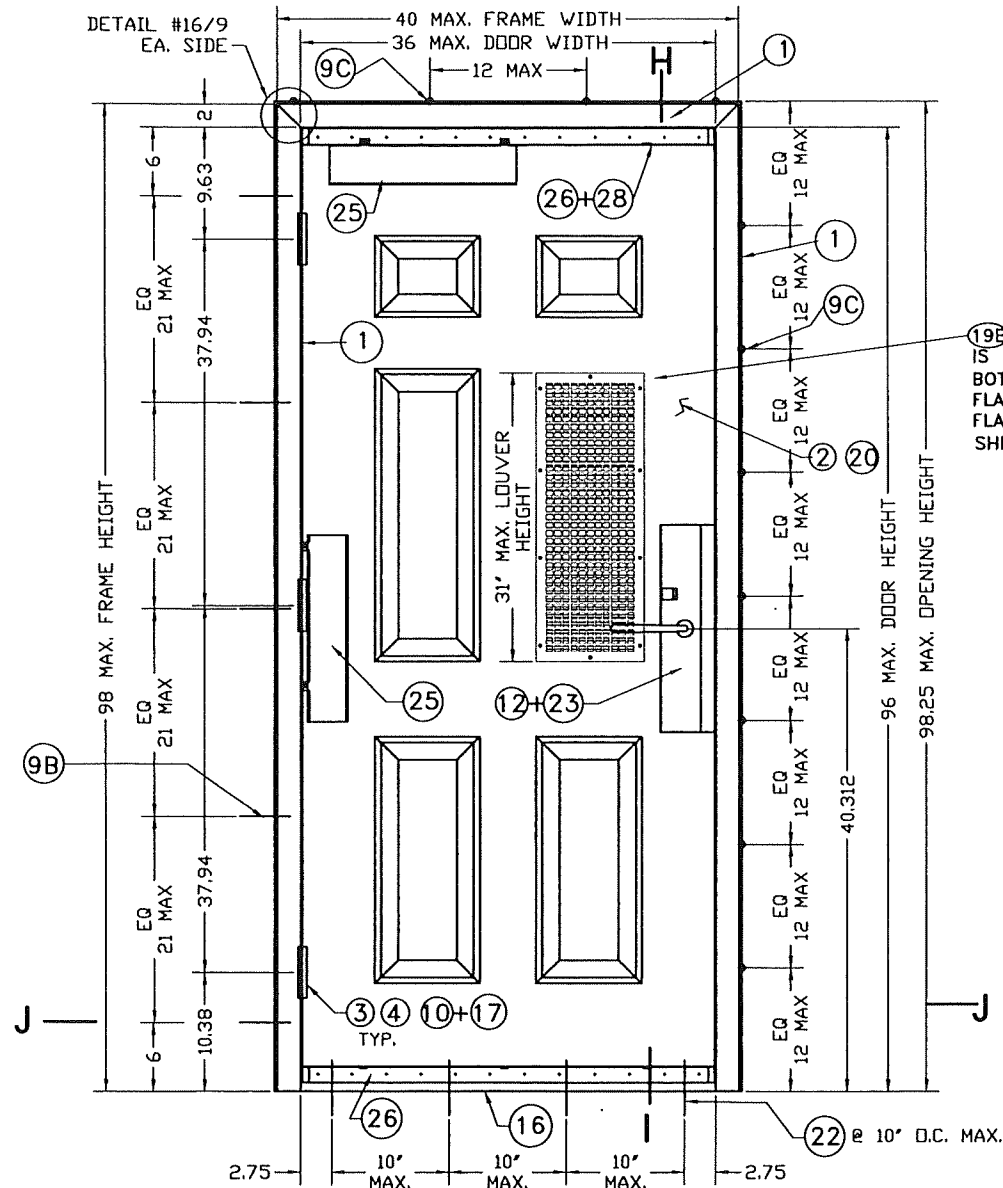

**ASSEMBLY #7-EMB EXTERIOR ELEVATION**  
SINGLE DOOR OUTSWING

WALL CONDITION - WELDED HOT ROLLED  
STRUCTURAL STEEL CHANNEL FRAME JAMB AND HEAD.

ANCHORS: 3/8"x3 1/2" FLAT HEAD MACHINE SCREW, LOCK WASHER & NUT W/ EMA (DET #23A), OR FRAME (1) WELDED @ 12" O.C. AT JAMB AND HEAD INCLUDING TOP & BOTTOM OF JAMB (DET #23B).  
SCH-L SERIES #86 MORTISE LOCK (12) W/ DEAD BOLT INCLUDED.  
4 1/2" HAGER MODEL # BB1279 STEEL BUTT HINGE (10).  
DOOR CORE (20) EXPANDED POLYSTYRENE OR HONEYCOMB PAPER.  
FULL EMBOSSED

AIR LOUVER INC., METAL LOUVER #1500-A (19B) W/ 24"x24" DOOR CUT-OFF,  
AND LOCATED AT 12" FROM TOP OF DOOR TO TOP OF LOUVER

OUTSWING SINGLE DOORS WITHOUT SURFACE BOLTS

**ASSEMBLY ELEVATIONS #7, 7-EMB**


SEE SECTIONS ON SHEET 7

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

- SEE SHEET 1 FOR MAXIMUM A.S.D. DESIGN PRESSURE RATING FOR EACH ASSEMBLY. BASED ON WATER INFILTRATION REQUIREMENTS AND AIR INFILTRATION LIMITATIONS.
- SEE SHEET 3A FOR MAXIMUM A.S.D. DESIGN PRESSURE RATING SCHEDULE FOR ASSEMBLY COMBINATIONS. BASED ON WATER INFILTRATION REQUIREMENTS AND AIR INFILTRATION LIMITATIONS.

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

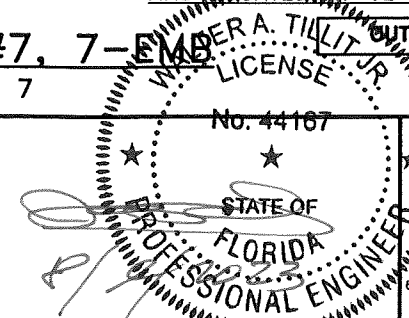

©2023 TILTECO, INC.

**TILTECO INC.**

TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 - Fax : (305)871-1531  
e-mail: [Tilteco@aol.com](mailto:Tilteco@aol.com)  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

Y.M.  
DRAWN BY

8/9/2023  
DATE

23-172  
DRAWING No

SHEET 3 OF 19

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		



MAX. A.S.D. DESIGN PRESSURE RATING (psf.) SCHEDULE FOR INSTALLATIONS COMBINING ASSEMBLIES  
#1 THRU #7-EMB BETWEEN EACH OTHER FOR A GIVEN ANCHOR JAMB TYPE \*, \*\*

ITEM (SEE SHEET 19)	ANCHOR SPECIFICATIONS AT JAMBS *	ASSEMBLY #1 (SEE SHEET 2) **	ASSEMBLY #2 (SEE SHEET 2) **	ASSEMBLY #3 (SEE SHEET 2) **	ASSEMBLY #7 (SEE SHEET 3) **	ASSEMBLY #7-EMB (SEE SHEET 3) **
6	0.157" DIA.x9 1/2" LONG WIRE ANCHOR (SEE DETAIL 21/17)	+65, -65	+65, -65	+65, -65	+65, -53.3	+65, -53.3
7	2 PIECE COMBINATION STUD ANCHOR (SEE DETAIL 20/17)	+65, -65	+65, -65	+65, -65	+65, -53.3	+65, -53.3
8	EXISTING MASONRY ANCHOR & E.M.A. (SEE DETAIL 22/17)	+65, -65	+65, -65	+65, -65	+65, -53.3	+65, -53.3
9	EXISTING WOOD BUCK ANCHOR W/WOOD SCREW LAG BOLT & E.M.A. (SEE DETAIL 22A/17)	+65, -65	+65, -65	+65, -65	+65, -53.3	+65, -53.3
9A	EXISTING WOOD BUCK ANCHOR W/ STEEL CARRIAGE BOLT & E.M.A. (SEE DETAIL 22B/17)	+65, -65	+65, -65	+65, -65	+65, -53.3	+65, -53.3
9B	CHANNEL IRON THROUGH BOLTING W/3/8" x 3 1/2" STEEL FLAT HEAD MACHINE SCREW & E.M.A. (SEE DETAIL 23A/17)	+65, -53.3	+65, -53.3	+65, -53.3	+65, -53.3	+65, -53.3
9C	CHANNEL IRON W/3/8" STITCH WELD (SEE DETAIL 23B/17)	+65, -53.3	+65, -53.3	+65, -53.3	+65, -53.3	+65, -53.3

\* NOTES ON FRAME HEAD REQUIREMENTS

1. FOR SINGLE & DOUBLE DOORS INSTALLED AT WOOD FRAME BUILDINGS, DOOR HEADS SHALL BE CONTINUOUSLY RETAINED BY EXISTING BUILDINGS WOOD HEADER FOLLOWING DETAILS AS PER SECTION E, SHEET 7.

2. FOR SINGLE & DOUBLE DOORS INSTALLED AT STEEL FRAME BUILDINGS, DOOR HEADS SHALL BE CONTINUOUSLY WELDED TO EXISTING BUILDINGS STEEL FRAME HEADER FOLLOWING DETAILS AS PER SECTION H, SHEET 7 & DETAIL 23B ON SHEET 17.

3. FOR SINGLE & DOUBLE DOORS INSTALLED AT CONCRETE /MASONRY BUILDINGS, DOOR HEADS NEED NOT BE ATTACHED TO EXISTING BUILDINGS HEADER. APPLICABLE TO SECTIONS D & F, SHEET 7.

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By Ishag I. Chank  
Miami-Dade Product Control

\*\* NOTES ON WATER AND AIR INFILTRATION REQUIREMENTS AND LIMITATIONS

1. SEE GENERAL NOTE 9 ON SHEET 1 OF 19 FOR REQUIREMENTS AND LIMITATIONS

MIAMI-DADE COUNTY

STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
No. 44167

WALTER A. TILLIT JR.  
P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.

TILTECO INC.

TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 • Fax : (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

DAYBAR INDUSTRIES LTD  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY

8/9/2023  
DATE

23-172  
DRAWING No

SHEET 3A OF 19

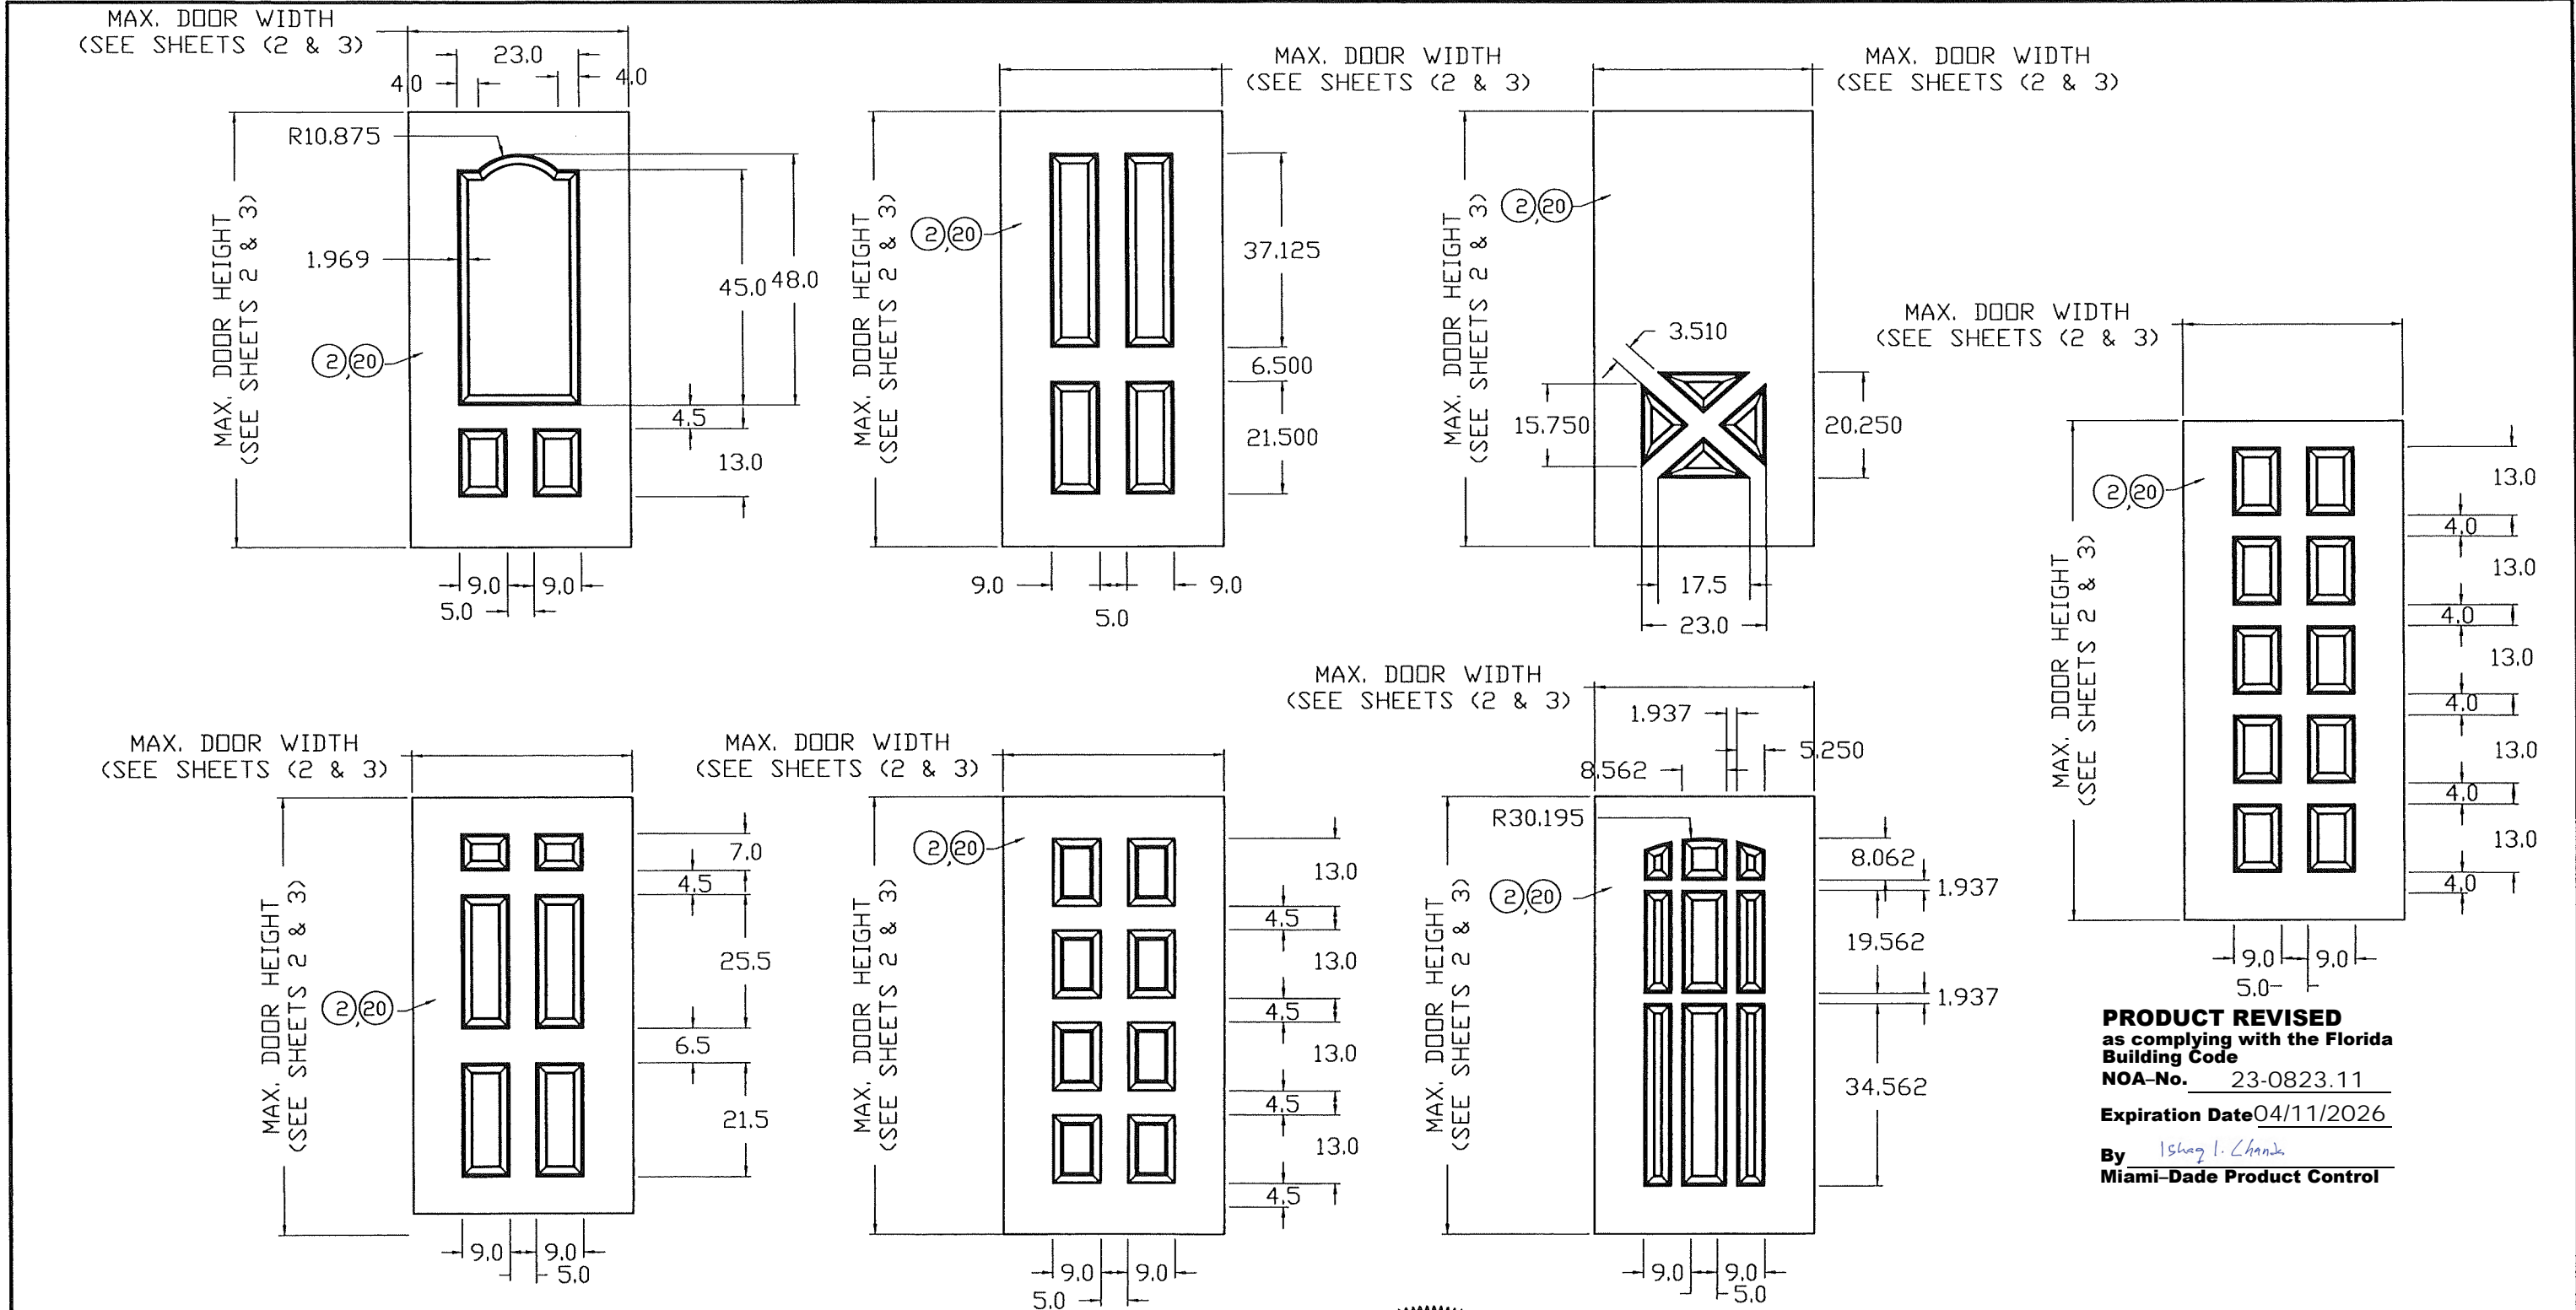

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By Ishag I. Chank  
Miami-Dade Product Control

OPTIONAL EMBOSSED DOOR SLAB W/ LOUVERS SHEET CONFIGURATIONS

NOTE:  
EMBOSSED DOORS W/ LOUVERS PERMITTED  
IN SINGLES & PAIRS LIMITED TO DESIGN  
PRESSURES NOTED FOR EACH ASSEMBLY

MIAMI-DADE COUNTY


WALTER A. TILLIT JR.  
No. 44167  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER  
P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.  
**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 Fax : (305)871-1531  
e-mail: [Tilteco@aol.com](mailto:Tilteco@aol.com)  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 18 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.  
**DAYBAR INDUSTRIES LTD**  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY  
8/9/2023  
DATE  
**23-172**  
DRAWING No  
SHEET 4 OF 19

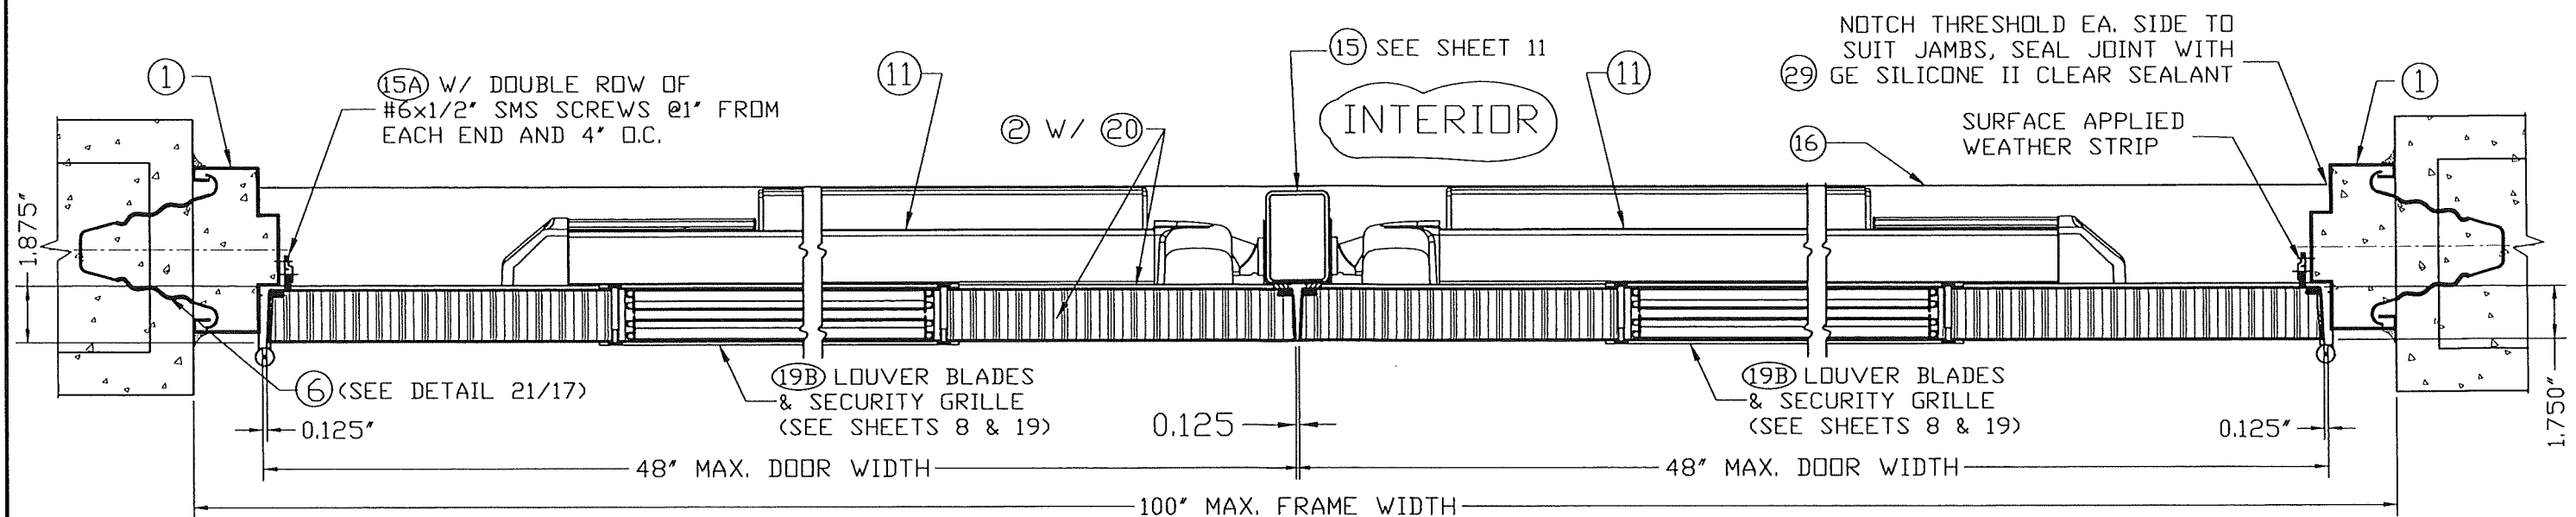

### SECTION A-A


SCALE: 3/16"=1"

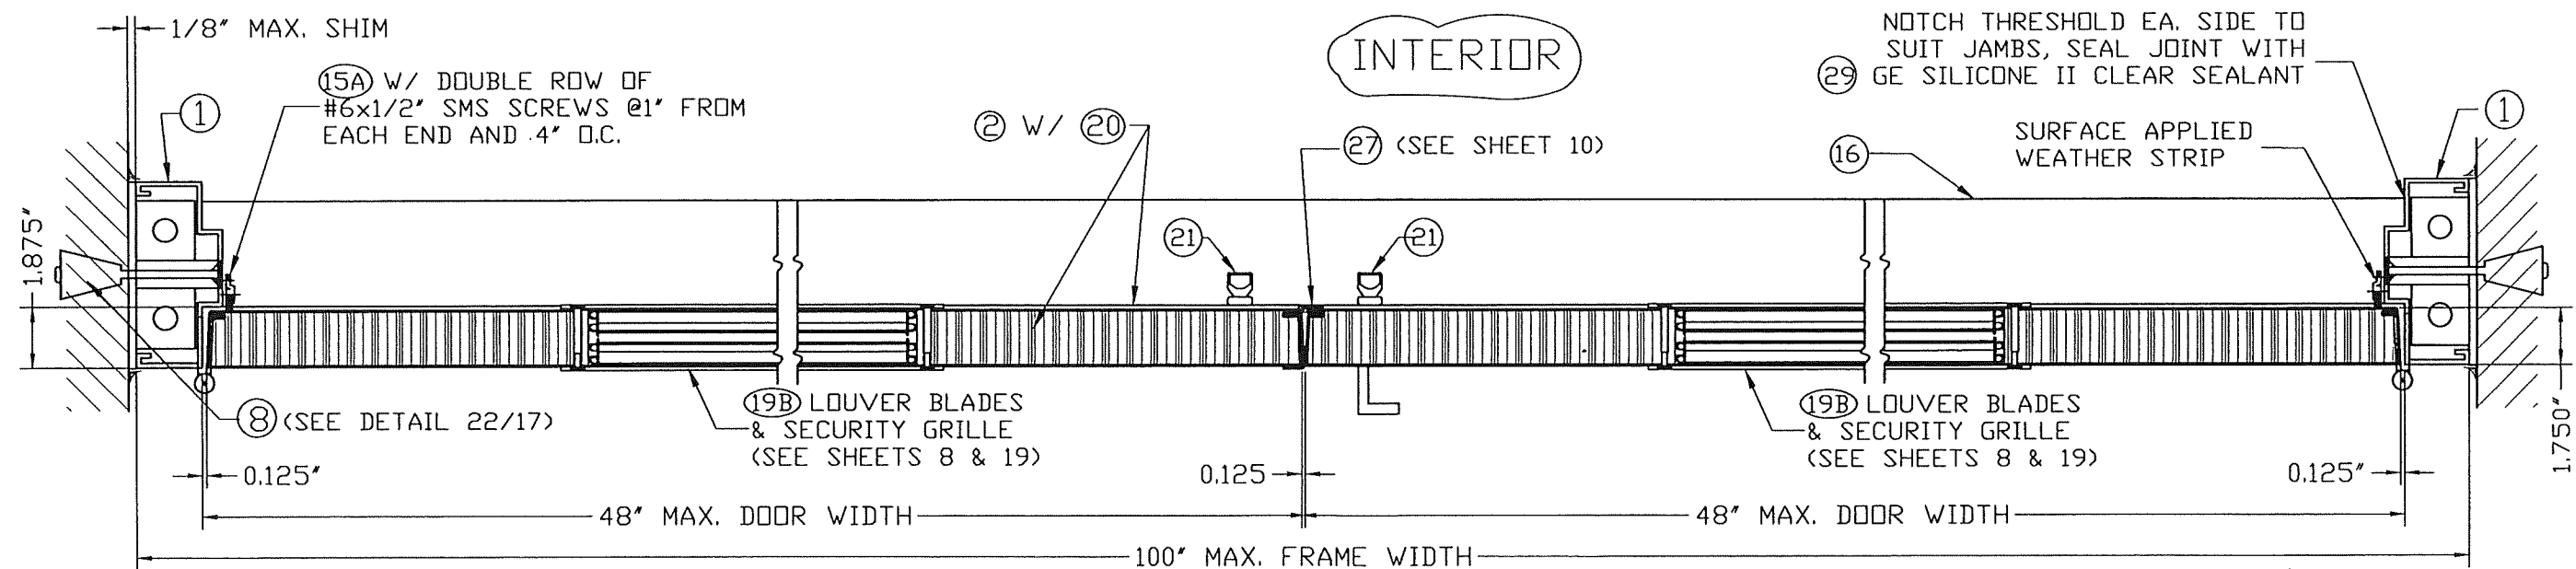

### SECTION B-B

SCALE: 3/16"=1"

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By Ishag I. Chande  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

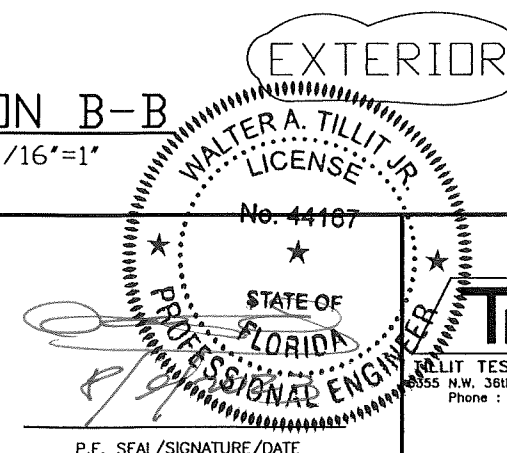

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

**TILTECO INC.**

TILLIT TESTING & ENGINEERING COMPANY  
3055 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone: (305)871-1530 • Fax: (305)871-1531  
e-mail: [tilteco@aol.com](mailto:tilteco@aol.com)  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

Y.M.  
DRAWN BY


8/9/2023  
DATE

**23-172**  
DRAWING No


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

SHEET 5 OF 19



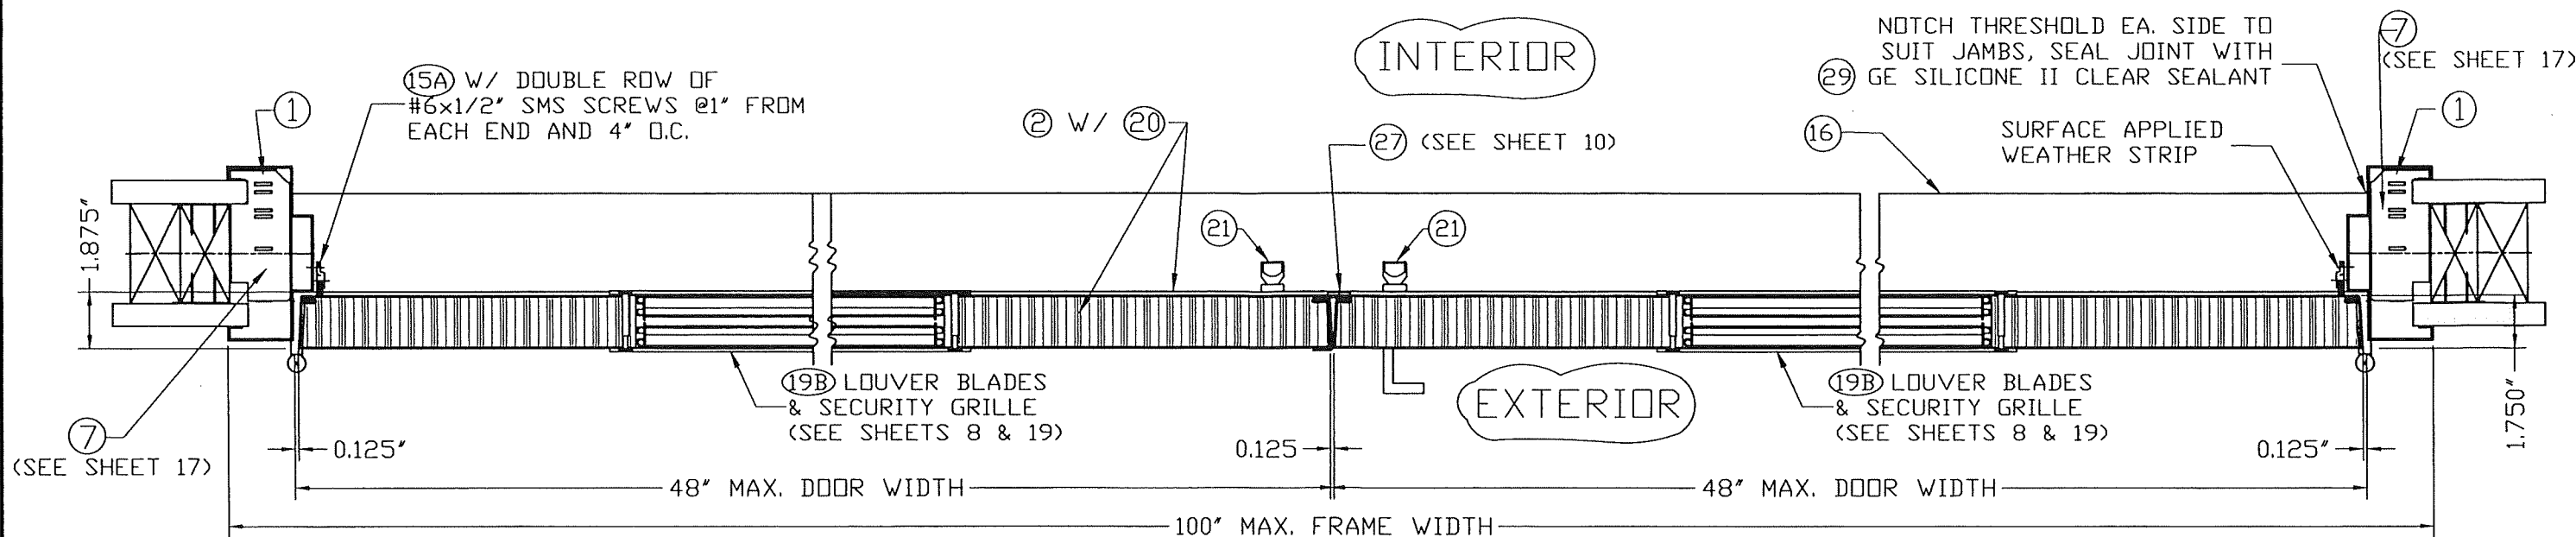

SECTION C-C  
SCALE: 3/16"=1"

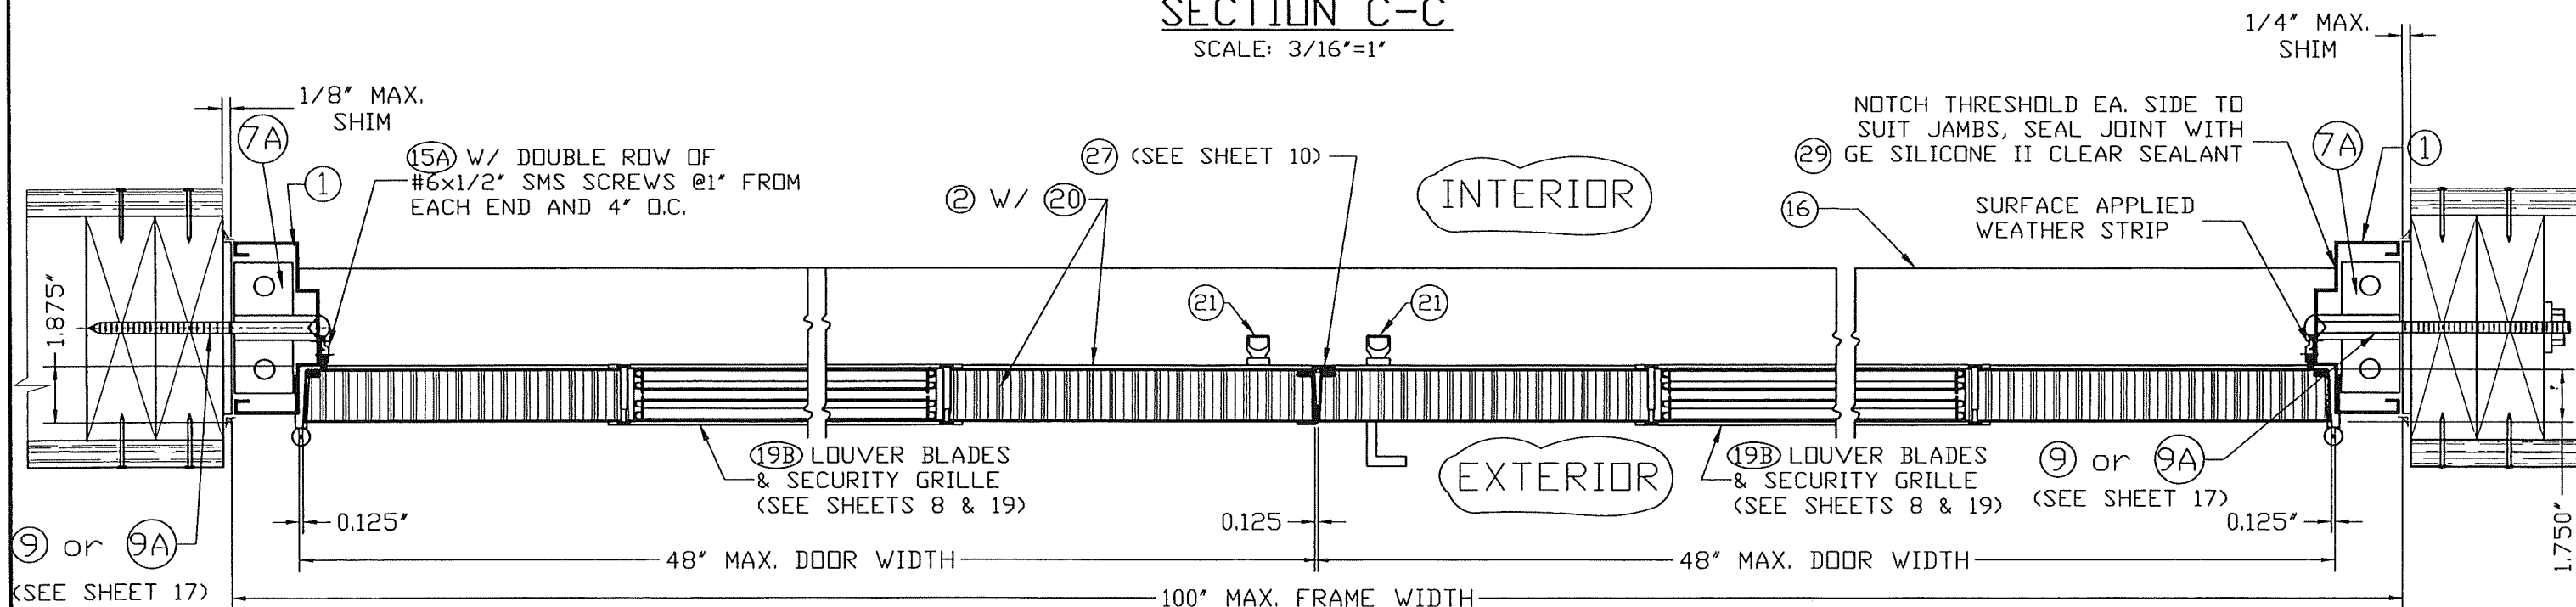

SECTION C'-C'  
SCALE: 3/16"=1"

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Isaac L. Chande*  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

WALTER A. TILLIT JR.  
LICENSE  
No. 44167  
STATE OF  
FLORIDA  
PROFESSIONAL ENGINEER  
P.E. SEAL/SIGNATURE/DATE

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

**TILTECO INC.**

TILLIT TESTING & ENGINEERING COMPANY  
365 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone: (305)871-1530 • Fax: (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY


8/9/2023  
DATE

**23-172**  
DRAWING No


SHEET 6 OF 19





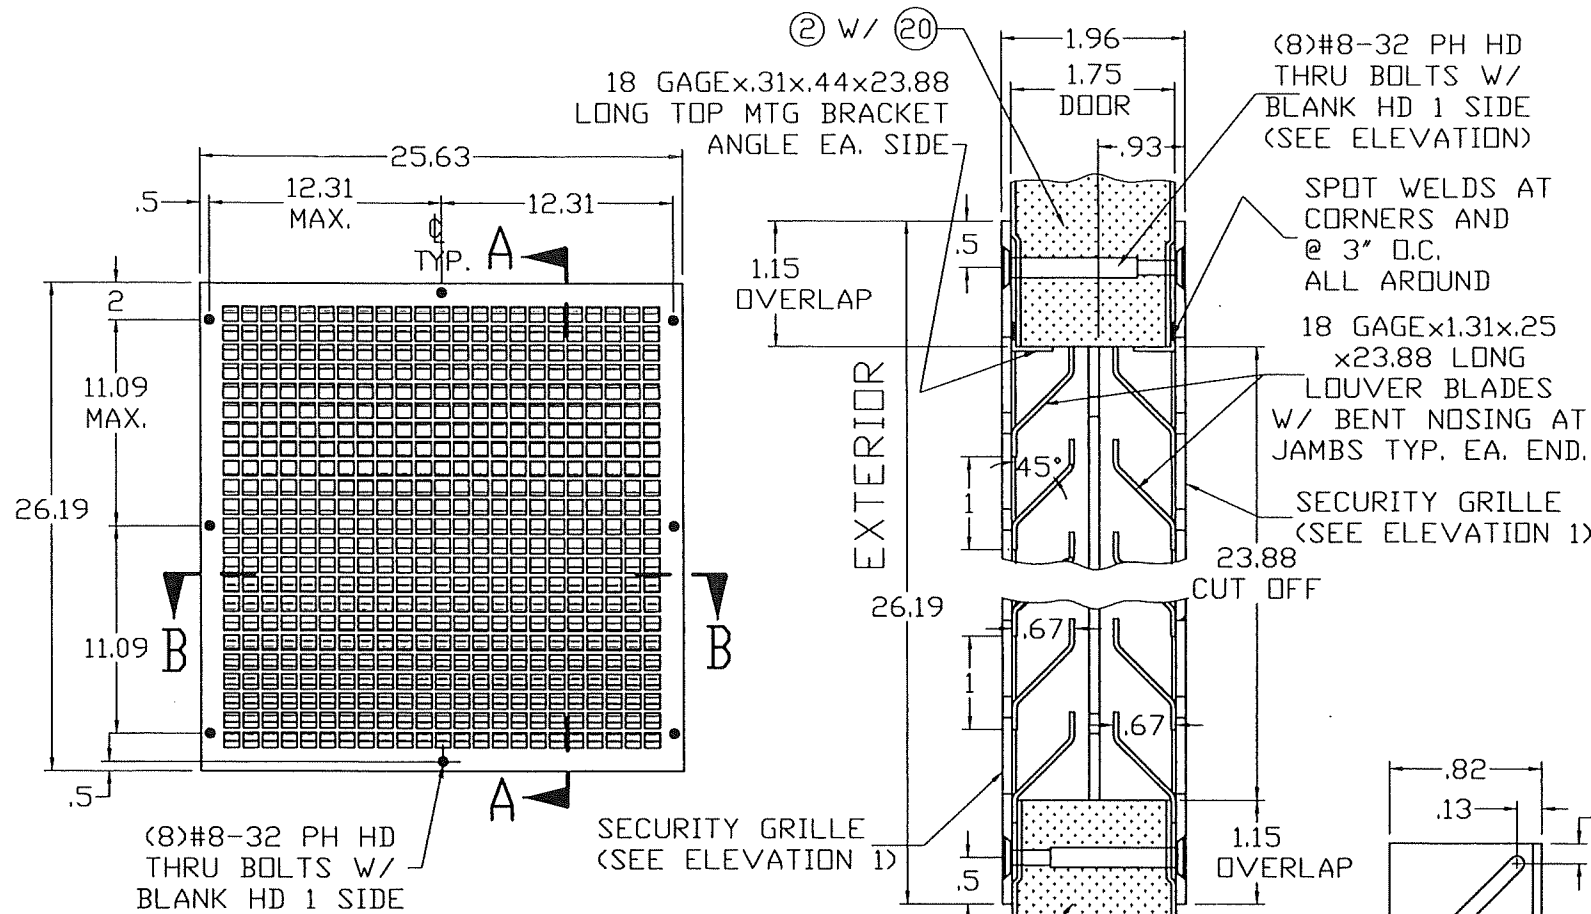

**SECURITY GRILLE & LOUVER ASSEMBLY  
(ELEVATION)**

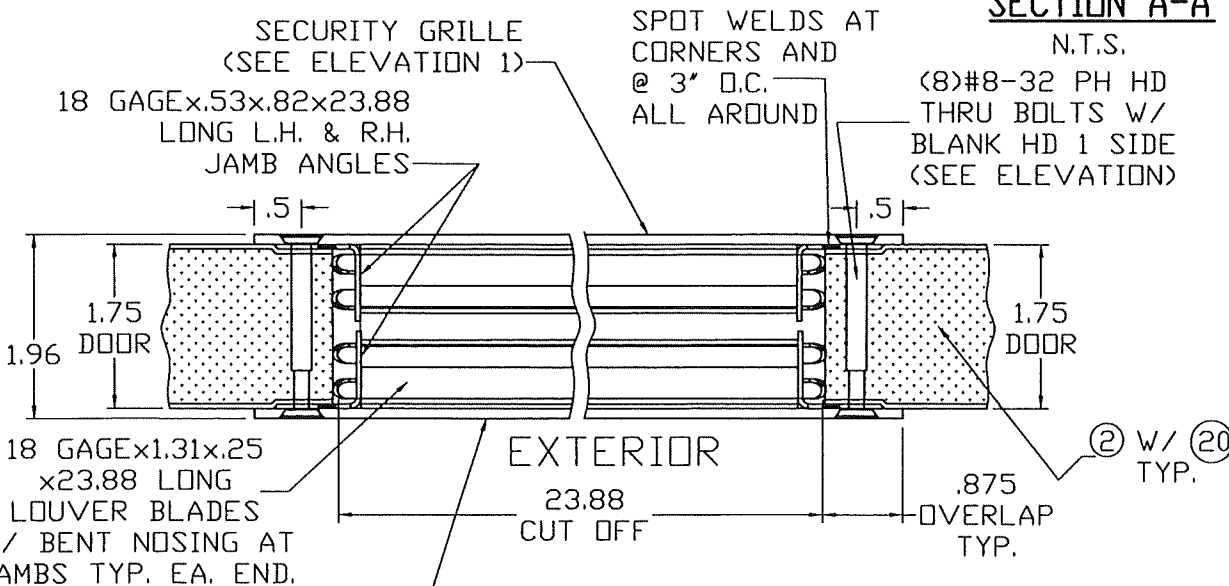

**SECTION A-A**

N.T.S.  
(8)#8-32 PH HD THRU BOLTS W/ BLANK HD 1 SIDE (SEE ELEVATION)

**TYP. SLOTTED HOLES FOR LOUVER BLADE @ JAMBS**


SCALE 1 : 1

19B

**MODEL 1500-A LOUVER 24"W X 24"H (MAX. 4 Ft<sup>2</sup> AREA)  
INVERTED "Y" BLADES C/W SECURITY GRILLE**

NOTE: SEE MAX. A.S.D. DESIGN PRESSURE RATING ON SHEET 1  
**FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)**

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Ishag I. Chank*  
**Miami-Dade Product Control**  
MIAMI-DADE COUNTY

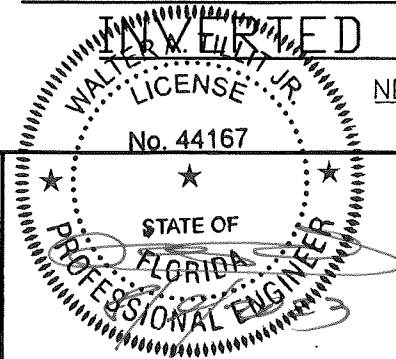


©2023 TILTECO, INC.  
**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 . Fax : (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

**DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.**  
**DAYBAR INDUSTRIES LTD**  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY  
8/9/2023  
DATE  
**23-172**  
DRAWING No  
SHEET 8 OF 19

**AIR LOUVERS, INC. MODEL 1500-A LOUVER & SECURITY GRILLE SPECIFICATIONS**  
MODEL: #1500-A  
MATERIAL: 18 GAGE CRS FRAME (MIN. Fy=45 ksi) AND LOUVER BLADES; 12 GAGE (MIN. Fy=45 ksi) CRS SECURITY GRILLE  
CONSTRUCTION: MITERED AND WELDED CORNERS; SECURITY GRILLE ON INTERIOR AND EXTERIOR OF LOUVER WITH 13/16" SQUARE OPENING 1" ON CENTER.  
FINISH: BAKED ON POWDER COAT.  
FASTENERS: #8-32 PHILIPS HEAD THRU BOLTS WITH BLANK HEAD ONE SIDE.  
FREE FLOW AREA: 40 % FREE AREA.

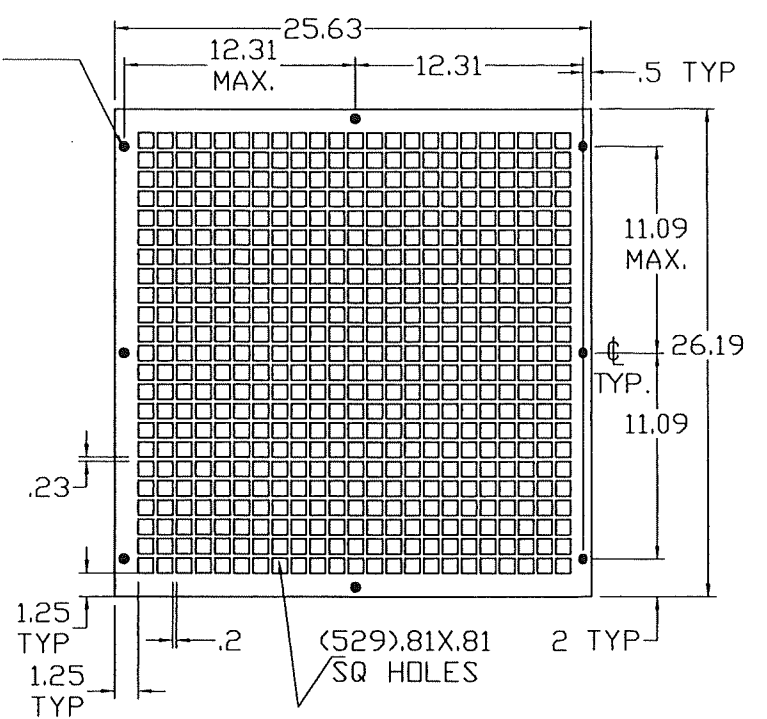


**SECURITY GRILLE ELEVATION 1**

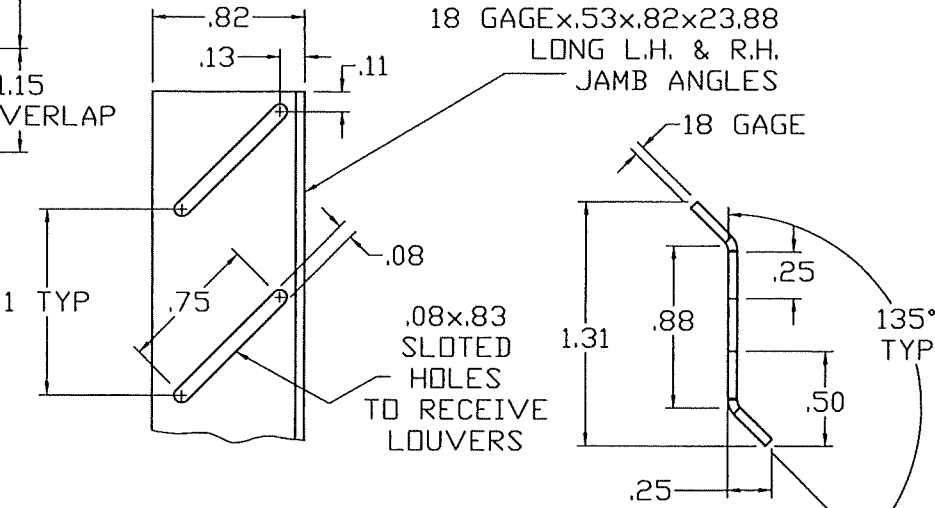

**SECTION**

**TYP. LOUVER BLADE DETAIL**

SCALE 1 : 1






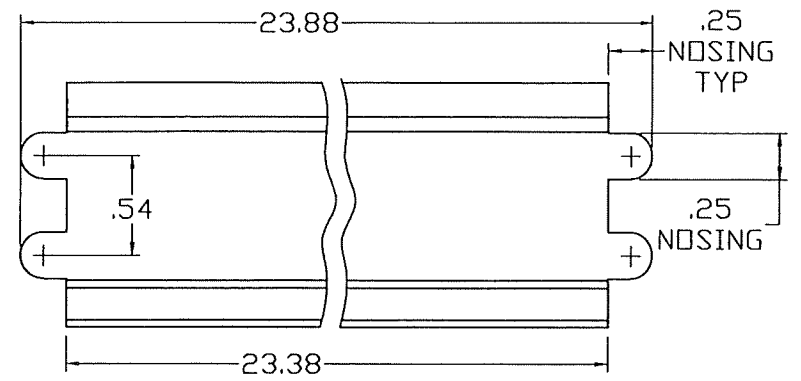


**ELEVATION**

**SECTION B-B**



N.T.S.



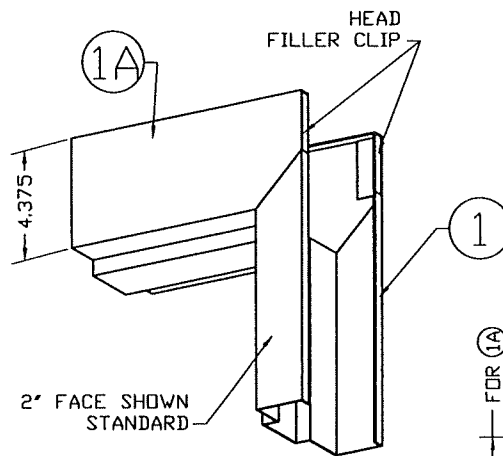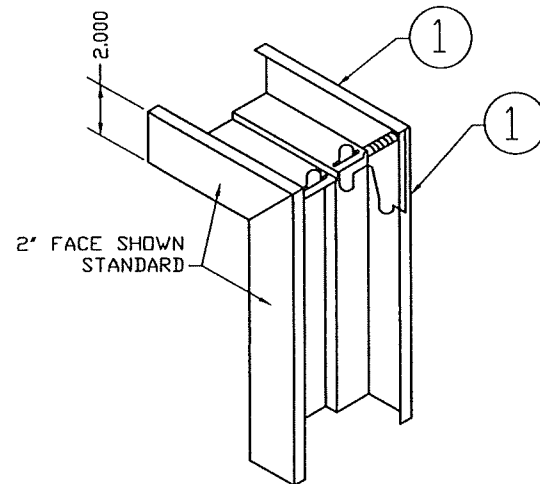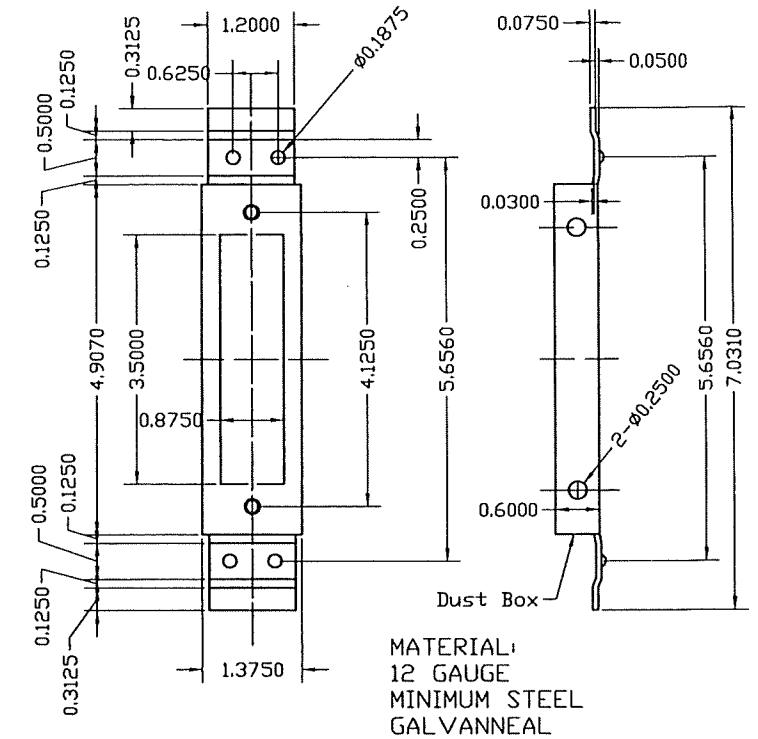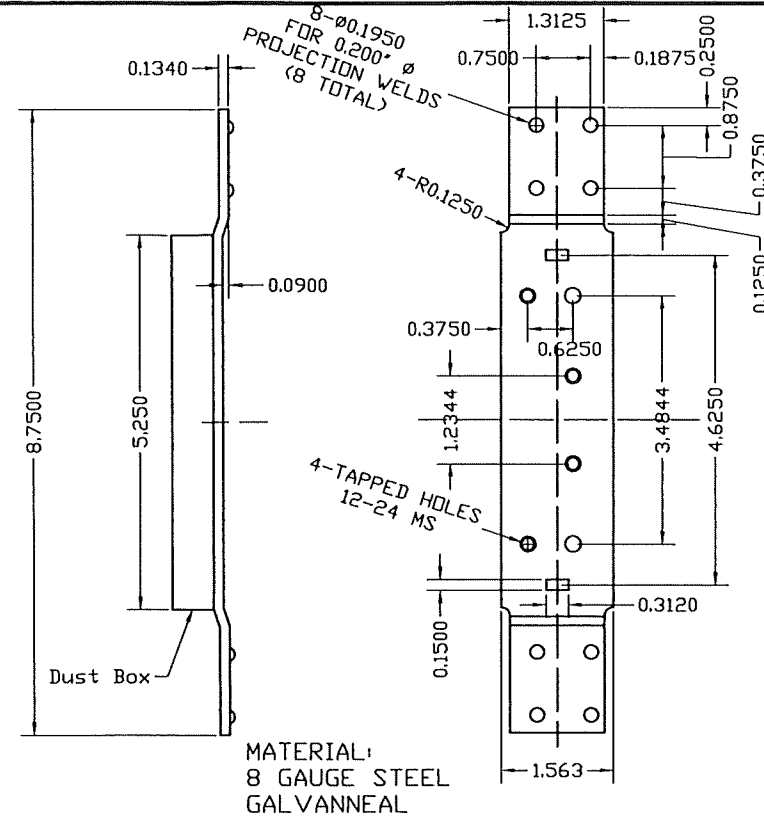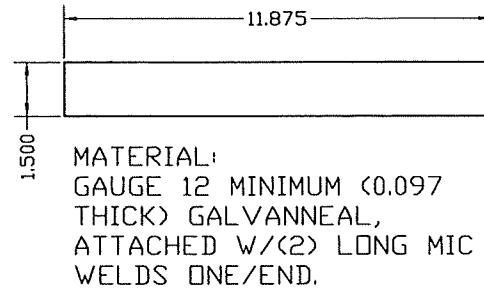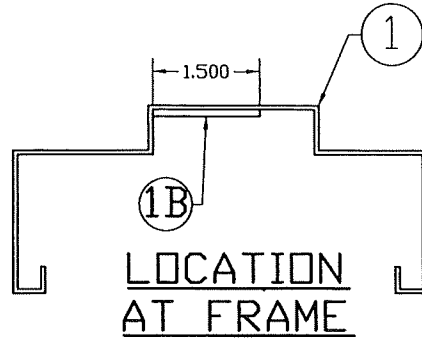


1. DIE MITERED CORNER CONT. WELDED INSIDE FACES & AT RETURNS
2. CAULK COMPLETE INSIDE CORNER WITH (29) GE SILICONE II

**DETAIL 16**  
**TYPICAL WELDED CORNER**

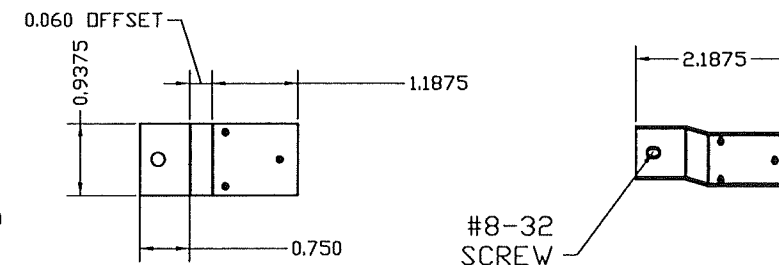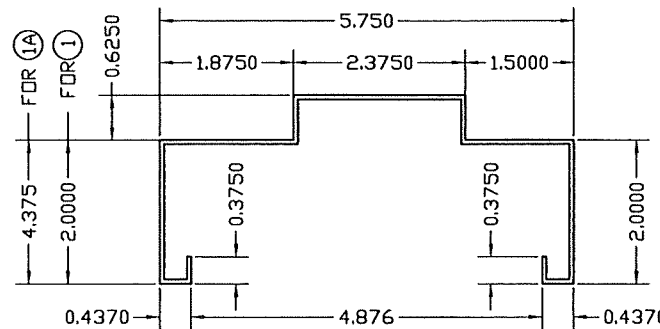

**DEAD LOCK STRIKE TAB**  
**14 GA (0.074) MIN**

ATTACHED TO STRIKE JAMB W/ (3) 1/8"  $\phi$  PROJECTION WELDS.

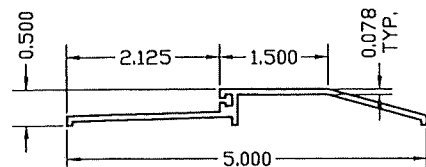

**16** **EXTRUDED ALUMINUM THRESHOLD NGP #950NA**

## FRAME SECTIONS AND REINFORCING DETAILS


**PRODUCT REVISED**  
as complying with the Florida Building Code

NOA-No. 23-0823.11

Expiration Date 04/11/2026

By Ishag I. Chande  
Miami-Dade Product Control

MIAMI-DADE COUNTY

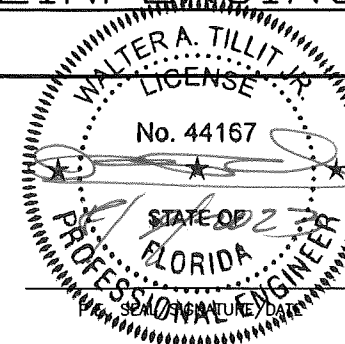

©2023 TILTECO, INC.

**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 • Fax : (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

**FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)**

**DOUBLE & SINGLE SERIES LS18 OUTSWING COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE STEEL FRAME LOUVERED ASSEMBLIES.**

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


Y.M.  
DRAWN BY

8/9/2023  
DATE

**23-172**  
DRAWING No


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

SHEET 9 OF 19

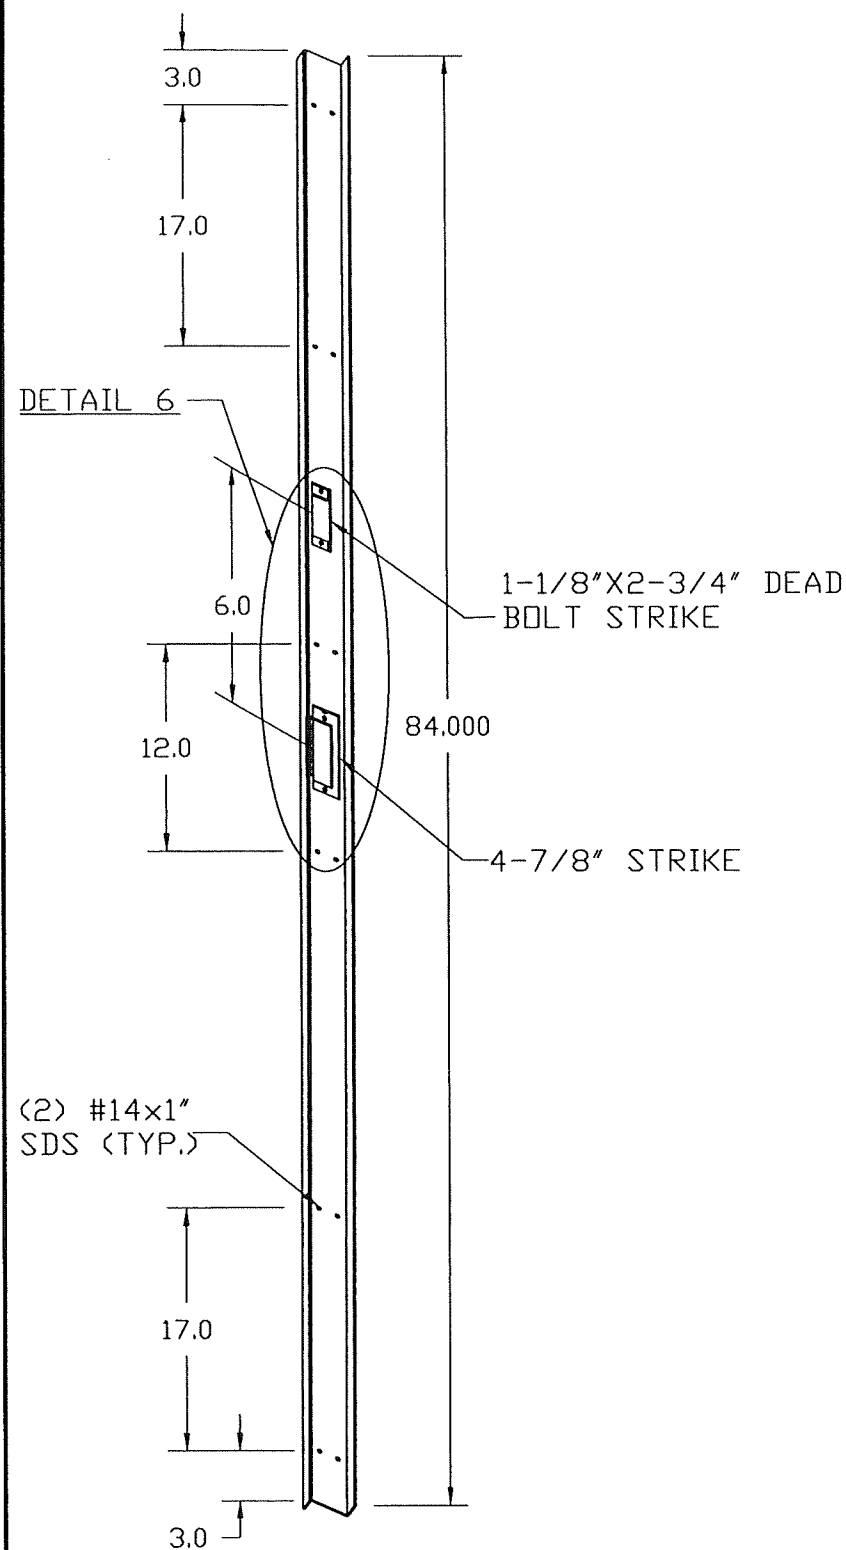


(27) "Z" ASTRAGAL ISOMETRIC DETAIL


MATERIAL:  
0.075" THICK STEEL

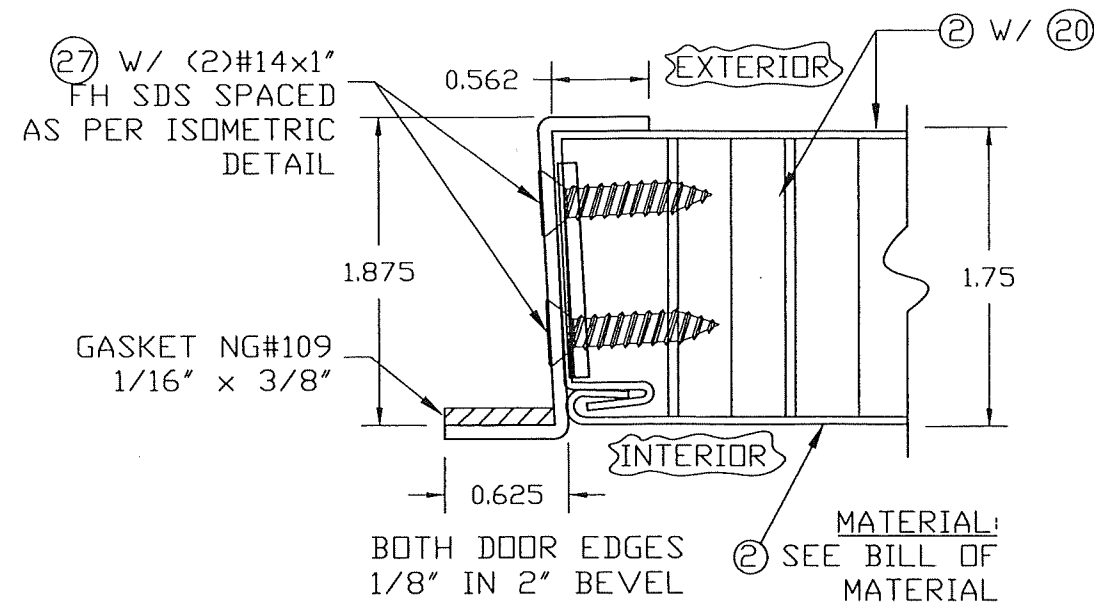

SECTION THRU ASTRAGAL AT DOUBLE DOOR

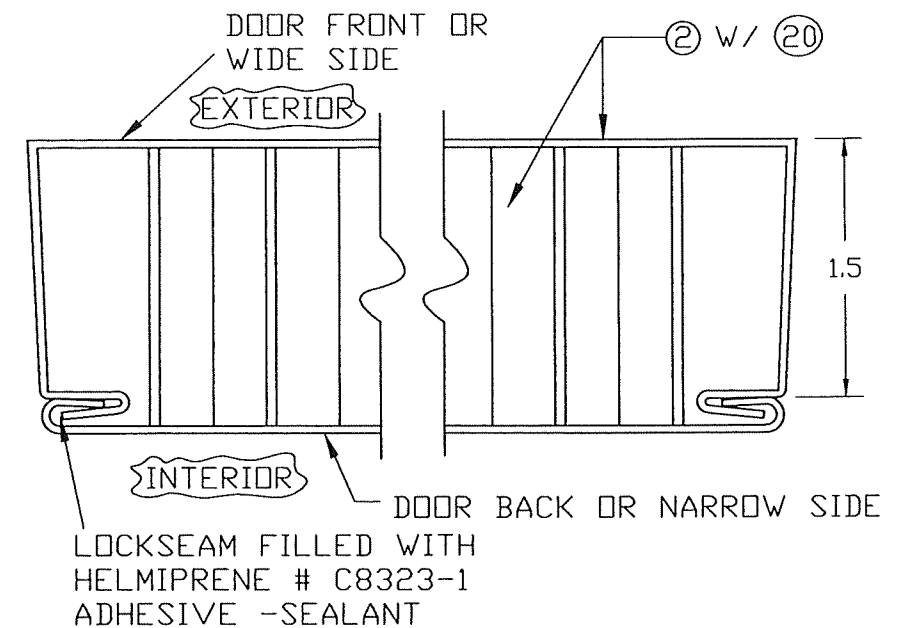


TYPICAL CROSS SECTION THRU DOOR

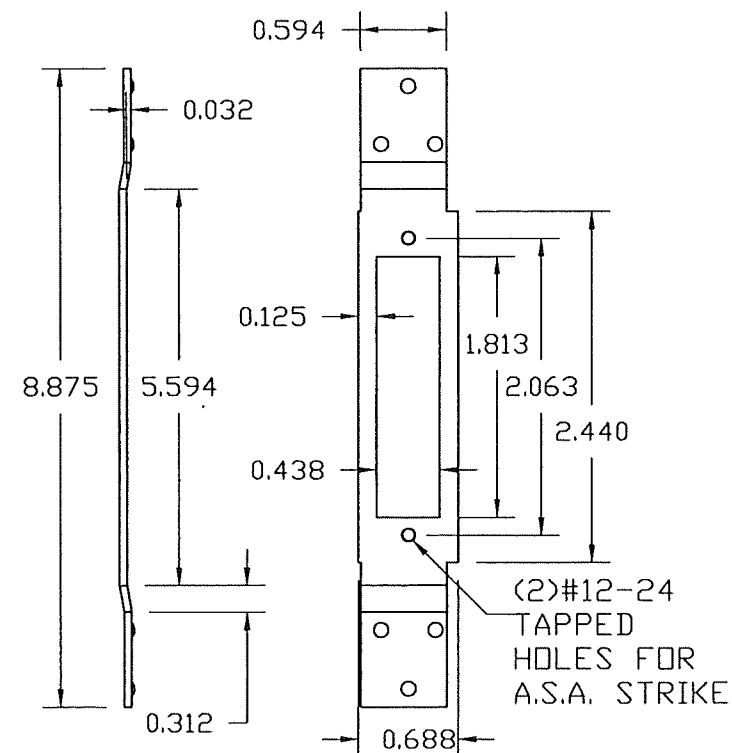

12 GAGE STEEL ASA 1299 STRIKE REINFORCEMENT FOR ASTRAGAL


12GA. STEEL ASA STRIKE REINFORCEMENT  
3x1/8" PROJECTION  
WELD EACH SIDE

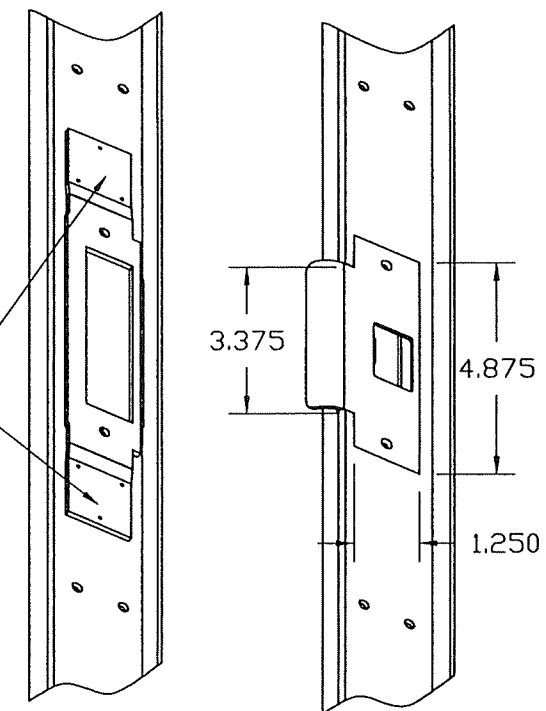

DETAIL 6

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Ishag I. Chande*  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

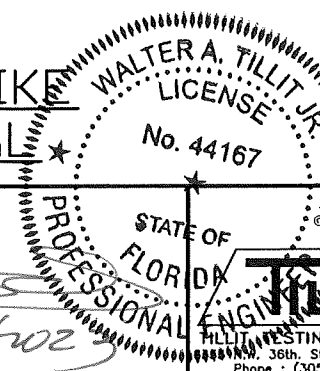

TILTECO, INC.  
TILTECO INVESTING & ENGINEERING COMPANY  
36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone: (305)871-1530 Fax: (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT JR. P.E.  
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


Y.M.  
DRAWN BY

8/9/2023  
DATE

**23-172**  
DRAWING No

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		


SHEET 10 OF 19

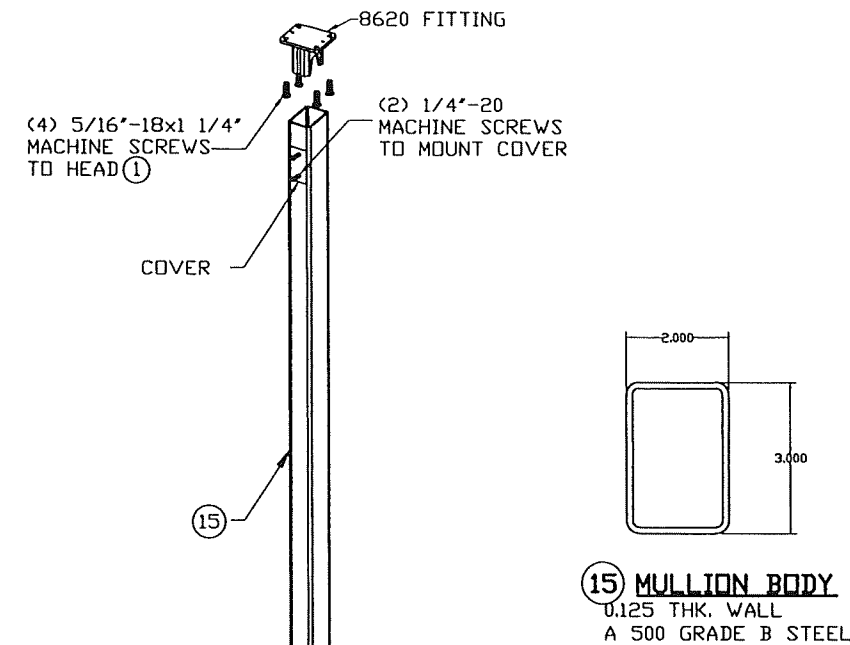

(4) 5/16"-18 POWERS FASTENERS CALK-IN ANCHORS W/ 1" MIN. EMBEDMENT TO POURED CONCRETE.

8620 FITTING



### ISOMETRIC

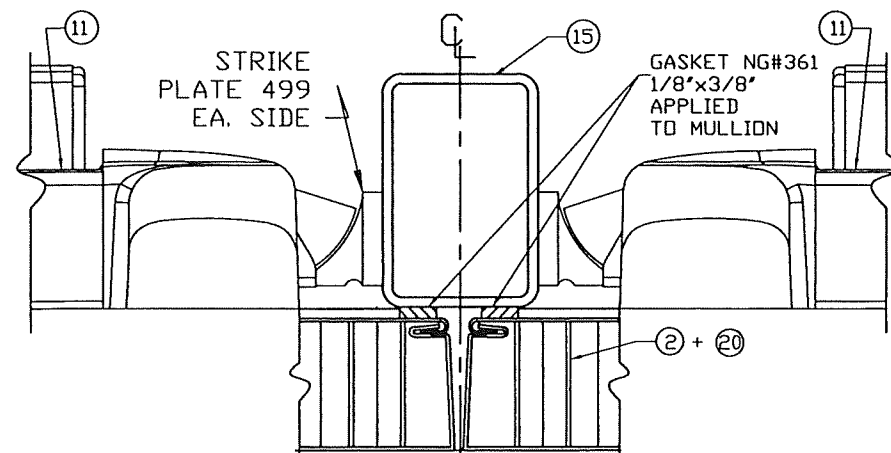


EXTERIOR

### MULLION/DOOR SEAL


⑮ VON DUPRIN SERIES 9954 (W/ 499 STRIKE PLATE) MULLION INSTALLATION

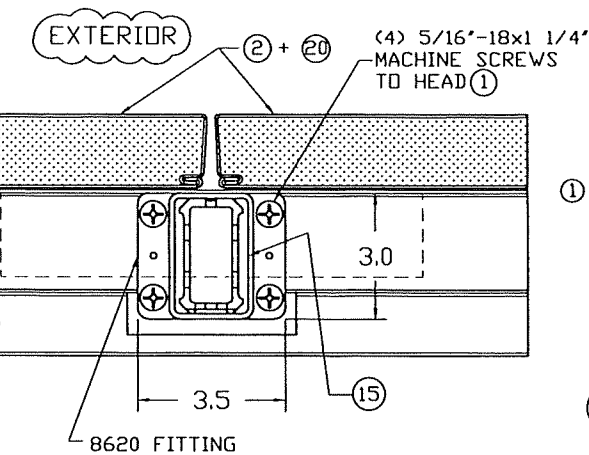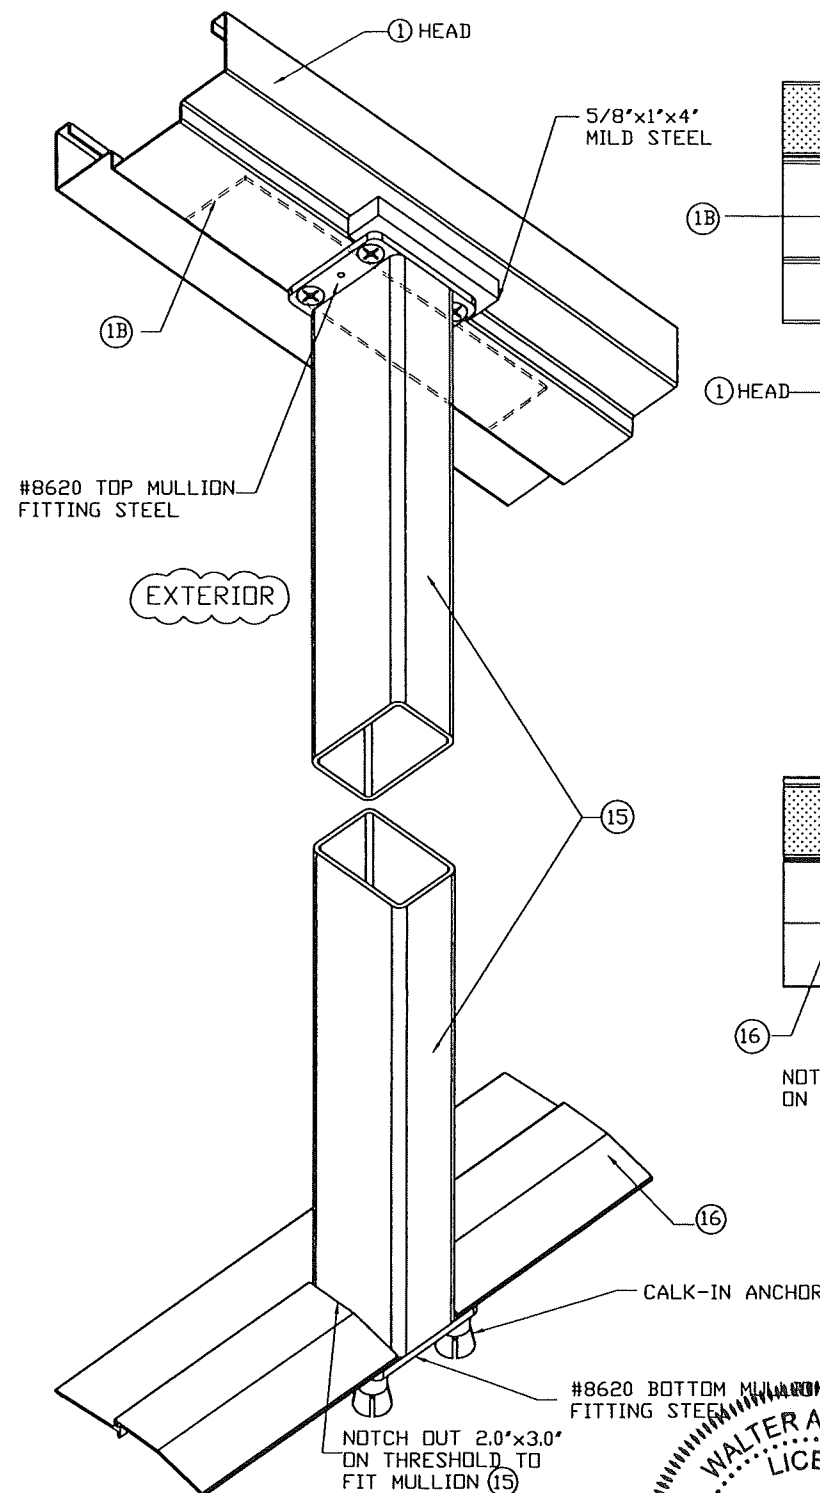


### CONNECTION AT TOP (PLAN)

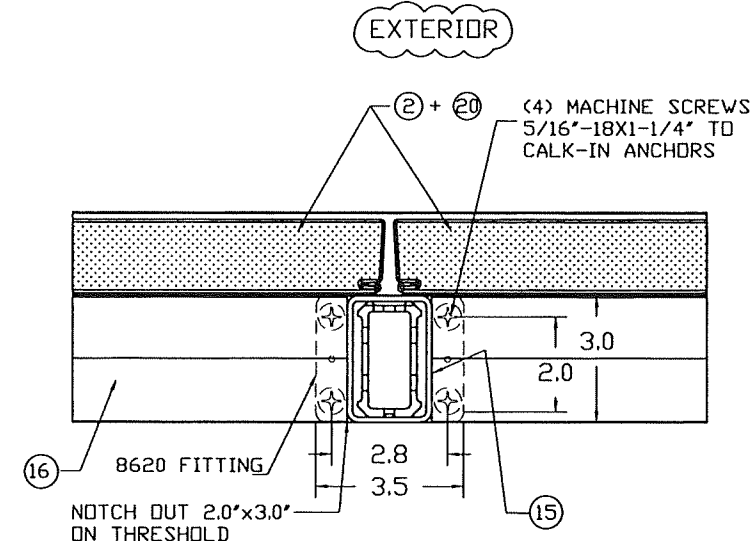


### CONNECTION AT BOTTOM (PLAN)

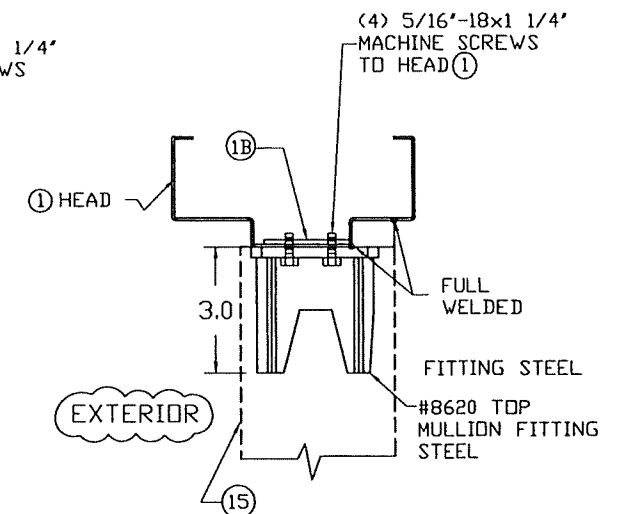

### SECTION

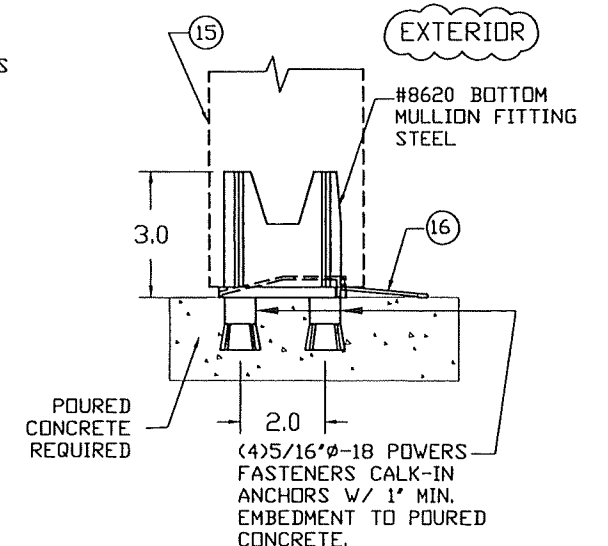

### SECTION

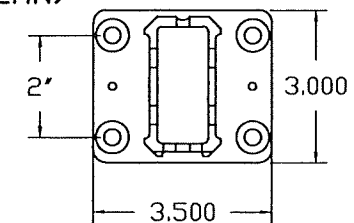

### MULLION FITTING 8620 STEEL

**PRODUCT REVISED**  
as complying with the Florida Building Code

NOA-No. 23-0823.11

Expiration Date 04/11/2026

By *Ishag I. Chank*  
Miami-Dade Product Control

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

WALTER A. TILLIT JR.  
LICENSE  
No. 44167  
STATE OF FLORIDA  
PROFESSIONAL ENGINEER

©2023 TILTECO, INC.

**TILTECO INC.**  
TILIT TESTING & ENGINEERING COMPANY  
3055 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 . Fax : (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

### FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

Y.M.  
DRAWN BY


8/9/2023  
DATE

23-172  
DRAWING No

SHEET 11 OF 19

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		




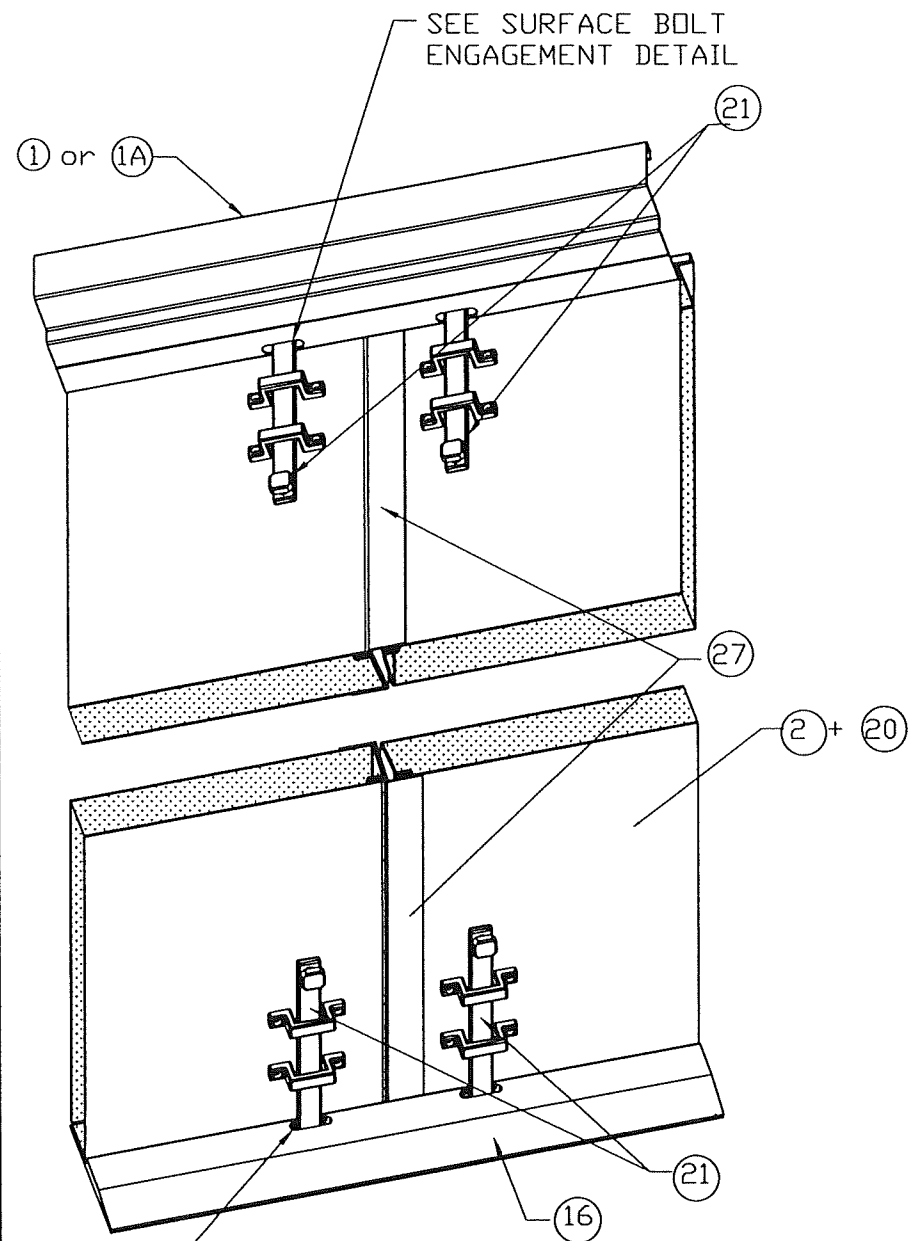


SEE SURFACE BOLT ENGAGEMENT DETAIL  
**SURFACE BOLT INSTALLATION AT DOOR W/ ASTRAGAL (INTERIOR VIEW)**

NOTE:  
 SURFACE BOLT  
 MANUFACTURER-HAGER  
 MODEL #275D  
 MATERIAL-STEEL  
 FINISH US26D


**(21) 8" #275D HAGER SURFACE BOLT**

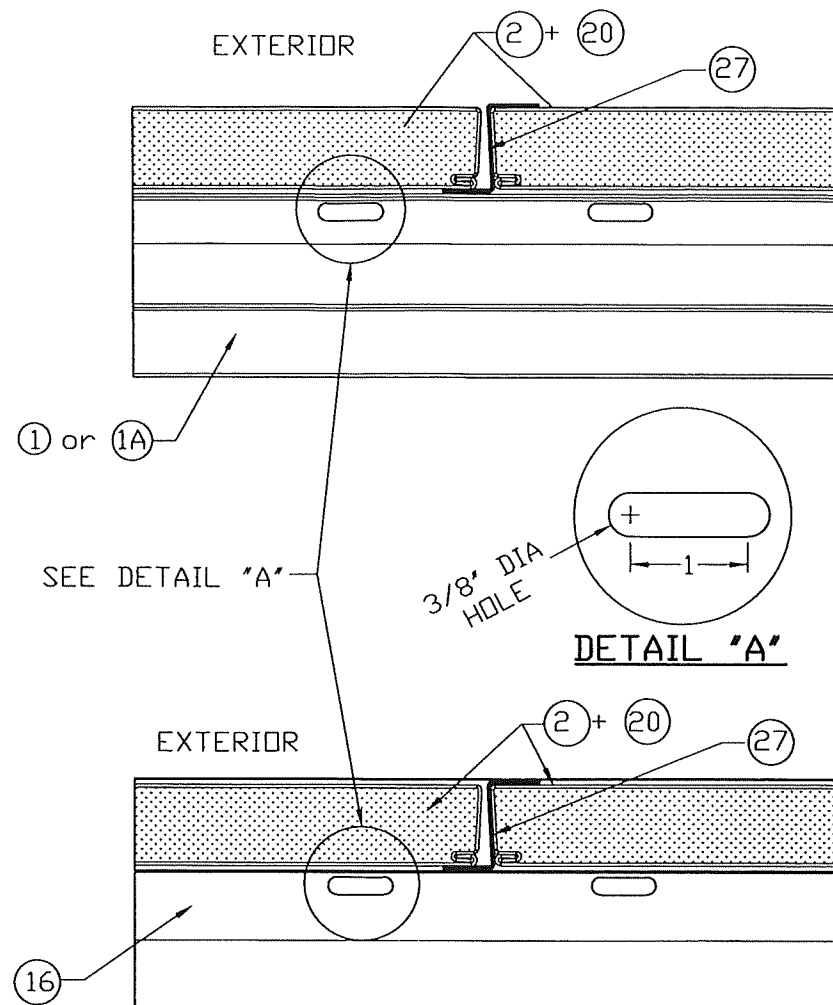

**TYPICAL SURFACE BOLT ENGAGEMENT DETAIL AT HEAD & SILL**

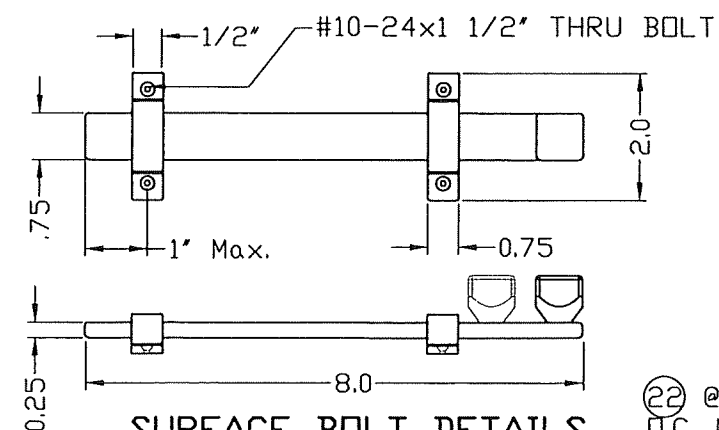

**SURFACE BOLT DETAILS**

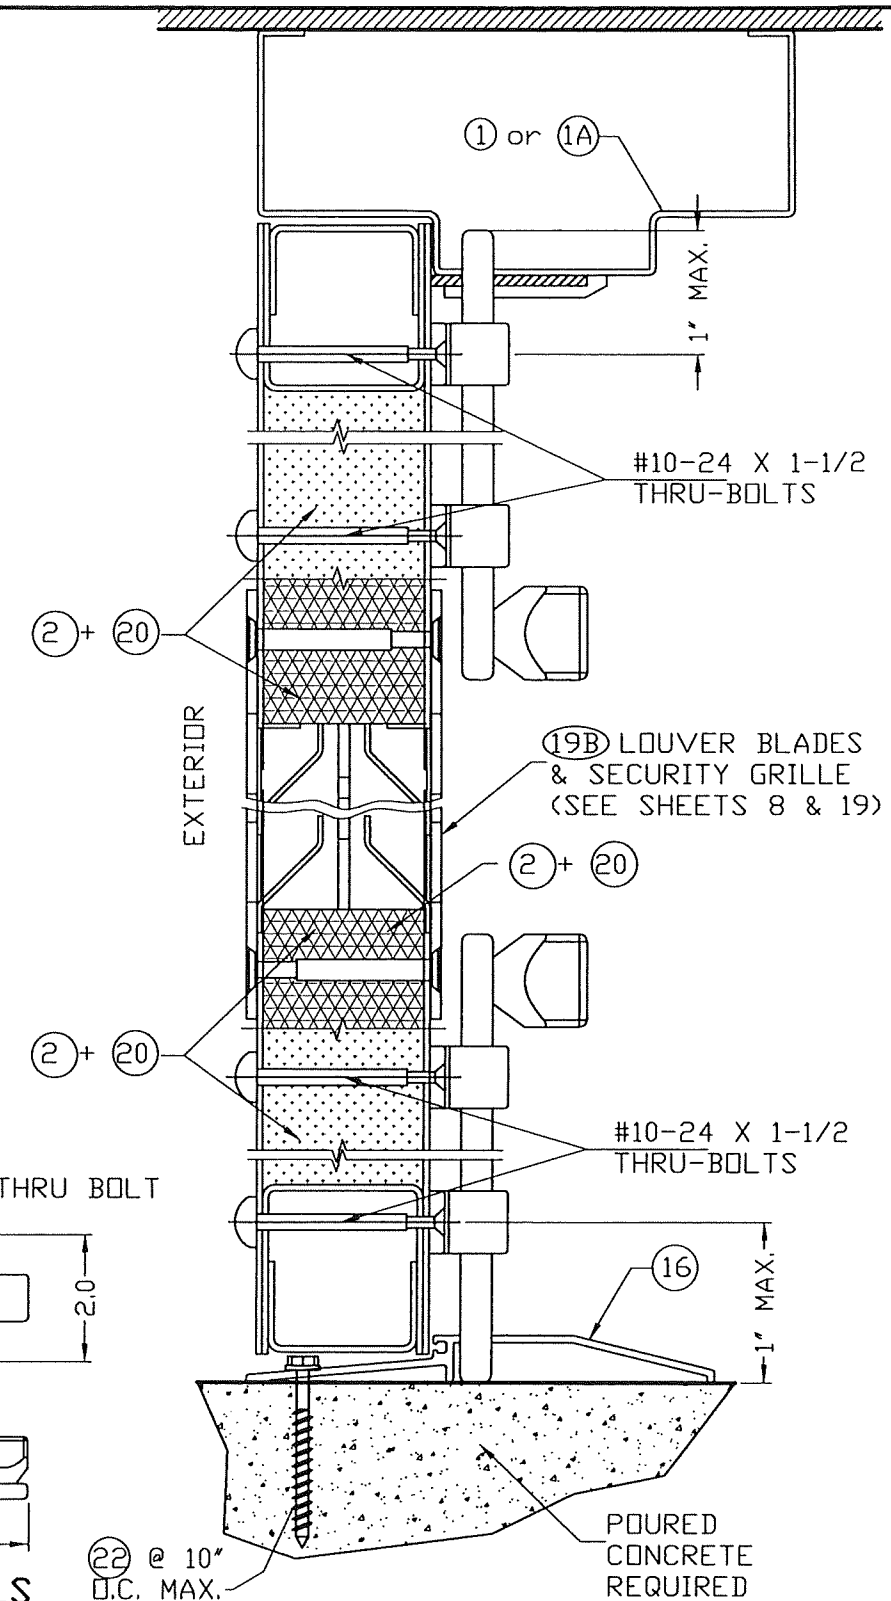

**FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)**

**PRODUCT REVISED**  
 as complying with the Florida Building Code  
 NOA-No. 23-0823.11  
 Expiration Date 04/11/2026  
 By *Ishag I. Chande*  
**Miami-Dade Product Control**  
 MIAMI-DADE COUNTY


WALTER A. TILLIT JR.  
 LICENSE No. 44167  
 STATE OF FLORIDA  
 PROFESSIONAL ENGINEER  
 P.E. SEAL/SIGNATURE/DATE

©2023 TILTECO, INC.  
**TILTECO INC.**  
 TILLIT TESTING & ENGINEERING COMPANY  
 6356 N.W. 25th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
 Phone: (305)871-1530 Fax: (305)871-1531  
 e-mail: tilteco@aol.com  
 CA-0006719  
 WALTER A. TILLIT JR. P.E.  
 FLORIDA Lic. # 44167

**DOUBLE & SINGLE SERIES LS18 OUTSWING COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE STEEL FRAME LOUVERED ASSEMBLIES.**  
**DAYBAR INDUSTRIES LTD**  
 50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4  
 TEL: 905 625-8000  
 FAX: 905 625-4204




REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
 DRAWN BY  
 8/9/2023  
 DATE  
**23-172**  
 DRAWING No  
 SHEET 12 OF 19

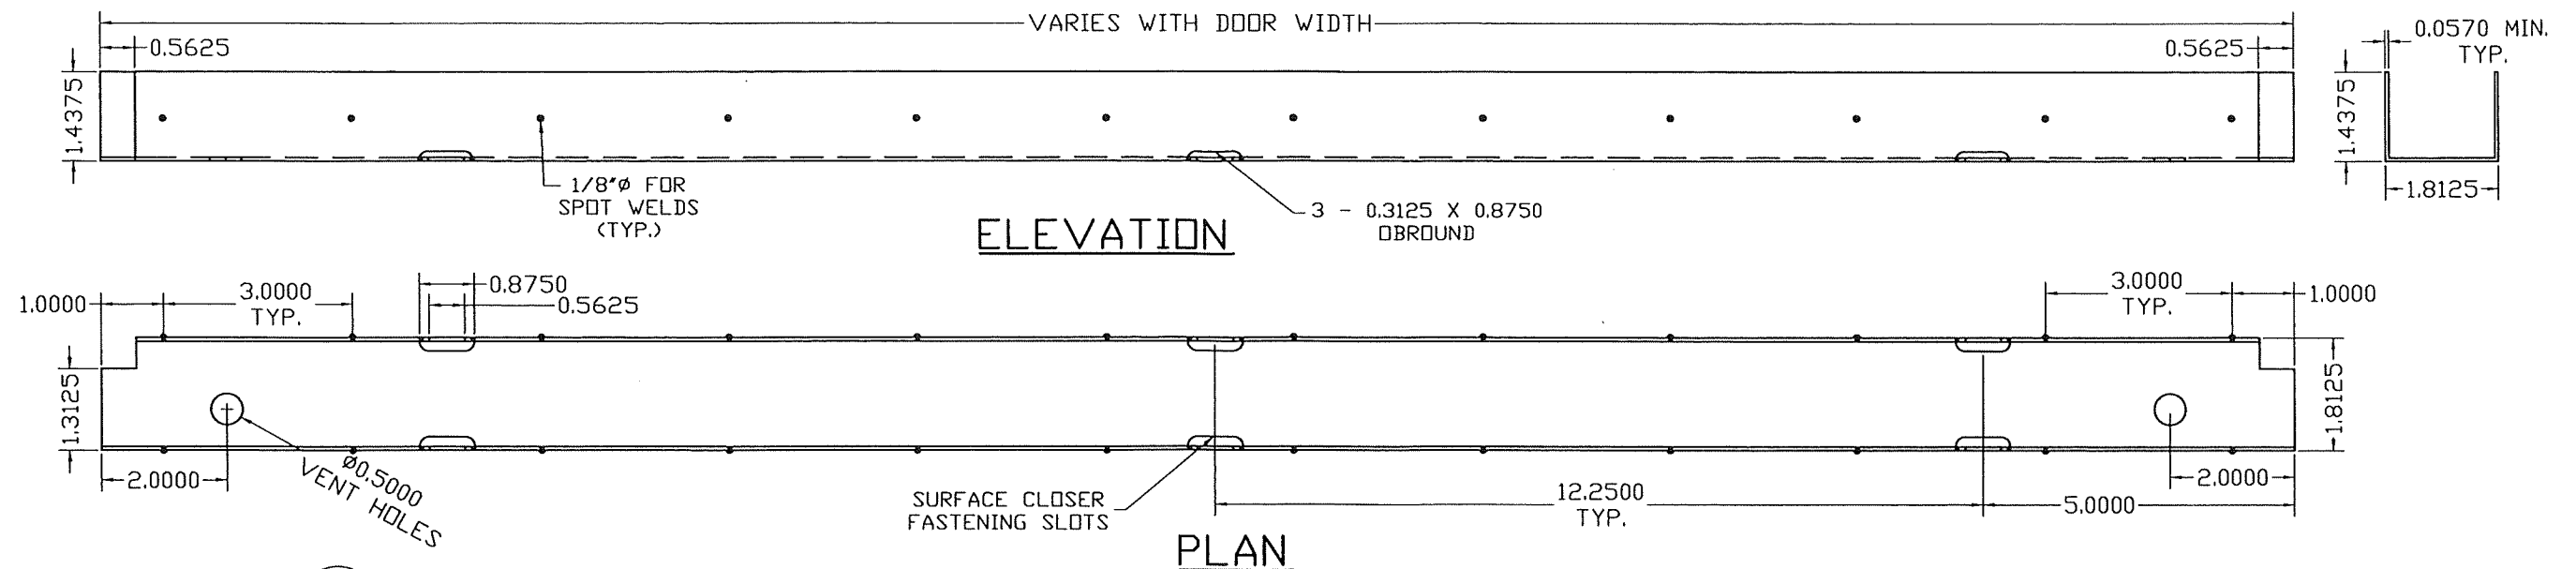


## 26 DOOR TOP AND BOTTOM TYPICAL END CHANNEL DETAIL

**MATERIAL:**  
16 GAUGE (0.057) MINIMUM  
GALVANNEAL STEEL

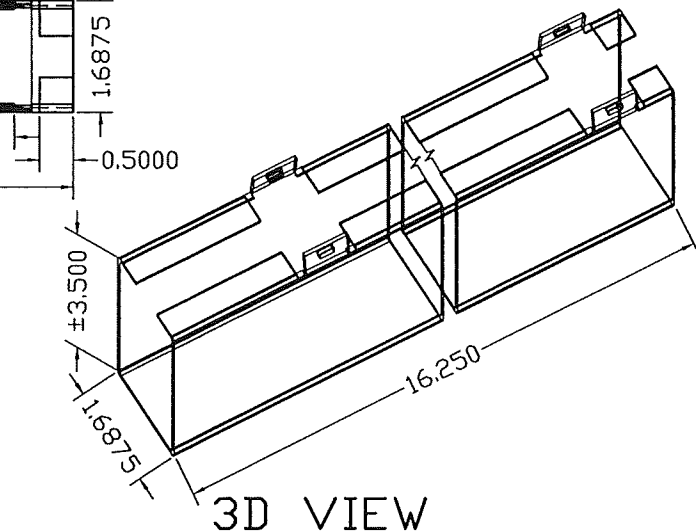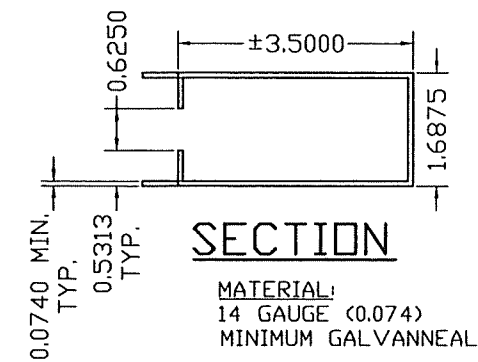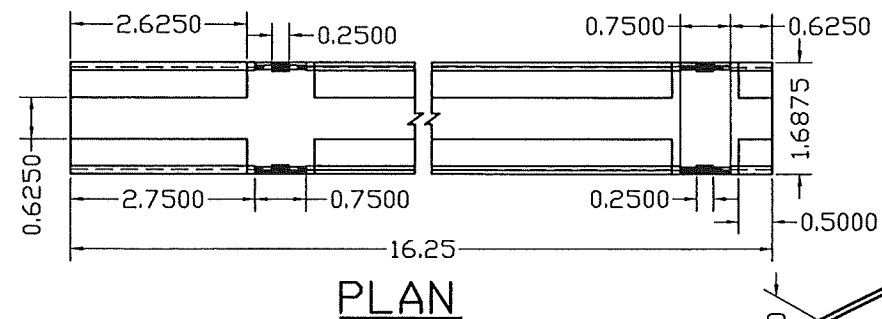


LAMINATED TO EACH FACE OF DOOR  
W/ CONTACT ADHESIVE (HELHIBOND 8326-1)  
AT HINGE EDGE AND TOP END CHANNEL.

## 25 DOOR SURFACE CLOSER REINFORCEMENT DETAIL

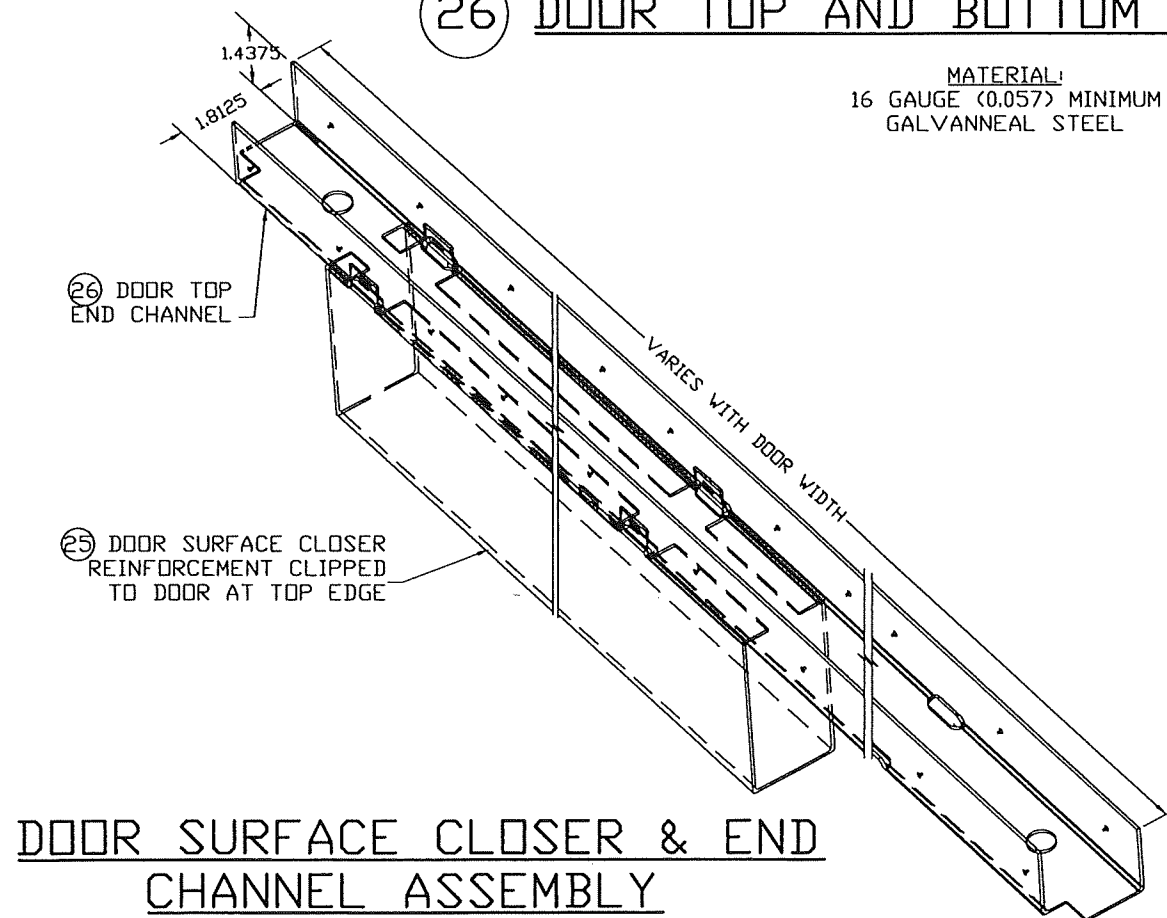

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Ishag I. Chank*  
**Miami-Dade Product Control**  
MIAMI-DADE COUNTY

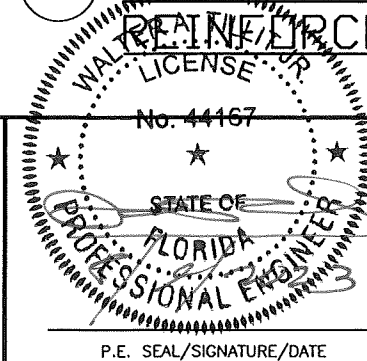

©2023 TILTECO, INC.  
**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone: (305) 871-1530, Fax: (305) 871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT JR. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


Y.M.  
DRAWN BY

8/9/2023  
DATE

**23-172**  
DRAWING No


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

SHEET 13 OF 19

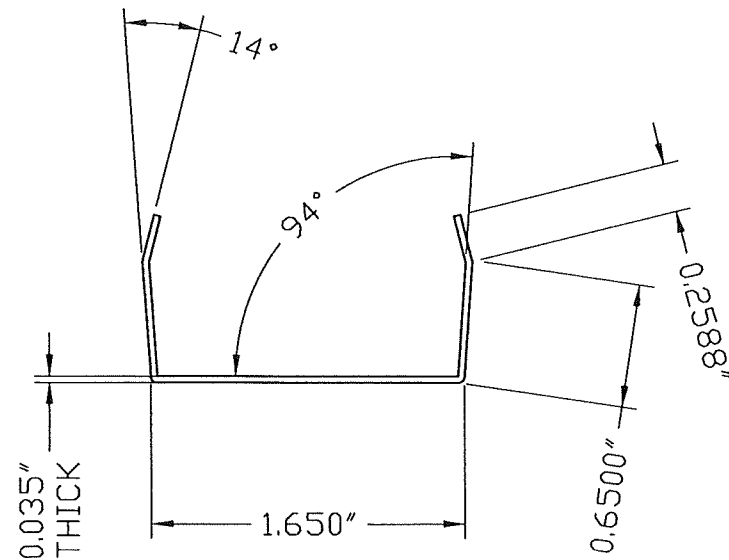


**DETAIL A**  
**SNAP IN CHANNEL**


**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Ishaq I. Chande*  
Miami-Dade Product Control

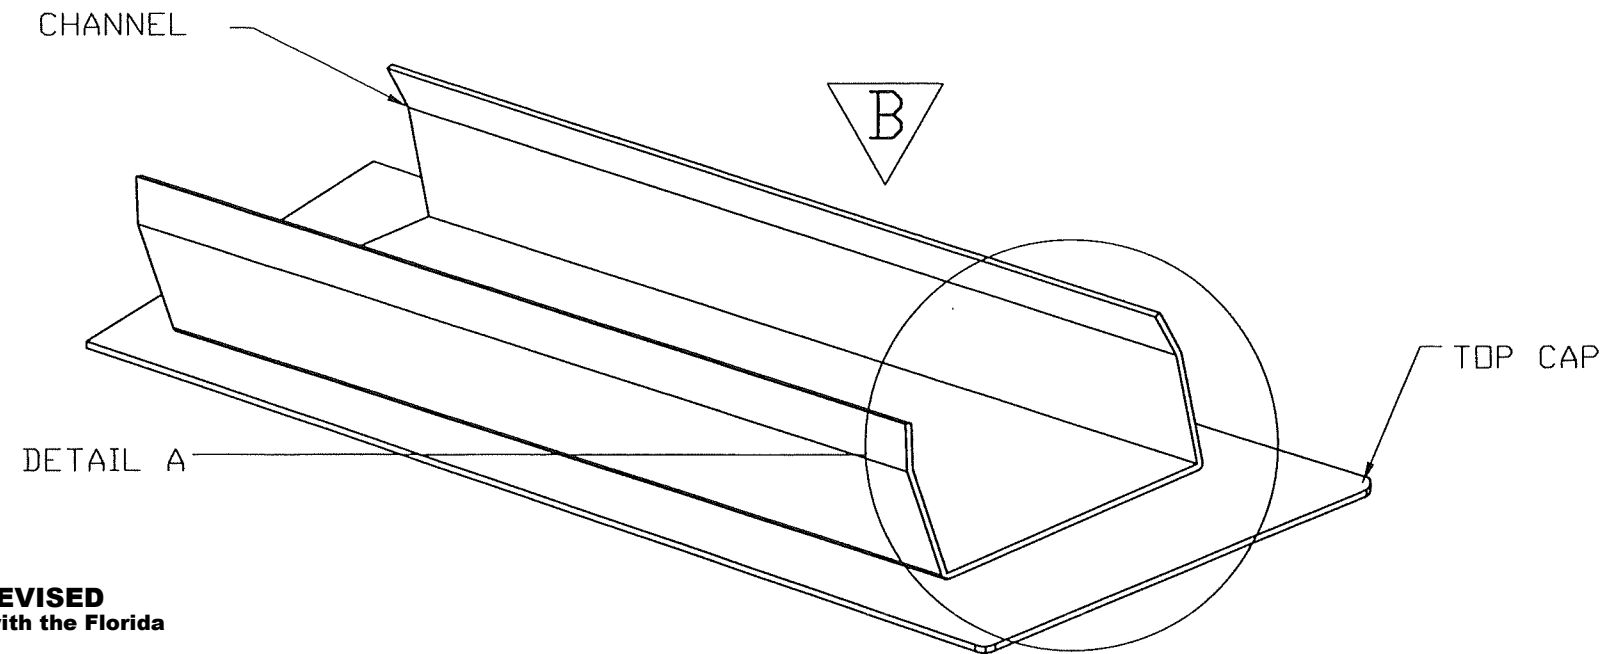

**ASSEMBLY (ISOMETRIC)**  
**(SNAP IN CHANNEL WITH TOP CAP)**

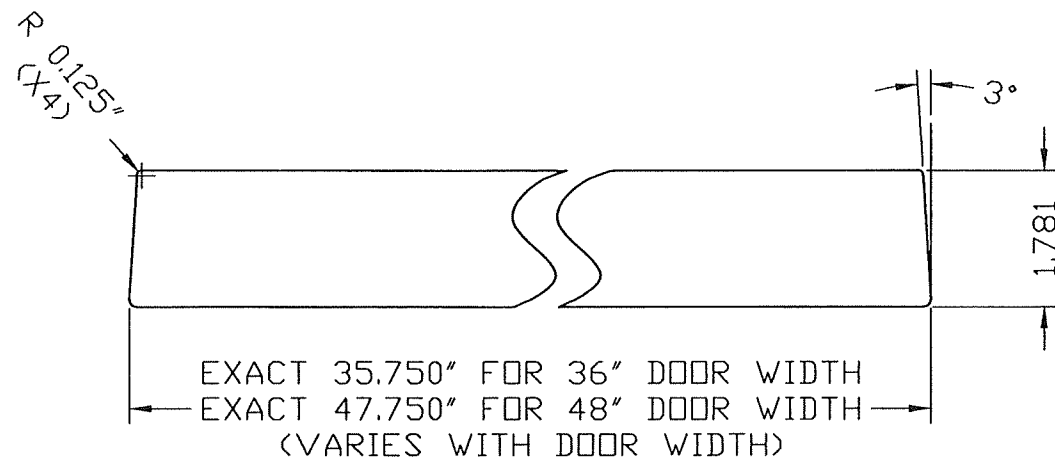

**STANDARD TOP CAP**

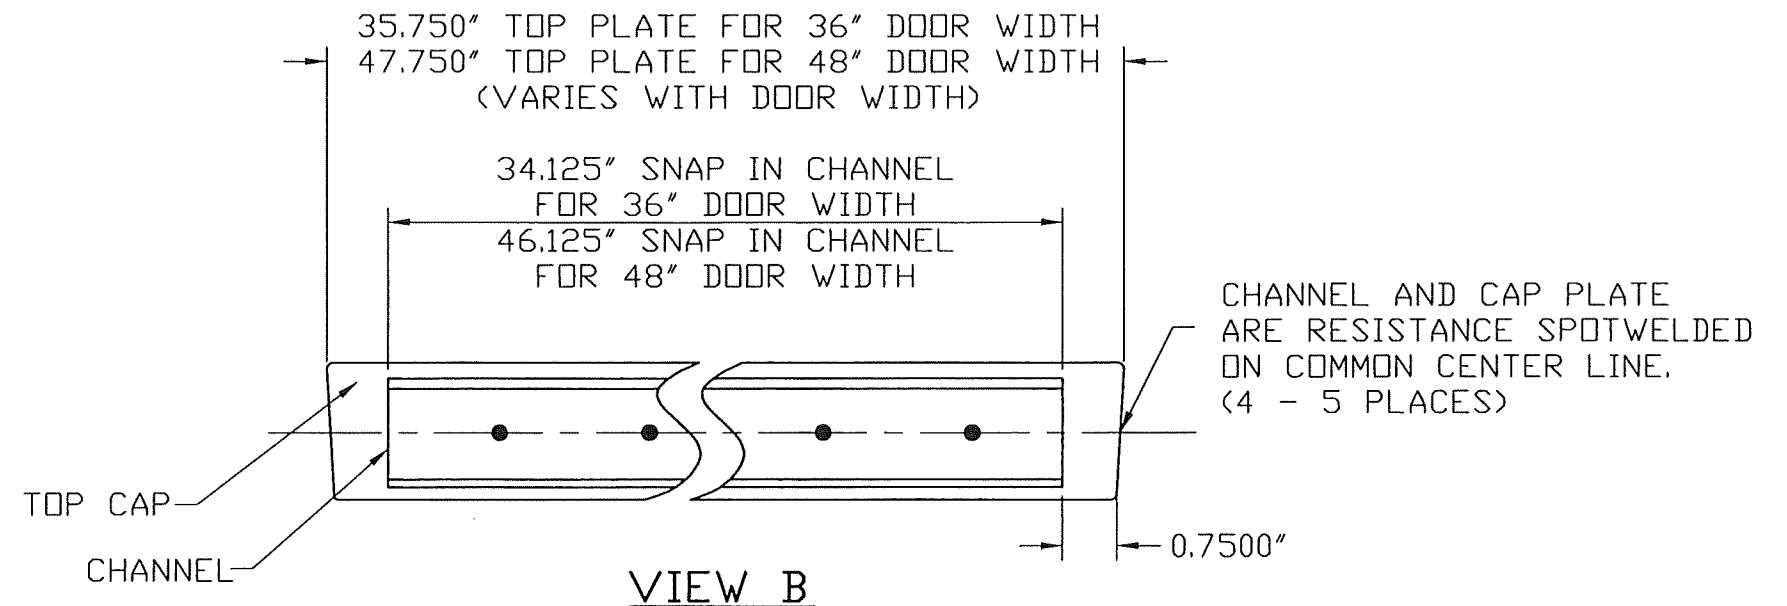

**VIEW B**

28

**DOOR SNAP IN TOP CAP DETAIL**

MATERIAL: 20 GA GALVANNEAL STEEL FOR  
BOTH PCS. ASTM A-653, A-60

**INSTALLATION OPTIONS:**

(A) CAULK AND PRESSFIT

(B) CAULK, PRESSFIT AND TACK WELD

MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

WALTER A. TILLIT JR.  
LICENSE  
No. 44167  
STATE OF  
FLORIDA  
PROFESSIONAL ENGINEER

©2023 TILTECO, INC.

**TILTECO INC.**  
TESTING & ENGINEERING COMPANY  
365 S.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305) 871-1530 • Fax : (305) 871-1531  
e-mail: [tilteco@aol.com](mailto:tilteco@aol.com)  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

**FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)**

**DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.**

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

Y.M.  
DRAWN BY


8/9/2023  
DATE

**23-172**  
DRAWING No


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

SHEET 14 OF 19



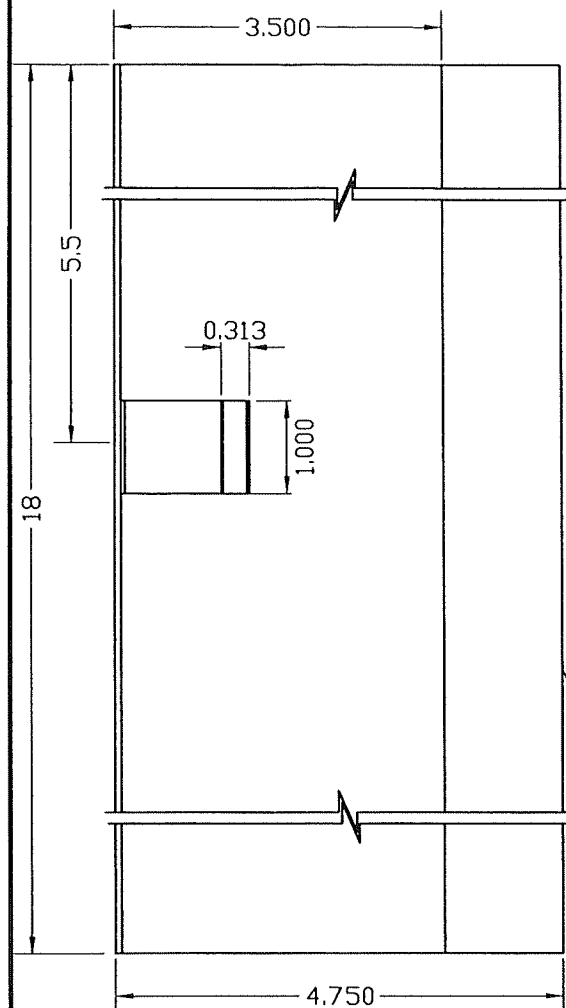

**ELEVATION**


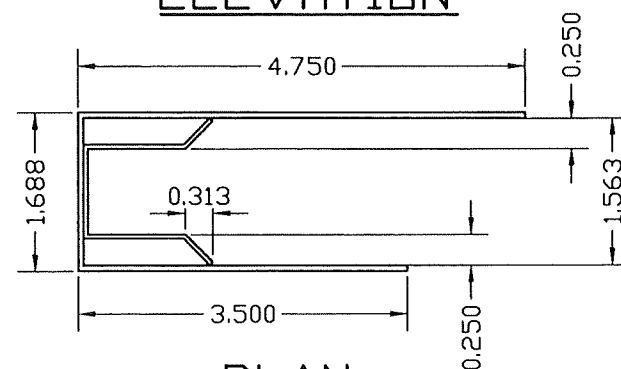


**PLAN**

MATERIAL:  
ALL GALVANNEAL STEEL

GAGE 14 (0.074) MINIMUM  
RP REINFORCING SAME AS #86.  
LESS LOCK CLIP & MOUNTING  
TABS, GLUE W /CONTACT  
ADHESIVE TO DOOR FACE


LOCK CLIP-18GA (0.045)  
MIN. ONLY VALID FOR  
ASSEMBLY WHERE  
APPLICABLE

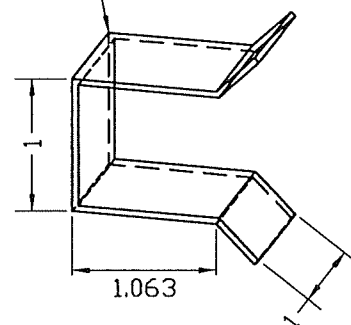

**DOOR EDGE  
MOUNTING TAB**

14 GA (0.074) MIN  
STEEL

#12-24  
SCREW




(3) 1/8"Ø  
PROJECTION  
WELDS


**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11

Expiration Date 04/11/2026

By *Ishag I. Chande*  
Miami-Dade Product Control

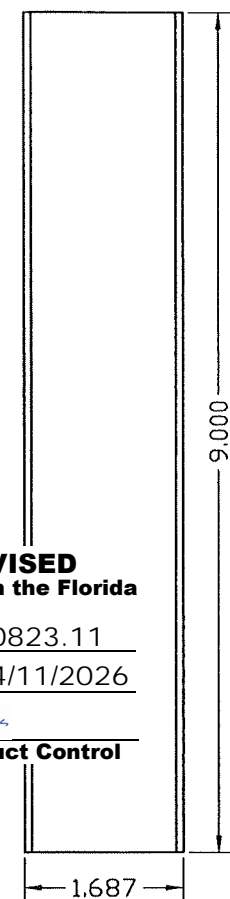


**VIEW X**

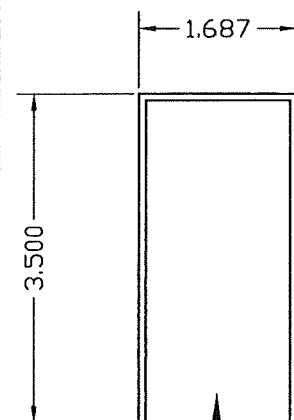


**PLAN**

MATERIAL:  
14 GAUGE (0.074) MINIMUM  
GALVANNEAL STEEL, GLUED TO  
DOOR AT HEAD & SILL USING  
HEMILBOND 8320-1 CONTACT  
ADHESIVE.

**(18) DOOR SURFACE  
BOLT REINFORCING  
DETAIL**

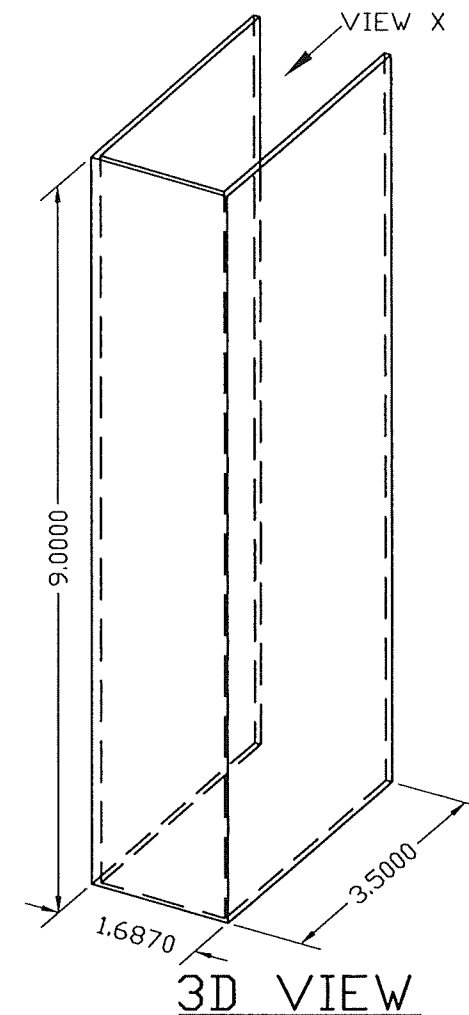


**3D VIEW**

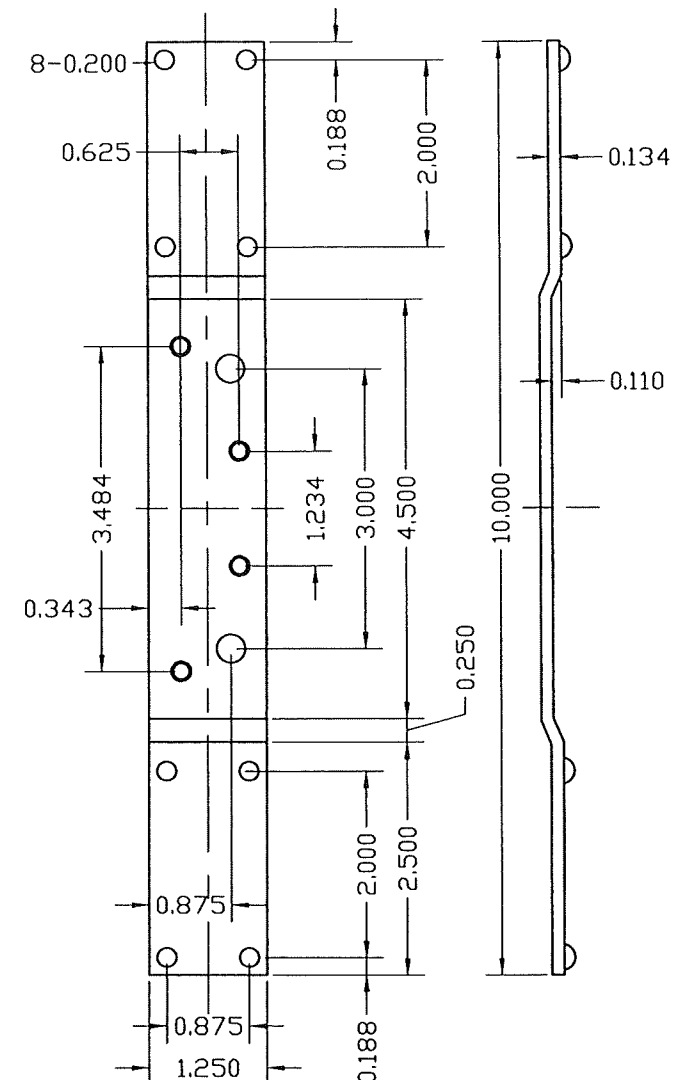

**(17) 4 1/2" HINGE BAR  
REINFORCING FOR DOOR**

MATERIAL:  
8 GAUGE  
GALVANNEAL STEEL

**(23) ANSI #A115.1 #86 MORTISE  
LOCK (12) /RIM PANIC (11) REINFORCING**

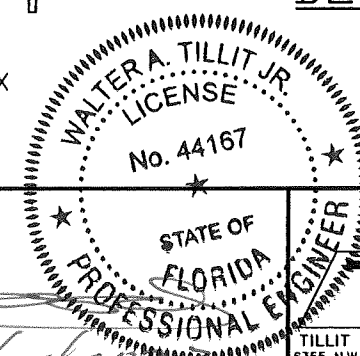

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.

**TILTECO INC.**

TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 • Fax : (305)871-1531  
e-mail: tilliteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

Y.M.  
DRAWN BY

8/9/2023  
DATE







**23-172**  
DRAWING No

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

SHEET 15 OF 19


MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE

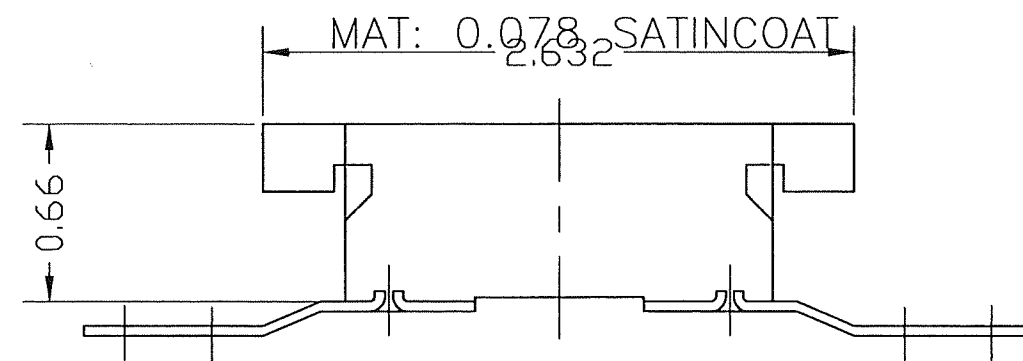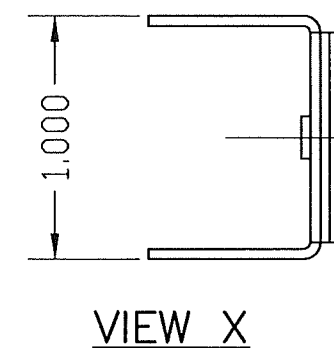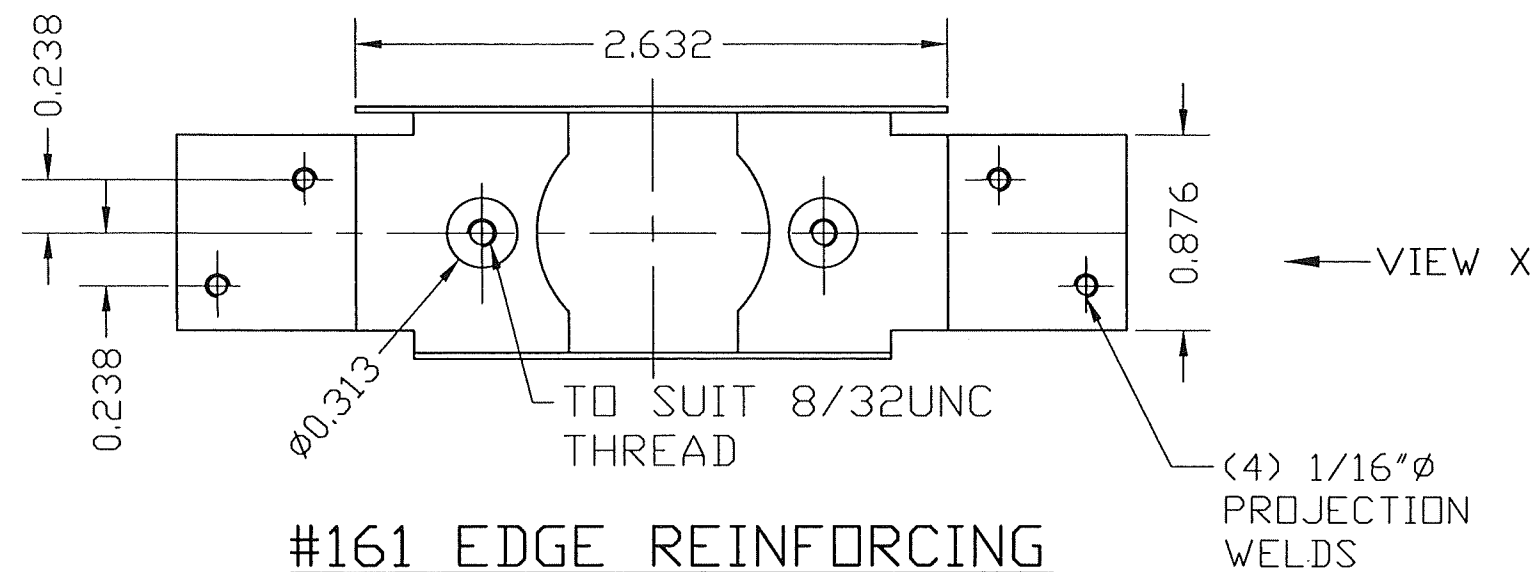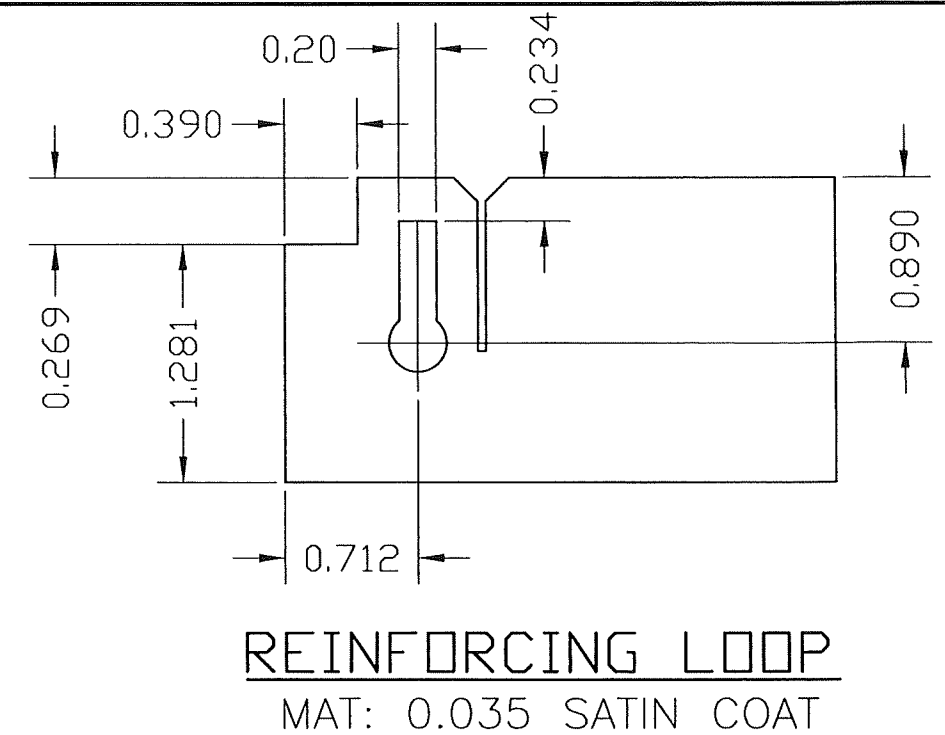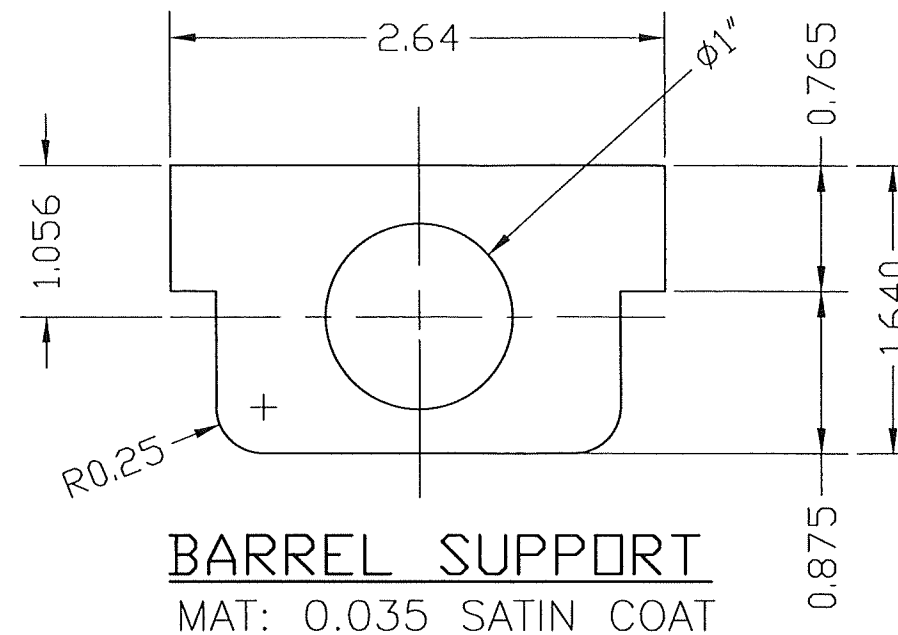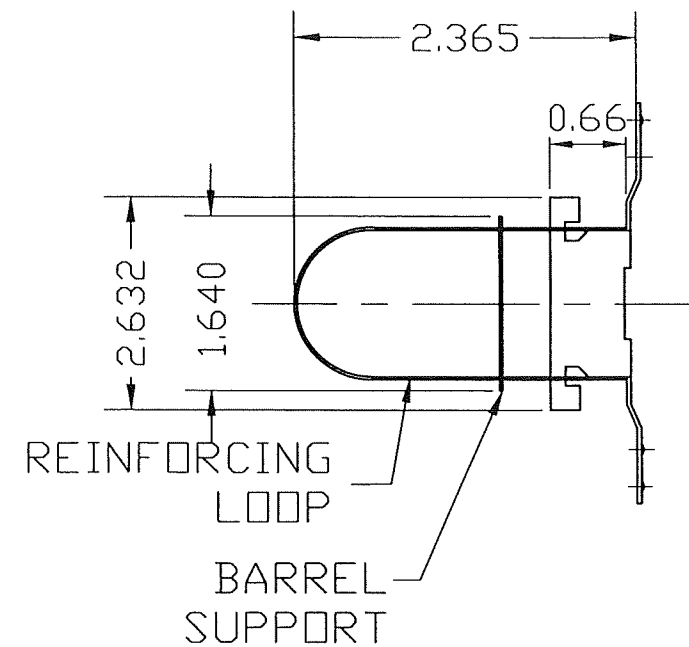

## (24) #161 CYLINDRICAL LOCK AND DEAD BOLT REINFORCEMENT DETAIL

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Ishag L. Chande*  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

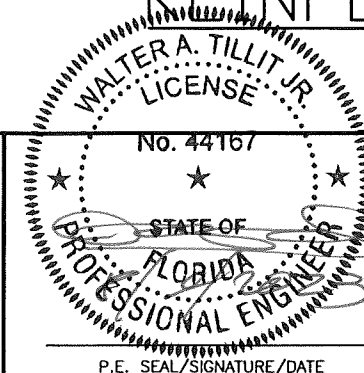

©2023 TILTECO, INC.  
**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 • Fax : (305)871-1531  
e-mail: tilteco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr., P.E.  
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**

50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204


Y.M.  
DRAWN BY

8/9/2023  
DATE


**23-172**  
DRAWING No

SHEET 16 OF 19


REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

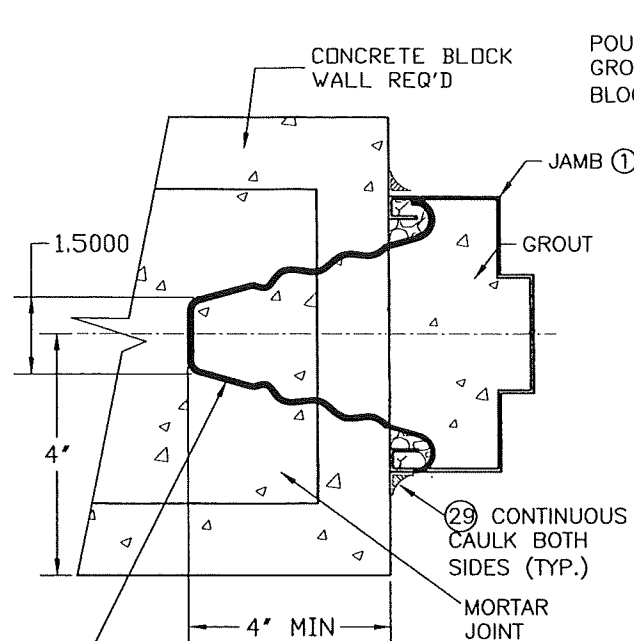


**DETAIL #21**  
**WIRE ANCHOR (6)**  
**INSTALLATION TO**  
**MASONRY WALLS**

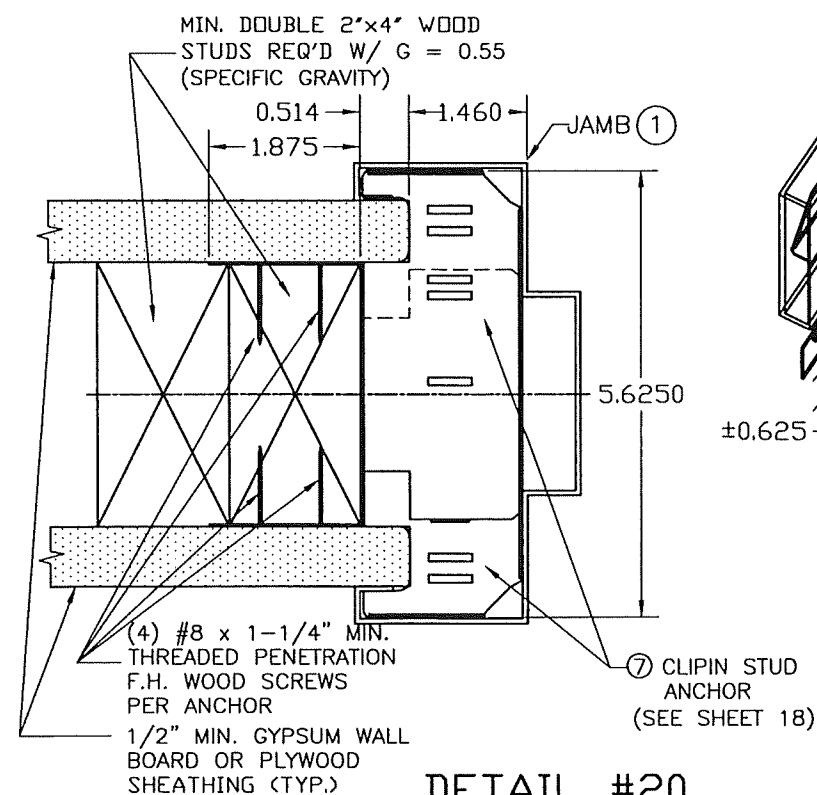


**DETAIL #20**  
**INSTALLATION OF 2 PIECE COMBINATION**  
**STUD ANCHOR (7) INTO WOOD FRAME WALLS**

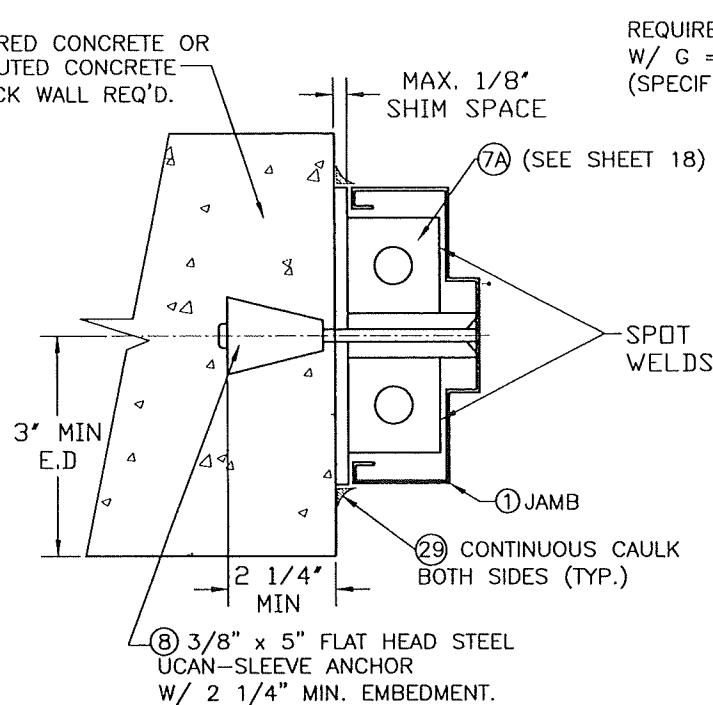


**DETAIL #22**  
**INSTALLATION OF UCAN**  
**SLEEVE ANCHORS (8) TO**  
**MASONRY WALLS**

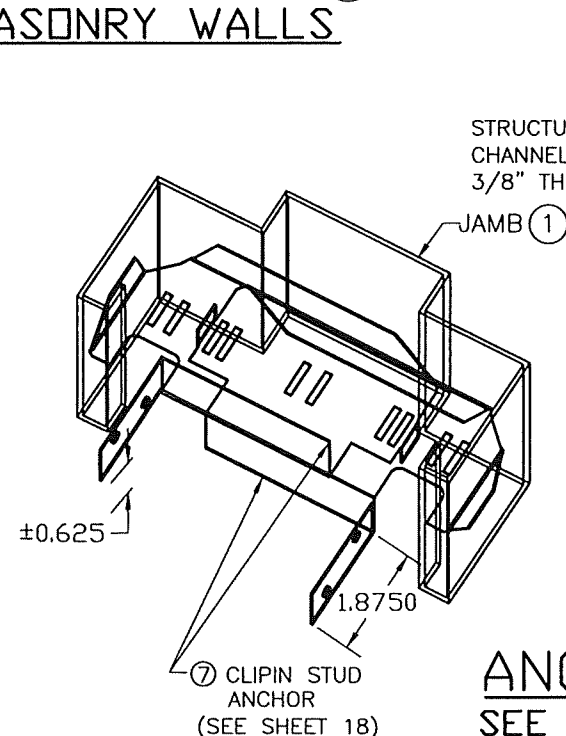


**DETAIL #23A**  
**INSTALLATION OF 3/8"**  
**F.H. M.S. (9B) TO STEEL CHANNEL**

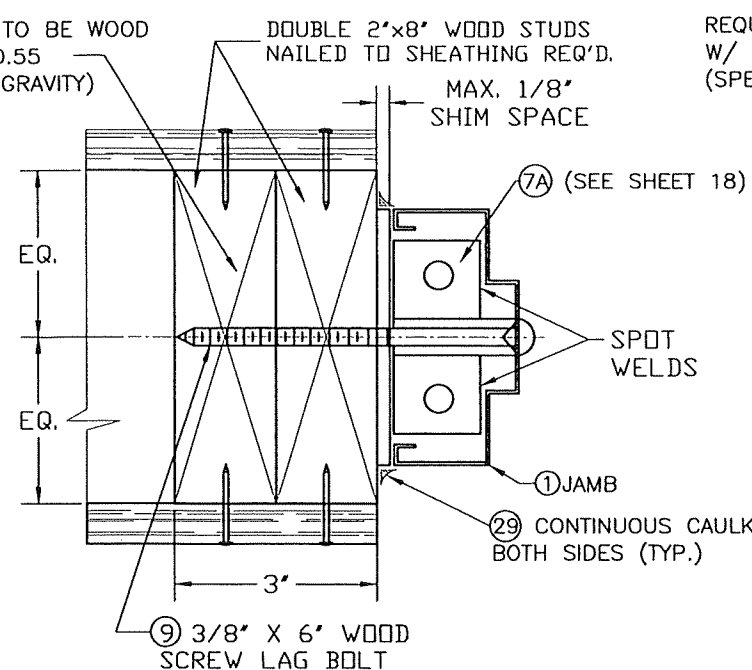

**DETAIL #22A**  
**INSTALLATION OF 3/8"Ø LAG**  
**SCREW (9) TO WOOD FRAME WALLS**

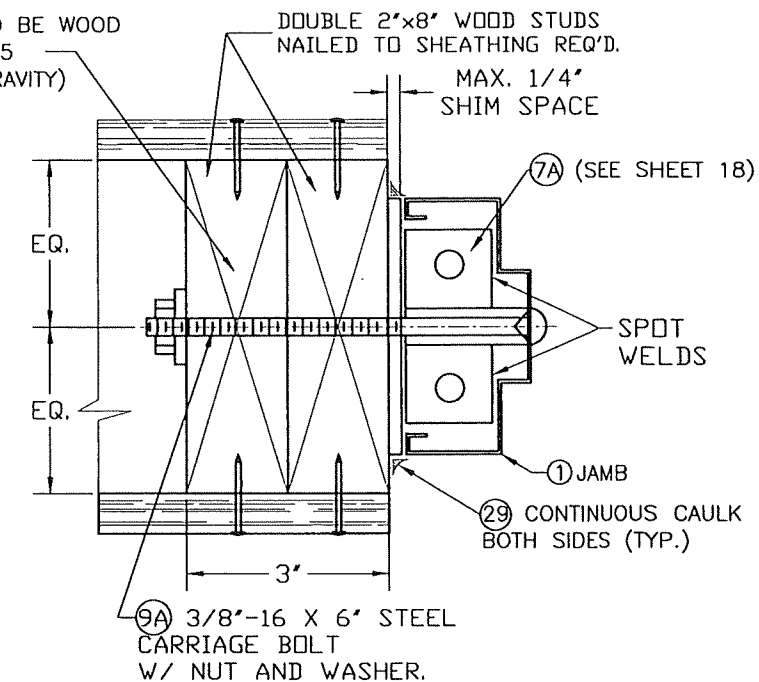

**DETAIL #22B**  
**INSTALLATION OF 3/8"Ø CARRIAGE**  
**BOLT (9A) TO WOOD FRAME WALLS**

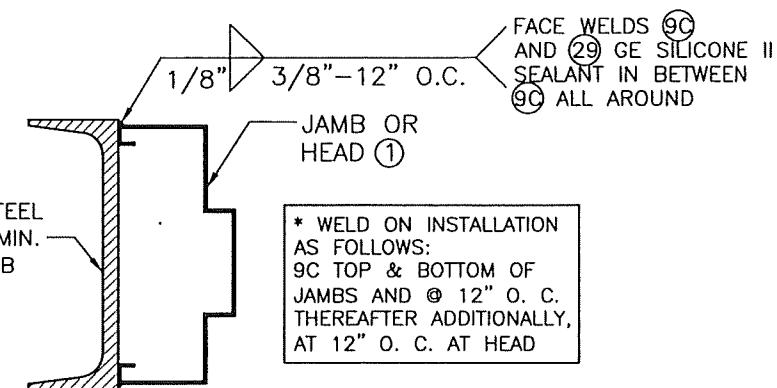

**DETAIL #23B**  
**INSTALLATION OF JAMB (1) TO**  
**STEEL CHANNEL THRU WELDING (9C)**

**ANCHOR DETAILS:**  
SEE SCHEDULE ON SHEET 18


**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Isaac L. Chanda*  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

WALTER A. TILLIT JR.  
No. 44167  
©2023 TILTECO, INC.  
**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
1100 W. 38th St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone: (305) 871-1530 • Fax: (305) 871-1531  
E-mail: tiltco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE STEEL FRAME LOUVERED ASSEMBLIES.						Y.M. DRAWN BY
<b>DAYBAR INDUSTRIES LTD</b> 50 WEST DRIVE, BRAMPTON, ON CANADA, L6T 2J4 TEL: 905 625-8000 FAX: 905 625-4204						8/9/2023 DATE
						<b>23-172</b> DRAWING No
REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE	
1	OLD 20-142	8/9/2023	3			
2			4			


SHEET 17 OF 19



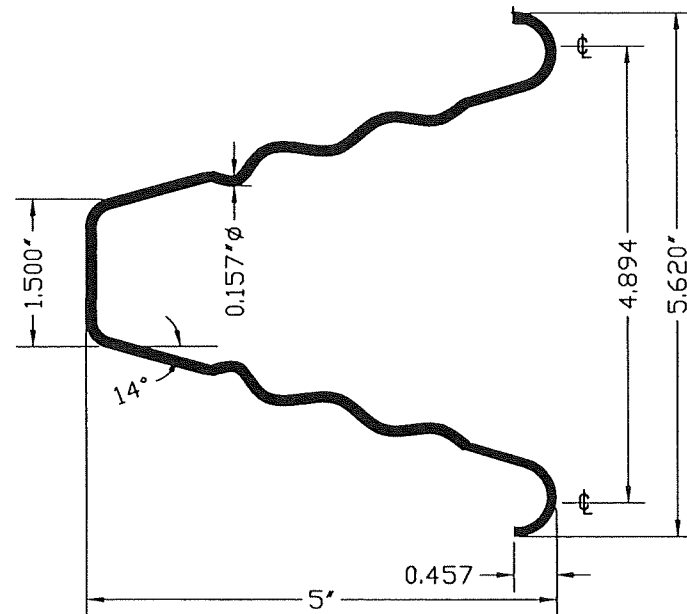


# ⑥ WIRE ANCHOR FOR DETAIL #21/17

STEEL WIRE ANCHORS  
(0.157" DIA, 9 1/2" LONG) IN HORIZ.  
Fu Min.=95.9 Ksi, Fy Min.=40.2 Ksi

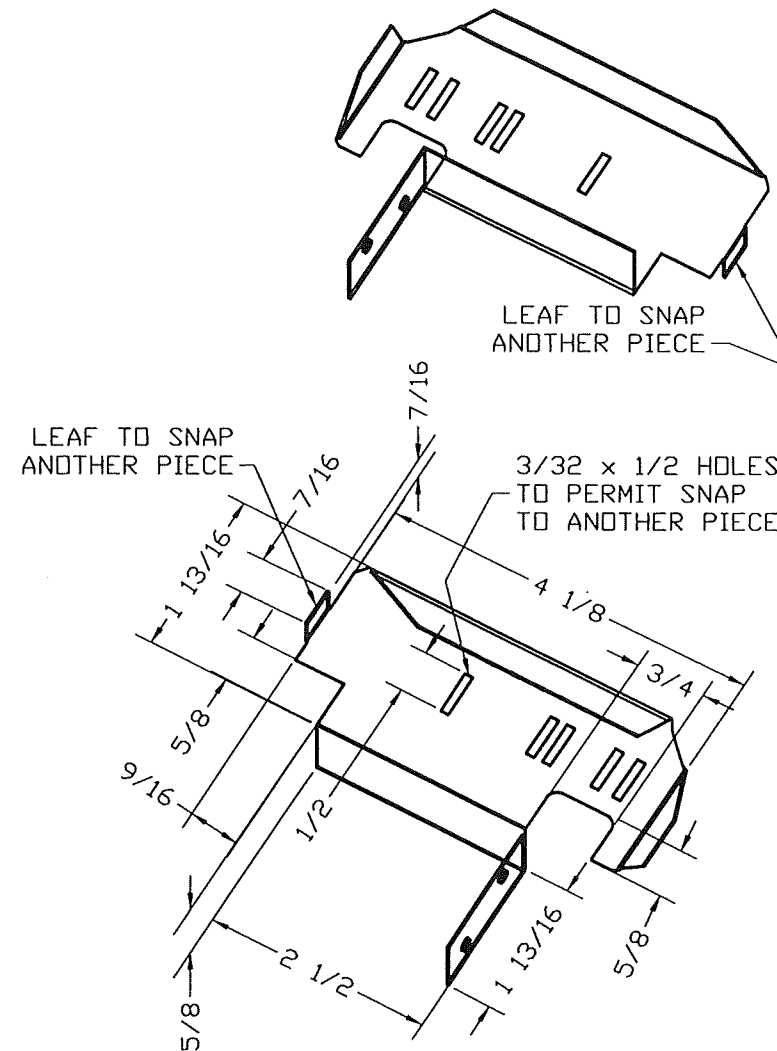


# ⑦ 2 PIECES COMBINATION STUD ANCHOR FOR DETAIL #20/17

CLIPIN STUD ANCHOR MATERIAL:  
GAUGE 20 (0.035) ASTM A-653,  
A-60 GALVANNEALED STEEL.

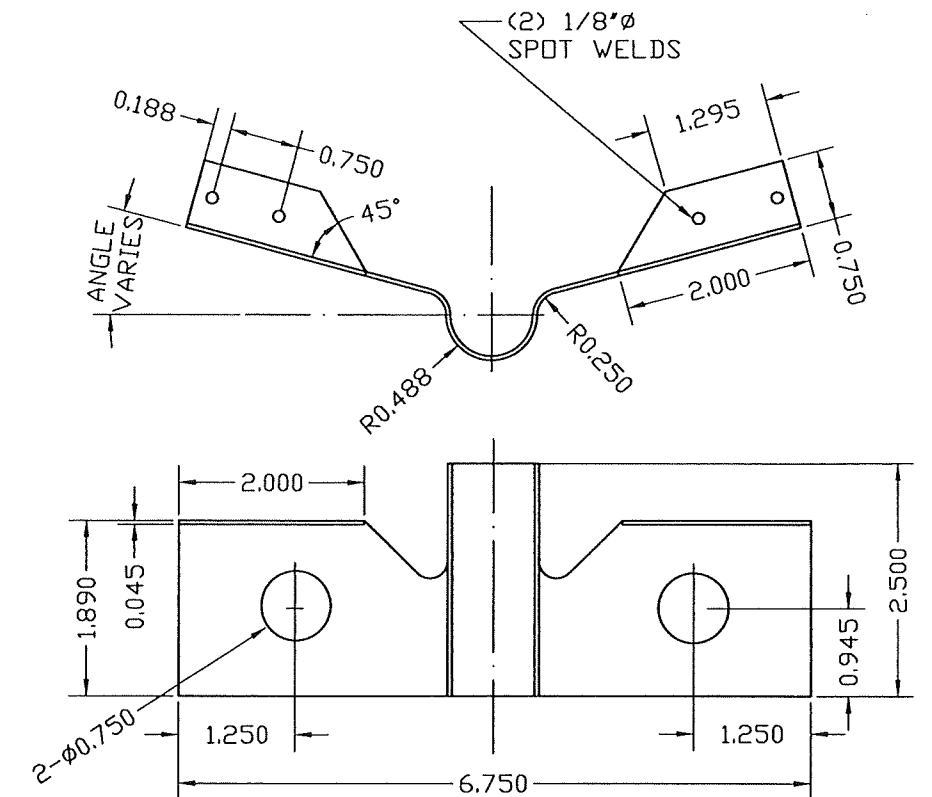

# ⑦A EMA BUTTERFLY ANCHOR (PART #PT1-008) FOR DETAILS 22/17, 22A/17, 22B/17 & 23A/17 MATERIAL: 18 GA SATIN COAT

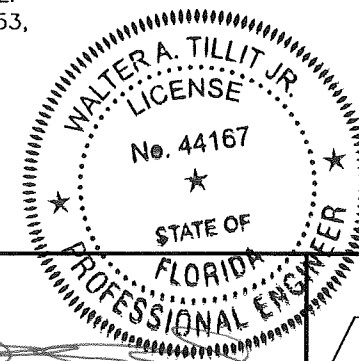

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By *Isang I. Chandra*  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

P.E. SEAL/SIGNATURE/DATE  
*8/9/2023*

©2023 TILTECO, INC.

**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 . Fax : (305)871-1531  
e-mail: [tillitco@aol.com](mailto:tillitco@aol.com)  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY

8/9/2023  
DATE


**23-172**  
DRAWING No

SHEET 18 OF 19

BILL OF MATERIALS:

ITEM	QTY	DESCRIPTION	MATERIAL	SIZE AND SPEC'S
1	1	16 GAUGE JAMB/ HEAD FRAME SERIES 'AS'	16 GAUGE .058 MINIMUM. ALL COMPONENTS OF THIS ITEM, I.e., HEAD, JAMBS, REINFORCEMENTS AND ANCHORS ARE COMMERCIAL GALVANIZED STEEL (TYPE B), ASTM A653/A653M, COATING DESIGNATION A40, KNOWN COMMERCIALLY AS PAINTABLE GALVANNEAL W/ MIN. TENSILE STRENGTH 52 KSI, MIN. YIELD STRENGTH 45 KSI, ELONGATION 40%.	5 3/4" DEPTH X 2" FACE X .058" MIN THICK (SEE SHEET 9)
1A	1	16 GAUGE OPTIONAL HEAD FRAME SERIES 'AS'	SAME AS ITEM 1	5 3/4" DEPTH X 4 3/8" FACE X .058" MIN THICK (SEE SHEET 9)
1B	1	SURFACE STRIKE REINFORCING	12 GAGE GALVANNEAL STEEL	12 GAGE (0.097" MIN.) x 1.500" x 11.875" LONG, SEE DETAIL ON SHEET 9.
2	1	18 GAUGE FLUSH/EMBOSSED DOOR COMMERCIAL W/ CORE (20)	18 GAUGE .045 MINIMUM. ALL COMPONENTS OF THIS ITEM, I.e., FACE SHEETS, INTERNAL COMPONENTS AND REINFORCEMENTS ARE GALVANIZED STEEL CONFORMING TO ASTM A924, TO ASTM A653/A653M, COMMERCIAL STEEL (TYPE B), COATING DESIGNATION A40, KNOWN COMMERCIALLY AS PAINTABLE GALVANNEAL W/TENSILE STRENGTH 60 KSI, AND YIELD STRENGTH 45 KSI, ELONGATION 40%.	1 3/4" THICK X (0.045 MIN), SEE SHEET 6.
3	3	8 GAUGE DOOR HINGE REINFORCING	STEEL	1 1/4" X 10" X 8 GAUGE
4	3	8 GAUGE FRAME HINGE REINFORCING	STEEL	1 1/2" X 8 3/4" X 8 GAUGE
5	1	STRIKE REINFORCING (FRAME)	STEEL	1 3/8" X 7 5/16" X 14 GAUGE (0.072 MIN)
6	AS REQ'D	WIRE MASONRY FRAME ANCHORS	STEEL W/ MIN. YIELD STRENGTH = 40.2KSI AND MIN. TENSILE STRENGTH = 95.9 KSI	9 1/2" LONG X 0.157" MIN. DIAMETER.
7	AS REQ'D	CLIPIN STUD ANCHORS (2 PIECE COMBINATION)	STEEL, ASTM A-653, A-60 GALVANNEAL	1 7/8" X 5 5/8" X 20 GAUGE (0.035 MIN) W/ (4)#8 X 1 5/8" WOOD SCREWS
7A	AS REQ'D	EMA BUTTERFLY ANCHOR (PART #PT1-008)	STEEL	18 GAUGE STEEL SATIN COAT.
8	AS REQ'D	EMA ANCHOR BOLTS	STEEL, W/ Fy = 45,000 psi.	3/8" X 5" STEEL UCAN-SLEEVE ANCHOR
9	AS REQ'D	WOOD SCREW LAG BOLT	STEEL, W/ Fy = 45,000 psi.	3/8" x 6"
9A	AS REQ'D	CARRIAGE ANCHOR BOLT	STEEL, W/ Fy = 45,000 psi.	3/8"-16 X 6" STEEL CARRIAGE BOLT C/W NUT AND WASHER, PER ASTM A-307
9B	AS REQ'D	F.H. M.S. TO STEEL CHANNEL THROUGH BOLTING	STEEL, W/ Fy = 45,000 psi.	3/8" X 3 1/2" STEEL F.H. M.S., PER ASTM A-307
9C	AS REQ'D	STEEL CHANNEL WELDING	STEEL, E60XX ELECTRODE	WELD ON INSTALLATION, MIN. 1/8"x3/8" STITCH WELD
10	3	HINGES-HAGER BB1279, BB1168HD OR STANLEY FBB179, FBB168	STEEL	4.5" X 4.5" STANDARD WEIGHT (134 THICK), ATTACHED TO FRAME W/(4) 12-24x1/2" FHMS.
11	1	RIM EXIT: VON DUPRIN 98/99L X CYC X TRIM	AS PER MANUFACTURER'S CATALOG	RIM EXIT ATTACHED TO DOOR W/(4) 1/4-20x1" MS.
12	1	MORTISE LOCK: SCHLAGE-L9000 SERIES W/ DEAD BOLT	AS PER MANUFACTURER'S CATALOG	MORTISE LOCK ATTACHED W/(2) #12-24x1/2" SREWS.
13	1	CYLINDRICAL LOCK: - SCHLAGE D SERIES	AS PER MANUFACTURER'S CATALOG	ATTACHED TO STRIKE PLATE W/(2) 12-24x1/2" SCREWS.
14	1	DEAD BOLT: - SCHLAGE B SERIES	AS PER MANUFACTURER'S CATALOG	ATTACHED TO STRIKE PLATE W/(2) 8-32x1/2" SCREWS
15	1	VON DUPRIN #9954 REMOVABLE MULLION	0.125" THICK A 500 GRADE B STEEL	SECURED TO 499 STRIKE PLATE WITH (8) 5/16"-18x3/4"(MIN.) MACHINE SCREWS.
15A	1	WEATHER STRIP (NATIONAL GUARD PRODUCTS #120NA)	NEOPRENE	SECURED WITH DOUBLE ROW OF #6x1/2" SMS SCREWS @ 1' FROM EACH END AND 4" O.C. (AS PREDRILLED BY MANUFACTURER)
16	1	THRESHOLD (NATIONAL GUARD PRODUCTS #950NA)	EXTRUDED ALUMINUM (6063-T5 ALLOY)	5" x 0.500" x 0.080" THICK, ATTACHED TO SLAB W/ 3/16"x 1 3/4" F. H. TAPCON ANCHORS W/ 1 1/4" MIN. EMBEDMENT LOCATED @ 2 3/4" FROM EACH END AND 10" O. C.
17	1	4 1/2" HINGE BAR REINFORCING FOR DOOR	GALVANNEAL STEEL	1.25" x 10" x 0.134" MIN. THICK
18	1	DOOR SURFACE BOLT REINFORCING	GALVANNEAL STEEL	14 GAGE (0.074") x 1.687" x 3.500" x 9.000" LONG.
19B	AS REQ'D	MODEL 1500-A LOUVER & SECURITY GRILLE	AS PER MANUFACTURER (AIR LOUVERS, INC.)	24" x 24" (MAX.), SEE SHEET 8 FOR DETAILS & COMPONENTS.
20	1	0.75" THICK EXPANDED POLYSTYRENE DOOR CORE OR 3/4" CELL PAPER HONEYCOMB.	0.75" THICK DOOR CORE: EXPANDED POLYSTYRENE SOLID SLAB RIGID BOARD TYPE 1. PCF CONFORMING TO ASTM C578 BY DYPLAST PRODUCTS LLC, OR 3/4" CELL PAPER HONEYCOMB.	BONDED TO FACE SHEET WITH CONTACT ADHESIVE HELMIBOND # 8320-1 APPLICATION RATE OF 7 GRAMS PER SQUARE FOOT ON ALL CORES
21	4	8' LONG # 275 D HAGER SURFACE BOLT	STEEL W/ US26D FINISH	ENGAGED TO THE DOOR AT TOP AND BOTTOM TO HEADER & THRESHOLD RESPECTIVELY & FASTENED TO DOOR W/ (4) #10-24 x 1 1/2" THRU BOLT EACH CONNECTION.
22	AS REQ'D	TAPCON ANCHORS	STEEL	3/16" x 1 3/4"
23	1	MORTISE LOCK AND RIM PANIC DEVICE REINFORCEMENT	0.074" MIN. THICK GALVANNEAL STEEL	SEE SHEET 15 FOR SUBCONJUNTS
24	1	#161 CYLINDRICAL LOCK AND DEAD BOLT REINFORCEMENT	SATIN COAT STEEL	SEE SHEET 16 FOR DETAILS
25	1	DOOR SURFACE CLOSER REINFORCEMENT	0.074" MIN. THICK GALVANNEAL STEEL	14 GAGE (0.074" MIN.) x 3 1/2" x 1.6875 x 16.250" LONG.
26	1	DOOR TOP/ BOTTOM END CHANNEL	16 GAGE GALVANNEAL STEEL	16 GAGE (0.057" MIN.) x 1.8125" x 1.4375.
27	1	'Z' ASTRAGAL	0.075" MIN. THICK A 500 GRADE B STEEL	0.075" MIN. THICK x 2.00" x (2)0.625" x 84" LONG.
28	1	DOOR SNAP IN TOP CAP	20 GAGE GALVANNEAL STEEL ASTM A-653, A-60	SEE SHEET 14 FOR SIZES
29	AS REQ'D	CAULKING: GE SILICONE II	N/A	
30	AS REQ'D	995 DDW CORNING STRUCTURAL SILICONE	N/A	

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-0823.11  
Expiration Date 04/11/2026  
By Ishag I. Chank  
Miami-Dade Product Control  
MIAMI-DADE COUNTY

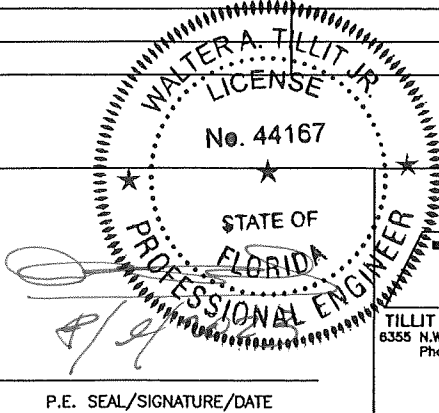

FLORIDA BUILDING CODE (HIGH VELOCITY HURRICANE ZONE)

©2023 TILTECO, INC.  
**TILTECO INC.**  
TILLIT TESTING & ENGINEERING COMPANY  
6355 N.W. 36th. St., Ste. 305, VIRGINIA GARDENS, FL 33166  
Phone : (305)871-1530 . Fax : (305)871-1531  
e-mail: tiltco@aol.com  
CA-0006719  
WALTER A. TILLIT Jr. P.E.  
FLORIDA Lic. # 44167

DOUBLE & SINGLE SERIES LS18 OUTSWING  
COMMERCIAL STEEL DOOR W/SERIES "AS" 16 GAGE  
STEEL FRAME LOUVERED ASSEMBLIES.

**DAYBAR INDUSTRIES LTD**  
50 WEST DRIVE, BRAMPTON,  
ON CANADA, L6T 2J4  
TEL: 905 625-8000  
FAX: 905 625-4204

REV. No	DESCRIPTION	DATE	REV. No	DESCRIPTION	DATE
1	OLD 20-142	8/9/2023	3		
2			4		

Y.M.  
DRAWN BY

8/9/2023  
DATE

23-172  
DRAWING No

SHEET 19 OF 19