



MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

Amarr Garage Doors dba Entrematic
165 Carriage Court
Winston Salem, NC 27105

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Models 2400 (I/S) & 2000 (I/S) Steel Sectional Garage Doors up to 9'-2" Wide – L.M.I.

APPROVAL DOCUMENT: Drawing No. **IRC-2409-177-21-I**, titled "Commercial Models 2400 (I/S) (24 GA), 2000 (I/S) (20 GA), Flush and Ribbed Panels", sheets 1 through 3 of 3, dated 07/29/2008, with revision A dated 11/29/2011, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 07/31/2023, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews and revises NOA No. 20-1015.30** and consists of this page 1 and evidence page E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



01/11/24

NOA No. 23-0828.04
Expiration Date: November 20, 2028
Approval Date: January 18, 2024
Page 1

Amarr Garage Doors dba Entrematic

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS “Submitted under NOA No. 12-0228.10”

1. Drawing No. **IRC-2409-177-21-I**, titled “Commercial Models 2400 (I/S) (24 GA), 2000 (I/S) (20 GA), Flush and Ribbed Panels”, sheets 1 through 3 of 3, dated 07/29/08, with revision A dated 11/29/11, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E.

B. TESTS “Submitted under NOA No. 12-0228.10”

1. Test report on Evaluation of Painted or Coated Specimens Subjected to Corrosive Environments per ASTM D1654 & ASTM B117, prepared by Architectural Testing, Inc., Test Report No. **A7420.01-106-18**, dated 04/12/11, signed and sealed by Joseph A. Reed, P.E.

“Submitted under NOA No. 08-1003.08”

2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test per FBC, TAS 202-94
5) Tensile Test per ASTM E8

along with marked-up drawings and installation diagram of Amarr 9'-2"x 8' 24 ga steel garage door Model 2400, prepared by American Test Lab, Inc, Test Report No. **ATLNC 0721.01-08**, dated 08/06/08, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS “Submitted under NOA No. 12-0228.10”

1. Anchor calculations prepared by Structural Solutions, P.A., dated 02/09/12, signed and sealed by Thomas L. Shelmerdine, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Test report on Surface Burning Characteristics on the expanded polystyrene UL file # R11812.

F. STATEMENTS “Submitted under NOA No. 18-0725.01”

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)** and of no financial interest, dated 09/11/17, issued by Structural Solutions, PA., signed and sealed by Tomas L. Shelmerdine, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 23-0828.04
Expiration Date: November 20, 2028
Approval Date: January 18, 2024

Amarr Garage Doors dba Entrematic

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER NOA # 20-1015.30 AND NEW

A. DRAWINGS

1. Drawing No. **IRC-2409-177-21-I**, titled “Commercial Models 2400 (I/S) (24 GA), 2000 (I/S) (20 GA), Flush and Ribbed Panels”, sheets 1 through 3 of 3, dated 07/29/2008, with revision A dated 11/29/2011, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 07/31/2023.

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of Amarr 9’-2”x 8’ 24 ga steel garage door Model 2400, prepared by American Test Lab, Inc, Test Report No. **ATLNC 0710.01-23**, dated 08/03/2023, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and of no financial interest, dated 11/07/2023, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.
2. Statement letter of conformance, complying with **FBC 7th Edition (2020)** and of no financial interest, dated August 27, 2020, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 23-0828.04
Expiration Date: November 20, 2028
Approval Date: January 18, 2024

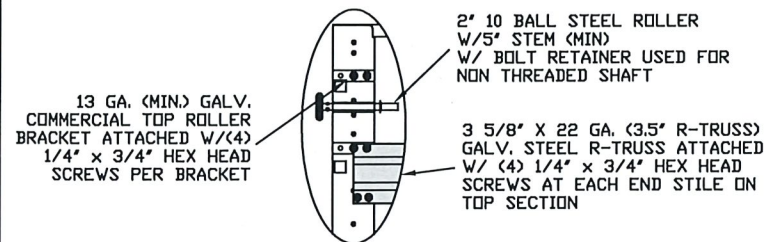

TYPICAL TOP FIXTURE
N.T.S.


1

3 5/8" X 22 GA. (3.5" R-TRUSS)
GALV. STEEL R-TRUSS ATTACHED
W/ (2) 1/4" X 3/4" HEX HEAD
SCREWS AT EACH CENTER STILE




TYPICAL CENTER HINGE
N.T.S.

2

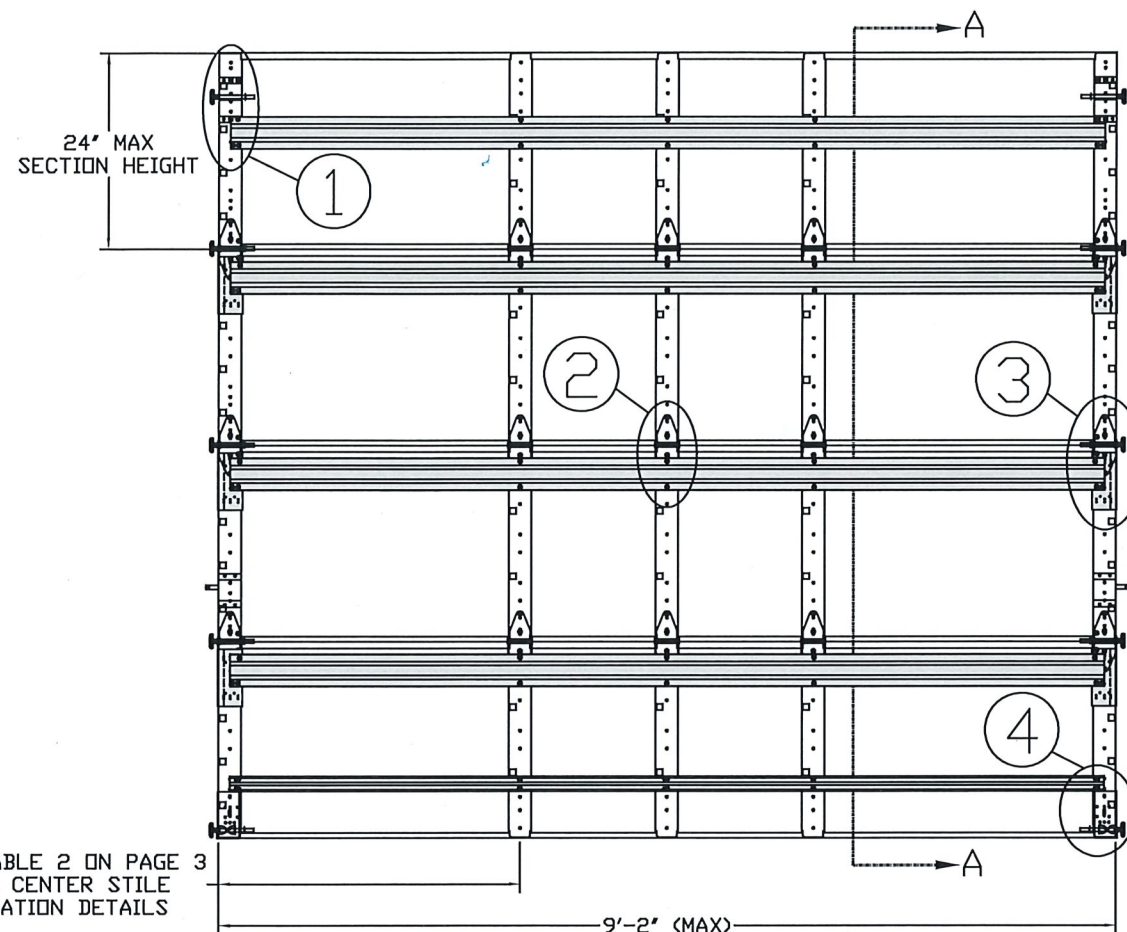

INSIDE ELEVATION
N.T.S.


SEE TABLE 2 ON PAGE 3
FOR CENTER STILE
LOCATION DETAILS

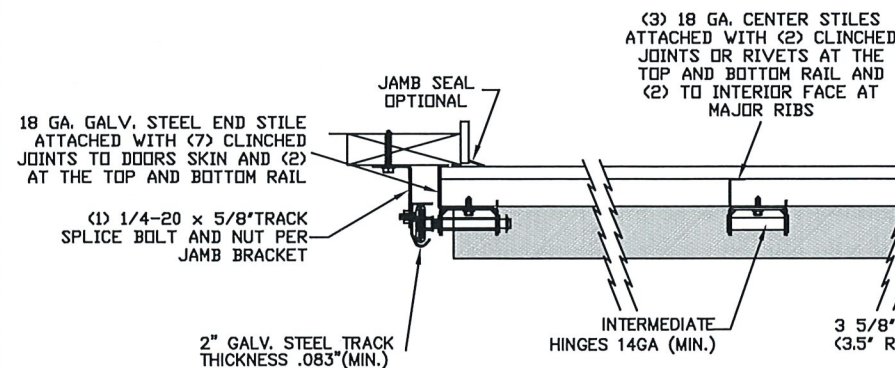

TRACK MOUNTING DETAIL
N.T.S.

24 GA. (.022\"/>

SECTION A-A (SIDE VIEW)

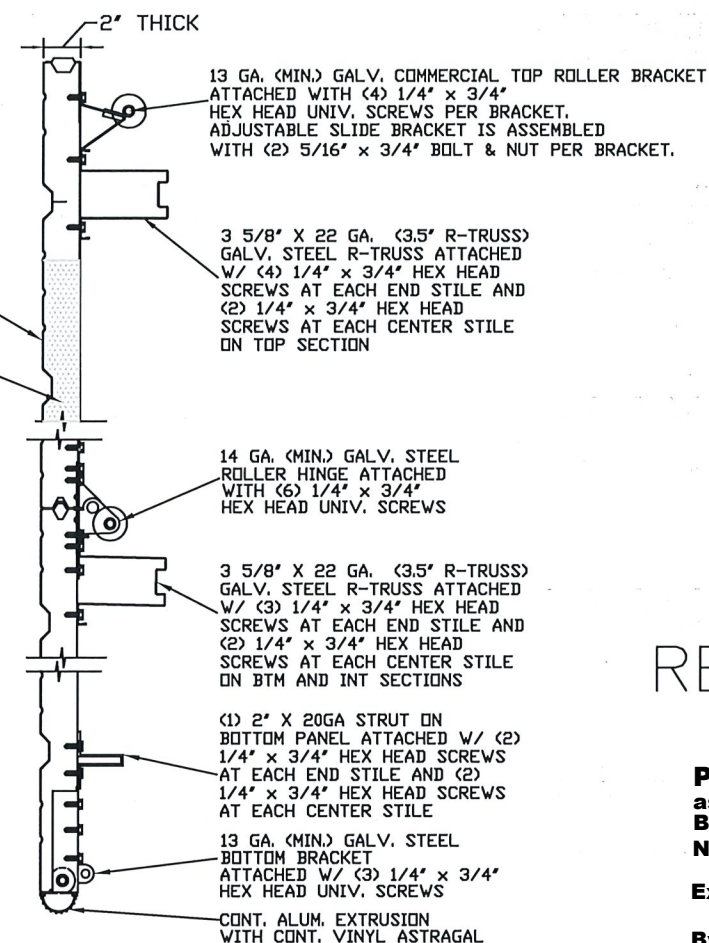

SLIDE LOCK ENGAGES
VERTICAL TRACK ON EACH SIDE
(SNAP LATCH, OR LOCK BAR OPTIONAL)
ATTACH W/ (2) 1/4\"/>

2\"/>

3 5/8\"/>

TYPICAL END HINGE
N.T.S.

14 GA. (MIN.)
END HINGE ROLLER
CARRIERS ATTACHED
W/ (6) TOTAL 1/4\"/>

7\"/>

3

2\"/>

2\"/>

BOTTOM BRACKET
13 GA. (MIN.) ATTACHED
W/ (3) 1/4\"/>

TYPICAL BOTTOM BRACKET
N.T.S.

4

LARGE MISSILE IMPACT RESISTANCE

PRODUCT REVISED
as complying with the Florida
Building Code


NOA-No. 23-0828.04

Expiration Date 11/20/2028

By *[Signature]*
Miami-Dade Product Control

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	UPDATED TO FBC 2010	11/29/11	RLR
<div> <div>MAX. SIZE WIDTH 9'2" HEIGHT 24'1"</div> <div>DESIGN LOADS +50.0 PSF -62.0 PSF</div> <div>LARGE MISSILE IMPACT RESISTANCE</div> </div>			
<div> <div> <div>THOMAS L. SHELMERDINE</div> <div>LICENSE</div> <div>No. 48579</div> <div>9.31.23</div> <div>STATE OF FLORIDA</div> <div>PROFESSIONAL ENGINEER</div> </div> <div>FL</div> </div>			
<div> <div>Amarr</div> <div>ENTREMATICS</div> </div>			
<div> <div>MODEL 2400 AMARR 2402, 2412, 2422</div> <div>MODEL 2000 AMARR 2002, 2012, 2022</div> </div>			
SIZE	DRAWN BY SKW	DATE 07/29/08	DRAWING NUMBER
B	CHECKED BY SKW	DATE 07/29/08	IRC-2409-177-21-I
ENTREMATICS 165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105			SHEET 1 OF 3


TRACK CONNECTION DIRECTLY TO STRUCTURE OPTIONS

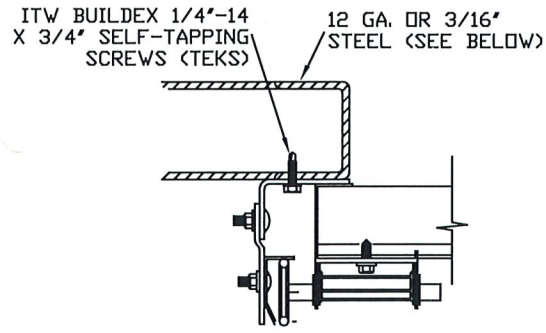

CLIP STYLE REVERSE ANGLE MOUNT SHOWN
BRACKET, CONTINUOUS AND TAPERED ANGLE
MOUNT AVAILABLE


12 GA. STEEL FRAMING
232 LBS./SCREW ALLOWABLE LOAD - 3'
FROM ENDS AND 12' O.C.
REFER TO NOTES 1, 2 AND 5

3/16" STEEL FRAMING
569 LBS./SCREW ALLOWABLE LOAD - 6'
FROM ENDS AND 24' O.C.
REFER TO NOTES 1, 2 AND 5

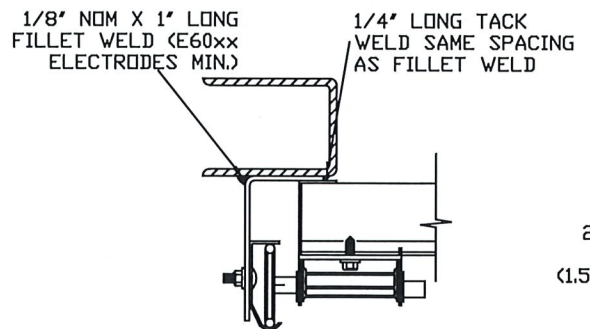


REVERSE ANGLE MOUNT SHOWN
BRACKET, CONTINUOUS AND
TAPERED ANGLE MOUNT AVAILABLE

STEEL FRAMING 12GA OR BETTER
1590 LBS./IN. ALLOWABLE LOAD -
6' FROM ENDS AND 24' O.C.
REFER TO NOTES 1, 2, 5, 6, 7, 8
AND 9

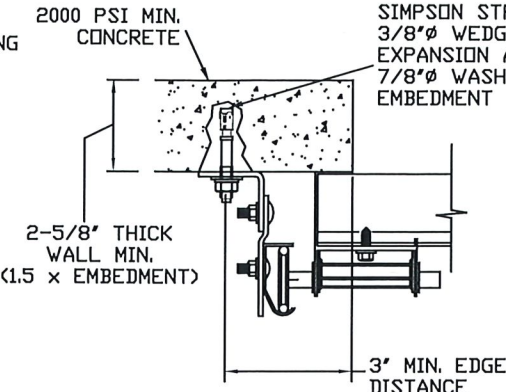

CLIP STYLE CONTINUOUS ANGLE MOUNT SHOWN
BRACKET, REVERSE AND TAPERED ANGLE MOUNT
AVAILABLE

2000 PSI CONCRETE OR GREATER
351 LBS./EXPANSION ANCHOR ALLOWABLE LOAD -
6' FROM ENDS AND 18' O.C.
REFER TO NOTES 1, 2, 3, 4 AND 5

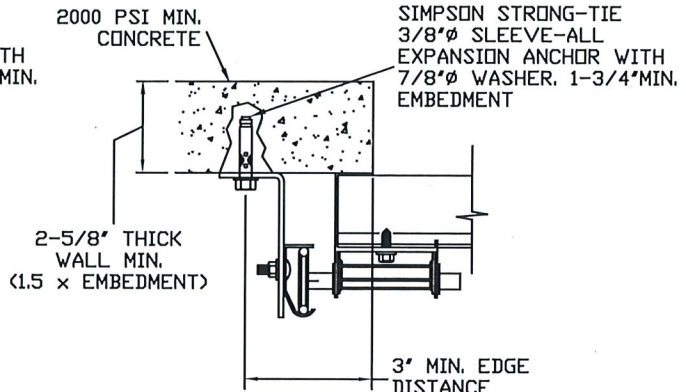


CONTINUOUS ANGLE MOUNT SHOWN
BRACKET, CONTINUOUS AND TAPERED ANGLE
MOUNT AVAILABLE

2000 PSI CONCRETE OR GREATER
336 LBS./EXPANSION ANCHOR ALLOWABLE
LOAD - 6' FROM ENDS AND 16' O.C.
REFER TO NOTES 1, 2, 3, 4 AND 5


- NOTES:
1. ANCHORS TO BE EVENLY SPACED BETWEEN THE HEADER AND FLOOR.
 2. FIRST (BOTTOM) ANCHOR STARTING AT NO MORE THAN HALF OF THE MAXIMUM ON-CENTER DISTANCE. HIGHEST ANCHOR INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING.
 3. MIN. EDGE DISTANCE OF 3" REQUIRED.
 4. USE WASHERS PROVIDED BY THE ANCHOR MANUFACTURER.
 5. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS IN ADDITION TO OTHER LOADS.
 6. MOST GARAGE DOOR TRACK IS GALVANIZED STEEL. USE ALL NECESSARY PRECAUTIONS WHEN WELDING GALVANIZED STEEL.
 7. ALL WELDS SHOULD BE PERFORMED BY A CERTIFIED WELDER OR INSPECTED BY A CERTIFIED WELDING INSPECTOR TO VERIFY THE INTEGRITY OF THE WELD.
 8. FILLET WELDS TO HAVE A STRAIGHT OR CONVEX FACE SURFACE.
 9. TACK WELD TOE OF ANGLE AT SAME SPACING TO PREVENT ROTATION OF TRACK ANGLE.

TABLE 1

DOOR HEIGHT	TRACK ATTACHMENT																				SPLICE S
	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	
7'	3.5"	10"	22"	34"	46"	58"															76"
8'	3.5"	10"	22"	34"	46"	58"	70"														88"
9'	3.5"	10"	22"	34"	46"	58"	70"	82"													100"
10'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"												112"
11'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"											124"
12'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"										136"
13'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"									148"
14'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"								160"
15'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"							172"
16'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"						184"
17'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"					196"
18'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"				208"
19'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"	202"			220"
20'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"	202"	214"		232"
21'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"	202"	214"	226"	244"
22'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"	202"	214"	226"	256"
23'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"	202"	214"	226"	268"
24'	3.5"	10"	22"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"	166"	178"	190"	202"	214"	226"	280"

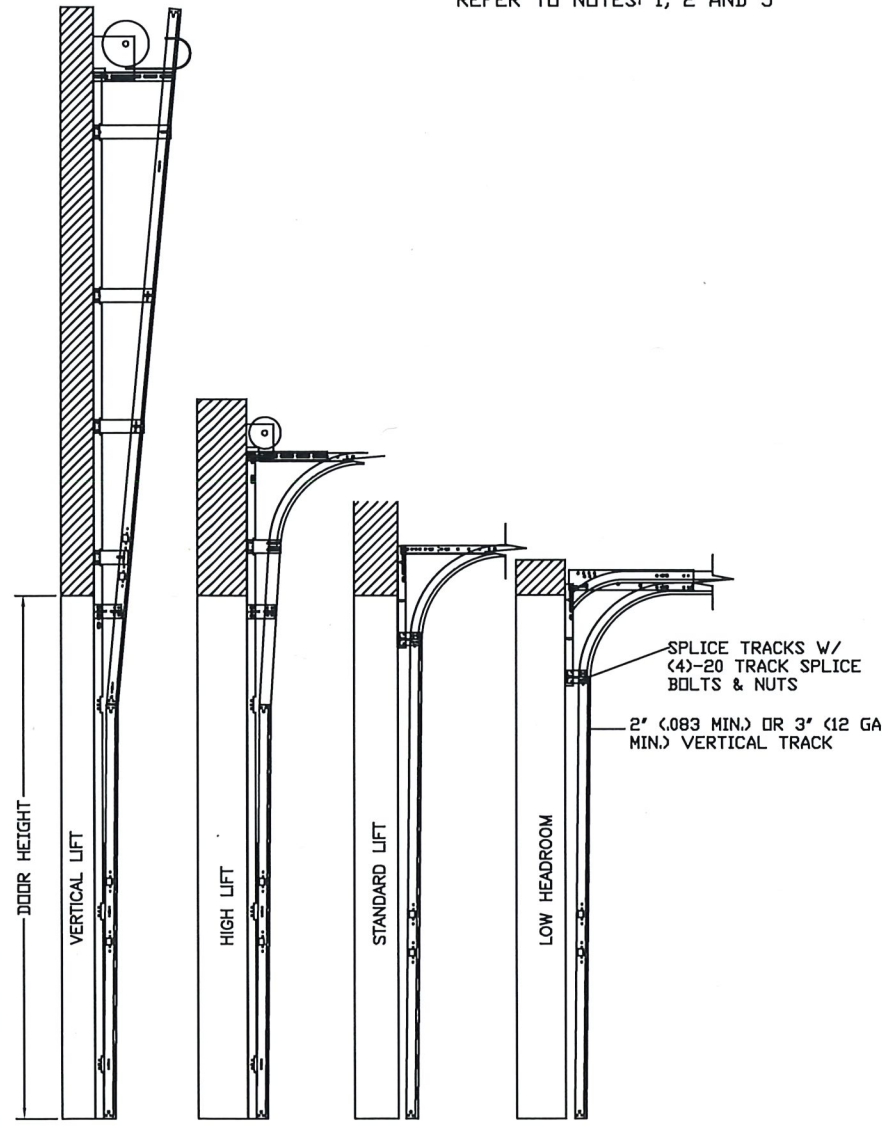

AVAILABLE TRACK CONFIGURATIONS
N.T.S.

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-0828.04
Expiration Date 11/20/2028
By 
Miami-Dade Product Control

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	UPDATED TO FBC 2010	11/29/11	RLR

MAX SIZE
WIDTH 9'2"
HEIGHT 24'1"

DESIGN LOADS
+50.0 PSF
-62.0 PSF

LARGE MISSILE
IMPACT
RESISTANCE

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #29412)

THOMAS L. SHELMERDINE
LICENSE
No. 48579
7.31.25
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
FL

dba Structural Solutions of North Carolina, Inc.
5921-G W. Friendly Ave., Greensboro, NC 27410

Amarr
ENTRE/MATIC

MODEL 2400 AMARR 2402, 2412, 2422
MODEL 2000 AMARR 2002, 2012, 2022


SIZE	DRAWN BY	SKW	DATE	07/29/08	DRAWING NUMBER
B	CHECKED BY	SKW	DATE	07/29/08	IRC-2409-177-21-I

ENTRE/MATIC
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

SHEET 2 OF 3


SPECIFICATIONS AND NOTES

1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF: +229.1 LBS/FT & -284.1 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. (.022) MIN. EXTERIOR SKIN ROLLED FORMED, W/ BAKED ON POLYESTER FINISH
5. DOORS UP TO 24'0" HIGH USE (1) 3 5/8" R-TRUSS PER SECTION AND (1) 2" 20GA STRUT ON BOTTOM SECTION
6. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.
8. THIS APPROVAL REQUIRES THE MANUFACTURER TO DO TESTING OF ALL COILS USED TO FABRICATE DOOR PANELS UNDER THIS NOTICE OF ACCEPTANCE. A MINIMUM OF 2 SPECIMENS SHALL BE CUT FROM EACH COIL AND TENSILE TESTED ACCORDING TO ASTM E-8 BY A DADE COUNTY APPROVED LAB SELECTED AND PAID BY THE MANUFACTURER. EVERY 3 MONTHS, 4 TIMES A YEAR, THE MANUFACTURER SHALL MAIL TO THIS OFFICE: A COPY OF THE TEST REPORTS WITH CONFIRMATION THAT THE SPECIMENS WERE SELECTED FROM COILS AT THE MANUFACTURER PRODUCTION FACILITIES. AND A NOTARIZED STATEMENT FROM THE MANUFACTURER THAT ONLY COILS WITH YIELD STRENGTH OF 34,600 PSI OR MORE SHALL BE USED TO MAKE DOOR PANELS FOR DADE COUNTY UNDER THIS NOTICE OF ACCEPTANCE.

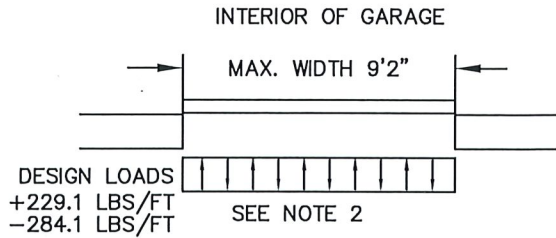


TRACK CONNECTION TO WOOD JAMB OPTIONS

FOR LAG SCREWS & BRACKET SPACING SEE TABLE 1

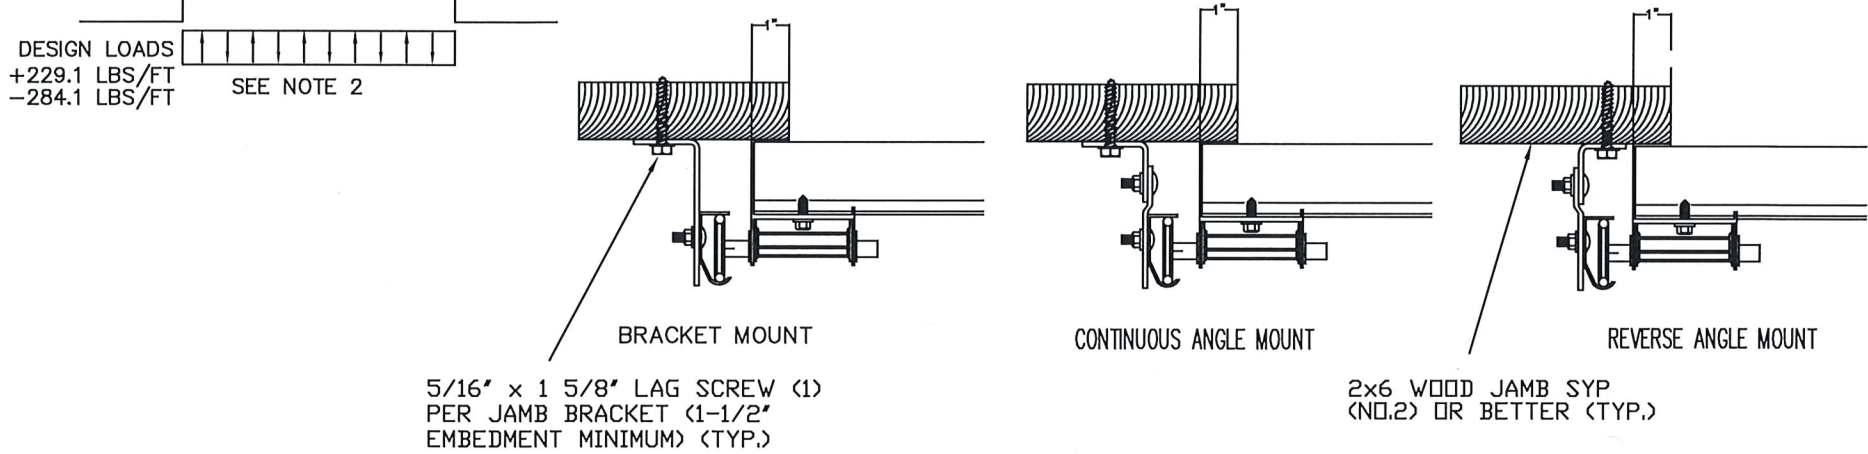

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-0828.04
Expiration Date 11/20/2028
By *[Signature]*
Miami-Dade Product Control

WOOD JAMB ATTACHMENT TO STRUCTURE (OPTIONAL)

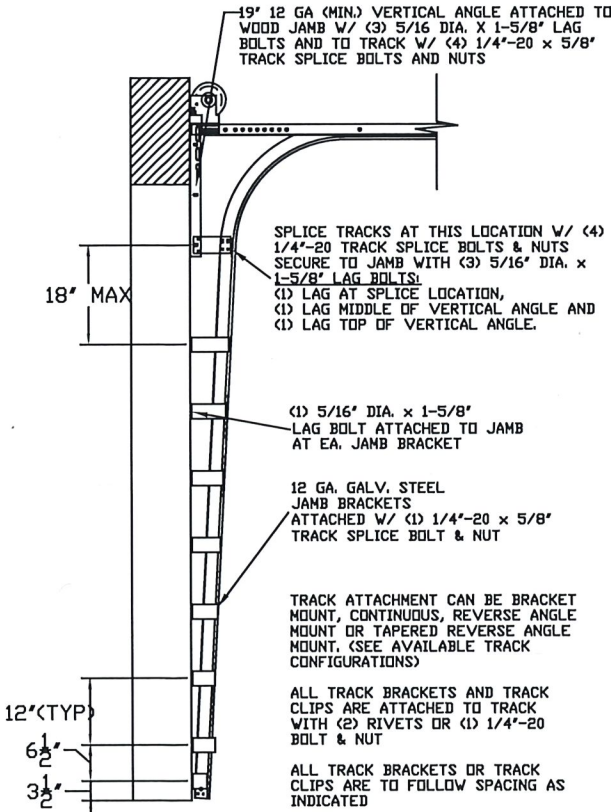

TRACK CONFIGURATION FOR UP TO 24' TALL DOORS

2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE
5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS THEN 20" O.C. (1 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE
HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 18" O.C. (1 1/4" EMBEDMENT)
ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK
SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART)
AT 8" O.C. (1 1/2" EMBEDMENT)
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART)
AT 8" O.C. (1 1/4" EMBEDMENT)

2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 22" O.C. (1 1/4" EMBEDMENT)
(OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)

*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
*PREPARATION OF WOOD JAMBS BY OTHERS

REV	DESCRIPTION OF REVISIONS	DATE	BY
A	UPDATED TO FBC 2010	11/29/11	RJR

MAX. SIZE
WIDTH 9'2"
HEIGHT 24'1"

DESIGN LOADS
+50.0 PSF
-62.0 PSF

LARGE MISSILE
IMPACT
RESISTANCE

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, P.A. (FL Firm #29412)

THOMAS L. SHELMERDINE
LICENSE
No. 48579
7.31.23
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
FL

dba Structural Solutions of North Carolina, Inc.
5921-G W. Friendly Ave., Greensboro, NC 27410

Amarr
ENTREMATIC

MODEL 2400 AMARR 2402, 2412, 2422
MODEL 2000 AMARR 2002, 2012, 2022

SIZE	DRAWN BY	SKW	DATE	07/29/08	DRAWING NUMBER
B	CHECKED BY	SKW	DATE	07/29/08	IRC-2409-177-21-I

ENTREMATIC
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

SHEET 3 OF 3