

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION NOTICE OF ACCEPTANCE (NOA)

Lawson Industries, Inc. 8501 NW 90 Street Medley, FL 33166

Scope:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HS-8800 (Fin Frame)" Aluminum Horizontal Sliding Window – L.M.I.

APPROVAL DOCUMENT: Drawing No. **L8800-0801 Rev F** titled "HS-8800 Horizontal Rolling Fin Impact Window", sheets 1 through 5 of 5, dated 04/08/08 and last revised on SEP 06, 2023, prepared by manufacturer and signed and sealed by Thomas J. Sotos, P.E. bearing Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami–Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises & renews NOA No. 20-0813.05** and consists of this page 1 and evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by Ishaq I. Chanda, P.E.





NOA No. 23-0907.03 Expiration Date: October 09, 2028 Approval Date: October 05, 2023 Page 1

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

- 1. Manufacturer's die drawings and sections. *(Submitted under NOA No. 08-0701.03)*
- Drawing No L8800-0801, titled "HS-8800 Horizontal Rolling Fin Impact Window", sheets 1 through 5 of 5, dated 04/08/08, with revision "D" dated 11/01/17, prepared by manufacturer, and signed and sealed by Thomas J. Sotos, P.E. (Submitted under NOA No. 17-1212.14)

B. TESTS

- 1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94

4) Forced Entry Test, per FBC 2411.3.2.1, and TAS 202-94 along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-07-4391**, dated 02/28/08, signed and sealed by Candido F. Font, P.E. (Submitted under NOA No.08-0701.03)

2. Test reports on: 1) Large Missile Impact Test per FBC, TAS 201-94

2) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of aluminum horizontal sliding windows, all prepared by Hurricane Engineering & Testing, Inc., Test Reports No.'s: **HETI-07-4392**, dated 01/15/08; **HETI-07-4393**, dated 01/15/08; **HETI-07-4395**, dated 01/15/08; **HETI-07-4394**, dated 02/28/08 and **HETI-08-2039**, dated 01/30/08; all signed and sealed by Candido F. Font, P.E.

(Submitted under NOA No.08-0701.03)

C. CALCULATIONS

- 1. Anchor verification calculations and structural analysis, complying with FBC, dated 06/20/08, prepared by manufacturer, signed and sealed by Thomas J. Sotos, P.E. *(Submitted under NOA No.08-0701.03)*
- 2. Glazing complies with ASTM E1300-04/09

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

Ishag 1. Chandes

Ishaq I. Chanda, P.E. Product Control Unit Supervisor NOA No. 23-0907.03 Expiration Date: October 09, 2028 Approval Date: October 05, 2023

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. 17-1114.14 issued to Kuraray America, Inc. for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 01/18/18, expiring on 07/08/19.
- 2. Notice of Acceptance No. 17-0712.05 issued to Eastman Chemical Company (MA) for their "Saflex Clear and Color Glass Interlayers" dated 09/07/17, expiring on 05/21/21.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC 6th Edition (2017), and of "No financial interest" dated November17, 2017, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.

(Submitted under previous NOA No. 17-1212.14)

- Statement letter dated 01/22/18 of the editorial drawing changes issued by Lawson Inc., signed by Nelson Erazo, Senior Design Engineer.
 (Submitted under previous NOA No. 17-1212.14)
- 3. Department of State Certification of LAWSON INDUSTRIES, INC. as a for profit corporation, active and organized under the laws of the State of Florida, dated 04/11/14 and filed at the Secretary of State.

(Submitted under NOA No. 14-0908.13)

Laboratory compliance letter for Test Reports No. HETI-07-4391, HETI-07-4392, HETI-07-4393, HETI-07-4394, HETI-07-4395 and HETI-08-2039, issued by Hurricane Engineering & Testing, Inc., dated 01/15/08 through 02/28/08, all signed and sealed by Candido F. Font, P.E. (Submitted under NOA No. 08-0701.03)

G. OTHERS

1. Notice of Acceptance No. 17-1212.14, issued to Lawson Industries, Inc. for their Series "HS-8800 Fin Frame" Aluminum Horizontal Sliding Window – L.M.I., approved on 02/01/18 and expiring on 10/09/18.

Ishag 1. Chandes

2. EVIDENCE SUBMITTED under previous approval

A. DRAWINGS

1. Drawing No L8800-0801, titled "HS-8800 Horizontal Rolling Fin Impact Window", sheets 1 through 5 of 5, dated 04/08/08, with revision "E" dated 07/31/20, prepared by manufacturer, and signed and sealed by Thomas J. Sotos, P.E..

B. TESTS

1. None

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. 19-0305.02 issued to Kuraray America, Inc. for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 05/09/19, expiring on 07/08/24.
- 2. Notice of Acceptance No. 20-0622.01 issued to Eastman Chemical Company (MA) for their "Saflex PVB Clear and Color Glass Interlayers" dated 08/06/20, expiring on 05/21/21.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC 7th Edition (2020), dated August 03, 2020, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.

G. OTHERS

1. Notice of Acceptance No. **18-0808.06**, issued to Lawson Industries, Inc. for their Series "HS-8800 Fin Frame" Aluminum Horizontal Sliding Window – L.M.I., approved on 09/20/18 and expiring on 10/09/23.

Ishag 1. Chands

Ishaq I. Chanda, P.E. Product Control Unit Supervisor NOA No. 23-0907.03 Expiration Date: October 09, 2028 Approval Date: October 05, 2023

4. **NEW EVIDENCE SUBMITTED**

A. DRAWINGS

1. Drawing No. L8800-0801 Rev F titled "HS-8800 Horizontal Rolling Fin Impact Window", sheets 1 through 5 of 5, dated 04/08/08 and last revised on SEP 06, 2023, prepared by manufacturer and signed and sealed by Thomas J. Sotos, P.E.

Note: The revision consists of addition of addition of Quanex: Super/ Duraseal spacers.

B. TESTS

- 1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
 - 3) Water Resistance Test, per FBC, TAS 202-94
 - 4) Large Missile Impact Test per FBC, TAS 201-94
 - 5) Cyclic Wind Pressure Loading per FBC, TAS 203-94

along with marked-up drawings and installation diagram of an aluminum horizontal sliding window, prepared by Hurricane Engineering & Testing, Inc., Test Report No. **HETI-23-0849**, dated 07/24/23, signed and sealed by Ram N. Tewari, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

- 1. Notice of Acceptance No. 19-0305.02 issued to Kuraray America, Inc. for their "Trosifol® Ultraclear, Clear and Color PVB Glass Interlayers" dated 05/09/19, expiring on 07/08/24.
- 2. Notice of Acceptance No. 23-0713.18 issued to Eastman Chemical Company (MA) for their "Saflex PVB Clear and Color Glass Interlayers", expiring on 05/21/26.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC 8th Edition (2023), dated 09/26/23, issued by the manufacturer, signed and sealed by Thomas J. Sotos, P.E.


G. OTHERS


- 1. This NOA revises & renews NOA No. 20-0813.05, updates to FBC 2023, expiring 10/09/28.
- 2. RER Test proposal #23-0461R dated 06/16/23, signed by Manny Perez, P.E.


Ishag 1. Chandes

Ishaq I. Chanda, P.E. Product Control Unit Supervisor NOA No. 23-0907.03 Expiration Date: October 09, 2028 Approval Date: October 05, 2023 General Notes:

- 1.) THIS WINDOW SYSTEM IS DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE (2020-7th Edition & 2023-8th Edition) INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ) AND ASTM 1300-98. THIS PRODUCT IS IMPACT RESISTANT AND DOES NOT REQUIRE SHUTTERS.
- 2.) 2 X WOOD BUCKS SHALL BE INSTALLED AND ANCHORED SO THAT THE BUILDING RESISTS THE SUPERIMPOSED LOADS IN ACCORDANCE WITH THE REQUIREMENTS OF FLORIDA BUILDING CODE & TO BE REVIEWED BY BUILDING OFFICIAL.
- 3.) ANCHORS SHOWN ABOVE ARE AS PER TEST UNITS. ON CENTER (O.C.) ANCHOR SPACINGS WILL VARY WITH UNIT DIMENSIONS, AND THE NUMBER OF ANCHORS REQUIRED, AS SPECIFIED ON THE LOAD TABLES.
- 4.) ANCHOR CONDITIONS NOT DESCRIBED IN THESE DRAWING'S ARE TO BE ENGINEERED ON A SITE SPECIFIC BASIS, UNDER SEPARATE APPROVAL AND TO BE REVIEWED BY BUILDING OFFICIAL.
- 5.) XO or OX WINDOWS ARE QUALIFIED FOR USE WITH SINGLE GLAZE LAMINATED GLASS TYPES TABULATED HEREIN (SEE SHEET #4).
- 6.) XO or OX WINDOWS ARE QUALIFIED FOR USE WITH DOUBLE GLAZE LAMINATED INSULATED GLASS TYPES TABULATED HEREIN (SEE SHEET #4).
- 7.) SEE SHEET #3 FOR LOCK DETAILS & OPTIONS.
- 8.) SEE SHEET #1 FOR GLAZING DETAILS & OPTIONS. (REFER TO SHEETS #4, FOR MAX. DESIGN PRESSURES.
- 9.) WOOD OPENINGS SHALL BE PROTECTED WITH AN APPROVED MOISTURE RESISTANT WEATHERBARRIER (BY OTHERS), PRIOR TO WINDOW INSTALLATION. (SEE SHEET #3 FOR INSTALLATION DETAIL)
- 10.) MATERIALS INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE **REQUIREMENTS OF FLORIDA BUILDING CODE SECTION 2003.8.4**

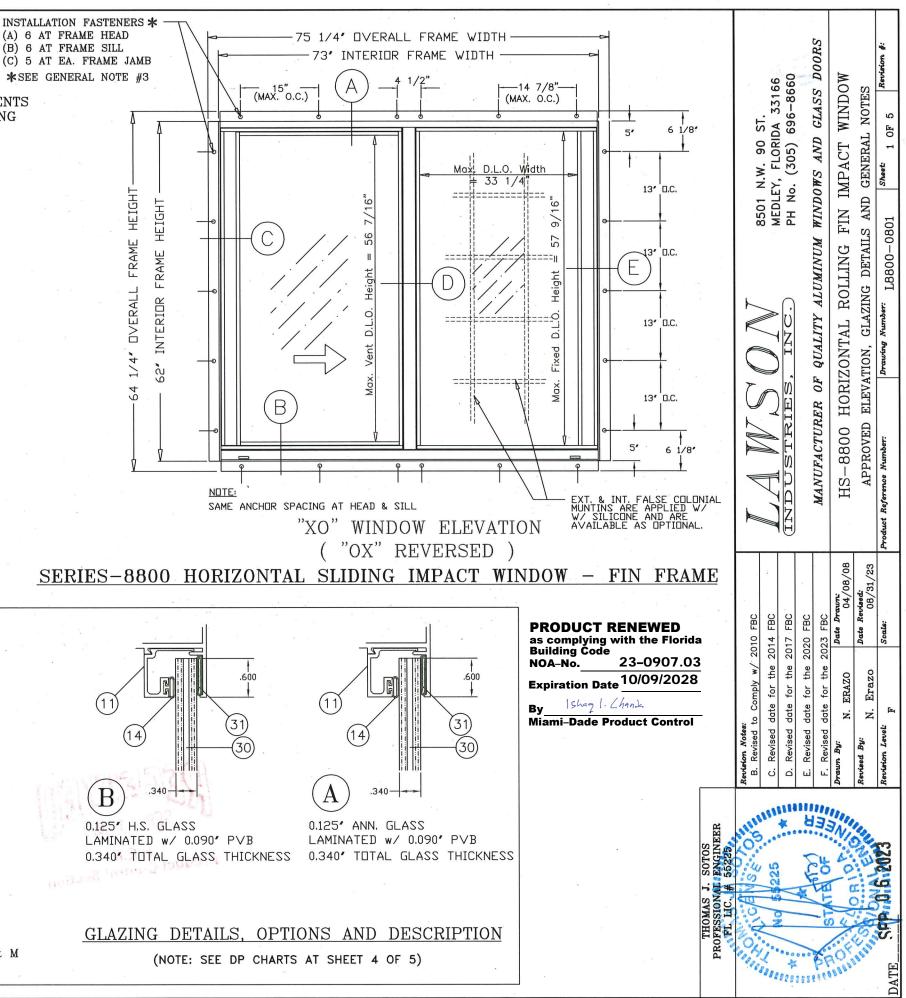


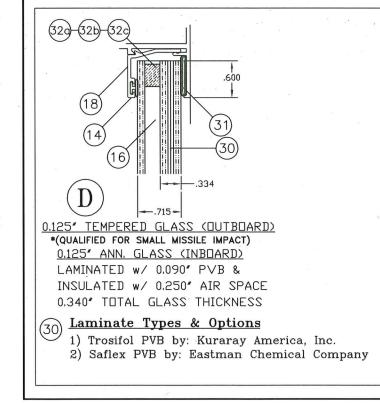

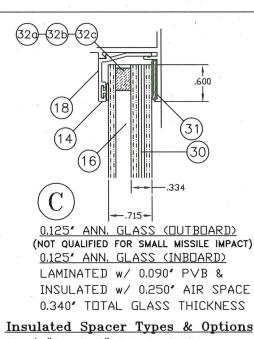


32 a) "TrueSeal" Swiggle Seal


- 32 b) "Quanex" SuperSpacer w/ Isomelt M
- 32 c) "Quanex" Duraseal




LAMINATED w/ 0.090" PVB 0.340' TOTAL GLASS THICKNESS

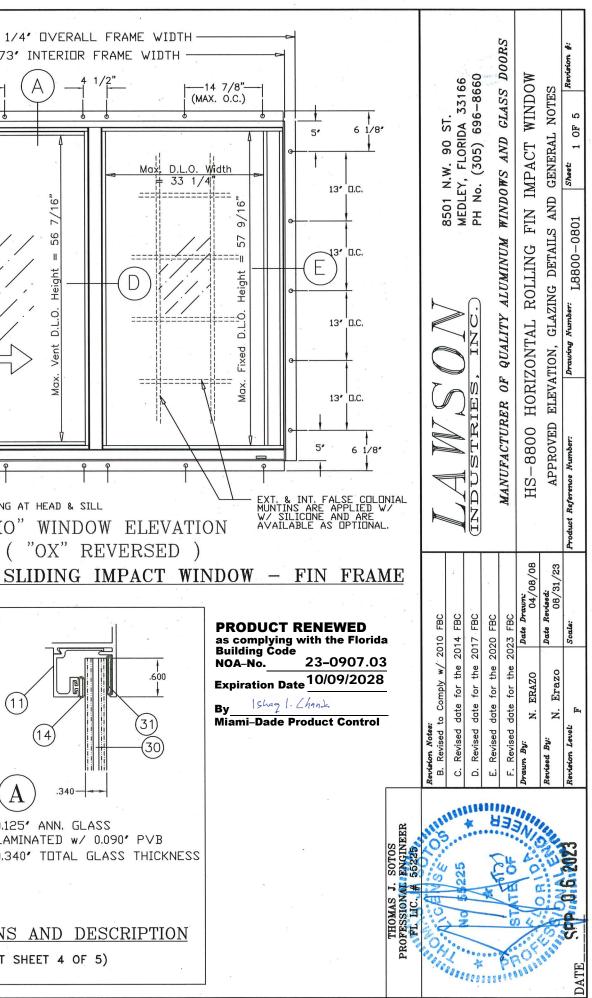

GLAZING DETAILS, OPTIONS AND DESCRIPTION

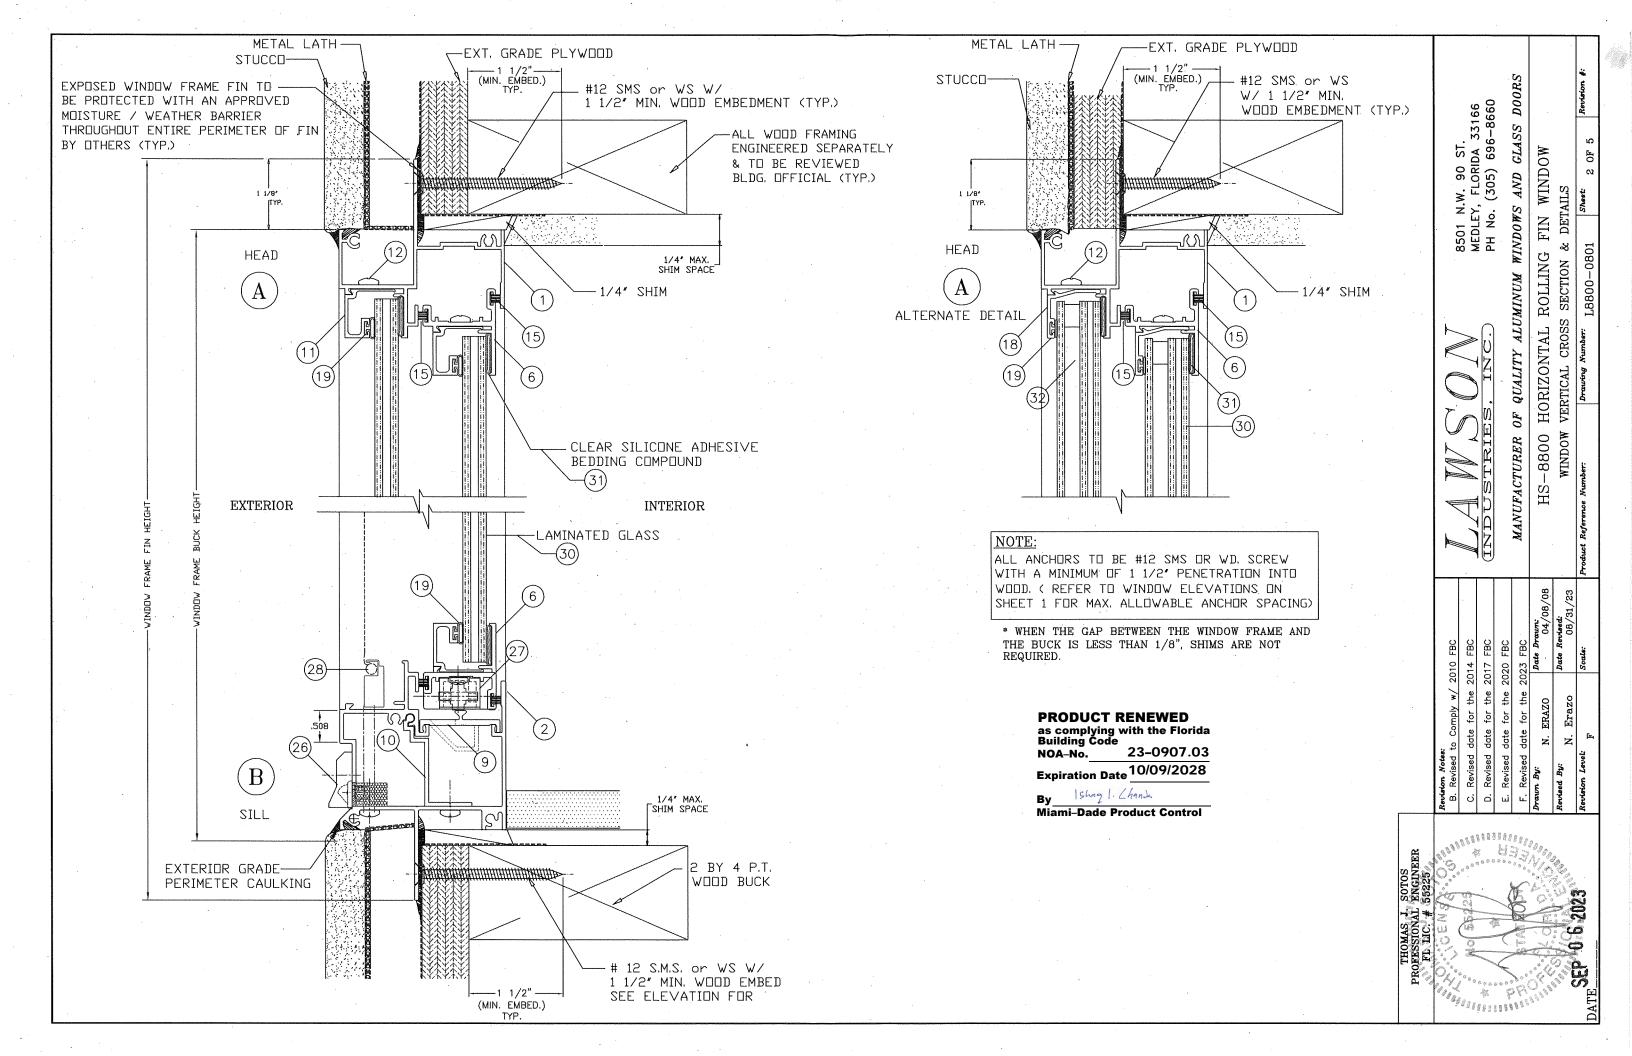

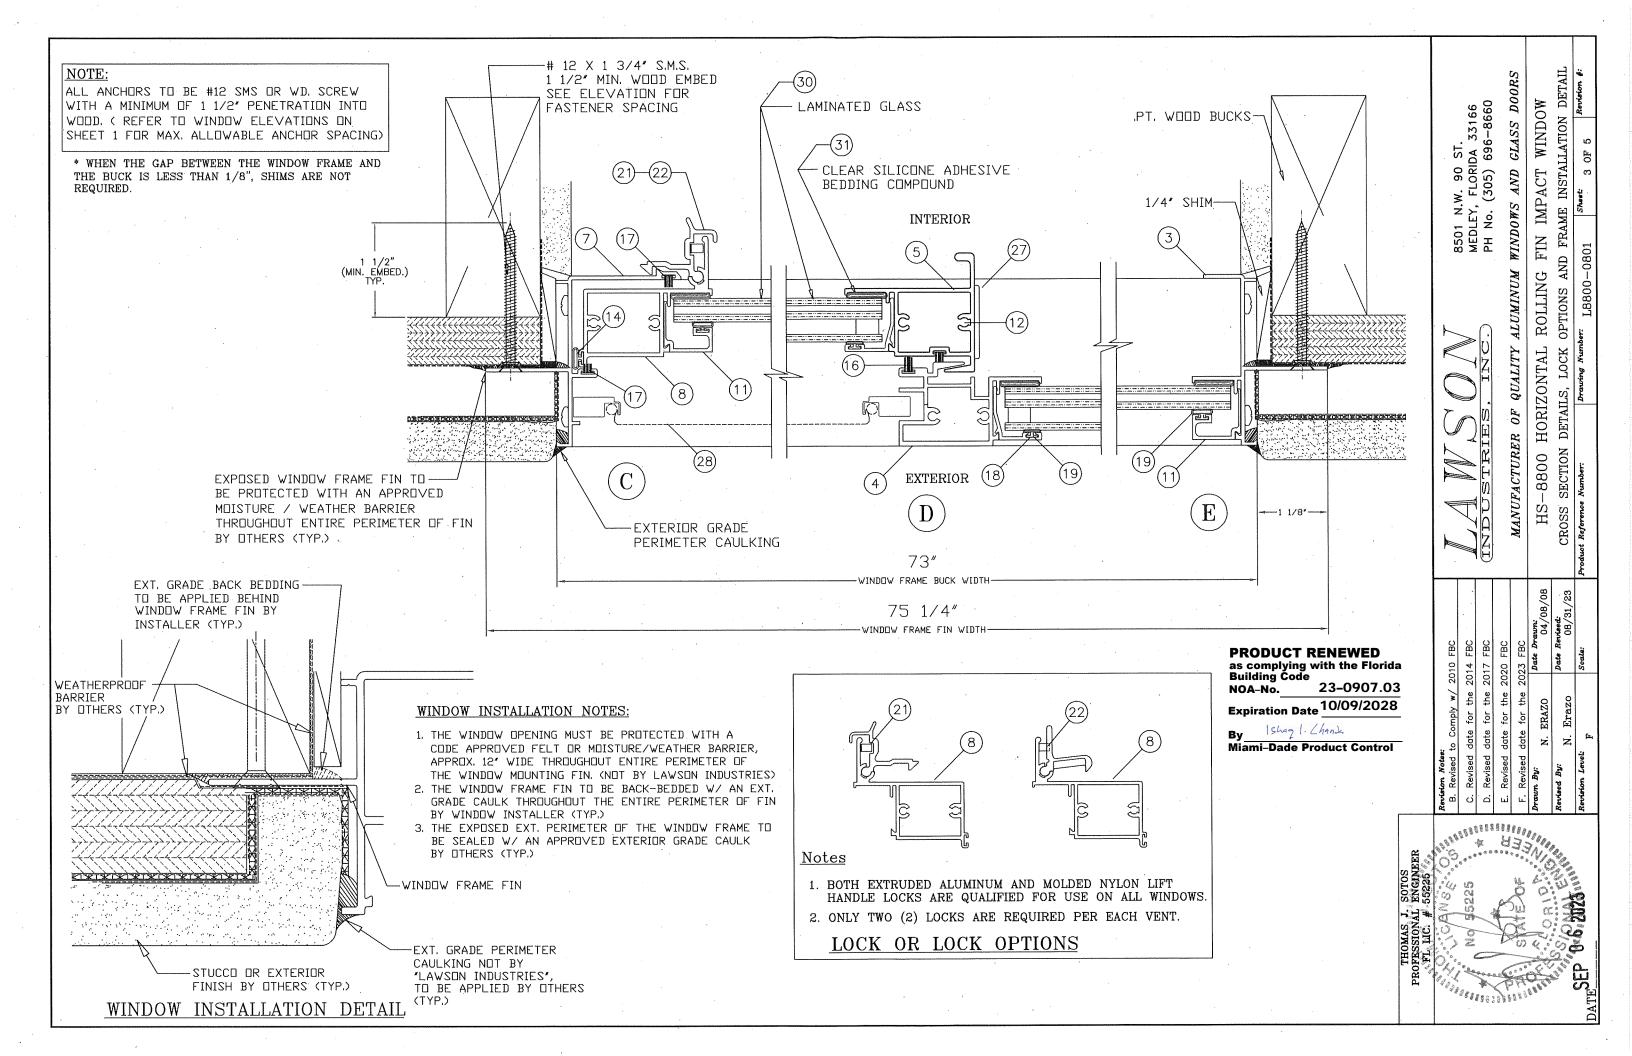


	HS-8	800 FIN	FRAME WINDOW BILL O	F MATERIALS			5	3		HS-880		t Horizo			indow				1 		
TEM #	PART #	REQD.	DESCRIPTION	REMARKS				, 				uration:	"XO oi	r OX"			н. ¹¹				DRS
1	L-7803	1	FIN FRAME HEAD	6063-T6 ALUMINUM			Frame B			stallation	Anchors					as per Gla			2		GLASS DOORS WINDOW
2	L-8801	+ 1	FIN FRAME SILL	6063-T6 ALUMINUM		Code	Width	Height	Head	Each	Total	"A" (Anr			H.S.)			"D" (Tem./		33166	GLASS D(WINDOW
3	L-7801	1	FIN FRAME FXD. JAMB	6063-T6 ALUMINUM		Size	(in)	(in)	Sill	Jamb	Req'd.	P(+)	P(-)	P(+)	P(-)	P(+)	P(-)	P(+)	P(-)	. 33	[NI
4	L-7704	1	FRAME FIXED MEETING RAIL	6063-T6 ALUMINUM		12	18.125 18.125	25 37.375	2	3	10 10	48.0 48.0	48.0 48.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0		
5	L-7705	1	VENT MEETING RAIL	6063-T6 ALUMINUM		14	18.125	49.625	2	4	10	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	90 0RI 5)	AND
6	L-7707	- 1	VENT TOP/BOTTOM RAIL	6063-T6 ALUMINUM		15	18.125	62	2	5	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	. L M	
7	L-8802	1	FIN FRAME VENT JAMB	6063-T6 ALUMINUM		H32	25.5	25	3	3	12	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	- デビー	WINDOWS ANI
8	L-7706	1	VENT JAMB LATCH RAIL		S	H33	25.5	37.375	3	3	12	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	8501 MEDLEY PH No.	91
		1		6063-T6 ALUMINUM	E N	H34	25.5 25.5	49.625	3	4	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	PH 85	FIN
9	L-8702	1	FRAME SILL TRACK	6063-T5 ALUMINUM	S	H35 22	25.5 36	62 25	3	5	16 12	48.0 48.0	48.0 48.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0	60.0 60.0		X
10	L-8705	1	FRAME SILL RETAINING CLIP	6063-T5 ALUMINUM	≿	22	36	37.375	3	3	12	48.0	48.0	60.0	60.0	60.0	60.0	60.0 60.0	60.0		NG
11	L-7708	AS REQ'D.	GLAZING BEAD (3/8')	6063-T5 ALUMINUM	ā	24	36	49.625	3	4	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		UTTI OTTI
12	FS-006	AS REQ'D.	FRAME ASSEMBLY SCREWS	#8 X 3/4" P.H. PHILLIPS	MO	25	36	62	3	5	16	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		ALU ROI
13	FS-040	AS REQD.	INSTALLATION SCREWS	#12 SMS F.H./PHIL.	Σ	32	52.125	25	4	3	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		N.
14	L-7531	AS REQ'D.	VENT JAMB VINYL WTS'P	1/4' DIA. BULB #3033	S	33	52.125	37.375	4	3	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		AL
15	PWS-003	AS REQ'D.	FIN SEAL WEATHERSTRIP	.187″ w x .230″ h		34	52.125	49.625	4 -	4	16	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		<i>QUALITY</i> ONTAL
16	PWS-005	AS REQ'D.	FIN SEAL WEATHERSTRIP	.187' w × .350' h		35 D22	52.125 73	62 25	<u>4</u> 6	5	18	48.0	48.0 48.0	60.0	60.0 60.0	60.0	60.0 60.0	60.0	60.0		
17	PWS-009	AS REQ'D.	FIN SEAL WEATHERSTRIP	.187" w x .310" h		D22	73	37.375	6	3	18 18	48.0 48.0	48.0	60.0 60.0	60.0	60.0 60.0	60.0	60.0 60.0	60.0 60.0	TOU	RI
18	L-7711	AS REQ'D.	GLAZING BEAD (3/4')	6063-T5 ALUMINUM		D24	73	49.625	6	4	20	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		HOH CH
19	L-7531	AS REQ'D.	BEAD VINYL BULB	1/4" DIA. BULB #3033		D25	73	62	6	5	22	-	-	60.0	60.0	60.0	60.0	60.0	60.0	ZI ZI	0-
20	*	AS REQ'D.				2020	23	23	3	3	12	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	F	FACTUI 8800
			COLONIAL FALSE MUNTIN	ALUMINUM		2030	23	35	3	3	12	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	N N	FA
21	L-7539	2	VENT EXTRUDED LATCH	6063-T5 ALUMINUM		2040	23 23	47 59	3	4	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		HS-
22	HC-057-1	2	VENT MOLDED LATCH	MOLDED NYLON		2050 3020	35	23	3	5	16 12	48.0 48.0	48.0 48.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	AL	HH
23	*	1 × LATCH	LATCH SPRING	STAINLESS STEEL		3020	35	35	3	3	12	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		
24	*	2	SILL/JAMB JOINT GASKET	1/16' CLOSED CELL FOAM	S	3040	35	47	3	4	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		·
25	FS-041	2	SILL RAIL ASSEMBLY SCREW	#8 X 2 1/4" P.H./PHIL.	ZE	3050	35	59	3	5	.16	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	}	
26	HC-044-1	2	WEEP FLAP & BAFFLE		S	4020	47	23	4	3	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		/08
27	HC-040-1	2	SASH ROLLER & HOUSING		AR	4030	47	35	4	3.	14	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		/08
28	HC-026-1	1	SCREEN FRAME & MESH		L L	4040	47 47	47 59	4	4	16 18	48.0 48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	 2010 FBC 2014 FBC 2017 FBC 2020 FBC 	naturn 04
29	*	1	ATTACHMENT SCREW @ CLIP	#8 X 5/8" S.D.S.	G	4050 5020	47 59	23	<u>4</u> 5	3	18	48.0	48.0 48.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	60.0 60.0	E E E	F BC
30	*	2	LAMINATED GLASS	See Detail @ sheet 1 of 5	Ŭ	5030	59	35	5	3	16	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	2010 014 017 020	023 Da
31	SM-5504		GLAZING SILICONE	See Detail @ sheet 1 of 5		5040	59	47	5	4	18	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	w/ 2 the 2 the 2 the 2	U U
32 a.	"TrueSeal"		Insulated Glass Swiggle Seal			5050	59	59	5	5	20	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		for the ERAZO
	-			1/4" air space	18	6020	71	23	6	3	18	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0		ER.
32 b	"Quanex"		Insulated Glass SuperSpacer			6030	71	35	6	3	18	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	to Co date date date	N.
32 c	"Quanex"		Insulated Glass Duraseal	1/4" air space		6040	71	47 59	6	4	20	48.0	48.0	60.0	60.0	60.0	60.0	60.0	60.0	Revision Notes: B. Revised to C. Revised o D. Revised o E. Revised d	lised
33	SM-5504	AS REQ'D.	JOINT SEALANT			6050		09	IN O	5	22	- <u>-</u>	-	60.0	60.0	60.0	60.0	60.0	60.0	Revi Revi Revi	n B
34	*	AS REQ'D.	PERIMETER ACRYLIC CAULK	DSI POLYSEAMSEAL					93	ine "	2015									ы <u>Б</u> ір	Praw
35	*	1	PRODUCT LABEL	<i>x</i>			Note	(*) WIN	NDDAR	WITH G	LASS T	YPES "C"	' INSTA	ALLED A	ABO∨e	30FT.					<u> </u>

Note: (*) WINDOWS WITH GLASS TYPES "C" INSTALLED ABOVE 30FT. IN THE HVHZ, THE I.G. EXTERIOR LITE SHALL BE TEMPERED.

PRODUCT RENEWED as complying with the Florida Building Code NOA-No. 23-0907.03 Expiration Date 10/09/2028

By Isheg I. Chanda Miami-Dade Product Control



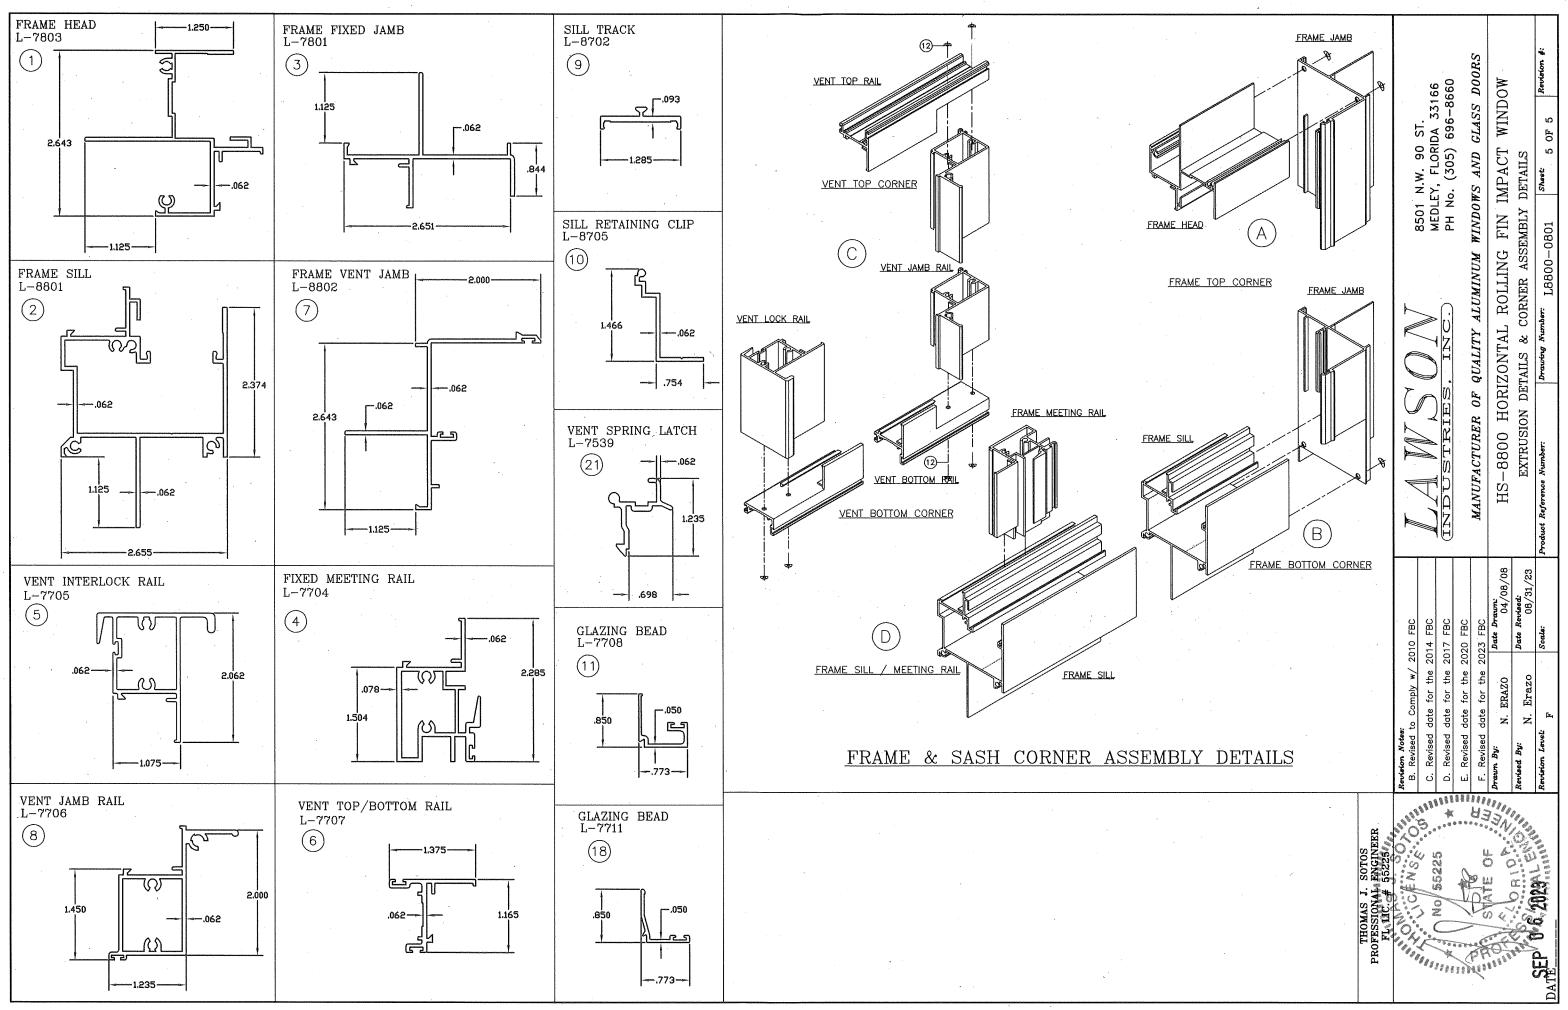

.