

MIAMI-DADE COUNTY PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208 Miami, FL 33175 T (786) 315-2590 F (786) 315-2599 www.miamidade.gov/economy

DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER) BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

CGI Windows and Doors, Inc. 3780 W 104th Street Hialeah, FL 33018

Scope:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "238" Impact Resistant Aluminum Tube Mullions-L.M.I.

APPROVAL DOCUMENT: Drawing No. 238MULL-1, titled "Aluminum Tube Mullions (LM)", sheets 1 thru 7 of 7, dated 02/22/2022, with revision A dated 08/23/2023, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state, model/series, and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 22-0309.01 and consists of this page 1 and evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by Sifang Zhao, P.E.

MIAMI-DADE COUNTY
APPROVED

4.2.

10/26/2023

NOA No. 23-0913.03 Expiration Date: April 26, 2027 Approval Date: October 26, 2023

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

- 1. Manufacturer's die drawings and sections. (Submitted under NOA#02-0123.07)
- 2. Drawing No. 238MULL-1, titled "Aluminum Tube Mullions (LM)", sheets 1 thru 7 of 7, dated 02/22/2022, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E. (Submitted under NOA#22-0309.01)

B. TESTS

- 1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 2) Large Missile Impact Test per FBC, TAS 201-94
 - 3) Cyclic Wind Pressure Loading per FBC, TAS 203-94 along with marked-up drawings and installation diagram of aluminum fixed windows mulled together, prepared by Hurricane Test Laboratory, LLC, Test Report No. **HTL-0080-0105-08**, dated 03/26/08, signed and sealed by Vinu J. Abraham, P.E. (Submitted under NOA#08-0429.04)
- 2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC PA-202-94 along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by Hurricane Engineering & Testing Inc., Test Report No. HETI-96-525, dated 02/12/95 signed and sealed by Hector Medina, P.E. (Submitted under NOA#02-0123.07)
- 3. Test reports on: 1) Large Missile Impact Test, Loading per FBC PA 201-94 along with marked-up drawings and installation diagram of an aluminum fixed window, prepared by Hurricane Engineering & Testing Inc., Test Report No. **HETI-96-525**, dated 10/30/95, signed and sealed by Timothy S. Marshall, P.E. (Submitted under NOA#02-0123.07)

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying with FBC-6th Edition (2017) and FBC-7th (2020) dated 03/04/22, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E. (Submitted under NOA#22-0309.01)

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

- 1. Statement letter of conformance, complying with **FBC** 6th **Edition (2017)** and with **FBC** 7th **Edition (2020)**, and of no financial interest, dated 03/04/2022, signed and sealed by Anthony Lynn Miller, P.E. (Submitted under NOA#22-0309.01)
- 2. Statement letter of successor engineer per 61G15-27.001 Florida Administrative Code. (Submitted under NOA#20-0610.08)

Sifang Zhao, P.E.
Product Control Examiner
NOA No. 23-0913.03
Expiration Date: April 26, 2027
Approval Date: October 26, 2023

CGI Windows and Doors, Inc.

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

G. OTHERS

Notice of Acceptance No. **20-0610.08**, issued to CGI Windows & Doors for their Series Clipped, Extruded Aluminum Tube Mullion with #373 Framing Member – L.M.I., approved on 09/24/2020 and expiring on 04/26/22.

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. 238MULL-1, titled "Aluminum Tube Mullions (LM)", sheets 1 thru 7 of 7, dated 02/22/2022, with revision A dated 08/23/23, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

B. TESTS

1. None.

C. CALCULATIONS

1. Anchor verification calculations and structural analysis, complying **FBC** 7th (2020) dated 03/04/2022, prepared by manufacturer, signed and sealed by Anthony Lynn Miller, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC 7th Edition (2020) and with FBC 8th Edition (2023), and of no financial interest, dated August 23, 2023, signed and sealed by Anthony Lynn Miller, P.E.

G. OTHERS

1. Notice of Acceptance No. **22-0309.01**, issued to CGI Windows & Doors for their Series Clipped, Extruded Aluminum Tube Mullion with #373 Framing Member – L.M.I., approved on 04/07/2022 and expiring on 04/26/27.

00

Sifang Zhao, P.E.
Product Control Examiner
NOA No. 23-0913.03
Expiration Date: April 26, 2027
Approval Date: October 26, 2023

SERIES 238, IMPACT-RESISTANT, ALUMINUM TUBE MULLIONS

1) MULLIONS AND CLIPS HAVE BEEN DESIGNED & TESTED TO COMPLY WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE, AND ARE APPROVED FOR IMPACT AND NON-IMPACT APPLICATIONS IN THE HVHZ. MULLIONS ARE ONLY TO BE USED WITH THE MANUFACTURER'S FENESTRATION PRODUCTS.

2) DETAILS SHOWN ARE FOR THE MULLION ONLY. ANCHORS SHOWN ARE IN ADDITION TO ANY ANCHORS REQUIRED FOR THE FENESTRATION PRODUCT INSTALLATION. TYPICAL APPLICATIONS ARE SHOWN. EACH SITUATION IS UNIQUE AND SHOULD BE EVALUATED BY AN EXPERIENCED INSTALLER FOR THE BEST INSTALLATION METHOD. OPTIONAL 1X OR 2X WOOD BUCKS IF USED, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS AND ARE TO BE DESIGNED BY OTHERS.

3) THE TYPE AND NUMBER OF ANCHORS IS CRITICAL TO THE STRUCTURAL PERFORMANCE OF THE MULLED UNITS. MULLIONS HAVE BEEN TESTED AS "FREE-FLOATING" WHEN USING THE MULLION CLIP (ITEM# 4), BUT SHALL NOT HAVE A GAP OF MORE THAN 1/4" FROM THE END OF THE MULLION TO THE BOTTOM OF THE CLIP, SEE SHEET 3.

4) THE ANCHORAGE METHODS SHOWN HAVE BEEN DESIGNED TO RESIST THE WINDLOADS CORRESPONDING TO THE REQUIRED DESIGN PRESSURE. MULLIONS ARE CALCULATED TO DEFLECT NO MORE THAN L/180. THE 1/3 STRESS INCREASE WAS NOT USED IN THIS ANCHOR EVALUATION. THE 1.6 LOAD DURATION FACTOR WAS USED FOR THE EVALUATION OF WOOD SCREWS.

5) PROPER SEALING OF ENTIRE ASSEMBLY IS THE RESPONSIBILITY OF OTHERS AND IS BEYOND THE SCOPE OF THESE INSTRUCTIONS.

6) USE THE COMBINED WIDTH OR HEIGHT OF ONLY TWO ADJACENT FENESTRATION PRODUCTS TO DETERMINE PRESSURES AND ANCHORAGE FOR THE COMMON MULLION. FOR MULTIPLE UNITS, CONSIDER ONLY TWO ADJACENT UNITS AT A TIME WHEN USING THE DESIGN PRESSURE AND ANCHORAGE TABLES. THE LOWEST DESIGN PRESSURE OF MULTIPLE MULLIONS OR FENESTRATION PRODUCTS SHALL APPLY.

7) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. WOOD BUCKS BY OTHERS, MUST BE ANCHORED PROPERLY TO TRANSFER LOADS TO THE STRUCTURE. ANCHORS SHALL BE COATED OR CORROSION RESISTANT AS APPROPRIATE FOR SUBSTRATE MATERIAL. DISSIMILAR MATERIALS SHALL BE PROTECTED AS REQUIRED TO PREVENT REACTIONS.

8) REFERENCE: DEWALT ULTRACON+, DEWALT/ELCO AGGRE-GATOR & CRETEFLEX NOA'S.

9) QUANTITY OF UNITS WITHIN A MULTIPLE MULLED ASSEMBLY IS UNLIMITED PROVIDED THAT THE SPAN AND OPENING WIDTH/HEIGHT OF EACH INDIVIDUAL MULLION COMPLIES WITH THE REQUIREMENTS OF THIS APPROVAL.

10) SUBSTRATES: CONCRETE SHALL CONFORM TO ACI 301 SPECIFICATIONS. HOLLOW AND GROUT-FILLED CONCRETE BLOCK UNIT (CMU) SHALL CONFORM TO ASTM C-90. WOOD SHALL HAVE A MIN. SG OF 0.55. ALUMINUM SHALL BE 6063-T5 AND BE A MINIMUM OF .125" THICK. STEEL STUDS TO BE A MINIMUM GRADE 33 AND .045" THICK (18 GAUGE). STRUCTURAL STEEL TO BE AT LEAST .125" THICK AND A36. ALL ANCHORS INTO METAL SHALL EXTEND AT LEAST 3 SCREW THREADS BEYOND THE MATERIAL.

ANCHOR CAPACITY ADJUSTMENT FORMULA

$$(DP_{REQ}) \times \left(\frac{ANCHOR\ CAP._{FROM\ TABLE}}{MULLION\ CAP._{FROM\ TABLE}}\right) = ANCHOR\ CAP._{REQ.}$$

USE THIS FORMULA TO OBTAIN THE "ANCHOR CAPACITY REQUIRED" CORRESPONDING TO AN ACTUAL PRESSURE REQUIREMENT FOR THE OPENING, WHEN IT IS LOWER THAN THE MULLION CAPACITY (FROM THE TABLE) OF THE SELECTED MULLION. IT WILL YIELD A MINIMUM ANCHOR CAPACITY WHICH MAY BE USED TO QUALIFY ADDITIONAL ANCHOR OPTIONS FROM THE CLIP/ANCHOR CAPACITY TABLE.

CODES / STANDARDS USED:


- 2023 FLORIDA BUILDING CODE (FBC), 8TH EDITION
- 2020 FLORIDA BUILDING CODE (FBC), 7TH EDITION
- ANSI/AF&PA NDS-2018 FOR WOOD CONSTRUCTION
- ALUMINUM DESIGN MANUAL, ADM-2020
- AISI S100-16
- AISC 360-16

DESIGN PRESSURE RATING

SEE TABLES 1A - 3A

IMPACT RATING

RATED FOR LARGE & SMALL
MISSILE IMPACT RESISTANCE

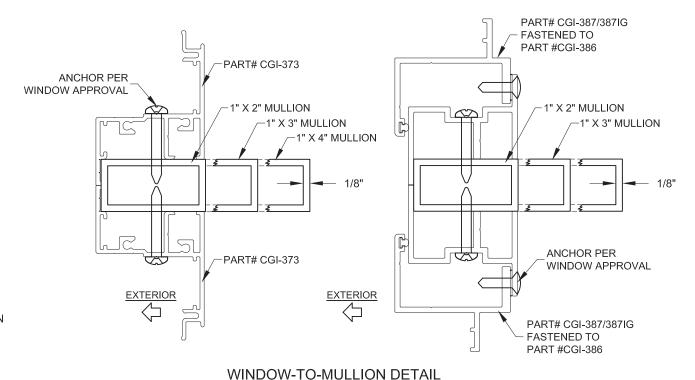

INSTRUCTIONS:

- 1) DETERMINE THE <u>ALLOWABLE STRESS DESIGN (ASD) PRESSURE REQUIREMENT (LBS/FT²)</u> FOR THE OPENING USING THE **ASCE-7 STANDARD**.
- 2) TO FIND THE DESIGN PRESSURE OF THE MULLION, USE TABLES 1A THROUGH 3A. THE MULLION DESIGN PRESSURE OBTAINED SHALL MEET OR EXCEED THE DESIGN PRESSURE REQUIREMENT FOR THE OPENING OBTAINED IN STEP 1. NOTE THAT YOU MUST FIRST DETERMINE WHETHER YOU HAVE A SINGLE MULLION OR CROSSING MULLIONS.
- 3) AFTER OBTAINING THE MULLION'S DESIGN PRESSURE, FIND THE VALUE IN THE COLUMN TITLED "ANCHOR CAPACITY REQUIRED (LBS)". THIS VALUE REPRESENTS THE CLIP/ANCHOR CAPACITY THAT MUST BE MET TO ATTAIN THE MULLION DESIGN PRESSURE.
- 4) FROM THE CLIP/ANCHOR CAPACITY TABLE ON THE SAME SHEET, CHOOSE AN ANCHOR/CLIP/SUBSTRATE CONDITION THAT MEETS OR EXCEEDS THE VALUE OBTAINED FROM STEP 3.
- 5) VERIFY THE DESIGN PRESSURE OF THE FENESTRATION PRODUCT TO BE USED AND COMPARE WITH THE FINAL DESIGN PRESSURE FOR THIS MULLION SYSTEM. THE LOWER OF THE TWO SHALL APPLY FOR THE ENTIRE MULLED FENESTRATION ASSEMBLY.
- 6) HIGHLIGHT OPTION USED AND TABLE VALUES USED IN A SPECIFIC APPLICATION WHEN USING THIS APPROVAL TO APPLY FOR A PERMIT.
- 7) OPTIONALLY, IF THE MULLION DESIGN PRESSURE OBTAINED IN THE TABLE IS MUCH HIGHER THAN THE DESIGN PRESSURE REQUIREMENT FOR THE OPENING, YOU MAY USE THE "ANCHOR CAPACITY ADJUSTMENT FORMULA" ON THIS SHEET TO OBTAIN A LOWER CLIP/ANCHOR CAPACITY.


PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-0913.03


Expiration Date 04/26/2027


By Miami-Dade Product Control


UPDATED TO 2023 BUILDING CODE. JR - 08/23/23

02/22/22 ROSOWSKI Rev. 238MULL-1 REGISTRATION #29296 Date D BY A. LYNN MILLER HNOLOGY DRIVE ;, FL 34275 JENS I **MULLIONS (LM)** By By PREPARED E 1070 TECHNO N. VENICE, F INSTRUCTIONS TUBE OF Resistant ws & Doors CLIPPED STREET - 33018 જ Windows GEN. NOTES 3780 W 104TH S HIALEAH, FL (Impact | ALUMINUM, 238MULLS



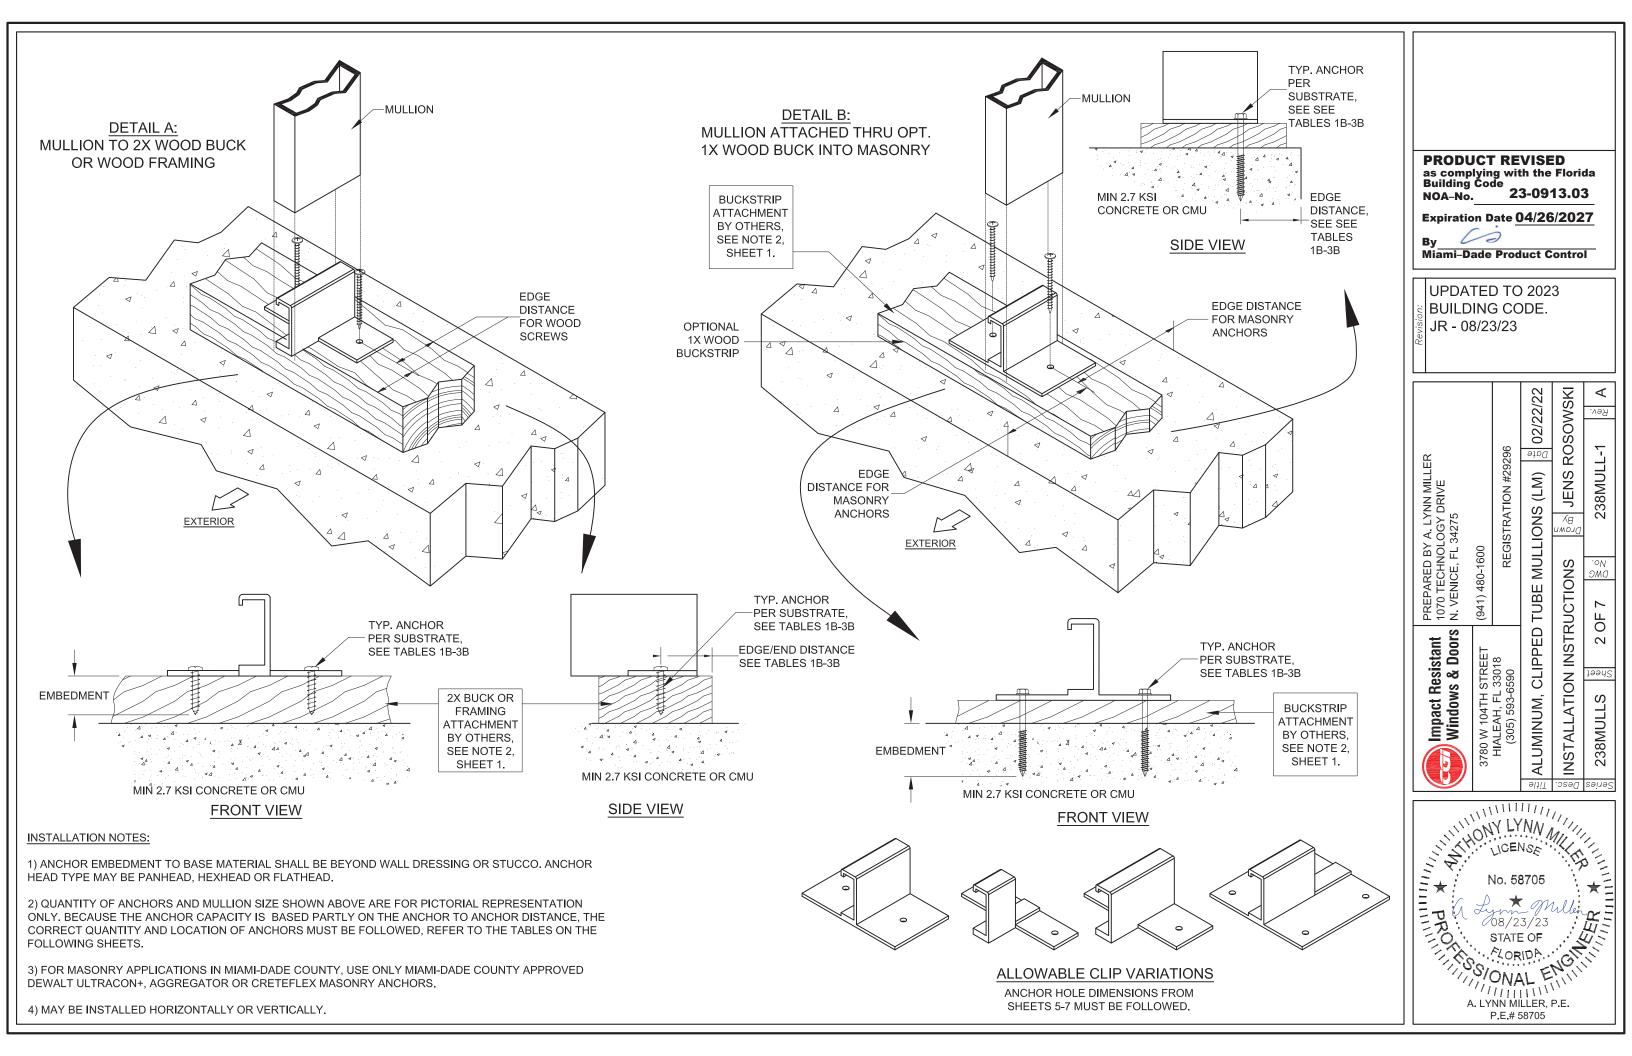

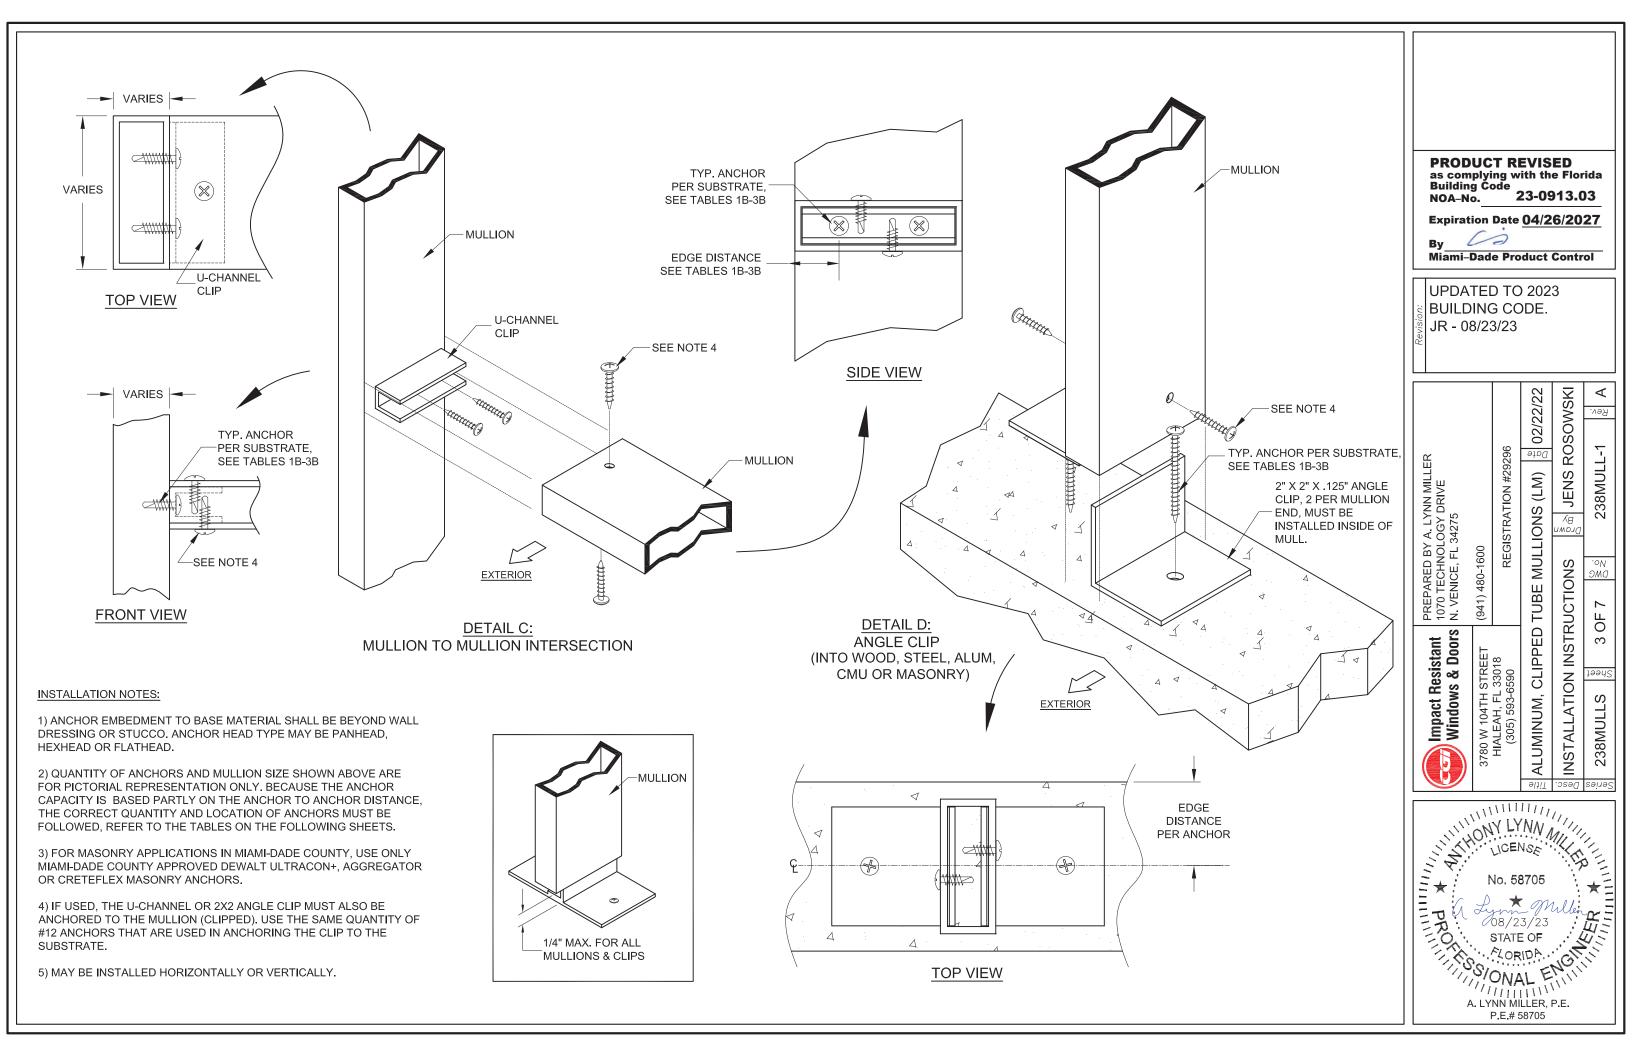


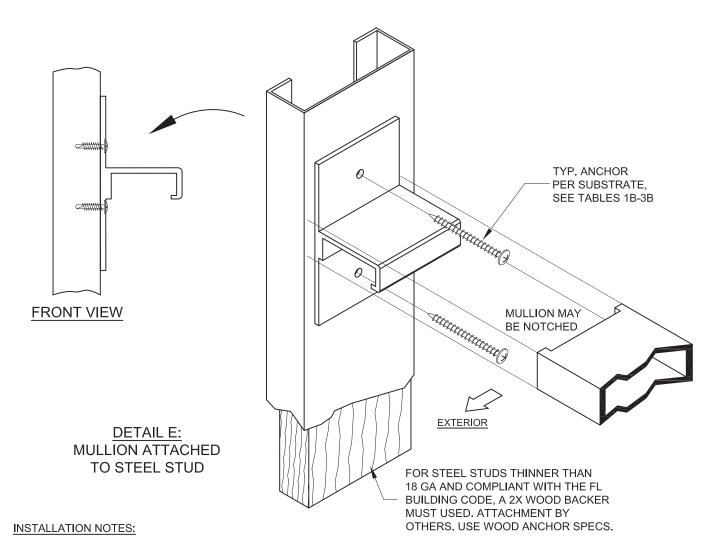


- 1) ANCHOR EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO. ANCHOR HEAD TYPE MAY BE PANHEAD, HEXHEAD OR FLATHEAD.
- 2) QUANTITY OF ANCHORS AND MULLION SIZE SHOWN ABOVE ARE FOR PICTORIAL REPRESENTATION ONLY. BÉCAUSE THE ANCHOR CAPACITY IS BASED PARTLY ON THE ANCHOR TO ANCHOR DISTANCE, THE CORRECT QUANTITY AND LOCATION OF ANCHORS MUST BE FOLLOWED. REFER TO THE TABLES ON THE FOLLOWING SHEETS.
- 3) FOR 2X WOOD-BACKED STEEL STUDS, WOOD ANCHOR VALUES ARE TO BE USED.
- 4) MAY BE INSTALLED HORIZONTALLY OR VERTICALLY.

BILL OF MATERIALS:


ITEM#	PART#	DESCRIPTION	MATERIAL
1	AL-403	1" X 2" X 1/8" Tube Mullion	6063-T6
2	AL-1035	1" X 3" X 1/8" Tube Mullion	6063-T6
3	AL-404	1" X 4" X 1/8" Tube Mullion	6063-T6
4	CGI-383	Mullion Clip	6063-T6
5	STD	2" X 2" X 1/8" Angle Clip	6063-T6
6	AL-416	1" X 3/4" X 1/8" U-Channel Clip	6063-T6
7	CGI-373	Panel Top Rail	6063-T6
8	CGI-386	Panel Top Rail	6063-T6
9	CGI-387	Panel Top Rail	6063-T6
10	CGI-387IG	Panel Top Rail	6063-T6





1.875"





── 1.000" **──**

3.000"

1" X 3" X 1/8"

TUBE MULLION

.125"

2.000"

2" X "2 X 1/8"

ANGLE CLIP

.125"

2.000"

5

1.000"

2.000'

.125"

1" X 2" X 1/8'


TUBE MULLION


4.000"


MULLION CLIP


.125"








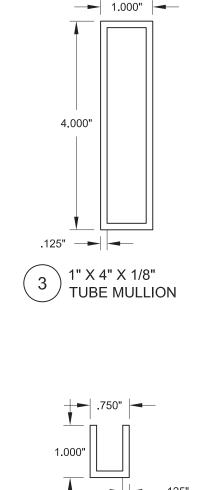



1" X 3/4" X 1/8" 6 **U-CHANNEL CLIP**

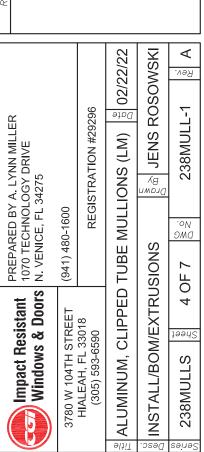

PRODUCT REVISED as complying with the Florida Building Code


Expiration Date 04/26/2027

Miami-Dade Product Control

UPDATED TO 2023 BUILDING CODE. JR - 08/23/23

NOA-No.

23-0913.03



TA	BLE 1A:																												
														Ol	pening I	Dimensi	on												
			50) in			60) in			70) in			80	in			90) in			100	0 in			120) in	
	1" x 2" Mullion Design	Po Loaded	oint Mullion	Uniformly Loaded Mullion		Point Loaded Mullion		Uniformly Loaded Mullion		Point Loaded Mullion			Uniformly Loaded Mullion		Point Loaded Mullion		Uniformly Loaded Mullion		Point Loaded Mullion		Uniformly Loaded Mullion		oint Mullion	Uniformly Loaded Mullion		Point Loaded Mullion		Uniformly Loaded Mullion	
Ai	ressure & achor Load quirement	Mullion Capacity (lbs/ft2)	Anchor Capacity Required (lbs)																										
	42 in	170.0	620	170.0	435	170.0	744	170.0	478	170.0	868	170.0	506	170.0	992	170.0	519	170.0	1116	170.0	521	170.0	1240	170.0	521	156.0	1365	170.0	521
	48 in	170.0	708	170.0	524	170.0	850	170.0	584	170.0	992	170.0	630	156.8	1045	170.0	661	139.4	1045	170.0	677	125.4	1045	170.0	680	104.5	1045	170.0	680
	50-5/8 in	170.0	747	170.0	563	170.0	896	170.0	631	152.7	940	170.0	684	133.6	940	170.0	723	118.8	940	167.7	737	106.9	940	165.1	734	89.1	940	165.0	734
	54 in	170.0	797	170.0	612	146.8	826	166.7	677	125.9	826	149.9	665	110.1	826	138.9	656	97.9	826	132.0	650	88.1	826	128.4	647	73.4	826	127.5	645
Span	60 in	128.4	669	137.9	569	107.0	669	118.6	556	91.7	669	105.6	545	80.3	669	96.7	537	71.4	669	90.6	531	64.2	669	86.6	526	53.5	669	83.6	523
	63 in	111.0	607	118.3	519	92.5	607	101.5	507	79.3	607	90.0	498	69.3	607	82.0	490	61.6	607	76.4	484	55.5	607	72.6	479	46.2	607	69.0	475
Mullion	66 in	96.5	553	102.3	475	80.4	553	87.5	465	68.9	553	77.4	456	60.3	553	70.2	449	53.6	553	65.1	443	48.3	553	61.6	438	40.2	553	57.8	433
M	72 in	74.3	465	78.1	403	61.9	465	66.5	395	53.1	465	58.5	387	46.5	465	52.8	381	41.3	465	48.6	376	37.2	465	45.5	371	31.0	465	41.8	366
	76 in	63.2	417	66.1	364	52.7	417	56.1	357	45.1	417	49.2	350	39.5	417	44.3	344	35.1	417	40.6	339	31.6	417	37.9	335	26.3	417	34.4	329
	78 in	58.5	396	61.0	347	48.7	396	51.8	340	41.8	396	45.4	333	36.5	396	40.7	328	32.5	396	37.3	323	29.2	396	34.7	319	24.4	396	31.3	313
	90 in	38.1	297	39.3	264	31.7	297	33.2	259	27.2	297	28.9	255																
	96 in	31.4	261	32.2	234	26.1	261	27.2	229	22.4	261																		

OPENING DIMENSION MULL MULLION SPAN SPAN **OPENING DIMENSION** MULL⁻ **OPENING** DIMENSION MULL MULLION SPAN UNIFORMLY LOADED MULLIONS

MULLION SPAN

POINT LOADED MULLION

(SEE NOTE 5)


OPENING DIMENSION


TABLE 1B:


	Substrate:		3k Co	ncrete		3.5k Conc.			Hollow o	r Filled Cl	MU			Filled CM	U	Wo	Metal *	
1" x 2" Clip/Anchor	Anchor Type:	3/16" [Ultra	Dewalt con+	1/4" [Ultra		1/4" Dewalt AggreGator	3/16" Ultra	Dewalt con+		Dewalt con+	1/4" Dewalt AggreGator	CreteFlex	3/16" Dewalt Ultracon+	1/4" Dewalt Ultracon+	1/4" Dewalt AggreGator			
Capacity	Edge Distance (in):	1"	2-1/2"	1"	2-1/2"	3-1/8"	1"	2-1/2"	1"	2-1/2"	2"	2-1/2"	1"	1"	2"	0.54"	0.60	0.36
	Embedment (in):	1-3/4"	1-3/4"	1-3/4"	1-3/4"	2"	1-1/4"	1-1/4"	1-1/4"	1-1/4"	1-1/4"	1-1/4"	1-3/4"	1-3/4"	2"	1-3/8"	1-3/8"	varies *
2 Anchors into Mullion C	lip or 2x2 Angle Clip Pair, Fig 1:	310 lbs	630 lbs	220 lbs	870 lbs	518 lbs	230 lbs	370 lbs	320 lbs	580 lbs	374 lbs	497 lbs	170 lbs	347 lbs	946 lbs	442 lbs	537 lbs	536 lbs
4 Anchors into Mullion C	lip or 2x2 Angle Clip Pair, Fig 2:	320 lbs	N/A	360 lbs	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	885 lbs	1073 lbs	1073 lbs
6 Anchors into Mullion C	lip or 2x2 Angle Clip Pair, Fig 3:	480 lbs	N/A	540 lbs	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1327 lbs	1610 lbs	1609 lbs
	2 Anchors into U-Clip, Fig 4:	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	536 lbs

* SEE NOTE 10 ON SHEET 1 FOR ADDITIONAL SUBSTRATE INFORMATION.

1" X 2" CLIP ANCHOR LOCATIONS, TOP VIEW:

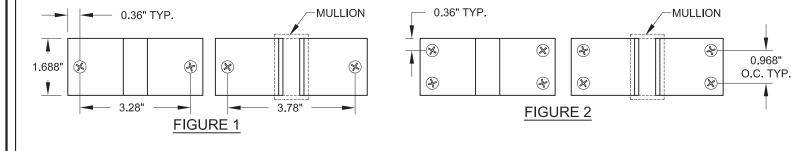

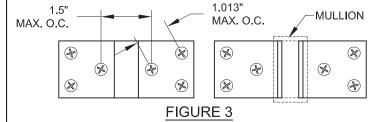



CLIP NOTES:


1) CLIP HOLES MAY BE DRILLED IN THE FIELD. CLIP VARIATIONS ARE ALLOWED (SEE SHEET 1), PROVIDED THE DIMENSIONS SHOWN ON THIS SHEET ARE FOLLOWED.


TABLE NOTES:

- 1) WHEN FINDING YOUR SIZE IN THE MULLION TABLE, ALWAYS ROUND UP TO THE NEXT SIZE SHOWN ON THE TABLE. LINEAR INTERPOLATION BETWEEN MULL LENGTHS AND/OR OPENING WIDTHS IS ALLOWABLE.
- 2) IF A LOWER ANCHOR CAPACITY IS ACCEPTABLE, USE THE FORMULA FROM SHEET 2 TO CALCULATE THE CORRESPONDING, LOWER DESIGN PRESSURE OF THE ANCHOR/MULLION SYSTEM.
- 3) FOR CROSSING MULLIONS, DETERMINE THE CAPACITIES FOR EACH MULLION. FOR TRIPLE+ MULLED WINDOWS, ONLY USE THE OPENING DIMENSION OF TWO ADJACENT WINDOWS.
- 4) WINDOW/MULL IMAGES MAY BE ROTATED 90°.
- 5) A POINT LOADED MULLION IS ONE THAT SUPPORTS THE END OF ANOTHER MULLION ALONG ITS SPAN.



UPDATED TO 2023 BUILDING CODE. JR - 08/23/23

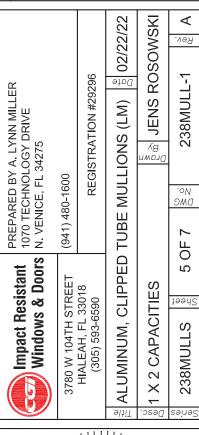



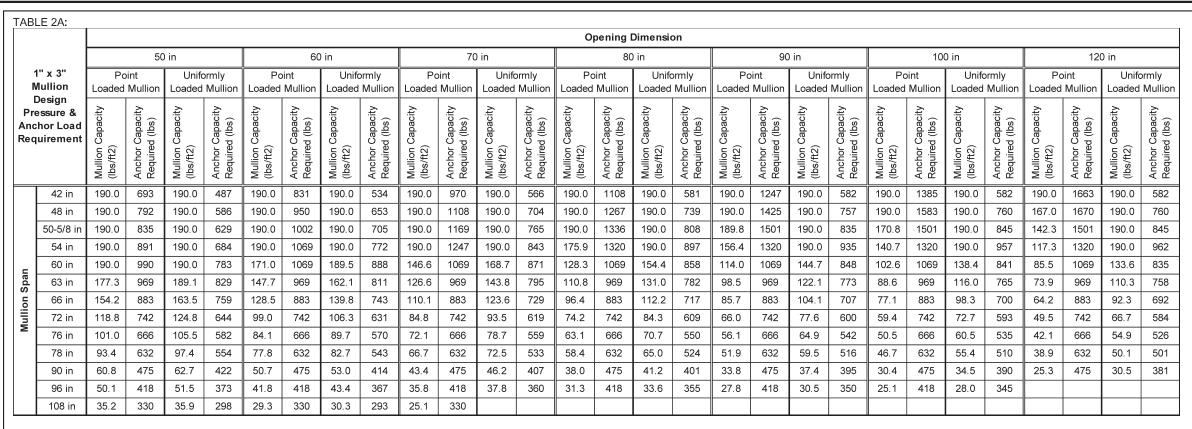


TABLE 2B:	Substrate:		3k Co	ncrete		3.5k Conc.			Hollow o	r Filled Cl	/III			Filled CN	III	l Wo	od *	Metal *
1" x 3" Clip/Anchor	Anchor Type:	3/16" DeWalt Ultracon+		1/4" DeWalt Ultracon+		1/4" DeWalt AggreGator			1/4" DeWalt Ultracon+		1/4" DeWalt AggreGator	1/4" DeWalt CreteFlex	3/16" DeWalt Ultracon+	1/4" DeWalt Ultracon+	1/4" DeWalt	#12 Steel	#14 Steel	
Capacity	Edge Distance (in):	1"	2-1/2"	1"	2-1/2"	3-1/8"	1"	2-1/2"	1"	2-1/2"	2"	2-1/2"	1"	1"	2"	0.54"	0.60	0.36
	Embedment (in):	1-3/4"	1-3/4"	1-3/4"	1-3/4"	2"	1-1/4"	1-1/4"	1-1/4"	1-1/4"	1-1/4"	1-1/4"	1-3/4"	1-3/4"	2"	1-3/8"	1-3/8"	varies *
2 Anchors into Mullion C	Clip or 2x2 Angle Clip Pair, Fig 1:	310 lbs	630 lbs	220 lbs	870 lbs	518 lbs	230 lbs	370 lbs	320 lbs	580 lbs	374 lbs	497 lbs	170 lbs	347 lbs	946 lbs	442 lbs	537 lbs	536 lbs
4 Anchors into Mullion C	Clip or 2x2 Angle Clip Pair, Fig 2:	537 lbs	1260 lbs	412 lbs	1712 lbs	1036 lbs	361 lbs	740 lbs	456 lbs	1018 lbs	N/A	892 lbs	340 lbs	474 lbs	N/A	885 lbs	1073 lbs	1073 lbs
6 Anchors into Mullion C	Clip or 2x2 Angle Clip Pair, Fig 3:	555 lbs	1890 lbs	578 lbs	N/A	N/A	N/A	1110 lbs	N/A	N/A	N/A	N/A	N/A	N/A	N/A	1327 lbs	1610 lbs	1609 lbs
	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	536 lbs	
	3 Anchors into U-Clip, Fig 5:	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	805 lbs
* SEE NOTE 10 ON SHEET 1 FOR ADDITIONAL SUBSTRATE INFORMATION.																		

MULL MULLION SPAN SPAN **OPENING** DIMENSION MULL **OPENING** DIMENSION MULL MULLION SPAN UNIFORMLY LOADED MULLIONS

MULLION

SPAN

POINT LOADED MULLION

(SEE NOTE 5)

OPENING

DIMENSION

OPENING

DIMENSION


PRODUCT REVISED as complying with the Florida Building Code 23-0913.03 NOA-No.

Expiration Date 04/26/2027


Miami-Dade Product Control


UPDATED TO 2023 BUILDING CODE. JR - 08/23/23


02/22/22 JENS ROSOWSKI Rev. 238MULL-1 Date MULLIONS (LM) PREPARED BY A. LYNN MILI 1070 TECHNOLOGY DRIVE N. VENICE, FL 34275 DKOW. P Impact Resistant Windows & Doors CLIPPE STREET - 33018 CAPACITIE ALUMINUM, 238MULLS 3780 W 104T HIALEAH, F $^{\circ}$ \times




1" X 3" CLIP ANCHOR LOCATIONS, TOP VIEW:

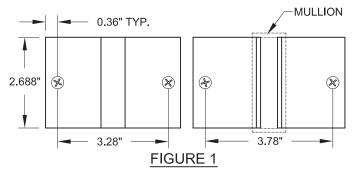

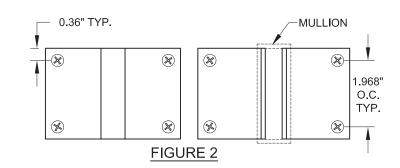

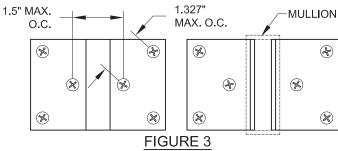



CLIP NOTES:

1) CLIP HOLES MAY BE DRILLED IN THE FIELD. CLIP VARIATIONS ARE ALLOWED (SEE SHEET 2), PROVIDED THE DIMENSIONS SHOWN ON THIS SHEET ARE FOLLOWED.

TABLE NOTES:

- 1) WHEN FINDING YOUR SIZE IN THE MULLION TABLE, ALWAYS ROUND UP TO THE NEXT SIZE SHOWN ON THE TABLE. LINEAR INTERPOLATION BETWEEN MULL LENGTHS AND/OR OPENING WIDTHS IS ALLOWABLE.
- 2) IF A LOWER ANCHOR CAPACITY IS ACCEPTABLE, USE THE FORMULA FROM SHEET 1 TO CALCULATE THE CORRESPONDING, LOWER DESIGN PRESSURE OF THE ANCHOR/MULLION SYSTEM.
- 3) FOR CROSSING MULLIONS, DETERMINE THE CAPACITIES FOR EACH MULLION, FOR TRIPLE+ MULLED WINDOWS, ONLY USE THE OPENING DIMENSION OF TWO ADJACENT WINDOWS.
- 4) WINDOW/MULL IMAGES MAY BE ROTATED 90°.
- 5) A POINT LOADED MULLION IS ONE THAT SUPPORTS THE END OF ANOTHER MULLION ALONG ITS SPAN.

TA	BLE 3A:																												
														Ol	pening l	Dimensi	on												
			50) in			60) in			70) in			80) in			90) in		100 in					12	0 in	
	1" x 4" Mullion		oint Mullion		ormly Mullion	Po	oint Mullion	Unifo	ormly Mullion	Po	int Mullion		ormly Mullion	Po Loaded	oint Mullion		ormly Mullion		oint I Mullion	Unifo	ormly Mullion		oint I Mullion		ormly Mullion		oint I Mullion		ormly I Mullion
	Design				Ι.									1					1										
A	Pressure & nchor Load equirement	Mullion Capacity (lbs/ft2)	Anchor Capacity Required (lbs)																										
	42 in	210.0	766	210.0	538	210.0	919	210.0	591	210.0	1072	210.0	625	210.0	1225	210.0	642	210.0	1378	210.0	643	210.0	1531	210.0	643	210.0	1838	210.0	643
	48 in	210.0	875	210.0	647	210.0	1050	210.0	722	210.0	1225	210.0	778	210.0	1400	210.0	817	210.0	1575	210.0	837	210.0	1750	210.0	840	210.0	2100	210.0	840
	50-5/8 in	210.0	923	210.0	695	210.0	1107	210.0	779	210.0	1292	210.0	845	210.0	1477	210.0	893	210.0	1661	210.0	923	210.0	1846	210.0	934	210.0	2215	210.0	934
	54 in	210.0	984	210.0	757	210.0	1181	210.0	853	210.0	1378	210.0	932	210.0	1575	210.0	992	210.0	1772	210.0	1034	210.0	1969	210.0	1057	200.1	2251	210.0	1063
	60 in	210.0	1094	210.0	866	210.0	1313	210.0	984	210.0	1531	210.0	1085	210.0	1750	210.0	1167	207.3	1944	210.0	1230	186.6	1944	210.0	1276	155.5	1944	210.0	1313
8	63 in	210.0	1148	210.0	921	210.0	1378	210.0	1050	210.0	1608	210.0	1161	201.5	1763	210.0	1254	179.1	1763	210.0	1329	161.2	1763	210.0	1385	134.3	1763	200.6	1379
S C C		210.0	1203	210.0	975	210.0	1444	210.0	1116	200.3	1606	210.0	1238	175.2	1606	204.0	1303	155.8	1606	189.2	1286	140.2	1606	178.8	1273	116.8	1606	167.8	1258
Mullion	72 in	210.0	1313	210.0	1085	180.0	1350	193.2	1147	154.2	1350	170.0	1126	135.0	1350	153.3	1107	120.0	1350	141.1	1091	108.0	1350	132.2	1079	90.0	1350	121.4	1062
2	76 in	183.6	1211	191.9 177.1	1058	153.0	1211	163.1	1036	131.2	1211	143.1	1017	114.8	1211	128.6	1000	102.0	1211	117.9	986	91.8	1211	110.0	974	76.5	1211	99.8 91.0	957
	78 in 90 in	169.8 110.6	1150 864	114.1	1007	141.5 92.1	1150 864	150.4 96.4	987	121.3 79.0	1150 864	131.8 84.0	969 740	106.2	1150	118.3 74.9	953	94.4	1150	108.3	939 718	84.9 55.3	1150	100.8	927 708	70.8 46.1	1150 864	55.5	910 693
	90 in 96 in	91.1	759	93.6	767 679	75.9	759	79.0	753 667	65.1	759	68.7	655	69.1 56.9	864 759	61.1	729 645	50.6	864 759	68.1 55.4	636	45.6	864 759	62.8 50.9	628	38.0	759	44.6	614
	108 in	64.0	600	65.4	542	53.3	600	55.0	533	45.7	600	47.7	525	40.0	600	42.3	517	35.5	600	38.2	510	32.0	600	34.9	503	26.7	600	30.3	492
	111 in	58.9	568	60.1	514	49.1	568	50.6	506	42.1	568	43.8	498	36.8	568	38.8	491	32.7	568	35.0	484	29.5	568	32.0	478	24.6	568	27.7	467
	120 in	46.6	486	47.4	443	38.9	486	39.9	436	33.3	486	34.5	430	29.2		30.5	424	25.9	486	27.4	418	20.0	000	02.0	770	24.5	555	21.1	
	120 in	46.6	486	47.4	443	38.9	486	39.9	436	33.3	486	34.5	430	29.2	486	30.5	424	25.9	486	27.4	418								

3/16" DeWalt

Ultracon+

1-1/4"

230 lbs

454 lbs

480 lbs

N/A

2-1/2"

1-1/4"

370 lbs

740 lbs

1110 lbs

N/A

N/A

Hollow or Filled CMU

2-1/2"

1-1/4"

580 lbs

1152 lbs

1440 lbs

N/A

N/A

1/4" DeWalt

1-1/4"

320 lbs

629 lbs

570 lbs

N/A

Filled CMU

1/4"

DeWalt

Ultracon-

1-3/4"

347 lbs

642 lbs

600 lbs

N/A

N/A

2"

946 lbs

N/A

N/A

N/A

SEE NOTE 10 ON SHEET 1 FOR ADDITIONAL SUBSTRATE INFORMATION.

1/4"

DeWalt

CreteFlex

2-1/2"

1-1/4"

497 lbs

982 lbs

1278 lbs

1/4" DeWalt

AggreGator

2"

1-1/4"

374 lbs

N/A

N/A

N/A

3/16"

DeWalt

Ultracon-

1-3/4"

170 lbs

340 lbs

510 lbs

N/A

N/A

Wood '

AggreGator Screw (G5) Screw (G5) Screw (G5

0.60

1-3/8"

537 lbs

1073 lbs

1610 lbs

N/A

N/A

/4" DeWalt #12 Steel #14 Steel

0.54"

1-3/8"

442 lbs

885 lbs

1327 lbs

N/A

N/A

Metal *

#12 Steel

0.36

varies *

536 lbs

1073 lbs

1609 lbs

536 lbs

805 lbs

6 Anchors into Mullion Clip or 2x2 Angle Clip Pair, Fig 3:	630 lbs
2 Anchors into U-Clip, Fig 4:	N/A
3 Anchors into U-Clip, Fig 5:	N/A

1" X 4" CLIP ANCHOR LOCATIONS TOP VIEW-

2 Anchors into Mullion Clip or 2x2 Angle Clip Pair, Fig 1

4 Anchors into Mullion Clip or 2x2 Angle Clip Pair, Fig 2:

0.36" TYP.	-MULLION 0.36" TYP.	MULLION	1.5" MAX. O.C. 1.73" MAX. O.C.	MULLION 0.36" TYP.
3.688" 🛞		2.968" O.C. TYP.		1.48" TYP.
3.28" — 3.78" FIGURE 1	FIGURE 2		FIGURE 3	FIGURE 4 FIGURE 5

CLIP NOTES:

TABLE 3B:

1" x 4"

Clip/Anchor

Capacity

1) CLIP HOLES MAY BE DRILLED IN THE FIELD. CLIP VARIATIONS ARE ALLOWED (SEE SHEET 2), PROVIDED THE DIMENSIONS SHOWN ON THIS SHEET ARE FOLLOWED.

Substrate:

Anchor Type:

Edge Distance (in)

Embedment (in

3k Concrete

1/4" DeWalt

1-3/4"

220 lbs

438 lbs

600 lbs

N/A

2-1/2"

1-3/4"

870 lbs

1738 lbs

2550 lbs

N/A

3/16" DeWalt

Ultracon+

1-3/4"

310 lbs

2-1/2"

1-3/4"

630 lbs

1260 lbs

1890 lbs

N/A

3.5k Conc.

I/4" DeWalt

AggreGator

3-1/8"

2"

518 lbs

1036 lbs

1554 lbs

N/A

TABLE NOTES:


1) WHEN FINDING YOUR SIZE IN THE MULLION TABLE, ALWAYS ROUND UP TO THE NEXT SIZE SHOWN ON THE TABLE, LINEAR INTERPOLATION BETWEEN MULL LENGTHS AND/OR OPENING WIDTHS IS ALLOWABLE.


2) IF A LOWER ANCHOR CAPACITY IS ACCEPTABLE, USE THE FORMULA FROM SHEET 1 TO CALCULATE THE CORRESPONDING, LOWER DESIGN PRESSURE OF THE ANCHOR/MULLION SYSTEM.


3) FOR CROSSING MULLIONS, DETERMINE THE CAPACITIES FOR EACH MULLION, FOR TRIPLE+ MULLED WINDOWS, ONLY USE THE OPENING DIMENSION OF TWO ADJACENT WINDOWS.

4) WINDOW/MULL IMAGES MAY BE ROTATED 90°.

5) A POINT LOADED MULLION IS ONE THAT SUPPORTS THE END OF ANOTHER MULLION ALONG ITS SPAN.







MULL

UNIFORMLY

MULLION SPAN LOADED MULLIONS

PRODUCT REVISED as complying with the Florida **Building Code** 23-0913.03 NOA-No.

Expiration Date <u>04/26/2027</u>

00 Miami-Dade Product Control

02/22/22

Rev.

UPDATED TO 2023 BUILDING CODE. JR - 08/23/23

ROSOWSKI Date MULLIONS (LM) Y A. LYNN MIL LOGY DRIVE 34275 By By PREPARED BY # 1070 TECHNOLC N. VENICE, FL 34 OF Resistant ws & Doors В CLIPPE STREET . 33018 1 X 4 CAPACITIES Impact Res 3780 W 104TH S HIALEAH, FL ALUMINUM, 238MULLS

No. 58705

No. 58705

No. 58705

Augustian Office of State of Stat A. LYNN MILLER, P.E.

P.E.# 58705