



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES  
(RER)

BOARD AND CODE ADMINISTRATION DIVISION

## NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208

Miami, Florida 33175-2474

T (786) 315-2590 F (786) 315-2599

[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

Clopay Corporation  
8585 Duke Boulevard  
Mason, OH 45040

### SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Full Vision W8 DP52 Aluminum Sectional Garage Door up to 9'-2" Wide with Impact Resistant Lites**

**APPROVAL DOCUMENT:** Drawing No. **105611**, titled "M/N 904 9' Wide +52/-58 psf", sheets 1 through 4 of 4, dated 09/22/2020, with revision **4** dated 09/06/23, prepared by Clopay Corporation, signed and sealed by Mark Westerfield, P.E. on 09/14/2023, bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**LABELING:** A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises NOA #22-0622.01** and consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Helmy A. Makar, P.E., M.S.**



*Helmy A. Makar*  
12/21/2023

NOA-No 23-0928.60  
Expiration Date: 09/30/2026  
Approval Date: 12/21/2023  
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. Evidence submitted under NOA # 20-1005.01

A. DRAWINGS

1. Drawing No. **105611**, titled “M/N 904 9’ Wide +52/-58 psf”, sheets 1 through 4 of 4, dated 09/22/2020, with revision **2** dated 09/20/2021, prepared by Clopay Corporation, signed and sealed by Mark Westerfield, P.E.

B. TESTS

1. Addendum prepared by American Test Lab, Inc. to Test Report No. **ATLNC 0714.01-20**, dated 07/14/2021, signed and sealed by David W. Johnson, P.E.
2. Addendum 2 prepared by American Test Lab, Inc. to Test Report No. **ATLNC 0714.01-20**, dated 08/09/2021, signed and sealed by David W. Johnson, P.E.
3. Addendum 3 prepared by American Test Lab, Inc. to Test Report No. **ATLNC 0714.01-20**, dated 09/07/2021, signed and sealed by David W. Johnson, P.E.
4. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
4) Forced Entry Test, per FBC, TAS 202-94  
5) Tensile Test per ASTM E8  
along with marked-up drawings and installation diagram of 9’2”x 8’, aluminum garage doors Model 904W8 with windows, prepared by American Test Lab, Inc., Test Report No. **ATLNC 0714.01-20**, dated 09/16/2020, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS

1. Horizontal track calculations prepared by Clopay Building Products Company, dated 08/17/2021, signed and sealed by Mark Westerfield, P.E.
2. Jamb anchor calculations prepared by Clopay Building Products Company, dated 09/03/2020, signed and sealed by Mark Westerfield, P.E.

D. QUALITY ASSURANCE


1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **20-0915.22** issued to Kuraray America, Inc. for their **Trosifol Ultraclear, Clear and Color PVB Glass Interlayers**, approved on 11/19/2020, expiring on 07/08/2024.

F. STATEMENTS

1. Statement letter of code conformance to the 6<sup>th</sup> edition (2017) and 7<sup>th</sup> edition (2020) of the FBC, issued by Clopay Corporation, dated 09/03/2020, signed and sealed by Mark Westerfield, P.E.
2. Statement letter of no financial interest issued by Clopay Corporation, dated 09/03/2020, signed and sealed by Mark Westerfield, P.E.

  
\_\_\_\_\_  
Helmy A. Makar, P.E., M.S.  
Product Control Section Supervisor  
NOA-No 23-0928.60  
Expiration Date: 09/30/2026  
Approval Date: 12/21/2023



NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER PREVIOUS APPROVAL # 22-0622.01

A. DRAWINGS

1. Drawing No. **105611**, titled “M/N 904 9’ Wide +52/-58 psf”, sheets 1 through 4 of 4, dated 09/22/2020, with revision **3** dated 4/22, prepared by Clopay Corporation, signed and sealed by Mark Westerfield, P.E. on 06/10/2022.

B. TESTS

1. Test reports on 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94  
2) Large Missile Impact Test per FBC, TAS 201-94  
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94  
4) Forced Entry Test, per FBC, TAS 202-94  
5) Tensile Test per ASTM E8  
along with marked-up drawings and installation diagram of 9’x 8’, aluminum garage doors Model 904W8 with windows, prepared by American Test Lab, Inc., Test Report No. **ATLNC 0606.01-22**, dated 06/13/2022, signed and sealed by David W. Johnson, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE


1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. None.

  
\_\_\_\_\_  
Helmy A. Makar, P.E., M.S.  
Product Control Section Supervisor  
NOA-No 23-0928.60  
Expiration Date: 09/30/2026  
Approval Date: 12/21/2023

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

3. NEW EVIDENCE SUBMITTED

A. DRAWINGS

- 1. Drawing No. 105611, titled “M/N 904 9’ Wide +52/-58 psf”, sheets 1 through 4 of 4, dated 09/22/2020, with revision 4 dated 09/06/23, prepared by Clopay Corporation, signed and sealed by Mark Westerfield, P.E. on 09/14/2023.

B. TESTS

- 1. None.

C. CALCULATIONS

- 1. None.

D. QUALITY ASSURANCE


- 1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

- 1. None.

G. STATEMENTS

- 1. Statement letter of code conformance to the 8<sup>th</sup> edition (2023) and 7<sup>th</sup> edition (2020) of the FBC, issued by Clopay Corporation, dated 09/15/2023, signed and sealed by Mark Westerfield, P.E.
- 2. Statement letter of no financial interest issued by Clopay Corporation, dated 09/15/2023, signed and sealed by Mark Westerfield, P.E.


  
Helmy A. Makar, P.E., M.S.  
Product Control Section Supervisor  
NOA-No 23-0928.60  
Expiration Date: 09/30/2026  
Approval Date: 12/21/2023



BRAND	MODEL
CLOPAY	904, 904U, AX, AXU
IDEAL	C4AL, C4ALU


SHEET:  
1 OF 4

REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
01		7/21		MWW	UPDATE PER M-D REQUEST; ADDED PAGE 4
02		9/21		MWW	UPDATED DLO PER TEST ADDENDUM
03		4/22		MWW	SWITCH TO SNAP-IN BEAD, SB100 & 1-1/2" TEK SCREWS
04		9/6/23		JDW	ADDED CODE COMPLIANCE STATEMENT.

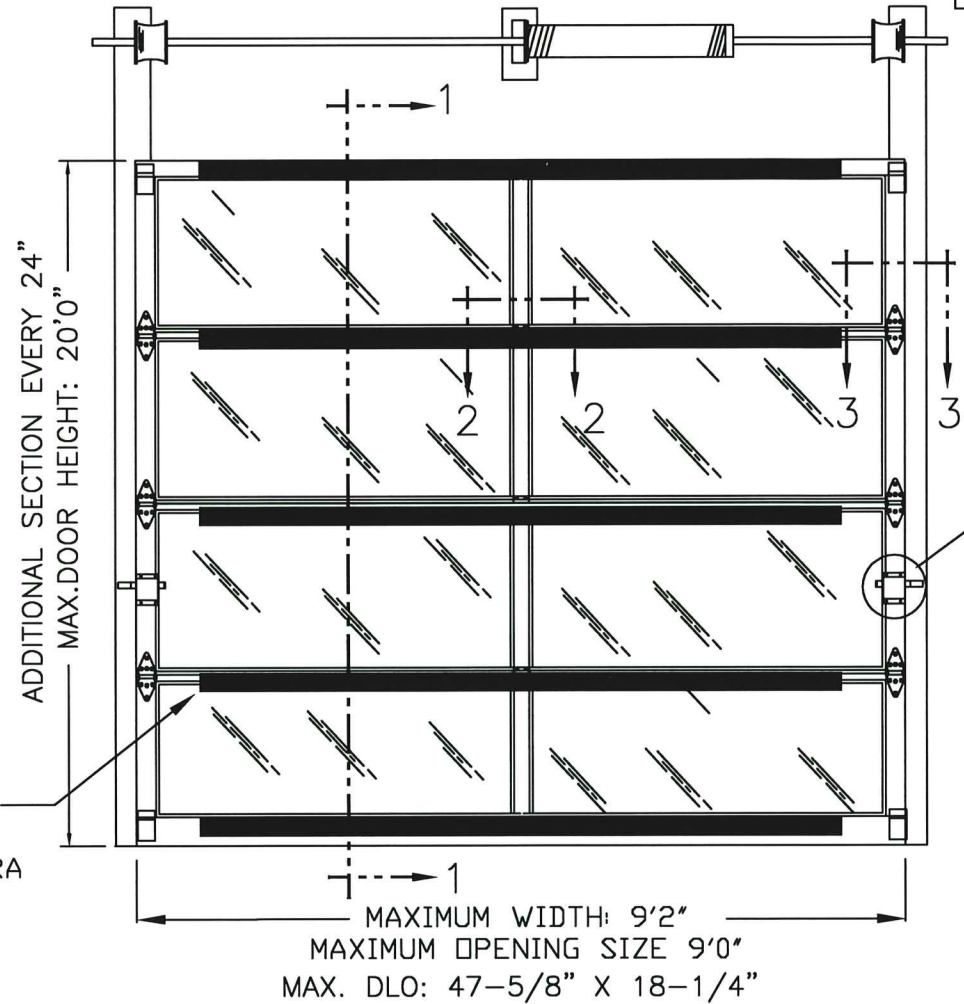

THIS PRODUCT CONFORMS TO THE REQUIREMENTS OF 7TH AND 8TH EDITION OF THE FLORIDA BUILDING CODE

SECTION 2 - 2

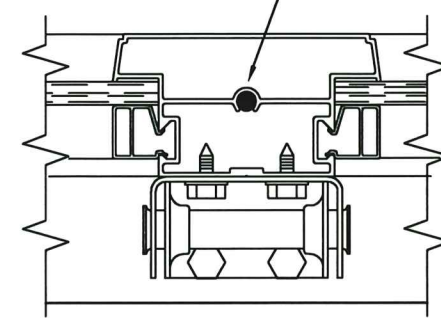


CENTER STILES FASTENED TO RAILS WITH FULL LENGTH 1/4" DIA. THREADED STEEL RODS AND FLANGE NUTS.

CENTER HINGES (SEE DETAILS ON PAGE 4) ATTACHED TO INTERM. BOTTOM RAIL WITH (2) #14x5/8" SMS AND TO FIN ON INTERM. TOP RAIL WITH (2) 1/4-20x1" HEX HEAD MACHINE SCREWS AND NUTS.

SECTIONS PER DOOR HEIGHT	
UP TO 6'0"	3
FROM 6'1" TO 8'0"	4
FROM 8'1" TO 10'0"	5
FROM 10'1" TO 12'0"	6
FROM 12'1" TO 14'0"	7
FROM 14'1" TO 16'0"	8
FROM 16'1" TO 18'0"	9
FROM 18'1" TO 20'0"	10

DOORS UP TO 4'8" SHALL HAVE (1) PANEL; DOORS 4'9" TO 9'2" SHALL HAVE AT LEAST (2) PANELS PER SECTION.

SECTION 1 - 1

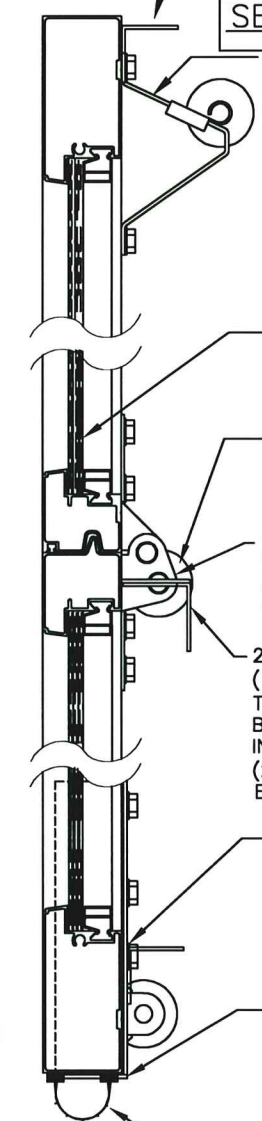

2" x 2" x 1/8" ALUMINUM ANGLE ON TOP SECTION AND BOTTOM OF BOTTOM SECTION ATTACHED WITH (1) 1/4"x3/4" SELF-TAPPING SCREW PER STILE LOCATION.

ADJUSTABLE TOP ROLLER BRACKET OF 12 GA. GALV. STEEL FASTENED WITH (4) #14 x 5/8" SHT MTL SCREWS.

LAMINATED GLASS (SEE "GLAZING DETAIL" ON PAGE 2 FOR DETAILS)

SHORT-STEM NYLON TIRE 10 BALL ROLLERS.

14 GA. ROLLER HINGES ATTACHED WITH (4) #14x5/8" SMS ALONG CENTER OF EACH HINGE AND (4) 1/4"x3/4" SELF TAPPING SCREWS


2"x2"x1/8" L-ANGLE REINFORCEMENT, (1) ATTACHED TO EACH INTEGRAL TOP RAIL FIN, WITH (2) 1/4" HEX BOLTS AND FLANGE NUTS AT EACH INTERMEDIATE HINGE LOCATION, AND (2) 3/8" BOLTS AND NUTS, (1) AT EACH END OF THE L-ANGLE.

BOTTOM ROLLER BRACKET OF 11 GA. GALV. STEEL, FASTENED WITH (4) #14 x 5/8" SHEET METAL SCREWS.

BOTTOM SECTION USES A TEMPERED ALUMINUM EXTRUSION WITH INTEGRAL RETAINER FOR FOR INSTALLATION OF FLEXIBLE VINYL ASTRAGAL. SEE PAGE 4.

FLEXIBLE VINYL ASTRAGAL.

SECTION 3-3

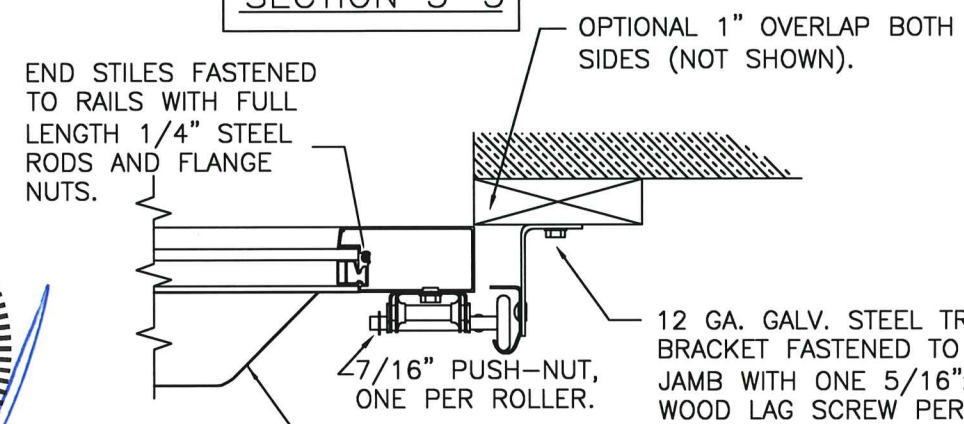

END STILES FASTENED TO RAILS WITH FULL LENGTH 1/4" STEEL RODS AND FLANGE NUTS.

OPTIONAL 1" OVERLAP BOTH SIDES (NOT SHOWN).



7/16" PUSH-NUT, ONE PER ROLLER.

12 GA. GALV. STEEL TRACK BRACKET FASTENED TO WOOD JAMB WITH ONE 5/16"x1-5/8" WOOD LAG SCREW PER BRACKET.

INTERGAL FIN ON INTER. TOP RAILS NOTCH CUT AT END STILES.

SEE PAGE 2 FOR DIFFERENT JAMB CONFIGURATIONS.

14 GAUGE ROLLER HINGE FASTENERS

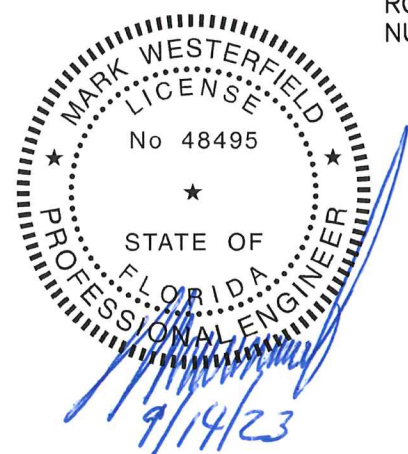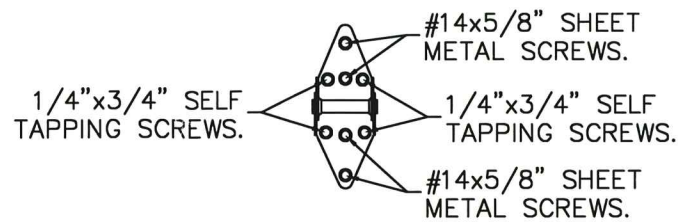

DESIGN ENGINEER:  
MARK WESTERFIELD, P.E.  
FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 23-0928.60  
Expiration Date 09/30/2026  
By *[Signature]*  
Miami Dade Product Control



DESIGN LOADS: +52.0, -58.0 PSF

<b>Clopay CORPORATION</b>		8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853	CLOPAY WINDLOAD RATING <b>W8</b>
DESCRIPTION: M/N 904 9' WIDE +52/-58 PSF			
DRAWN BY: SH	DATE: 9/22/20	SCALE:	DWG. <b>B</b>
CHECKED BY: MWW	DATE: 7/7/21	SHEET 1 OF 4	
DWG. NO.: 105611	VERSION: M-D		



BRAND	MODEL
CLOPAY	904, 904U, AX, AXU
IDEAL	C4AL, C4ALU

SHEET:		REVISIONS					DESCRIPTION
2 OF 4		REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	
		--	--	---	--	--	
SEE PAGE 1 FOR REVISION DETAILS							

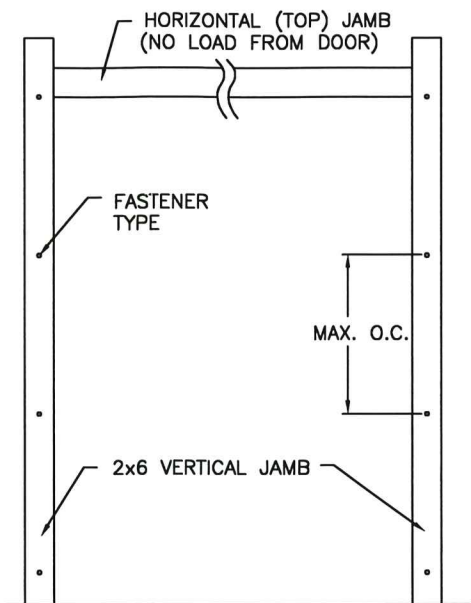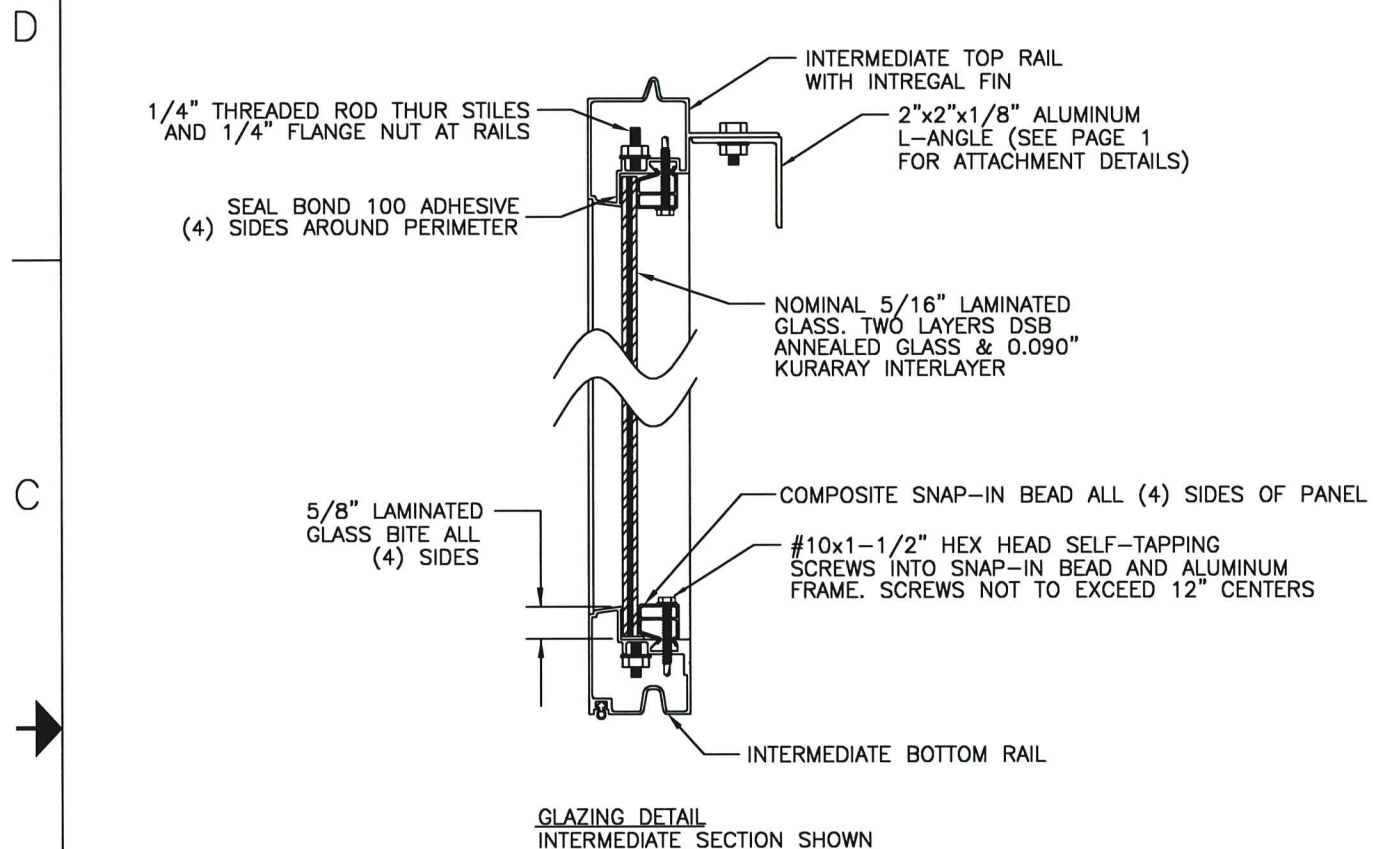

### JAMB TO SUPPORTING STRUCTURE ATTACHMENT

- NOTES:**
1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE TRACK AND THEN FROM THE TRACK TO THE 2x6 VERTICAL SYP (GRADE #2 OR BETTER) JAMBS. NO LOAD FROM THE DOOR IS TRANSFERRED TO THE HORIZONTAL (TOP) JAMB.
  2. EACH VERTICAL JAMB SEES A MAXIMUM DESIGN LOAD OF +234 LB. PER LINEAR FOOT OF JAMB.
  3. ALL JAMB FASTENERS MAY BE (BUT ARE NOT REQUIRED TO BE) COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
  4. A 1/3 STRESS INCREASE FOR WIND LOAD WAS NOT USED IN THE CALCULATION OF ALLOWABLE LOADS FOR ANCHORS AND FASTENERS FOR STEEL, CONCRETE AND MASONRY.

### PREPARATION OF JAMBS BY OTHERS


**NOTE:** THE DESIGN OF THE SUPPORTING STRUCTURAL ELEMENTS SHALL BE THE RESPONSIBILITY OF THE PROFESSIONAL OF RECORD FOR THE BUILDING OR STRUCTURE AND IN ACCORDANCE WITH CURRENT BUILDING CODES FOR THE LOADS LISTED ON THIS DRAWING.

**2x6 JAMB TO SUPPORTING STRUCTURE ATTACHMENT**  
(NOT TO BE USED FOR ATTACHMENT OF TRACK ANGLE TO 2x6 VERTICAL JAMBS OR SUPPORTING STRUCTURE)

BUILDING TYPE	FASTENER TYPE	MAXIMUM ON-CENTER DISTANCE BETWEEN FASTENERS*	STEEL WASHERS REQUIRED?
BLOCK WALL	1/4" x 1-1/4" EMBED ULTRACON CONCRETE ANCHOR	7"	NO
GROUT-FILLED BLOCK WALL	1/4" x 1-3/4" EMBED ULTRACON CONCRETE ANCHOR	11-3/4"	NO
2,846 PSI MIN. CONCRETE	1/4" x 1-3/4" EMBED ULTRACON CONCRETE ANCHOR	24"	NO
2,000 PSI MIN. CONCRETE	1/4" x 1-3/4" EMBED ULTRACON CONCRETE ANCHOR	22-1/2"	NO
2,500 PSI MIN. CONCRETE	3/8" x 1-3/4" EMBED ITW TRIBOLT WEDGE CONCRETE ANCHOR WITH SYP 0.55 SG	22-1/4"	1" O.D.
WOOD FRAME (SYP 0.55 SG)	1/2" x 1-1/2" EMBED LAG SCREW WITH 1-3/8" O.D. WASHER	24"	YES
14 GA MIN. STEEL JAMB	1/4" -14 ITW BUILDEX TEKS SELF-DRILLING FASTENER	12-1/4"	NO
12 GA MIN. STEEL JAMB	1/4" -14 ITW BUILDEX TEKS SELF-DRILLING FASTENER	17"	NO
1/8" MIN. STEEL JAMB	1/4" -14 ITW BUILDEX TEKS SELF-DRILLING FASTENER	20-1/4"	NO

**NOTE:** FOR DOORS WITH CONTINUOUS OR REVERSE ANGLE TRACK, THESE VALUES CAN BE USED TO DIRECTLY ATTACH THE TRACK TO THE WALL.

\* FIRST (BOTTOM) ANCHOR STARTING AT NO MORE THAN HALF OF THE MAXIMUM ON-CENTER DISTANCE. HIGHEST ANCHOR INSTALLED AT LEAST AS HIGH AS THE DOOR OPENING.  
CLOPAY DOES NOT SUPPLY JAMB ATTACHMENT FASTENERS.  
MINIMUM DISTANCE BETWEEN CENTER OF ANCHOR AND EDGE OF CONCRETE BLOCK: 2-1/2", EXCLUDING STUCCO THICKNESS.

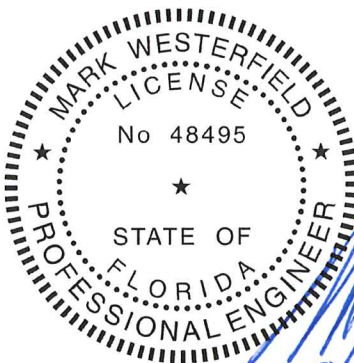

DESIGN ENGINEER:  
MARK WESTERFIELD, P.E.  
FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 23-0924.00  
Expiration Date 04/30/2026  
By *H. A. Miller*  
Miami Design Product Control

<b>Clopay CORPORATION</b>		8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853	CLOPAY WINDLOAD RATING <b>W8</b>
DESCRIPTION: M/N 904 9' WIDE +52/-58 PSF			
DRAWN BY: SH	DATE: 9/22/20	SCALE:	DWG. SIZE <b>B</b>
CHECKED BY: MWW	DATE: 7/7/21	SHEET 2 OF 4	
DWG. NO.: 105611		VERSION: M-D	




BRAND	MODEL
CLOPAY	904, 904U, AX, AXU
IDEAL	C4AL, C4ALU


SHEET		REVISIONS					DESCRIPTION
3	OF 4	REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	
		--	--	--	--	--	
SEE PAGE 1 FOR REVISION DETAILS							

NOTE: HORIZONTAL TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING OF THIS DOOR.

## 2" TRACK CONFIGURATION

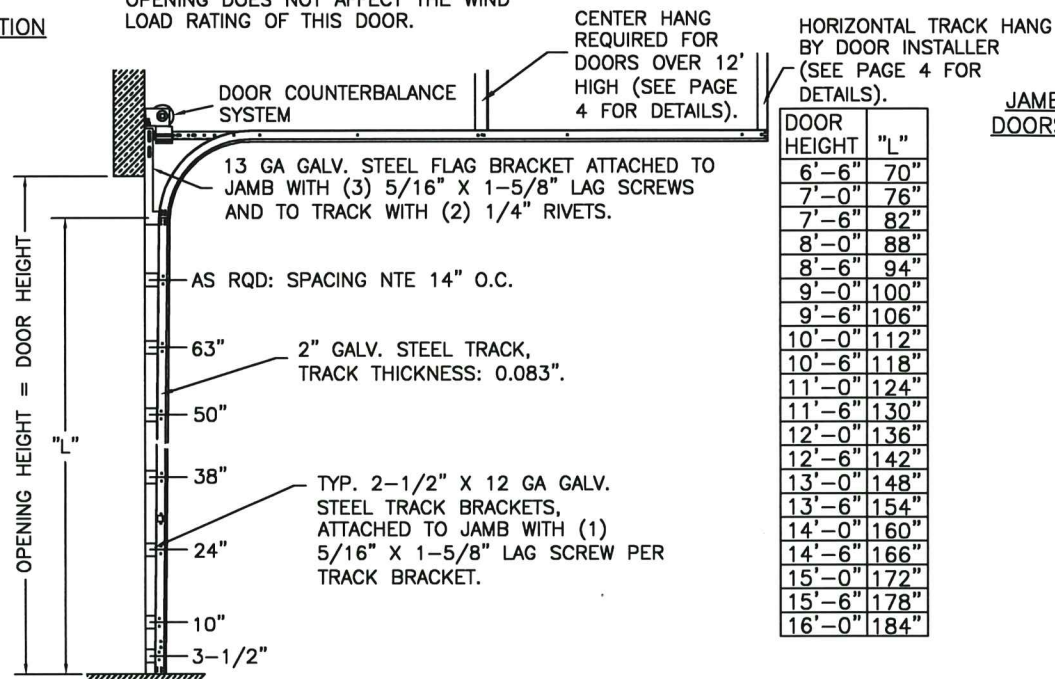


## JAMB CONFIGURATION DOORS WITH 2" TRACK.

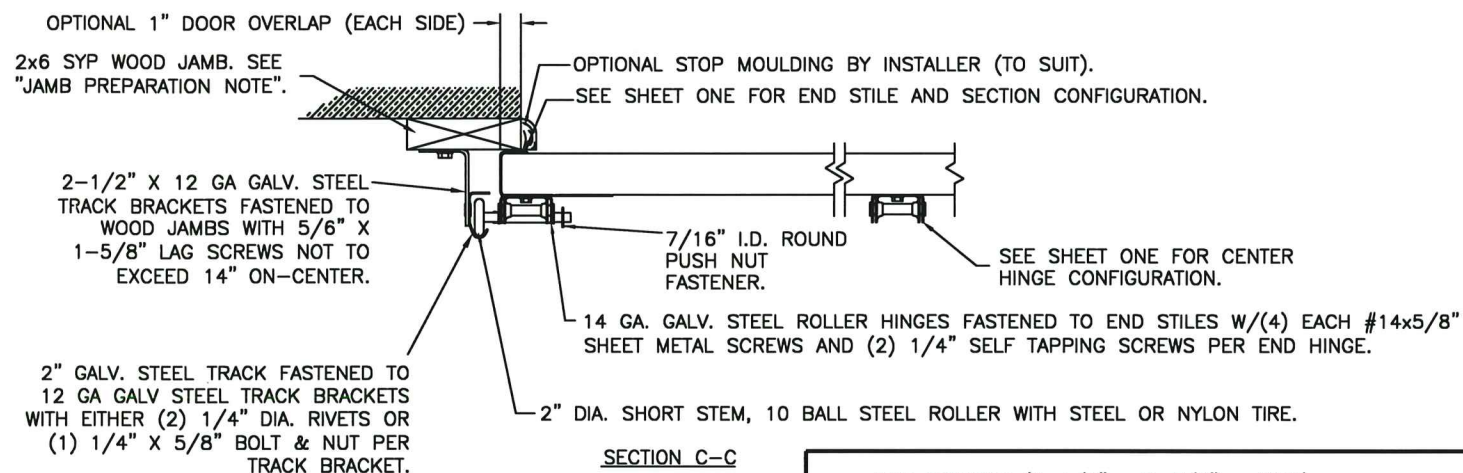


NOTE: HORIZONTAL TRACK CONFIGURATION ABOVE THE DOOR OPENING DOES NOT AFFECT THE WIND LOAD RATING OF THIS DOOR.

## 3" TRACK CONFIGURATION


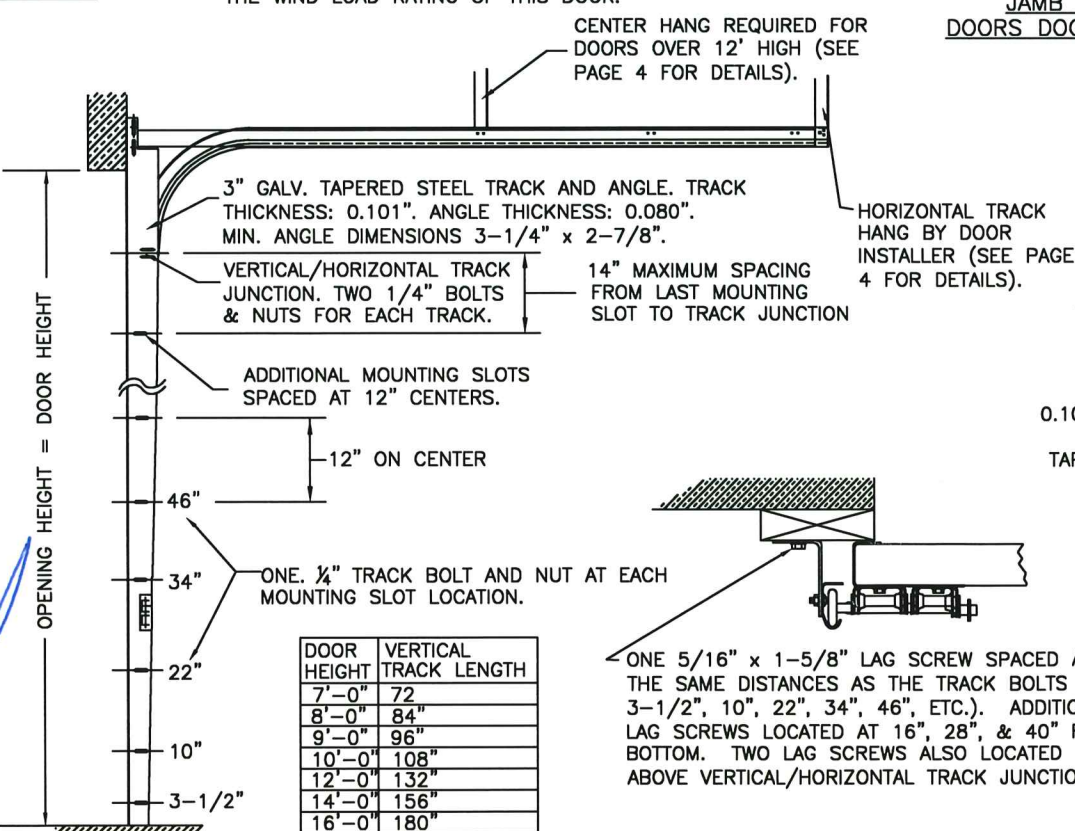


## JAMB CONFIGURATION DOORS WITH 3" TRACK.

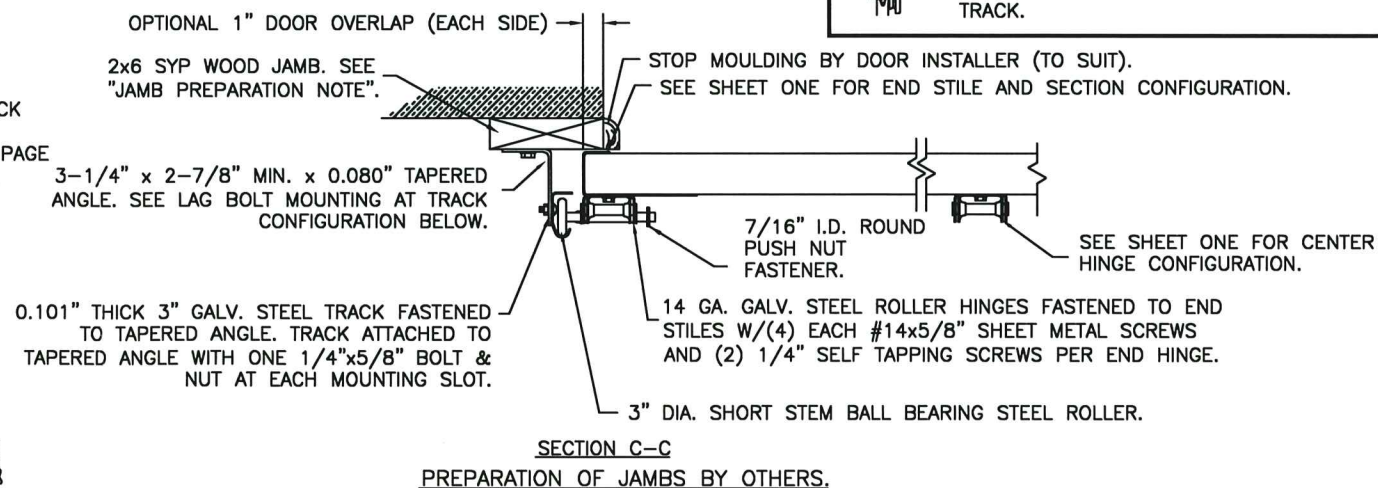

LHR BRACKET (2-1/2" X 5-3/4" X 12GA) ATTACHED WITH (2) 1/4" X 3/4" SELF TAPPING SCREWS. NOTE THAT LHR BRACKETS ARE ALSO USED WITH "DOUBLE END STILE" AS SHOWN IN ZONE B-3 SHEET 1.

DOUBLE TRACK LOW HEADROOM OPTION (AVAIL. FOR BOTH 2" AND 3" TRACK)

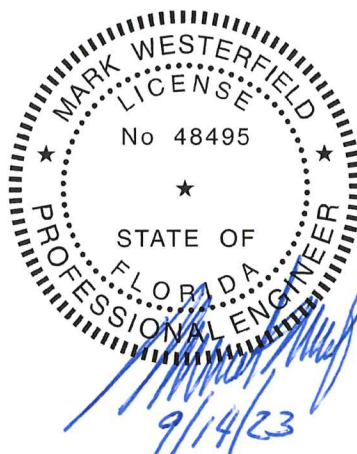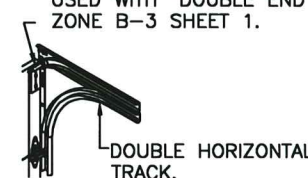

DESIGN ENGINEER:  
MARK WESTERFIELD, P.E.  
FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 23-0924.60  
Expiration Date 09/30/2026  
By *[Signature]*  
Miami Data Product Control

<b>Clopay CORPORATION</b>		8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853	CLOPAY WINDLOAD RATING <b>W8</b>
DESCRIPTION: M/N 904 9' WIDE +52/-58 PSF			
DRAWN BY: SH	DATE: 9/22/20	SCALE:	DWG. SIZE <b>B</b>
CHECKED BY: MWW	DATE: 7/7/21	SHEET 3 OF 4	
DWG. NO.: 105611	VERSION: M-D		




BRAND	MODEL
CLOPAY	904, 904U, AX, AXU
IDEAL	C4AL, C4ALU

# ALUMINUM PROFILES, HARDWARE & TRACK PARTS

SHEET:  
4 OF 4


REVISIONS					
REV. NO.	ZONE:	DATE:	ECN NO.	APPVD:	DESCRIPTION
--	--	---	--	--	SEE PAGE 1 FOR REVISION DETAILS

D

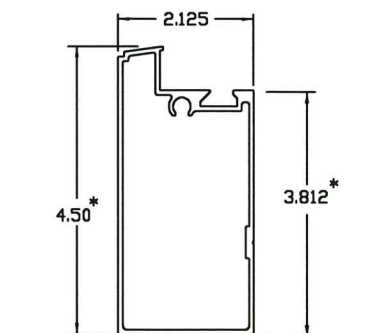


END STILE, BOTTOM & TOP RAIL  
105008 - .075" WALL  
\* DOORS WITH 1" JAMB OVERLAP THESE  
END STILE DIMENSIONS ARE 1" LONGER  
(5.50 & 4.812)

C

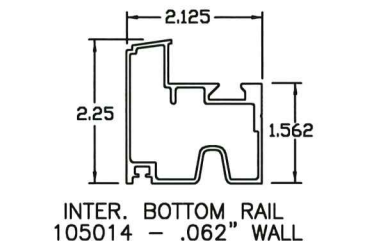


INTER. BOTTOM RAIL  
105014 - .062" WALL

B

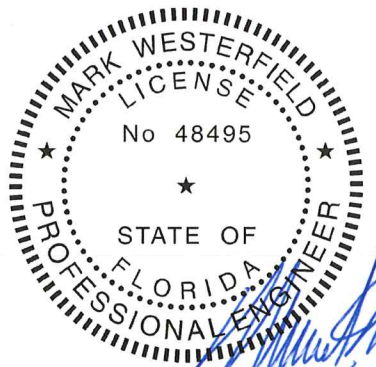


DESIGN ENGINEER:  
MARK WESTERFIELD, P.E.  
FLORIDA P.E. #48495, NC P.E. #23832, TEXAS P.E. #91513


4

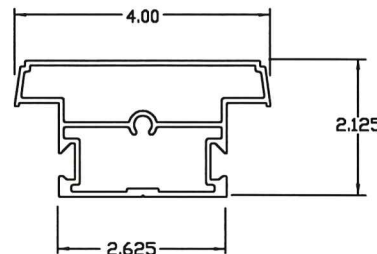

CENTER STILE  
105011 - .075" WALL

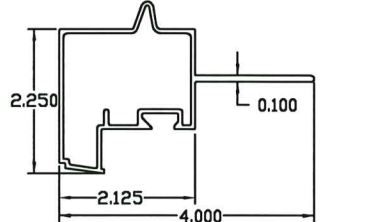


INTER. TOP RAIL W/FIN  
105012 - .062" WALL




BOTTOM ASTRAGAL RETAINER  
100624 - .050" WALL

3

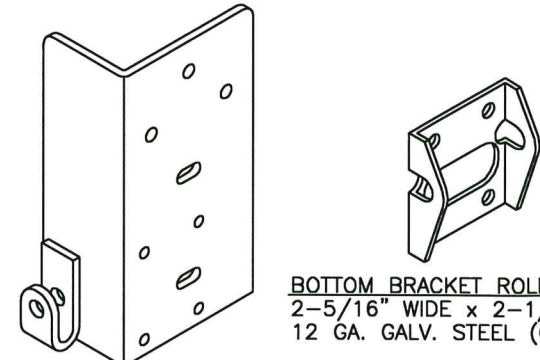


BOTTOM BRACKET ROLLER CARRIER  
2-5/16" WIDE x 2-1/2" TALL  
12 GA. GALV. STEEL (0.097" THICK)

BOTTOM BRACKET  
3-1/8" WIDE x 6" TALL x 1-7/8" DEEP  
11 GA. GALV. STEEL (0.114" THICK)

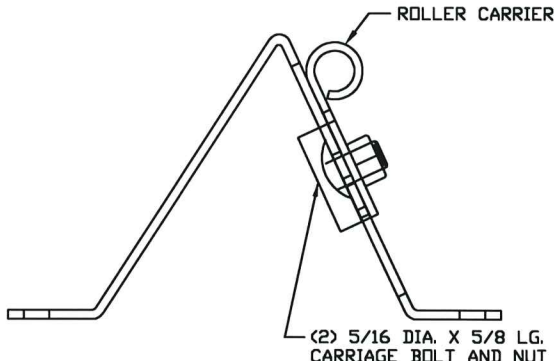

TOP ROLLER BRACKET  
5-3/8" LONG x 3-1/8" TALL x 2-3/4" WIDE  
MAIN PART: 12 GA. GALV STEEL (0.099")  
ROLLER CARRIER: 13 GA. GALV STEEL (0.085")


SEE HANG DETAIL A-A

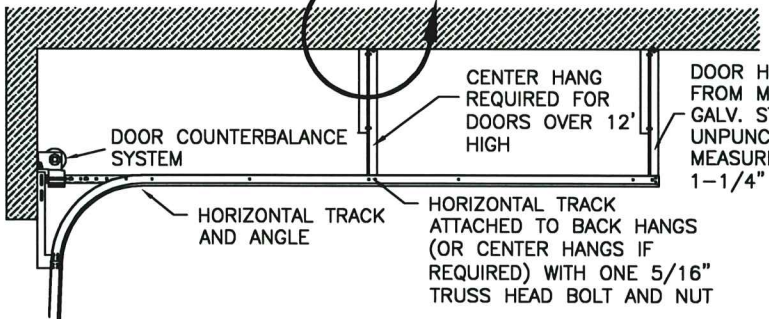


HORIZONTAL TRACK  
STANDARD LIFT TRACK SHOWN.  
LOW HEADROOM, HIGH LIFT AND VERTICAL LIFT  
TRACK ALSO AVAILABLE.

3


2

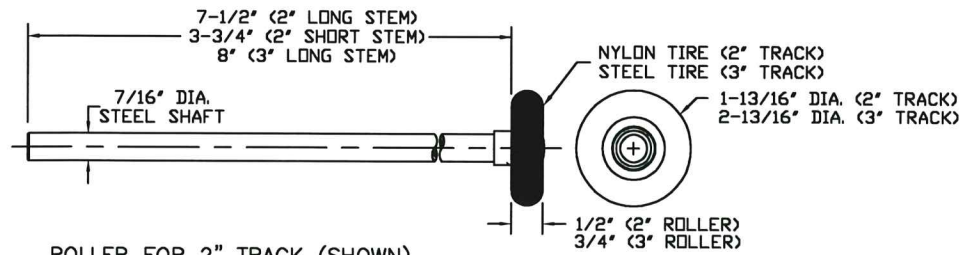

ROLLER FOR 2" TRACK (SHOWN)  
ROLLER FOR 3" TRACK FOR DOORS OVER 800 LB.  
OR OPTIONAL FOR DOORS LESS THAN 800 LB.

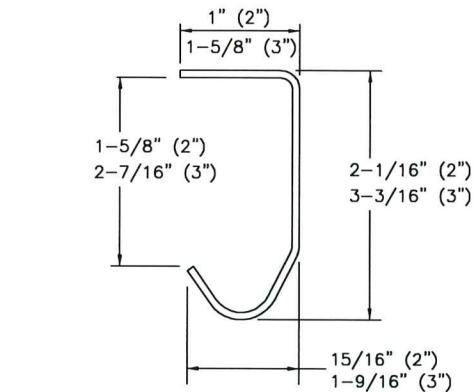


TRACK (2" AND 3")  
0.075" OR 0.083" GALV. STEEL (2")  
0.101" GALV. STEEL (3")

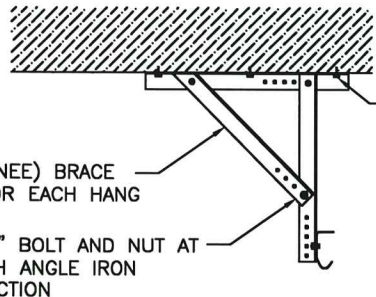


HANG DETAIL A-A  
HANGS CAN BE MOVED TO MATCH CEILING STRUCTURE

ANGLE IRON ATTACHMENT  
WOOD (MIN 0.5 S.G.):  
(3) MIN. 5/16" X 1-1/2" EMBED  
LAG SCREWS WITH WASHER  
2,000 MIN. PSI CONCRETE  
(3) MIN. 1/4" x 1-3/4" EMBED  
CONCRETE ANCHOR WITH WASHER  
NOTE: SCREW EMBEDMENT TO EXCLUDE  
STUCCO OR FALSE CEILINGS.

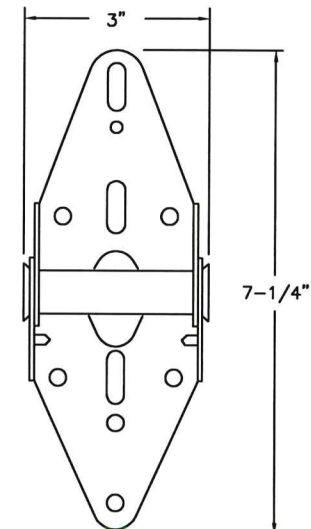

END ROLLER HINGE  
14 GA. (0.071" MIN) GALV. STEEL  
(8) 1/4" x 3/4" SELF-  
TAPPING SCREWS PER HINGE

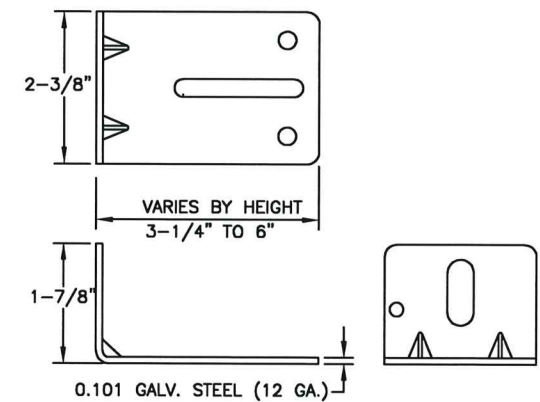

TRACK BRACKETS  
ATTACHED TO VERTICAL TRACKS

D

C

B

A

PRODUCT REVISED  
as complying with the Florida  
Building Code  
Acceptance No. 23-0928-60  
Expiration Date 09/30/2026  
By H. G. A. Mc  
Miami Code Product Control

<b>Clopay</b> CORPORATION		8585 Duke Boulevard Mason, OH 45040 USA Tel. No. 513-770-4800 Fax No. 513-770-4853	CLOPAY WINDLOAD RATING W8
DESCRIPTION: M/N 904 9' WIDE +52/-58 PSF			
DRAWN BY: SH	DATE: 9/22/20	SCALE:	DWG. SIZE B
CHECKED BY: MWW	DATE: 7/7/21	SHEET 4 OF 4	
DWG. NO.: 105611	VERSION: M-D		

2

1