



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

Tecnoglass, LLC
3550 NW 49 Street
Miami, FL 33142

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series "HP-3060" Aluminum Window Wall System – L.M.I.

APPROVAL DOCUMENT: Drawing No. **W03-108**, titled "HP3060 Alum. Window Wall System (L.M.I.)", sheets 1 through 7 of 7, dated 12/01/03, with revision **I** dated 09/20/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, **Barranquilla, Colombia S.A.**, series and following statement: "Miami-Dade County Product Control Approved" unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/ or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.


ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises and renews** NOA No. **21-0225.05** and consists of this page 1, evidence pages E-1, E-2, E-3 and E-4, as well as approval document mentioned above.

The submitted documentation was reviewed by **Manuel Perez, P.E.**




1/3/24

NOA No. 23-1012.10
Expiration Date: April 01, 2025
Approval Date: January 11, 2024
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED


1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 03-1224.04)
2. Drawing No. **W03-108**, titled "HP3060 Alum. Window Wall System (L.M.I.)", sheets 1 through 7 of 7, dated 12/01/03, with revision **H** dated 11/20/20, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 21-0225.05)

B. TESTS

1. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Small Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
6) Safety Performance Test, (class A) per ANSI Z97.1 Class A
7) Forced Entry Test, Type "B window" fixed window, Grade 10, LV 1 per ASTM F 588 and per FBC 2411 3.2.1, TAS 202-94
along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-5739** dated 11/14/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 09-0324.01)
2. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Report No. **FTL-2993**, dated 03/19/01, signed and sealed by Luis Antonio Figueredo, P.E.
(Submitted under NOA No. 03-1224.04)


Manuel Perez, P.E.
Product Control Examiner
NOA No. 23-1012.10
Expiration Date: April 01, 2025
Approval Date: January 11, 2024

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)

B. TESTS (CONTINUED)

3. Test reports on: 1) Air Infiltration Test, per FBC, TAS 202-94
2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
3) Water Resistance Test, per FBC, TAS 202-94
4) Large Missile Impact Test per FBC, TAS 201-94
5) Cyclic Wind Pressure Loading per FBC, TAS 203-94
along with marked-up drawings and installation diagram of an aluminum window wall system, prepared by Fenestration Testing Laboratory, Inc., Test Reports No. **FTL-2618, FTL-2356 & FTL-2172**, dated 08/23/00, 07/19/99 and 11/16/98, respectively, all signed and sealed by Edmundo J. Largaespada, P.E.
(Submitted under NOA No. 03-1224.04)

C. CALCULATIONS


1. Anchor verification calculations and structural analysis, complying with FBC 5th Edition (2014), dated 04/25/16, revised on 09/21/17 to comply with FBC 6th Edition (2017), and updated on 02/02/21 to comply with FBC 7th Edition (2020), prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 21-0225.05)
2. Glazing complies with **ASTM E 1300-09**

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. Notice of Acceptance No. **18-0725.11** issued to **Kuraray America, Inc.** for their "**Kuraray SentryGlas® Xtra™ (SGX™) Clear Glass Interlayer**" dated 05/23/19, expiring on 05/23/24.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 23-1012.10
Expiration Date: April 01, 2025
Approval Date: January 11, 2024


NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's (CONTINUED)
F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, and of no financial interest, dated February 02, 2021, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
(Submitted under NOA No. 21-0225.05)
2. Asset purchase agreement dated 06/19/14, signed by Mr. Raul Casares, for and on behalf of R.C. Aluminum Industries, Inc. and Mr. José M. Daes, for and on behalf of Tecnoglass, LLC.
(Submitted under NOA No. 17-0505.08)
3. Statement letter dated 07/15/14, issued by R.C. Aluminum Industries, Inc. of sales of asset and relinquishing of all rights of NOA No. **12-0330.14**, signed by Raul Casares, for and on behalf of R.C. Aluminum Industries, Inc.
(Submitted under NOA No. 17-0505.08)
4. Department of State Certification of **TECNOGLASS, LLC** as a limited liability company, active and organized under the laws of the State of Florida, dated 03/03/14 and signed by Ken Detzner, Secretary of State.
(Submitted under NOA No. 17-0505.08)
5. Laboratory compliance letters prepared by Fenestration Testing Laboratory, Inc., for Test Reports No.:
FTL-5739 dated 11/14/08, signed and sealed by Carlos S. Rionda, P.E.
(Submitted under NOA No. 09-0324.01)
FTL-2993, dated 03/19/01, signed and sealed by Luis Antonio Figueredo, P.E.
(Submitted under NOA No. 03-1224.04)
FTL-2618, **FTL-2356** and **FTL-2172**, dated 08/23/00, 07/19/99 and 11/16/98, respectively, all signed and sealed by Edmundo J. Largaespada, P.E.
(Submitted under NOA No. 03-1224.04)

G. OTHERS

1. Notice of Acceptance No. **18-0821.06**, issued to Tecnoglass, LLC for their Series "HP-3060" Aluminum Window Wall System – L.M.I., approved on 10/04/18 and expiring on 04/01/24.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 23-1012.10
Expiration Date: April 01, 2025
Approval Date: January 11, 2024

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **W03-108**, titled “HP3060 Alum. Window Wall System (L.M.I.)”, sheets 1 through 7 of 7, dated 12/01/03, with revision **I** dated 09/20/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.

B. TESTS

1. None

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. Notice of Acceptance No. **22-1116.01** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**” dated 12/15/22, expiring on 07/04/28.


F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 7th Edition (2020)**, with **FBC 8th Edition (2023)** and of no financial interest, dated September 26, 2023, issued by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
2. Letter from professional engineer requesting a 1-year extension to allow time to perform verification test, dated 09/26/23, prepared by Al-Farooq Corporation, signed and sealed by Jalal Farooq, P.E.
3. Testing agreement letter, dated 09/27/23, between QAI Laboratories and Tecnoglass, LLC, issued by QAI Laboratory, Inc. and signed by Lusinda Delgado, Technical Report Writer.

G. OTHERS

1. Notice of Acceptance No. **21-0225.05**, issued to Tecnoglass, LLC for their Series “HP-3060” Aluminum Window Wall System – L.M.I., approved on 04/29/21 and expiring on 04/01/24.
2. This is a one-year approval, subjected to successful verification test, the final approval will be issued for a total of 5 years.


Manuel Perez, P.E.
Product Control Examiner
NOA No. 23-1012.10
Expiration Date: April 01, 2025
Approval Date: January 11, 2024

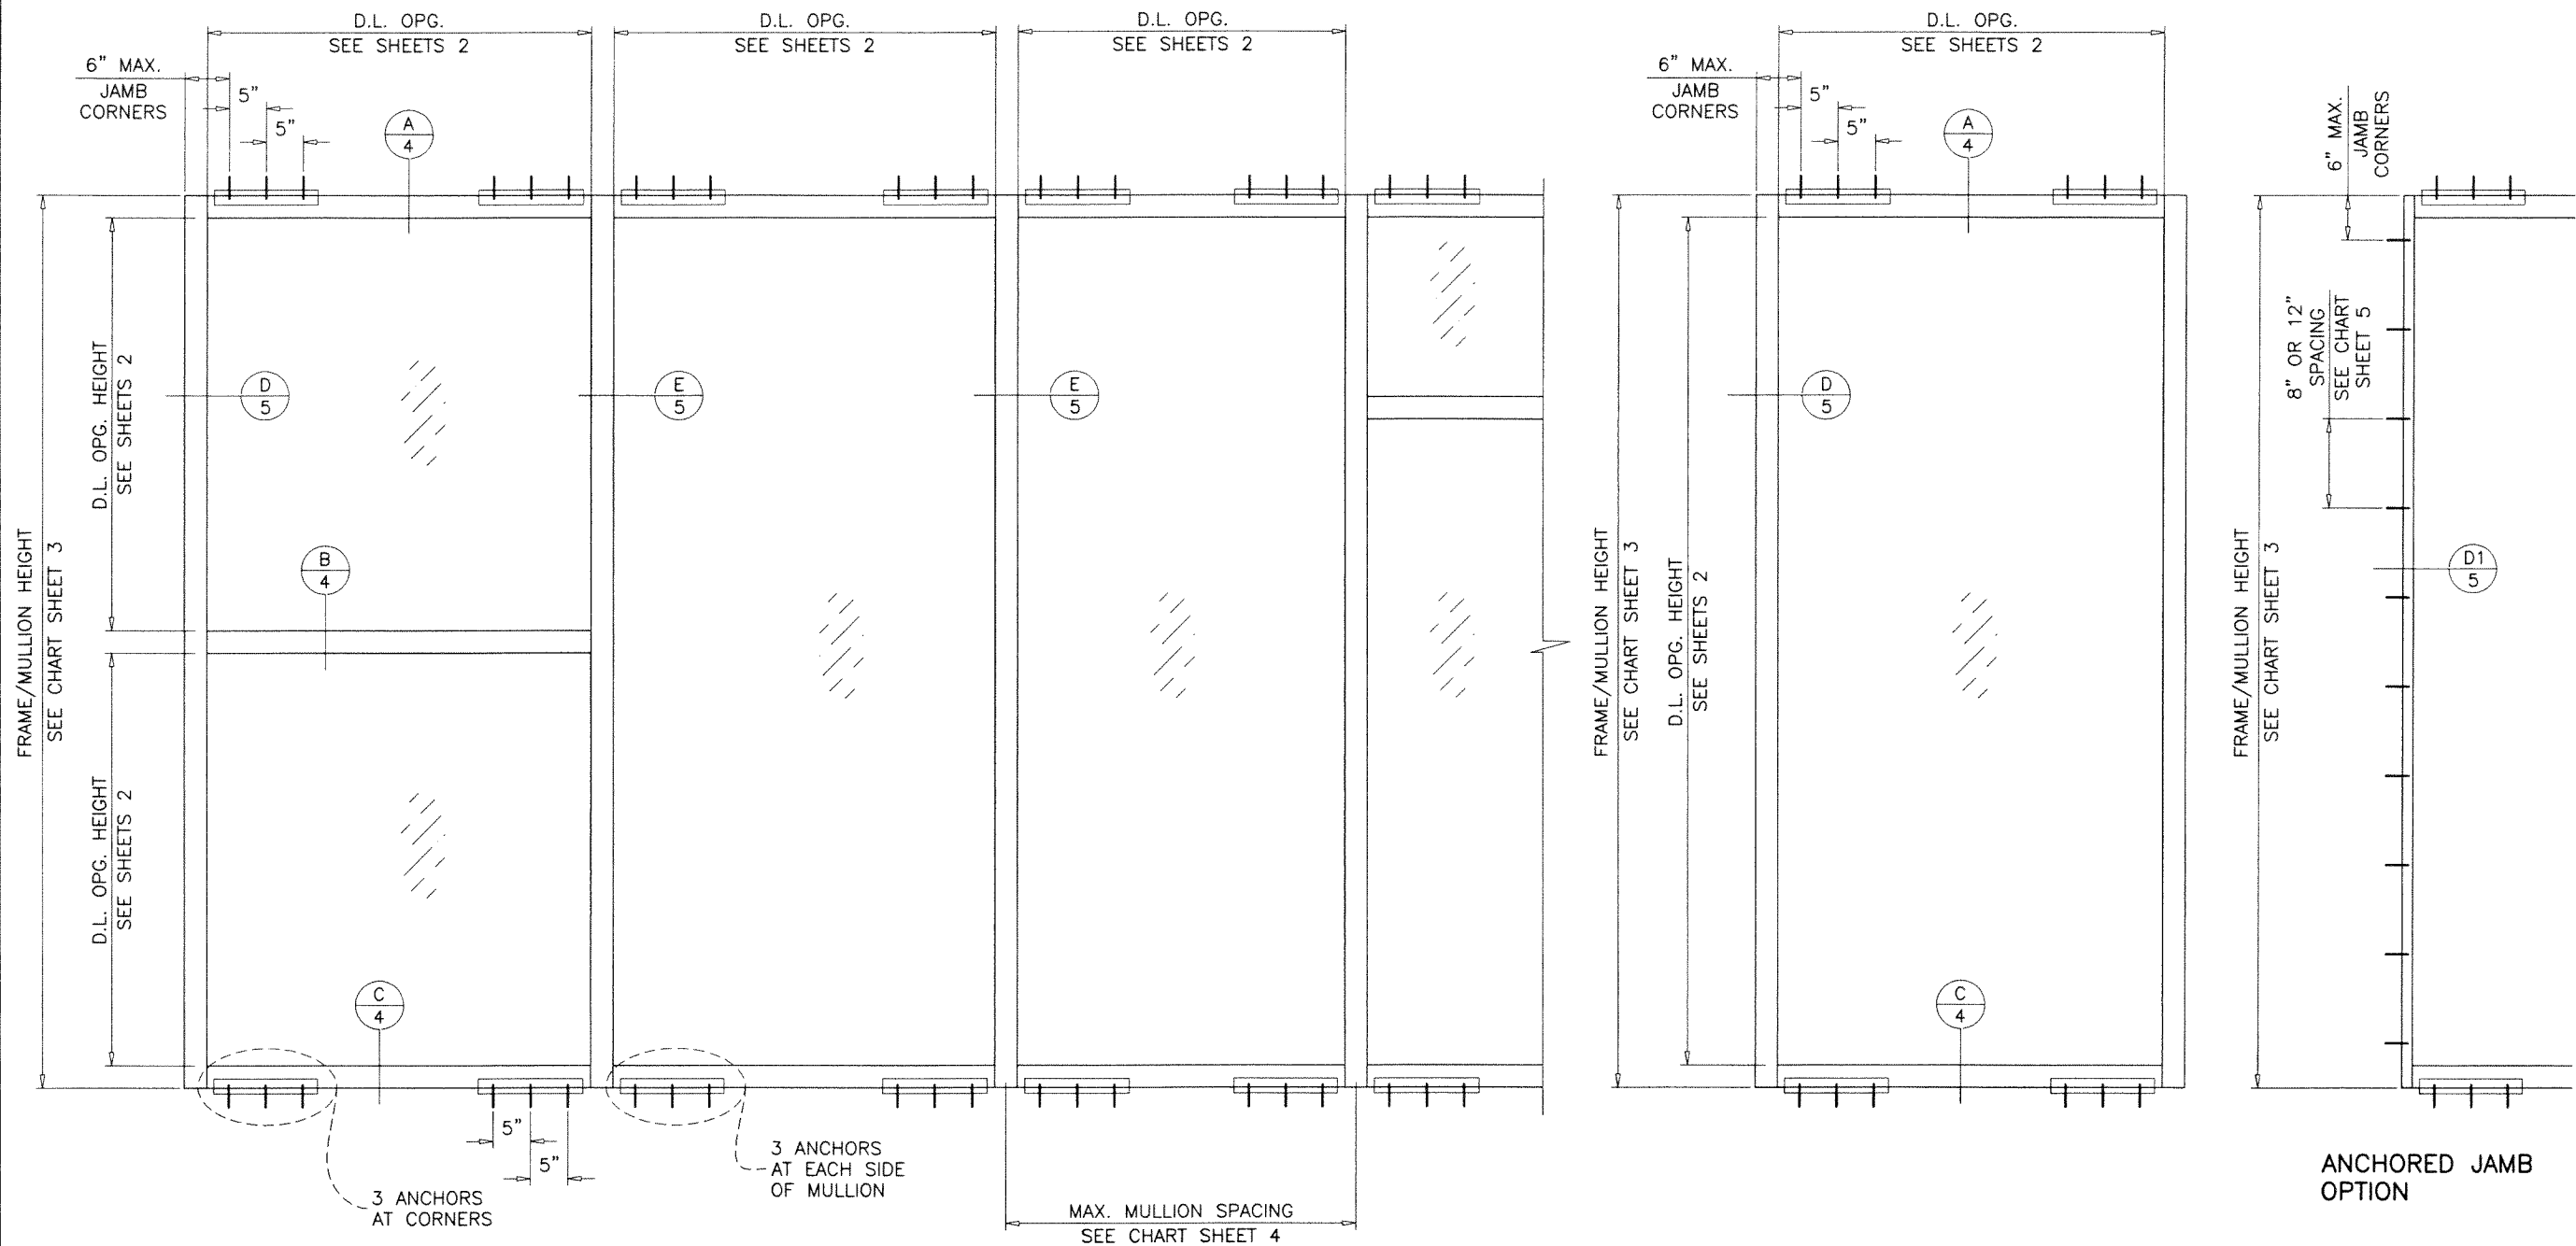

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)

THIS SYSTEM IS RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2020 (7TH EDITION)/2023 (8TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2020/2023 FLORIDA BLDG. CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC. CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.

DESIGN LOADS SHOWN ARE BASED ON 'ALLOWABLE STRESS DESIGN (ASD)'.

TYPICAL ELEVATIONS

INSTRUCTIONS:

USE CHARTS AS FOLLOWS.

- STEP 1** DETERMINE DESIGN WIND LOAD REQUIREMENT BASED ON WIND VELOCITY, BLDG. HEIGHT, WIND ZONE USING APPLICABLE ASCE 7 STANDARD.
- STEP 2** SEE CHARTS ON SHEETS 2 FOR DESIGN LOAD CAPACITY OF DESIRED GLASS SIZE.
- STEP 3** CHECK MULLION AND JAMB CAPACITY FOR A GIVEN SPACING AND HEIGHT USING CHARTS ON SHEET 3. THE CAPACITY SHOULD EXCEED THE DESIGN LOAD.
- STEP 4** THE LOWEST VALUE RESULTING FROM STEPS 2 AND 3 SHALL APPLY TO ENTIRE SYSTEM.

DAYLITE OPENINGS:

D.L.O. HEIGHT = FRAME HEIGHT - 6"

D.L.O. WIDTH = FRAME WIDTH - 6"

WINDOW WALL SYSTEM WITH GLASS TYPES 'A', 'A1' & 'A2'
COMPLIES WITH REQUIREMENTS OF ANSI Z97.1.


PRODUCT REVISED
As complying with the Florida
Building Code

NOA-No. **23-1012.10**

Expiration Date: **04/01/2025**

By: *Manuel Ferraz*
Miami-Dade Product Control

SEP 22 2023

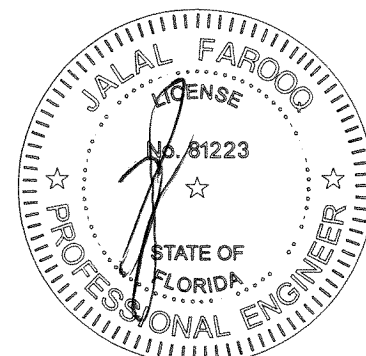

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE\W03-108RC

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)
TECNOGLASS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

no	date	by	description
E	08.05.14	MANUF. NAME	REV.
F	05.13.16	UPDATED TO 2014 FBC	
G	10.04.17	REV. PER PER COMMENTS	
H	11.20.20	UPDATED TO 2020 FBC	
I	09.20.23	UPDATED TO 2023 FBC	


date: 12-01-03
scale: 1/2"=1'-0"
dr. by: TARIQ
chk. by:

drawing no.

W03-108

sheet 1 of 7


GLASS DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS		GLASS TYPE 'A'
D.L.O. WIDTH	D.L.O. HEIGHT	EXT.(+) & INT.(-)
36"	36"	140.0
39"		140.0
42"		140.0
45"		140.0
48"		140.0
51"		140.0
54"		140.0
57"		140.0
60"		140.0
36"	42"	140.0
39"		140.0
42"		140.0
45"		140.0
48"		140.0
51"		140.0
54"		140.0
36"	48"	140.0
39"		140.0
42"		140.0
45"		140.0
48"		140.0
36"	54"	140.0
39"		140.0
42"		140.0
36"	60"	140.0

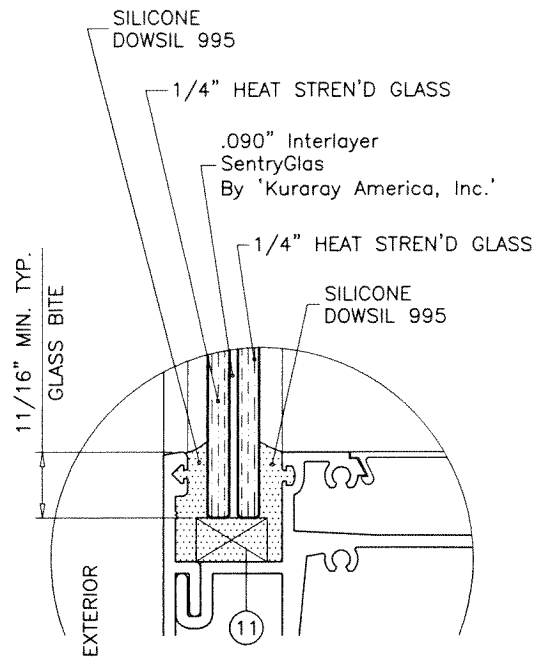

GLASS TYPE 'A'
9/16" OVERALL GLASS

GLASS DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS		GLASS TYPE 'A1'
D.L.O. WIDTH	D.L.O. HEIGHT	EXT.(+) & INT.(-)
33"	60"	110.0
36"		110.0
39"		110.0
42"		110.0
45"		110.0
48"		110.0
51"		110.0
54"		110.0
57"	66"	110.0
60"		110.0
63"		110.0
66"		110.0
69"		110.0
33"	72"	110.0
36"		110.0
39"		110.0
42"		110.0
45"		110.0
48"		110.0
51"		110.0
54"		110.0
57"	78"	110.0
33"		110.0
36"		110.0
39"		110.0
42"		110.0
45"		110.0
48"		110.0
51"	84"	110.0
54"		110.0
33"		110.0
36"		110.0
39"	90"	110.0
42"		110.0
45"		110.0
48"		110.0


GLASS DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS		GLASS TYPE 'A1'
D.L.O. WIDTH	D.L.O. HEIGHT	EXT.(+) & INT.(-)
33"	96"	110.0
36"		110.0
39"		110.0
42"		110.0
33"	102"	110.0
36"		110.0
39"		110.0
33"	108"	110.0
36"		110.0
39"		110.0
33"	114"	110.0
36"		110.0
33"		110.0
33"	118"	110.0
36"		110.0
33"		110.0
33"	120"	110.0
33"		110.0
33"	126"	110.0

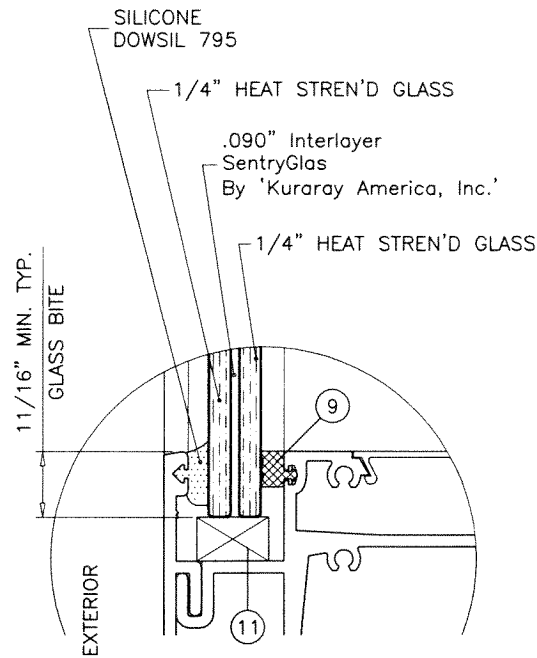

GLASS TYPE 'A1'
9/16" OVERALL GLASS

NOTE:
GLASS CAPACITIES ON THIS SHEET ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS).


GLASS DESIGN LOAD CAPACITY - PSF		
NOMINAL DIMS		GLASS TYPE 'A2'
D.L.O. WIDTH	D.L.O. HEIGHT	EXT.(+) & INT.(-)
36"	36"	100.0
39"		100.0
42"		100.0
45"		100.0
48"		100.0
51"		100.0
54"		100.0
57"		100.0
36"	42"	100.0
39"		100.0
42"		100.0
45"		100.0
48"		100.0
51"		100.0
54"		100.0
57"		100.0
36"	48"	100.0
39"		100.0
42"		100.0
45"		100.0
48"		100.0
51"		100.0
54"		100.0
57"		100.0
36"	54"	100.0
39"		100.0
42"		100.0
45"		100.0
48"		100.0
51"		100.0
54"		100.0
57"		100.0
36"	59"	100.0
39"		100.0
42"		100.0
45"		100.0
48"		100.0
51"		100.0
54"		100.0
57"		100.0

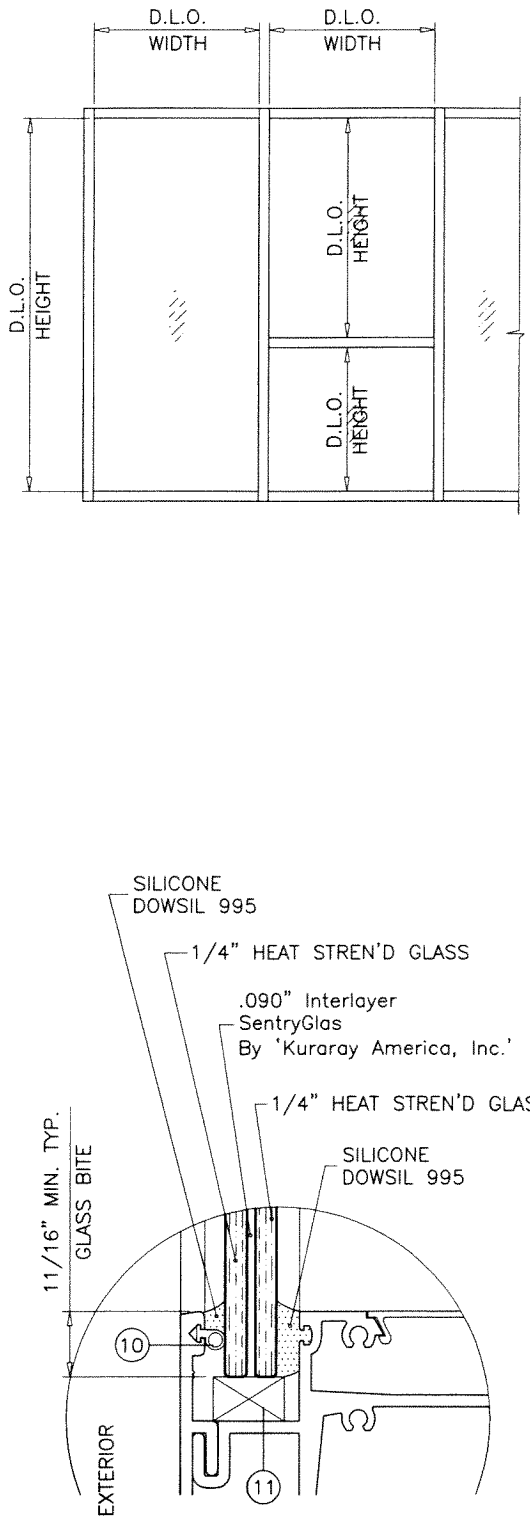

GLASS TYPE 'A2'
9/16" OVERALL GLASS

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-1012.10**
Expiration Date: **04/01/2025**
By: *Manuel Torres*
Miami-Dade Product Control

SEP 22 2023

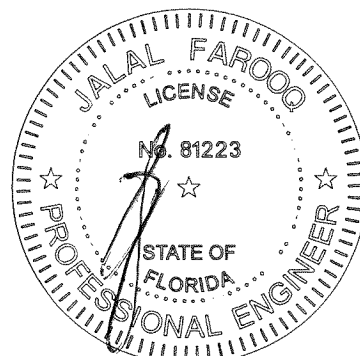

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978

TECNOGLASS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:


no	date	by	description
E	08.05.14	MANUF.	NAME REV.
F	05.13.16		UPDATED TO 2014 FBC
G	10.04.17		NO CHANGE THIS SHEET
H	11.20.20		UPDATED TO 2020 FBC
I	09.20.23		NO CHANGE THIS SHEET

date: 12-01-03	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
drawing no. W03-108		sheet 2 of 7	

MULLION/JAMB DESIGN LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS					
NOMINAL DIMS.		JAMB 'J1'		MULLION 'M1'	
WIDTH (W)	FRAME HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30"	90"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		140.0	140.0	140.0	140.0
72"		140.0	140.0	140.0	140.0
30"	96"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		140.0	140.0	140.0	140.0
69"		140.0	140.0	140.0	140.0
30"	102"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		140.0	140.0	139.4	139.4
30"	108"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	136.7	136.7
63"		140.0	140.0	130.2	130.2
30"	114"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	136.3	136.3
60"		138.8	138.8	122.7	122.7
30"	120"	110.0	110.0	110.0	110.0
36"		110.0	110.0	110.0	110.0
42"		110.0	110.0	110.0	110.0
30"	126"	110.0	110.0	110.0	110.0
36"		110.0	110.0	110.0	110.0
39"		110.0	110.0	110.0	110.0
30"	132"	110.0	110.0	110.0	110.0
36"		110.0	110.0	110.0	110.0
39"		110.0	110.0	110.0	110.0

MULLION/JAMB DESIGN LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS					
NOMINAL DIMS.		JAMB 'J2'		MULLION 'M2'	
WIDTH (W)	FRAME HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30"	90"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
66"		140.0	140.0	140.0	140.0
72"		140.0	140.0	140.0	140.0
30"	96"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		140.0	140.0	140.0	140.0
69"		140.0	140.0	140.0	140.0
72"		100.0	100.0	100.0	100.0
30"	102"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		140.0	140.0	140.0	140.0
72"		100.0	100.0	100.0	100.0
30"	108"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		140.0	140.0	140.0	140.0
72"		100.0	100.0	100.0	100.0
30"	114"	140.0	140.0	140.0	140.0
36"		140.0	140.0	140.0	140.0
42"		140.0	140.0	140.0	140.0
48"		140.0	140.0	140.0	140.0
54"		140.0	140.0	140.0	140.0
60"		140.0	140.0	140.0	140.0
63"		140.0	140.0	140.0	140.0
66"		100.0	100.0	100.0	100.0
72"		100.0	100.0	100.0	100.0
30"	120"	100.0	100.0	100.0	100.0
36"		100.0	100.0	100.0	100.0
42"		100.0	100.0	100.0	100.0
48"		100.0	100.0	100.0	100.0
54"		100.0	100.0	100.0	100.0
60"		100.0	100.0	100.0	100.0
63"		100.0	100.0	100.0	100.0
66"		100.0	100.0	100.0	100.0
72"		100.0	100.0	100.0	100.0

MULLION/JAMB DESIGN LOAD CAPACITY - PSF WITH OR WITHOUT INTERMEDIATE HORIZONTALS					
NOMINAL DIMS.		JAMB 'J2'		MULLION 'M2'	
WIDTH (W)	FRAME HEIGHT	EXT.(+)	INT.(-)	EXT.(+)	INT.(-)
30"	126"	100.0	100.0	100.0	100.0
36"		100.0	100.0	100.0	100.0
39"		100.0	100.0	100.0	100.0
42"		100.0	100.0	100.0	100.0
48"		100.0	100.0	100.0	100.0
54"		100.0	100.0	100.0	100.0
60"		100.0	100.0	100.0	100.0
63"		100.0	100.0	100.0	100.0
66"		100.0	100.0	100.0	100.0
72"		100.0	100.0	100.0	100.0
30"	132"	100.0	100.0	100.0	100.0
36"		100.0	100.0	100.0	100.0
39"		100.0	100.0	100.0	100.0
42"		100.0	100.0	100.0	100.0
48"		100.0	100.0	100.0	100.0
54"		100.0	100.0	100.0	100.0
60"		100.0	100.0	100.0	100.0
63"		100.0	100.0	100.0	100.0
66"		100.0	100.0	100.0	100.0
72"		90.0	90.0	90.0	90.0
30"	138"	100.0	100.0	100.0	100.0
36"		100.0	100.0	100.0	100.0
42"		100.0	100.0	100.0	100.0
48"		100.0	100.0	100.0	100.0
54"		100.0	100.0	100.0	100.0
60"		100.0	100.0	100.0	100.0
63"		100.0	100.0	100.0	100.0
30"	141"	100.0	100.0	100.0	100.0
36"		100.0	100.0	100.0	100.0
42"		100.0	100.0	100.0	100.0
48"		100.0	100.0	100.0	100.0
54"		100.0	100.0	100.0	100.0
60"		100.0	100.0	100.0	100.0
63"		100.0	100.0	100.0	100.0

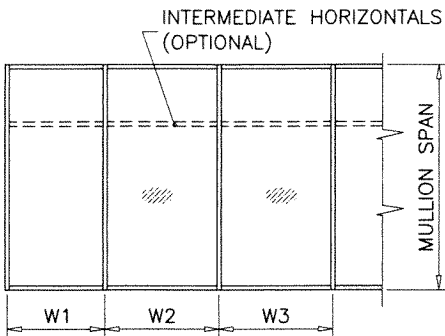


WIDTH (W) = W1
AT FRAME JAMB

WIDTH (W) = $\frac{W2 + W3}{2}$
AT FRAME MULLION

PRODUCT REVISED
As complying with the Florida Building Code
NOA-No. **23-1012.10**
Expiration Date: **04/01/2025**
By: *Manuel Perez*
Miami-Dade Product Control

LIMIT UNBRACED SPAN TO 101 IN. FOR THIS JAMB ONLY		LIMIT UNBRACED SPAN TO 101 IN. FOR THIS JAMB ONLY	
JAMB 'J1'	MULLION 'M1'	JAMB 'J2'	MULLION 'M2'
I_x IN ⁴ 12.121 S_x IN ³ 3.776	I_x IN ⁴ 14.081 S_x IN ³ 4.4616 ALUMINUM STEEL 3.7969 TOTAL 23.132 I_x ALUM + I_x STL X 2.9	I_x IN ⁴ 12.121 S_x IN ³ 3.776 ALUMINUM STEEL 3.7969 TOTAL 25.092 I_x ALUM + I_x STL X 2.9	I_x IN ⁴ 14.081 S_x IN ³ 4.4616 ALUMINUM STEEL 7.5938 TOTAL 36.103 I_x ALUM + I_x STL X 2.9

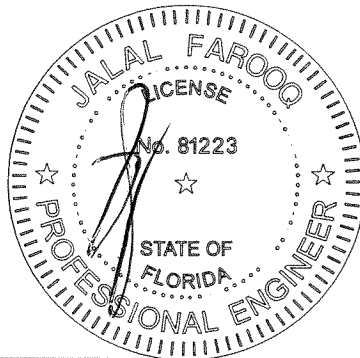

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 262-6978
FAX. (305) 262-6978

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)

TECNOGLASS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151
FAX. (305) 638-5158

revisions:

no.	date	description
E	08.05.14	MANUF. NAME REV
F	05.13.16	UPDATED TO 2014 FBC
G	10.04.17	REV. PER RER COMMENTS
H	11.20.20	UPDATED TO 2020 FBC
I	09.20.23	NO CHANGE THIS SHEET

date: 12-01-03




scale: -

dr. by: TARIO

chk. by:

drawing no. **W03-108**

sheet **3** of **7**

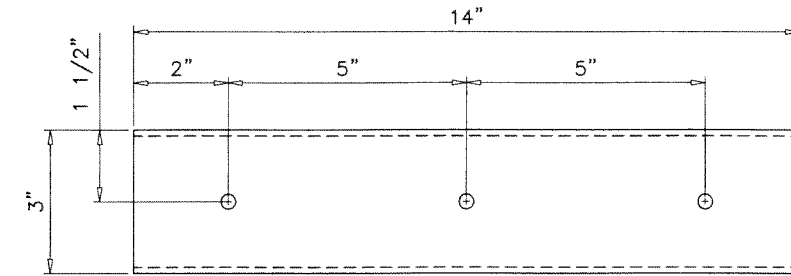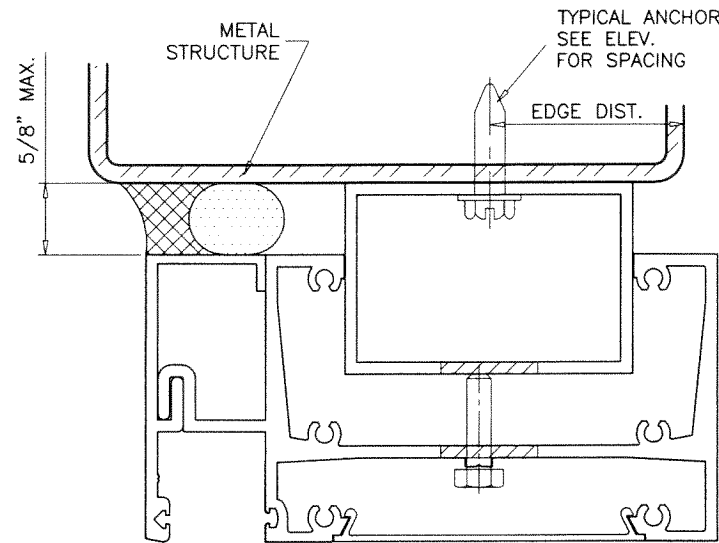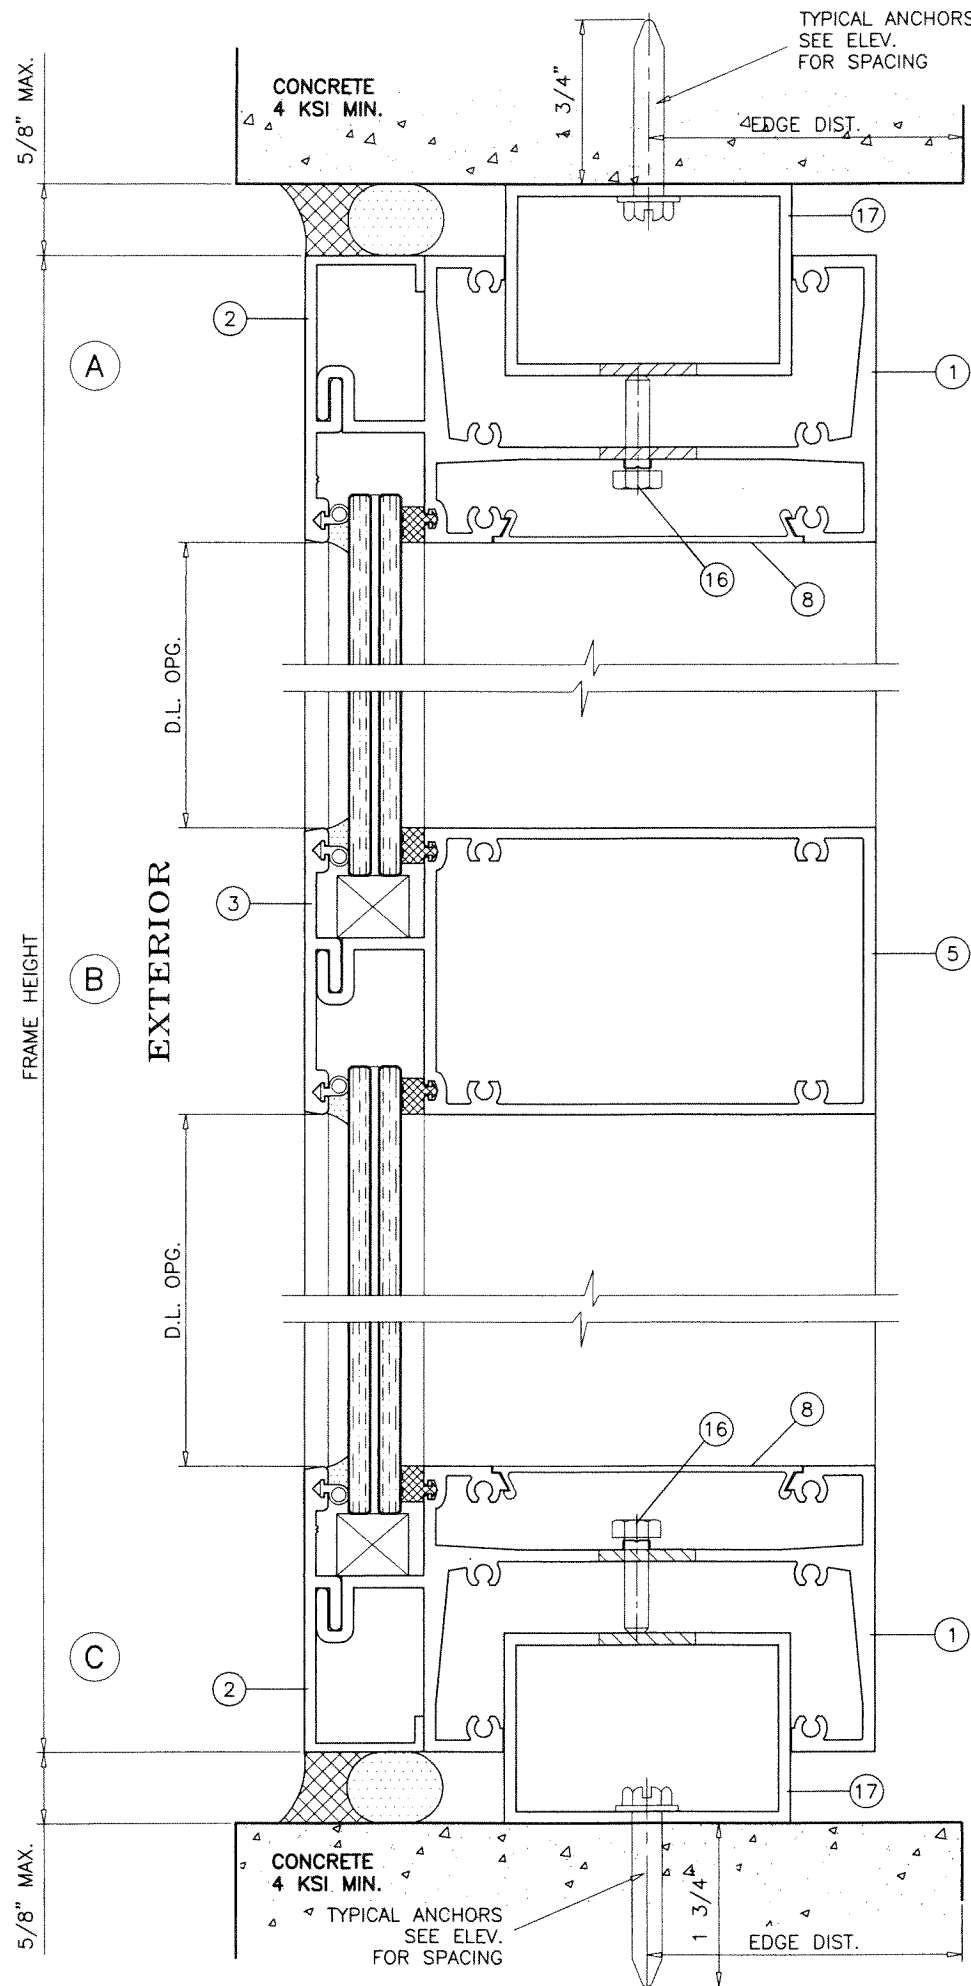

ANCHOR TUBE HOLES PATTERN

METAL STRUCTURES NOT BY 'TECNOGLASS'
MUST SUPPORT LOADS IMPOSED BY GLAZING SYSTEM
AND TRANSFER THEM TO THE BUILDING STRUCTURE.

TYPICAL ANCHORS: SEE ELEV. FOR SPACING

TYPE 'A'— 5/16" DIA. ULTRA CON BY 'DEWALT' (Fu=177 KSI, Fy=155 KSI)
DIRECTLY INTO CONCRETE
1-3/4" MIN. EMBED INTO CONCRETE (HEAD/SILL)

TYPE 'B'— 5/16" DIA. TEKS OR SELF DRILLING SCREWS (GRADE 5 CRS)
INTO METAL STRUCTURES (HEAD/SILL)
(3) THREADS MIN. PENETRATION BEYOND SUBSTRATE
ALUMINUM: 1/8" THK. MIN. (6063-T5 MIN.)
STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
(STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)

TYPICAL EDGE DISTANCE


INTO CONCRETE = 3-1/8" MIN.
INTO METAL STRUCTURE = 3/4" MIN.

CONCRETE AT HEAD OR SILL f'c = 4000 PSI MIN.

SEALANTS:

ALL FRAME CORNERS AND MULLION SEAMS SEALED
WITH SILICONE.

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-1012.10**
Expiration Date: **04/01/2025**
By: *Manuel Perez*
Miami-Dade Product Control

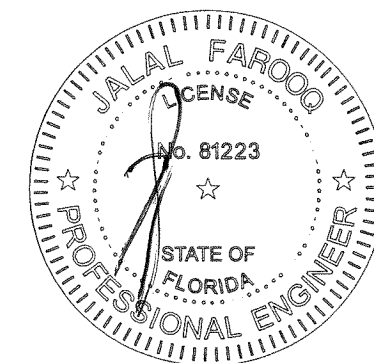


AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
STORE W03-108RC

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)
TECNOGLASS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158



no	date	by	description
E	08.05.14	MANUF.	NAME REV.
F	05.13.16		UPDATED TO 2014 FBC
G	10.04.17	REV.	PER PER COMMENTS
H	11.20.20		UPDATED TO 2020 FBC
I	09.20.23		NO CHANGE THIS SHEET

date: 12-01-03
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:


drawing no.
W03-108
sheet 4 of 7

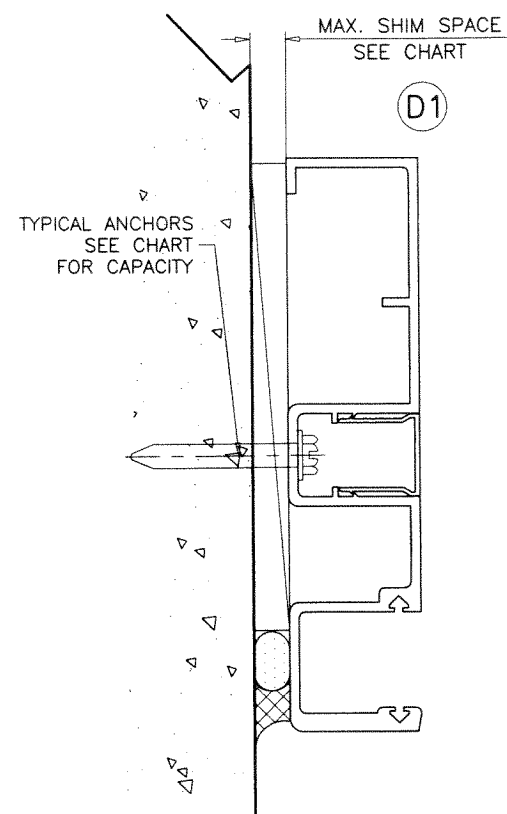

JAMB ANCHORS DESIGN LOAD CAPACITY - PSF							
WIDTH (W)	3/8" MAX. SHIM SPACE				1/4" MAX. SHIM SPACE		
	12" O.C.		8" O.C.		12" O.C.		8" O.C.
	TYPE 'A'	TYPE 'B'	TYPE 'A'	TYPE 'B'	TYPE 'A'	TYPE 'B'	TYPE 'A'
	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)	EXT.(+) INT.(-)
42"	140.0	140.0	140.0	140.0	140.0	140.0	140.0
48"	130.6	140.0	140.0	140.0	140.0	140.0	140.0
54"	116.0	140.0	140.0	140.0	140.0	140.0	140.0
57"	109.9	140.0	140.0	140.0	140.0	140.0	140.0
60"	104.4	140.0	140.0	140.0	140.0	140.0	140.0
63"	99.5	140.0	140.0	140.0	140.0	140.0	140.0
66"	94.9	135.1	140.0	140.0	134.5	140.0	140.0
69"	90.8	129.3	140.0	140.0	128.7	140.0	140.0
72"	87.0	123.9	130.6	140.0	123.3	140.0	140.0

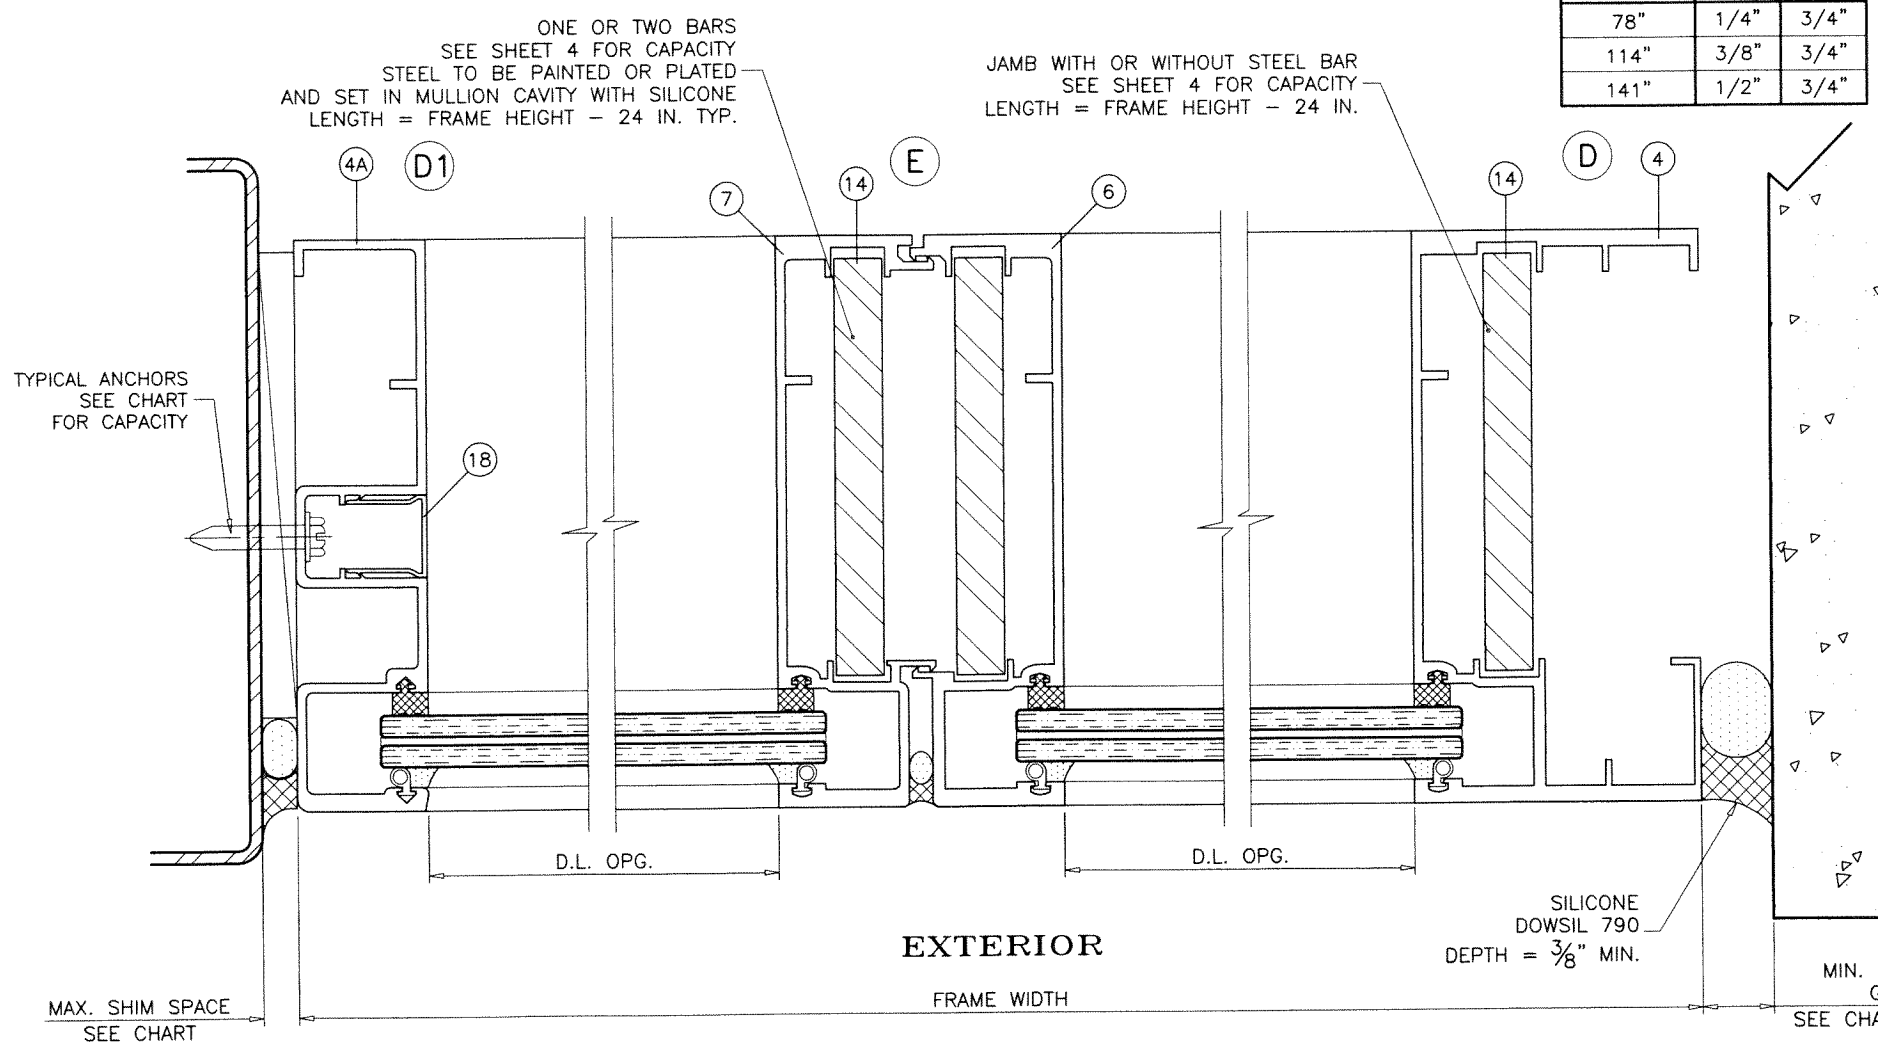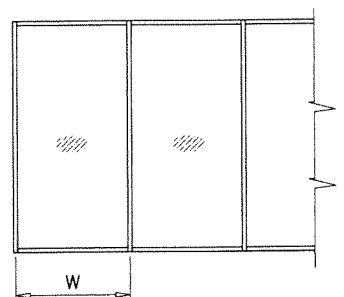


MAX. FRAME HEIGHT	GAP	
	MIN.	MAX.
78"	1/4"	3/4"
114"	3/8"	3/4"
141"	1/2"	3/4"

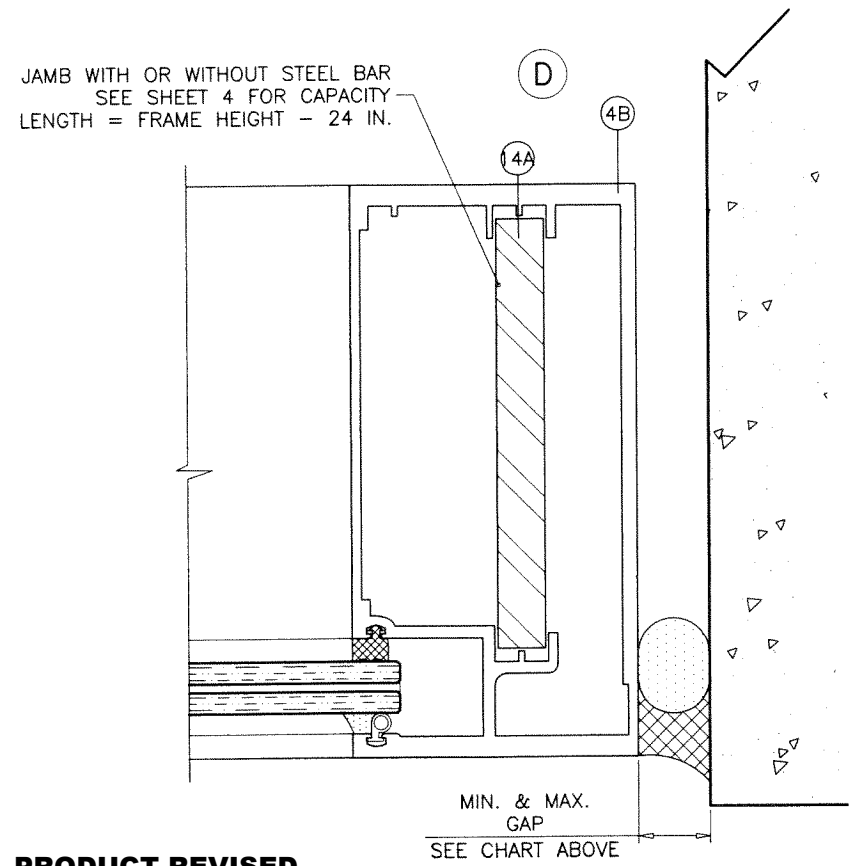

PRODUCT REVISED
 As complying with the Florida Building Code
 NOA-No. **23-1012.10**
 Expiration Date: **04/01/2025**
 By: *Manuel Perez*
 Miami-Dade Product Control

SEP 22 2023

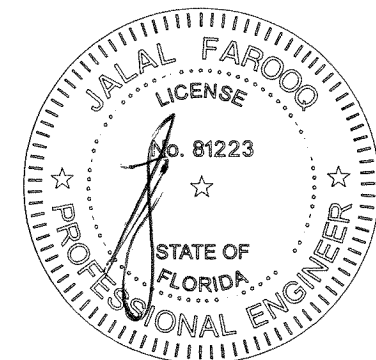

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

af c

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)

TECNOGLASS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:	no	date	by	description
	E	08.05.14	MANUF.	NAME REV.
	F	05.13.16		UPDATED TO 2014 FBC
	G	10.04.17		NO CHANGE THIS SHEET
	H	11.20.20		UPDATED TO 2020 FBC
	I	09.20.23		NO CHANGE THIS SHEET

date: 12-01-03













scale: 1/2" = 1"

dr. by: TARIQ

chk. by:


drawing no.
W03-108

sheet 5 of 7

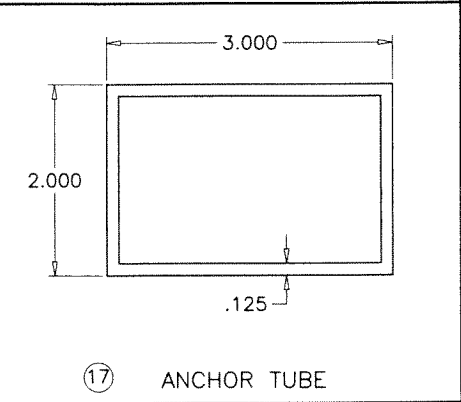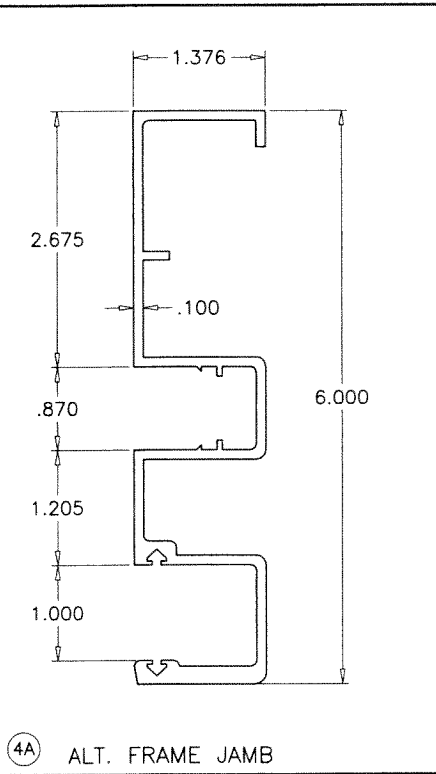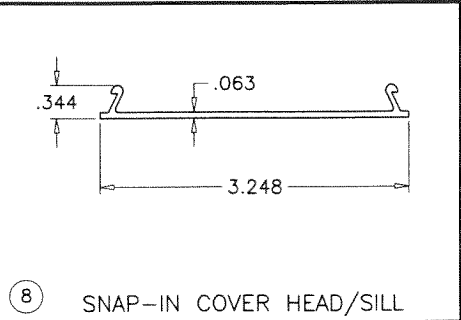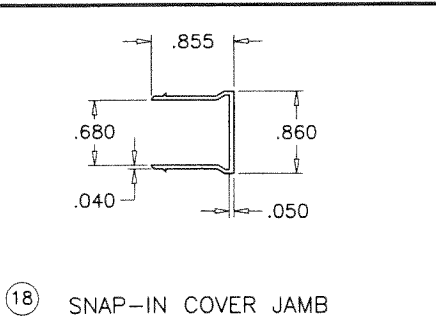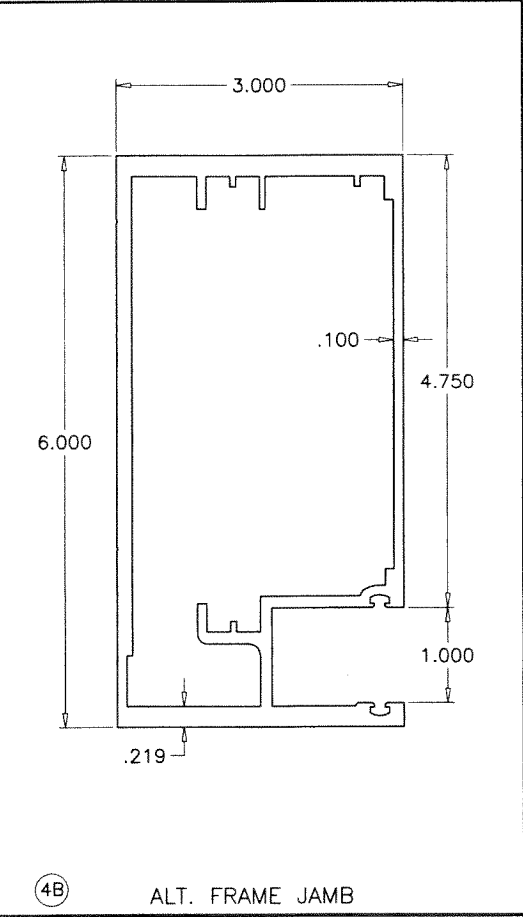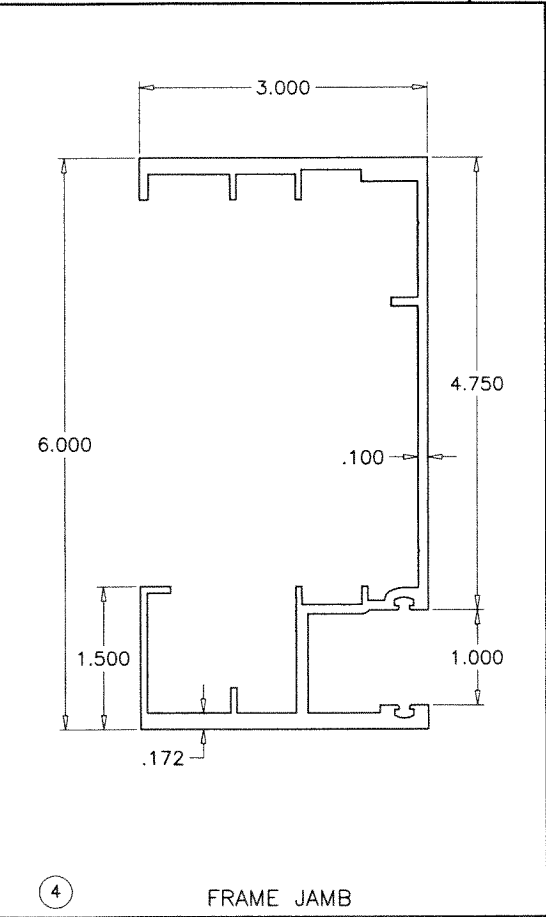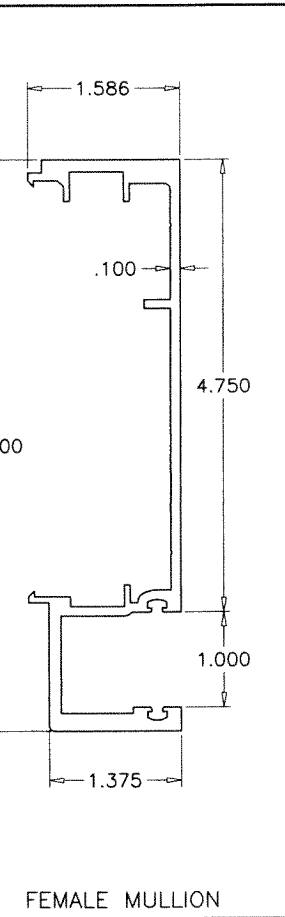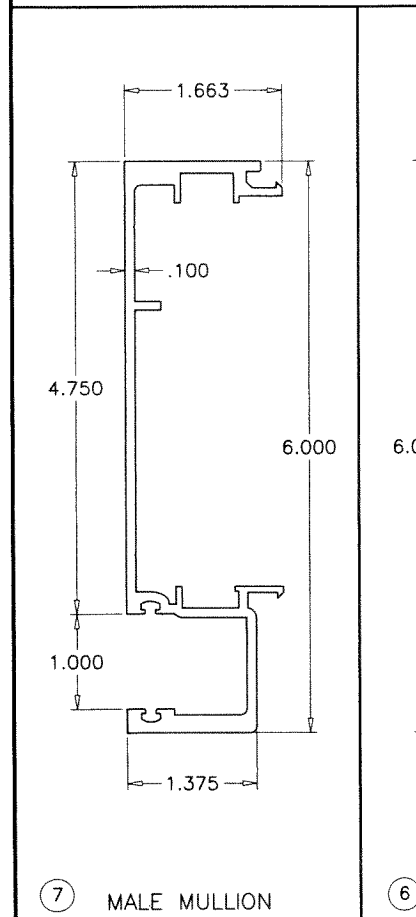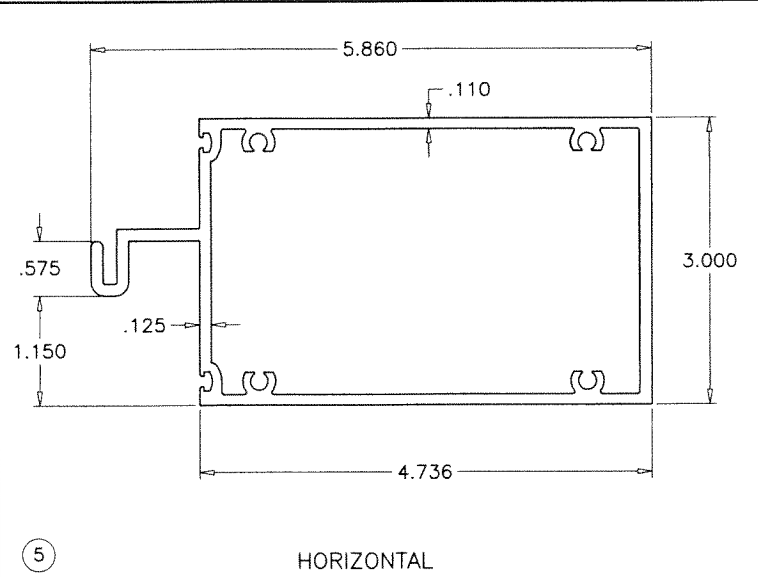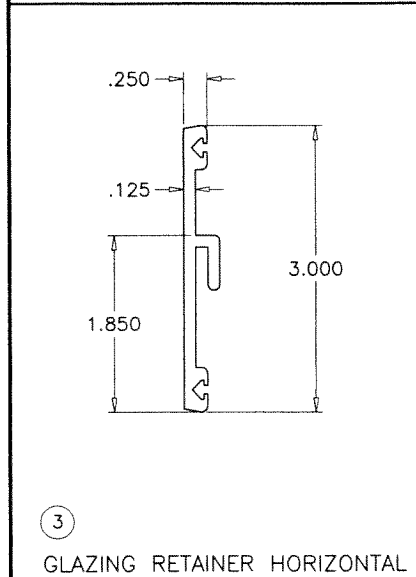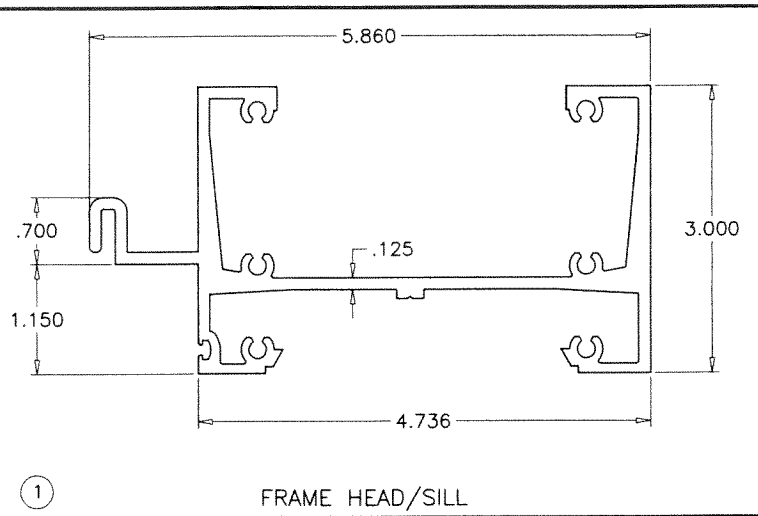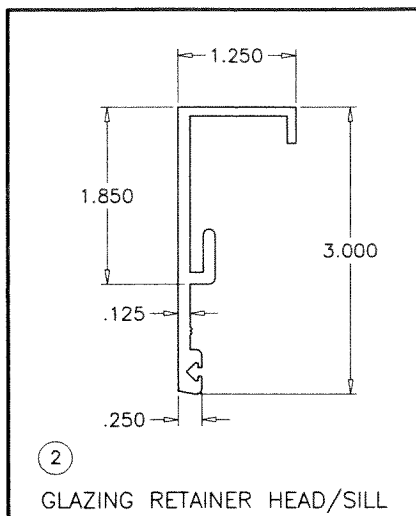

PRODUCT REVISED
 As complying with the Florida
 Building Code
 NOA-No. **23-1012.10**
 Expiration Date: **04/01/2025**
 By: *Manuel Perez*
 Miami-Dade Product Control

SEP 22 2023

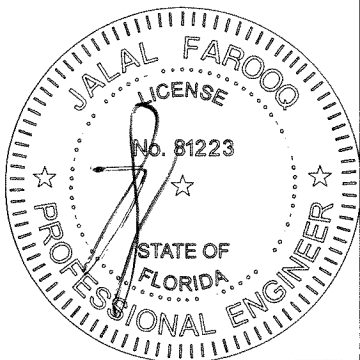

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173
 TEL. (305) 264-8100 FAX. (305) 262-6978

STORE W03-108RC

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)


TECNOGLASS, LLC
 3550 N.W. 49 STREET
 MIAMI, FL. 33142
 TEL. (305) 638-5151 FAX. (305) 638-5158

SEP 22 2023

no	date	by	description
E	08.05.14	MANUF.	NAME REV.
F	05.13.16		UPDATED TO 2014 FBC
G	10.04.17		NO CHANGE THIS SHEET
H	11.20.20		UPDATED TO 2020 FBC
I	09.20.23		NO CHANGE THIS SHEET

date: 12-01-03
 scale: 1/2" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
W03-108
 sheet 6 of 7

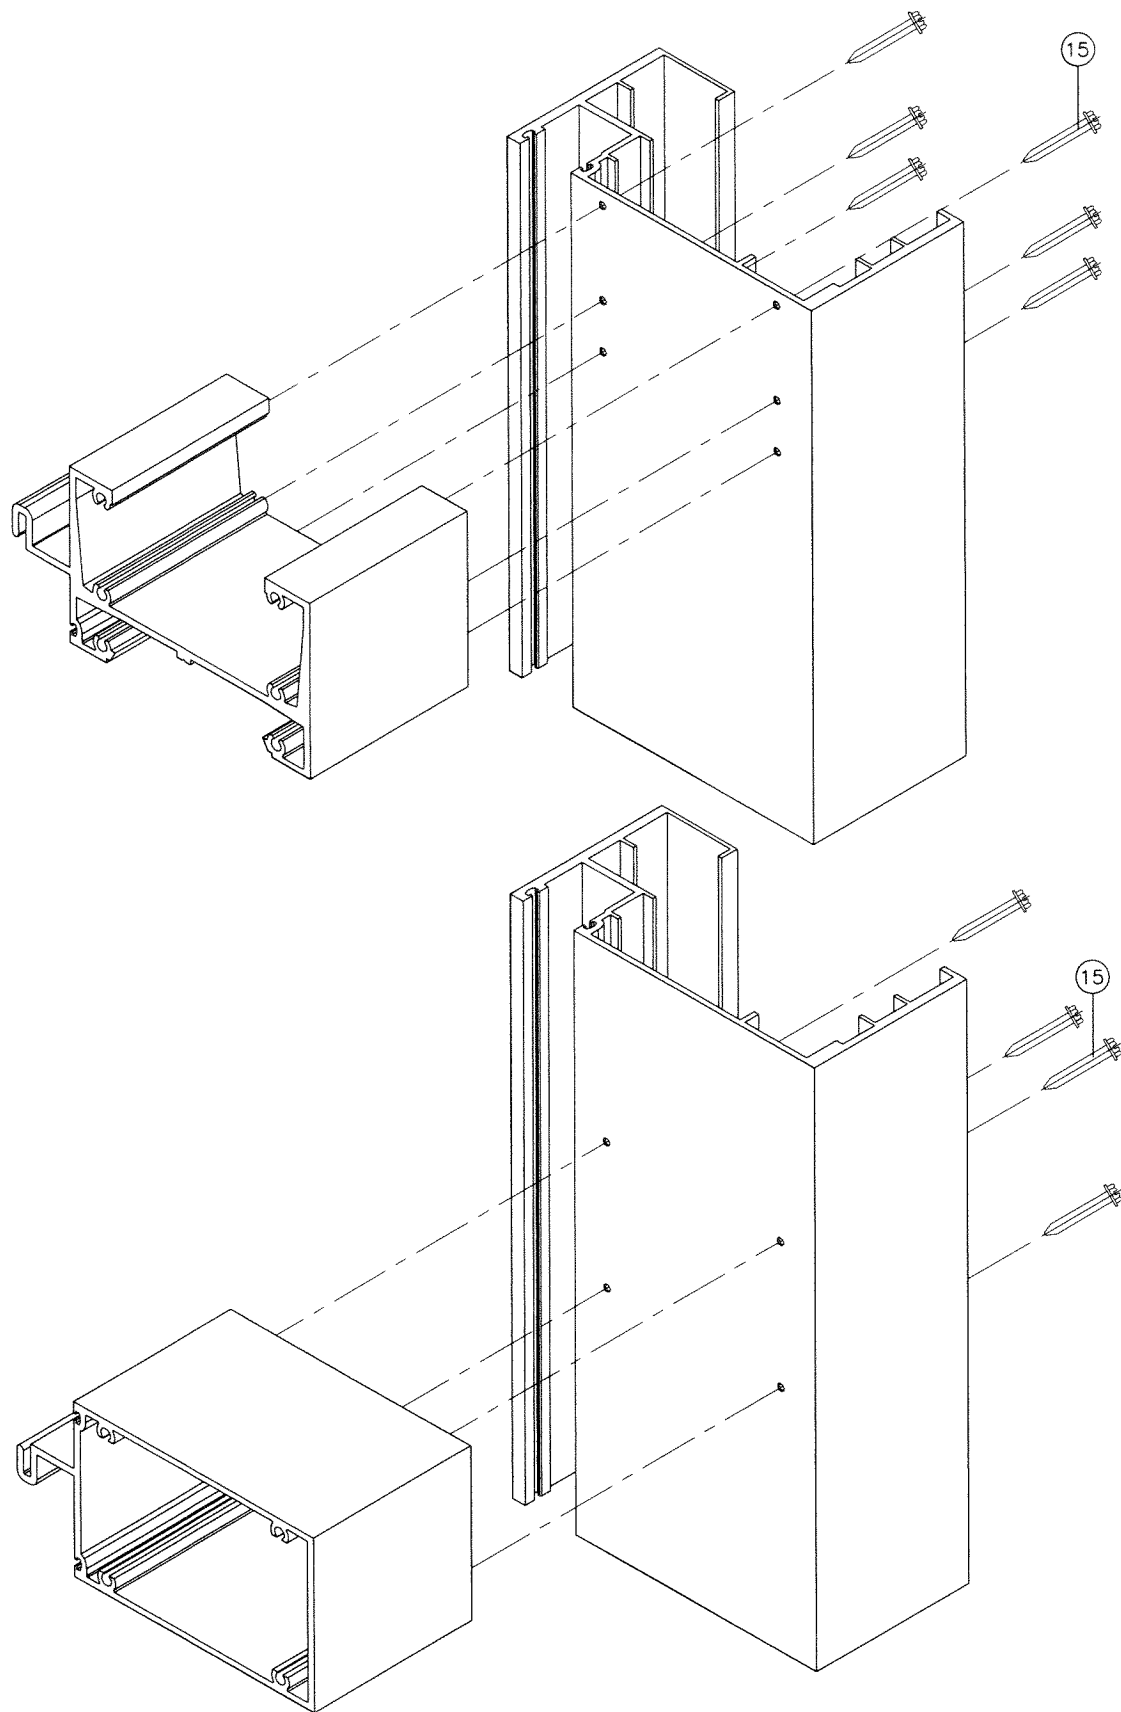


FRAME CORNER

MATERIALS LIST					
ITEM NO.	PART NUMBER	QUANTITY	DESCRIPTION	MATERIAL	MANF./SUPPLIER/REMARKS
1	HP3060-051	AS REQD.	FRAME HEAD/SILL	6005-T5	-
2	FX345-006	AS REQD.	GLAZING RETAINER (HEAD/SILL)	6063-T6	-
3	FX345-005	AS REQD.	GLAZING RETAINER (HORIZONTAL)	6063-T6	-
4	HP3060-036	AS REQD.	FRAME JAMB	6063-T6	-
4A	HP3060-022	AS REQD.	ALT. FRAME JAMB	6063-T6	-
4B	HP3060-068	AS REQD.	ALT. FRAME JAMB	6063-T6	-
5	HP3060-041	AS REQD.	HORIZONTAL	6063-T6	-
6	HP3060-037	AS REQD.	FEMALE MULLION	6063-T6	-
7	HP3060-038	AS REQD.	MALE MULLION	6063-T6	-
8	HP3060-011	AS REQD.	SNAP-IN COVER HEAD/SILL	6063-T6	-
9	V-003	AS REQD.	GLAZING GASKET	TPE	MELTPOINT, DUROMETER 75±5 SHORE A
10	V-009	AS REQD.	BULB WEATHERSTRIPPING	TPE	MELTPOINT, DUROMETER 75±5 SHORE A
11	-	2/ LITE	SETTING BLOCKS (1/2" X 5/8" X 4")	EPDM	LOWE, DUROMETER 80±5 SHORE A
12	-	-	SEALANT DOW CORNING 995	SILICONE	-
13	-	-	SEALANT DOW CORNING 795	SILICONE	-
14	-	AS REQD.	REINFORCING BAR (1/2" X 4-3/8")	STEEL	SILICONED IN PLACE
14A	-	AS REQD.	REINFORCING BAR (1/2" X 4-1/2")	STEEL	SILICONED IN PLACE
15	-	AS REQD.	FRAME ASSEMBLY SCREWS	-	# 12 X 1-1/4" PH SMS
16	-	AS REQD.	LEVELING SCREWS	-	1/4-20 X 3/4" HH MS
17	-	AS REQD.	ANCHOR TUBE (2 X 3 X 1/8")	-	14" LONG
18	245FX-011	AS REQD.	SNAP-IN COVER JAMB	6063-T5	-

PRODUCT REVISED
As complying with the Florida
Building Code
NOA-No. **23-1012.10**
Expiration Date: **04/01/2025**
By: *Manuel Perez*
Miami-Dade Product Control

SEP 22 2023

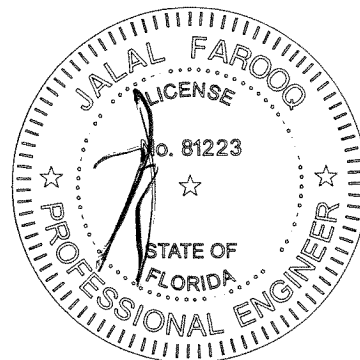

HP3060 ALUM. WINDOW WALL SYSTEM (L.M.I.)

TECNOGLASS, LLC
3550 N.W. 49 STREET
MIAMI, FL. 33142
TEL. (305) 638-5151 FAX. (305) 638-5158

revisions:		by		description	
no	date	no	date	no	date
E	08.05.14			MANUF. NAME REV.	
F	05.13.16			UPDATED TO 2014 FBC	
G	10.04.17			NO CHANGE THIS SHEET	
H	11.20.20			UPDATED TO 2020 FBC	
I	09.20.23			NO CHANGE THIS SHEET	

date: 12-01-03	scale: 1/2" = 1"	dr. by: TARIQ	chk. by:
----------------	------------------	---------------	----------

drawing no.
W03-108
sheet 7 of 7

AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3538)
TEL. (305) 264-8100 FAX. (305) 262-6978

STORE\W03-108RC