



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

Amarr Garage Doors dba Entrematic
165 Carriage Court
Winston Salem, NC 27105

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ). This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code. This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Model 500 Classica 1000, 2000 Steel Sectional Garage Door up to 9'-0" Wide – L.M.I.

APPROVAL DOCUMENT: Drawing No. **IRC-5309-185-21-I**, titled "Model #500 Classica 1000 & 2000", sheets 1 through 3 of 3, dated 01/21/2021, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 06/16/2021, bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises # 21-0408.02** consists of this page 1 and evidence page E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**

 01/25/24



NOA No. 23-1114.04
Expiration Date: August 5, 2026
Approval Date: January 05, 2024
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **IRC-5309-185-21-I**, titled “Model #500 Classica 1000 & 2000”, sheets 1 through 3 of 3, dated 01/21/2021, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 06/16/2021.

B. TESTS

1. Addendum letter to Test Report No. **ATLNC 0126.04-21**, dated 06/16/2021, signed and sealed by David W. Johnson, P.E.
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
3) Cyclic Wind Pressure Loading per FBC, TAS 203-94
4) Forced Entry Test, TAS 202-94
5) Tensile Test per ASTM E8
along with installation diagram on Models 500 Steel Sectional Garage Doors, prepared by American Test Lab, Inc, Test Report No. **ATLNC 0126.04-21**, dated 02/10/2021, signed and sealed by David W. Johnson, P.E.
3. Test report on Salt Spray per ASTM D1654-08 and ASTM B117 of G-40 galvanized with polyester top coat, prepared by Intertek/ATI, Test Report No. **C5463.01-106-18**, dated 04/03/2013, signed by Joseph A. Reed, P.E. on 06/15/2017.

C. CALCULATIONS

1. Anchor calculations prepared by Structural Solutions, P.A., dated 03/15/2021, signed and sealed by Thomas L. Shelmerdine, P.E.

D. QUALITY ASSURANCE


1. Miami-Dade Department of Regulatory and Economic Resources (RER).

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with FBC 7th Edition (2020) and of no financial interest, dated 03/15/2021, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.



Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 23-1114.04
Expiration Date: August 5, 2026
Approval Date: January 05, 2024

Amarr Garage Doors dba Entrematic

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **IRC-5309-185-21-I**, titled “Model #500 Classica 1000 & 2000”, sheets 1 through 3 of 3, dated 01/21/2021, prepared by manufacturer, signed and sealed by Thomas L. Shelmerdine, P.E. on 06/16/2021.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS


1. Statement letter of conformance, complying with **FBC 8th Edition (2023)** and of no financial interest, dated 10/27/2023, issued by Structural Solutions, P.A., signed and sealed by Thomas L. Shelmerdine, P.E.

G. OTHERS


1. This NOA revises **NOA No. 20-0408.02** and updates to FBC 2023 expiring on 08/05/26.




Ishaq I. Chanda, P.E.
Product Control Unit Supervisor
NOA No. 23-1114.04
Expiration Date: August 5, 2026
Approval Date: January 05, 2024

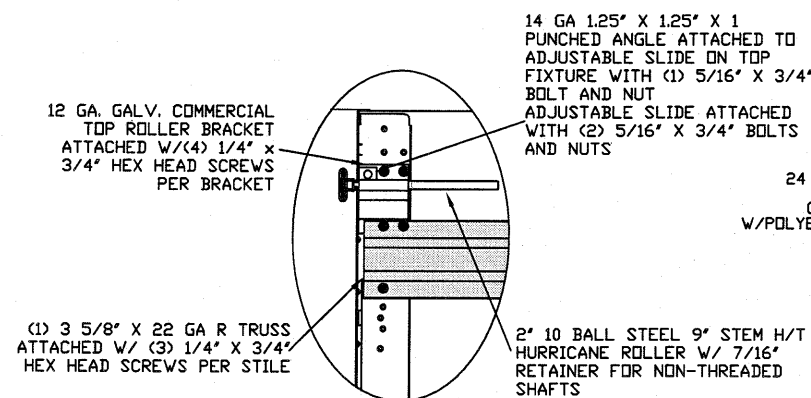


TYPICAL TOP FIXTURES
N.T.S. 1

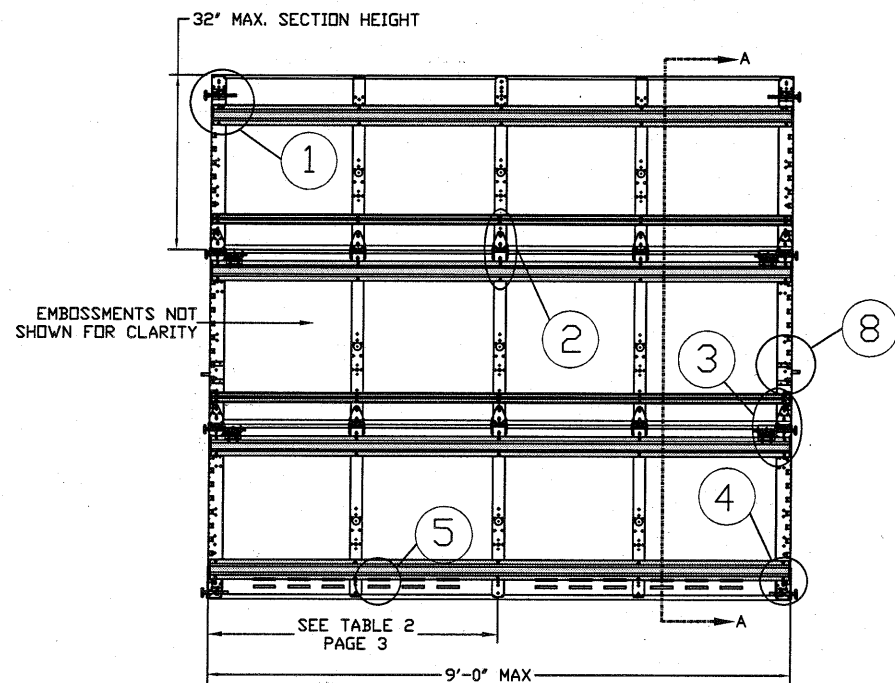

INSIDE ELEVATION
N.T.S.

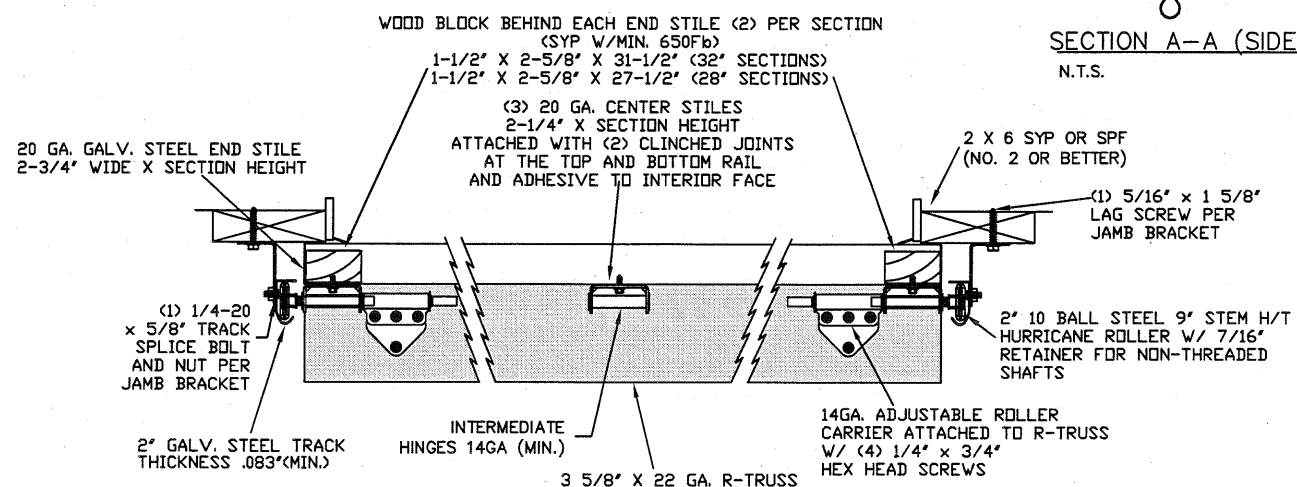


TRACK MOUNTING DETAIL
N.T.S.

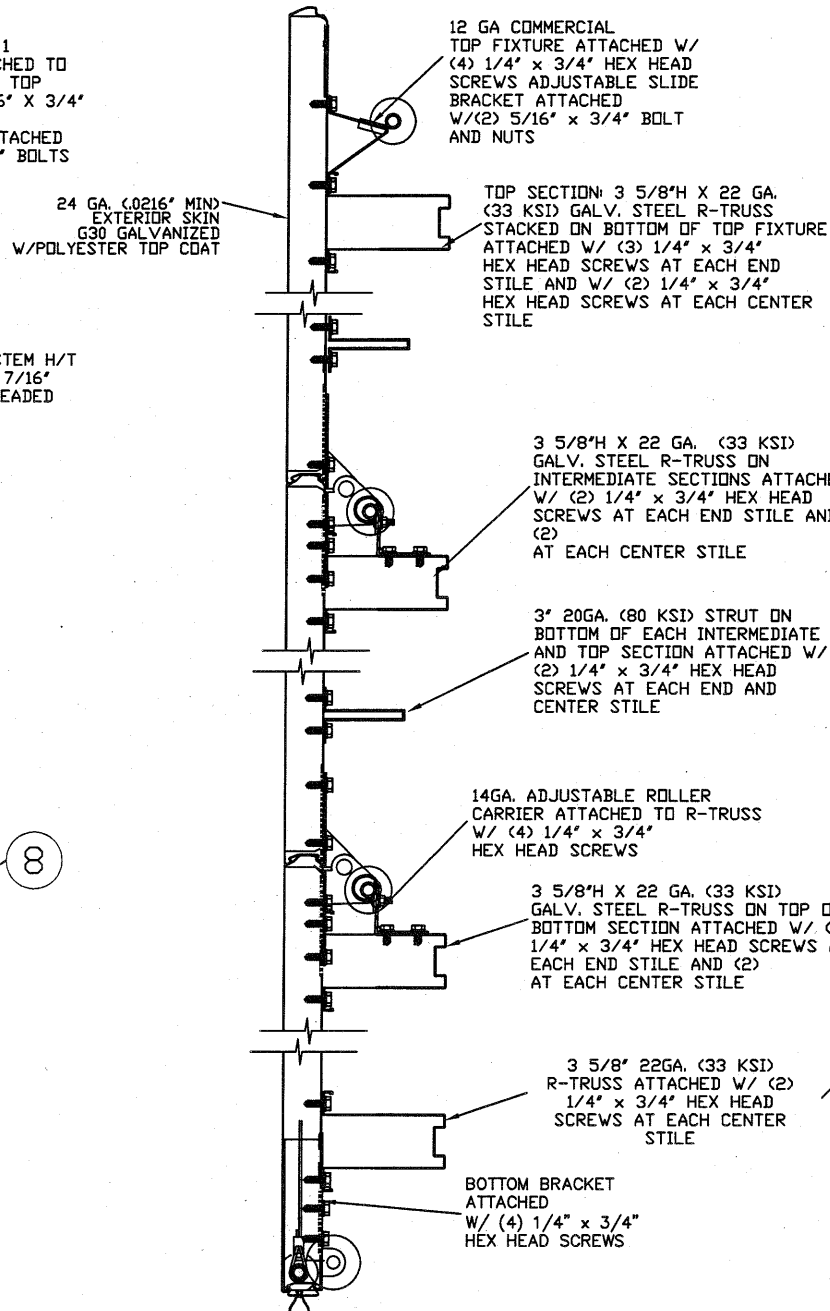


SECTION A-A (SIDE VIEW)
N.T.S.


TWO (2) ROWS OF THREE (3) VENTS EQUALS 15 SQ. INCHES

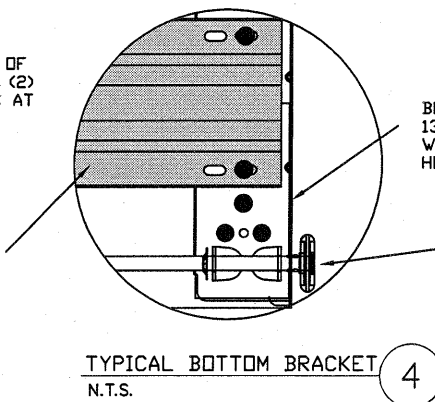

TYPICAL BOTTOM BRACKET
N.T.S. 4

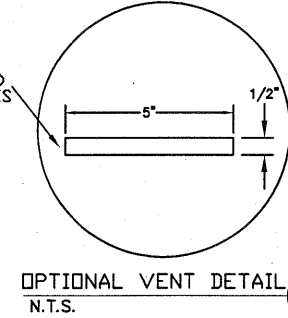

OPTIONAL VENT DETAIL
N.T.S. 5

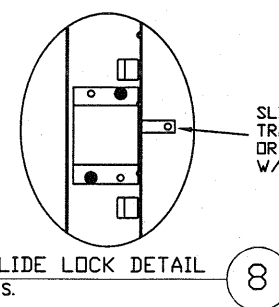


SLIDE LOCK DETAIL
N.T.S. 8


LARGE MISSILE IMPACT RESISTANT

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-1114.04
Expiration Date 08/05/2026
By Ishag I. Chank
Miami-Dade Product Control

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 21-0408.02
Approval Date 08/05/2021
By [Signature]
Miami-Dade Product Control

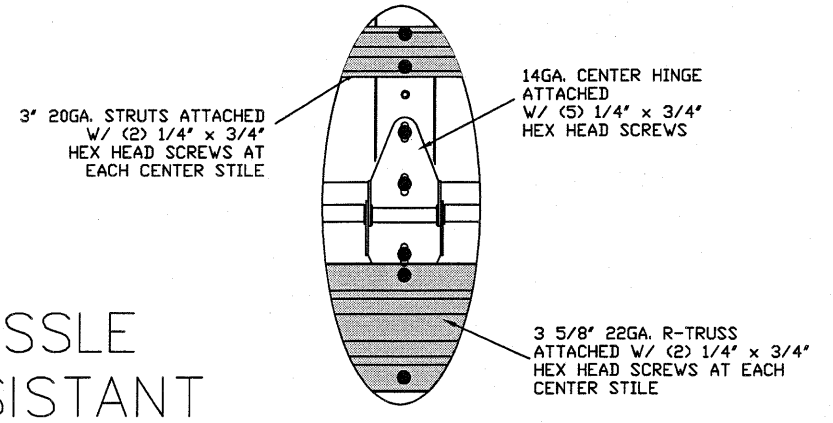

TYPICAL CENTER HINGE
N.T.S. 2

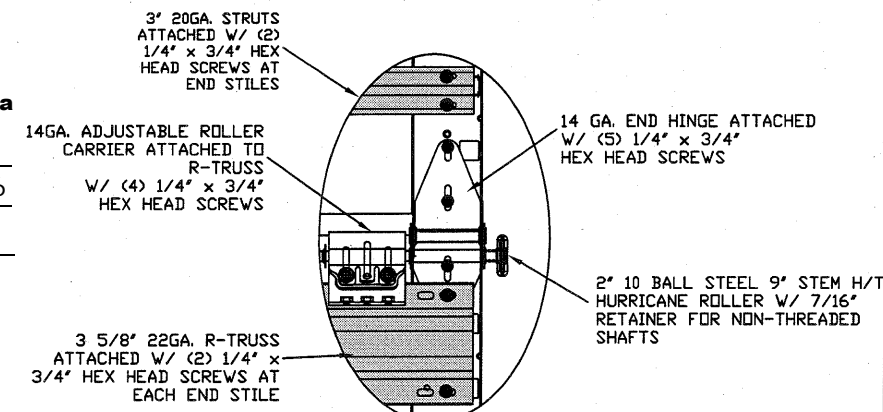

TYPICAL END HINGE
N.T.S. 3

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE
9' x 14'

DESIGN LOADS
+54.4 PSF
-62.0 PSF

TEST LOADS
+81.6 PSF
-93.0 PSF


LARGE MISSILE
IMPACT
RESISTANCE

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #29412)

THOMAS L. SHELMERDINE
LICENSE
No. 48579
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
FL


dba Structural Solutions of North Carolina, Inc.
5921-G W. Friendly Ave., Greensboro, NC 27410


<p>Amarr ENTREMATIC</p> <p>MODEL #500 CLASSICA 1000, 2000</p>			
SIZE	DRAWN BY	DRC	DATE
B	CHECKED BY	DLJ	DATE
ENTREMATIC 165 CARRIAGE COURT WINSTON-SALEM, NC. 27105			DRAWING NUMBER IRC-5309-185-21-I SHEET 1 OF 3

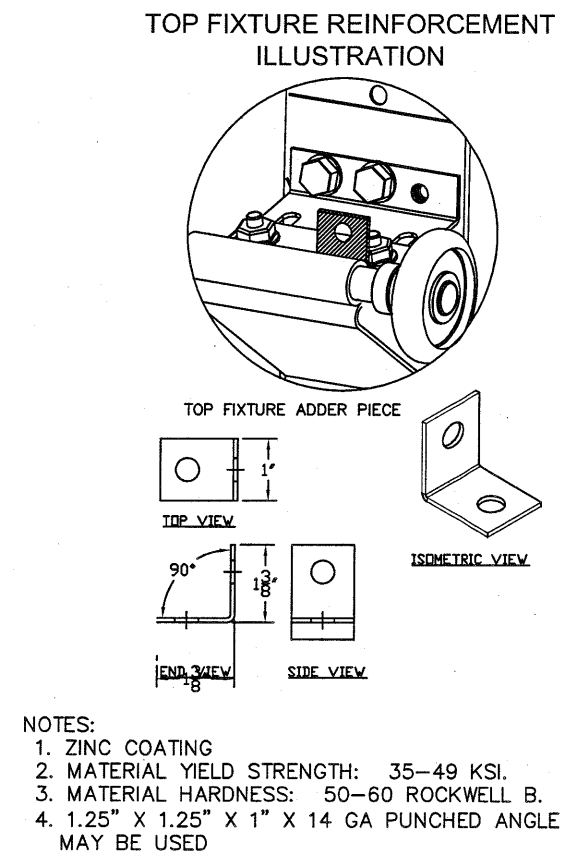

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 21-0408.02

Approval Date 08/05/2021

By 
Miami-Dade Product Control

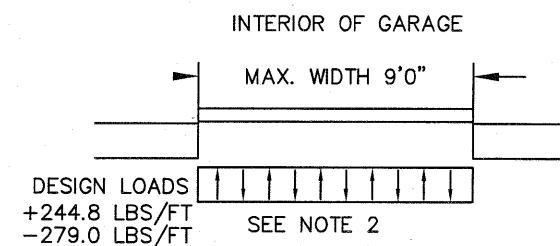

1. ALL THE LOAD FROM THE DOOR IS TRANSFERRED TO THE VERTICAL TRACK, FROM THE TRACK THE LOAD IS TRANSFERRED TO THE VERTICAL JAMBS. THE HORIZONTAL JAMB OR HEADER RECEIVES NO PORTION OF THE LOAD TRANSFERRED FROM THE DOOR.
2. EACH VERTICAL JAMBS RECEIVES MAXIMUM DESIGN LOADS OF:
+244.8 LBS/FT & -279.0 LBS/FT
3. DOOR AND HARDWARE WILL BE DESIGNED, MANUFACTURED AND INSTALLED WITH STANDARDS AS SET FORTH BY DASMA.
4. DOOR SECTIONS SHALL BE 24 GA. MIN. (.022") EXTERIOR SKIN ROLLED FORMED, G30 GALVNZED W/ POLYESTER TOP COAT
5. SUPPORTING STRUCTURAL ELEMENTS SHALL BE DESIGNED BY A REGISTERED PROFESSIONAL ENGINEER FOR WIND LOADS INDICATED ON THIS DRAWING IN ADDITION TO OTHER LOADINGS.
6. THIS APPROVAL REQUIRES THE MANUFACTURER TO DO TESTING OF ALL COILS USED TO FABRICATE DOOR PANELS UNDER THIS NOTICE OF ACCEPTANCE. A MINIMUM OF 2 SPECIMENS SHALL BE CUT FROM EACH COIL AND TENSILE TESTED ACCORDING TO ASTM E-8 BY A DADE COUNTY APPROVED LAB SELECTED AND PAID BY THE MANUFACTURER. EVERY 3 MONTHS, 4 TIMES A YEAR, THE MANUFACTURER SHALL MAIL TO THIS OFFICE: A COPY OF THE TEST REPORTS WITH CONFIRMATION THAT THE SPECIMENS WERE SELECTED FROM COILS AT THE MANUFACTURER PRODUCTION FACILITIES. AND A NOTARIZED STATEMENT FROM THE MANUFACTURER THAT ONLY COILS WITH YIELD STRENGTH OF 47,000 PSI OR MORE SHALL BE USED TO MAKE DOOR PANELS FOR DADE COUNTY UNDER THIS NOTICE OF ACCEPTANCE.

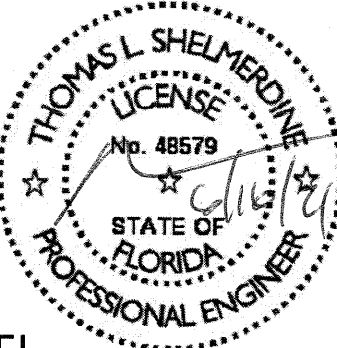
REV	DESCRIPTION OF REVISIONS	DATE	BY
<p>MAX SIZE 9' x 14'</p> <p>DESIGN LOADS +54.4 PSF -62.0 PSF</p> <p>TEST LOADS +81.6 PSF -93.0 PSF</p> <p>LARGE MISSILE IMPACT RESISTANCE</p>		<p>Thomas L. Shelmerdine, PE (FL PE #0048579) Structural Solutions, PA (FL Firm #29412)</p> <p>FL</p>  <p>dba Structural Solutions of North Carolina, Inc. 5921-G.W. Friendly Ave., Greensboro, NC 27410</p>	
<p><i>Amarr</i></p> <p>ENTRE/MATIC</p>			
<p>MODEL #500</p> <p>CLASSICA 1000, 2000</p>			
SIZE	DRAWN BY	DRC	DATE 1/18/21
B	CHECKED BY	DLJ	DATE 1/21/21
<p>ENTRE/MATIC</p> <p>165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105</p>			<p>DRAWING NUMBER</p> <p>IRC-5309-185-21-I</p>
<p>SHEET 2 OF 3</p>			<p>SHEET 2 OF 3</p>

TABLE 1

DOOR HEIGHT	TRACK ATTACHMENT															TYPICAL SPLICE
	A	B	C	D	E	F	G	H	I	J	K	L	M	N		
7' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"									76"
7' 6"	3.5"	10.0"	22.0"	34"	46"	58"	70"									82"
8' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"								88"
8' 6"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"								94"
9' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"							100"
9' 6"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"							106"
10' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"	106"						112"
11' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"	106"	118"					124"
12' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"	106"	118"	130"				136"
13' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"			148"
14' 0"	3.5"	10.0"	22.0"	34"	46"	58"	70"	82"	94"	106"	118"	130"	142"	154"		160"

ALL TRACK AND ATTACHMENT SPACING +/-2"
ALLOWED WITH SYP OR SPF NO. 2 OR BETTER ONLY

TABLE 2

Section Width (ft)	Panel Type	Center Stile Location (Measured from Left)	
		1st (in)	2st (in)
6' 0	Short	24.6	47.4
7' 0	Short	29.1	54.9
7' 2	Short	29.9	56.1
7' 4	Short	30.6	57.4
7' 6	Long/Short	45.0	
7' 8	Long/Short	46.0	
7' 10	Long/Short	47.0	
8' 0	Long/Short	48.0	
8' 2	Long/Short	49.0	
8' 4	Long/Short	50.0	
8' 6	Long/Short	51.0	
8' 8	Long/Short	52.0	
8' 10	Long/Short	53.0	
9' 0	Long/Short	54.0	


TABLE 3

SECTION	STRUT SIZE
TOP	3 5/8" TRUSS
	3" STRUT
5TH	3 5/8" TRUSS
	3" STRUT
4TH	3 5/8" TRUSS
	3" STRUT
3RD	3 5/8" TRUSS
	3" STRUT
2ND	3 5/8" TRUSS
	3" STRUT
BOTTOM	3 5/8" TRUSS
	3 5/8" TRUSS

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. 23-1114.04
Expiration Date 08/05/2026
By Ishaq I. Chande
Miami-Dade Product Control

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 21-0408.02
Approval Date 08/05/2021
By R. J. [Signature]
Miami-Dade Product Control

WOOD JAMB ATTACHMENT TO STRUCTURE

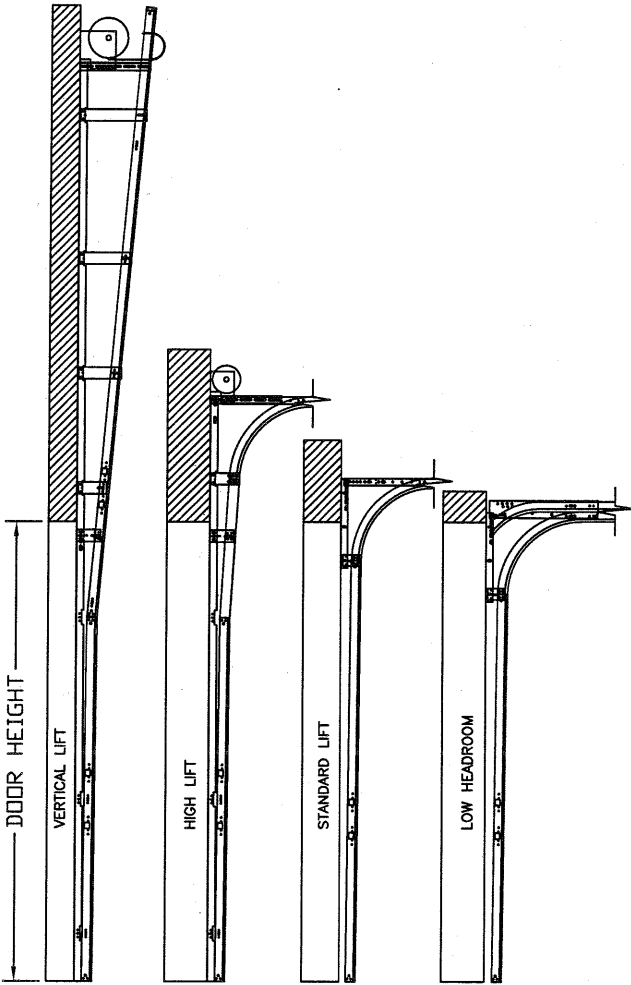

AVAILABLE TRACK CONFIGURATIONS
N.T.S.

2 X 6 VERTICAL JAMB ATTACHMENT TO WOOD FRAME STRUCTURE (G=0.42)
5/16" X 3" LAG SCREWS STARTING 6" FROM ENDS THEN 20" O.C. (1 1/2" EMBEDMENT)
2 X 6 VERTICAL JAMB ATTACHMENT TO 2,000 PSI CONCRETE
HILTI KWIK BOLT 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 18" O.C. (1 1/4" EMBEDMENT)
ITW/RAMSET REDHEAD (TRU-BOLT) 3/8" X 4" STARTING 6" FROM ENDS THEN 24" O.C. (2 1/2" EMBEDMENT)
2 X 6 VERTICAL JAMB ATTACHMENT TO HOLLOW C-90 BLOCK
SIMPSON 1/4" X 3" TITEN SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART)
AT 8" O.C. (1 1/2" EMBEDMENT)
HILTI 1/4" X 2-3/4" KWIK-CON II+ SCREWS STARTING 6" FROM ENDS, USE PAIRS OF FASTENERS (3" APART)
AT 8" O.C. (1 1/4" EMBEDMENT)
2 X 6 VERTICAL JAMB ATTACHMENT TO GROUTED C-90 BLOCK (2000 PSI GROUT)
HILTI SLEEVE ANCHOR 3/8" X 2-3/4" STARTING 6" FROM ENDS THEN 20" O.C. (1 1/4" EMBEDMENT)
(OR, USE FASTENERS FOR HOLLOW C-90 BLOCK)

*LAGS AND BOLTS CAN BE COUNTERSUNK TO PROVIDE A FLUSH MOUNTING SURFACE.
*PREPARATION OF WOOD JAMBS BY OTHERS

WOOD STRUCTURE
CONCRETE STRUCTURE
HOLLOW BLOCK STRUCTURE
GROUTED BLOCK STRUCTURE

EMBEDMENT
1/2" MIN
2-3/4" MIN
1-1/2" MIN
3" MIN
4"

2X6 JAMB TYP.

REV	DESCRIPTION OF REVISIONS	DATE	BY

MAX SIZE
9' x 14'

DESIGN LOADS
+54.4 PSF
-62.0 PSF

TEST LOADS
+81.6 PSF
-93.0 PSF

LARGE MISSILE
IMPACT
RESISTANCE

Thomas L. Shelmerdine, PE (FL PE #0048579)
Structural Solutions, PA (FL Firm #29412)

THOMAS L. SHELMERDINE
LICENSE
No. 48579
STATE OF
FLORIDA
PROFESSIONAL ENGINEER
FL

dba Structural Solutions of North Carolina, Inc.
5921-G W. Friendly Ave., Greensboro, NC 27410

Amarr
ENTREMATICA

MODEL #500
CLASSICA 1000, 2000

SIZE B	DRAWN BY DRC	DATE 1/18/21	DRAWING NUMBER IRC-5309-185-21-1
	CHECKED BY DLJ	DATE 1/21/21	

ENTREMATICA
165 CARRIAGE COURT WINSTON-SALEM, N.C. 27105

SHEET 3 OF 3