



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)  
BOARD AND CODE ADMINISTRATION DIVISION  
**NOTICE OF ACCEPTANCE (NOA)**

MIAMI-DADE COUNTY  
PRODUCT CONTROL SECTION  
11805 SW 26 Street, Room 208  
Miami, Florida 33175-2474  
T (786) 315-2590 F (786) 315-2599  
[www.miamidade.gov/economy](http://www.miamidade.gov/economy)

The Door Store of America, Inc.,  
10681 World Trade Blvd.  
Raleigh, N.C. 27617

**SCOPE:**

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER -Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

**DESCRIPTION: Series "Complete Collection" Inswing Glazed Wood Doors-L. M. Impact**

**APPROVAL DOCUMENT:** Drawing No. **DSA 0008 Rev 1**, titled "Inswing Opaque Wood Door", sheets 1, 2 (2A-2D), 3 (3A-3D), 4 (4A-4C), 5 (5A-5C), 6-11, 12(12A),13, 14 (14A), 15 (15A-15C), 16 thru 19 of 19 dated 08/03/22 and last revised on 09/06/22, prepared by PTC, signed and sealed by Robert J. Amoruso, P.E., bearing the Miami-Dade County Product Control Revision stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

**MISSILE IMPACT RATING: Large and Small Missile Impact Resistant**

**Limitations:**

1. Multi-point **Ashland** applicable to all models. **Gu**-multi-point limited to Single doors only see sheets 15, 15A-15C.
2. **Partial** raised/Opaque panels are limited to max. **24-1/2" W X 33-7/8" H**.
3. Max **DLO** (day light opening) = **24-1/2"** wide X **105-1/8"** high. See glazing note 6, sheet 1 (laminated glass at Exterior)
4. See approved glazed models' sheets 17 thru 19. Partial opaque permitted. Model with Surface applied Muntin only.
5. Limited Water infiltration Rating, see **Positive DP** in sheet **1**. See sheets 6, 8 and 9 for sill (thresholds) installation.

**LABELING:** Each unit shall bear a permanent label with the manufacturer's name or logo, State and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

**RENEWAL** of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

**TERMINATION** of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

**ADVERTISEMENT:** The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

**INSPECTION:** A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **revises #20-1130.02** consists of this page 1 and evidence pages E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Ishaq I. Chanda, P.E.**



*Ishaq I. Chanda*  
01/04/24

NOA No. 23-1117.07  
Expiration Date: October 13, 2027  
Approval Date: January 04, 2024  
Page 1

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**A. DRAWINGS**

1. Manufacturer's parts and sections drawings
2. Drawing No. **DSA 0008 Rev 1**, titled "Inswing Opaque Wood Door", sheets 1, 2 (2A-2D), 3 (3A-3C), 4 (4A-4C), 5 (5A-5C), 6-11, 12(12A), 13, 14 (14A), 15 (15A-15C), 16 thru 19 of 19 dated 08/03/22 and last revised on 09/06/22, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.

**B. TESTS**

1. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94 (limited +19.5 PSF)
  - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
  - 5) Large Missile impact Test per FBC, TAS 201-94
  - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of Rectangular Inswing /Outswing glazed Wood doors, prepared by American Testing Lab, Test Report No(s). **ATLNC 0624.01-19**, dated 05/13/20, signed & sealed by David Johnson, P.E.

(These test reports have been revised by an addendum letter dated 09/21/2022, issued by American Testing Lab, signed & sealed by David Johnson, P.E.)

2. Test reports on 1) Air Infiltration Test, per FBC, TAS 202-94
  - 2) Uniform Static Air Pressure Test, Loading per FBC, TAS 202-94
  - 3) Water Resistance Test, per FBC, TAS 202-94 (limited +19.5 PSF)
  - 4) Forced Entry Test, per FBC 2411 3.2.1 and TAS 202-94
  - 5) Large Missile impact Test per FBC, TAS 201-94
  - 6) Cyclic Wind Pressure Loading per FBC, TAS 203-94

Along with marked-up drawings and installation diagram of shaped Inswing glazed Wood doors, prepared by American Testing Lab, Test Report No(s). **ATLNC 0624.01-19 (Addendum 2)**, dated 08/08/22, signed & sealed by David Johnson, P.E

**C. CALCULATIONS**

1. Anchor verification calculations, dated 08/02/2022, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.
2. Glazing complies with ASTM E-1300-09, -12 and -16.

**D. QUALITY ASSURANCE**

1. Miami Dade department of Regulatory and Economic Resources (RER).

**E. MATERIAL CERTIFICATIONS**

1. Notice of Acceptance No. **17-0808.02** issued to **Kuraray America, Inc.** for their "SentryGlas® (Clear and White) Glass Interlayers", expiring on 07/04/23.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-1117.07**  
**Expiration Date: October 13, 2027**  
**Approval Date: January 04, 2024**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

**F. STATEMENTS**

1. Statement letters of conformance to FBC 2020 (7<sup>th</sup> Edition) and “No financial interest”, both dated 10/26/20, signed & sealed by prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.

**G. OTHER**

1. Test proposal # **21-1045** dated 10/12/21, approved by RER.
2. Article of incorporation and Business corporation name, issued by State of North Carolina.

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-1117.07**  
**Expiration Date: October 13, 2027**  
**Approval Date: January 04, 2024**

**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS** (submitted under previous approval)
1. Drawing No. **DSA 0008 Rev 1**, titled “Inswing Opaque Wood Door”, sheets 1, 2 (2A-2D), 3 (3A-3C), 4 (4A-4C), 5 (5A-5C), 6-11, 12(12A),13, 14 (14A), 15 (15A-15C), 16 thru 19 of 19 dated 08/03/22 and last revised on 09/06/22, prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.
- B. TESTS**
1. None.
- C. CALCULATIONS** (submitted under previous approval)
1. None.
- D. QUALITY ASSURANCE**
1. Miami Dade department of Regulatory and Economic Resources (RER).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**”, expiring on 07/04/28.
- F. STATEMENTS**
1. Statement letters of conformance to FBC 2023 (8<sup>th</sup> Edition), dated 11/07/23, signed & sealed by prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E
  2. Statement letters of conformance to FBC 2020 (7<sup>th</sup> Edition) and “No financial interest”, both dated 10/26/20, signed & sealed by prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E.(submitted under previous approval).
- G. OTHER**
1. This NOA **revises #20-1103.02** and updates to FBC 2023, expiring **10/13/27**.
  2. Article of incorporation and Business corporation name, issued by State of North Carolina. (submitted under previous approval).

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-1117.07**  
**Expiration Date: October 13, 2027**  
**Approval Date: January 04, 2024**



**NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED**

- A. DRAWINGS** (submitted under previous approval)
1. Drawing No. **DSA 0008 Rev 1**, titled “Inswing Opaque Wood Door”, sheets 1, 2 (2A-2D), 3 (3A-3D), 4 (4A-4C), 5 (5A-5C), 6-11, 12(12A),13, 14 (14A), 15 (15A-15C), 16 thru 19 of 19 dated 08/03/22 and last revised on 09/06/22, prepared by PTC, signed and sealed by Robert J. Amoruso, P.E.
- B. TESTS**
1. None.
- C. CALCULATIONS** (submitted under previous approval)
1. None.
- D. QUALITY ASSURANCE**
1. Miami Dade department of Regulatory and Economic Resources (RER).
- E. MATERIAL CERTIFICATIONS**
1. Notice of Acceptance No. **23-0717.30** issued to **Kuraray America, Inc.** for their “**SentryGlas® (Clear and White) Glass Interlayers**”, expiring on 07/04/28.
- F. STATEMENTS**
1. Statement letters of conformance to FBC 2023 (8<sup>th</sup> Edition), dated 11/07/23, signed & sealed by prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E
  2. Statement letters of conformance to FBC 2020 (7<sup>th</sup> Edition) and “No financial interest”, both dated 10/26/20, signed & sealed by prepared by PTC, LLC, signed and sealed by Robert J. Amoruso, P.E. (submitted under previous approval).
- G. OTHER**
1. This NOA revises **#20-1103.02** and updates to FBC 2023, expiring **10/13/27**.
  2. Article of incorporation and Business corporation name, issued by State of North Carolina. (submitted under previous approval).

*Ishaq I. Chanda*

---

**Ishaq I. Chanda, P.E.**  
**Product Control Unit Supervisor**  
**NOA No. 23-1117.07**  
**Expiration Date: October 13, 2027**  
**Approval Date: January 04, 2024**



The Door Store of America, Inc.

Complete Collection, Single and Double Doors, Inswing, Fully and Partially Glazed

GENERAL NOTES:

1. THIS PRODUCT IS DESIGNED TO COMPLY WITH THE CURRENT EDITION OF THE FLORIDA BUILDING CODE - BUILDING AND RESIDENTIAL REQUIREMENTS INCLUDING THE HIGH VELOCITY HURRICANE ZONE (HVHZ) AT THE DESIGN PRESSURE(S) STATED HEREIN. THE PRODUCT DETAILS CONTAINED HEREIN ARE BASED UPON SIGNED AND SEALED TEST REPORT NO. ATLNC 0624.01-19, DATED 5/13/20 AND ADDENDUM DATED 07/20/22 AND ASSOCIATED LABORATORY STAMPED DRAWINGS, SIGNED AND SEALED BY DAVID WESLEY JOHNSON, FL PE NO. 61915. TESTING WAS PERFORMED TO THE FOLLOWING:
- 1.1. ASTM E330-02, ASTM E331-00, ASTM E283-04
- 1.2. TAS 201-94, TAS 202-94 AND TAS 203-94
2. ADEQUACY OF THE EXISTING STRUCTURAL CONCRETE / MASONRY AND 2X FRAMING AS A MAIN WIND FORCE RESISTING SYSTEM CAPABLE OF WITHSTANDING AND TRANSFERRING APPLIED PRODUCT LOADS TO THE STRUCTURE IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
3. 1X AND 2X BUCKS (WHEN USED) SHALL BE DESIGNED AND ANCHORED TO PROPERLY TRANSFER ALL LOADS TO THE STRUCTURE. BUCK DESIGN AND INSTALLATION IS THE RESPONSIBILITY OF THE ARCHITECT OR ENGINEER OF RECORD.
4. IN AREAS WHERE WIND-BORNE DEBRIS PROTECTION REQUIREMENTS EXIST, USE OF AN APPROVED IMPACT PROTECTIVE SYSTEM IS NOT REQUIRED WITH THIS PRODUCT.
5. DOOR FRAME AND PANEL MATERIAL: MAHOGANY, KNOTTY-ALDER, WALNUT, WHITE OAK AND ACCOYA. MINIMUM SPECIFIC GRAVITY (SG) = 0.55 FOR BASIC AND 0.68 FOR 12% MC.
6. GLAZING: 1" OVERALL THICKNESS: 5/32" TEMPERED, AIR SPACE (1/2" TPS SPACER BY PT ABEBERSA PRATAMA), 5/16" LAMINATED (1/8" ANNEALED x KURARAY AMERICA 0.090 SG INTERLAYER x 1/8" ANNEALED). GLAZED USING DOW 995 STRUCTURAL ADHESIVE GRADE SEALANT.
- 6.1. GLASS MEETS THE REQUIREMENTS OF ASTM E1300-12AE1.
7. SITE CONDITIONS THAT DEVIATE FROM THE DETAILS OF THIS DRAWING REQUIRE FURTHER ENGINEERING EVALUATION BY A LICENSED ENGINEER OR REGISTERED ARCHITECT.
8. DESIGNATION "X" STANDS FOR OPERABLE PANEL.
9. HARDWARE (AS-TESTED; SUBSTITUTIONS ALLOWED PER FBC REQUIREMENTS):
- 9.1. MULTI-POINT LOCK AND HANDLES BY:
- 9.1.1. DOUBLE (XX) DOOR: ASHLAND MULTIPOINT HARDWARE; MODEL V-5100-560.
- 9.1.2. SINGLE (X) FOOR: GU MULTIPOINT HARDWARE; MODEL 6-35565-02-R-8B.
- 9.2. HINGES: (10) STEEL 4-1/2" X 4-1/2" BALL BEARING HINGES BY PHILADELPHIA HARDWARE
- 9.3. THRESHOLD: HYDROSILL 2200 SERIES FOR INSWING BY SCHLEGEL
10. INTERIOR AND EXTERIOR FINISHING AND PERIMETER SEALING ARE FOR ILLUSTRATIVE PURPOSES ONLY. THESE DRAWINGS CERTIFY THE DOOR INSTALLATION ONLY. WATER SEALING OF THE INSTALLED DOOR IS NOT PART OF THIS INSTALLATION CERTIFICATION. WATER SEALING SHALL BE THE RESPONSIBILITY OF THE INSTALLER.
- 10.1. PERIMETER AND JOINT SEALANT BY OTHERS TO BE DESIGNED IN ACCORDANCE WITH THE FBC RESIDENTIAL AND BUILDING AND WITH FMA/AAMA/WDMA PROTOCOLS OR AS RECOMMENDED BY THE MANUFACTURER.

PRODUCT REVISED  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishay I. Chanin  
Miami-Dade Product Control

INSTALLATION NOTES:

1. INSTALLATION ANCHORAGE SHALL BE LOCATED AS SHOWN IN THE FOLLOWING ELEVATION VIEWS.
- 1.1. 2X WOOD FRAMING OR BUCKING SUBSTRATES SHOWN ON SHEET 3, 3A, 3B & 3C.
- 1.2. CONCRETE AND MASONRY SUBSTRATES AS SHOWN ON SHEET 4, 4A, 4B & 4C.
2. SPECIFIC INSTALLATION DETAILS ARE SHOWN ON THE FOLLOWING SHEETS.
- 2.1. 2X WOOD FRAMING OR BUCKING AT HEAD, SILLS OR JAMBS
- 2.1.1. SEE DETAILS ON SHEET 6 FOR HEAD AND SILL INSTALLATION ANCHORAGE REQUIREMENTS.
- 2.1.2. SEE DETAILS ON SHEET 7 FOR JAMB INSTALLATION ANCHORAGE REQUIREMENTS.
- 2.2. CONCRETE OR MASONRY AT HEAD, SILLS OR JAMBS (OPTIONAL 1X WOOD BUCK ALLOWED, SEE NOTE 3.1)
- 2.1.1. SEE DETAILS ON SHEET 8 FOR HEAD AND SILL INSTALLATION ANCHORAGE REQUIREMENTS.
- 2.1.2. SEE DETAILS ON SHEET 9 FOR JAMB INSTALLATION ANCHORAGE REQUIREMENTS.
3. VERTICAL AND HORIZONTAL SECTION VIEWS ARE SHOWN ON THE FOLLOWING SHEETS.
- 3.1. 2X WOOD FRAMING OR BUCKING AT HEAD, SILLS OR JAMBS
- 3.1.1. SEE DETAILS ON SHEET 11 FOR VERTICAL SECTION VIEWS OF HEAD AND SILL.
- 3.1.2. SEE DETAILS ON SHEET 12 & 12A FOR HORIZONTAL SECTION VIEWS OF JAMBS.
- 3.2. CONCRETE OR MASONRY AT HEAD, SILLS OR JAMBS (OPTIONAL 1X WOOD BUCK ALLOWED, SEE NOTE 3.1)
- 3.1.1. SEE DETAILS ON SHEET 13 FOR VERTICAL SECTION VIEWS OF HEAD AND SILL.
- 3.1.2. SEE DETAILS ON SHEET 14 & 14A FOR HORIZONTAL SECTION VIEWS OF JAMBS.
4. INSTALLATION SCREW (ANCHORAGE) SPECIFICATION
- 4.1. NO. 14 WOOD SCREWS.
- 4.1.1. WOOD SCREWS SHALL MEET ANSI B18.6.1 AND BE A MINIMUM GRADE 2 STRENGTH
- 4.1.2. MINIMUM EMBEDMENT IS 1-1/2". WOOD SCREW LENGTHS CAN BE VARIED IF NEEDED AS LONG AS MINIMUM EMBEDMENT IS MAINTAINED. THIS REQUIREMENT APPLICABLE TO SUBSTRATE EMBEDDED SCREWS ONLY.
- 4.1.3. MINIMUM EDGE DISTANCE AND SPACING BETWEEN SCREW IS 1".
- 4.2. 1/4" DIAMETER ELCO ULTRA CONCRETE SCREWS
- 4.2.1. MINIMUM EMBEDMENT IS 1-3/4" IN CONCRETE AND 1-1/4" IN MASONRY (CMU).
- 4.2.2. MINIMUM EDGE DISTANCE IS 2-1/2".
- 4.2.3. MINIMUM SPACING BETWEEN SCREWS IS 4".
- 4.2.3.1. EXCEPTION: HINGE ANCHORAGE AS SHOWN ON SHEET 9, DETAIL 10 HAS BEEN ACCOUNTED FOR. THE 3.484" SPACING BETWEEN ANCHORS IS ACCEPTABLE.
5. THE NUMBER OF INSTALLATION ANCHORS DEPICTED IS THE MINIMUM NUMBER OF ANCHORS TO BE USED FOR PRODUCT INSTALLATION AT THE MAXIMUM UNIT SIZE SHOWN. SMALLER UNIT SIZES CAN HAVE LESS ANCHORS AS LONG AS THE EDGE DISTANCE AND ON CENTER (O.C.) SPACING ARE THE SAME AS OR LESS THAN THAT SHOWN. INSTALLATION ANCHORS AT THE STRIKE PLATES AND HINGES SHALL REMAIN THE SAME.
6. SHIM AS REQUIRED AT EACH INSTALLATION ANCHOR WITH LOAD BEARING SHIM(S). MAXIMUM ALLOWABLE SHIM SIZE IS 1/4 INCH. SHIM WHERE SPACE OF 1/16 INCH OR GREATER OCCURS. SHIM(S) SHALL BE CONSTRUCTED OF HIGH DENSITY PLASTIC OR BETTER. SHIMS MAY NOT BE SHOWN IN THE SECTION VIEWS OF THIS DRAWING FOR CLARITY
7. MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDE WALL FINISHES (INCLUDING BUT NOT LIMITED TO STUCCO, FOAM, BRICK VENEER AND SIDING).

PERFORMANCE RATING			
MAXIMUM UNIT DIMENSIONS	DESIGN PRESSURE RATING (PSF)	WATER PENETRATION RATING	IMPACT RATING
76" X 123-1/16" XX INSWING - RECTANGULAR 76-1/8" X 122-7/8" XX INSWING - ARCH TOP 39-1/4" X 122-7/8" X INSWING - RECTANGULAR 39-1/4" X 122-7/8" X INSWING - ARCH TOP	±70.0 *	SEE NOTE 1 & 2 *	HVHZ LARGE MISSILE IMPACT
	+19.5 / -70	SEE NOTE 1 & 3	

NOTE 1: PRODUCT TESTED FOR LIMITED WATER PENETRATION RESISTANCE AT 19.5 PSF POSITIVE DESIGN PRESSURE.

NOTE 2: THE PRODUCT MUST BE USED WHERE WATER PENETRATION IS NOT REQUIRED OR WHERE AN OVERHANG MEETING THE REQUIREMENTS OF THE CURRENT EDITION OF THE FLORIDA BUILDING AND RESIDENTIAL CODES HAS BEEN EMPLOYED.

NOTE 3: WHERE DP REQUIREMENTS DO NOT EXCEED +19.5/-70 PSF, THE PRODUCT CAN BE USED WITHOUT OVERHANG.

TABLE OF CONTENTS	
SHEET	DESCRIPTION
1	NOTES - GENERAL & INSTALLATION
2, 2A, 2B, 2C & 2D	ELEVATIONS - X & XX RECTANGULAR, ARCH TOP, AND FULL RADIUS
3, 3A, 3B & 3C	ELEVATION - ANCHOR LAYOUT - WOOD INSTALLATION
4, 4A, 4B & 4C	ELEVATION - ANCHOR LAYOUT - CONCRETE/MASONRY INSTALLATION
5, 5A, 5B & 5C	ELEVATIONS - HINGES & BRICK MOULD
6	WOOD INSTALLATION - DETAILS 1 THRU 6
7	WOOD INSTALLATION - DETAILS 7 THRU 11
8	CONCRETE INSTALLATION - DETAILS 1 THRU 6
9	CONCRETE/MASONRY INSTALLATION - DETAILS 7 THRU 11
10	DETAILS - MISCELLANEOUS
11	SECTIONS - VERTICAL - WOOD INSTALLATION
12 & 12A	SECTIONS - HORIZONTAL - WOOD INSTALLATION
13	SECTIONS - VERTICAL - CONCRETE INSTALLATION
14 & 14A	SECTIONS - HORIZONTAL - CONCRETE/MASONRY INSTALLATION
15, 15A, 15B & 15C	MULTIPOINT LOCK LAYOUT
16	PANEL CONSTRUCTION - MULTIPOINT LOCK DETAIL
17 THRU 19	APPROVED CONFIGURATIONS

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
NOTES - GENERAL & INSTALLATION

PREPARED BY: RJA  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SCALE: N.T.S.  
REV: A  
SHEET: 1 OF 19

PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 12007  
LONGWOOD, FL 32073  
Phone: 321.690.1788  
Fax: 321.690.1789  
Email: info@ptc-corp.com  
FBIPE C.A. NO. 25935

Approved as complying with the  
Florida Building Code  
Date 10/13/2022  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishay I. Chanin

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752






XX  
RECTANGULAR  
ELEVATION  
EXTERIOR

**PRODUCT LIMITATIONS:**

1. MAXIMUM OVERALL (O.A.) FRAME SIZE
  - 1.1. 76" X 123-1/16"
2. MAXIMUM PANEL SIZE
  - 2.1. 36" X 120"
3. MINIMUM PANEL THICKNESS
  - 3.1. 2-1/4" (NOMINAL)
4. MAXIMUM DAYLIGHT OPENING (DLO)
  - 4.1. MAXIMUM FULL VIEW LITE DLO 24-1/4" X 105-1/8"
  - 4.2. DLO SHOWN IS APPROXIMATE AND MAY VARY.
5. FULL VIEW GLAZED LITES SHOWN.
6. SEE SHEETS 17, 18 AND 19 FOR ADDITIONAL APPROVED CONFIGURATIONS.
7. SEE SHEET 2D FOR PANEL RAIL AND STILE DIMENSIONING.

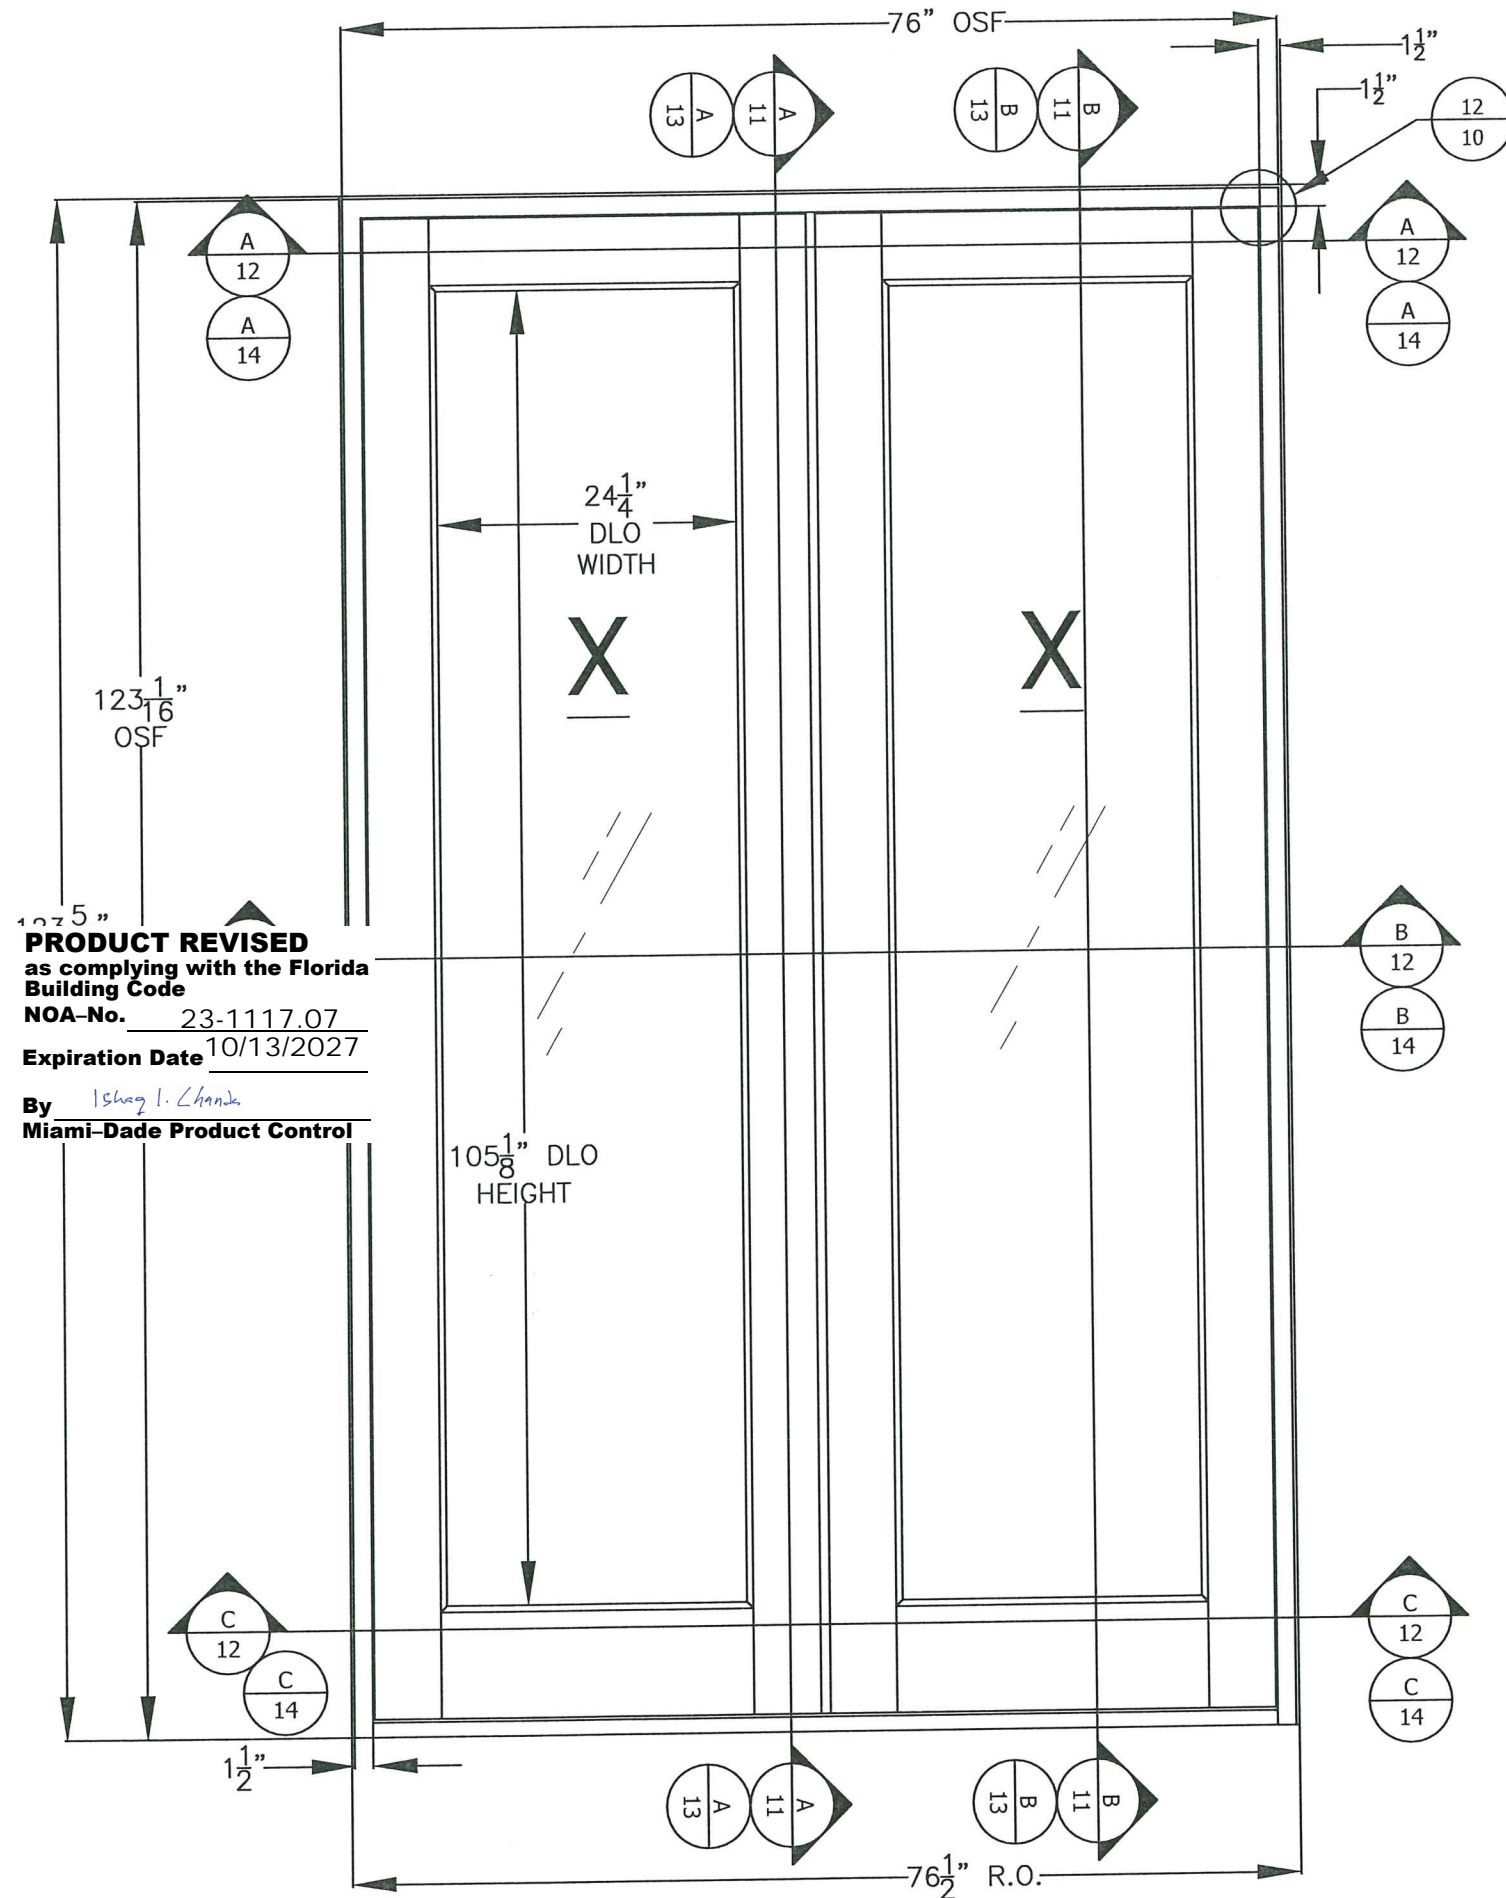

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130.02  
Miami Dade Product Control

By Isheyl L. Chavala

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752










XX PARTIALLY  
GLAZED ARCH  
TOP ELEVATION  
EXTERIOR

PRODUCT LIMITATIONS:

1. MAXIMUM OVERALL (O.A.) FRAME SIZE
  - 1.1. 39-1/4" X 122-7/8"
2. MAXIMUM PANEL SIZE
  - 2.1. 36" X 120"
3. MINIMUM PANEL THICKNESS
  - 3.1. 2-1/4" (NOMINAL)
4. MAXIMUM DAYLIGHT OPENING (DLO)
  - 4.1. MAXIMUM PARTIALLY GLAZED LITE DLO 24-1/4" X 79-3/4" & 24-1/4" X 85-3/4".
  - 4.2. DLO SHOWN IS APPROXIMATE AND MAY VARY.
5. PARTIALLY GLAZED LITES WITH OPAQUE RAISED PANELS SHOWN.
6. SEE SHEETS 17, 18 AND 19 FOR ADDITIONAL APPROVED CONFIGURATIONS.
7. SEE SHEET 2D FOR PANEL RAIL AND STILE DIMENSIONING.

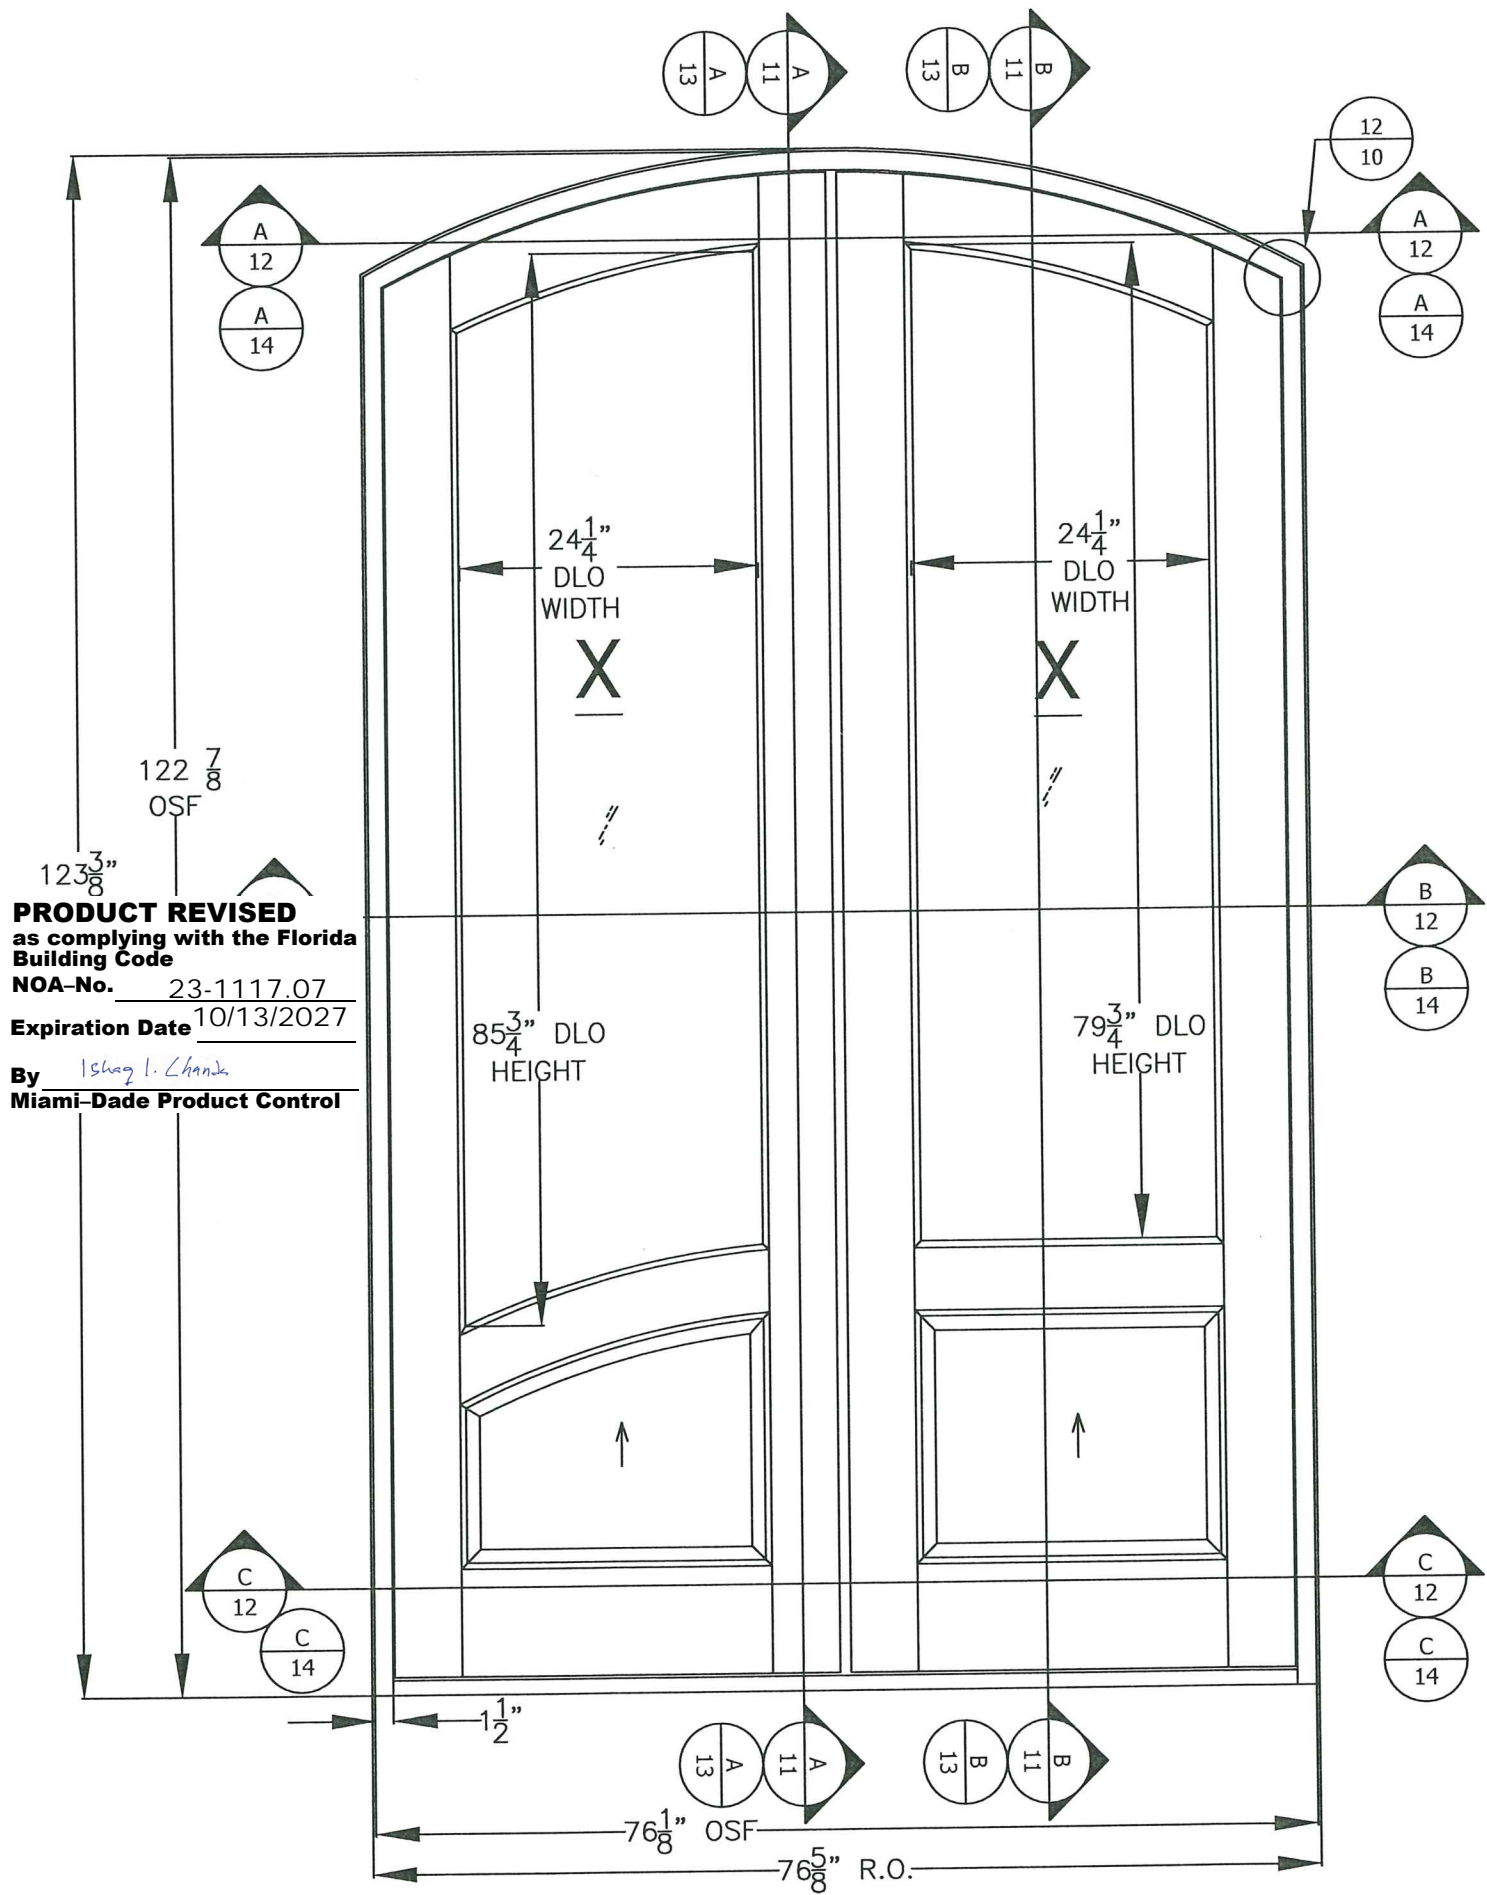

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
XX PARTIALLY GLAZED ARCH TOP ELEVATION

PREPARED BY: RJA DATE: 8/3/2022 DRAWING NO: DSA0008 SHEET: 2B OF 19

SCALE: N.T.S. REV: A

REVISED FOR MD COMMENTS

DATE

BY

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control

By Ishay L. Chandra

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752







# X PARTIALLY GLAZED RECTANGULAR AND ARCH TOP ELEVATIONS EXTERIOR

## PRODUCT LIMITATIONS:

1. MAXIMUM OVERALL (O.A.) FRAME SIZE
  - 1.1. 39-1/4" X 122-7/8"
2. MAXIMUM PANEL SIZE
  - 2.1. 36" X 120"
3. MINIMUM PANEL THICKNESS
  - 3.1. 2-1/4" (NOMINAL)
4. MAXIMUM DAYLIGHT OPENING (DLO)
  - 4.1. MAXIMUM PARTIALLY GLAZED LITE DLO 24-1/4" X 79-3/4"
  - 4.2. DLO SHOWN IS APPROXIMATE AND MAY VARY.
5. PARTIALLY GLAZED LITES WITH OPAQUE RAISED PANELS SHOWN.
6. SEE SHEETS 17, 18 AND 19 FOR ADDITIONAL APPROVED CONFIGURATIONS.
7. SEE SHEET 2D FOR PANEL RAIL AND STILE DIMENSIONING.

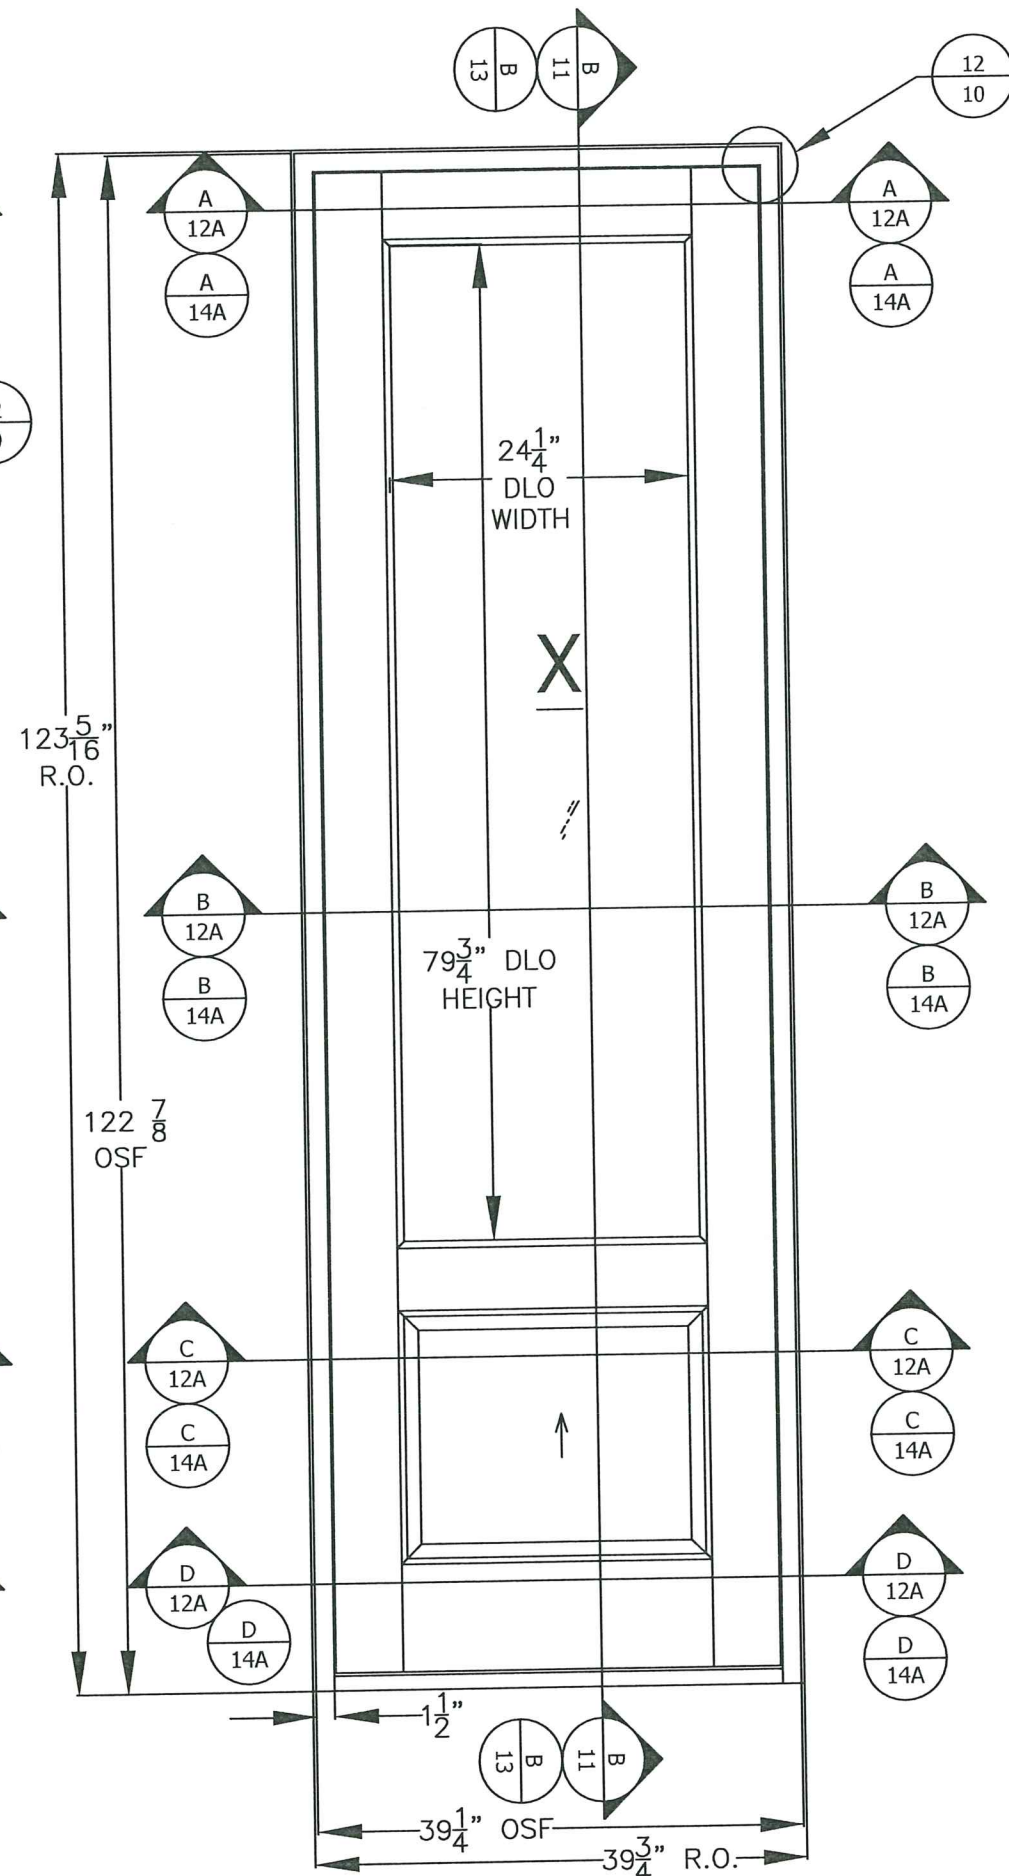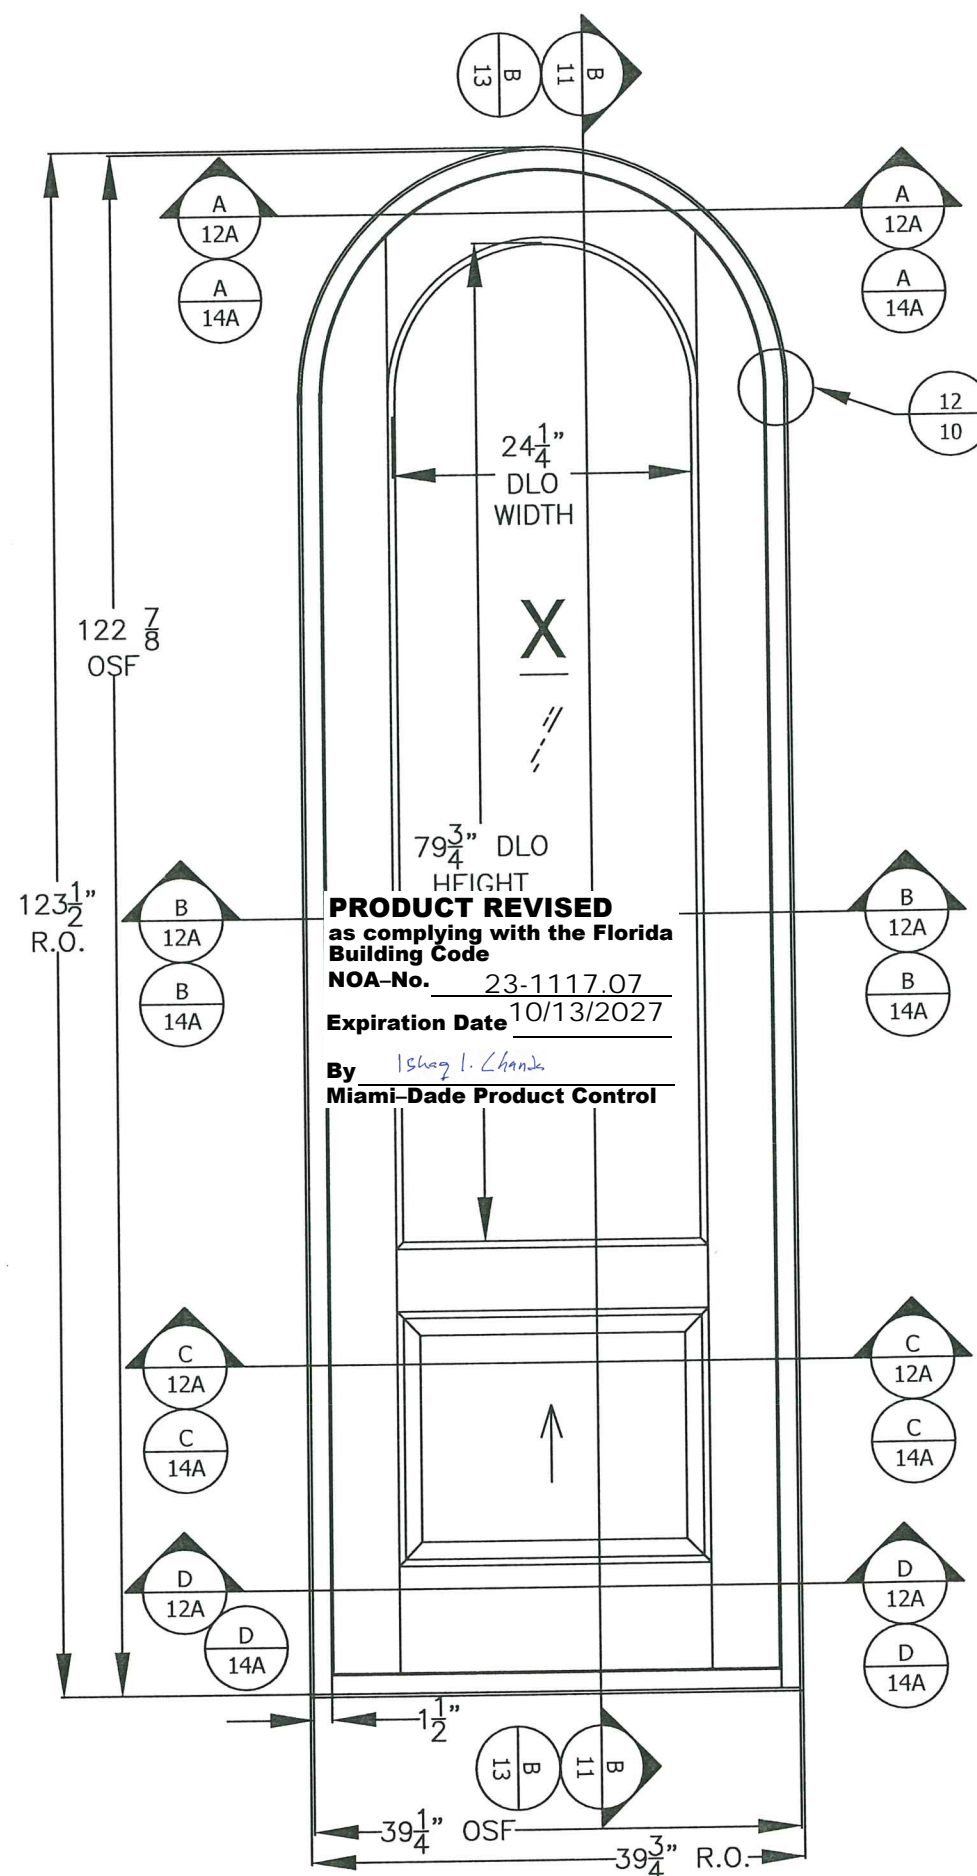

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
X PARTIALLY GLAZED RECTANGULAR AND ARCH TOP ELEVATIONS

PREPARED BY: RJA  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SCALE: N.T.S.  
REV: A  
SHEET: 2C OF 19

PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 52075  
LONGWOOD, FLORIDA 32752  
Phone: 321.690.1788  
Fax: 321.690.1789  
Email: info@ptc-corp.com  
FBPE C.A. NO. 23555


Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishag I. Chankh

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752






## EXTERIOR

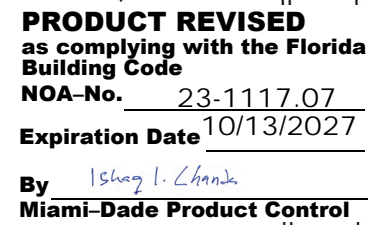

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

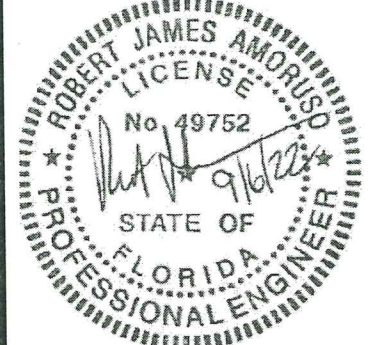

**The Door Store of America, Inc.**  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed PANEL RAIL AND STYLE SIZING ELEVATIONS	DRAWN BY:	DATE:
--	-----------	-------

**PREPARED BY:**

**PTC PRODUCT DESIGN GROUP, LLC**

Phone: 321.690.4788  
Fax: 321.690.1789  
Email: [info@ptc-corp.com](mailto:info@ptc-corp.com)

PO BOX 520775  
LONGWOOD, FLORIDA 32752  
FBPE C.A. NO. 25935


DRAWN BY: RJA	DATE: 8/3/2022
SCALE: N.T.S.	DRAWING NO: DSA0008
REV: A	SHEET: 2 OF 19

PROJECT #420-0601

[illegible]



XX  
RECTANGULAR  
ELEVATION  
2X WOOD  
BUCK/FRAMING  
INSTALLATION

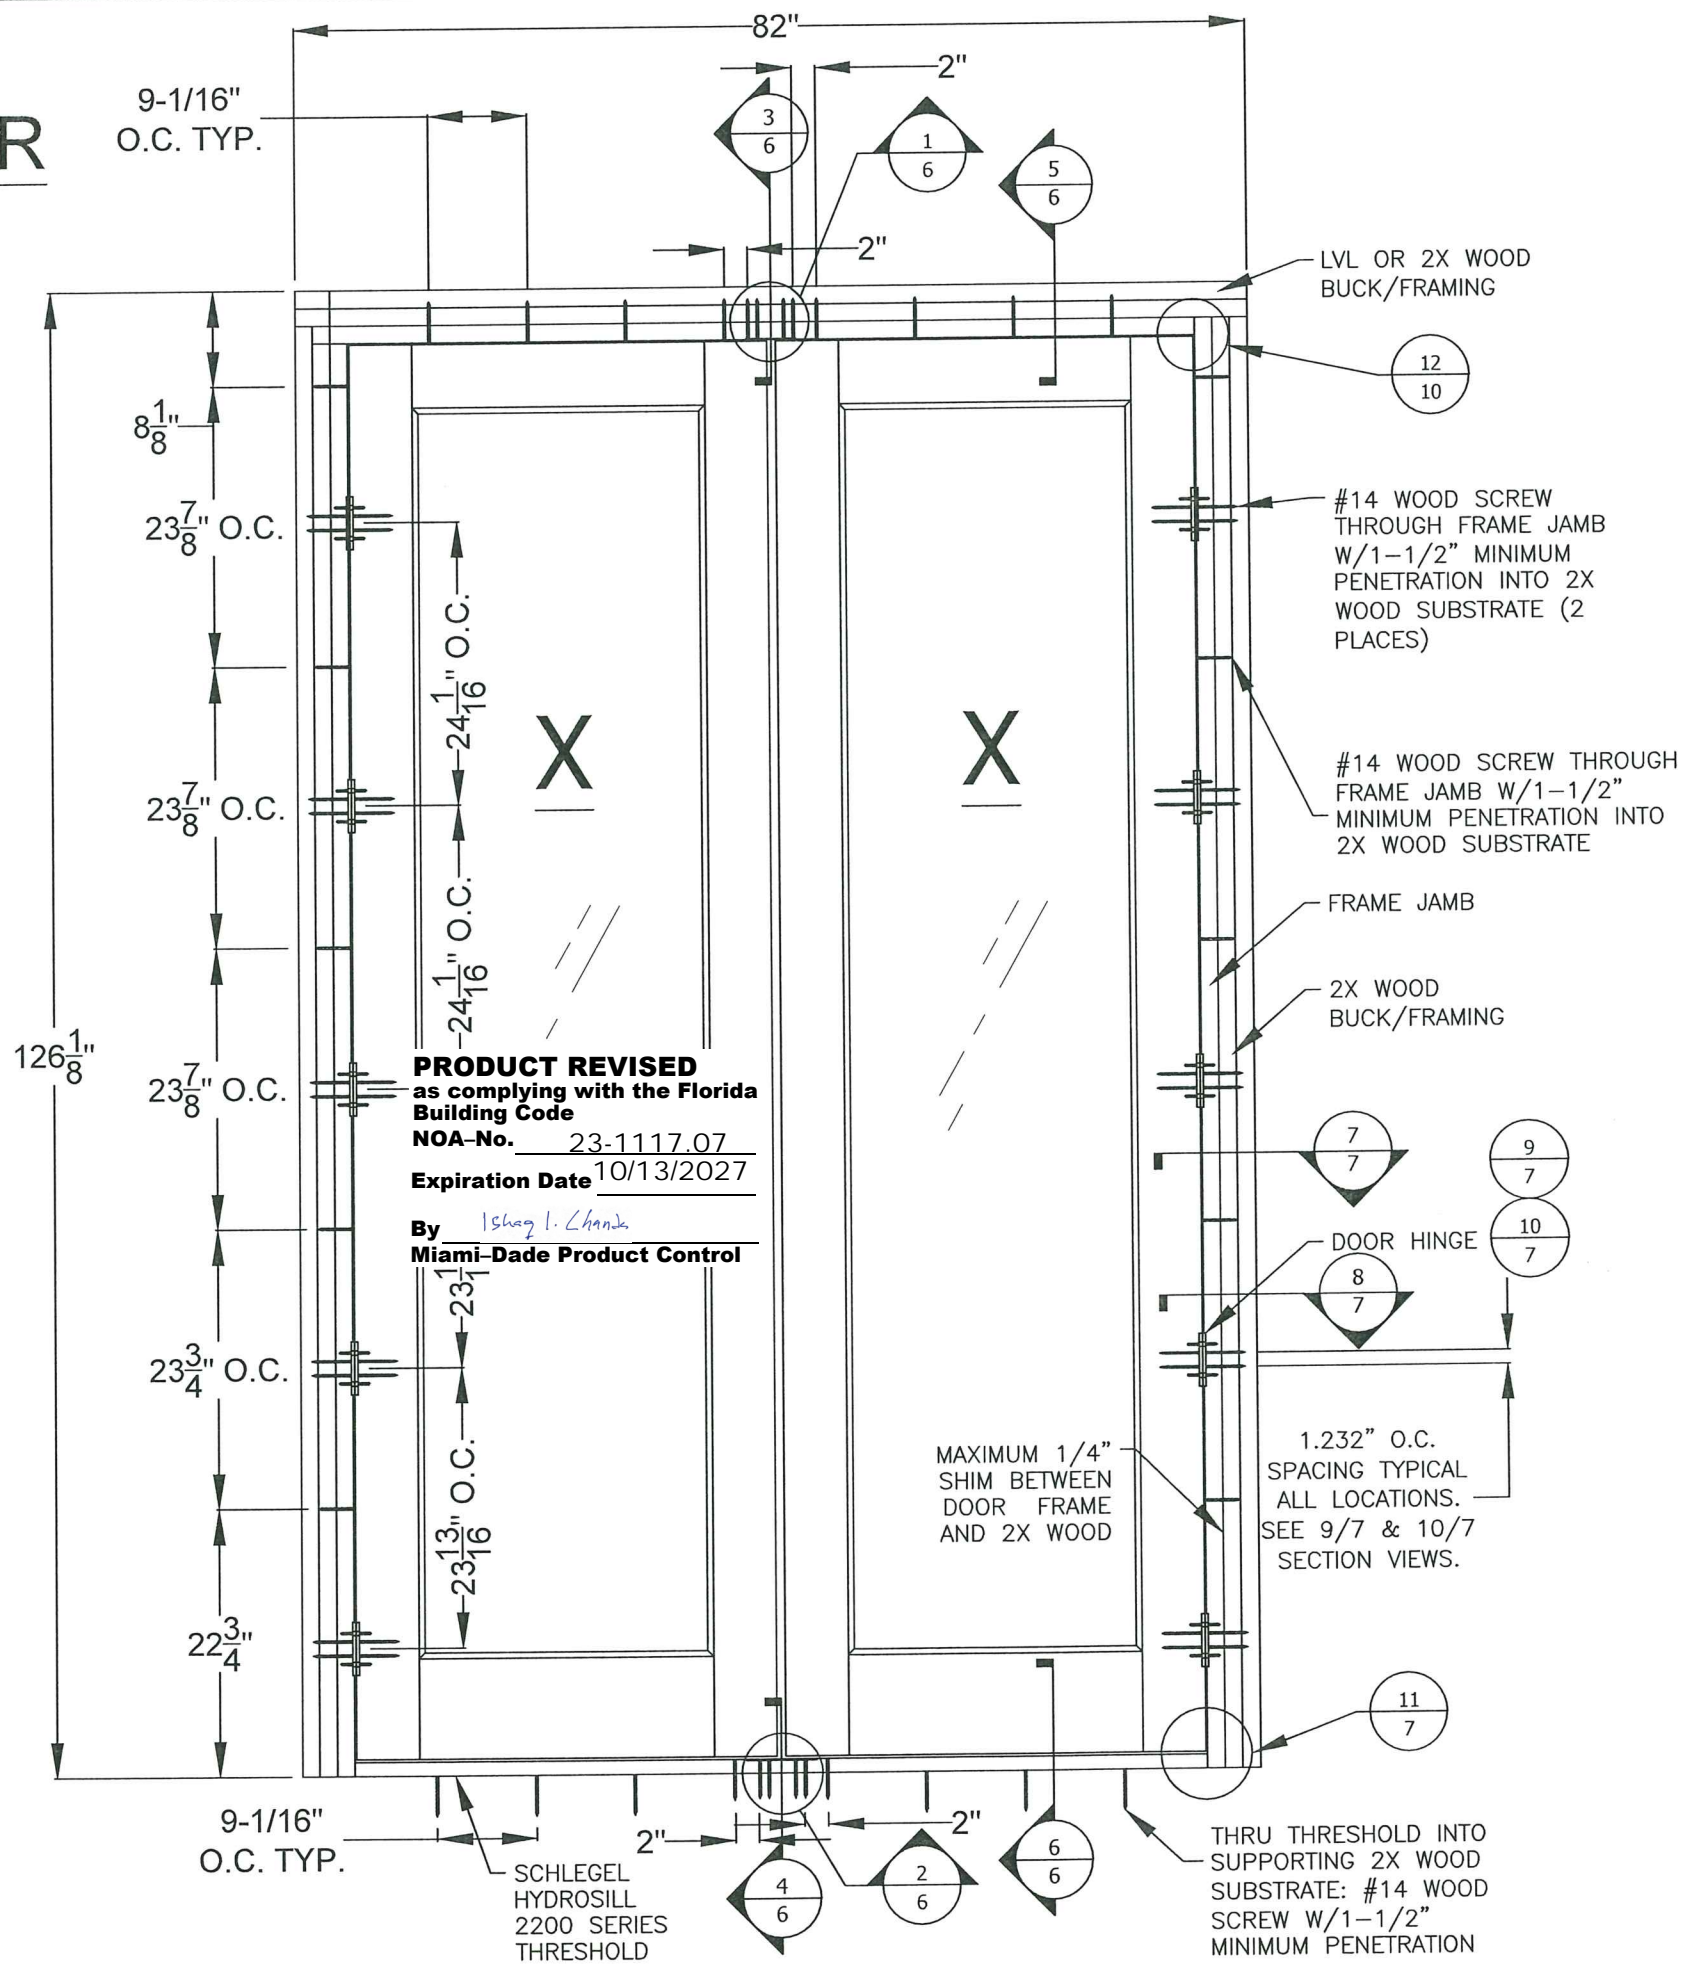

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

DATE: 8/3/2022

DRAWING NO: DSA0008

SHEET: 3 OF 19

PREPARED BY: RJA

SCALE: N.T.S.

REV: A

REVISOR: A

DATE: 9/2/2022

DESCRIPTION: REVISED FOR MD COMMENTS

BY: RJA

DATE: 9/2/2022

DESCRIPTION: REVISED FOR MD COMMENTS

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed

ELEVATION - ANCHOR LAYOUT - WOOD

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishag I. Chande


Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

ROBERT JAMES AMORUSO  
LICENSE  
No. 49752  
STATE OF  
FLORIDA  
PROFESSIONAL ENGINEER



# XX ARCH TOP ELEVATION

## 2X WOOD BUCK/FRAMING INSTALLATION

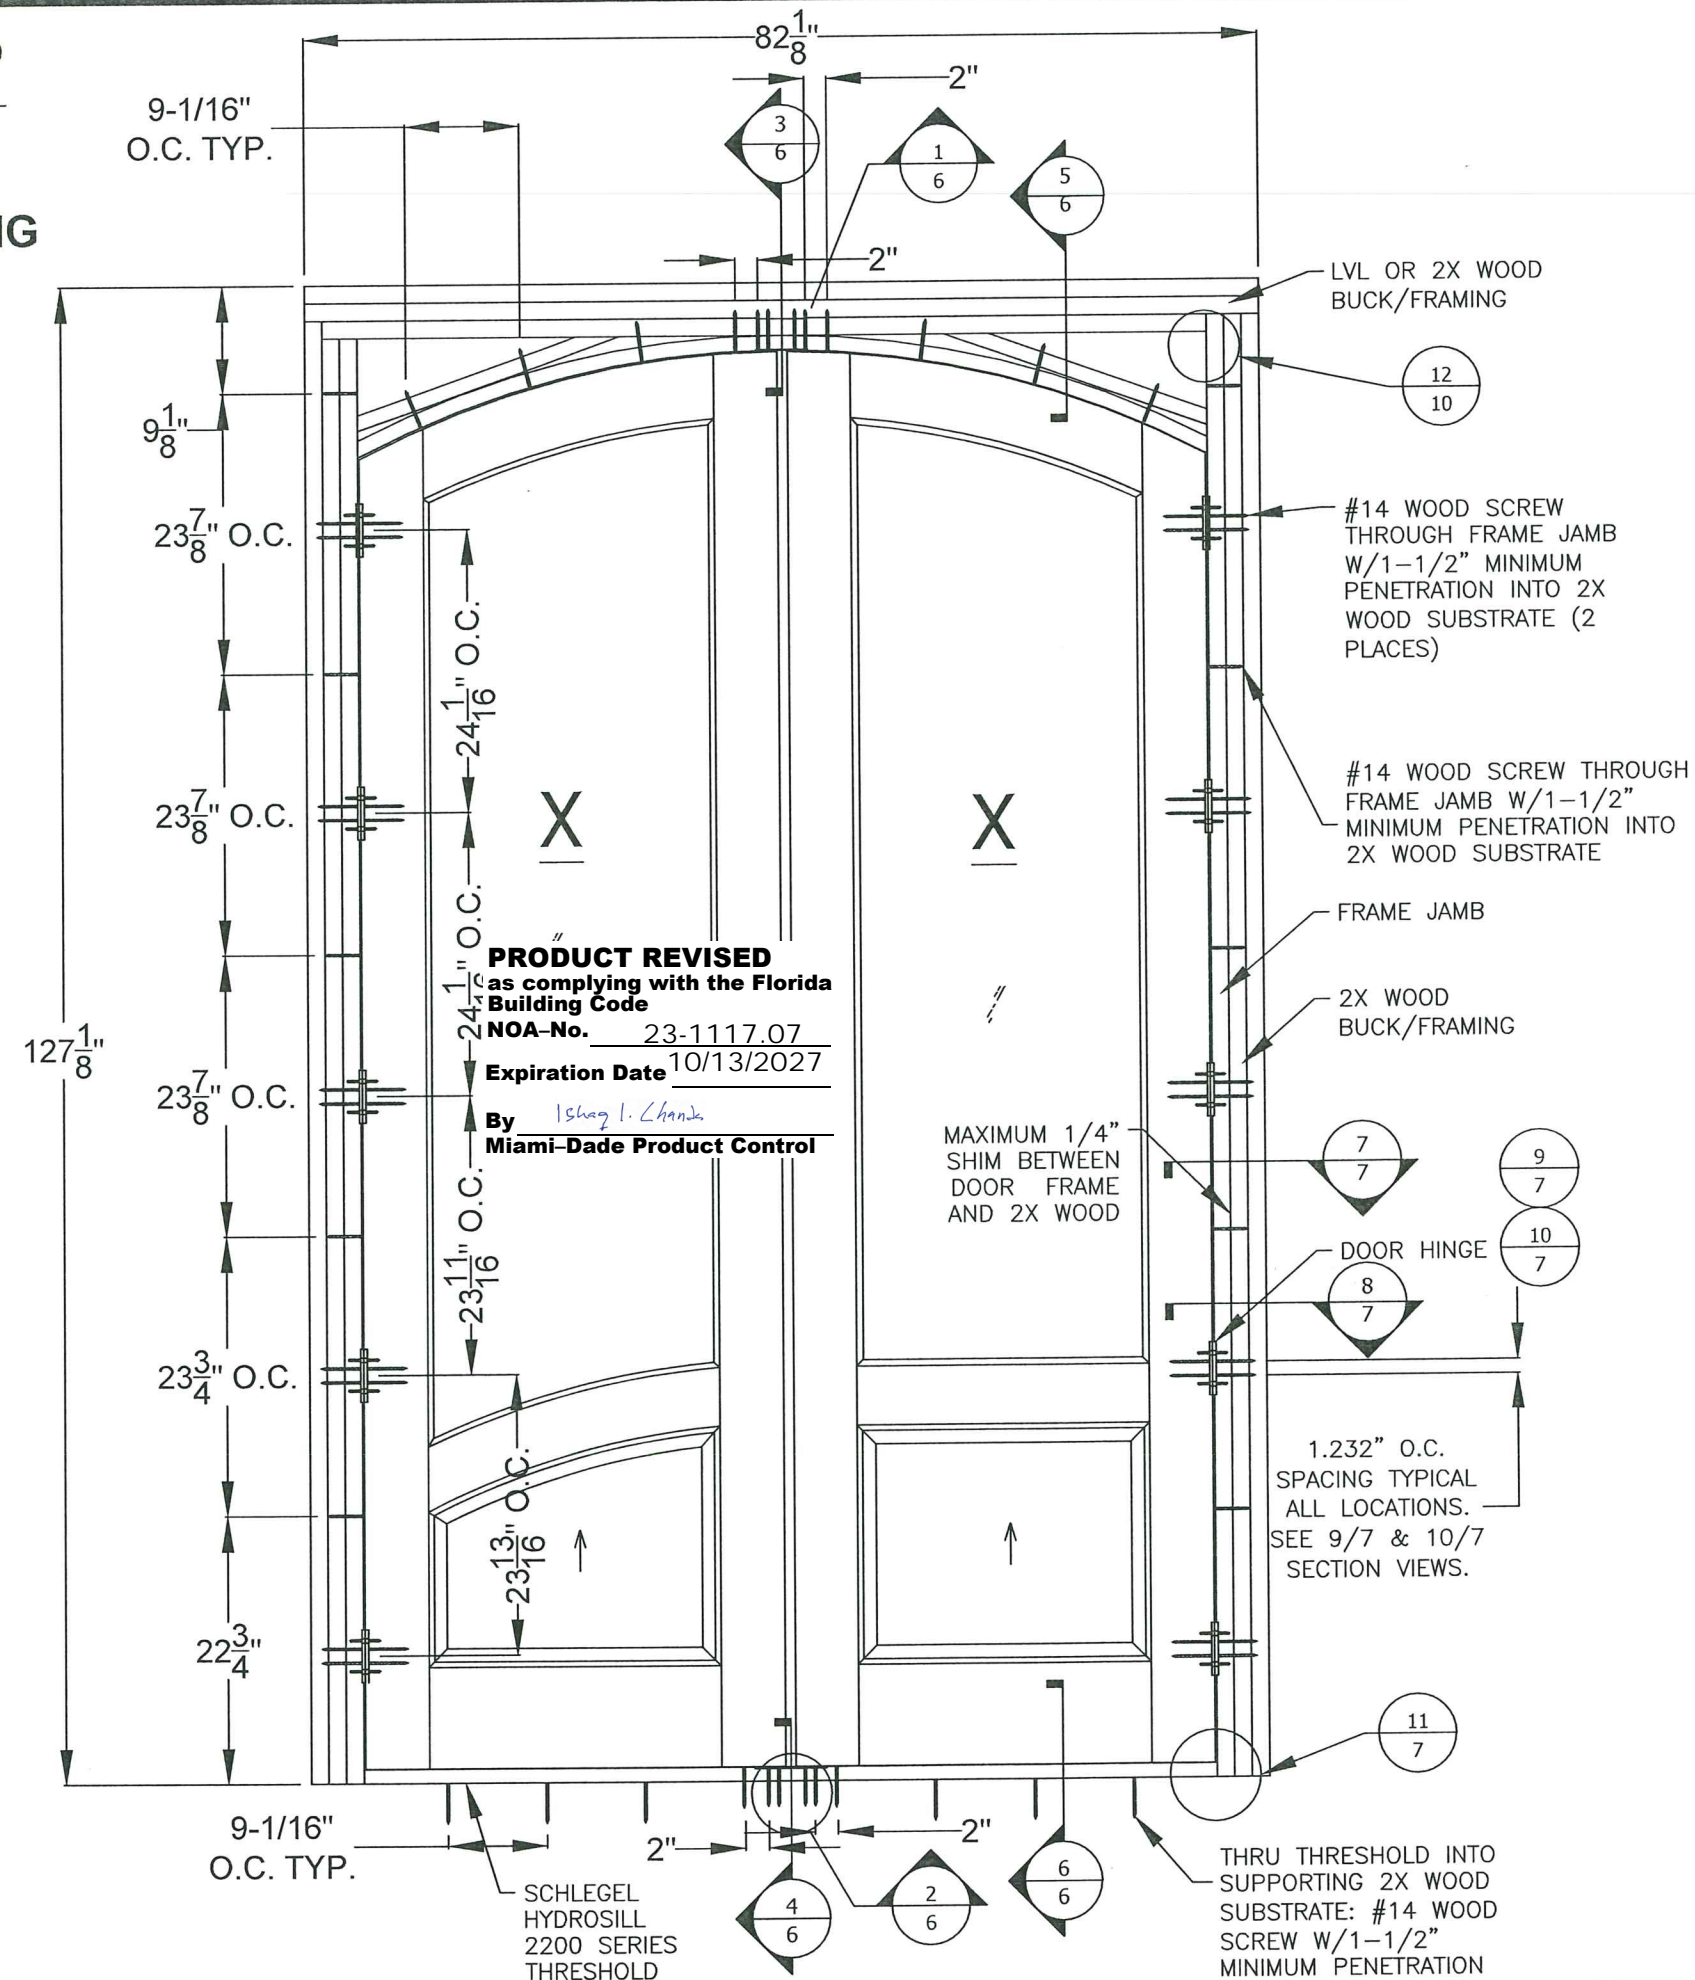

**The Door Store of America, Inc.**  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATION - ANCHOR LAYOUT - WOOD

PREPARED BY:	DATE:	8/3/2022
DRAWN BY:	RJA	DRAWING NO:
SCALE:	N.T.S.	DSA0008
REV:	A	SHEET:
3A OF 19		



Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1136.02  
Miami Dade Product Control  
By Kenny L. L...

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752





X RECTANGULAR  
ELEVATION  
2X WOOD BUCK/FRAMING  
INSTALLATION

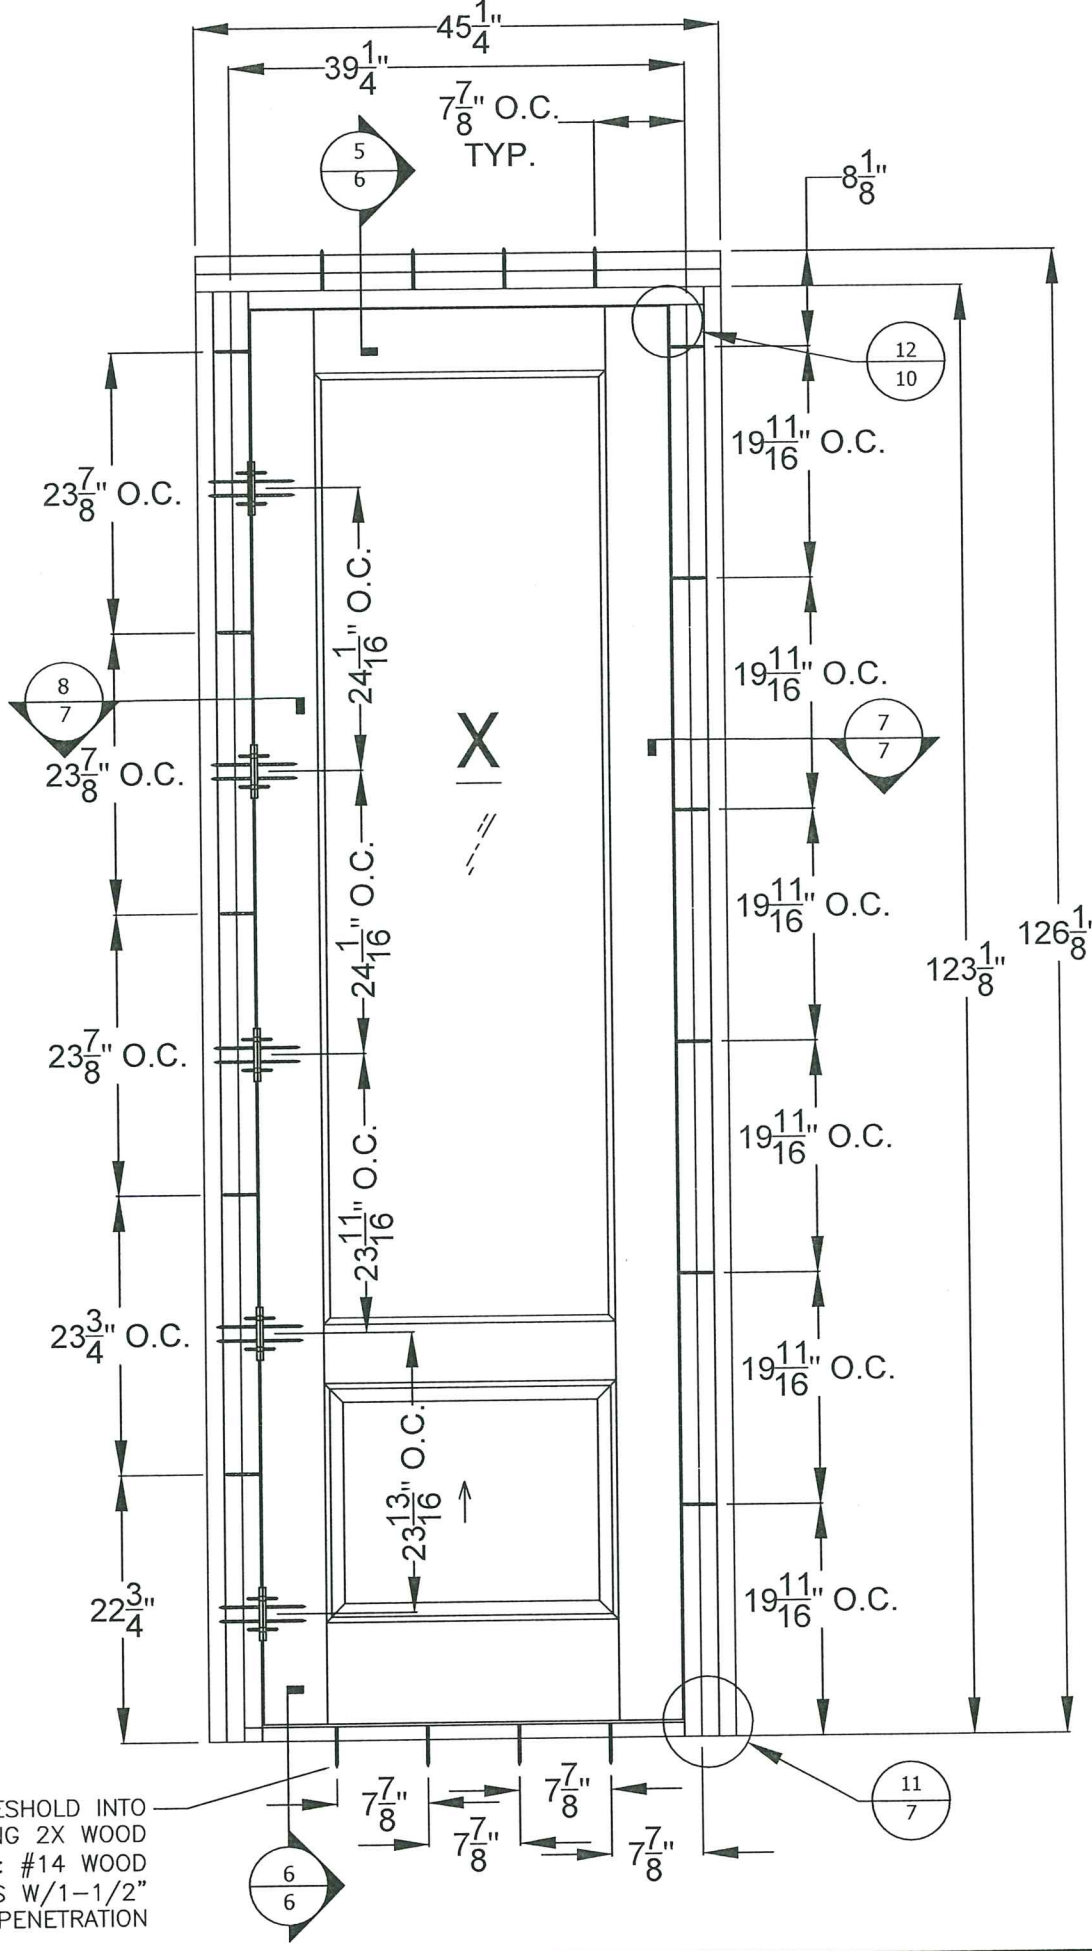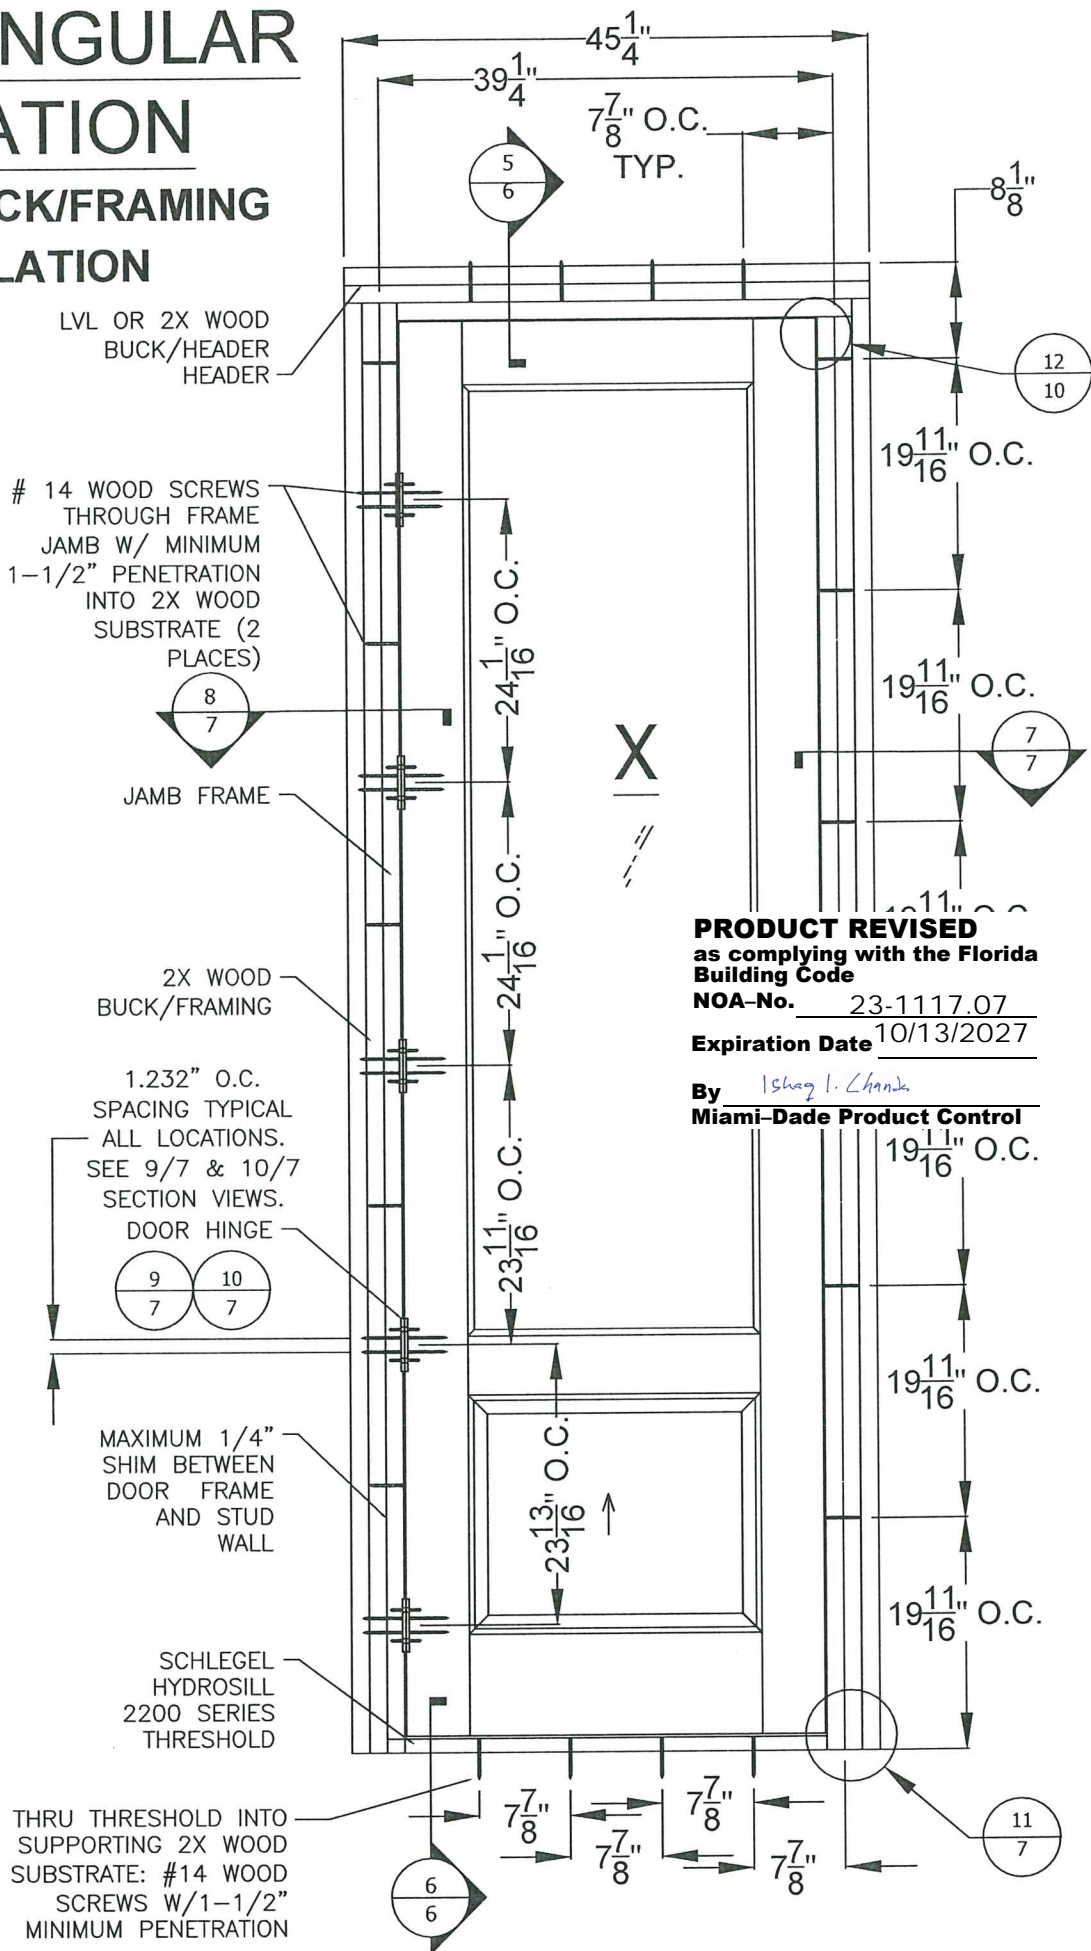

PROJECT #420-0601


The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617  
TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATION - ANCHOR LAYOUT - WOOD

PREPARED BY: RJA  
DRAWN BY: RJA  
SCALE: N.T.S.  
REV: A  
DATE: 8/3/2022  
DRAWING NO.: DSA0008  
SHEET: 3B OF 19

REV  
DESCRIPTION  
DATE  
BY  
RJA  
9/2/2022

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 23-1130-02  
Miami Dade Product Control  
By Ismael I. Chanla



Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

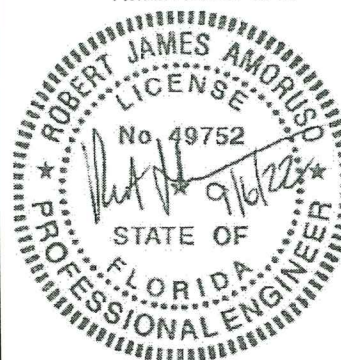



# X ARCH TOP ELEVATION

## 2X WOOD BUCK/FRAMING INSTALLATION

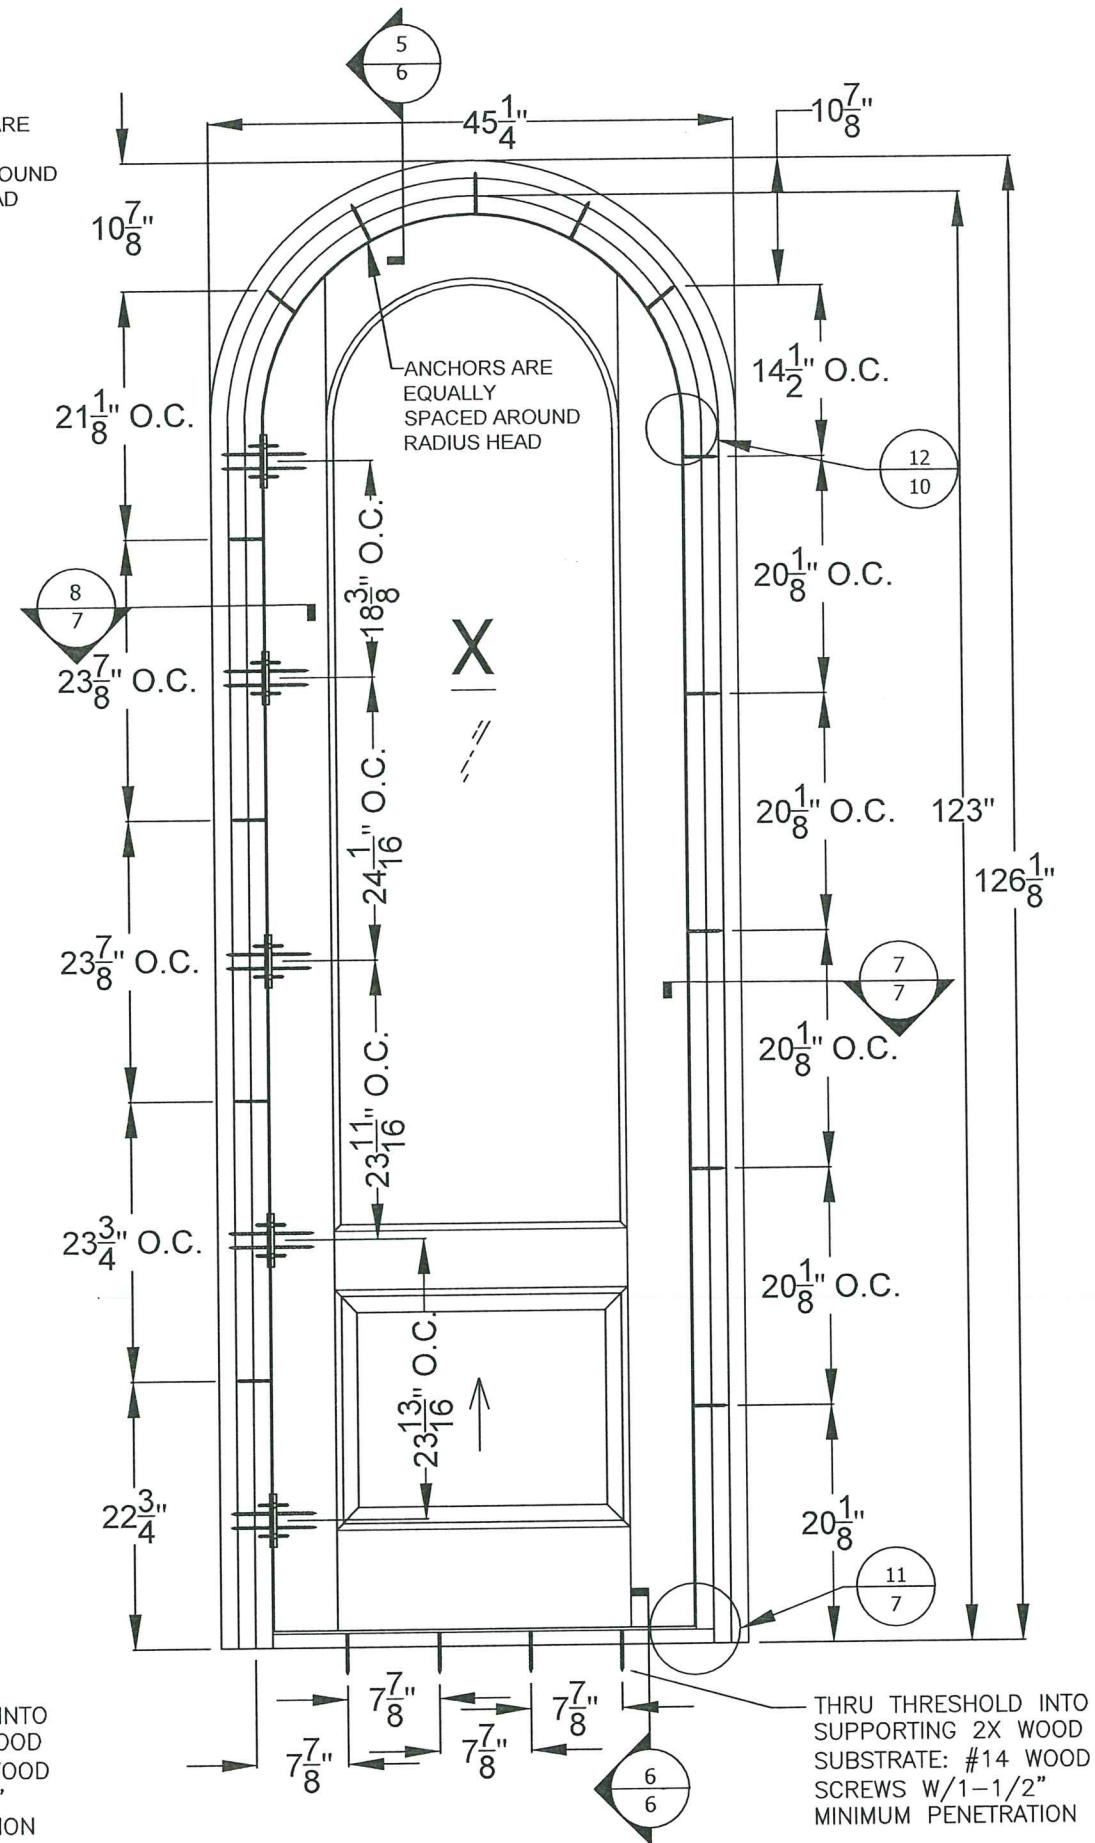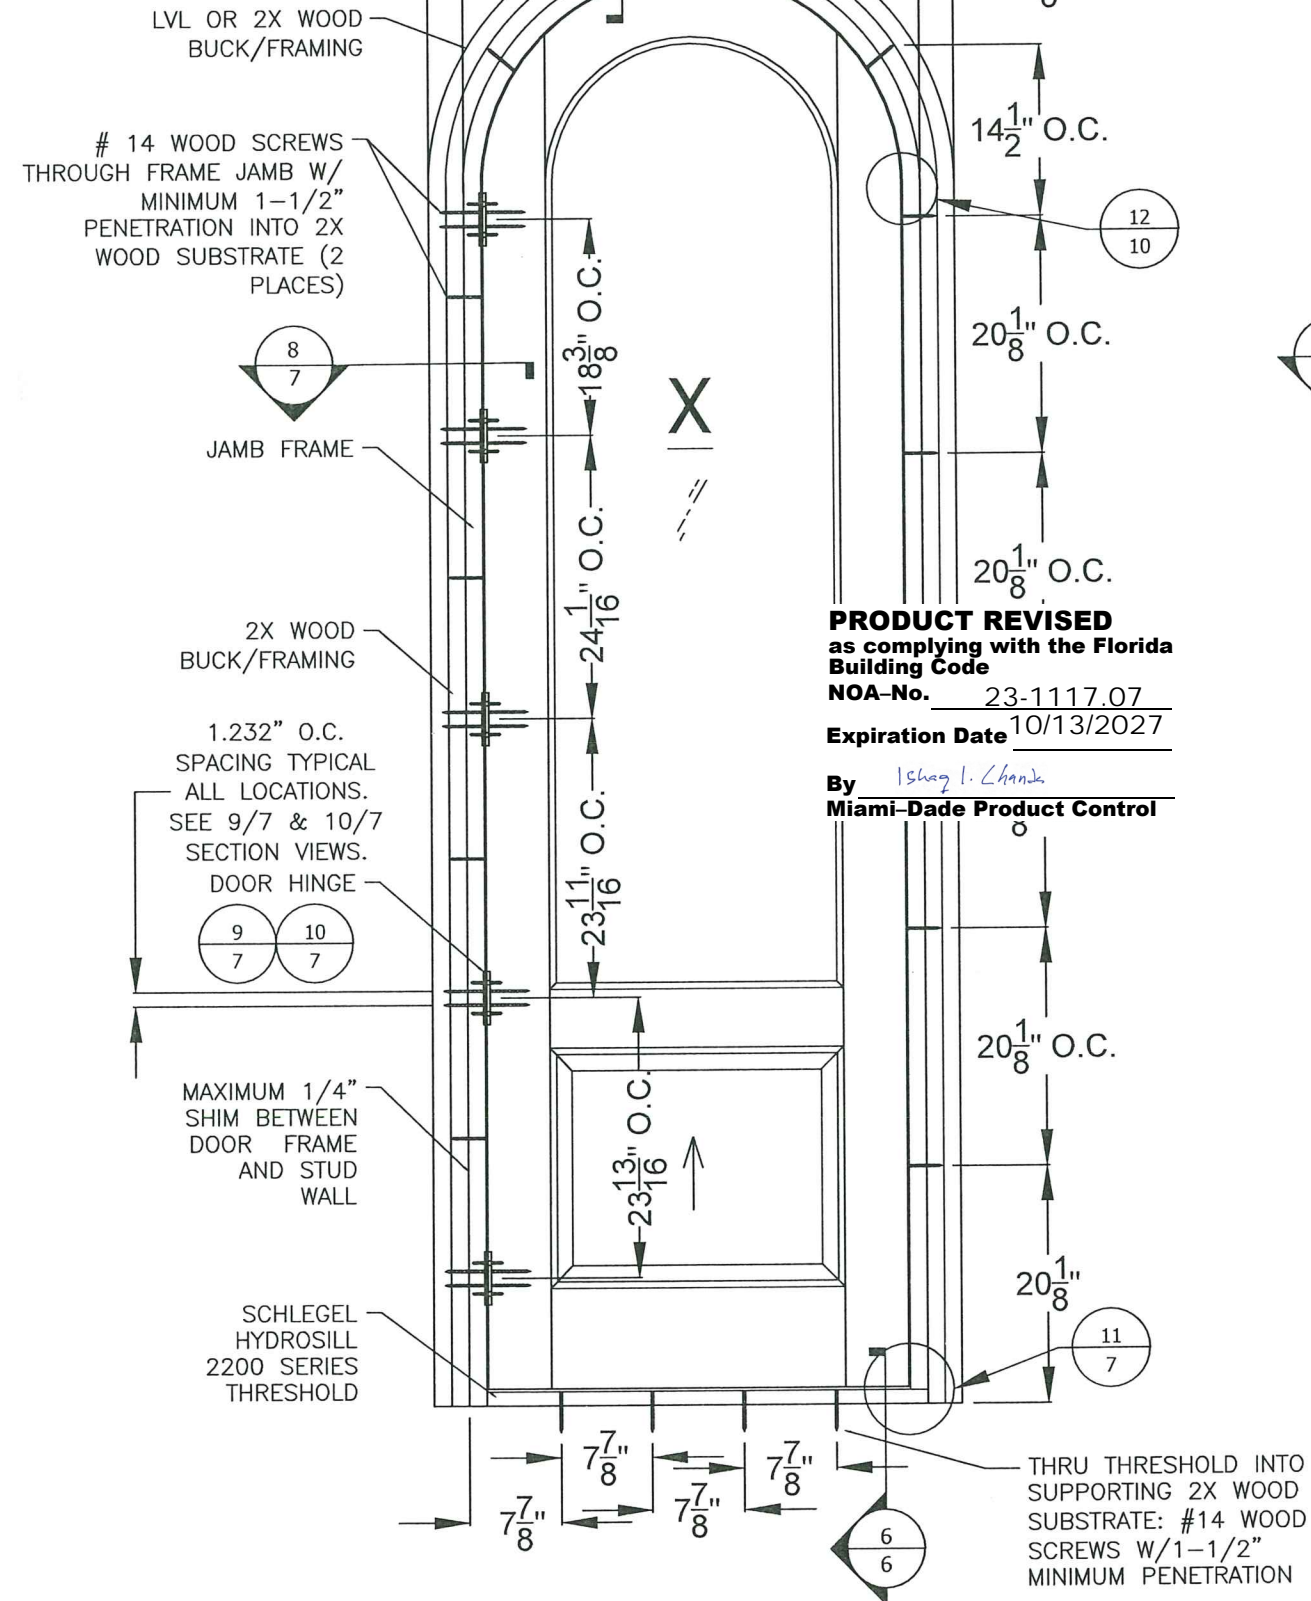

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617  
TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATION - ANCHOR LAYOUT - WOOD

DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 3C OF 19  
REV: A  
N.T.S.  
RJA  
8/3/2022

PREPARED BY: RJA  
SCALE: N.T.S.  
REV: A  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 3C OF 19

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Isheq I. Chanik

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752











# XX ARCH TOP ELEVATION CONCRETE/MASONRY INSTALLATION

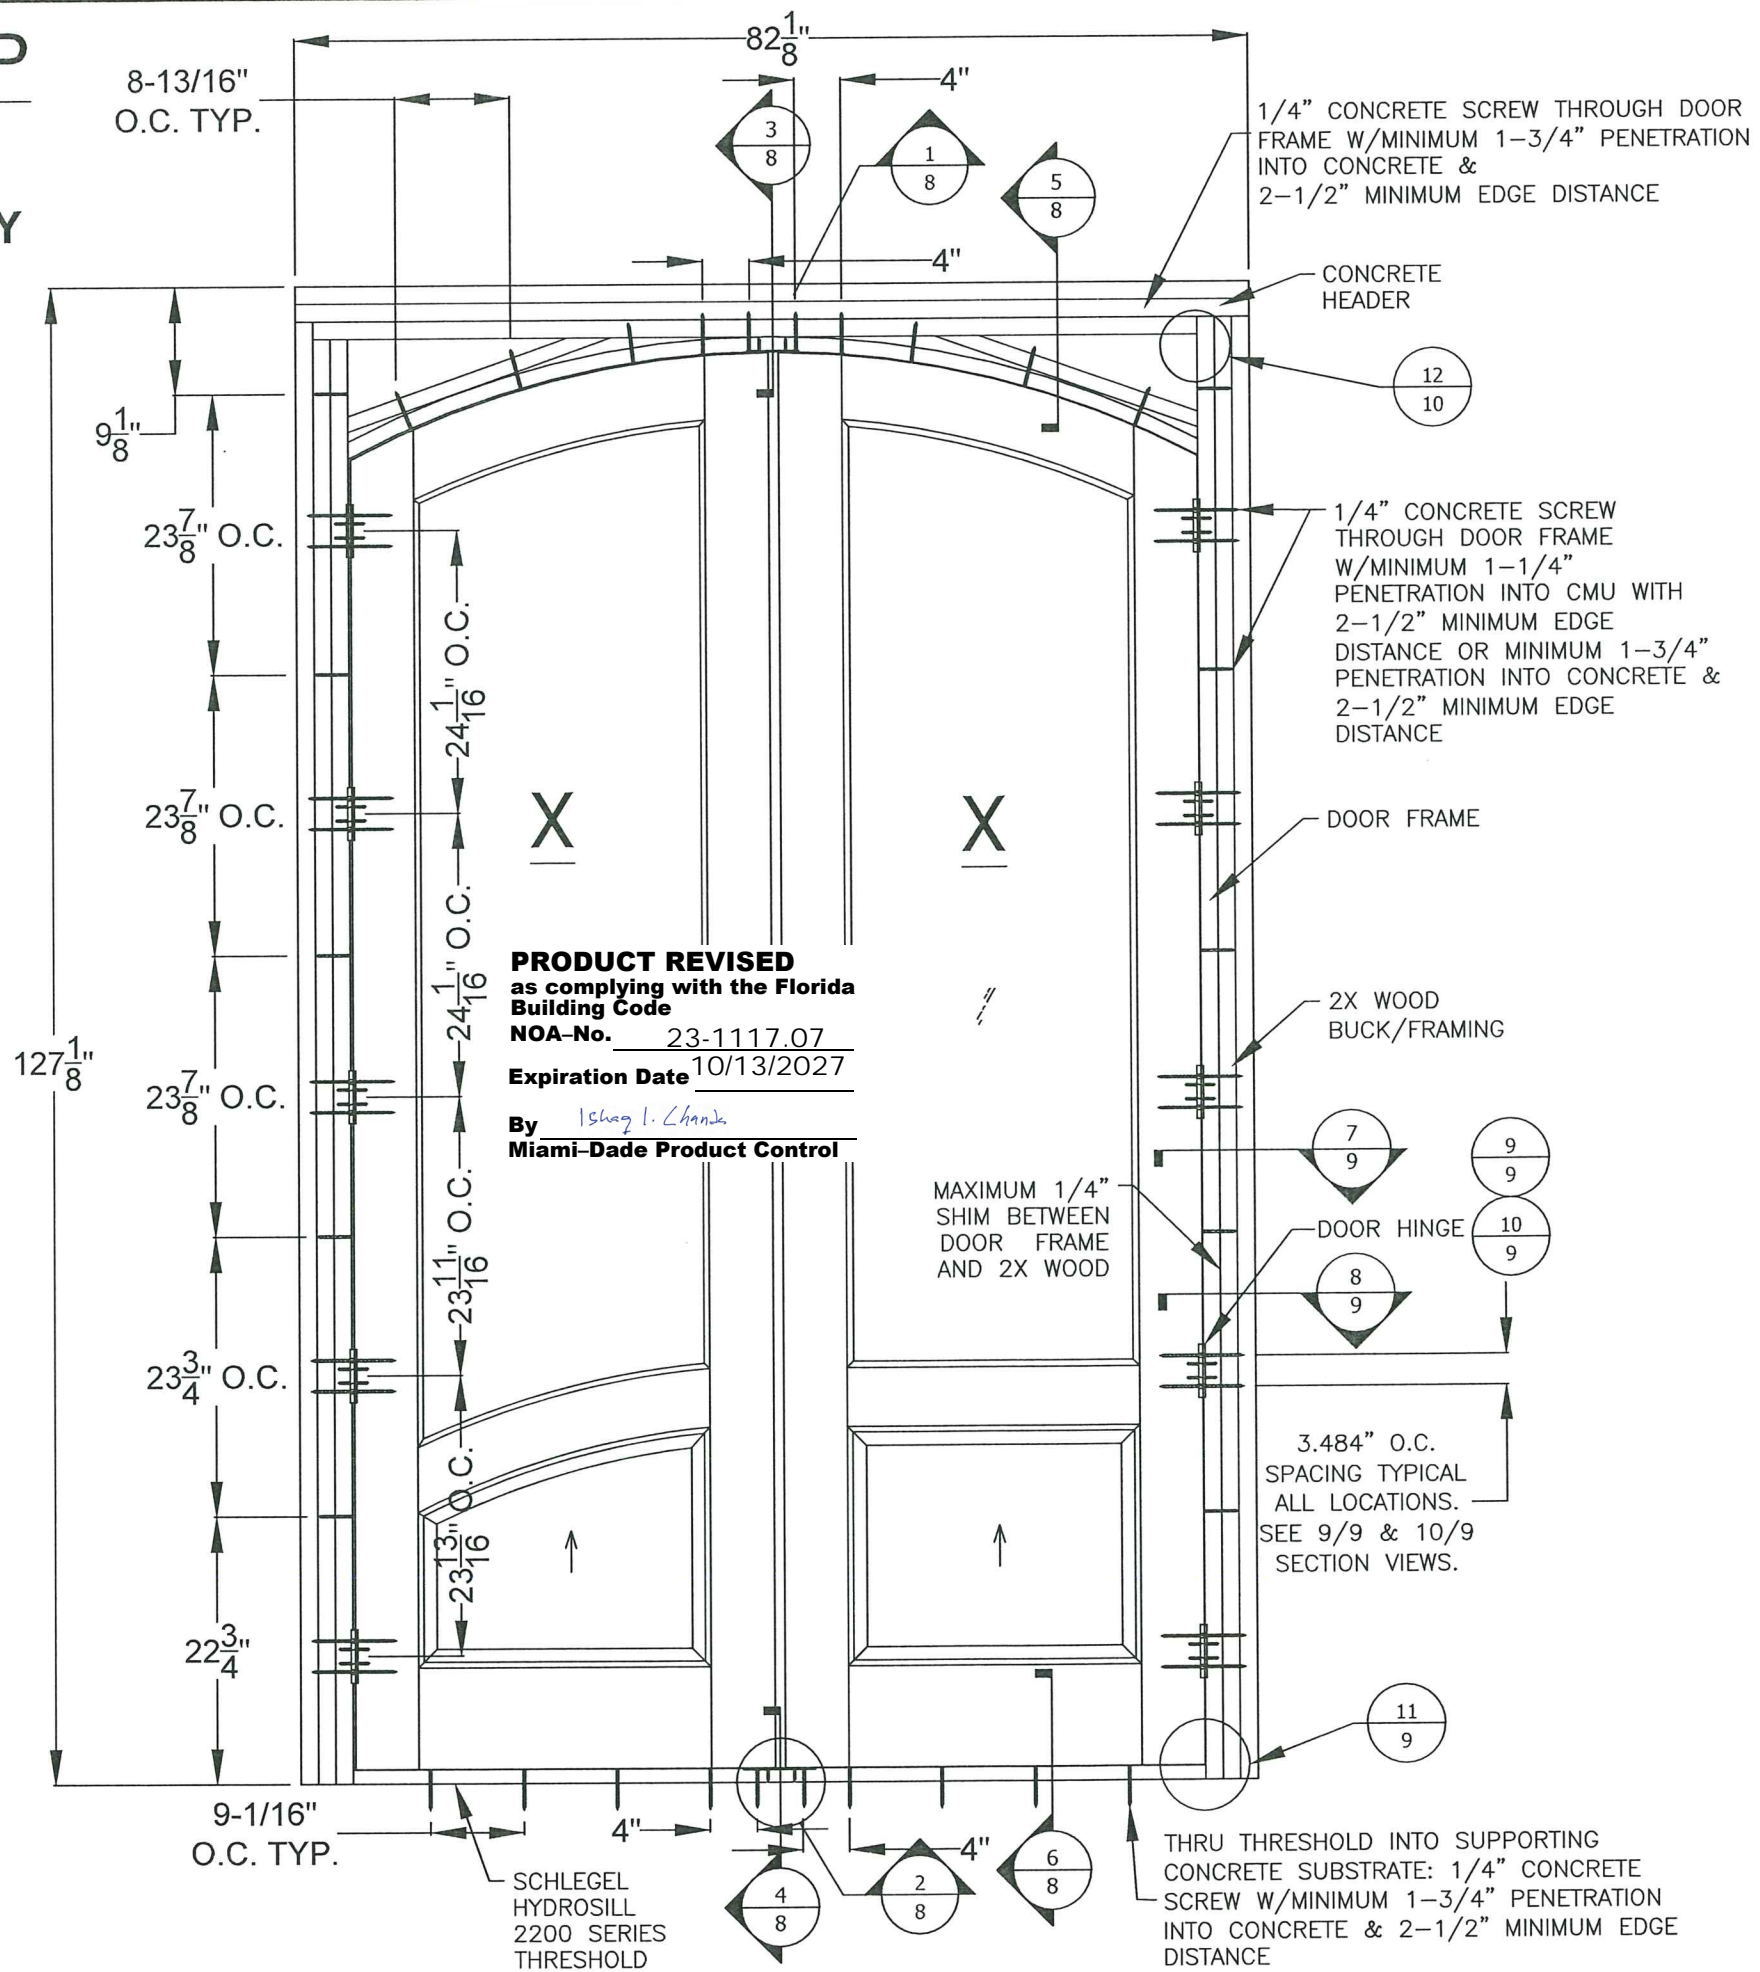


**The Door Store of America, Inc.**  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATION - ANCHOR LAYOUT - CONCRETE/MASONRY

PREPARED BY:	DATE:
 PPTC PRODUCT DESIGN GROUP, LLC PO BOX 520775 LONGWOOD, FLORIDA 32752 Phone: 321.690.1788 Email: info@pdc-corp.com	DRAWN BY: RJA DRAWING NO: DSA0008 SCALE: N.T.S. REV: A SHEET: 4A OF 19

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ismael L. Hernandez

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

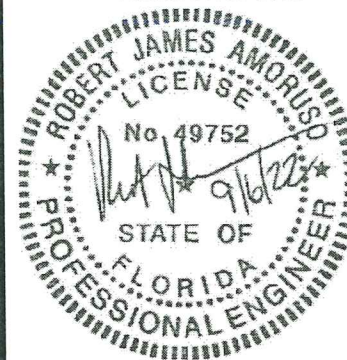







# X ARCH TOP ELEVATION CONCRETE/MASONRY INSTALLATION

1/4" CONCRETE SCREWS THROUGH  
DOOR FRAME JAMB W/ MINIMUM  
1-1/4" PENETRATION INTO CMU WITH  
2-1/2" MINIMUM EDGE DISTANCE OR  
MINIMUM 1-3/4" PENETRATION INTO  
CONCRETE & 2-1/2" MINIMUM EDGE  
DISTANCE

DOOR FRAME


2X WOOD  
BUCK/FRAMING

3.484" O.C.  
SPACING TYPICAL  
ALL LOCATIONS.  
SEE 9/9 & 10/9  
SECTION VIEWS.

DOOR HINGE

MAXIMUM 1/4"  
SHIM BETWEEN  
DOOR FRAME  
AND 2X WOOD

SCHLEGEL  
HYDROSILL  
2200 SERIES  
THRESHOLD

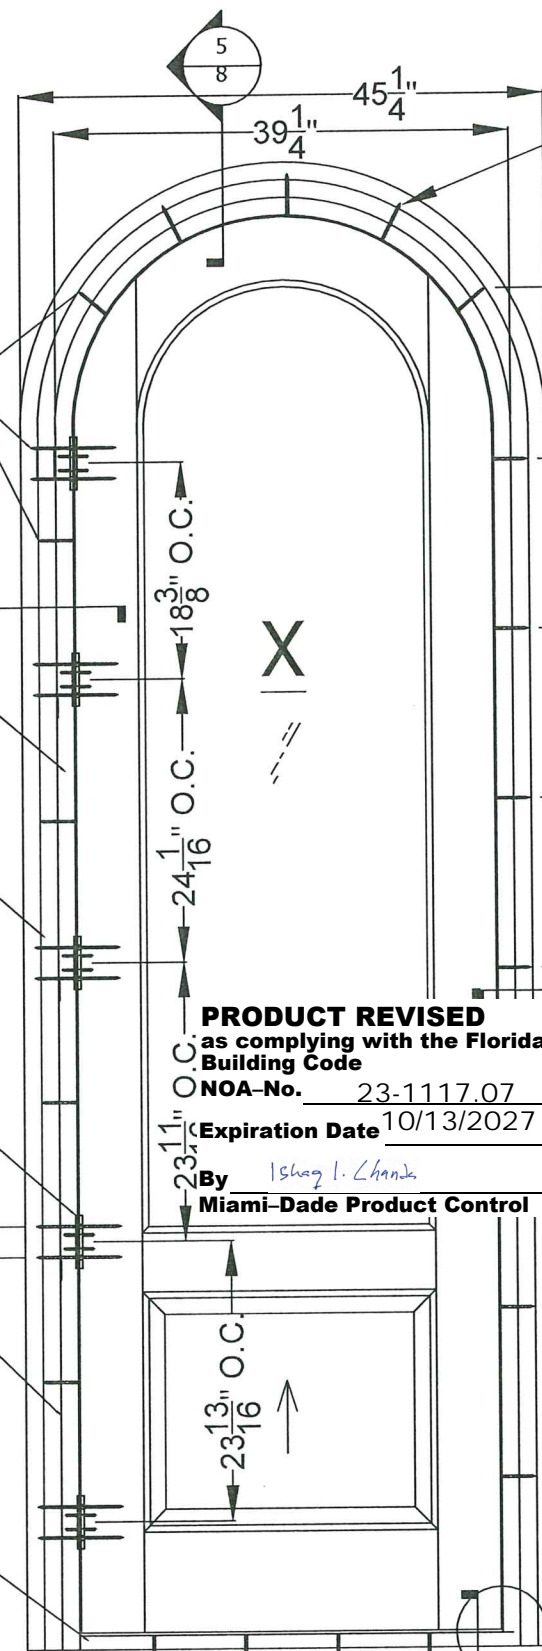

ANCHORS ARE  
EQUALLY  
SPACED AROUND  
RADIUS HEAD

**PRODUCT REVISED**  
as complying with the Florida  
Building Code


NOA-No. 23-1117.07

Expiration Date 10/13/2027

By Ishay I. Chandra

Miami-Dade Product Control

THRU THRESHOLD INTO  
SUPPORTING CONCRETE  
SUBSTRATE: 1/4"  
CONCRETE SCREWS  
W/1-1/2" MINIMUM  
PENETRATION INTO  
CONCRETE & 2-1/2"  
MINIMUM EDGE DISTANCE

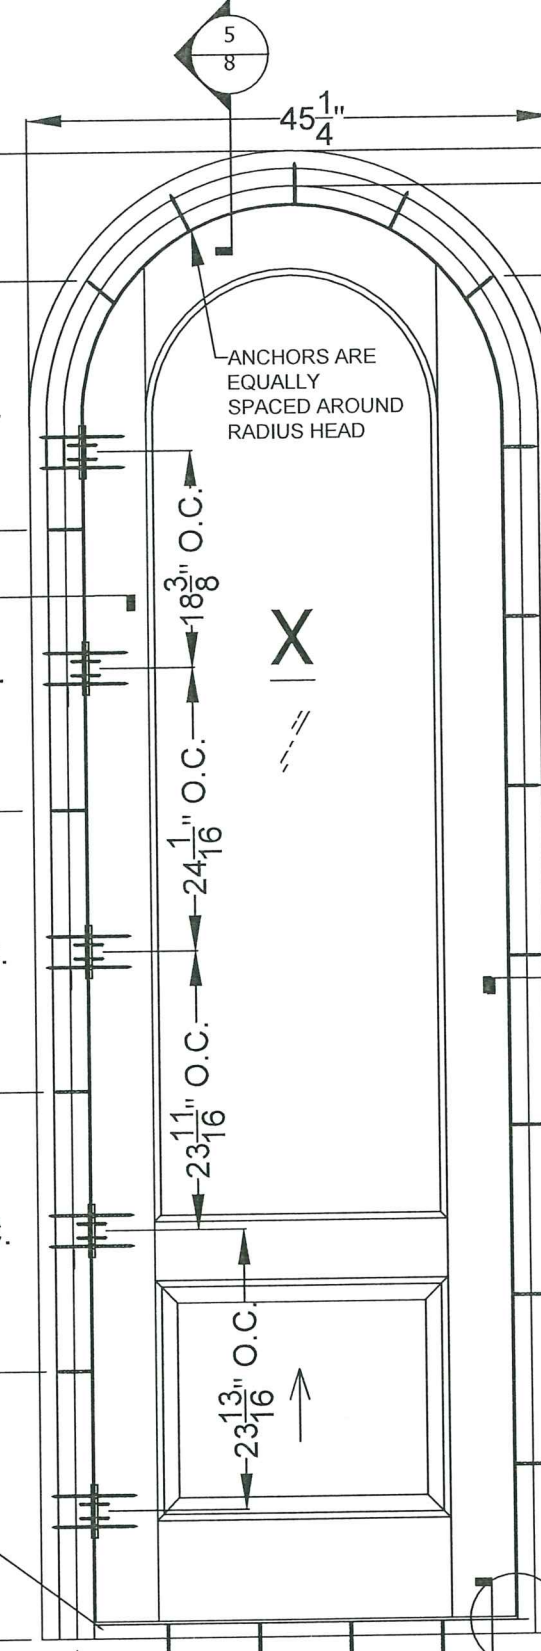

ANCHORS ARE  
EQUALLY  
SPACED AROUND  
RADIUS HEAD

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130.02  
Miami Dade Product Control

By Ishay I. Chandra

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752



PROJECT #420-0601

DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 4C OF 19


THE DOOR STORE OF AMERICA, INC.  
10681 World Trade Blvd  
Raleigh, NC 27617  
TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATION - ANCHOR LAYOUT - CONCRETE/MASONRY  
PREPARED BY: RJA  
SCALE: N.T.S.  
REV: A  
PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520775  
LONGWOOD, FLORIDA 32752  
Phone: 321.650.1768  
Fax: 321.650.1769  
Email: info@ptc-corp.com



ELEVATION  
XX HINGE LOCATION

RECTANGULAR  
FRAME

ELEVATION  
XX BRICK MOULD  
INSTALLATION

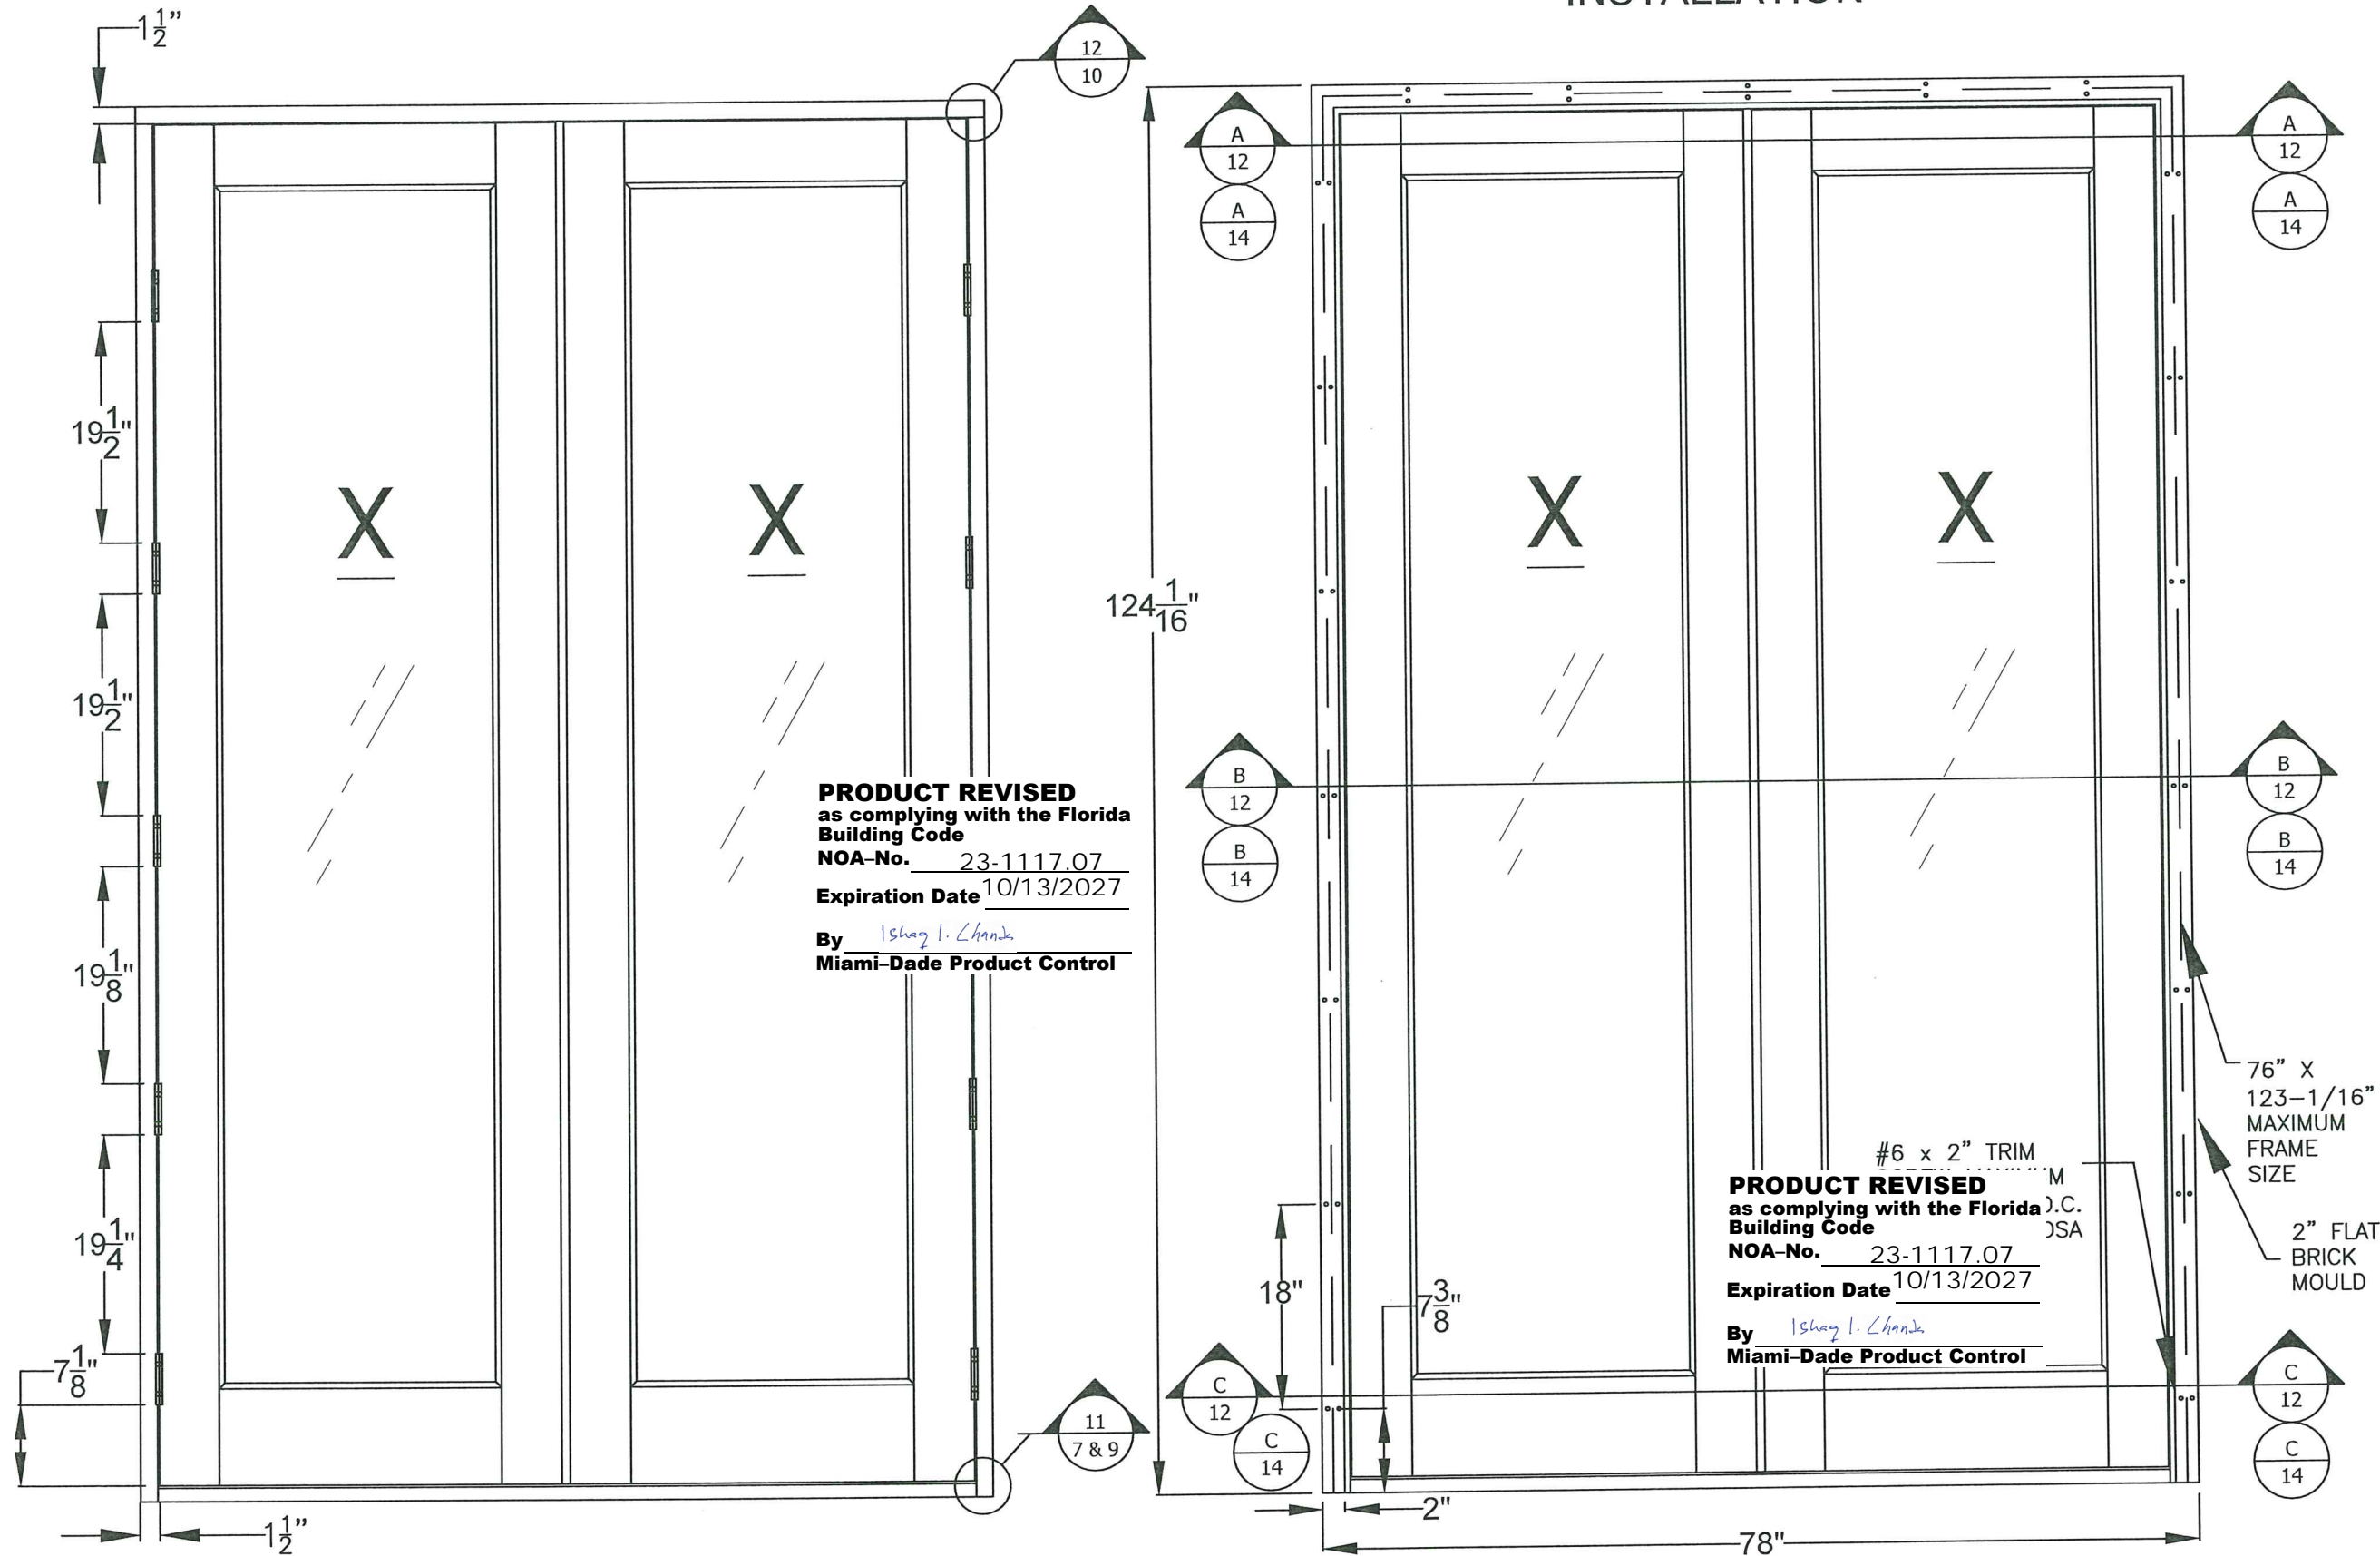

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATIONS - HINGES & BRICK MOULD

DATE	REV	DESCRIPTION	BY
9/2/2022	A	REVISED FOR MD COMMENTS	RJA
8/3/2022	A	DATE	BY
8/3/2022	DSA0008	DATE	BY
8/3/2022	5 OF 19	DATE	BY

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishag I. Chande

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752






**ELEVATION**  
XX HINGE LOCATION

**ARCH TOP  
FRAME**

**ELEVATION**  
XX BRICK MOULD  
INSTALLATION

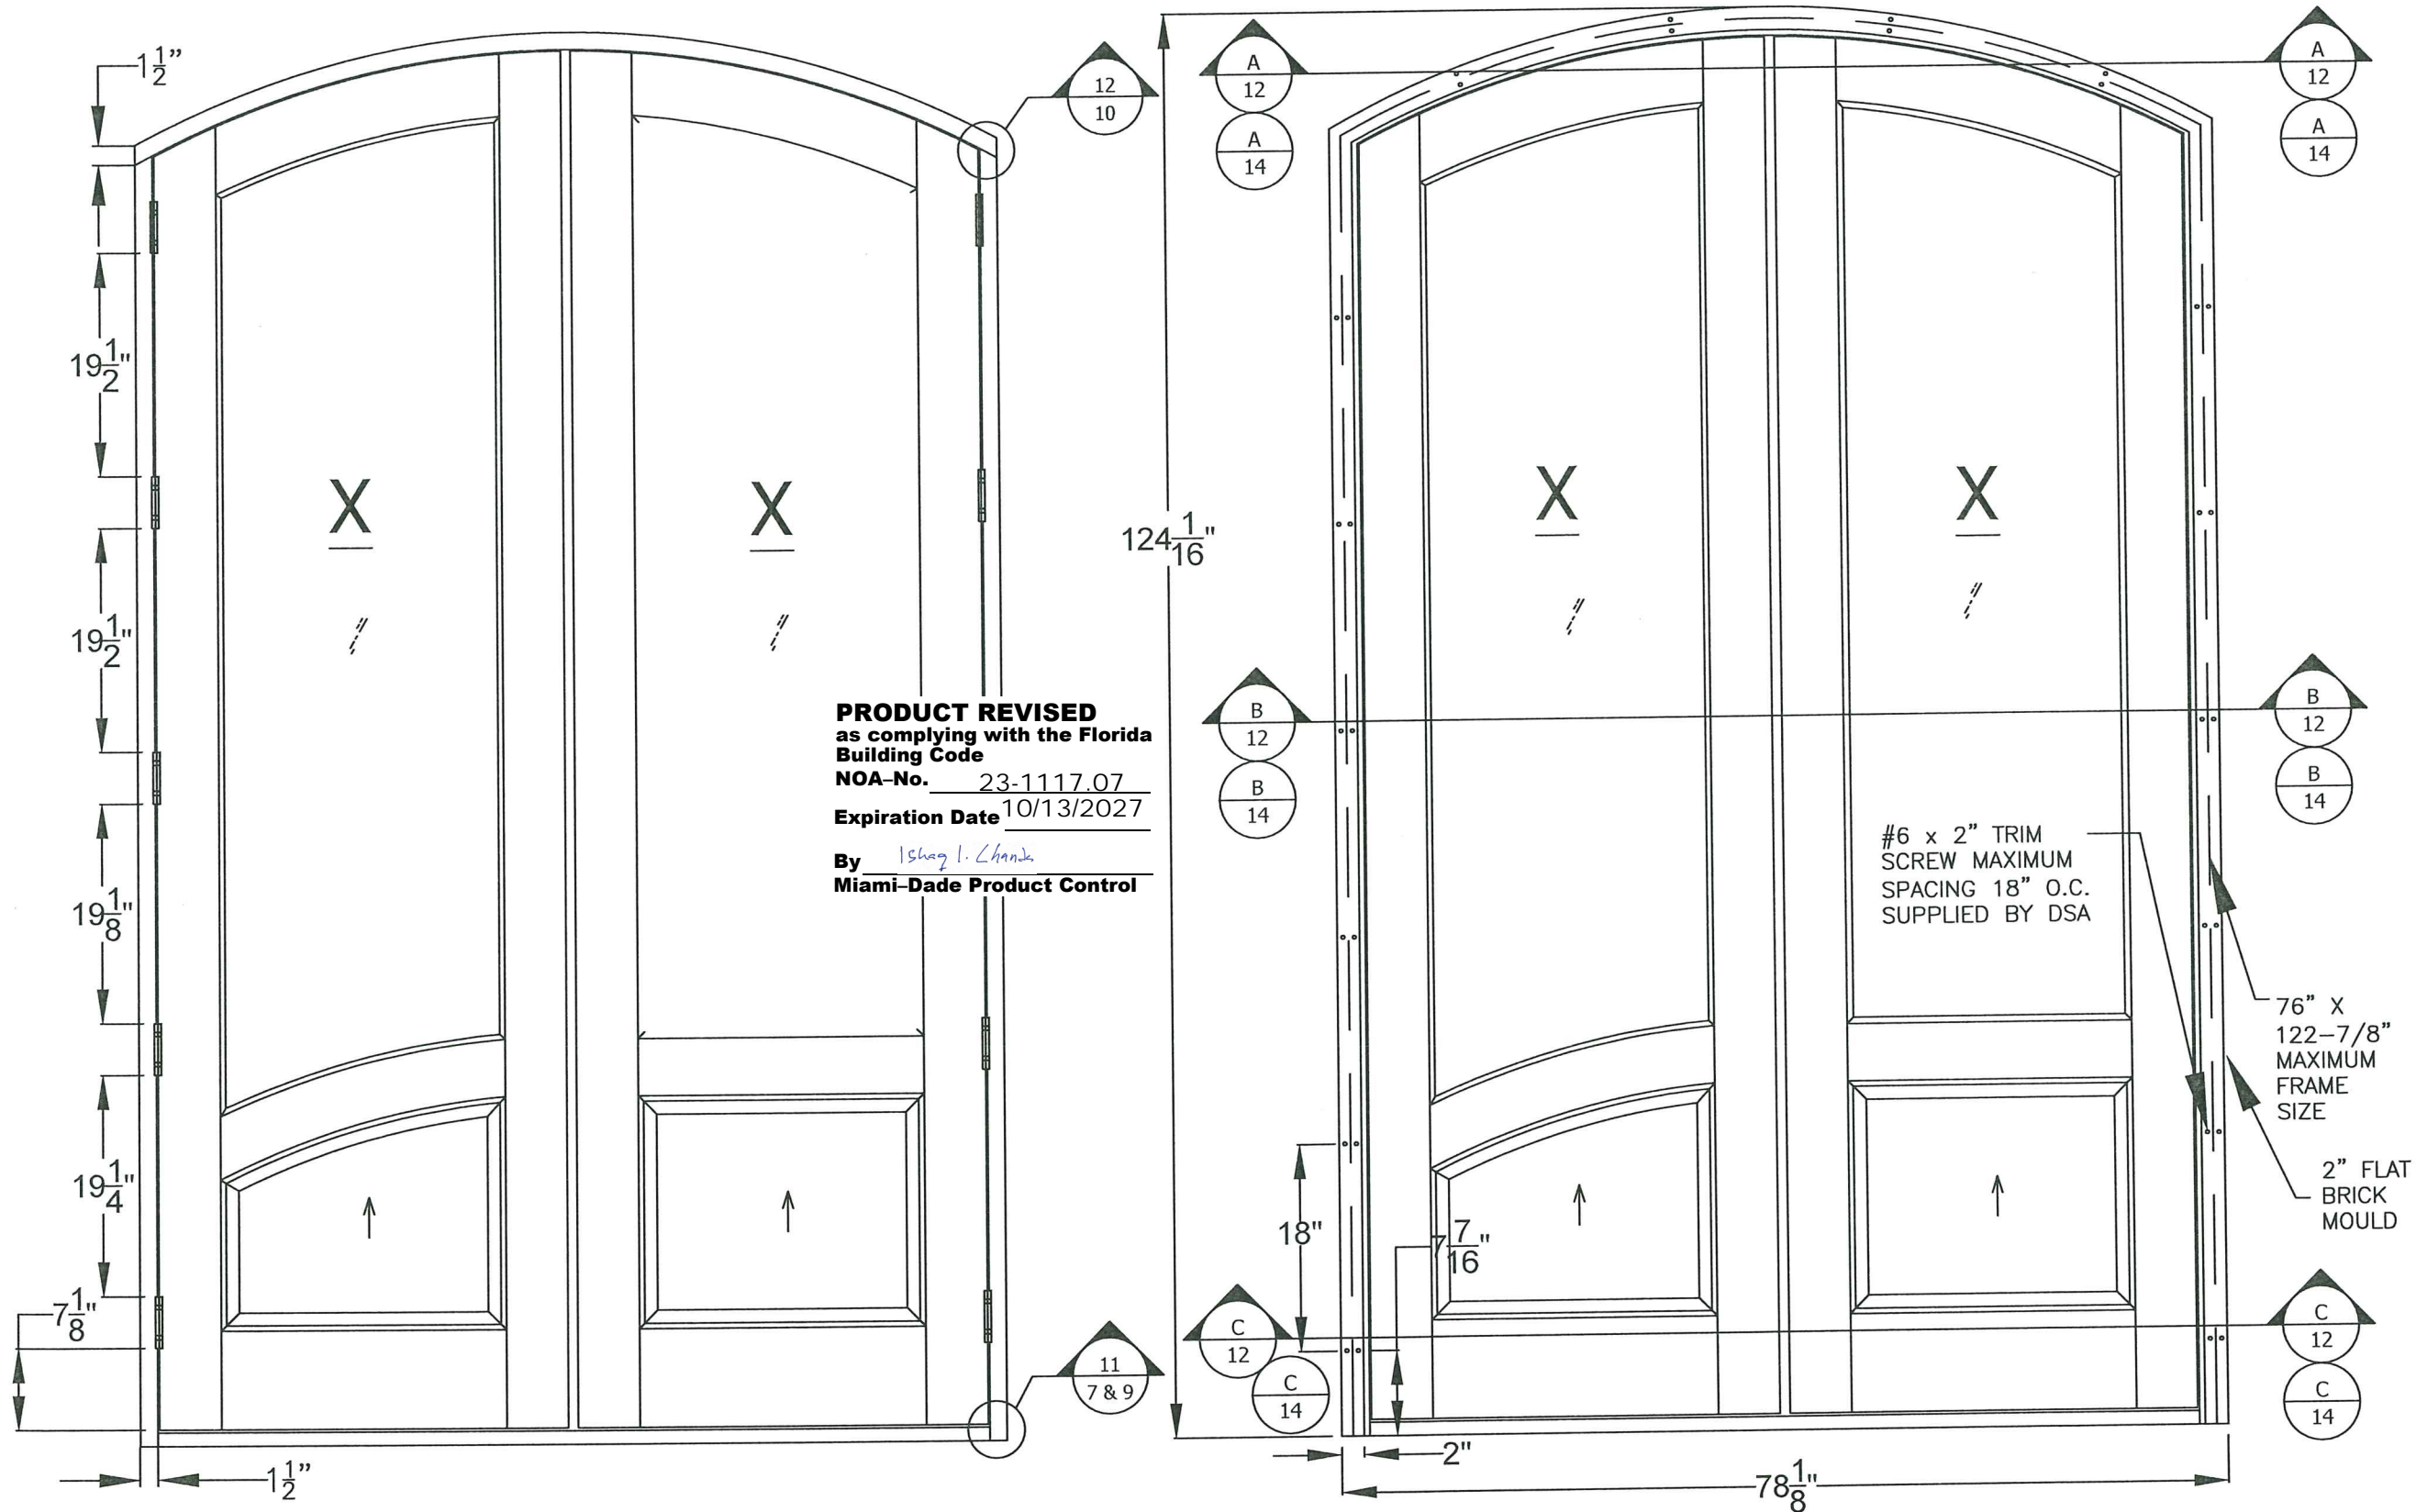

PROJECT #420-0601


The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATIONS - HINGES & BRICK MOULD

DATE	8/3/2022	REVISED FOR MD COMMENTS	9/2/2022	DATE	9/2/2022
DRAWING NO.	DSA0008	DESCRIPTION		BY	
SCALE	N.T.S.				
REV	A				
SHEET	5A OF 19				

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishay I. Chandra

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752

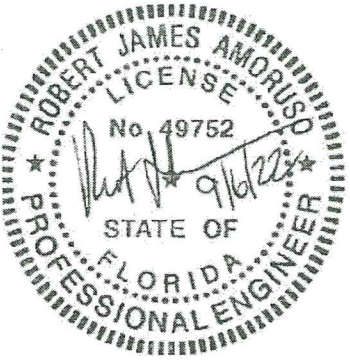



Architectural drawing of a door with dimensions and callouts:

- Top callout:  $\frac{12}{10}$
- Left side dimensions (from top to bottom):
  - $1\frac{1}{2}"$
  - $19\frac{1}{2}"$
  - $19\frac{1}{2}"$
  - $19\frac{1}{8}"$
  - $19\frac{1}{4}"$
  - $7\frac{1}{8}"$
- Bottom callout:  $\frac{2}{15}$
- Door panel features:
  - Large upper panel with an "X" and a dashed line.
  - Lower panel with an upward arrow.

**PRODUCT REVISED** 1/8  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishag I. Chande  
**Miami-Dade Product Control**

Technical drawing of a door assembly showing dimensions and components. The drawing includes a central door panel with a large 'X' and a smaller panel at the bottom with an upward arrow. The door is framed by a brick mould. Dimensions are provided for the door height (71 1/8"), door width (41 1/4"), and frame width (2"). The door is divided into four sections labeled A, B, C, and D, each with a 12A and 14A label. The frame is labeled '39-1/4" X 123" MAXIMUM FRAME SIZE' and '2" FLAT BRICK MOULD'. The door is shown with a 2" gap from the wall. The bottom section is labeled '18"'. The top section is labeled '7 3/8"'. The door is shown with a 2" gap from the wall. The door is shown with a 2" gap from the wall. The door is shown with a 2" gap from the wall.

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 22-1130-02  
Miami Dade Product Control  
By Ismael I. Chaves


Robert J. Amoruso, P.E.  
Florida P.E. No. 49752



PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed ELEVATIONS - HINGES & BRICK MOULD	
PREPARED BY:	DRAWN BY:
DATE:	DATE:

<b>PREPARED BY:</b>  <b>PTC PRODUCT DESIGN GROUP, LLC</b> P.O. BOX 520775 LONGWOOD, FLORIDA 32752 FBPE C.A. NO. 25935	<b>DRAWN BY:</b> RJA	<b>DATE:</b> 8/3/2022
	<b>SCALE:</b> N.T.S.	<b>DRAWING NO:</b> DSA008
	<b>REV:</b> A	<b>SHEET:</b> 5B OF 19
	<b>Phone:</b> 321.690.1788 <b>Fax:</b> 321.690.1789 <b>Email:</b> info@ptc-corp.com	


A	REVISED FOR MID COMMENTS	9/2/2022	RJA
REV	DESCRIPTION	DATE	BY




# ELEVATION X HINGE LOCATION

# RECTANGULAR FRAME

# ELEVATION X BRICK MOULD INSTALLATION

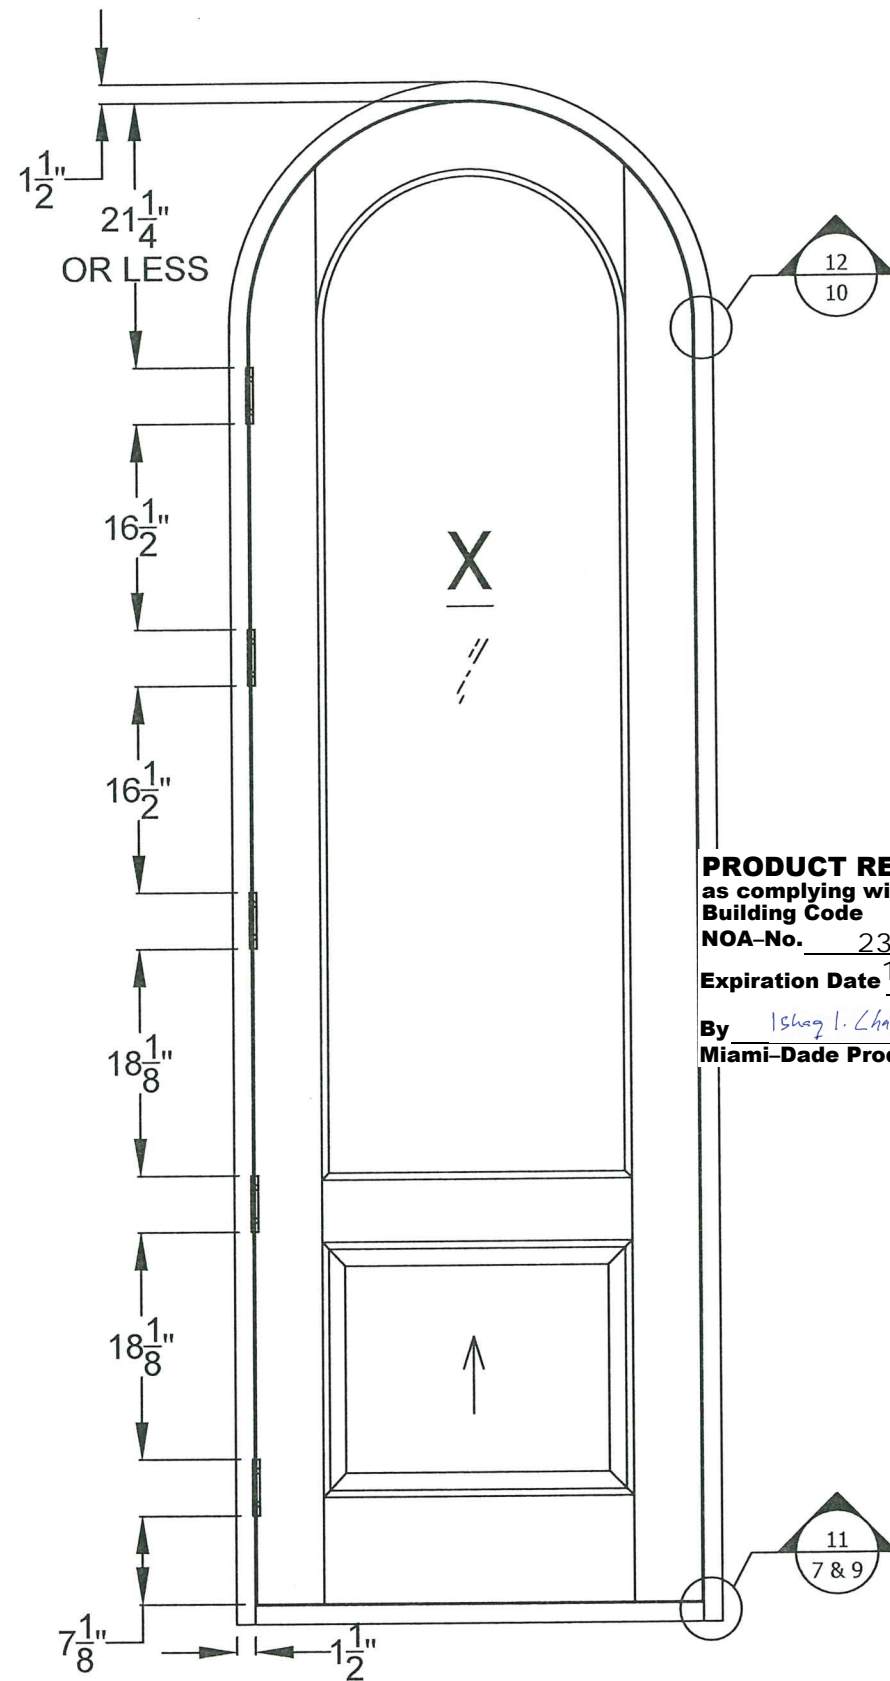

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishay I. Chandra  
Miami-Dade Product Control

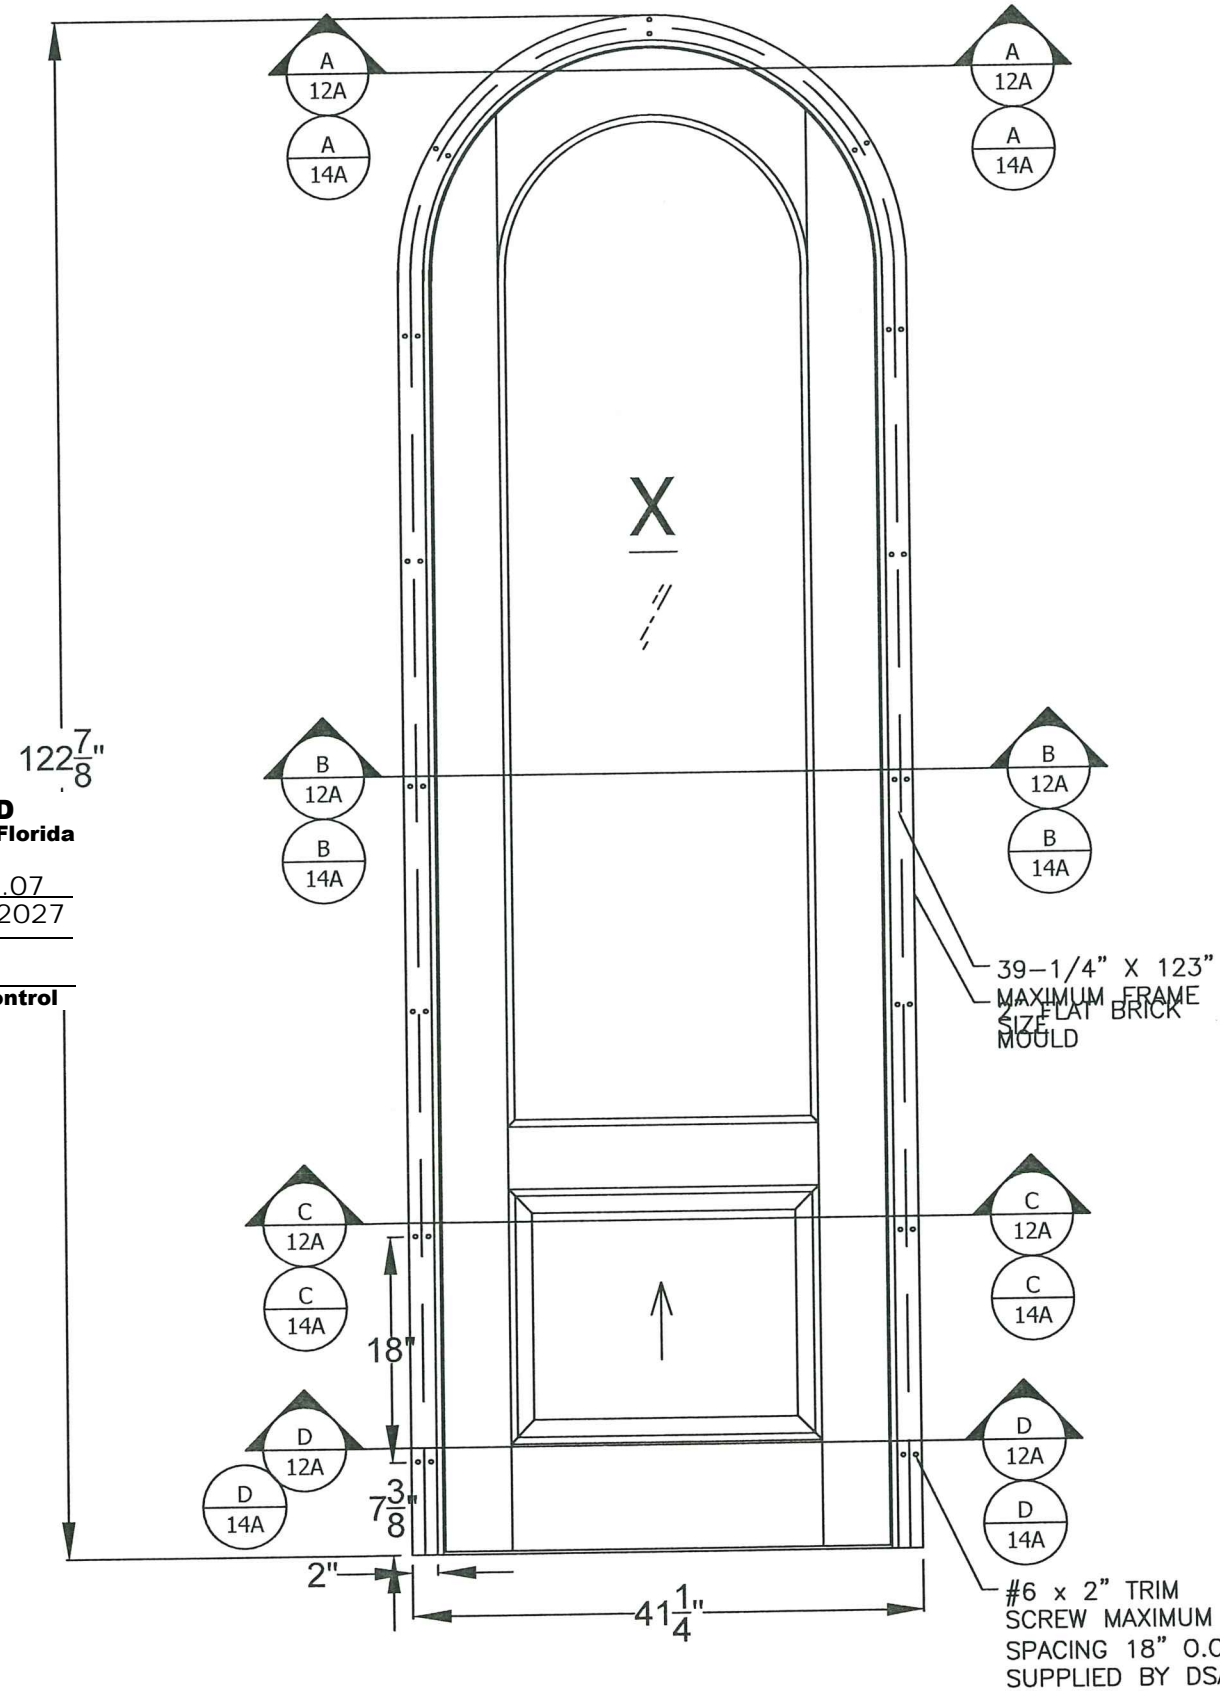

#6 x 2" TRIM  
SCREW MAXIMUM  
SPACING 18" O.C.  
SUPPLIED BY DSA

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
ELEVATIONS - HINGES & BRICK MOULD

PREPARED BY: PTC  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SCALE: N.T.S.  
REV: A  
SHEET: 5C OF 19

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 23-113002  
Miami Dade Product Control  
By Ishay I. Chandra


Robert J. Amoroso, P.E.  
Florida P.E. No. 49752






# DETAILS


## 2X WOOD BUCK/FRAMING INSTALLATION

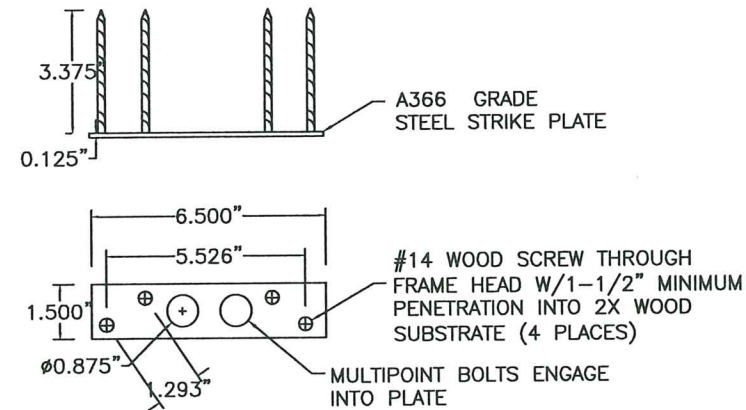


1 TOP STRIKE PLATE

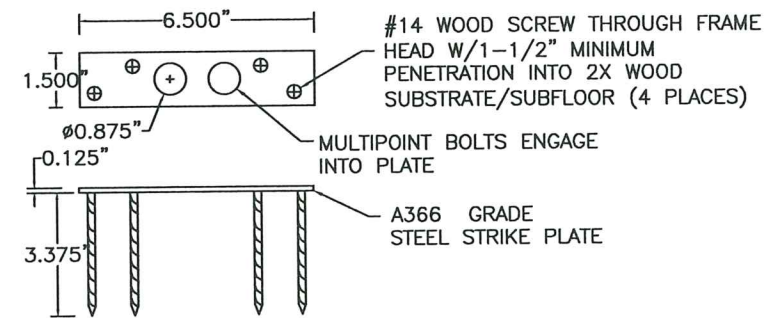


2 BOTTOM STRIKE PLATE

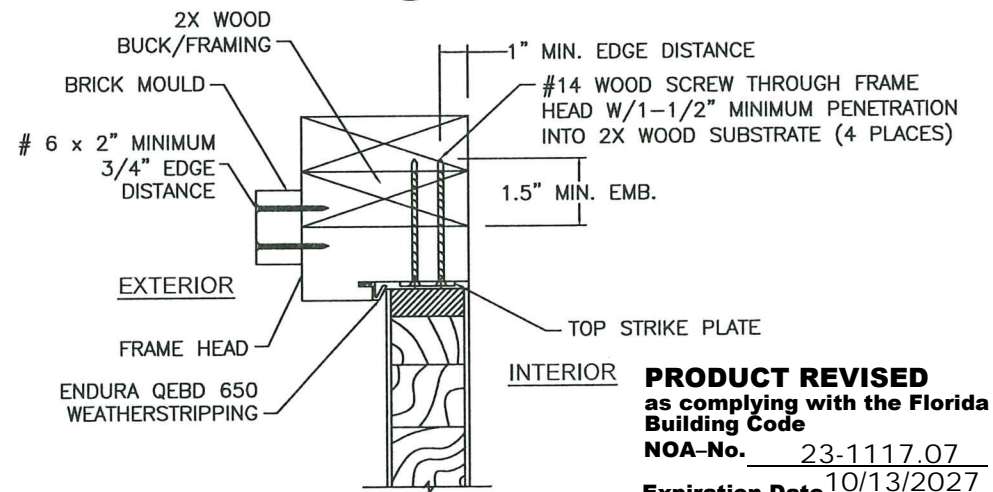


3 HEAD ANCHORAGE AT STRIKE PLATE

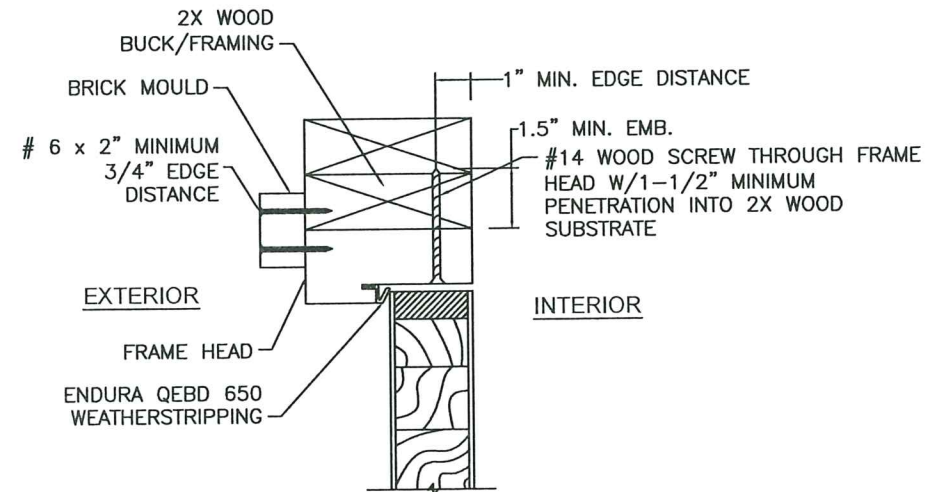

5 HEAD ANCHORAGE AT FRAME HEAD

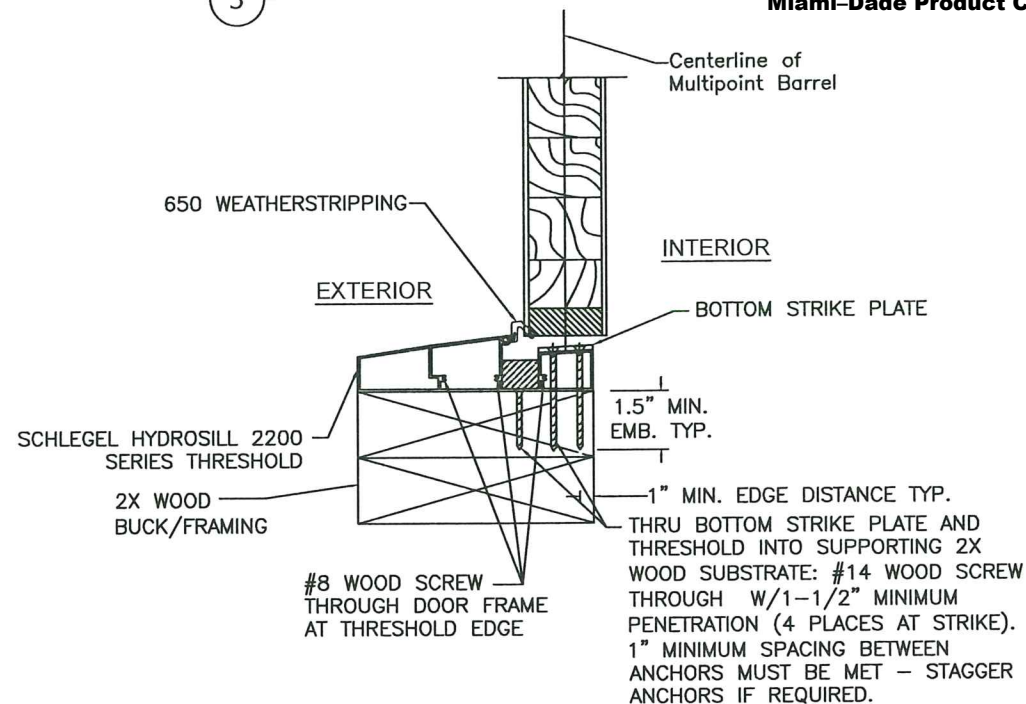

4 THRESHOLD SECTION AT STRIKE PLATE

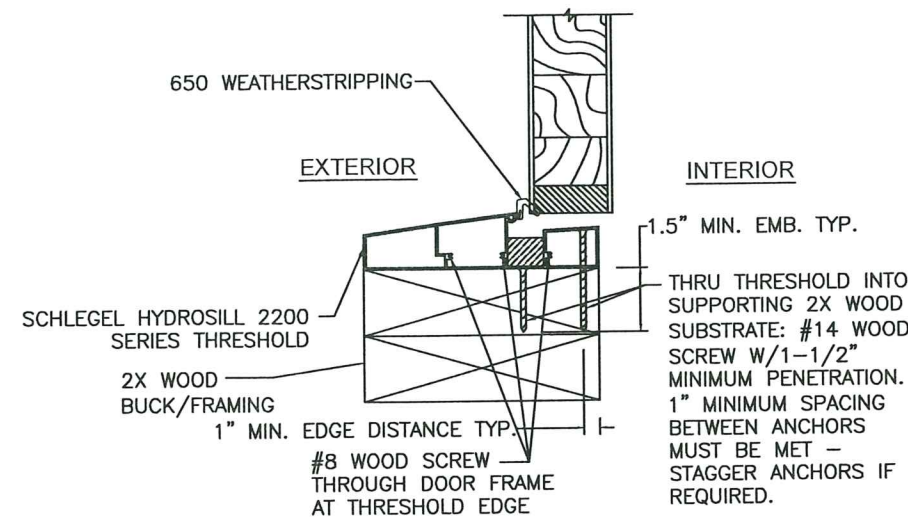

6 THRESHOLD SECTION AT SILL

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027

By Ismael I. Chanle  
Miami-Dade Product Control

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617  
TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
WOOD INSTALLATION - DETAILS 1 THRU 6  
DRAWN BY: RJA DATE: 8/3/2022  
SCALE: N.T.S. DRAWING NO: DSA0008  
REV: A SHEET: 6 OF 19  
PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520775 Phone: 321.690.1788  
LONGWOOD, FLORIDA 32752 Fax: 321.690.1789  
PBP C.A. NO. 23935 Email: info@ptc-corp.com

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami-Dade Product Control  
By Ismael I. Chanle


Robert J. Amoroso, P.E.  
Florida P.E. No. 49752






## DETAILS


### 2X WOOD BUCK/FRAMING INSTALLATION

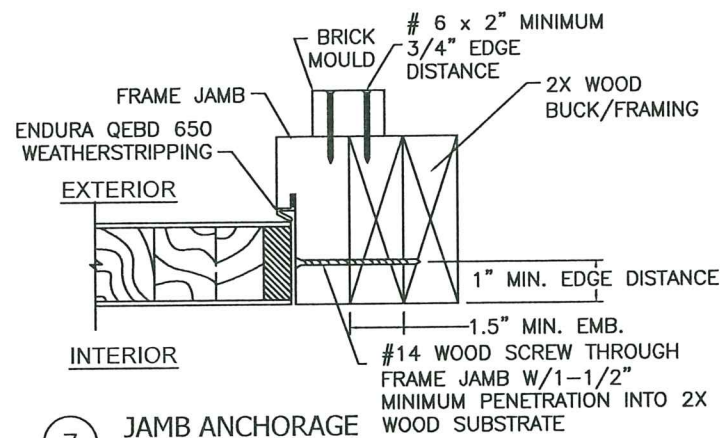

## 7 JAMB ANCHORAGE

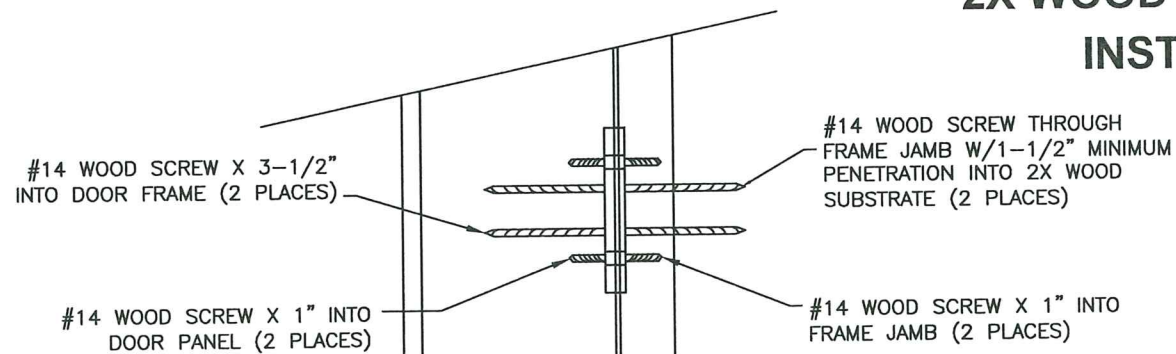

9 CLOSED HINGE - 2X WOOD

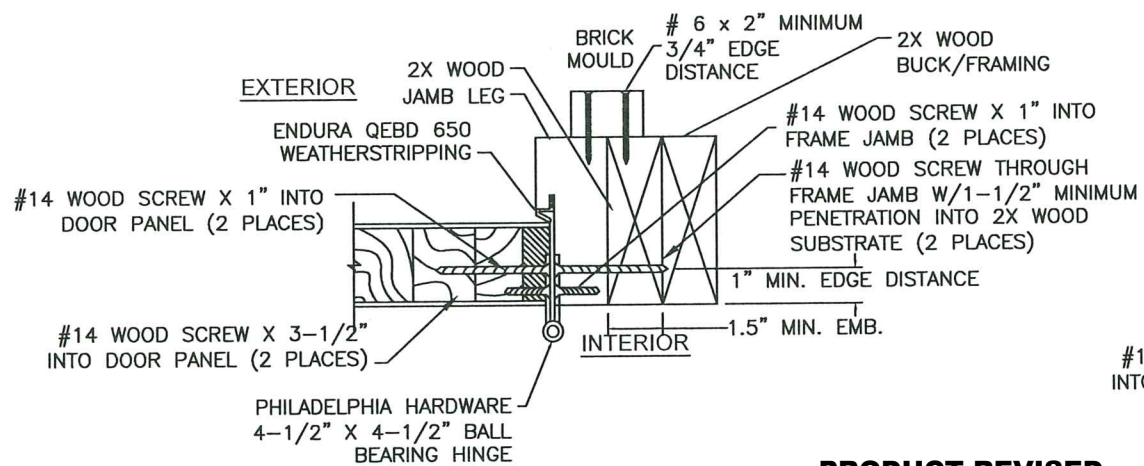


## 8 JAMB ANCHORAGE @ HINGE

**PRODUCT REVISED**  
as complying with the Florida  
Building Code



**NOA-No.** 23-1117.07

**Expiration Date** 10/13/2027



By Ishaq I. Chande  
Miami-Dade Product Control

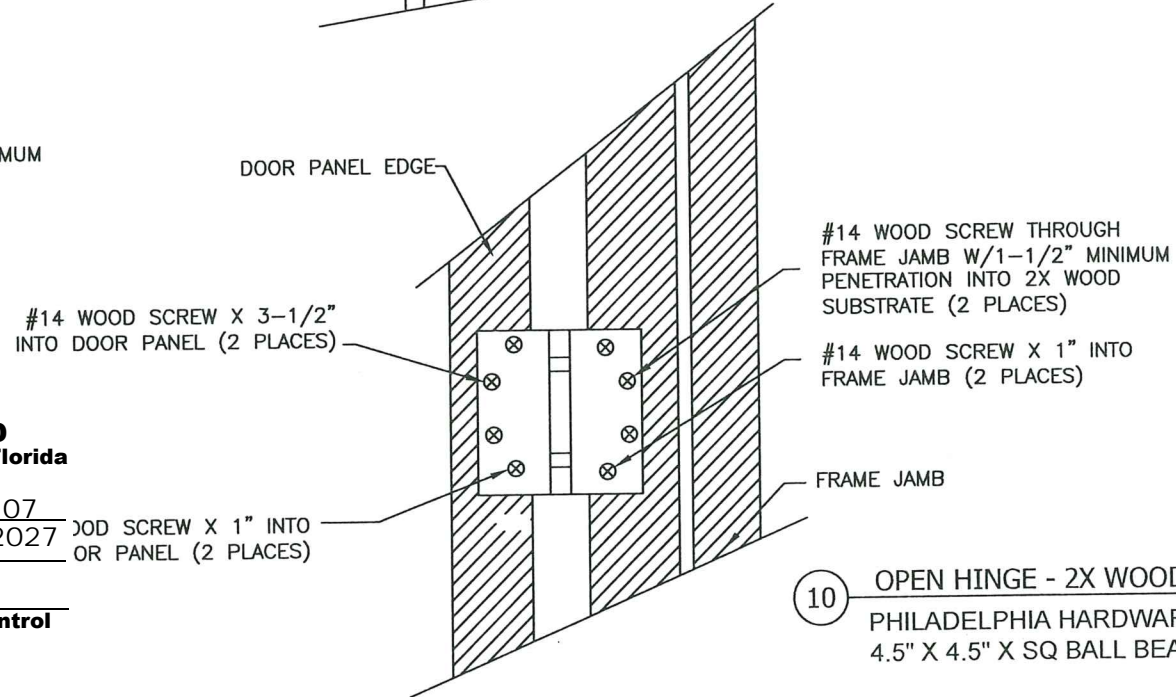

10 OPEN HINGE - 2X WOOD  
PHILADELPHIA HARDWARE GROUP INC.  
4.5" X 4.5" X SQ BALL BEARING HINGE

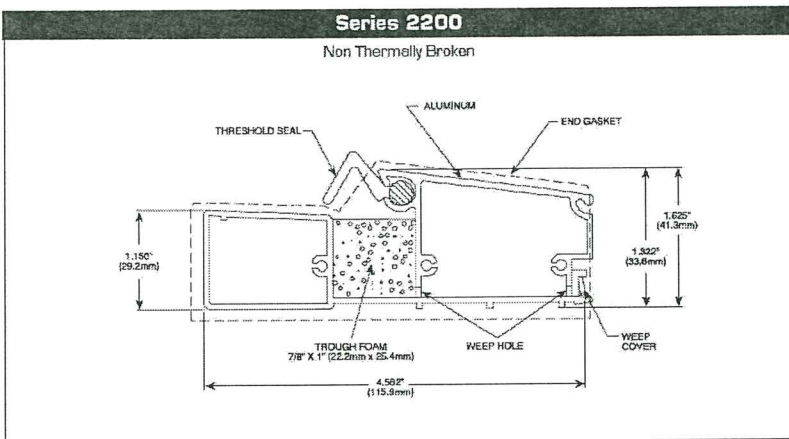

11 THRESHOLD TO FRAME DETAIL  
SCHLEGEL SERIES 2200 HYDROSILL

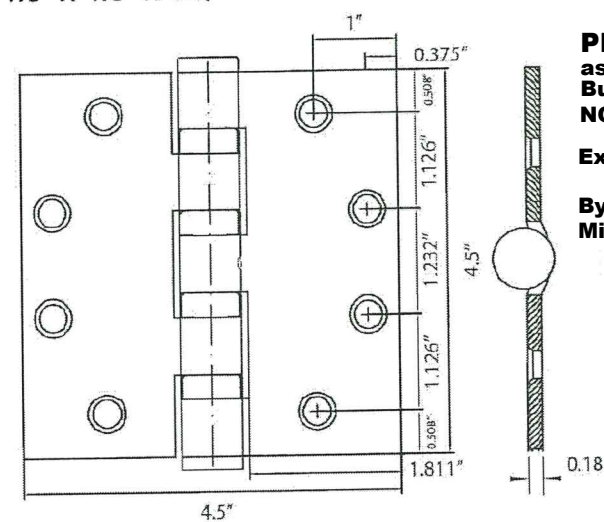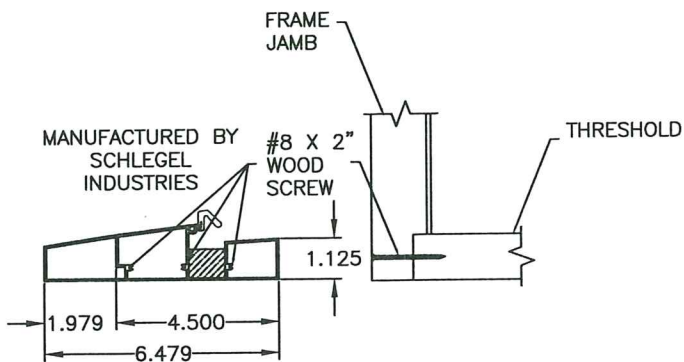

**PRODUCT REVISED**  
as complying with the Florida  
Building Code

**NOA-No.** 23-1117.07


**Expiration Date** 10/13/2027

By Ishaq I. Chank  
Miami-Dade Product Control

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130.02  
Miami Dade Product Control

By Ishy I. Uland

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

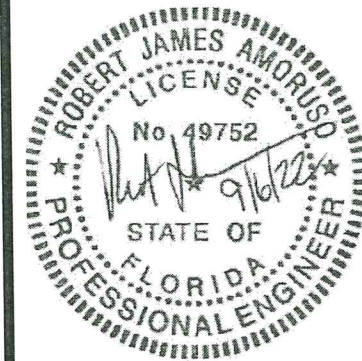




# DETAILS


## CONCRETE INSTALLATION

### NOTES:


1. BRICK MOULD INSTALLATION SHALL USE NO. 6 WOOD SCREW X 2" MINIMUM LENGTH FOR BRICK MOULD-TO-DOOR FRAME INSTALLATION
2. ALL ADDITIONAL FASTENING INCLUDING THE USE OF SEALANTS SHALL BE AT THE DISCRETION OF THE INSTALLER OR AS RECOMMENDED BY THE DOOR MANUFACTURER.

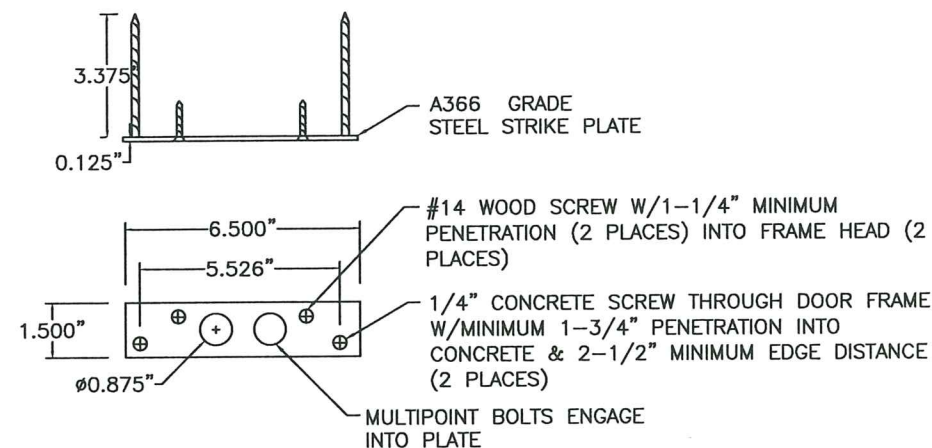


1 TOP STRIKE PLATE

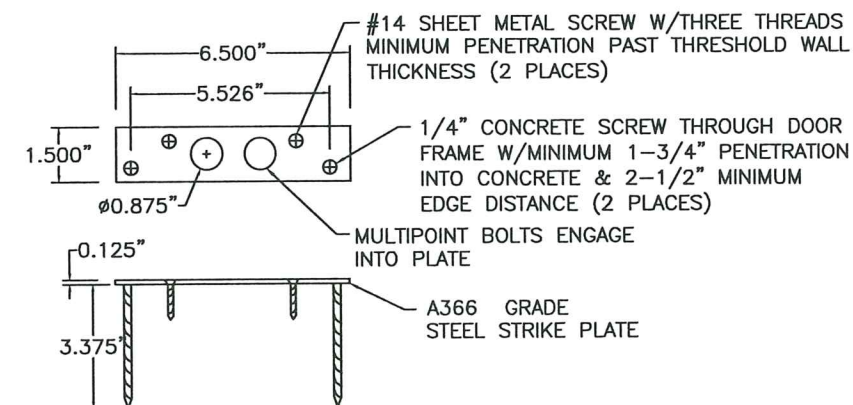


2 BOTTOM STRIKE PLATE

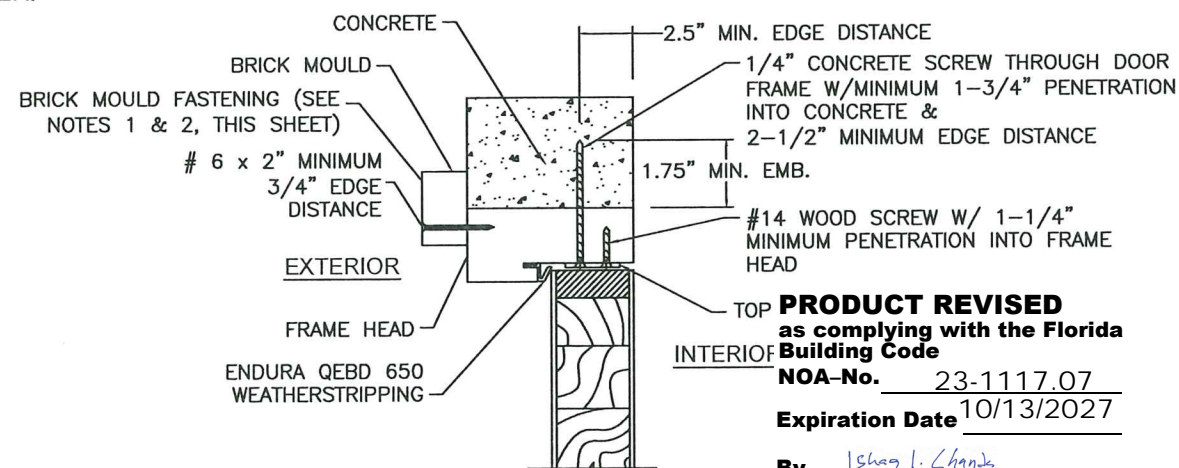


3 HEAD ANCHORAGE AT STRIKE PLATE

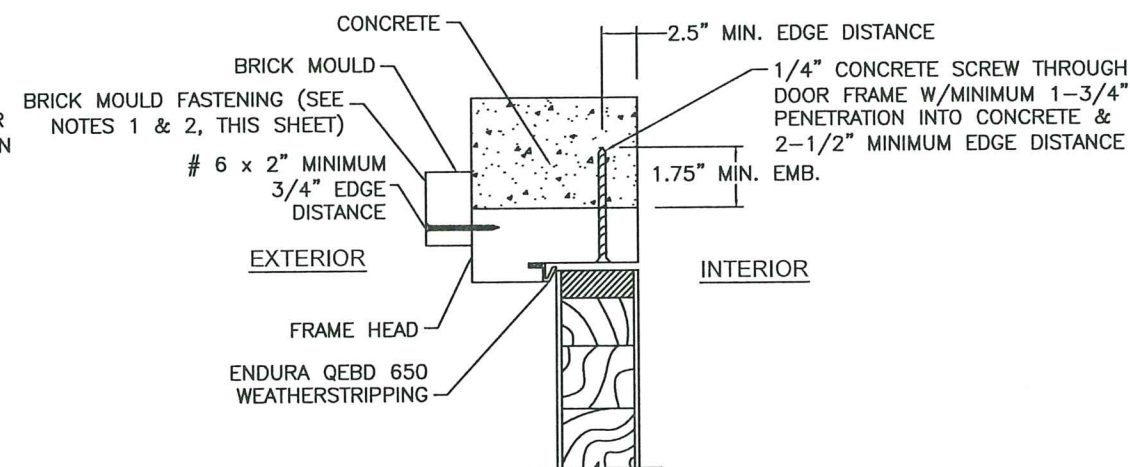

5 HEAD ANCHORAGE AT FRAME HEAD

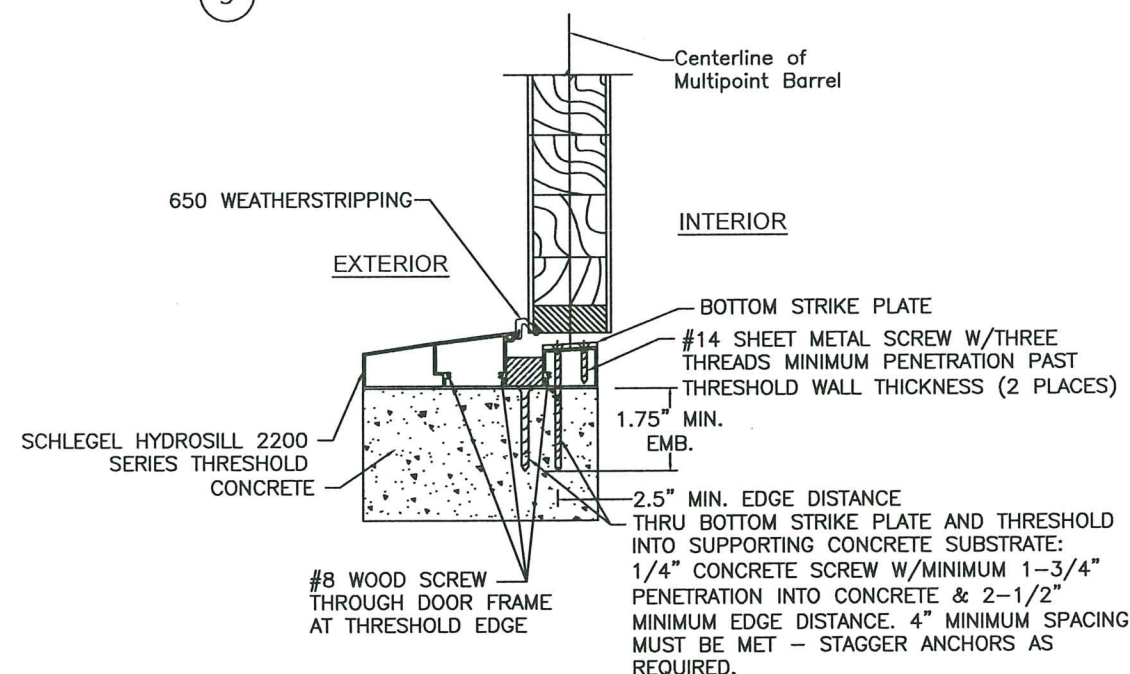

4 THRESHOLD SECTION AT STRIKE PLATE

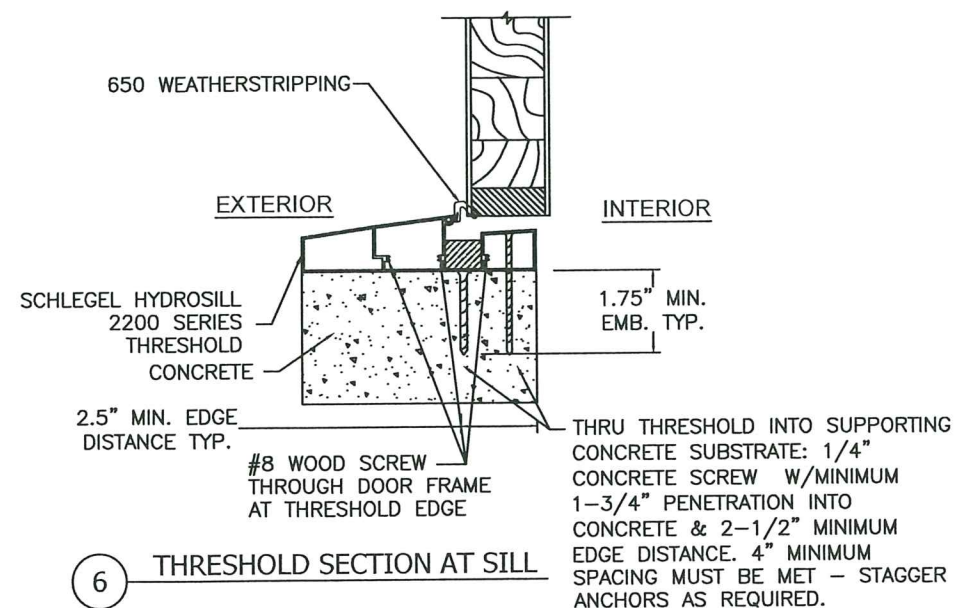

6 THRESHOLD SECTION AT SILL

PROJECT #420-0601

The Door Store of America, Inc.  
10881 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
CONCRETE INSTALLATION - DETAILS 1 THRU 6

PREPARED BY: RJA

DATE: 8/3/2022

DRAWING NO: DSA0008

REVISED FOR MD COMMENTS

DATE


REV

DESCRIPTION

BY

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishay L. Chanik





Robert J. Amoroso, P.E.  
Florida P.E. No. 49752

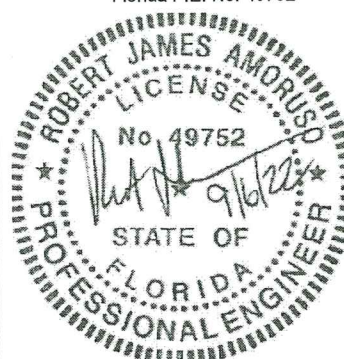



# DETAILS




## CONCRETE/MASONRY INSTALLATION

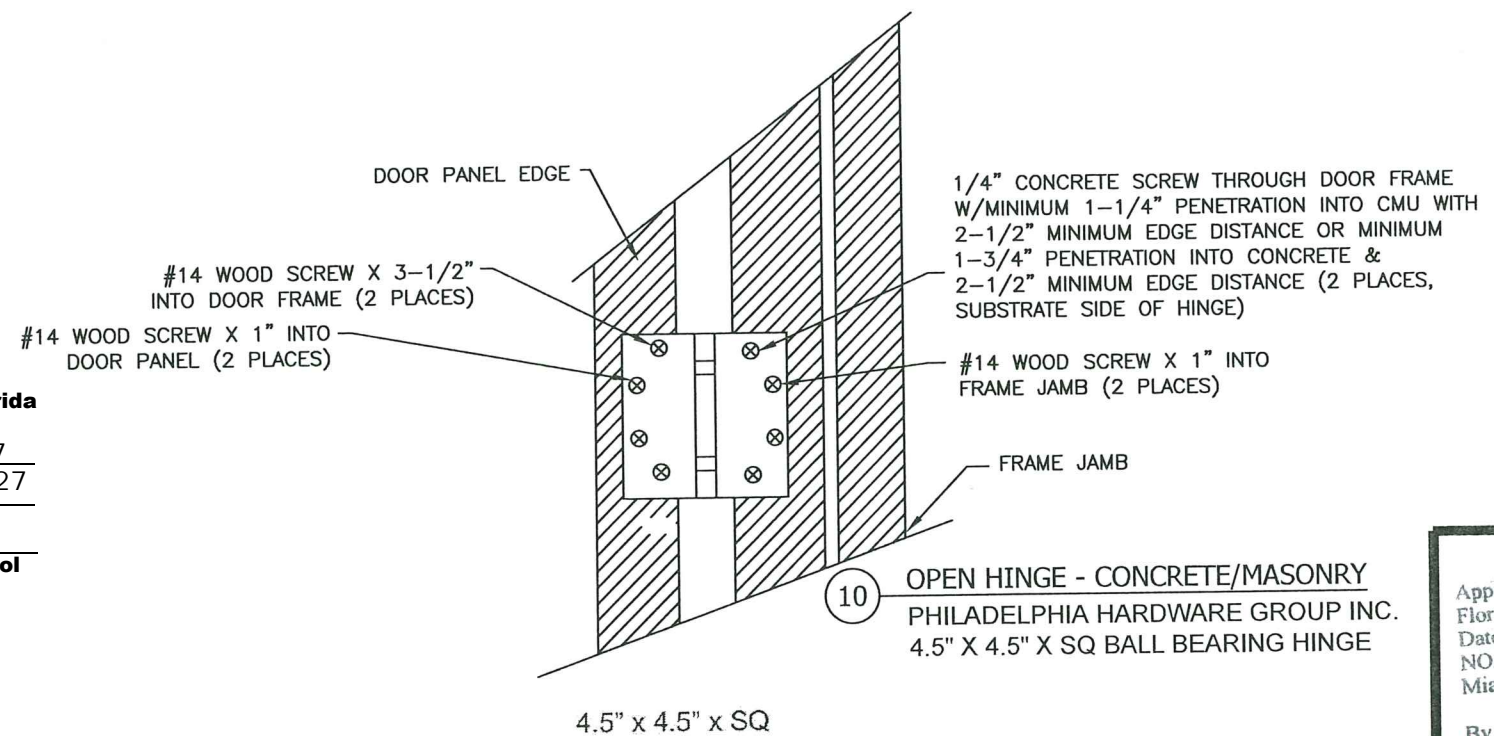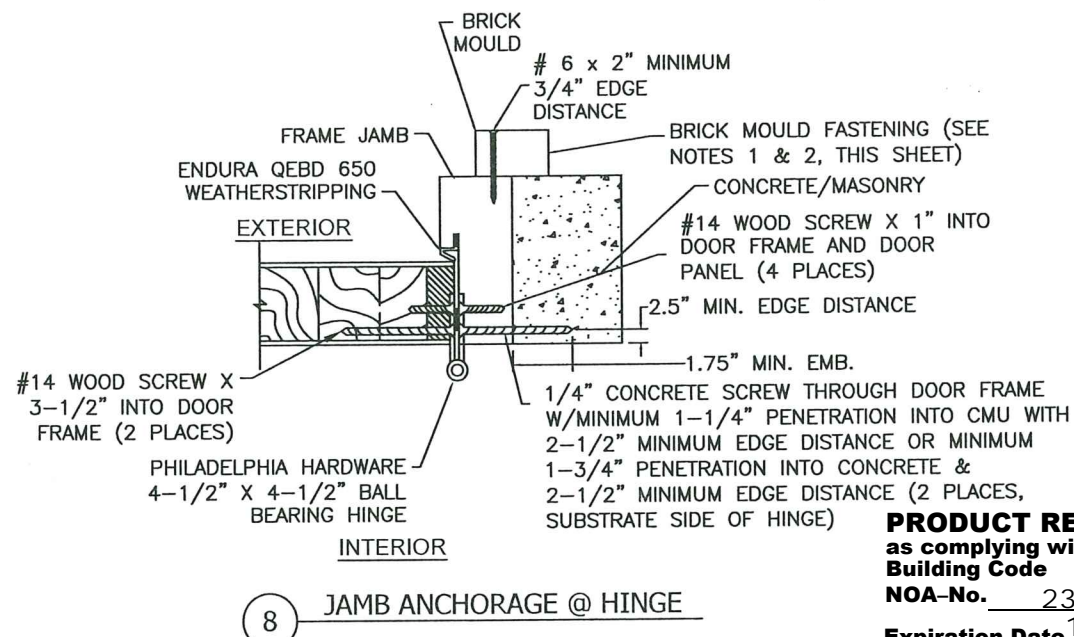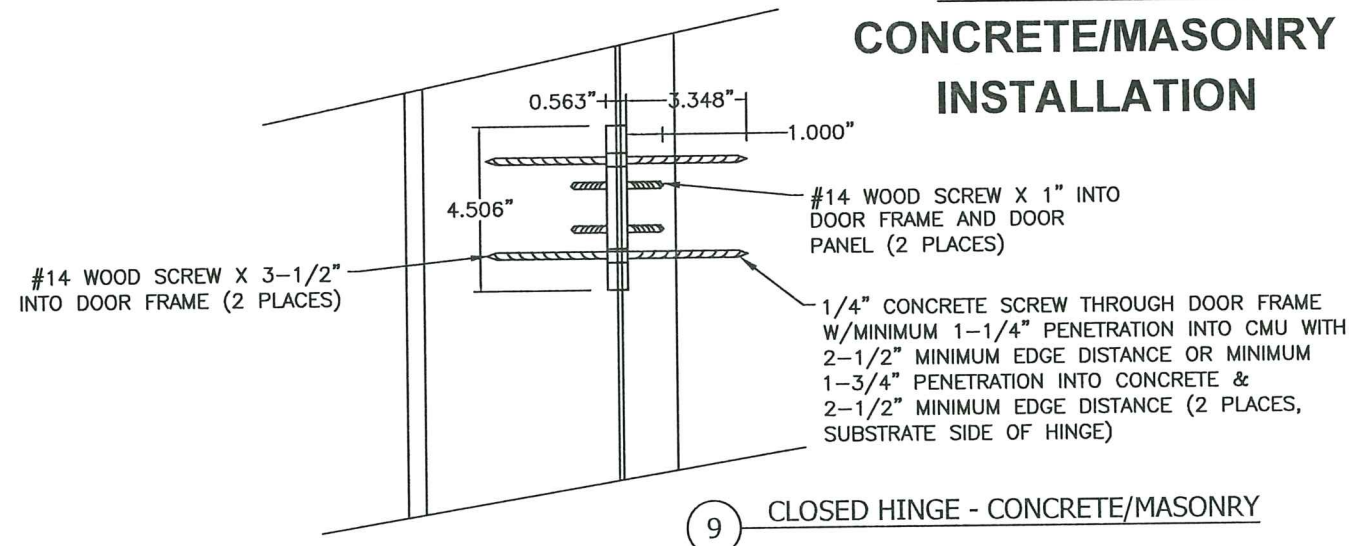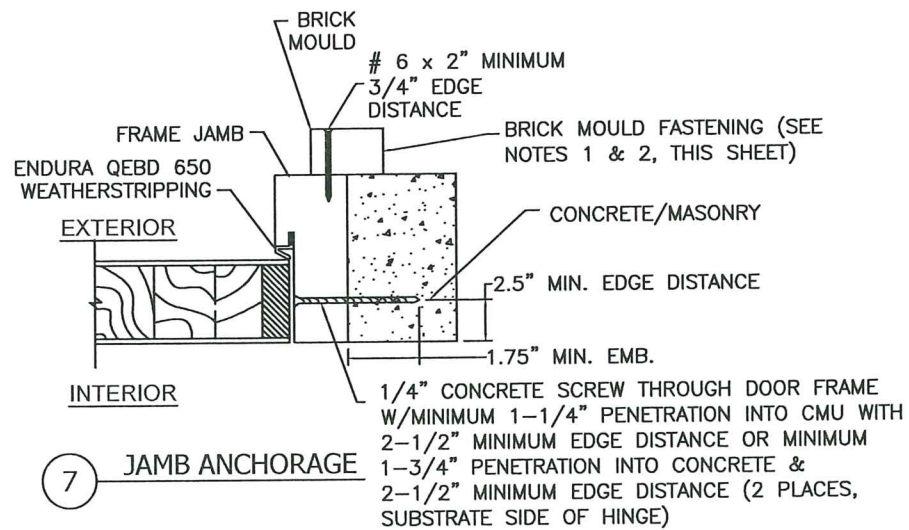

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishay I. Chandra  
**Miami-Dade Product Control**

### NOTES:

- BRICK MOULD INSTALLATION SHALL USE NO. 6 WOOD SCREW X 2" MINIMUM LENGTH FOR BRICK MOULD-TO-DOOR FRAME INSTALLATION
- ALL ADDITIONAL FASTENING INCLUDING THE USE OF SEALANTS SHALL BE AT THE DISCRETION OF THE INSTALLER OR AS RECOMMENDED BY THE DOOR MANUFACTURER.

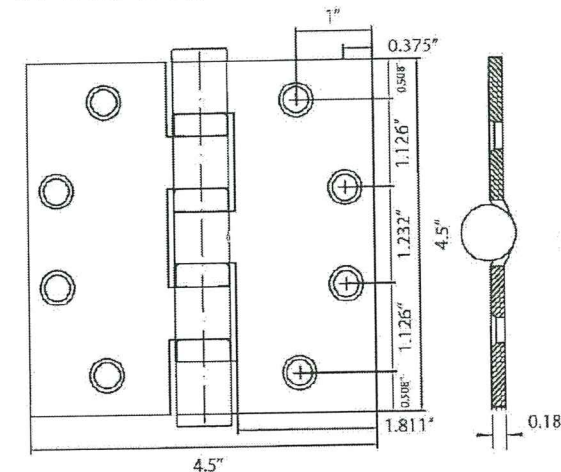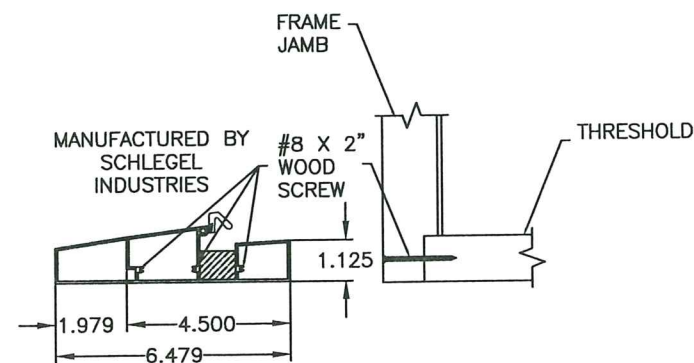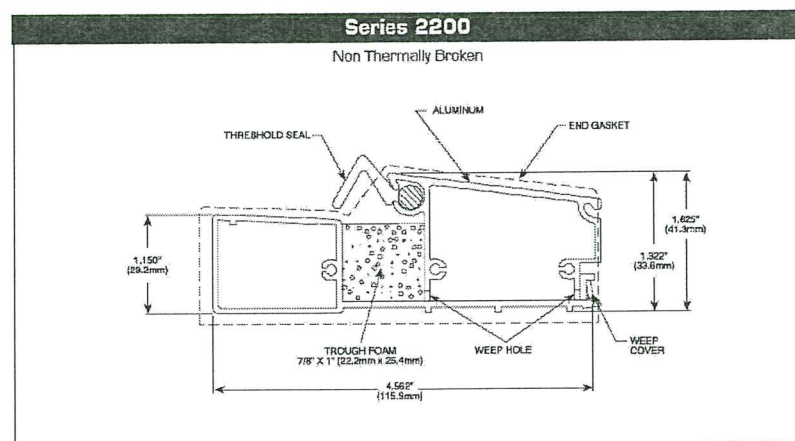

11 THRESHOLD TO FRAME DETAIL  
SCHLEGEL SERIES 2200 HYDROSILL

PROJECT #420-0601


The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
CONCRETE/MASONRY INSTALLATION - DETAILS 7 THRU 11

PREPARED BY: RJA  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SCALE: N.T.S.  
SHEET: 9 OF 19  
REV: A  
PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520775  
LONGWOOD, FLORIDA 32752  
Phone: 321.650.1788  
Fax: 321.650.1789  
Email: info@ptc-corp.com


Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 22-1130-02  
Miami Dade Product Control  
By Ishay I. Chandra

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752


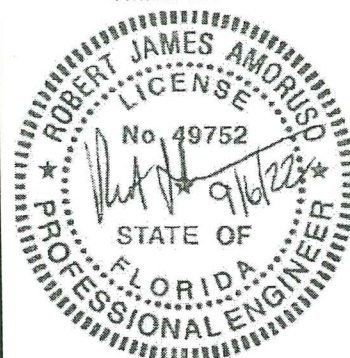





# DETAILS MISCELLANEOUS

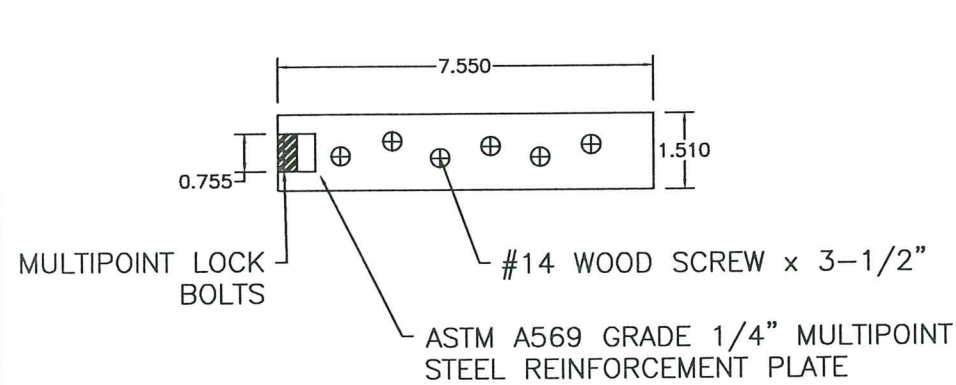

14 REINFORCEMENT PLATE AT MULTIPOINT LOCK

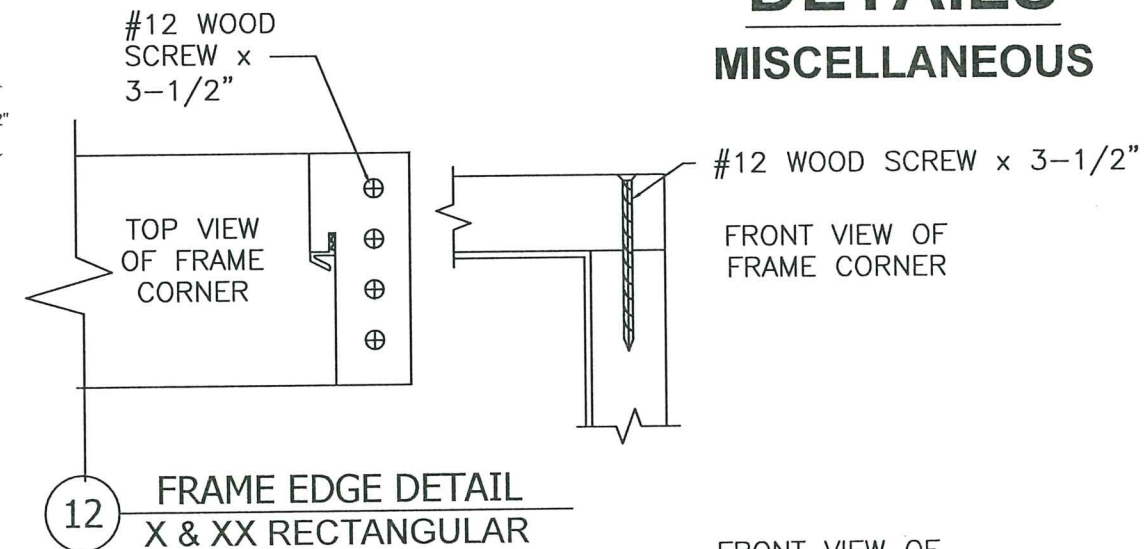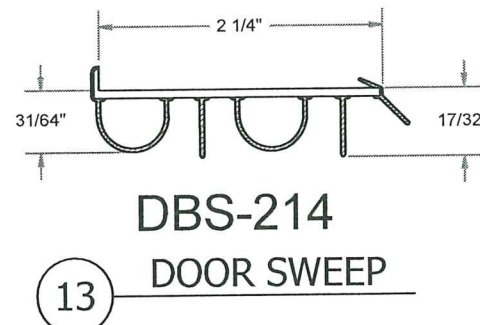


12 FRAME EDGE DETAIL  
X & XX RECTANGULAR

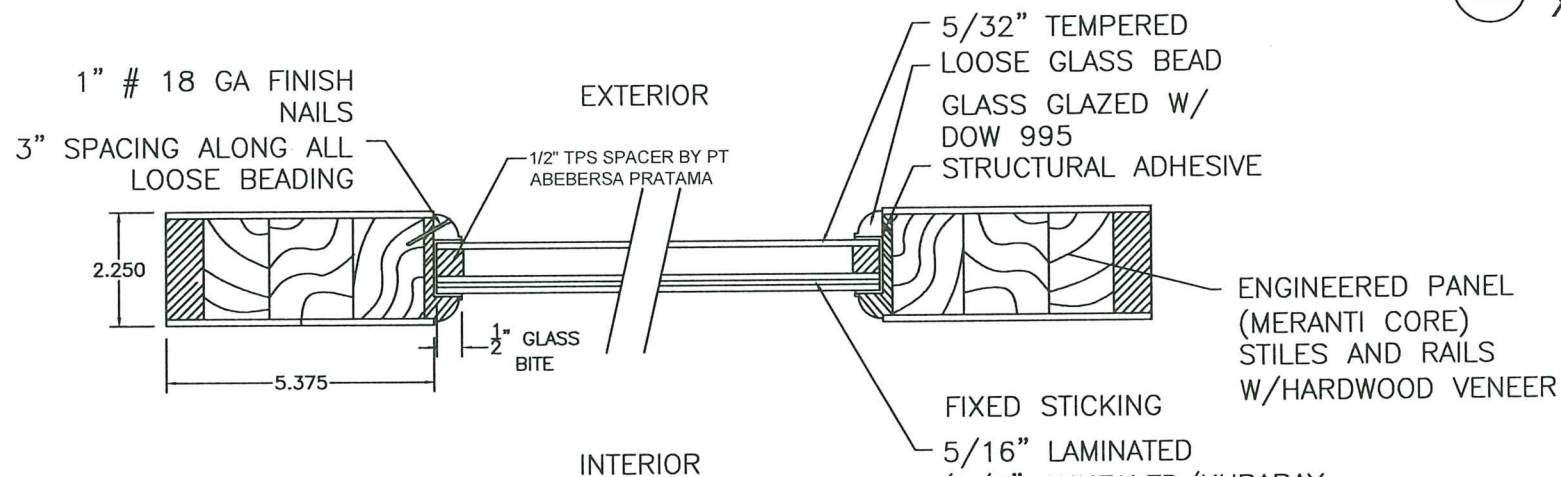


GLAZING IS LESS THAN 3' IN WIDTH,  
THEREFORE SETTING BLOCKS NOT  
REQUIRED. IF USED, SETTING BLOCKS SHALL  
BE NEOPRENE 70-90 SHORE A DUROMETER  
HARDNESS OR APPROVED EQUAL.

**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishag I. Chande  
Miami-Dade Product Control


15 PANEL GLAZING DETAIL 9

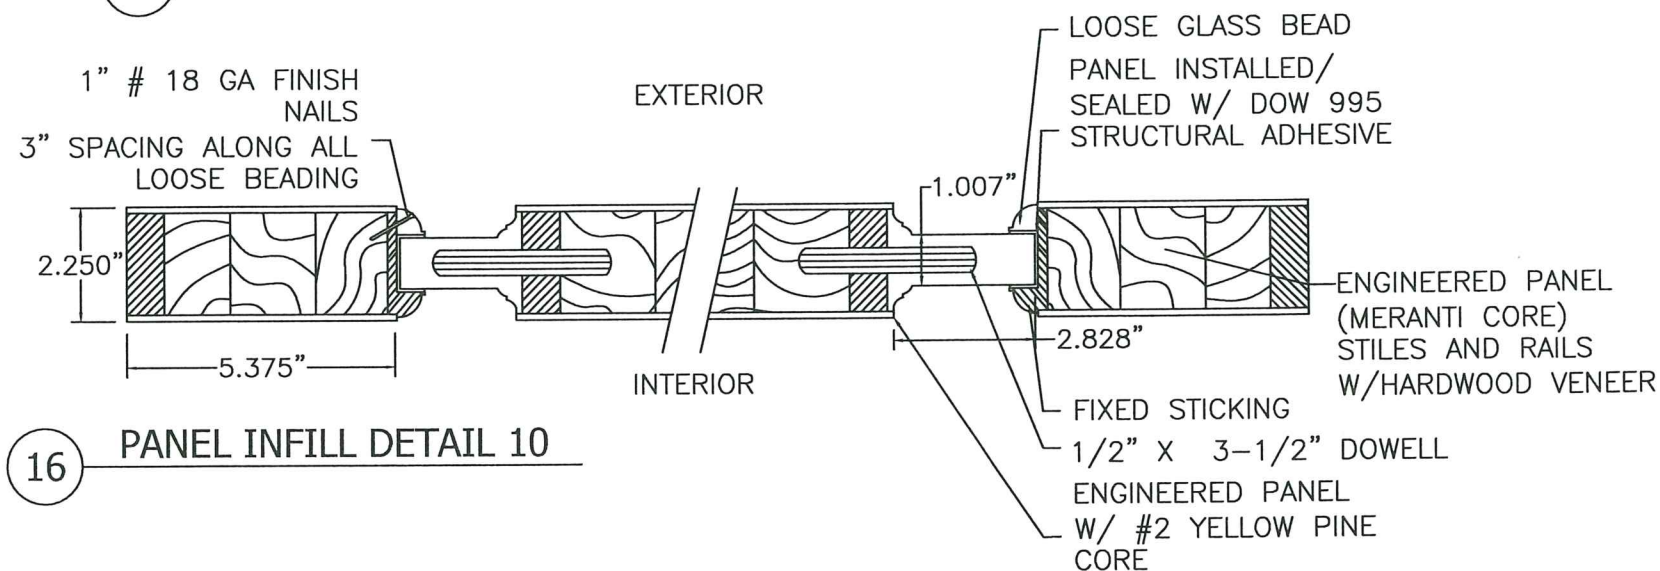

16 PANEL INFILL DETAIL 10

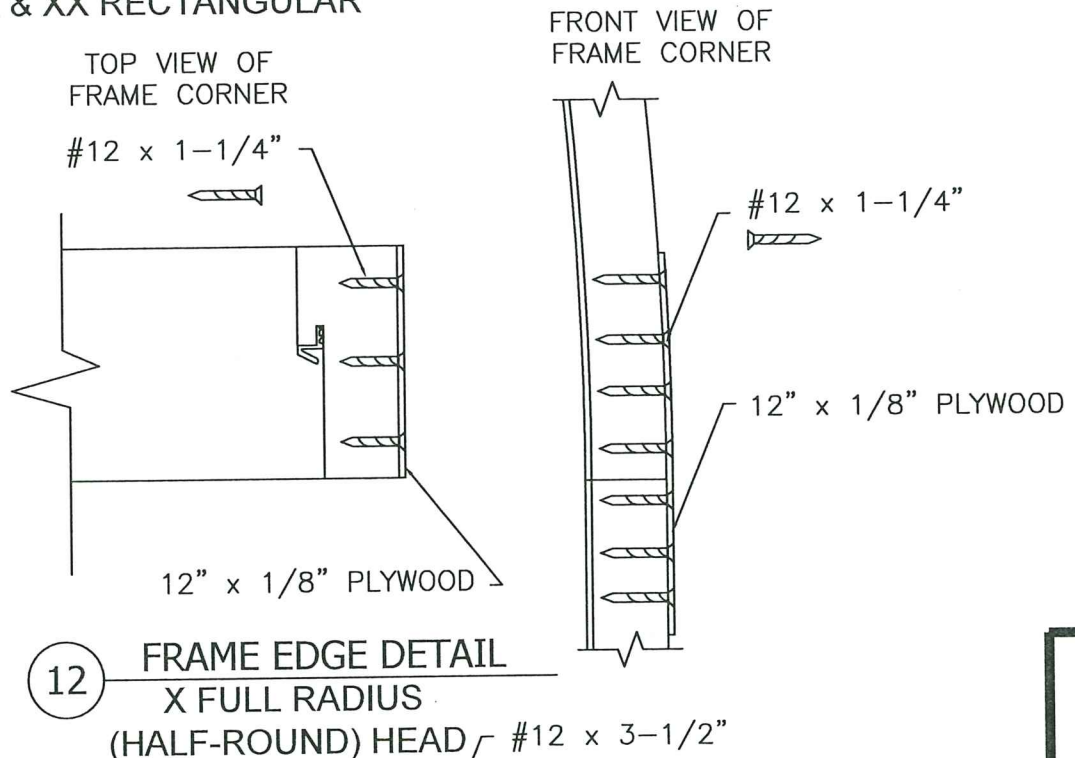

12 FRAME EDGE DETAIL  
X FULL RADIUS  
(HALF-ROUND) HEAD

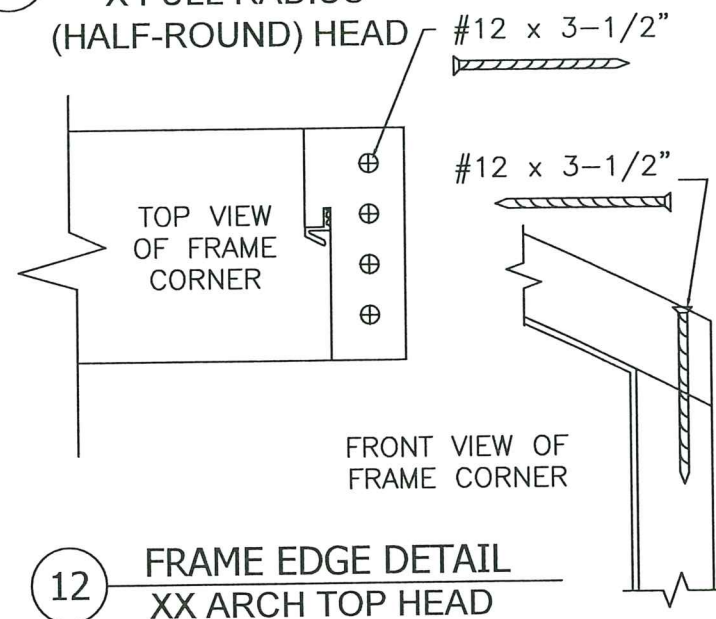

12 FRAME EDGE DETAIL  
XX ARCH TOP HEAD

PROJECT #420-0601

REV	DATE	DESCRIPTION
A	9/2/2022	REVISED FOR MID COMMENTS

RJA

The Door Store of America, Inc.  
 10681 World Trade Blvd  
 Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
 DETAILS - MISCELLANEOUS

PREPARED BY: RJA  
 SCALE: N.T.S.  
 REV: A

DATE: 8/3/2022  
 DRAWING NO: DSA0008  
 SHEET: 10 OF 19

Approved as complying with the  
 Florida Building Code  
 Date 10/13/22  
 NOA# 20-1130-02  
 Miami Dade Product Control  
 By Ishag I. Chande


Robert J. Amoroso, P.E.  
 Florida P.E. No. 49752




Diagram illustrating the dimensions of the frame head detail:

- Top width:  $45\frac{5}{8}$  inches
- Left height:  $1\frac{1}{2}$  inches
- Right height: 2 inches
- Bottom width (main section):  $25\frac{5}{8}$  inches
- Bottom width (extension): 2 inches

FRAME HEAD DETAIL

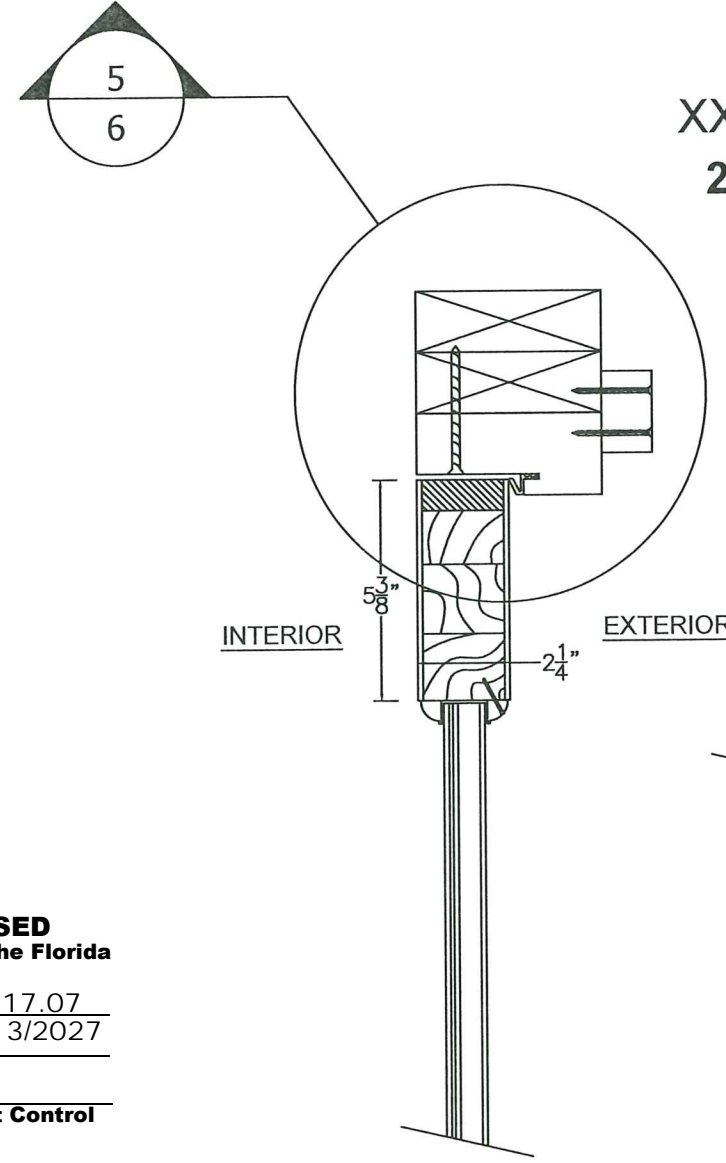

FULLY GLAZED DOOR  
PANEL SHOWN.  
PARTIALLY GLAZED WITH  
OPAQUE RAISED PANEL  
AS-TESTED ARE  
APPROVED.

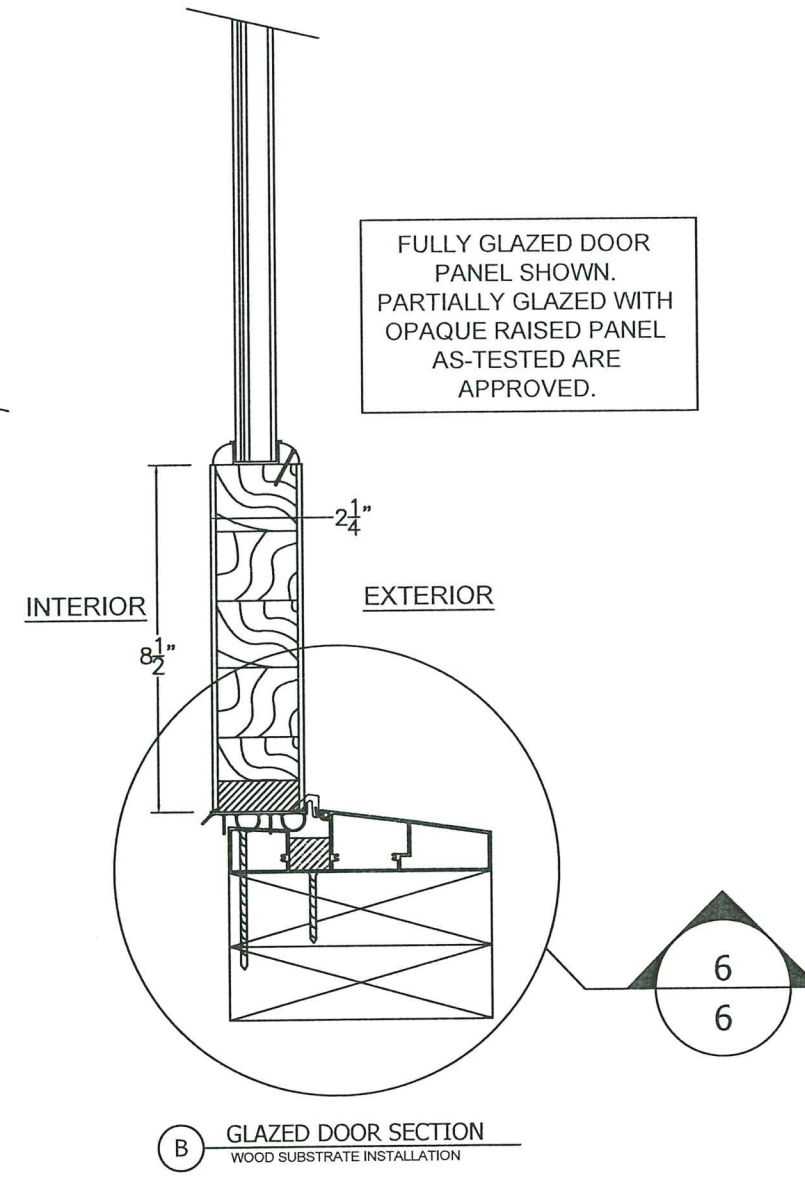


Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-A2  
Miami Dade Product Control  
By Iskay I. Urrutia



# SECTIONS

## XX DOOR HORIZONTAL VIEWS 2X WOOD BUCK/FRAMING INSTALLATION

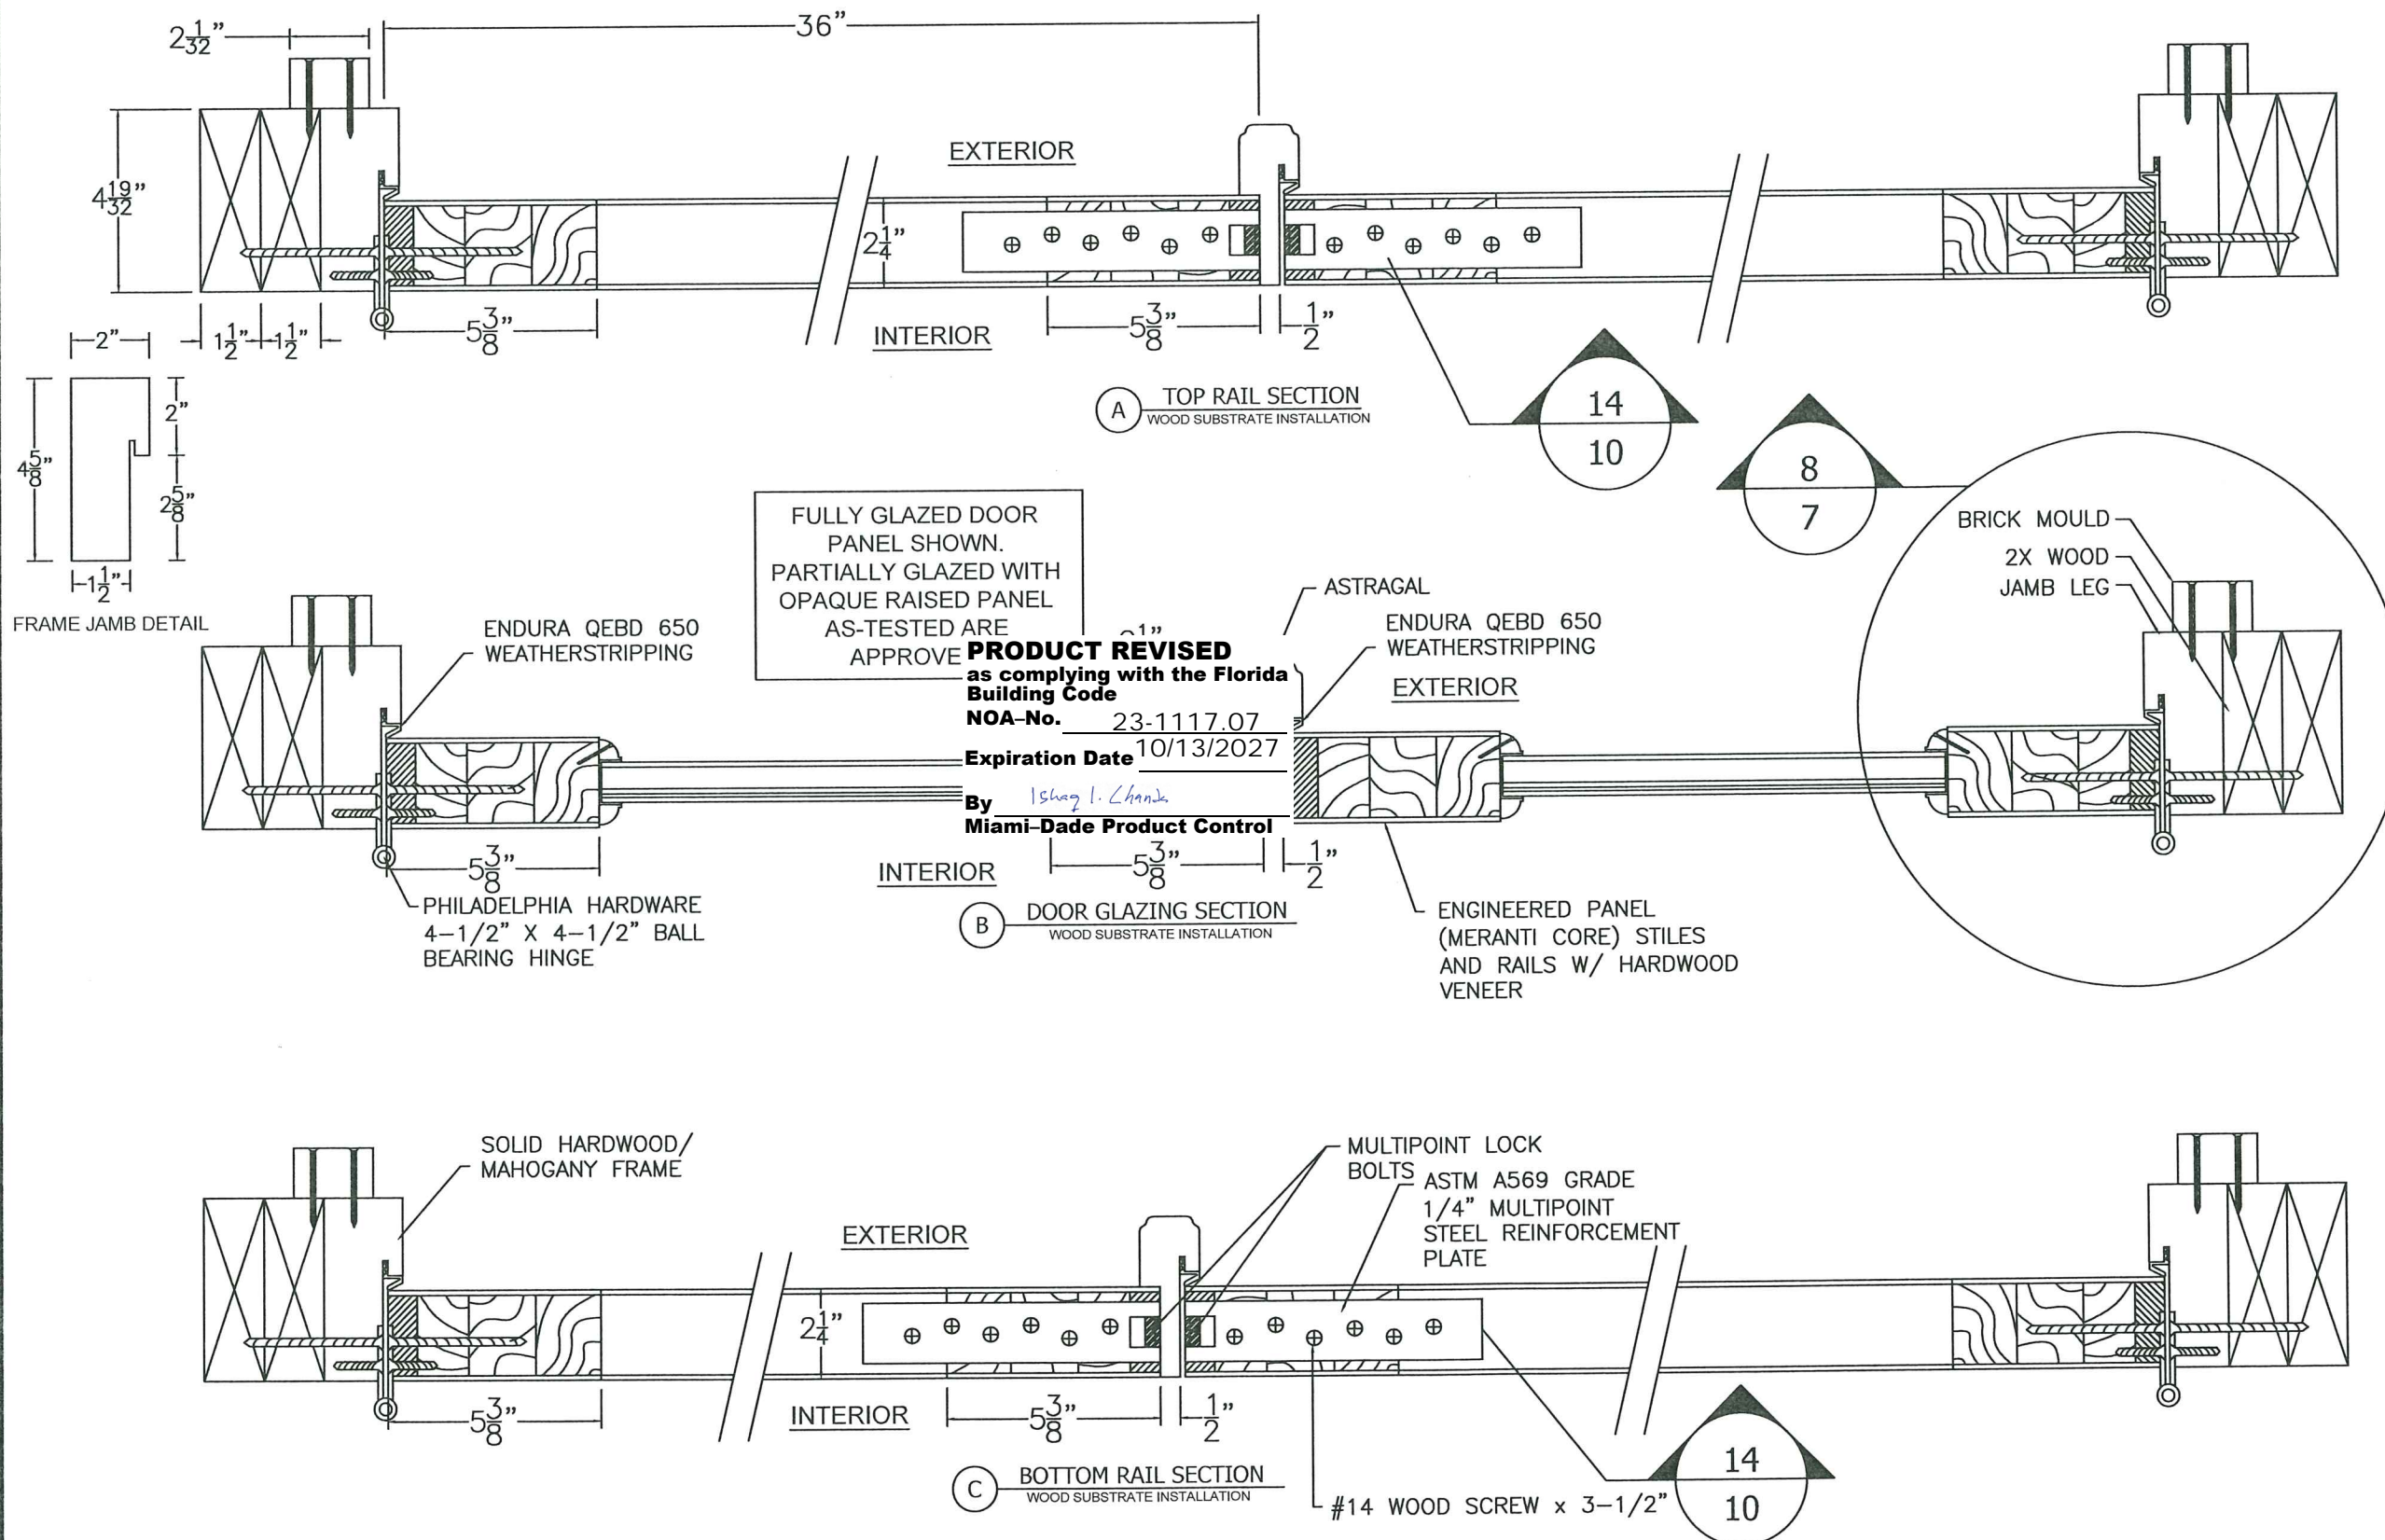

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617


TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
SECTIONS - HORIZONTAL - WOOD INSTALLATION

PREPARED BY: RJA  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 12 OF 19  
SCALE: N.T.S.  
REV: A

REVISED FOR MD COMMENTS  
9/2/2022  
RJA  
BY


Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130.02  
Miami Dade Product Control  
By Ishay I. Chanin

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

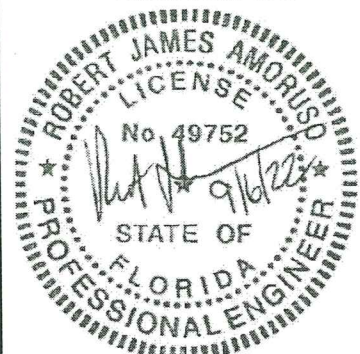



**X DOOR HORIZONTAL VIEWS**  
**2X WOOD BUCK/FRAMING**  
**INSTALLATION**

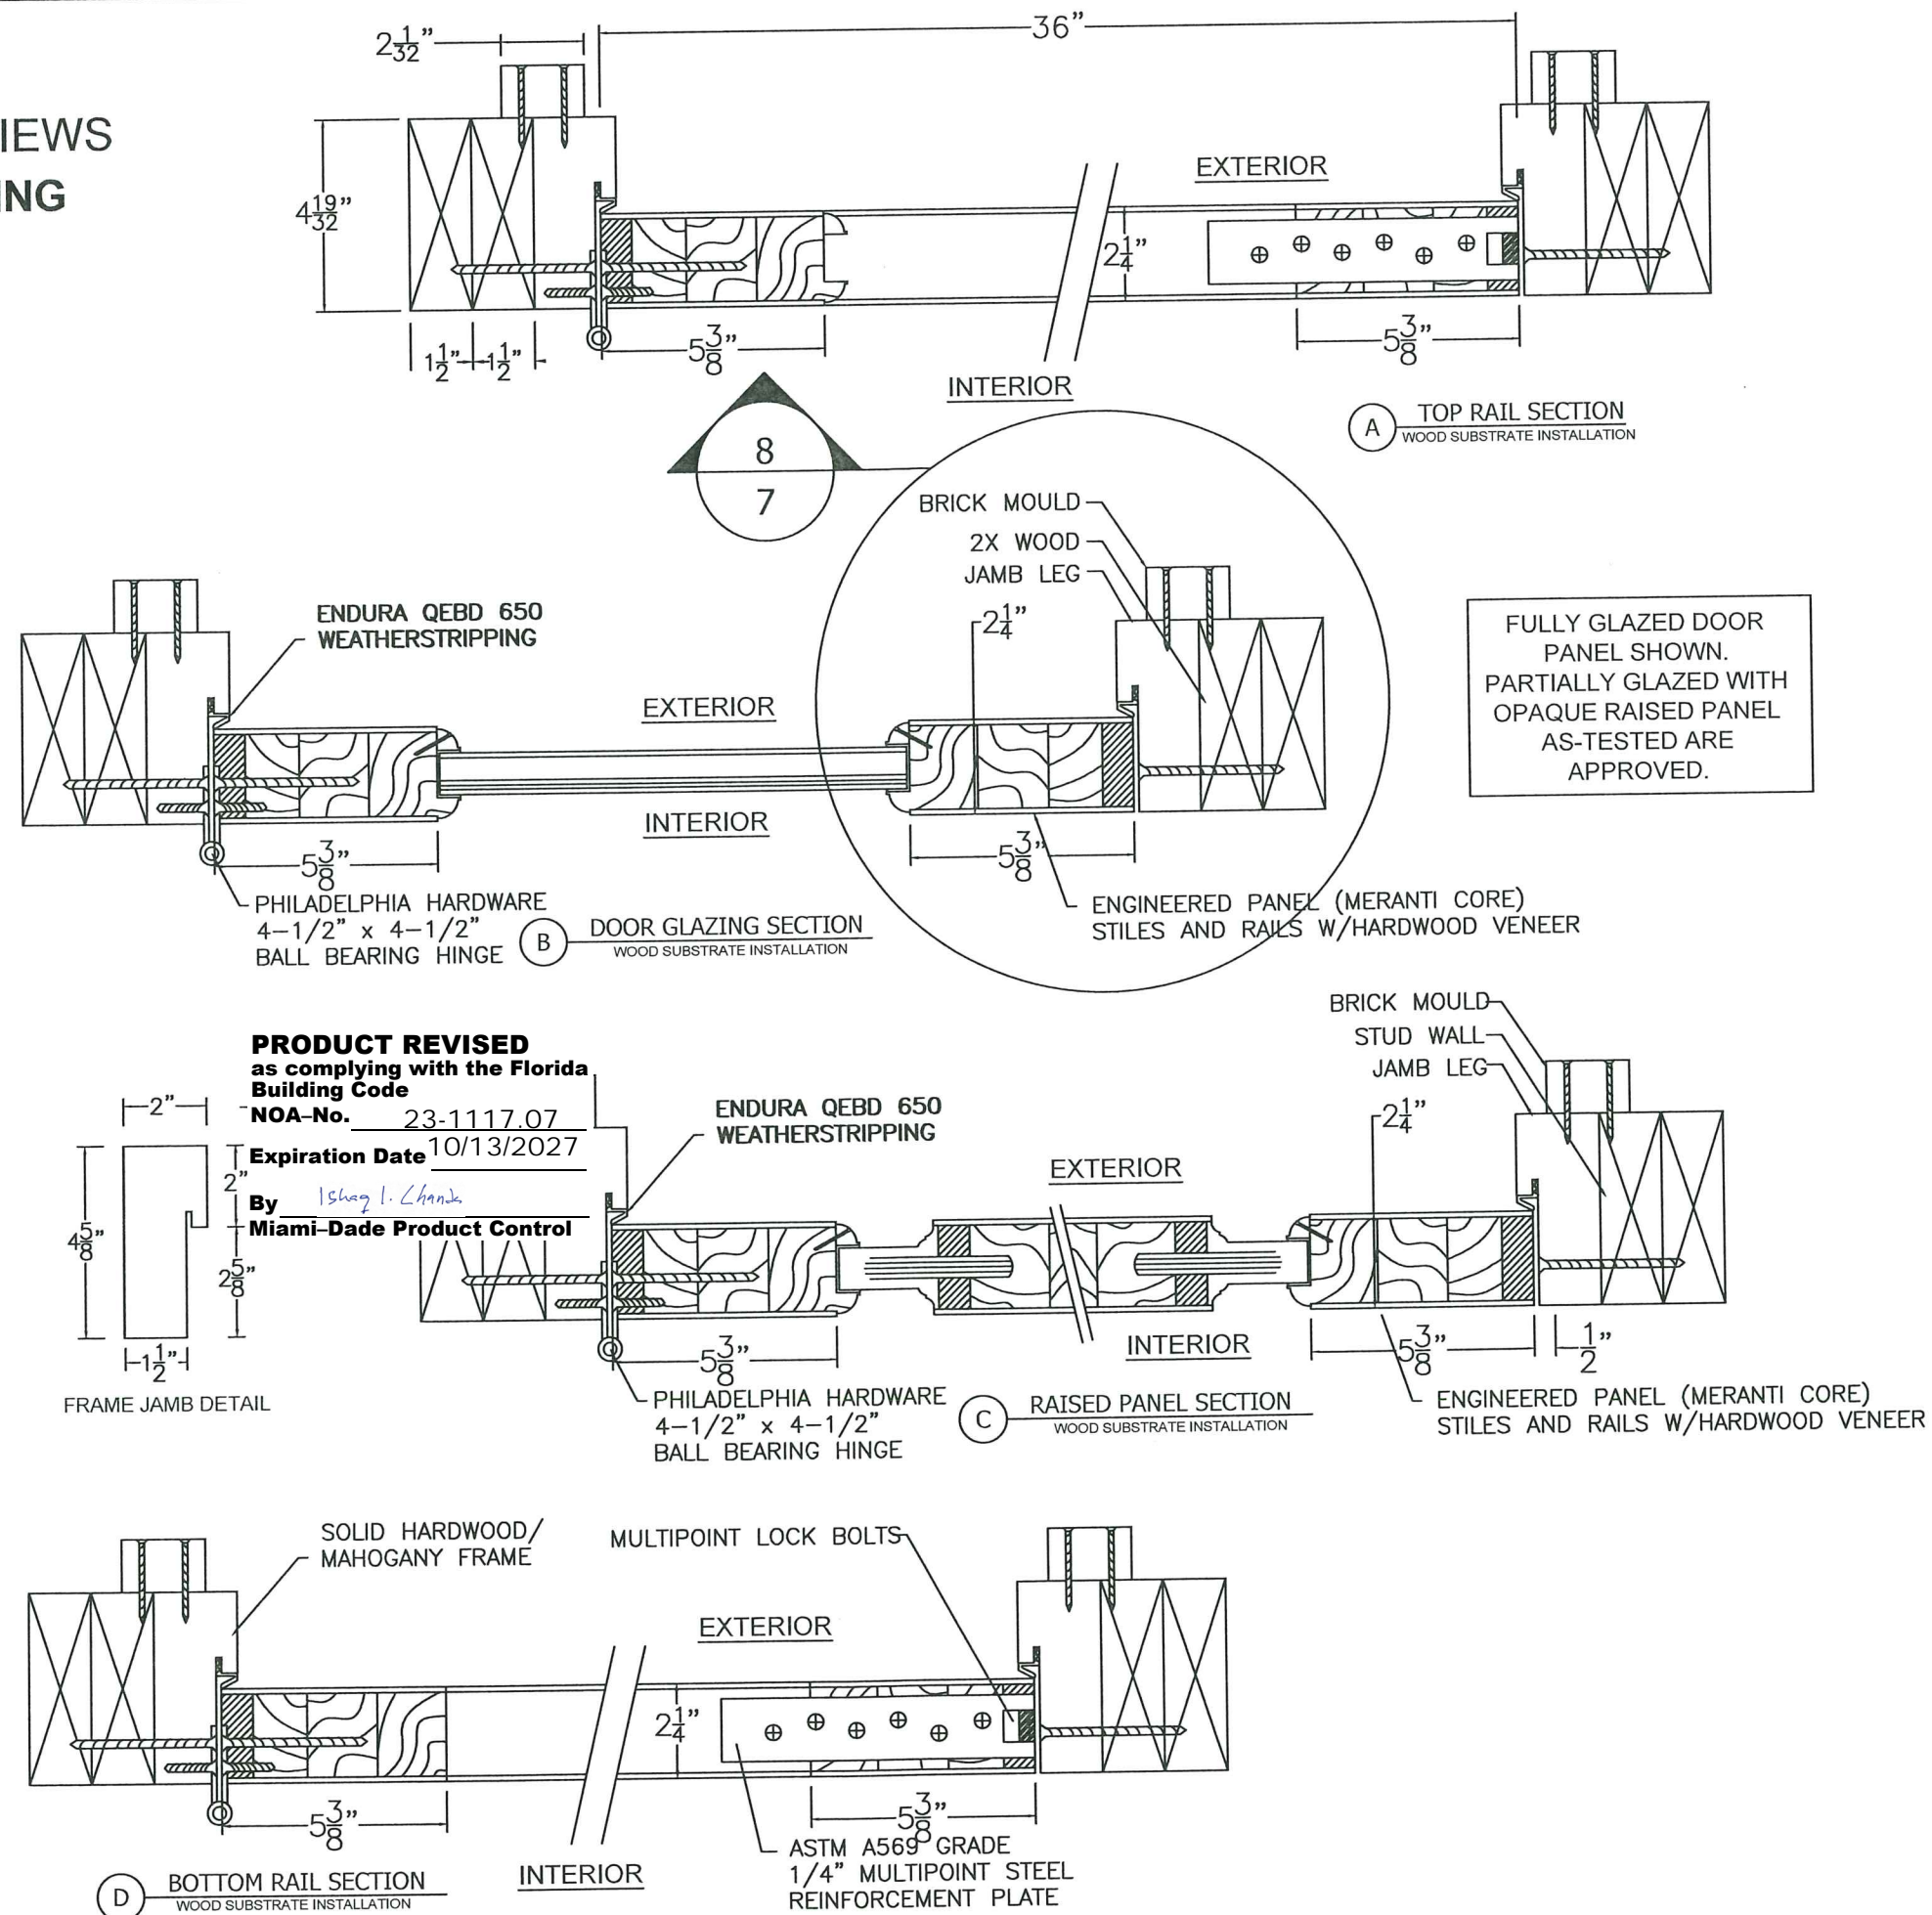

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control

By Sheryl L. Underwood

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752



PROJECT #420-0601

**The Door Store of America, Inc.**  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
SECTIONS - HORIZONTAL - WOOD INSTALLATION

PREPARED BY:

**PDC**

PDC PRODUCT DESIGN GROUP, LLC  
PO BOX 520775  
LONGWOOD, FLORIDA 32752  
EPAE C.A. NO. 259335

Phone: 321.690.1788  
Fax: 321.690.1789  
Email: [info@pdc-corp.com](mailto:info@pdc-corp.com)

REV	DESCRIPTION	DATE	BY
A	REVISED FOR MD COMMENTS	9/2/2022	RJA




# SECTIONS



## XX DOOR VERTICAL VIEWS

### CONCRETE INSTALLATION

3  
8

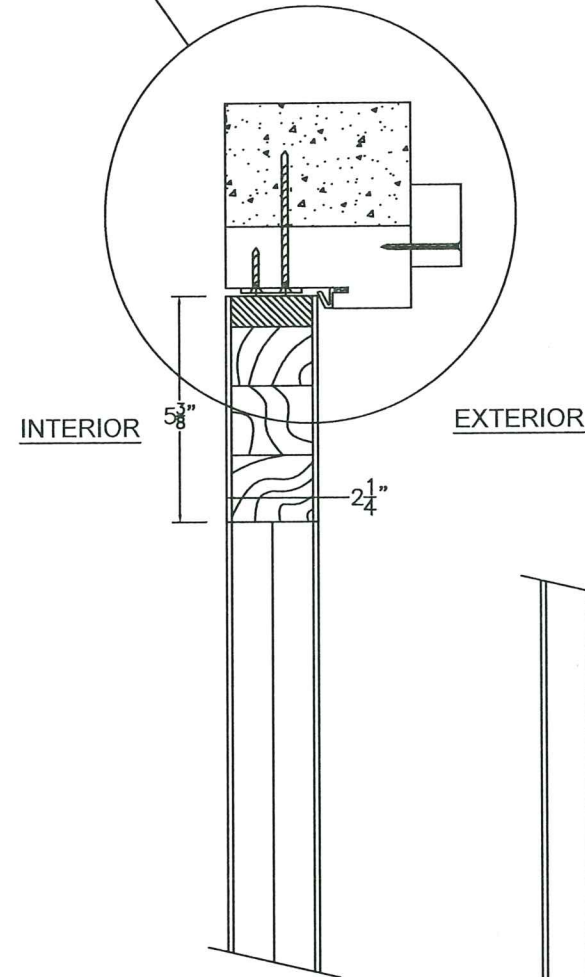


5  
8

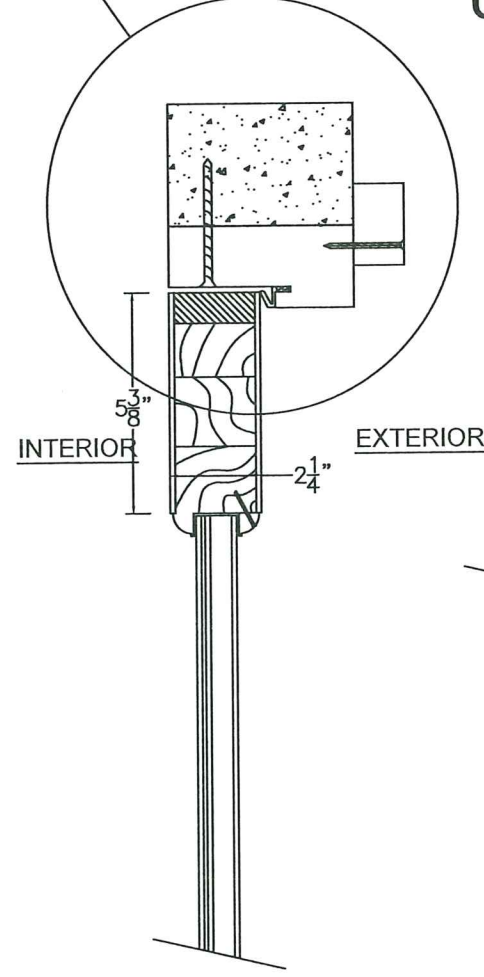


**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishay I. Chanin  
Miami-Dade Product Control

FULLY GLAZED DOOR  
PANEL SHOWN.  
PARTIALLY GLAZED WITH  
OPAQUE RAISED PANEL  
AS-TESTED ARE  
APPROVED.

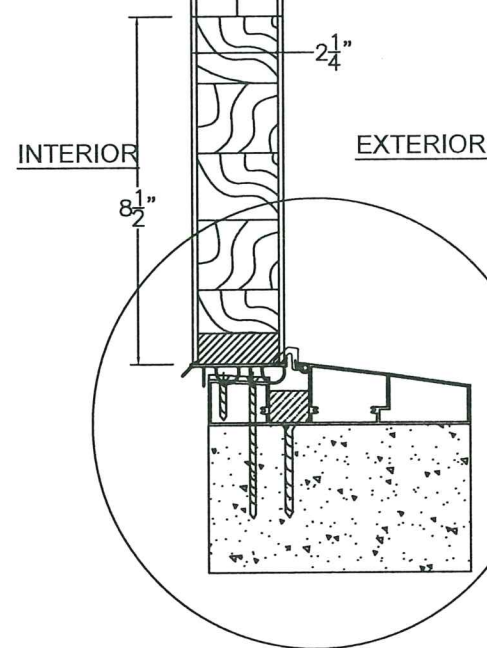

4  
8

A STILE DOOR SECTION  
CONCRETE/MASONRY SUBSTRATE  
INSTALLATION

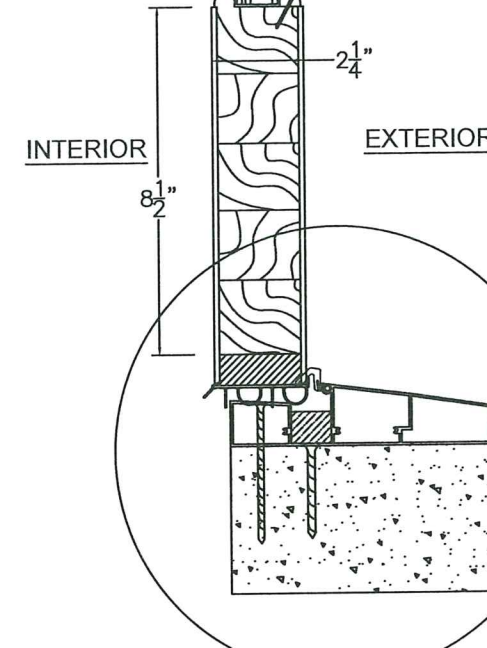

6  
8

B GLAZED DOOR SECTION  
CONCRETE/MASONRY SUBSTRATE  
INSTALLATION

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
SECTIONS - VERTICAL - CONCRETE INSTALLATION

PREPARED BY: **PTC**  
PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520715  
LONGWOOD, FLORIDA 32752  
FBPE C.A. NO. 23935  
Phone: 321.690.1788  
Fax: 321.690.1789  
Email: info@ptc-corp.com

DRAWN BY: RJA  
SCALE: N.T.S.  
REV: A  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 13 OF 19

REV	DESCRIPTION	DATE	BY
A	REVISED FOR MD COMMENTS	9/2/2022	RJA

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishay I. Chanin


Robert J. Amoruso, P.E.  
Florida P.E. No. 49752






## XX DOOR HORIZONTAL VIEWS

### CONCRETE/MASONRY INSTALLATION

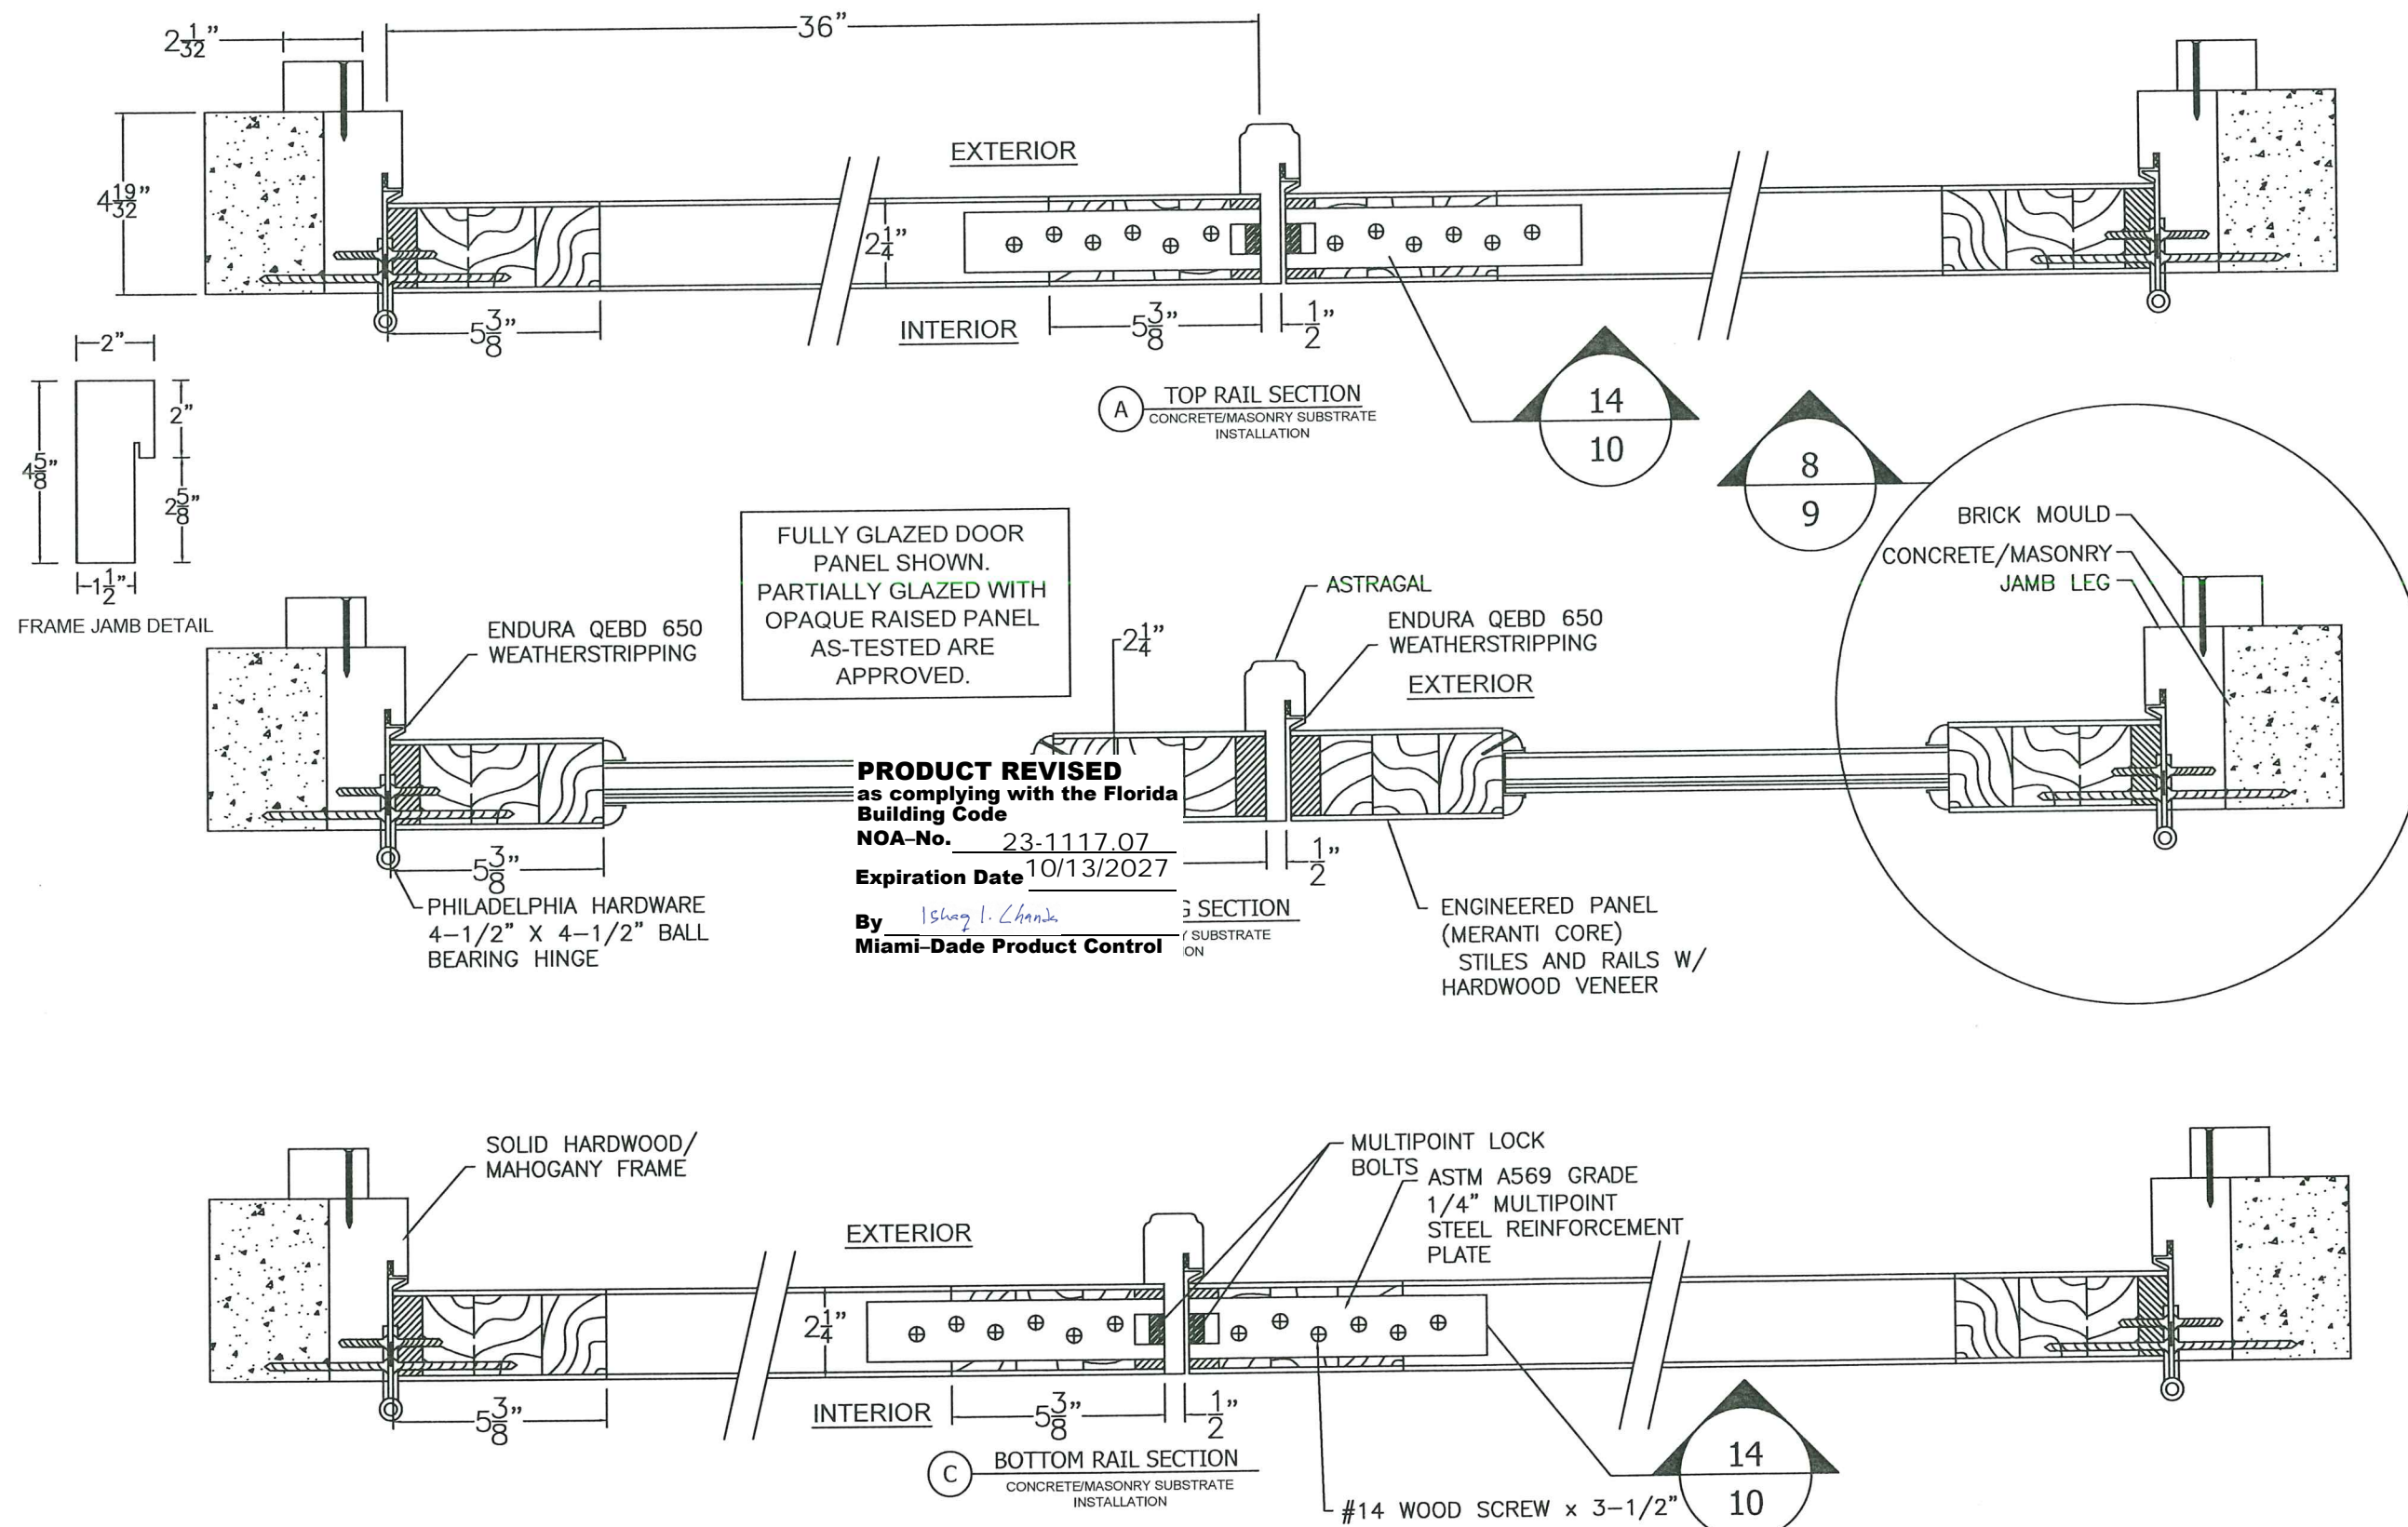

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130.02  
Miami Dade Product Control  
By Khyl L. Llanza

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

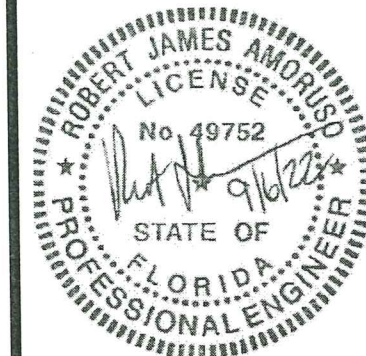

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
SECTIONS - HORIZONTAL - CONCRETE/MASONRY INSTALLATION

**PREPARED BY:**

**PDL**

PDL PRODUCT DESIGN GROUP, LLC  
PO BOX 520715  
LONGWOOD, FLORIDA 32752


Phone: 321.690.1768  
Fax: 321.690.1789  
E-mail: info@pdl-pro.com

A	REVISED FOR MD COMMENTS	9/2/2022	RJA	
REV	DESCRIPTION	DATE	BY	



## X DOOR HORIZONTAL VIEWS

### CONCRETE/MASONRY INSTALLATION

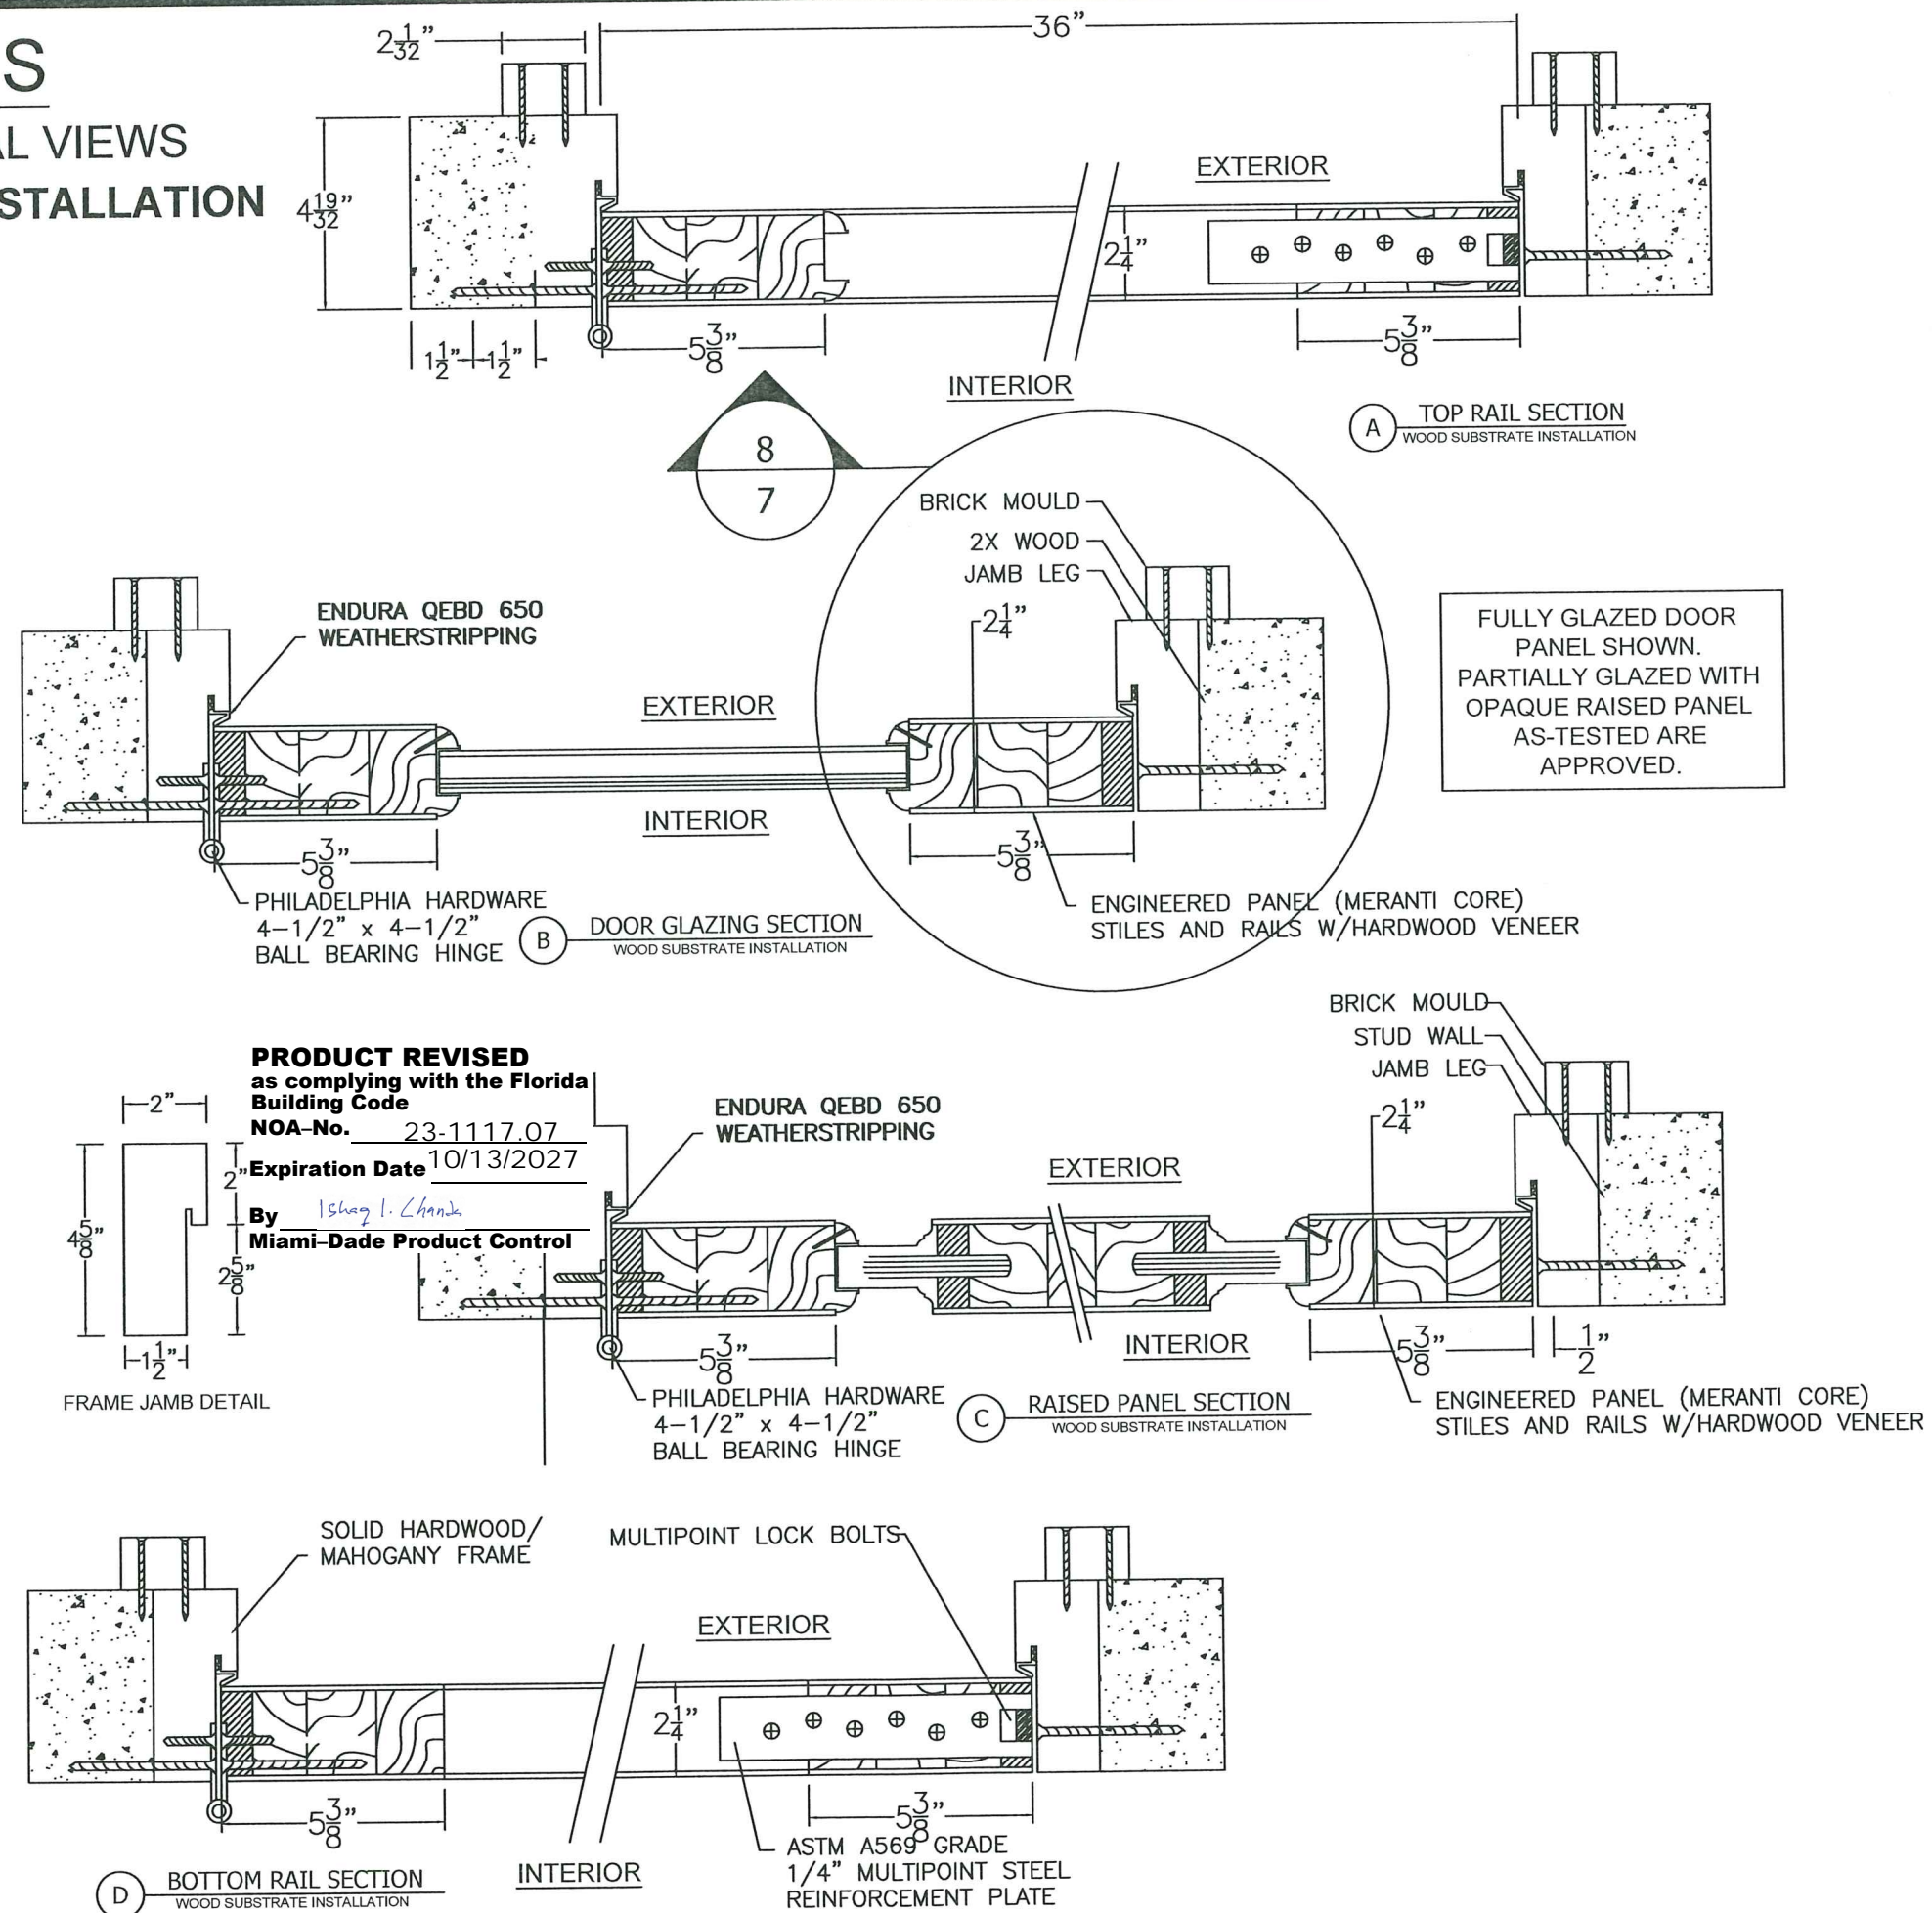

PROJECT #420-0601

**The Door Store of America, Inc.**  
10681 World Trade Blvd  
Raleigh, NC 27617


**TITLE:** Complete Collection, Single and Double Doors, Inswing, Glazed SECTIONS - HORIZONTAL - CONCRETE/MASONRY INSTALLATION

PREPARED BY:		DRAWN BY:	RJA	DATE:	8/3/2022
--------------	---	-----------	-----	-------	----------

**PTC PRODUCT DESIGN GROUP, LLC**  
PO BOX 520775  
LONGWOOD, FLORIDA 32752  
ERPE C.A. NO. 25935  
Phone: 321.690.1788  
Fax: 321.690.1789  
Email: [info@ptc-corp.com](mailto:info@ptc-corp.com)

ed as complying with the  
 Florida Building Code  
 Date 10/13/22  
 NOA# 20-1130-02  
 Miami Dade Product Control  
 By Wesley I. Cheate


Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

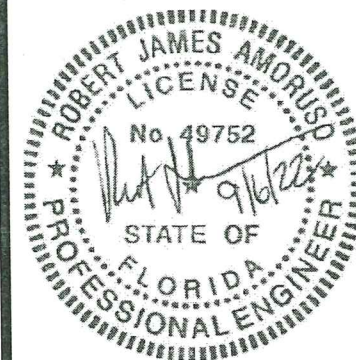




# XX PANEL DETAILS

MULTIPOINT LOCK LAYOUT  
RECTANGULAR PANELS  
SHOWN  
ARCH TOP PANELS SAME  
(SEE SHEETS 15A, 15B &  
15C FOR ADDITIONAL  
DETAILS)

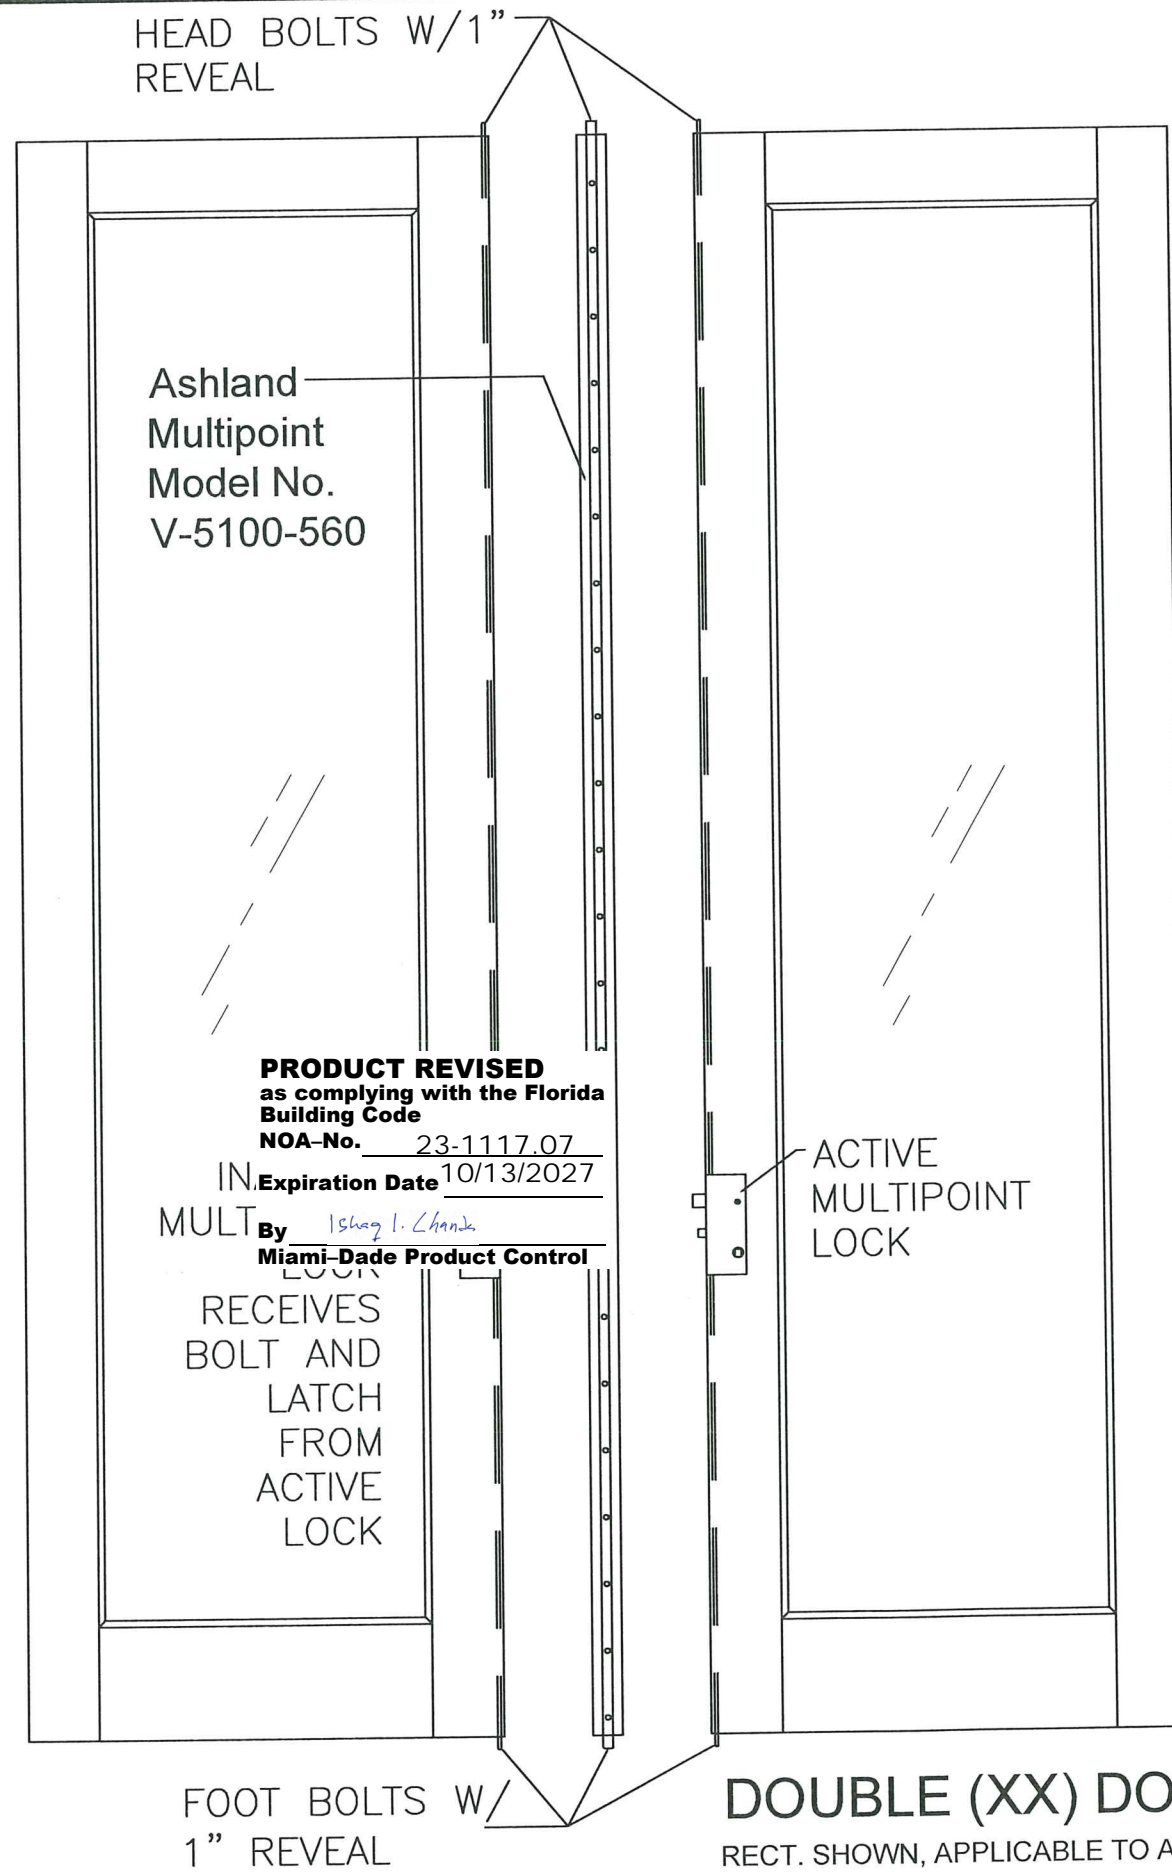

FOOT BOLTS W/  
1" REVEAL

DOUBLE (XX) DOORS  
RECT. SHOWN, APPLICABLE TO ARCH TOP

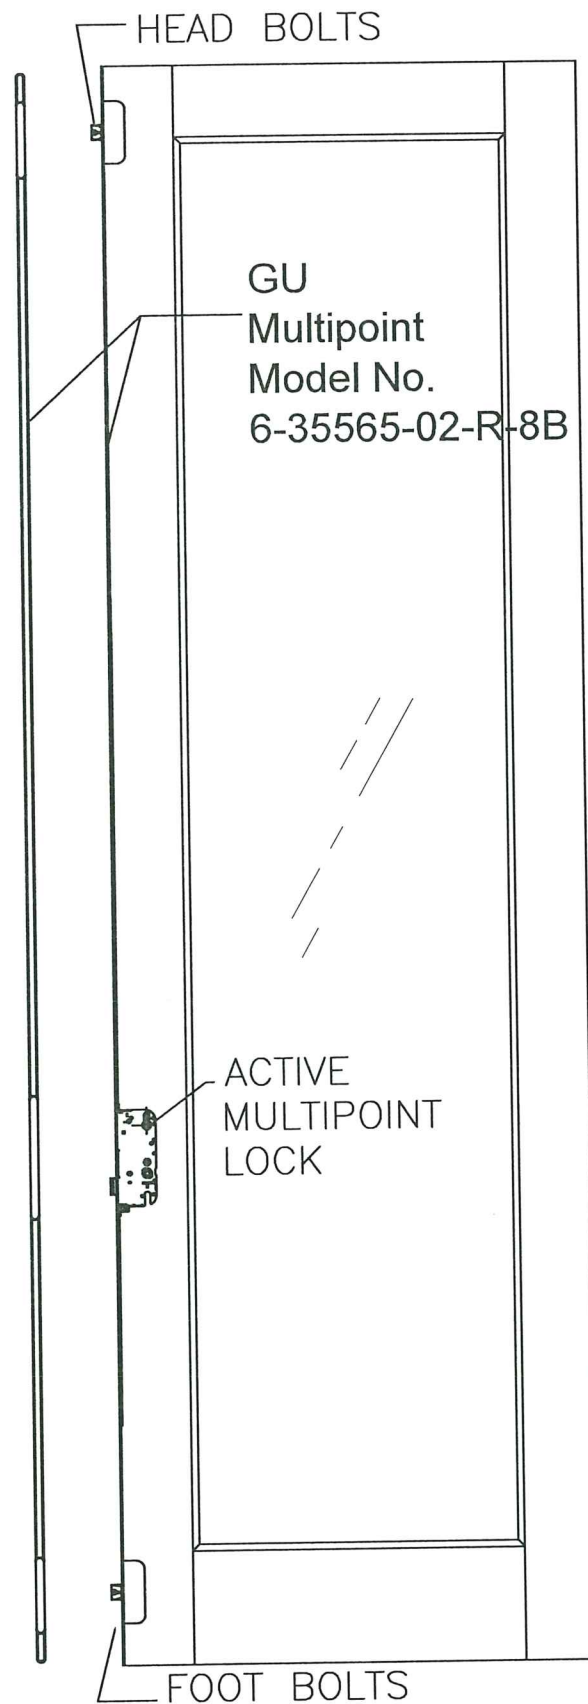


FOOT BOLTS  
SINGLE (X) DOOR  
RECT. SHOWN, APPLICABLE TO ARCH TOP

PROJECT #420-0601					
The Door Store of America, Inc. 10681 World Trade Blvd Raleigh, NC 27617	TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed MULTIPOINT LOCK LAYOUT		DATE: 8/3/2022	REVISED FOR MD COMMENTS	BY: RJA
	DRAWN BY: RJA	SCALE: N.T.S.	DRAWING NO: DSA0008	DESCRIPTION	DATE: 9/2/2022
PREPARED BY: RJA		REV: A	SHEET: 15 OF 19		
PTC PRODUCT DESIGN GROUP, LLC PO BOX 520775 LONGWOOD, FLORIDA 32752 Phone: 321.690.1788 Fax: 321.690.1789 Email: info@ptc-corp.com		FIRE			

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishag I. Chande

Robert J. Amoroso, P.E.  
Florida P.E. No. 49752

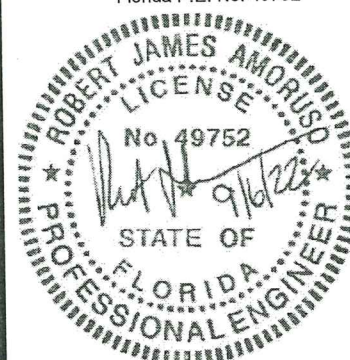




# XX PANEL RECT. & ARCH TOP DETAILS

## ASHLAND MULTIPOINT LOCK LAYOUT

### Ashland Multipoint Model No. V-5100-560

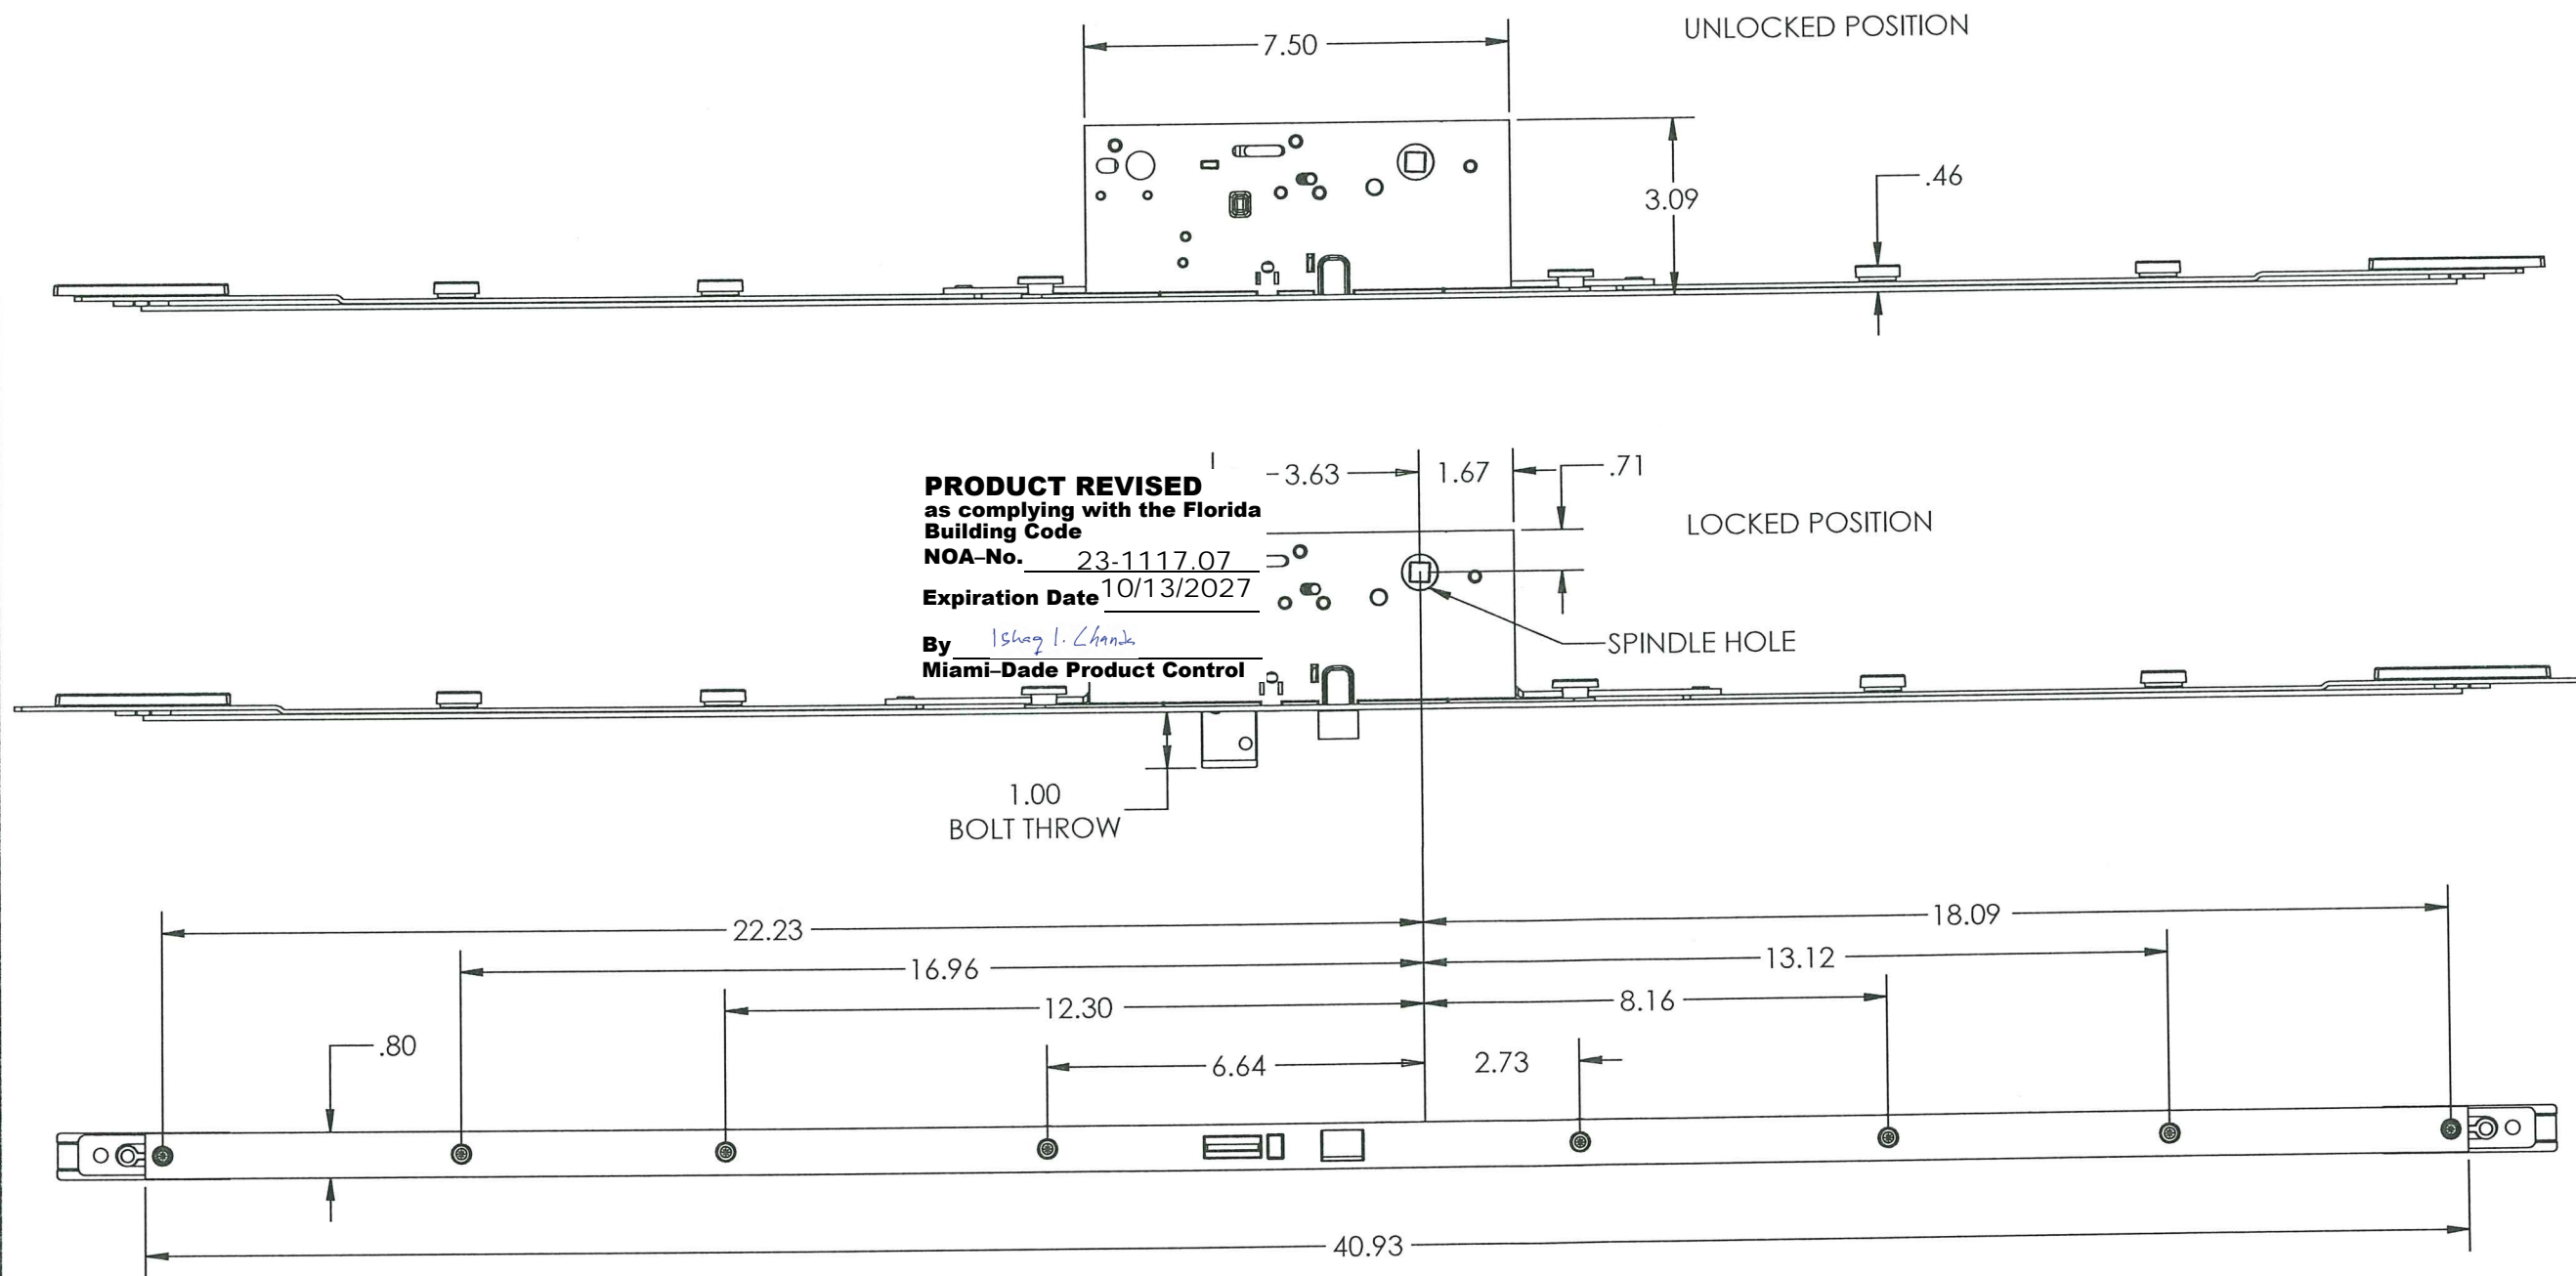

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishay I. Chandra  
Miami-Dade Product Control

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishay I. Chandra


Robert J. Amoroso, P.E.  
Florida P.E. No. 49752  
Professional Engineer  
State of Florida  
License No. 49752  
Date 9/16/22

PROJECT #420-0601		DATE		BY	
		9/2/2022		RJA	
		REVISED FOR MD COMMENTS		A	
		DESCRIPTION		REV	
		15A OF 19			
The Door Store of America, Inc. 10681 World Trade Blvd Raleigh, NC 27617		DATE: 8/3/2022		DRAWING NO: DSA0008	
TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed MULTIPOINT LOCK LAYOUT		DRAWN BY: RJA		SCALE: N.T.S.	
		PREPARED BY: PTC		REV: A	
		PTC PRODUCT DESIGN GROUP, LLC PO BOX 520775 LONGWOOD, FLORIDA 32752 Phone: 321.650.1788 Fax: 321.650.1789 Email: info@ptc-corp.com			



# X PANEL RECT. & ARCH TOP DETAILS

## GU MULTIPOINT LOCK LAYOUT

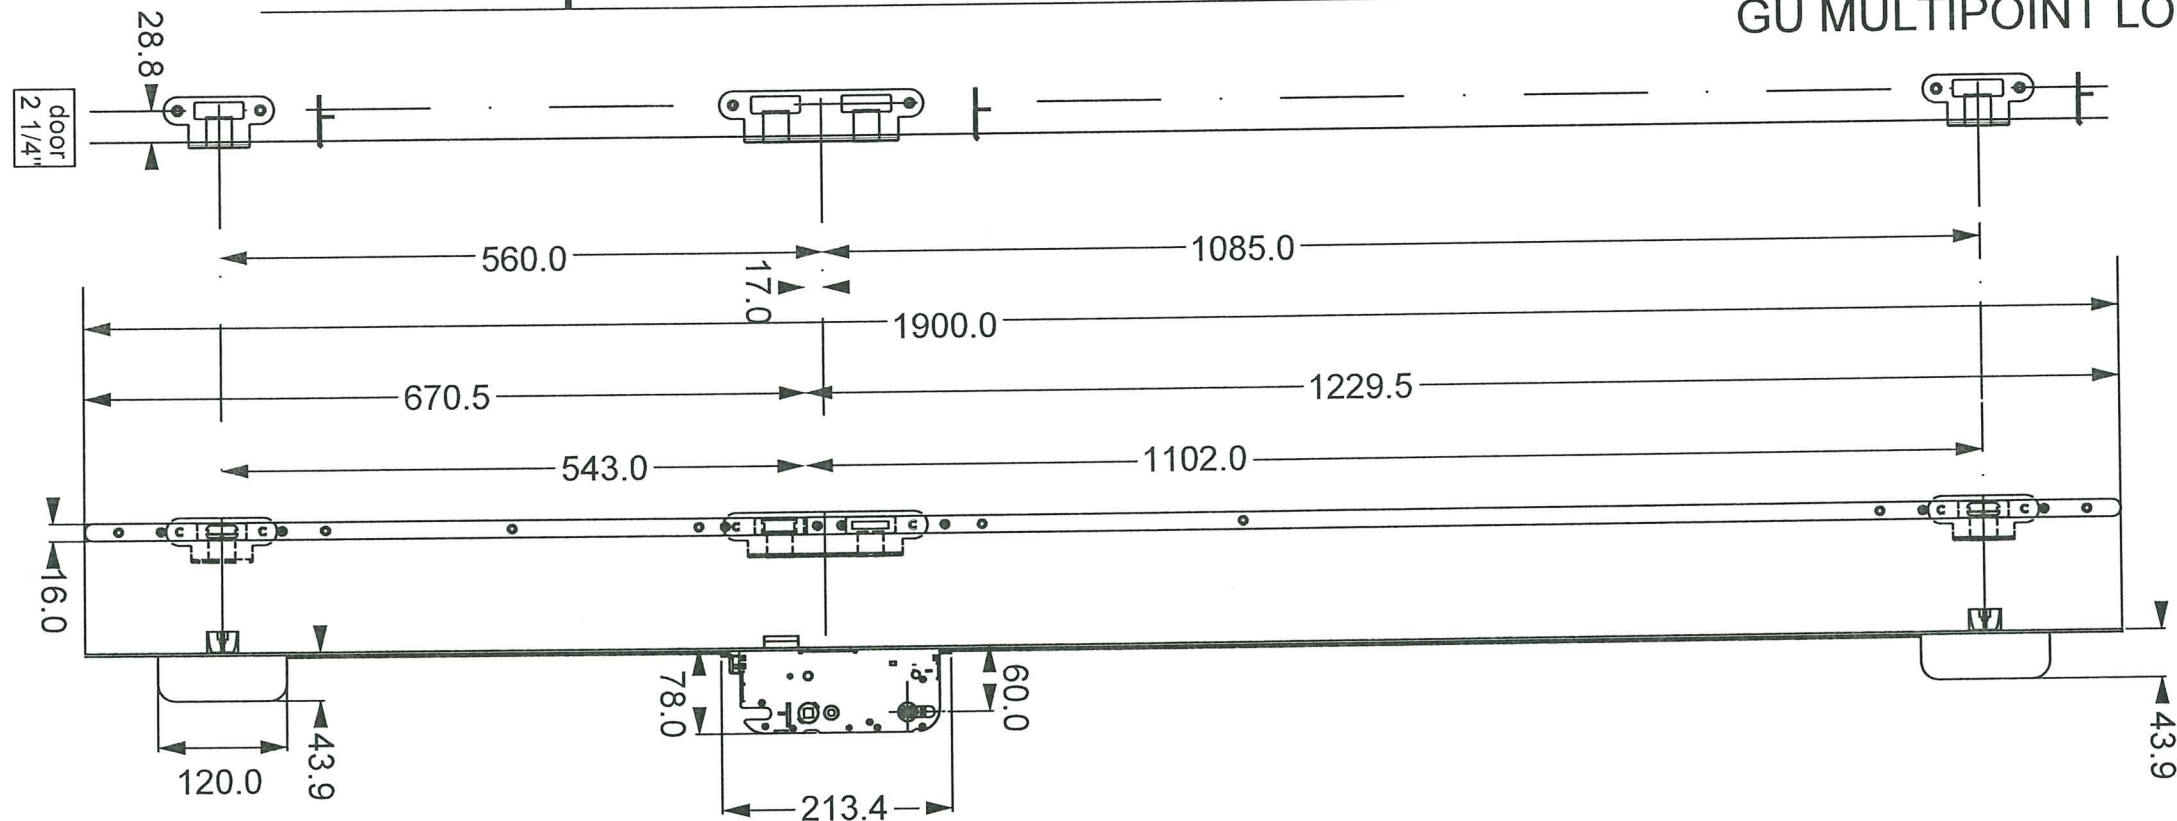

Height of handle by customer (36"-915mm recommended) **PRODUCT REVISED**  
as complying with the Florida  
Building Code


**PRODUCT REVISED**  
as complying with the Florida  
Building Code

**NOA-No.** 23-1117.07

**Expiration Date** 10/13/2027

By Ishaq I. /bank

**- Miami-Dade Product Control**

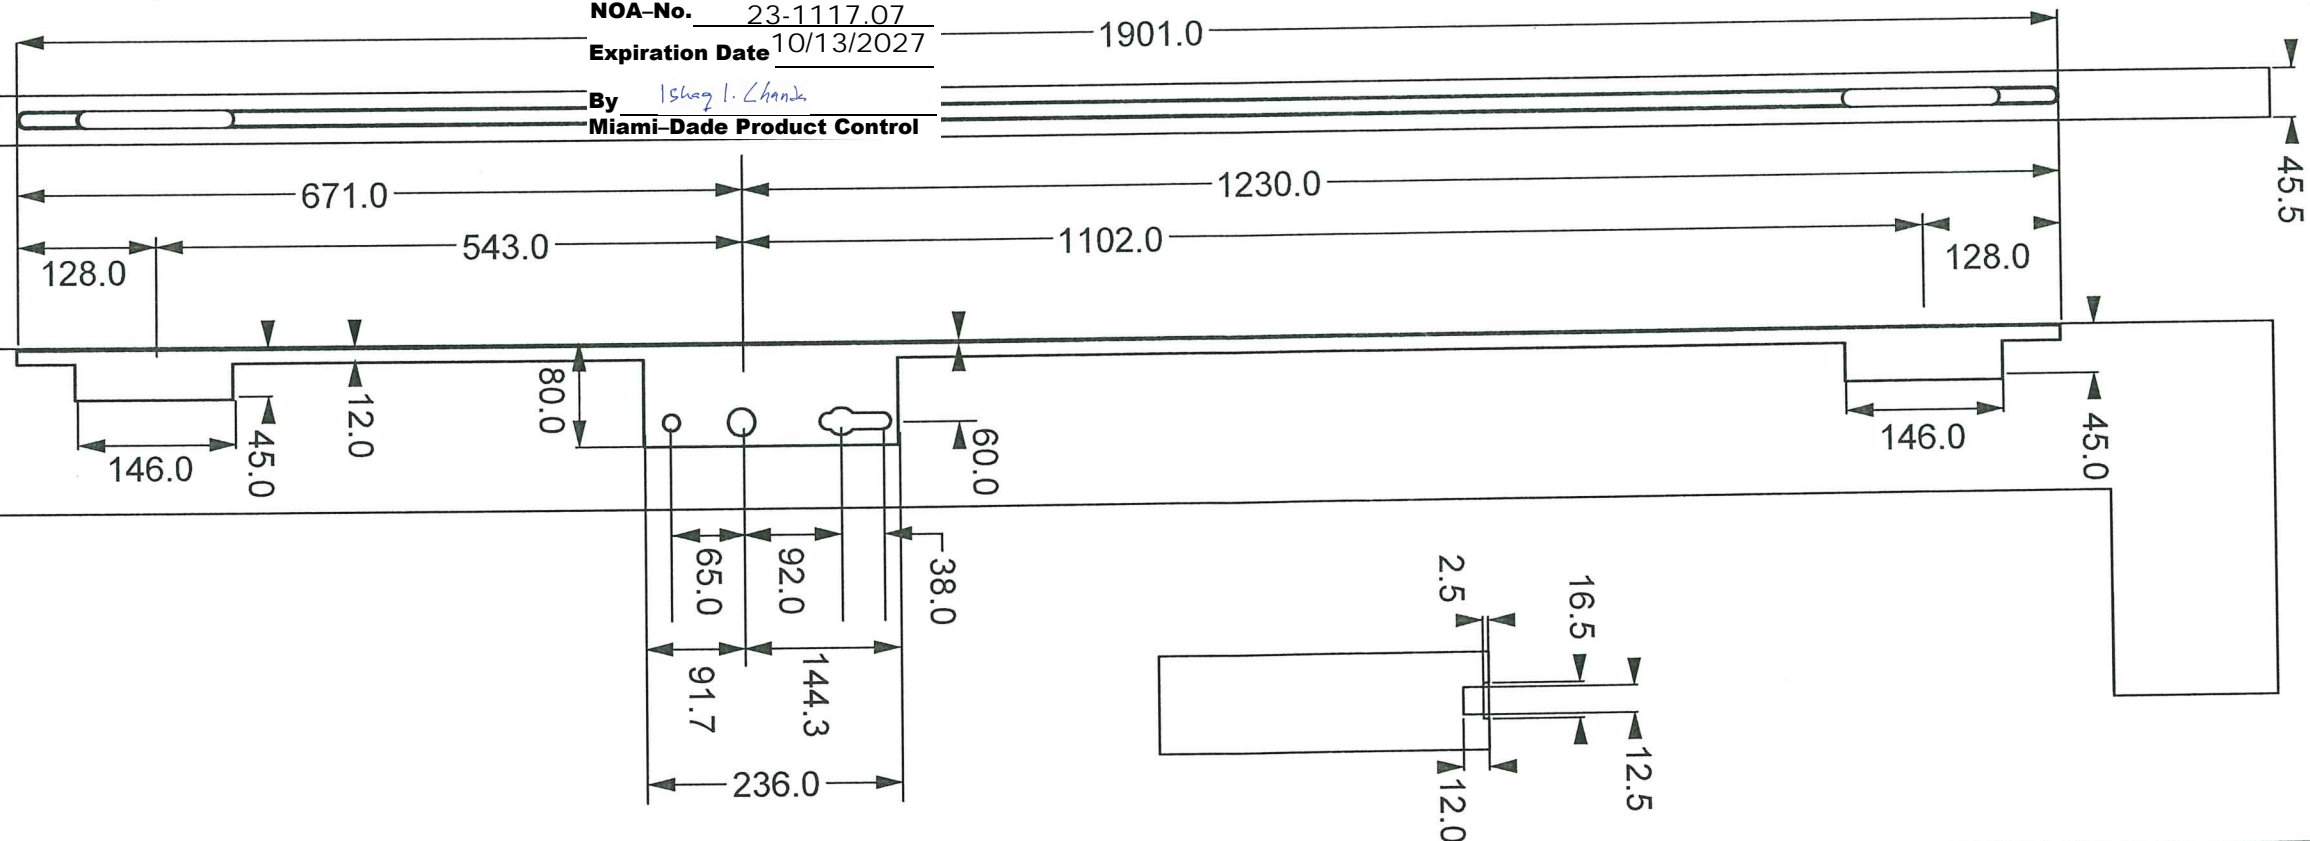



Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control

By Ishay I. Gander


Robert J. Amoruso, P.E.  
Florida P.E. No. 49752





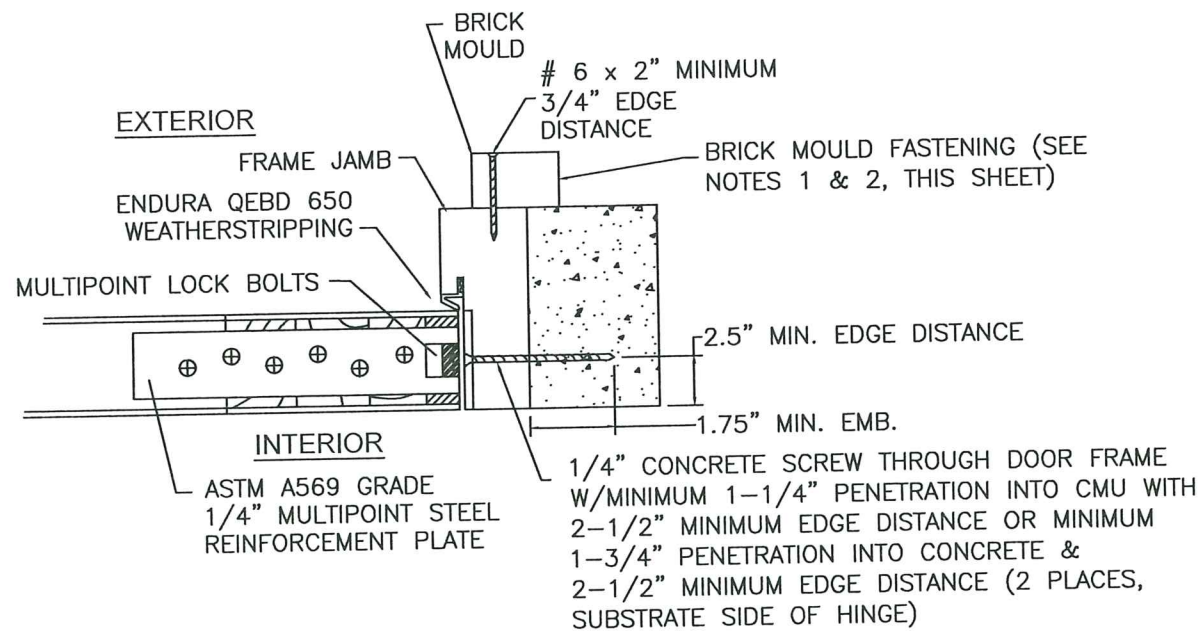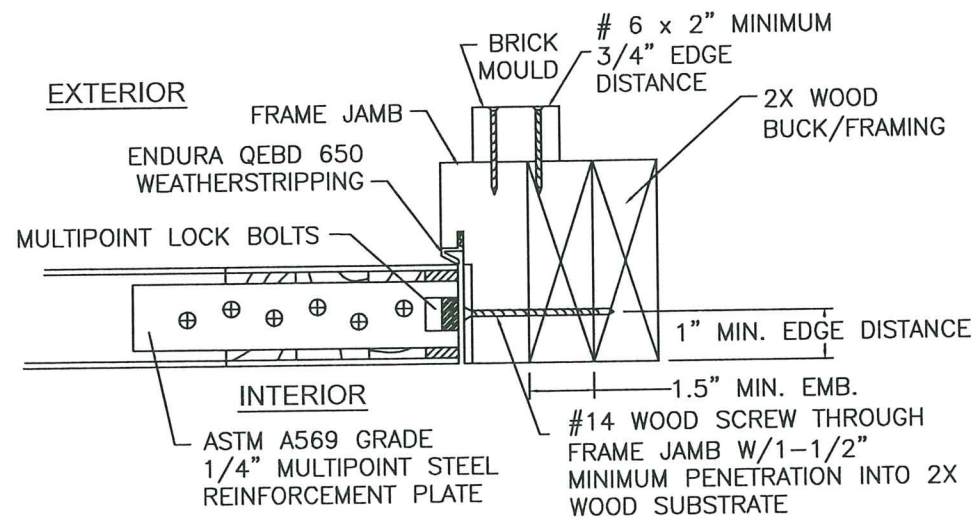

MULTIPOINT HEAD & FOOT BOLTS ENGAGE INTO PLATE

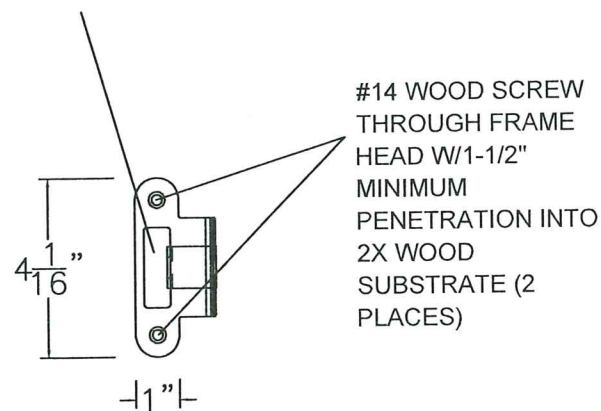


#14 WOOD SCREW THROUGH FRAME HEAD W/1-1/2\"/>

- NOTES:
1. BRICK MOULD INSTALLATION SHALL USE NO. 6 WOOD SCREW X 2\"/>


**PRODUCT REVISED**  
as complying with the Florida Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027

By Ishay I. Chandra  
**Miami-Dade Product Control**  
FRAME HEAD W/1-1/2\"/>

MULTIPOINT LOCK BOLTS ENGAGE INTO PLATE

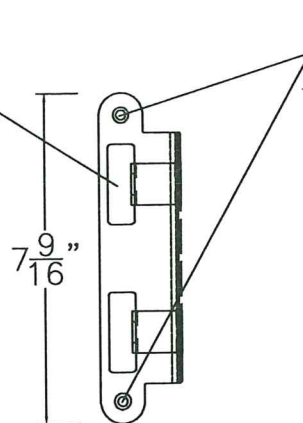


MULTIPOINT HEAD & FOOT BOLTS ENGAGE INTO PLATE

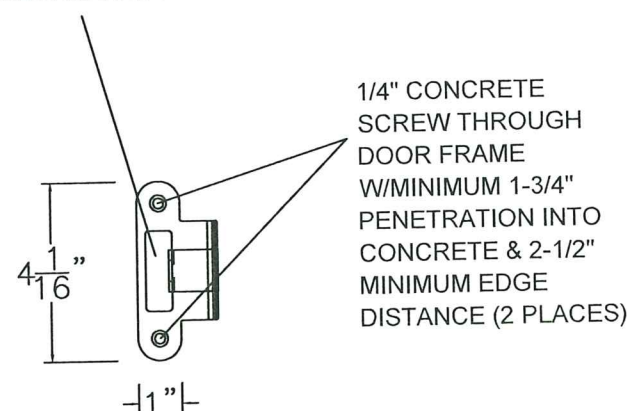

1/4\"/>

MULTIPOINT LOCK BOLTS ENGAGE INTO PLATE

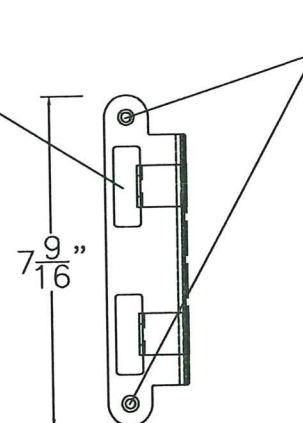

1/4\"/>

## X PANEL RECT. & ARCH TOP DETAILS GU MULTIPOINT LOCK INSTALLATION

Strike Plate Detail in Wood

Strike Plate Detail in Concrete

Strike Plate Details for GU Multipoint Strike Plates at Lock Set  
and Head/Foot Bolts

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
MULTIPOINT LOCK LAYOUT

PREPARED BY: RJA  
DRAWN BY: RJA  
SCALE: N.T.S.  
REV: A

DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 15C OF 19

PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520775  
LONGWOOD, FLORIDA 32752  
Phone: 321.660.1788  
Fax: 321.660.1789  
Email: info@ptc-corp.com

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami-Dade Product Control  
By Ishay I. Chandra



Robert J. Amoruso, P.E.  
Florida P.E. No. 49752





# PANEL CONSTRUCTION DETAIL (X & XX)

XX & X RECTANGULAR PANEL CONSTRUCTION (XX ARCH TOP PANEL SIMILAR) - DOWEL LOCATION  
X ARCH TOP PANEL CONSTRUCTION - DOWEL LOCATION

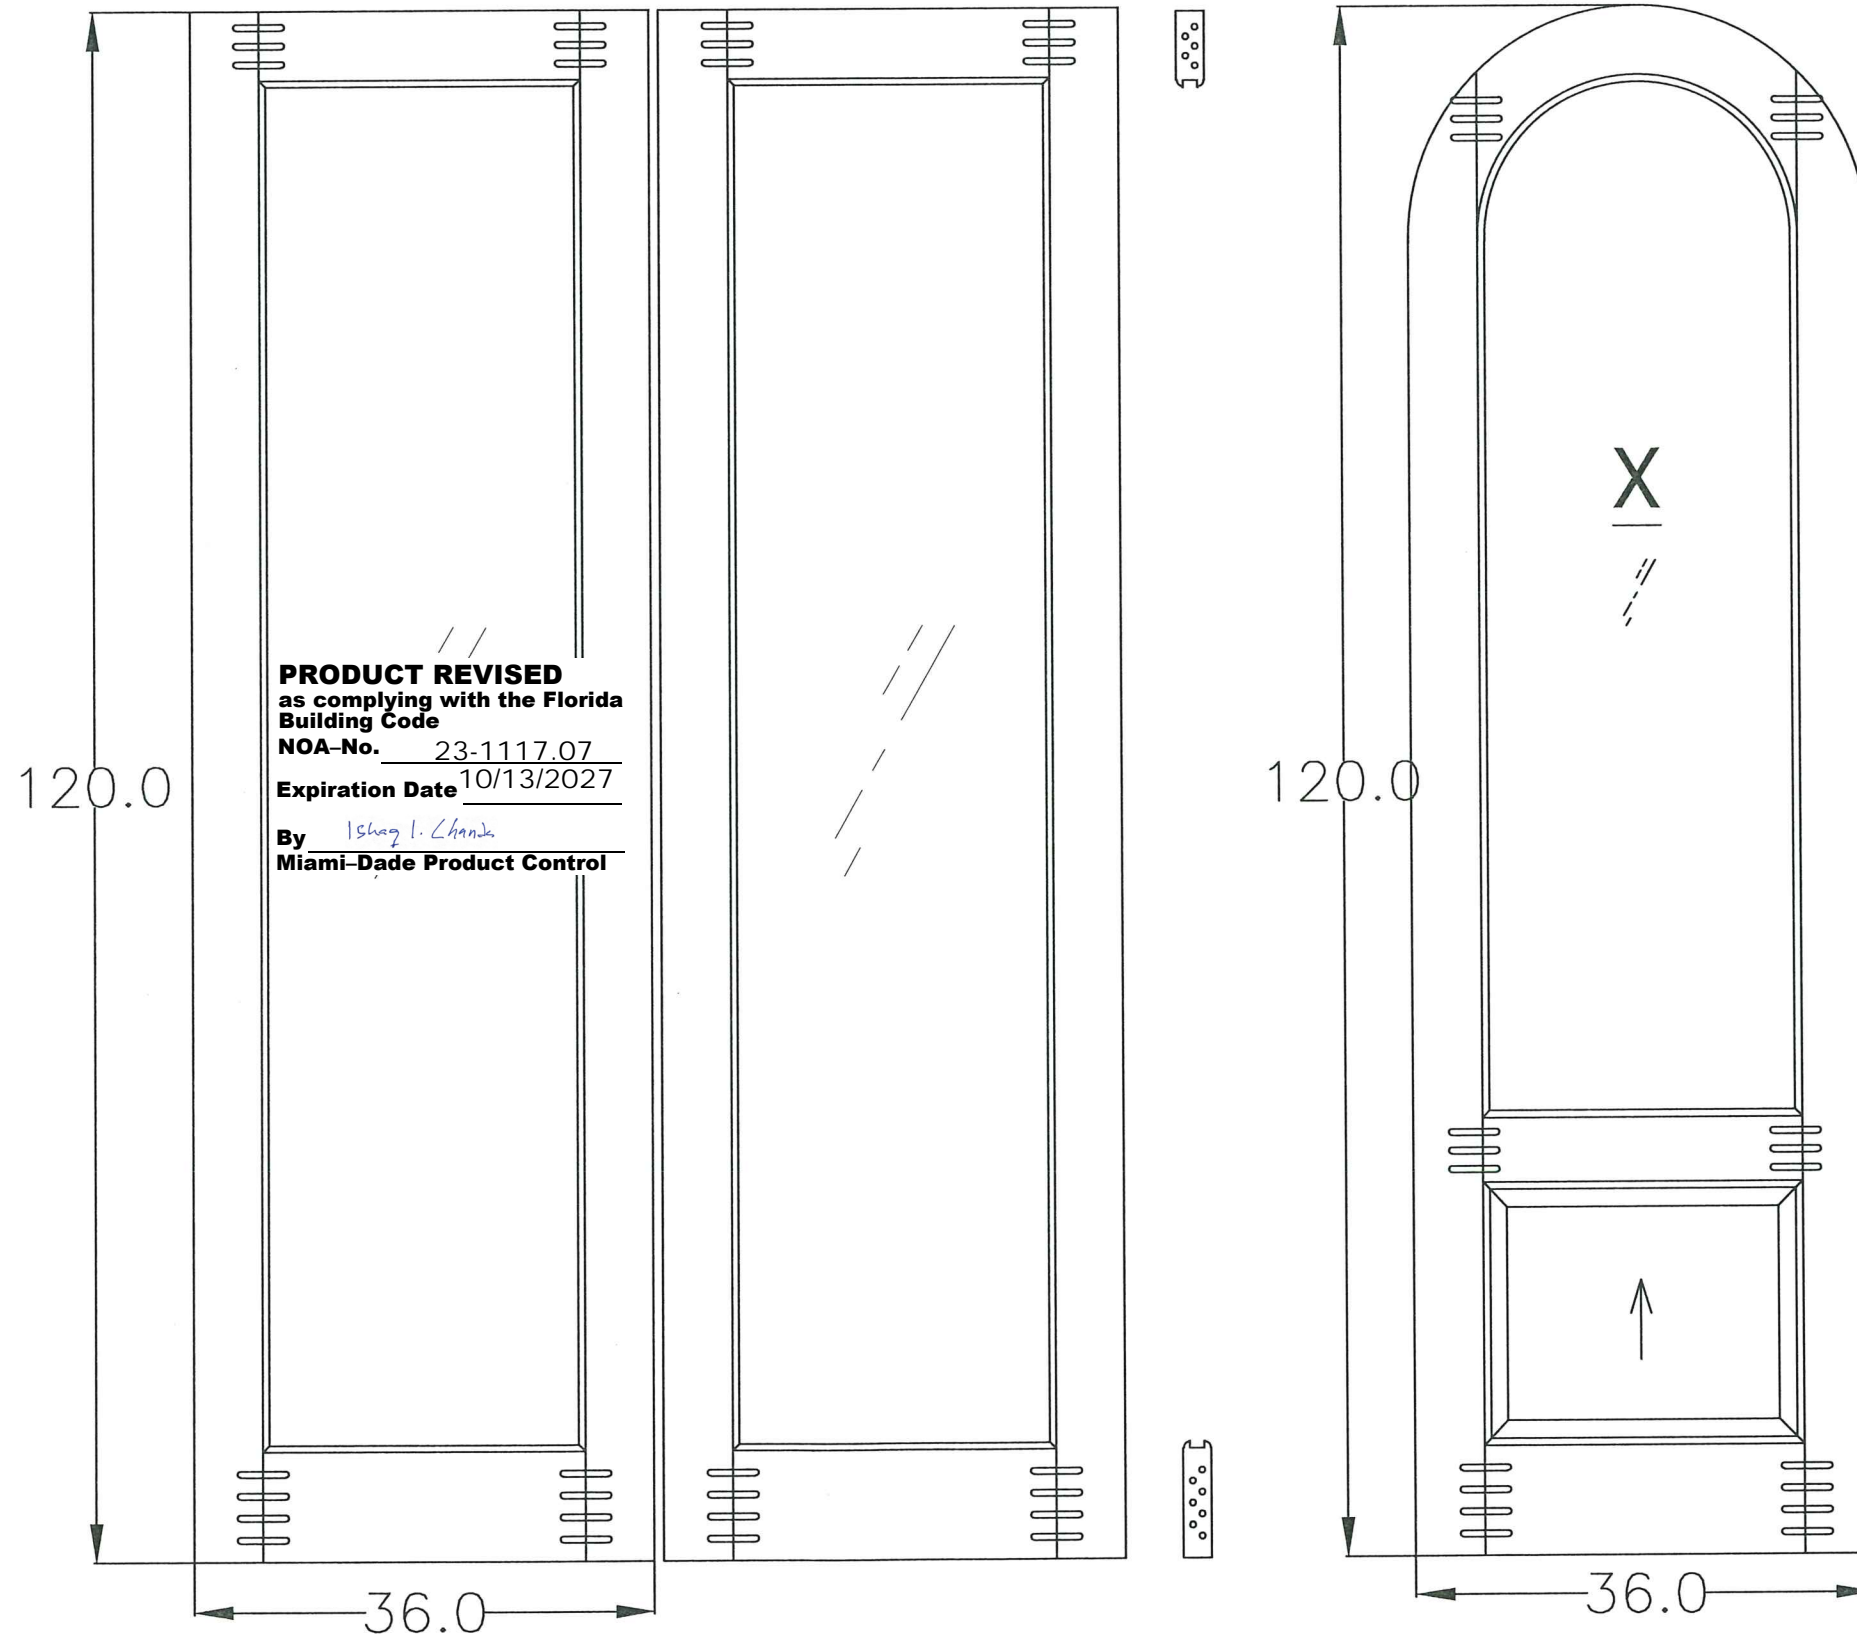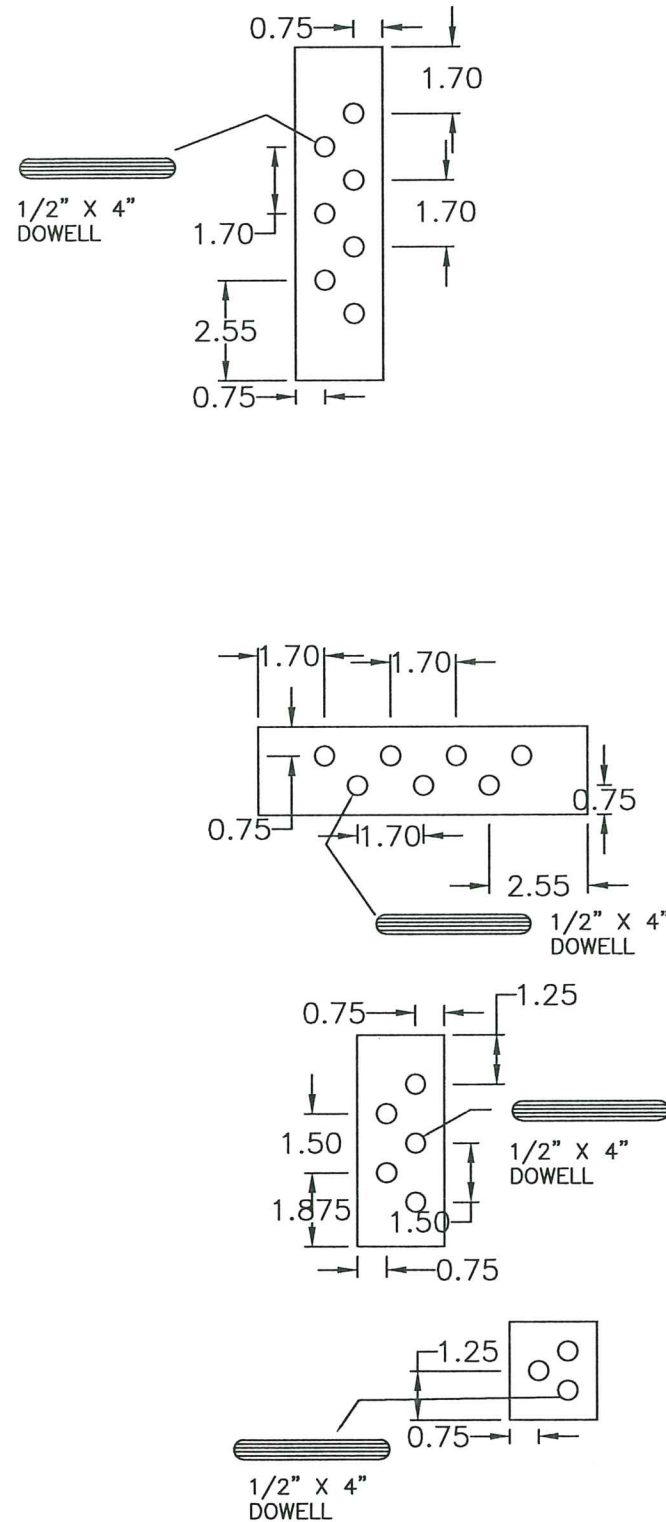

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
PANEL CONSTRUCTION - MULTIPOINT LOCK DETAIL


DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 16 OF 19

DRAWN BY: RJA  
SCALE: N.T.S.  
REV: A

PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520715  
LONGWOOD, FLORIDA 32752  
Phone: 321.690.1788  
Fax: 321.690.1789  
Email: info@ptc-corp.com

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 23-1130.02  
Miami Dade Product Control  
By Ishay I. Chanin


Robert J. Amoroso, P.E.  
Florida P.E. No. 49752

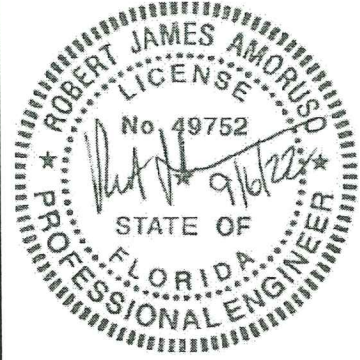



# APPROVED CONFIGURATIONS


MAXIMUM FRAME, DOOR PANEL AND DLO SIZES SHOWN ON SHEETS 2, 2A, 2B, 2C AND 2D MUST BE MET.

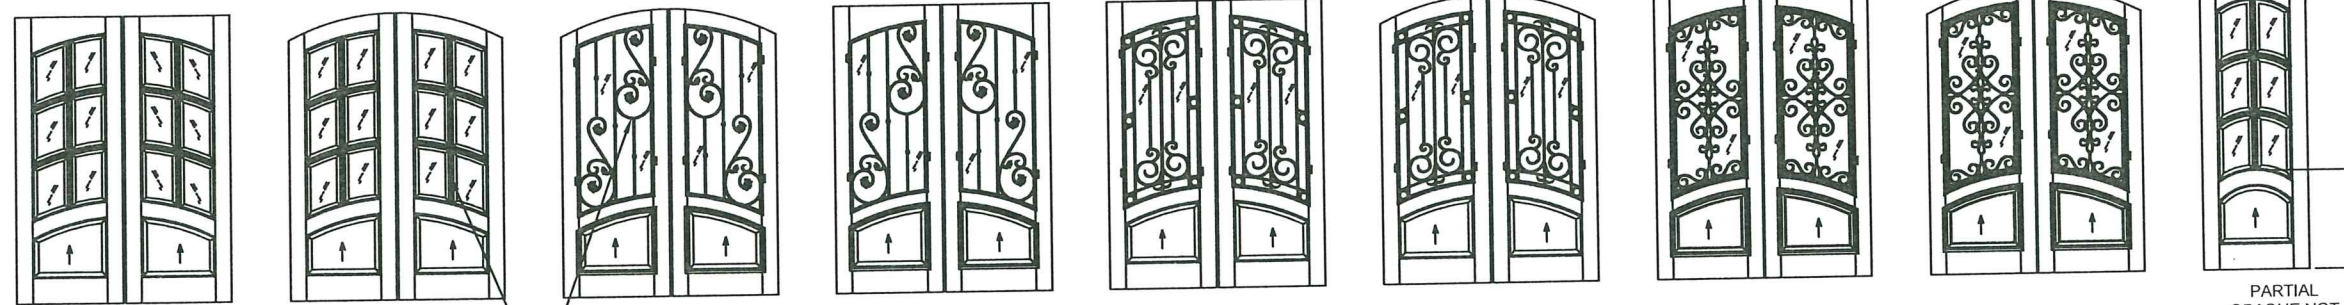

Aberdeen

SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES


PARTIAL  
OPAQUE NOT  
TO EXCEED  
TESTED SIZE  
(TYP. ALL  
PLACES)

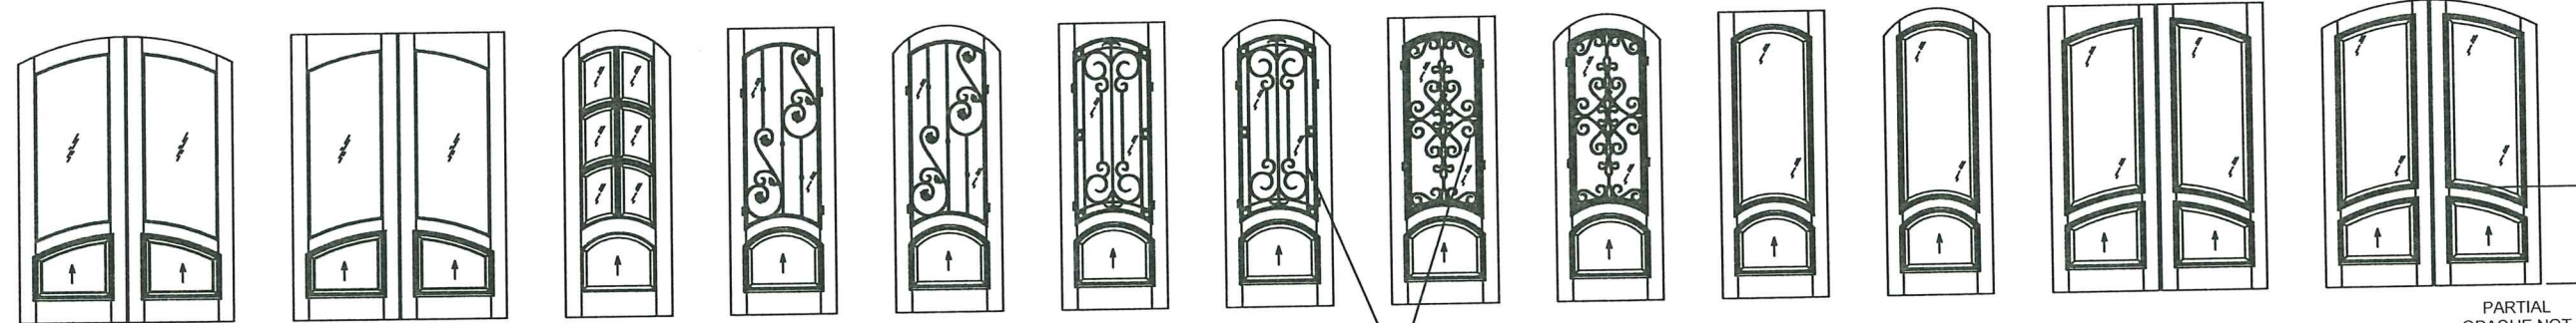

Alexandria

SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES

PARTIAL  
OPAQUE NOT  
TO EXCEED  
TESTED SIZE  
(TYP. ALL  
PLACES)

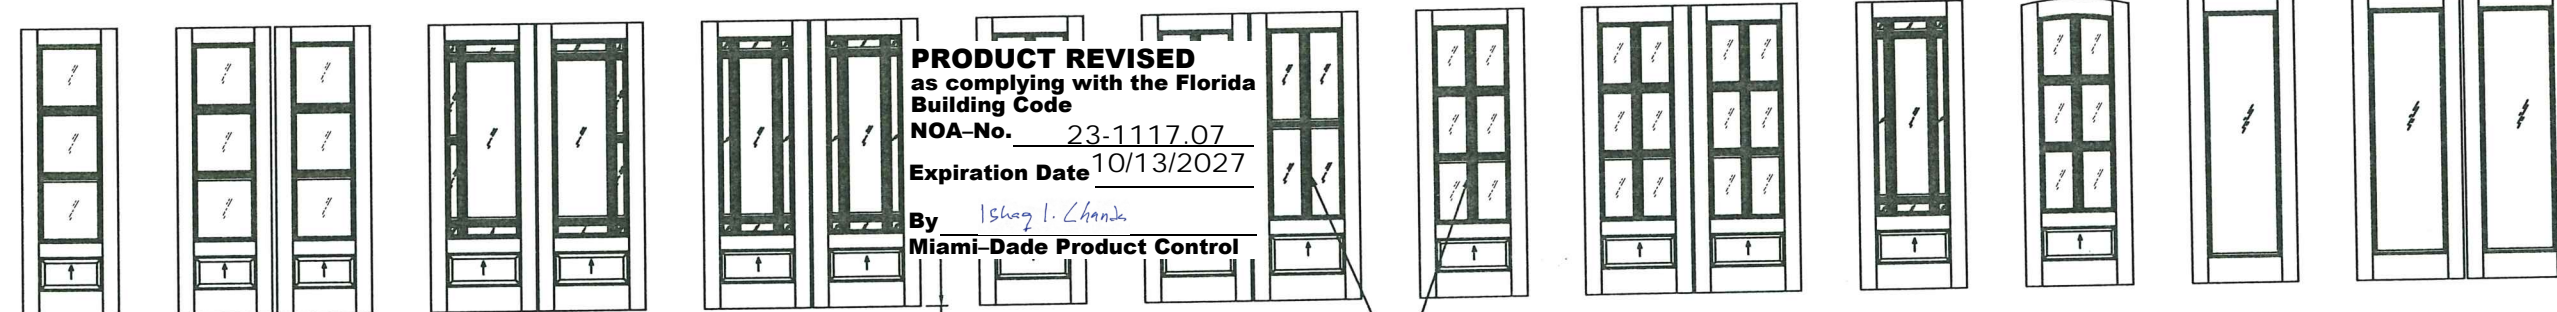



Alexandria

PARTIAL  
OPAQUE NOT  
TO EXCEED  
TESTED SIZE  
(TYP. ALL  
PLACES)

SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES


**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027

By Ishag I. Chande  
**Miami-Dade Product Control**  
(TYP. ALL  
PLACES)

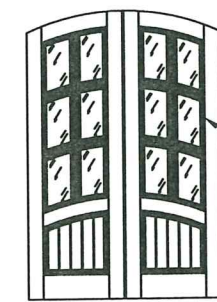

Keowee

SURFACE APPLIED FALSE  
MUNTINS TYPICAL ALL  
PLACES



Ocone



Brentwood

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
APPROVED CONFIGURATIONS

DATE:	8/3/2022	REVISION:	9/2/2022	BY:	RJA
DRAWN BY:	RJA	REVISION:	9/2/2022	BY:	RJA
SCALE:	N.T.S.	REVISION:	9/2/2022	BY:	RJA
REV:	A	REVISION:	9/2/2022	BY:	RJA
SHEET:	17 OF 19	REVISION:	9/2/2022	BY:	RJA

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control  
By Ishag I. Chande


Robert J. Amoroso, P.E.  
Florida P.E. No. 49752





# APPROVED CONFIGURATIONS


MAXIMUM FRAME, DOOR PANEL AND DLO SIZES SHOWN ON SHEETS 2, 2A, 2B, 2C AND 2D MUST BE MET.

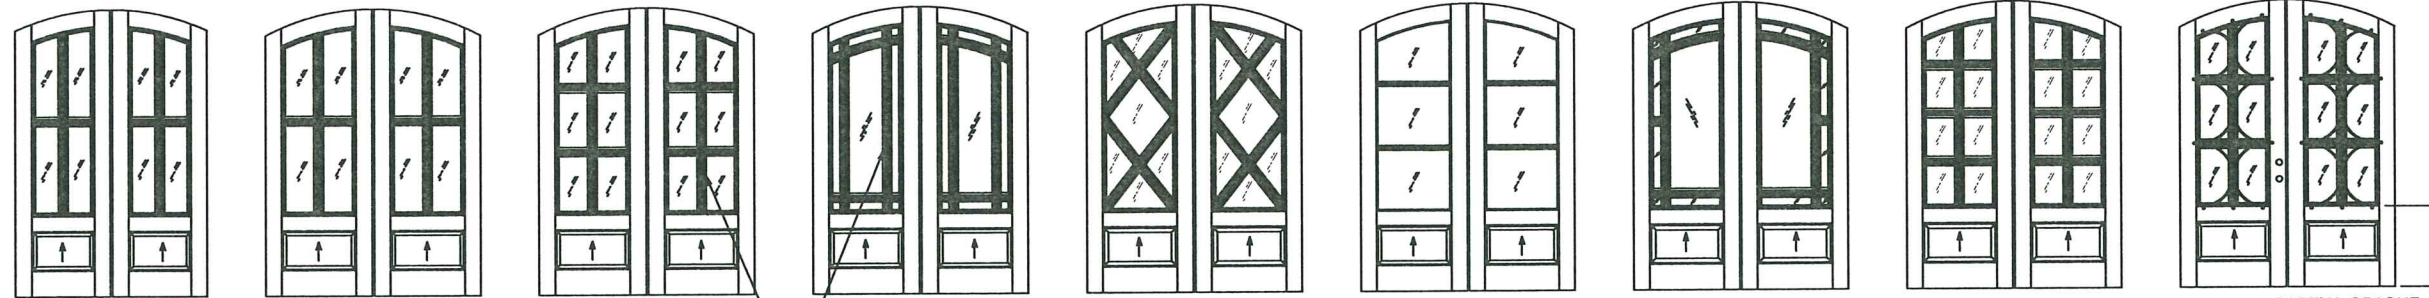

Tiffany


SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES

PARTIAL OPAQUE  
NOT TO EXCEED  
TESTED SIZE  
(TYP. ALL PLACES)

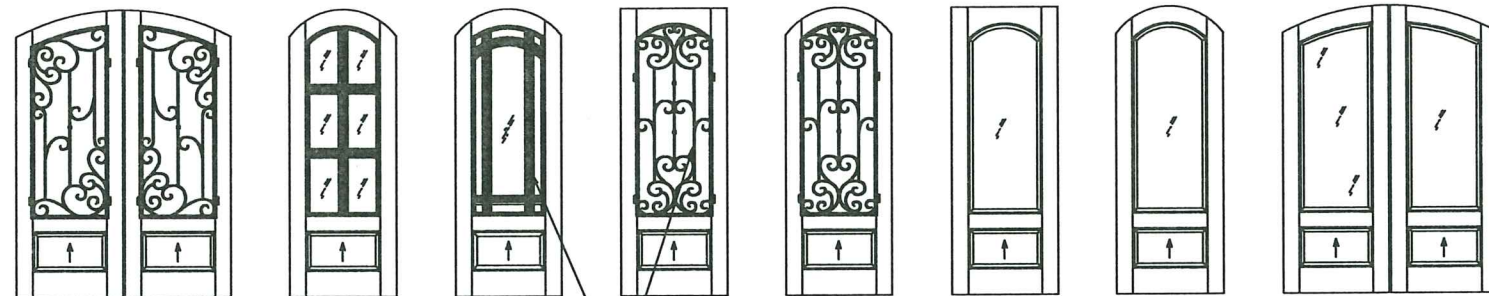

SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES

PARTIAL OPAQUE  
NOT TO EXCEED  
TESTED SIZE (TYP.  
ALL PLACES)

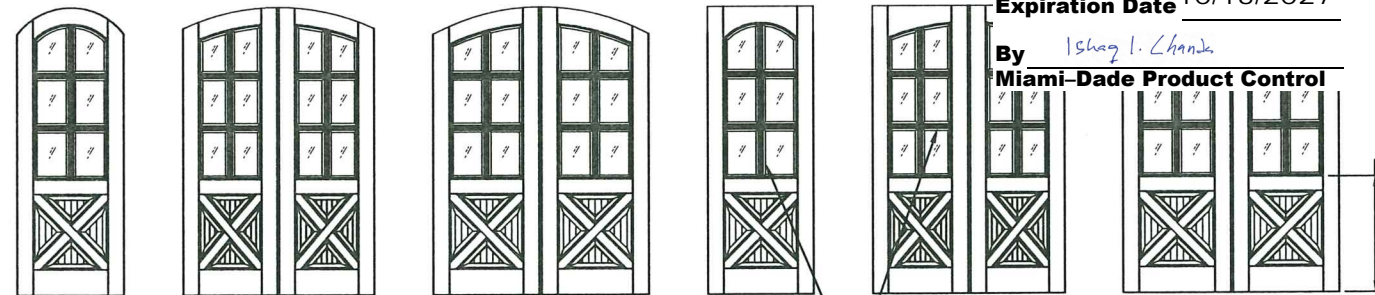

SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES

Havasu

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027

By Ismael I. Chanle  
Miami-Dade Product Control

PARTIAL  
OPAQUE NOT  
TO EXCEED  
TESTED SIZE  
(TYP. ALL  
PLACES)

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
APPROVED CONFIGURATIONS

PREPARED BY: **PTC**  
PTC PRODUCT DESIGN GROUP, LLC  
PO BOX 520775  
LONGWOOD, FLORIDA 32752  
PHONE: 321.690.1788  
FAX: 321.690.1789  
EMAIL: info@ptc-corp.com

DRAWN BY: RJA  
SCALE: N.T.S.  
REV: A  
DATE: 8/3/2022  
DRAWING NO: DSA0008  
SHEET: 18 OF 19

REVISED FOR MD COMMENTS  
A  
REV  
DESCRIPTION  
DATE  
9/2/2022  
RJA  
BY

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130-02  
Miami Dade Product Control

By Ismael I. Chanle


Robert J. Amoroso, P.E.  
Florida P.E. No. 49752






## APPROVED CONFIGURATIONS


MAXIMUM FRAME, DOOR PANEL AND DLO SIZES SHOWN ON SHEETS 2, 2A, 2B, 2C AND 2D MUST BE MET.

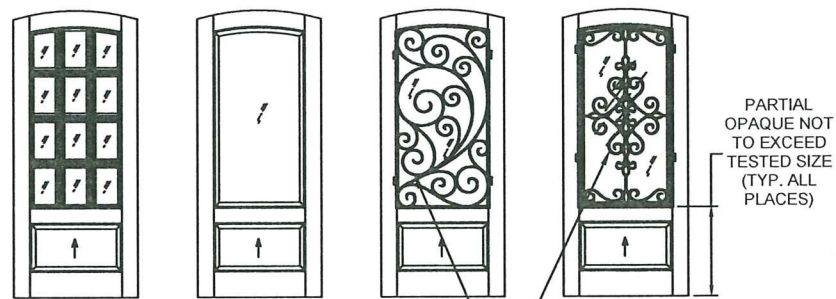


Trinity

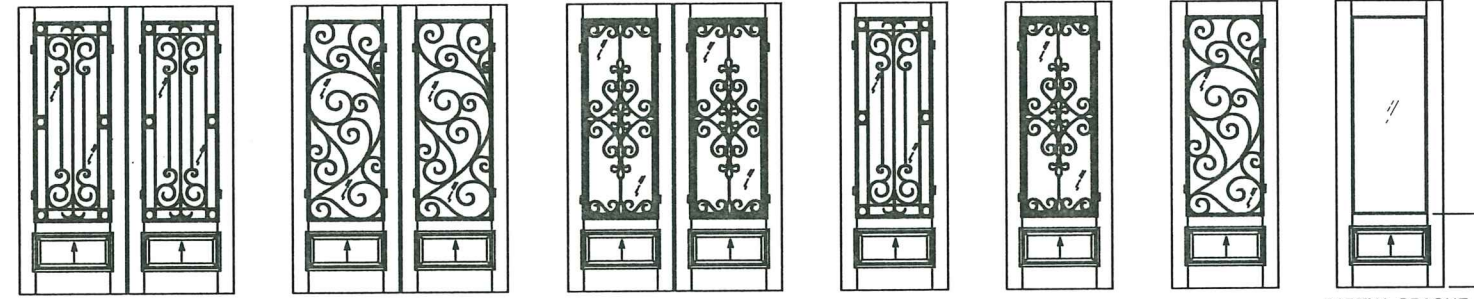

Wakefield

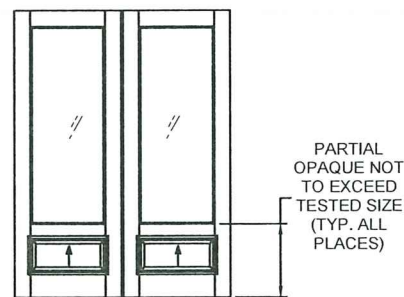

Madison Seville

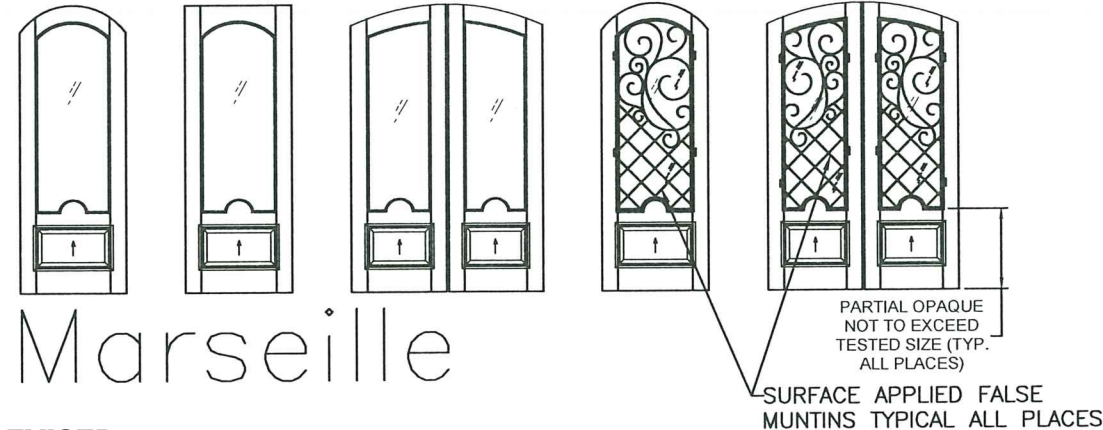

# Marseille

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishaq I. Chande  
Miami-Dade Product Control

**PRODUCT REVISED**  
as complying with the Florida  
Building Code  
NOA-No. 23-1117.07  
Expiration Date 10/13/2027  
By Ishaq I. Chande  
Miami-Dade Product Control

By Ishag I. Chande  
Miami-Dade Product

**Miami-Dade Product Control**

✓ SURFACE APPLIED FALSE MUNTINS TYPICAL ALL PLACES

PROJECT #420-0601

The Door Store of America, Inc.  
10681 World Trade Blvd  
Raleigh, NC 27617

TITLE: Complete Collection, Single and Double Doors, Inswing, Glazed  
APPROVED CONFIGURATIONS

DATE: 8/3/2022

DRAWING NO: DSA0008

SHEET: 19 OF 19

DRAWN BY:  
RJA

SCALE: N T S

REV: A

1



Phone: 321.690.1788  
Fax: 321.690.1789  
Email: [info@ptc-corp.com](mailto:info@ptc-corp.com)

Approved as complying with the  
Florida Building Code  
Date 10/13/22  
NOA# 20-1130.02  
Miami Dade Product Control

By Ismael I. Chandra

Robert J. Amoruso, P.E.  
Florida P.E. No. 49752

