



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Air Vent, Inc.
4117 Pinnacle Point Drive
Dallas, TX. 75212

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Airhawk SLP150 Slant Back Roof Vent

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA renews and revises NOA# 22-1223.06 and consists of pages 1 through 5.
The submitted documentation was reviewed by Alex Tigera.

03/14/24



NOA No.: 24-0220.01
Expiration Date: 03/21/29
Approval Date: 03/14/24
Page 1 of 5

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Ventilation
Materials: Plastic
Maximum Design Pressure N/A
Fire Classification: N/A

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

| <u>Product</u> | <u>Dimensions</u> | <u>Test Specification</u> | <u>Product Description</u> |
|-------------------------------------|---------------------------|----------------------------------|---|
| Airhawk SLP150 Slant Back Roof Vent | See detail drawing herein | TAS 100 | High density polypropylene low profile attic ridge vent for installation in asphalt shingle roof systems. |

MANUFACTURING LOCATION

1. ML-5

EVIDENCE SUBMITTED:

| <u>Test Agency/Identifier</u> | <u>Name</u> | <u>Report</u> | <u>Date</u> |
|---|----------------------------------|-------------------------------|--------------------|
| Architectural Testing, Inc. | TAS 100A(95) Wind Driven Rain | B8510.01-801-18 Revision 2 | 02/18/13 |
| PRI Construction Materials Technologies | ASTM G 155/D 638 | 122T0003 | 01/31/24 |
| | ASTM G 1929 | 122T0003 | 01/31/24 |
| | ASTM D 635 | 122T0003 | 01/31/24 |



NOA No.: 24-0220.01
Expiration Date: 03/21/29
Approval Date: 03/14/24
Page 2 of 5

APPROVED APPLICATIONS:

Tradename: Airhawk SLP150 Slant Back Roof Vent

System Type: Mechanical attachment of static vent over asphalt shingle roof systems.

Cutout: Cut a minimum 13" x 13" square opening at a location no greater than 2 feet below the ridgeline.

Installation: Place ridge vent section centered over the cutout. Fasten the SLP 150 with 11 smooth shank nails. Nails shall be minimum 0.375" head diameter x 0.122" shank diameter x 1.080" long. Nails shall be positioned as follows (See details herein):

One nail at each corner (total of 4)

One nail at center point along leading edge (total of 1)

Two nails at side and trailing edge positioned in thirds. (total of 6)

Apply roofing sealant over all nail heads. Replace shingles over the trailing edge of the vent flange. Vents should be shingled down to side flange ribbing only.

Net Free Area: Refer to manufacturers published literature.


Minimum Slope: 3:12


LIMITATIONS:

1. Refer to applicable building codes for required ventilation.
2. Vents shall not be installed on roof mean heights greater than 33 feet.
3. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule **61G20-3** of the Florida Administrative Code.
4. All products or packaging shall bear the imprint or identifiable marking of the manufacturer's name or logo and the following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below:




DETAIL DRAWINGS

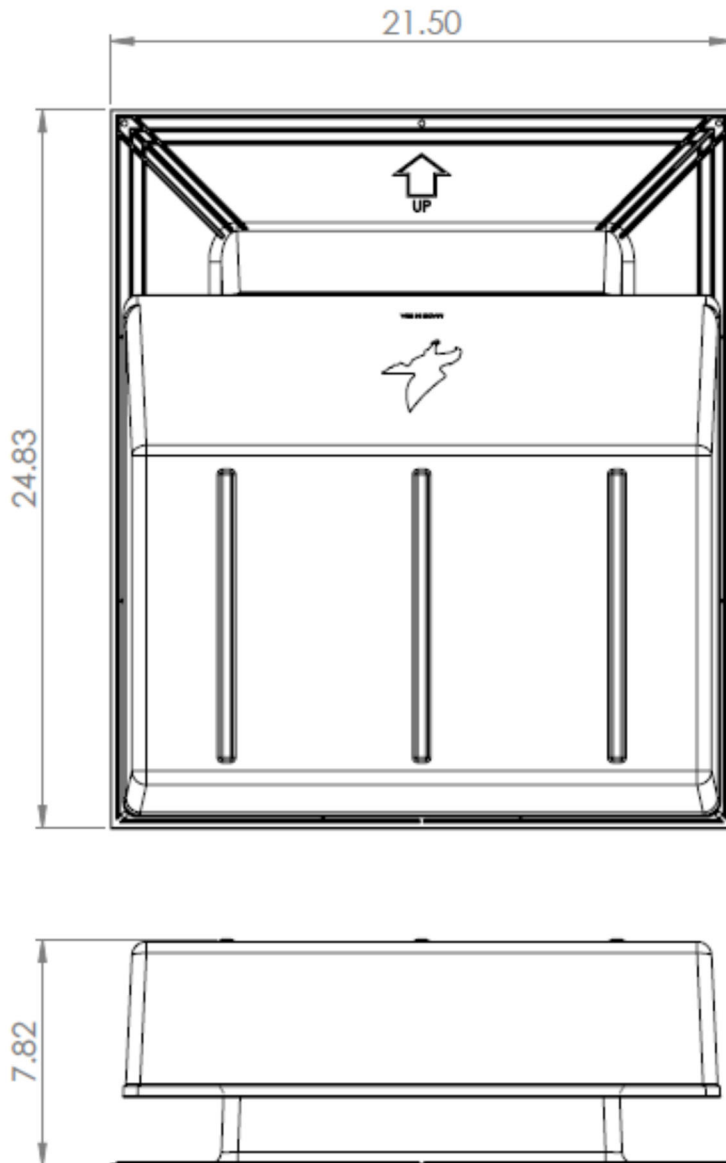

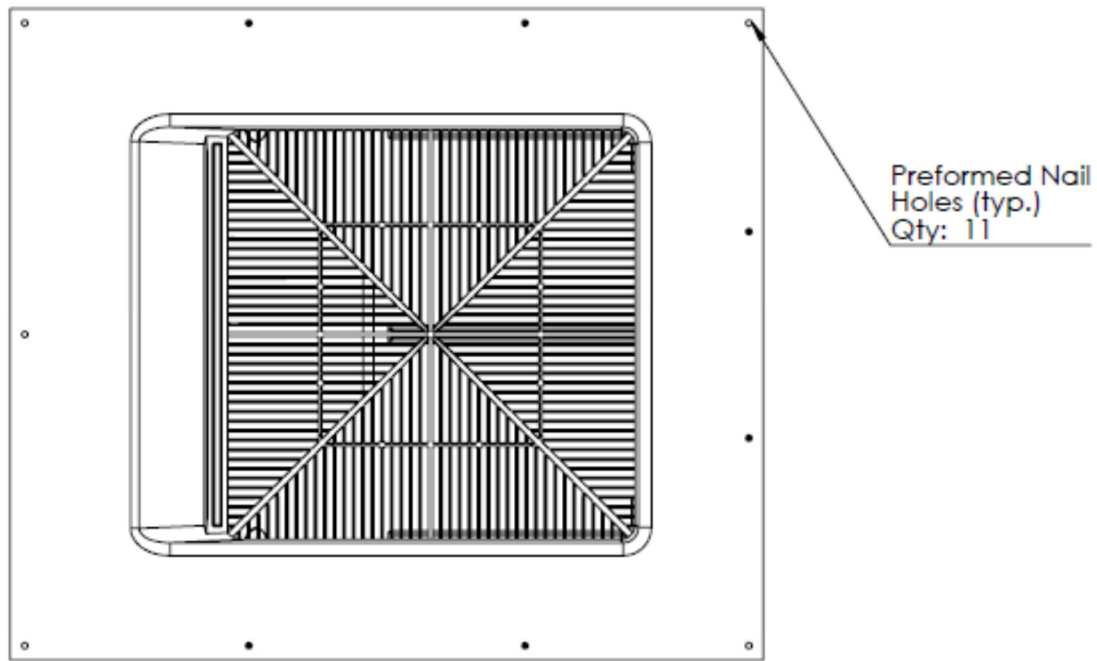

Bottom View

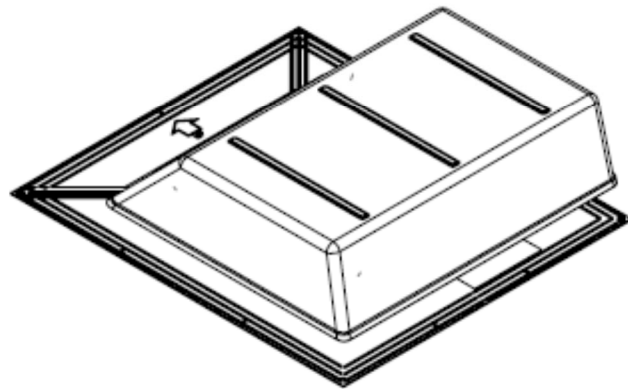

END OF THIS ACCEPTANCE