



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

DECRA Roofing Systems, Inc.
1230 Railroad St.
Corona, CA. 92882

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: DECRA Villa Tile Metal Roof Panel Vent

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA and consists of pages 1 through 4.
The submitted documentation was reviewed by Alex Tigera.

02/27/25



NOA No.: 24-0304.01
Expiration Date: 02/27/30
Approval Date: 02/27/25
Page 1 of 4

ROOFING COMPONENT APPROVAL

Category: Roofing
Sub-Category: Ventilation
Material: Metal
Minimum Slope: 3:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

<u>Product</u>	<u>Dimensions</u>	<u>Test Specification</u>	<u>Product Description</u>
DECRA Villa Tile	Ht. = 3" (avg.)	TAS 100(A)	Low profile attic exhaust vent consisting of all metal components for installation with DECRA Villa Tile Metal Roof panel roof systems.
Metal Roof Panel Vent	Width = 15-5/8" (avg.)		
	Lengths = 48-5/8" (avg.)		

MANUFACTURING LOCATION

1. Rohnert Park, CA

EVIDENCE SUBMITTED

<u>Test Agency/Identifier</u>	<u>Name</u>	<u>Report</u>	<u>Date</u>
Intertek Testing Services NA, Inc.	Q3787.01-450-18 R1	TAS-100(A)	12/20/24
PRI Construction Materials Technologies	1158T0001	ASTM B 117	06/07/22
	1158T0002	ASTM G 155	05/09/22



NOA No.: 24-0304.01
Expiration Date: 02/27/30
Approval Date: 02/27/25
Page 2 of 4

APPROVED APPLICATIONS:

Trade Name: DECRA Villa Tile Metal Roof Panel Vent

System Type A: Mechanical attachment of DECRA Villa Tile Metal Roof Panel Vent in a course run of DECRA metal roof panels, installed just below the roof ridge.

Installation:

1. At proper panel vent position in a roof panel course run near the roof ridge, cut a 19"w x 7"h hole in roof sheathing; attach metal vent screen unit.
2. Install DECRA Villa Tile Metal Roof Panel Vent unit directly over center of roof deck vent screen, in the DECRA roof panel course run.
3. Follow DECRA Installation Guide detail for attaching roof panels below, above, and to panel vent sides. Verify proper overlap of adjoining panels. Reference DECRA Roof Systems NOA No. **23-0207.04** for approved fastener type and placement to attach DECRA Villa Tile Metal Roof Panel Vent and adjacent DECRA Roof Panels.

Net Free Area: Refer to Manufacturer's website (www.decra.com) and Published Literature.

Minimum Slope: 3:12


LIMITATIONS:

1. Refer to applicable Building Code required ventilation.
2. DECRA Metal Roof Panel Vent shall comply with applicable Building Code.
3. DECRA Metal Roof Panel Vent shall not be installed on roof mean heights greater than 33 feet.
4. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.



NOA No.: 24-0304.01
Expiration Date: 02/27/30
Approval Date: 02/27/25
Page 3 of 4

DETAIL A

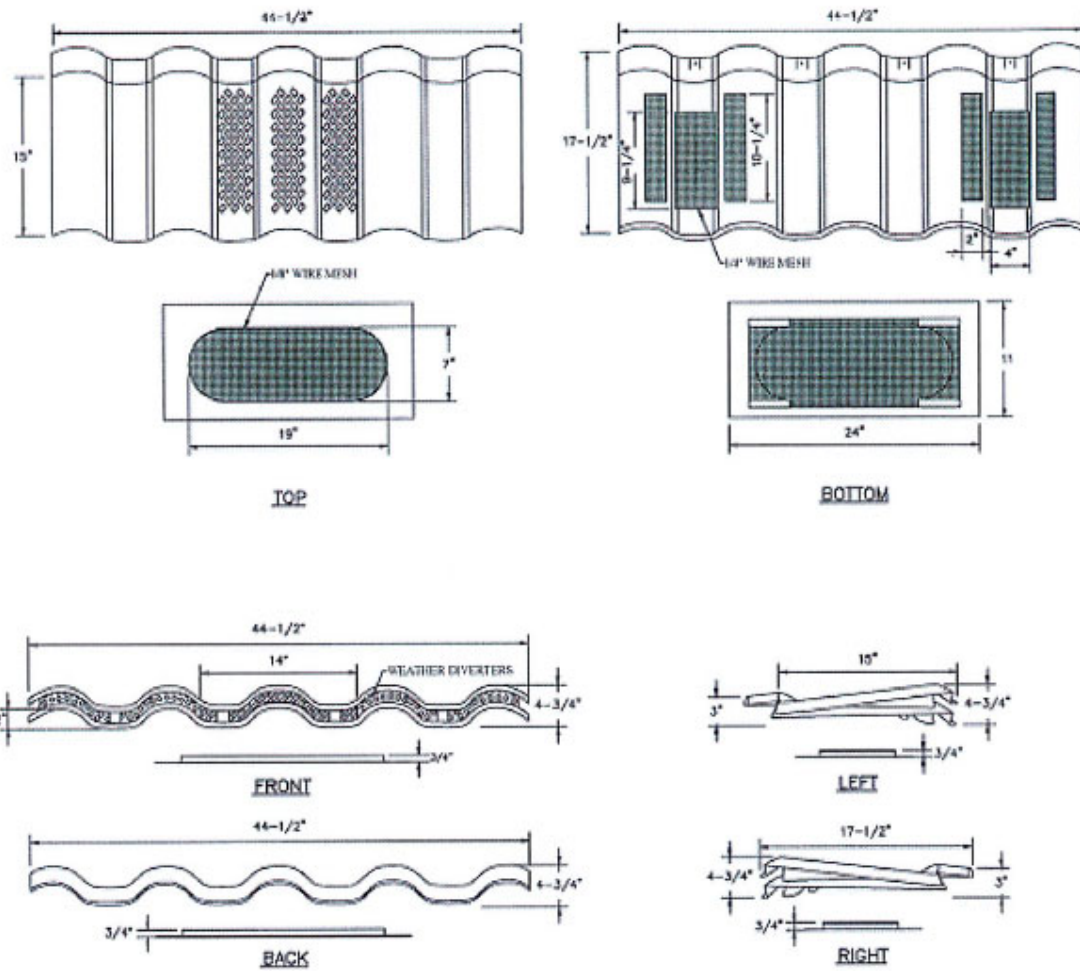

END OF THIS ACCEPTANCE