



**DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)**

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/building

**Loren Cook Company
2015 E. Dale Street
Springfield, MO 65803**

SCOPE: This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Models “GI and GR” Steel and Aluminum Rooftop Gravity Vents – N.I.

APPROVAL DOCUMENT: Drawing No. **SD130708-02**, titled “GI/GR Gravity Ventilator Hurricane Rated Steel and Aluminum”, sheet 1 through 10 of 10, dated 05/22/2014, prepared by manufacturer, signed and sealed by Jerry T. Miller, P.E. on 02/16/2024, bearing the Miami-Dade County Product Control Renewal stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each unit shall bear a permanent label with the manufacturer’s name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading ‘Miami-Dade County Product Control Approved’ is to be located on the door’s side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA **renews NOA No. 21-0405.11** and consists of this page 1 and evidence page E-1, E-2 and E-3, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



04/10/24

**NOA No. 24-0311.07
Expiration Date: August 21, 2029
Approval Date: April 18, 2024**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA's

A. DRAWINGS

1. Manufacturer's die drawings and sections.
(Submitted under NOA No. 13-1105.01)
2. Drawing No. **SD130708-02**, titled "GI/GR Gravity Ventilator Hurricane Rated Steel and Aluminum", sheets 1 through 10 of 10, dated 05/22/14, with revision D, prepared by manufacturer, signed and sealed by Bradley F. Skidmore, P.E.
(Submitted under NOA No. 19-0621.02)

B. TESTS

1. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
2) Large Missile Impact Test per FBC, TAS 201-94
along with marked-up drawings and installation diagram of Model ACRU/VCR 300 rooftop ventilator with 48" high roof curb, prepared by Intertek/ATI, Test Report No. **G1591.01-801-18**, dated 09/22/16, signed and sealed by Tyler Westerling, P.E.
(Submitted under NOA No. 16-1108.05)
2. Test reports on: 1) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
along with marked-up drawings and installation diagram of Series/Model GI steel and aluminum gravity ventilator, prepared by Architectural Testing, Inc., Test Report No. **C1438.01-801-18**, dated 07/05/13, with revision #2 dated 05/15/14, signed and sealed by Shawn G. Collins, P.E.
(Submitted under NOA No. 13-1105.01)

C. CALCULATIONS

1. Wind loads and anchor verification calculations dated 06/10/19, prepared by manufacturer, signed and sealed by Bradley F. Skidmore, P.E.
(Submitted under NOA No. 19-0621.02)



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 24-0311.07
Expiration Date: August 21, 2029
Approval Date: April 18, 2024

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS

1. Statement letter of conformance, complying with **FBC 6th Edition (2017)** dated 06/11/19, issued by manufacturer, signed and sealed by Bradley F. Skidmore, P.E.
(Submitted under NOA No. 19-0621.02)
2. Statement letter of no financial interest dated 10/29/13, issued by manufacturer, signed and sealed by Bradley F. Skidmore, P.E.
(Submitted under NOA No. 13-1105.01)

G. OTHERS

1. Notice of Acceptance No. **15-1013.02**, issued to Loren Cook Company for their Model GI and GR Steel and Aluminum Rooftop Gravity Vents, approved on 01/28/16 and expiring on 08/21/19.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 24-0311.07
Expiration Date: August 21, 2029
Approval Date: April 18, 2024

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. EVIDENCE SUBMITTED UNDER NOA # 21-0405.11 AND NEW

A. DRAWINGS

1. Drawing No. **SD130708-02**, titled “GI/GR Gravity Ventilator Hurricane Rated Steel and Aluminum”, sheet 1 through 10 of 10, dated 05/22/2014, prepared by manufacturer, signed and sealed by Jerry T. Miller, P.E. on 02/16/2024.

B. TESTS

1. None.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS



1. Statement letter of conformance, complying with 8th edition (2023) of the FBC, issued by Miller Engineering, dated 02/23/2024, signed and sealed by Jerry T. Miller, P.E.
2. Statement letter of no financial interest, issued by Miller Engineering, dated 02/23/2024, signed and sealed by Jerry T. Miller, P.E.

“Submitted under NOA # 21-0405.11”

3. Statement letter of code conformance, complying with the 7th edition (2020) of the FBC, issued by manufacturer, dated 03/19/2021, signed and sealed by Bradley F. Skidmore, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 24-0311.07
Expiration Date: August 21, 2029
Approval Date: April 18, 2024

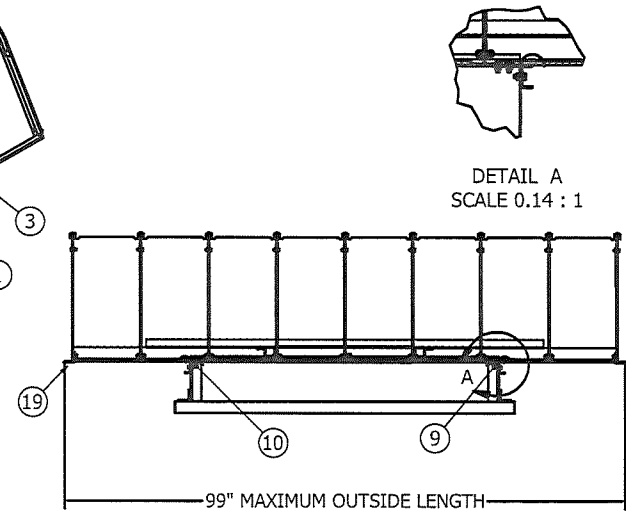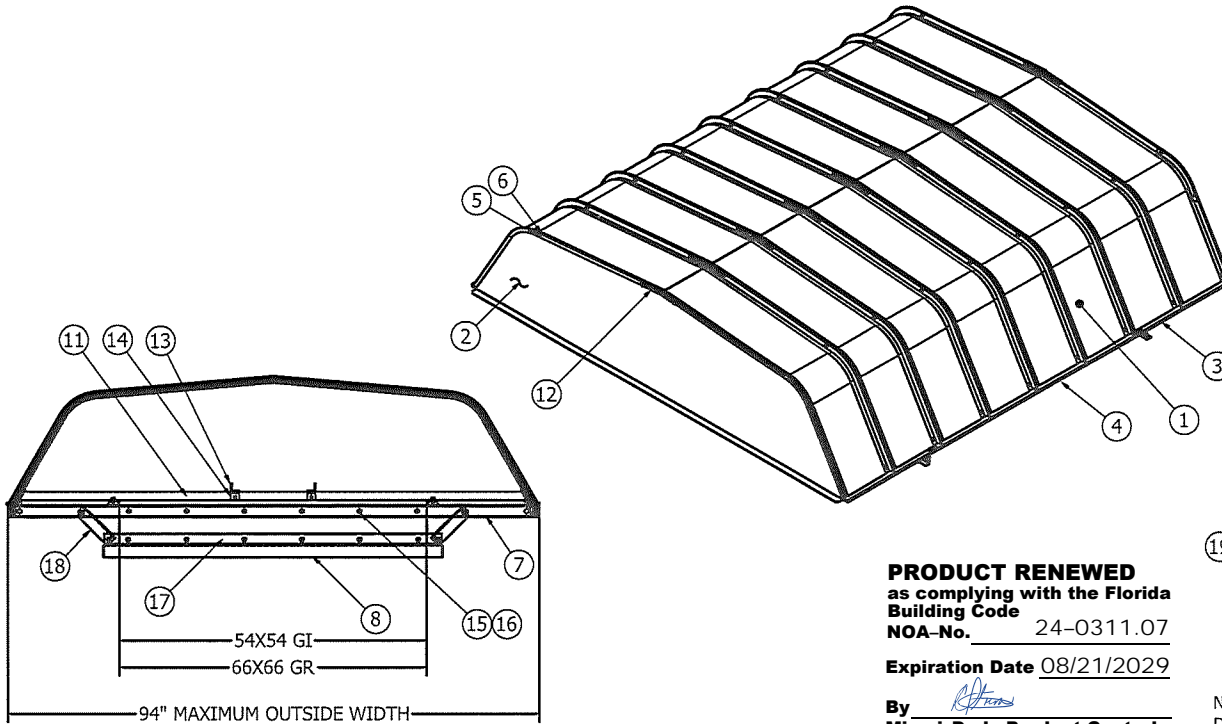

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07
 Expiration Date 08/21/2029
 By [Signature]
 Miami-Dade Product Control

NOTES:
 DESIGN PRESSURE: +/- 90 PSF GALVANIZED STEEL CONSTRUCTION
 +/- 90 PSF ALUMINUM CONSTRUCTION
 ALL DIMENSIONS IN INCHES
 DESIGN, TESTING AND ATTACHMENT CONFORMS TO FLORIDA BUILDING CODE
 UNIT SIZED DETERMINED BY INSIDE THROAT DIMENSION
 MAXIMUM SIZE: GI-54X54 (INTAKE) GR-66X66 (RELIEF)
 MAXIMUM OUTSIDE HOOD DIMENSIONS 94X99
 MAXIMUM UNIT WEIGHT: 630LBS (GALVANIZED STEEL) / 420LBS (ALUMINUM)

19	2	SHEET 6	END SUPPORT ANGLE
18	4	SHEET 10	HOOD SUPPORT ANGLE
17	2	SHEET 10	BASE SUPPORT ANGLE
16	22	---	5/16-18 WIZZNUT
15	22	---	5/16-18 x 3/4 WIZZLOCK BOLT
14	4	SHEET 7	BASE OPENING MOUNTING ANGLE (ALUM CONSTRUCTION ONLY)
13	2	SHEET 7	BASE OPENING ANGLE (ALUMINUM CONSTRUCTION ONLY)
12	18	SHEET 7	STIFFENING BRACKET
11	2	SHEET 7	SUPPORT ANGLE WELDMENT
10	2	SHEET 9	RIGHT MOUNTING BRACKET
9	2	SHEET 9	LEFT MOUNTING BRACKET
8	2	SHEET 8	BASE WELDMENT
7	2	SHEET 7	MOUNTING CHANNEL
6	77	---	1/4-20 WIZZ NUT
5	77	---	1/4-20 X .75 WIZZ BOLT
4	2	SHEET 6	SECTION RAIL SPLICE
3	4	SHEET 6	SECTION RAIL
2	2	SHEET 6	GI/GR END PANEL
1	8	SHEET 5	GI/GR HOOD PANEL
ITEM	QTY	SHEET NUMBER	DESCRIPTION




MAT'L	---	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 1 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 96"=±1/8"	
.XXXX=±.001"	>96" THRU 144"=±1/4"	
	>144"=±3/8"	
ANGULAR	(NC)=NO INSPECTION REQ'D	
±2"		




LOREN COOK CO.
 MANUFACTURERS OF AIR MOVING EQUIPMENT
 SPRINGFIELD, MISSOURI

GI/GR GRAVITY VENTILATOR
 HURRICANE RATED
 STEEL AND ALUMINUM

SIZE	DRAWING NO.	REV.
B	SD130708-02	D

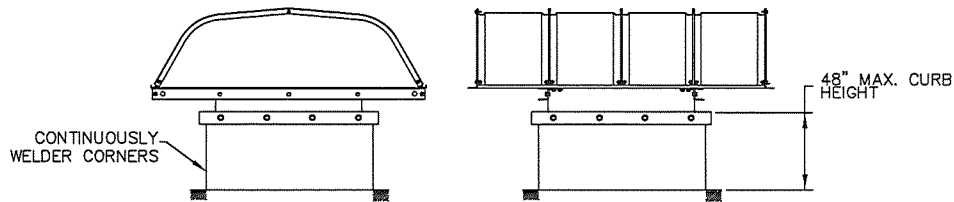


ATTACHMENT OF CURB TO ROOF STRUCTURE

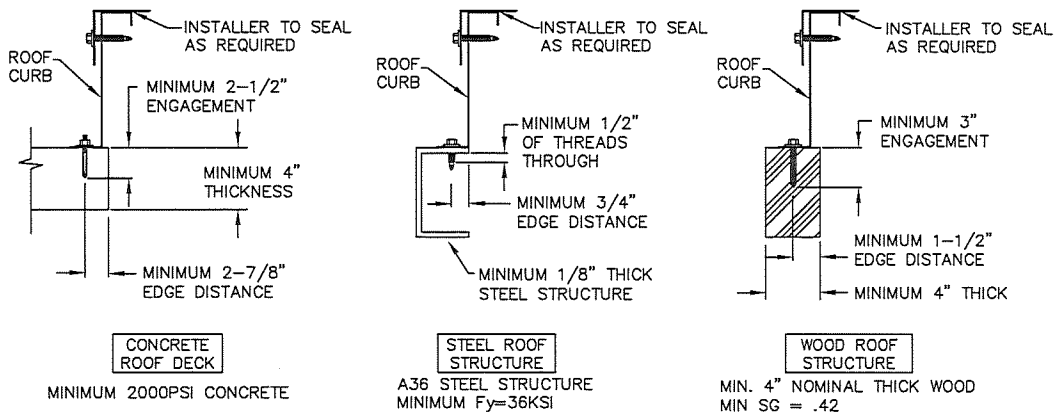



NOTES:


- 1) THE GI/GR GRAVITY VENTILATOR REFERRED TO HEREIN REFERS TO THE LOREN COOK MODEL GI WHICH IS NORMALLY USED FOR INTAKE VENTILATION AND THE MODEL GR WHICH IS NORMALLY USED FOR RELIEF VENTILATION. THE GI AND GR SIZES ARE DESIGNATED BY THE INSIDE THROAT DIMENSIONS WHICH SHALL NOT EXCEED 54"x54" FOR THE GI AND 66"x66" FOR THE GR AND MAY BE CONSTRUCTED FROM ALUMINUM OR GALVANIZED STEEL. THE OUTSIDE HOOD DIMENSIONS SHALL NOT EXCEED 94"x99".
- 2) THIS APPROVAL IS FOR THE STRUCTURAL CAPACITY OF THE EXTERIOR HOUSING ONLY, IT DOES NOT INCLUDE ANY INTERIOR MECHANISM OR ELECTRICAL PART.
- 3) THIS PRODUCT HAS NOT BEEN TESTED FOR IMPACT RESISTANCE.
- 4) THIS PRODUCT HAS NOT BEEN TESTED FOR WATER PENETRATION ACCORDING TO FLORIDA BUILDING CODE, TAS 100(A), WIND DRIVEN RAIN TEST. IT CANNOT BE INSTALLED WITHIN THE RIDGE AREA (FBC 1523.6.5.2.13)
- 5) UNIT IS TO INCLUDE A CURB CAP BASE TO FACILITATE MOUNTING OF THE UNIT TO A CURB. THE CURB WILL BE ADEQUATELY ATTACHED TO THE BUILDING STRUCTURE TO SUSTAIN ALL FORCES WHICH MAY BE PRODUCED BY THE PRESCRIBED ENVIRONMENTAL FORCES EXERTED ON THE FAN AND CURB. THE CURB MUST BE ATTACHED TO A STRUCTURAL MEMBER OF THE BUILDING.
 - CONCRETE DECK: CURB IS TO BE ATTACHED WITH WEDGE TYPE CONCRETE ANCHOR - MINIMUM 3/8" DIAMETER CARBON STEEL - HILTI KWIK BOLT 3 OR EQUAL. MINIMUM 2-1/2" OF ENGAGEMENT IN 2000 PSI MINIMUM CONCRETE. MINIMUM DECK THICKNESS IS 4".
 - STEEL ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH SELF-DRILLING STEEL SCREWS OF MINIMUM NOMINAL SIZE OF 1/4" DIAMETER AND SCREWS SHALL PASS THROUGH STEEL AT LEAST 1/2".
 - WOOD ROOF STRUCTURE: CURB IS TO BE ATTACHED WITH STEEL LAG BOLTS NOMINAL SIZE OF 3/8" DIAMETER. WOOD IS TO BE 4" NOMINAL SIZE OR GREATER. THE BOLTS SHALL HAVE A MINIMUM OF 3" OF THREAD ENGAGEMENT.
- 6) THE ROOF CURB SHALL HAVE CONTINUOUSLY WELDED CORNERS AND SHALL BE CONSTRUCTED OF G-90 GALVANIZED STEEL OR 5052H-34 ALUMINUM OR STAINLESS STEEL. THE CURB MATERIAL THICKNESS SHALL BE 18 GA (.0470") OR GREATER AND HAVE MINIMUM 30 KSI YIELD STRENGTH. THE HEIGHT SHALL NOT EXCEED 48".
- 7) THE GR GRAVITY VENTILATOR SHALL BE ATTACHED TO THE CURB WITH ONE OF THE FOLLOWING METHODS INSTALLED ON ALL FOUR SIDES OF THE CURB CAP. THE FASTENERS SHALL BE 6" FROM EACH CORNER OF THE FAN BASE AND SPACED NO GREATER THAN 6" THEREAFTER.
 - A) #12 X 2" HEX WASHER HEAD SELF-DRILLING SCREW
 - B) ALTERNATE FASTENER - .25"DIA. HEX HEAD BOLT AND WASHER WITH COMPANION NUT INSTALLED ON THE INTERIOR OF THE CURB.
- 8) ALL FASTENERS ARE TO BE HIGH QUALITY CORROSION RESISTANT STEEL OR STAINLESS STEEL. ALL ALUMINUM SHALL BE PROTECTED FROM CONTACT WITH DISSIMILAR METALS PER ADM1-2015. BY APPLYING BITUMINOUS COATING OR RUBBERIZED GASKETS BETWEEN SURFACES WHEN INSTALLING VENTS.
- 9) ANY GAP BETWEEN THE CURB AND CURB CAP SHALL BE FILLED BY THE INSTALLING CONTRACTOR WITH A SUITABLE CORROSION RESISTANT MATERIAL THAT ALLOWS THE FASTENERS TO BE INSTALLED WITHOUT CAUSING EXCESSIVE DISTORTION OF THE UNIT FLANGES.
- 10) THE INSTALLER IS RESPONSIBLE FOR CHECKING THAT ALL FASTENERS ARE PROPERLY INSTALLED AND ALL ACCESS PANELS ARE IN PLACE BEFORE PUTTING THE UNIT INTO SERVICE.
- 11) ALL FASTENERS AND ACCESS PANELS MUST BE PROPERLY INSTALLED AFTER MAINTENANCE OPERATIONS FOR UNIT TO MAINTAIN CODE COMPLIANCE.

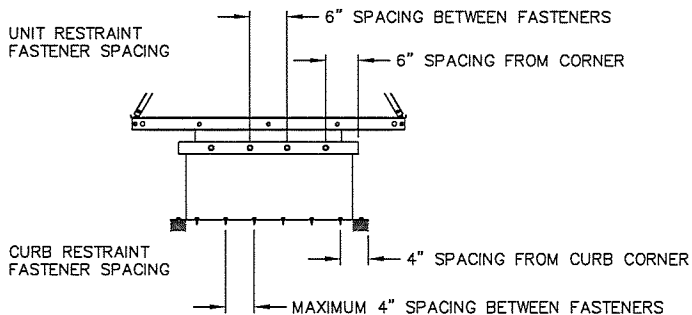

PRODUCT RENEWED
as complying with the Florida Building Code
NOA-No. 24-0311.07
Expiration Date 08/21/2029
By *[Signature]*
Miami-Dade Product Control




MAT'L	-	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 2 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 96"=±1/8"	
.XXXX=±.001"	>96" THRU 144"=±1/4"	
ANGULAR	>144"=±3/8"	
±2"	(NC)=NO INSPECTION REQ'D	
		
LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		
GI/GR GRAVITY VENTILATOR HURRICANE RATED ALUMINUM AND STEEL		
SIZE	DRAWING NO.	REV.
B	SD130708-02	D

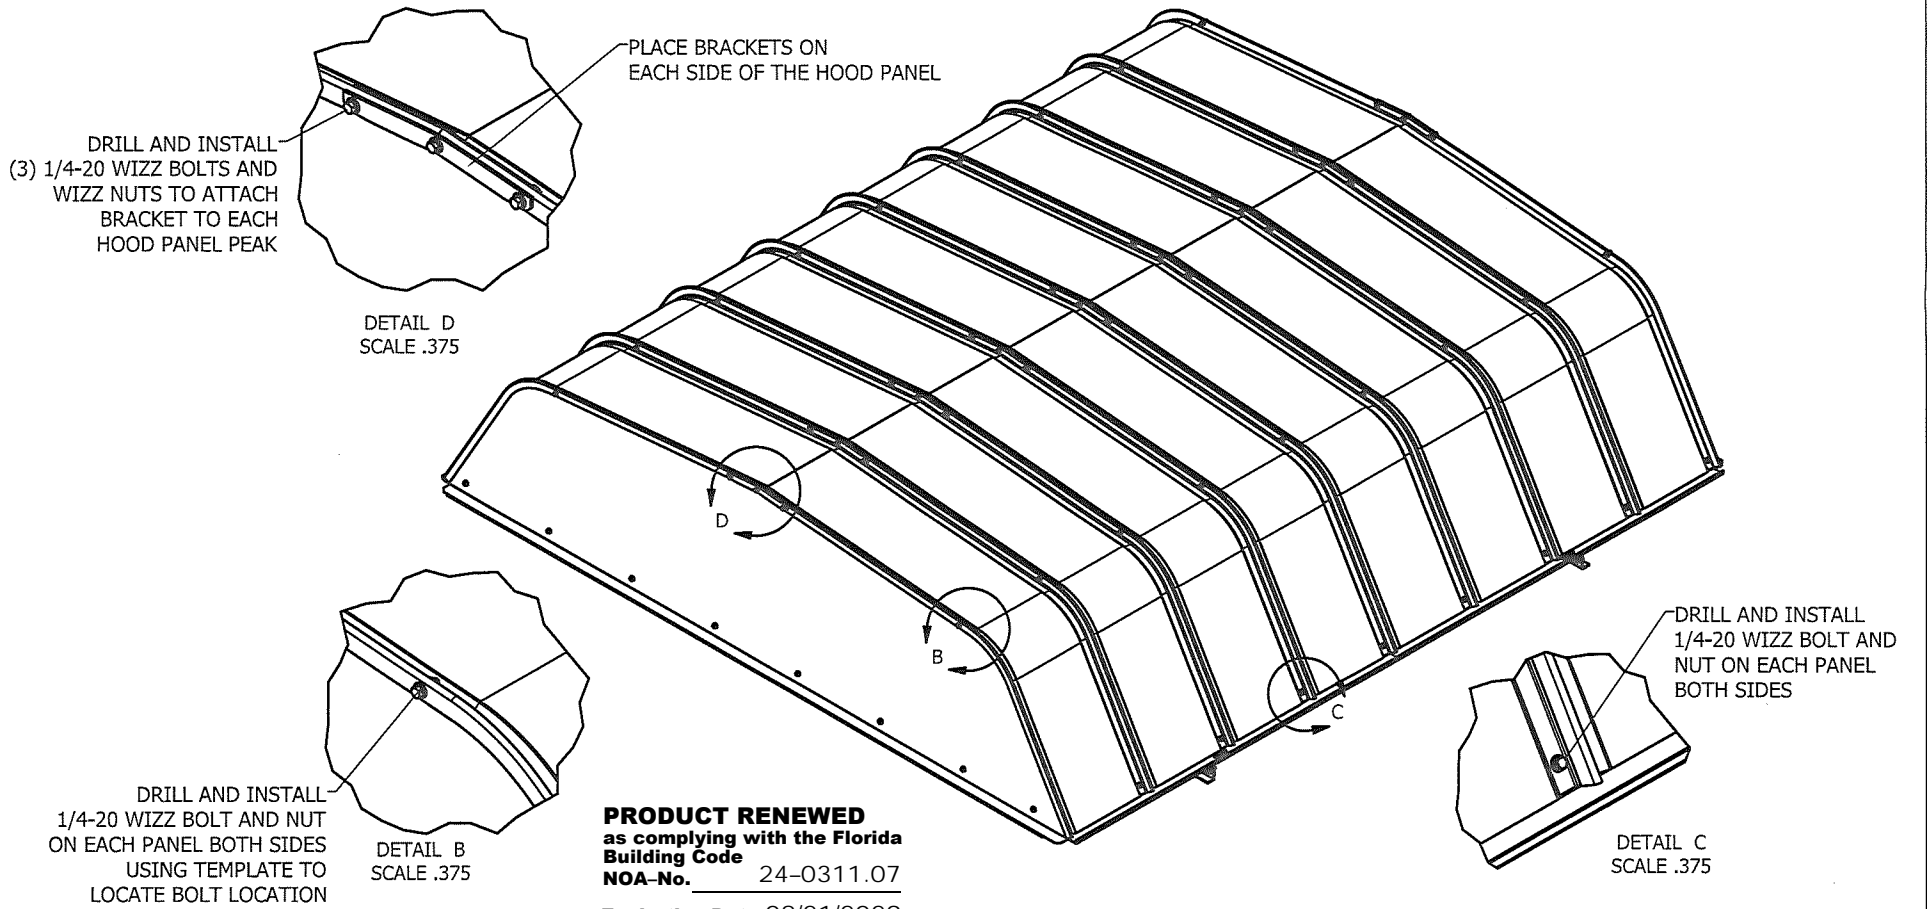

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07
 Expiration Date 08/21/2029
 By *[Signature]*
 Miami-Dade Product Control



NOTES:
 1. ATTACH BIRDSCREEN TO UNDERSIDE OF SECTION RAIL AND END PANEL




MAT'L	-	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 3 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 96"=±1/8"	
.XXX=±.001"	>96" THRU 144"=±1/4"	
ANGULAR	>144"=±3/8"	
±2'	(NC)=NO INSPECTION REQ'D	

LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		SIZE	DRAWING NO.	REV.
		B	SD130708-02	D

GI/GR GRAVITY VENTILATOR
 HURRICANE RATED
 STEEL AND ALUMINUM

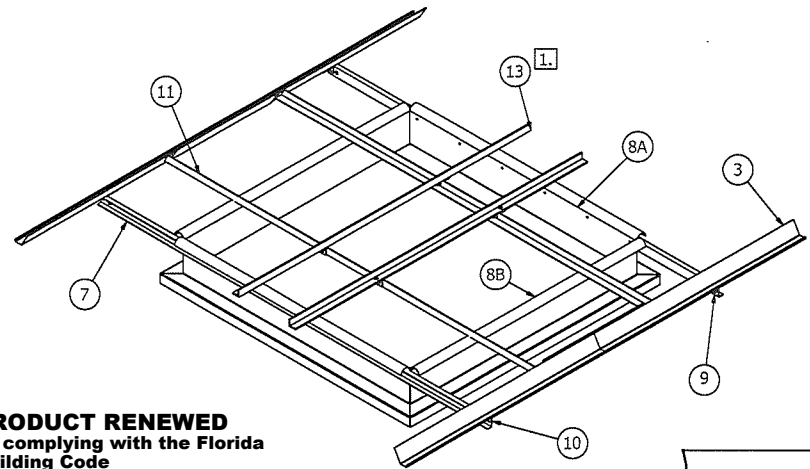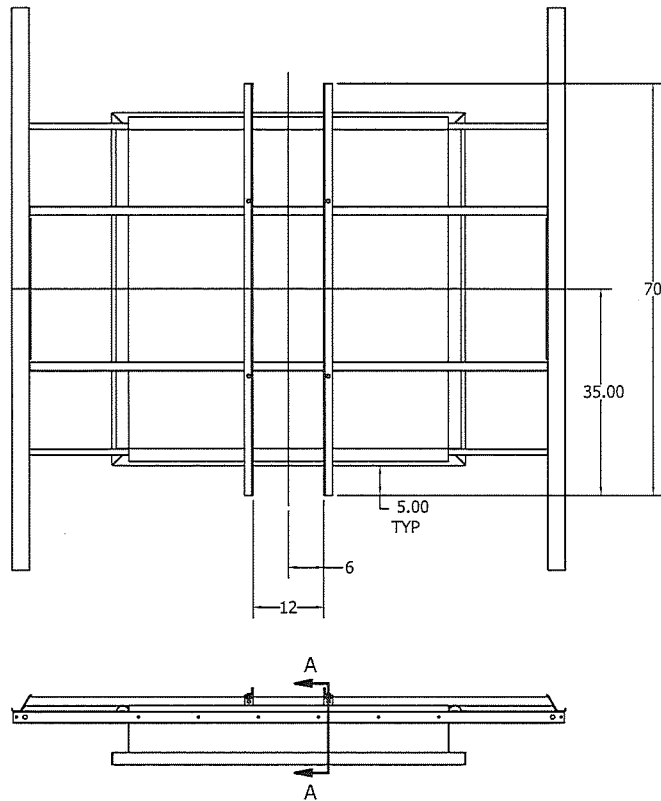

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07
 Expiration Date 08/21/2029
 By *[Signature]*
 Miami-Dade Product Control




DETAIL E
 SCALE 0.375 : 1




SECTION A-A
 SCALE 0.07 : 1


NOTES:
 1. ITEMS 13 AND 14 FOR ALUMINUM HURRICANE CONSTRUCTION ONLY NOT
 REQUIRED FOR GALVANIZED HURRICANE CONSTRUCTION

ITEM	QTY	SHEET NO.	DESCRIPTION
14	4	SHEET 7	BASE OPENING MOUNTING ANGLE (REQUIRED ON ALUMINUM UNITS ONLY)
13	2	SHEET 7	BASE OPENING ANGLE (REQUIRED ON ALUMINUM UNITS ONLY)
11	2	SHEET 7	SUPPORT ANGLE WELDMENT
10	2	SHEET 9	RIGHT MOUNTING BRACKET
9	2	SHEET 9	LEFT MOUNTING BRACKET
8	1	SHEET 8	BASE WELDMENT
7	2	SHEET 7	MOUNTING CHANNEL
3	4	SHEET 6	SECTION RAIL




MAT'L	-	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 4 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 96"=±1/8"	
.XXXX=±.001"	>96" THRU 144"=±1/4"	
ANGULAR	>144"=±3/8"	
±2'	(NC)=NO INSPECTION REQ'D	

 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI	GI/GR GRAVITY VENTILATOR HURRICANE RATED STEEL AND ALUMINUM	
	SIZE	DRAWING NO.
B	SD130708-02	REV. D

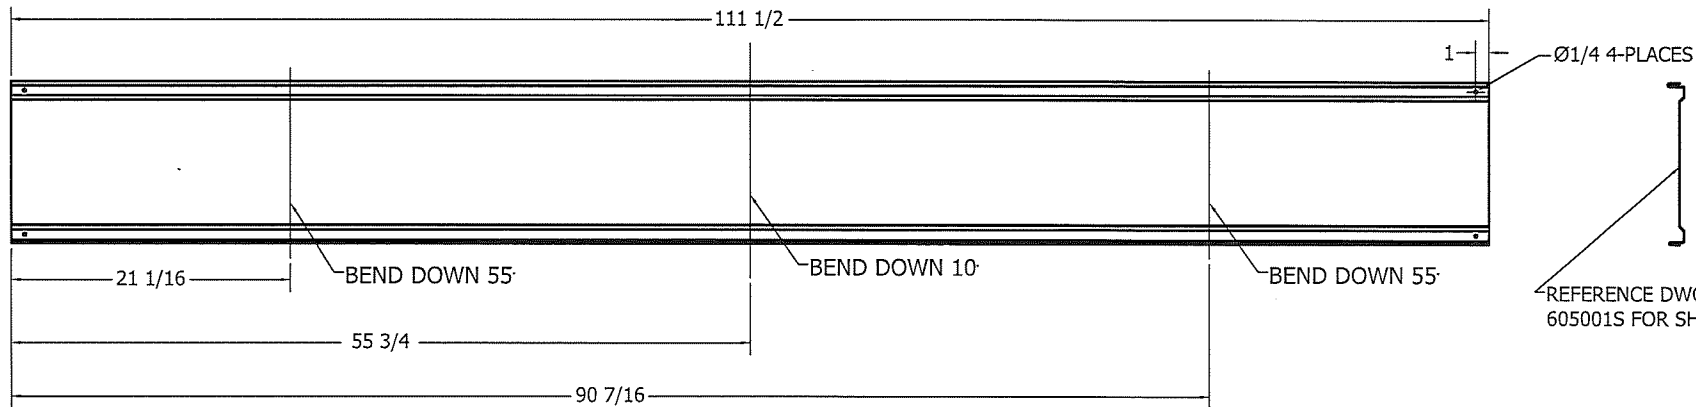


HOOD PANEL

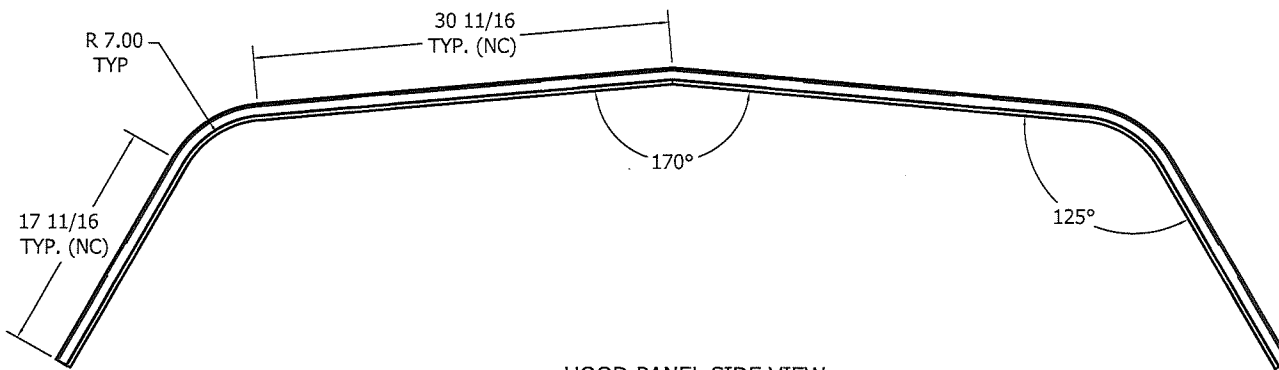

HOOD PANEL SIDE VIEW


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07
 Expiration Date 08/21/2029
 By *RH*
 Miami-Dade Product Control

NOTES:
 8 HOOD PANELS REQUIRED PER UNIT
 MATERIAL: 20 GA G-90 GALVANIZED STEEL: $S_y=30$ KSI MINIMUM
 ALTERNATE CONSTRUCTION: .040 3003 H-14 ALUMINUM: $S_y=17$ KSI MINIMUM




MAT'L		-	
DRAWN	BFS	05/22/14	
DESIGNER	BFS	SHEET 5 OF 10	
DO NOT SCALE DRAWING			
TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL	FRACTIONAL		
.XX=±.063"	<12"=±1/16"		
.XXX=±.010"	>12" THRU 96"=±1/8"		
.XXXX=±.001"	>96" THRU 144"=±1/4"		
ANGULAR	>144"=±3/8"		
±2"	(NC)=NO INSPECTION REQ'D		


		LOREN COOK CO.	
<small>MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI</small>			
GI/GR GRAVITY VENTILATOR			
HURRICANE RATED			
STEEL AND ALUMINUM			
SIZE	DRAWING NO.		REV.
B	SD130708-02		D

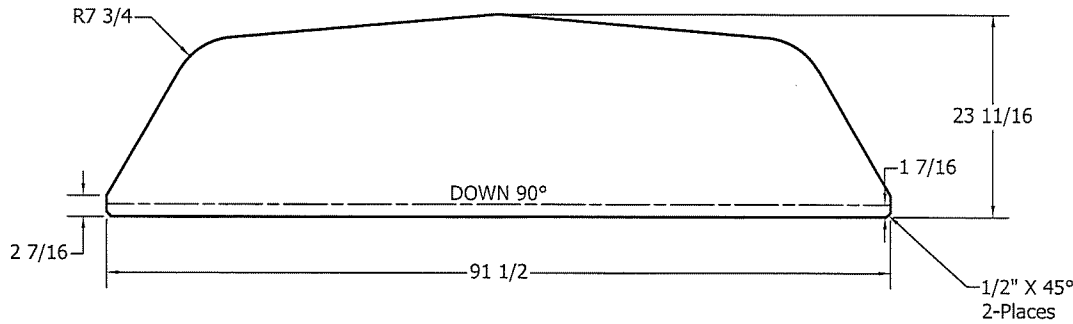

HOOD END PANEL

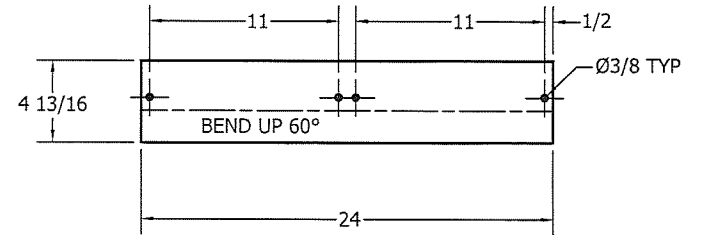


SECTION RAIL SPLICE

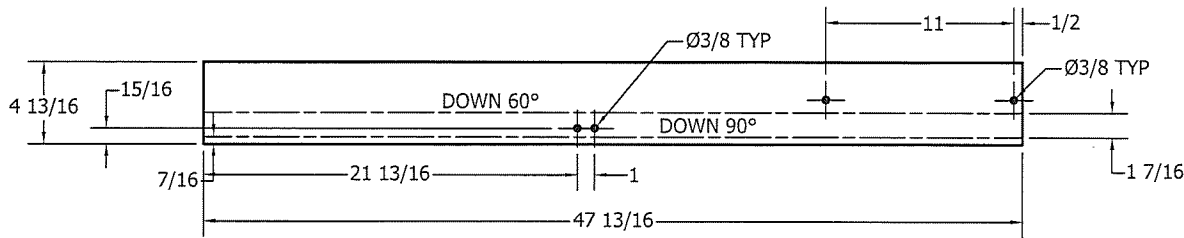

SECTION RAIL

BEND 2 AS SHOWN, BEND 2 OPPOSITE

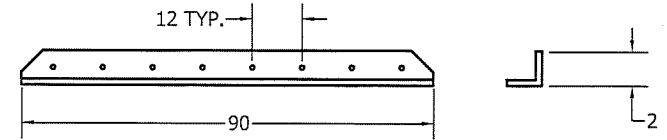

END SUPPORT ANGLE

NOTES:


- 1) G90 GALVANIZED STEEL: Sy=30 KSI MINIMUM
- 2) A36 STEEL: Sy=36 KSI MINIMUM
- 3) 6005-T5 ALUMINUM: Sy=35 KSI MINIMUM
- 4) 3003H-14 ALUMINUM SHEET: Sy=17 KSI MINIMUM

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07


Expiration Date 08/21/2029

By *[Signature]*
 Miami-Dade Product Control

ITEM	DESCRIPTION	QTY	MATERIAL
19	END SUPPORT ANGLE (2x2x1/4)	2	A36 STEEL-PAINTED / 6005-T5 ALUMINUM
4	SECTION RAIL SPLICE	2	16 GA G90 GALV STEEL / .100 ALUMINUM(NOTE4)
3	SECTION RAIL	4	16 GA G90 GALV STEEL / .100 ALUMINUM(NOTE4)
2	HOOD END PANEL	2	18 GA G90 GALV STEEL / .063 ALUMINUM(NOTE4)




MAT'L	SEE TABLE	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 6 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 96"=±1/8"	
.XXXX=±.001"	>96" THRU 144"=±1/4"	
ANGULAR	>144"=±3/8"	
±2"	(NC)=NO INSPECTION REQ'D	




LOREN COOK CO.
 MANUFACTURERS OF AIR MOVING EQUIPMENT
 SPRINGFIELD, MISSOURI

GI/GR GRAVITY VENTILATOR
HURRICANE RATED
STEEL AND ALUMINUM


SIZE	DRAWING NO.	REV.
B	SD130708-02	D

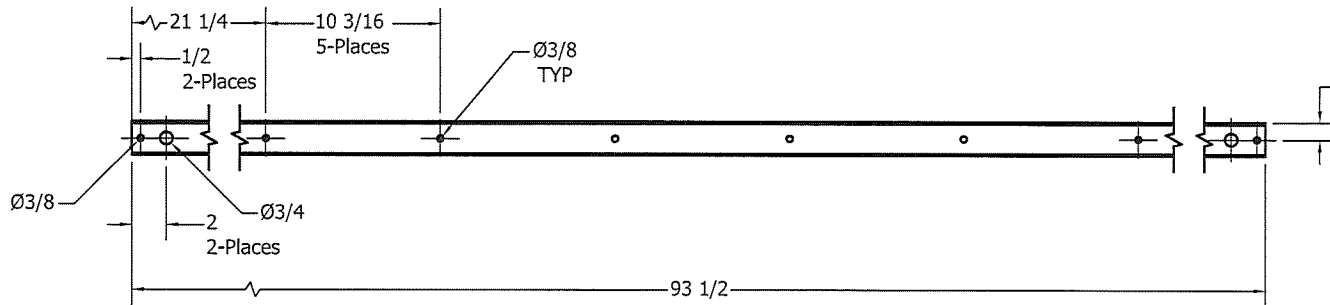


MOUNTING CHANNEL

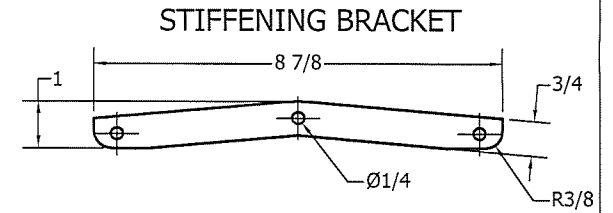


STIFFENING BRACKET

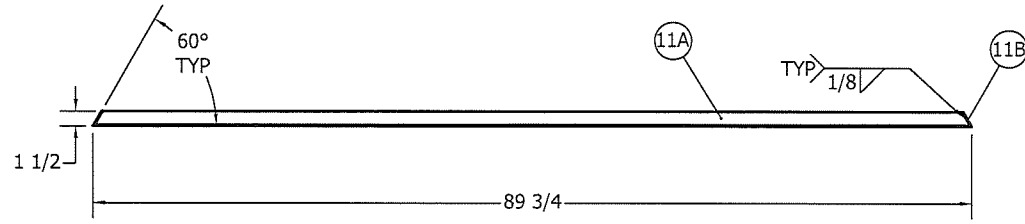

SUPPORT ANGLE WELDMENT



BASE OPENING ANGLE

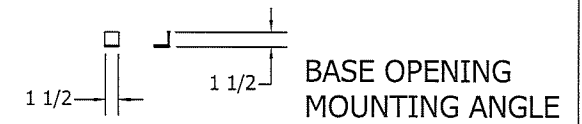

BASE OPENING MOUNTING ANGLE

NOTES:


- 1) G90 GALVANIZED STEEL: Sy=30KSI MINIMUM
- 2) A36 STEEL: Sy=36KSI MINIMUM
- 3) 6005-T5 ALUMINUM: Sy=35KSI MINIMUM
- 4) 3003H-14 ALUMINUM SHEET: Sy=17KSI MINIMUM


PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07




Expiration Date 08/21/2029

By *[Signature]*
 Miami-Dade Product Control

ITEM	DESCRIPTION	QTY	MATERIAL
14	BASE OPENING MOUNTING ANGLE	4	1-1/2 X 1-1/2 X 1/8 ALUM ANGLE (NOTE3)
13	BASE OPENING ANGLE	2	1-1/2 X 1-1/2 X 1/8 ALUM ANGLE (NOTE3)
12	STIFFENING BRACKET	18	12 GA G-90 GALV. STEEL(NOTE1)
11B	END CAP	4	1 1/2 X 1 3/4 X 12 GA (NOTE1) OR 1 1/2 X 1 3/4 X 1/8" ALUMINUM(NOTE4)
11A	SUPPORT ANGLE	2	1 1/2 X 1 1/2 X 12 GA (NOTE1) OR 1 1/2X1 1/2 X 1/8" ALUMINUM(NOTE3)
11	SUPPORT ANGLE WELDMENT	(2)	(SEE PARTS ABOVE)
7	MOUNTING CHANNEL	2	2 X 1 X 12GA (NOTE1) / 2 X 1 X .130 ALUMINUM (NOTE3)




MAT'L	SEE NOTES		 LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI
DRAWN	BFS	05/22/14	
DESIGNER	BFS	SHEET 7 OF 10	
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED			
DECIMAL	FRACTIONAL		
.XX=±.063"	≤12"=±1/16"		
.XXX=±.010"	>12" THRU 96"=±1/8"		
.XXXX=±.001"	>96" THRU 144"=±1/4"		
ANGULAR ±2'	>144"=±3/8"		
(NC)=NO INSPECTION REQ'D			
GI/GR GRAVITY VENTILATOR HURRICANE RATED STEEL AND ALUMINUM			REV.
SIZE DRAWING NO.			D
B SD130708-02			

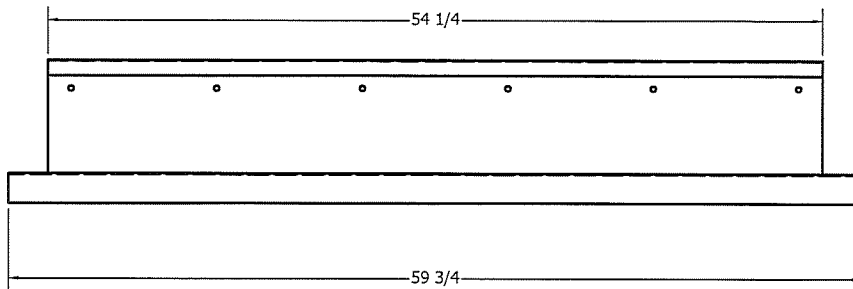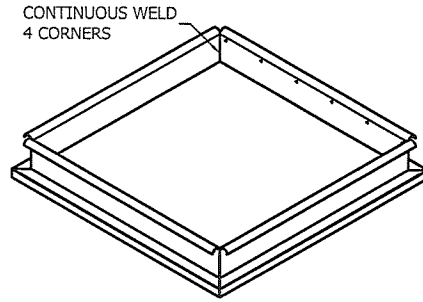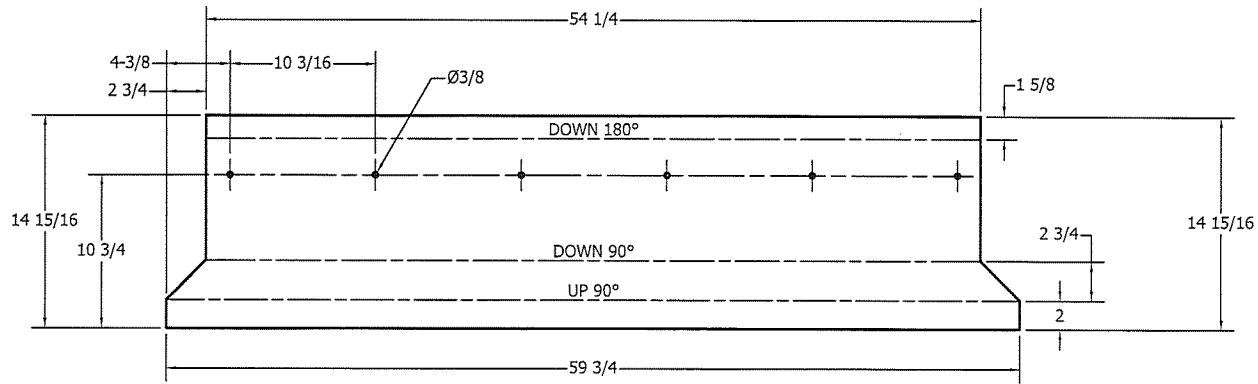

BASE PANEL

*PUNCH HOLES IN TWO PARTS ONLY




PRODUCT RENEWED
as complying with the Florida
Building Code
NOA-No. 24-0311.07

Expiration Date 08/21/2029


By 
Miami-Dade Product Control


NOTES:
MATERIAL: 16 GA. G-90 GALVANIZED STEEL $S_y=30$ KSI MINIMUM
ALTERNATE MATERIAL: .080 3003 H-14 ALUMINUM $S_y=17$ KSI MINIMUM

ITEM	QTY	DESCRIPTION	MATERIAL
8A	2	BASE PANEL WITH HOLES	SEE NOTES
8B	2	BASE PANEL WITHOUT HOLES	SEE NOTES



MAT'L	SEE NOTES	
DRAWN	BFS	5/22/14
DESIGNER	BFS	SHEET 8 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 95"=±1/8"	
.XXXX=±.001"	>95" THRU 144"=±1/4"	
ANGULAR	>144"=±3/8"	
±2'	(NC)=NO INSPECTION REQ'D	


	LOREN COOK CO.	
	MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI	
GI/GR GRAVITY VENTILATOR HURRICANE RATED STEEL AND ALUMINUM		
SIZE	DRAWING NO.	REV.
B	SD130708-02	D

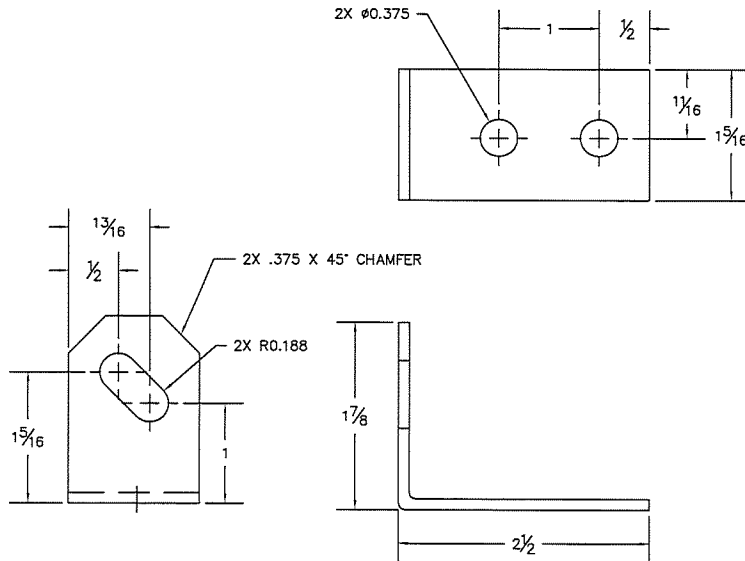

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07
 Expiration Date 08/21/2029
 By *R. Torres*
 Miami-Dade Product Control

NOTES:
 1) G90 GALVALIZED STEEL: Sy=30KSI MINIMUM


ITEM	QTY	DESCRIPTION	MATERIAL
10	2	RIGHT MOUNTING BRACKET (FORM OPPOSITE)	12GA. G90 GALV. STEEL
9	2	LEFT MOUNTING BRACKET (AS SHOWN)	12GA. G90 GALV. STEEL




MAT'L	SEE TABLE	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 9 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX±.063"	≤12" = ±1/16"	
.XXX±.010"	>12" THRU 96" = ±1/8"	
.XXXX±.001"	>96" THRU 144" = ±1/4"	
	>144" = ±3/8"	
ANGULAR	±2° (NC)=NO INSPECTION REQ'D	

LOREN COOK CO.
 MANUFACTURERS OF AIR MOVING EQUIPMENT
 SPRINGFIELD, MISSOURI

GI/GR GRAVITY VENTILATOR HURRICANE RATED STEEL AND ALUMINUM		
SIZE	DRAWING NO.	REV.
B	SD130708-02	D

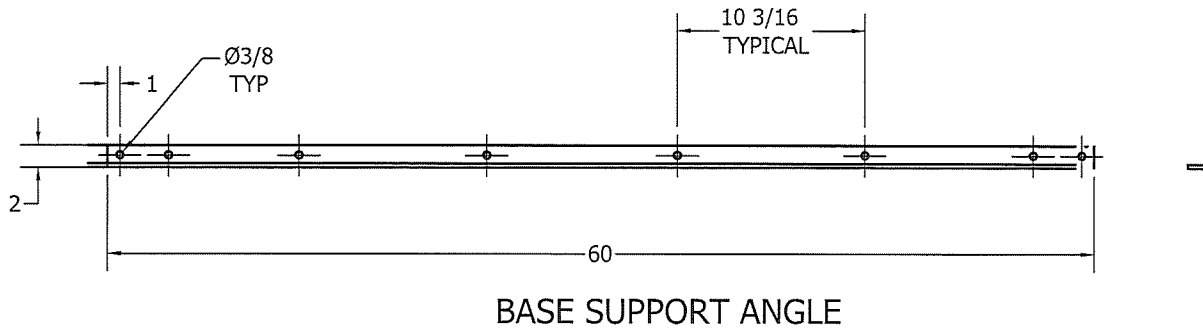

BASE SUPPORT ANGLE

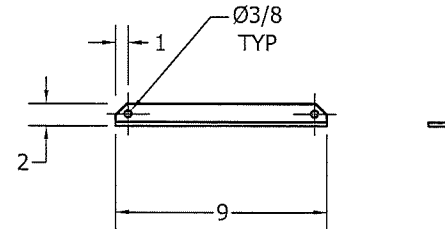


HOOD SUPPORT ANGLE

PRODUCT RENEWED
 as complying with the Florida
 Building Code
 NOA-No. 24-0311.07
 Expiration Date 08/21/2029
 By [Signature]
 Miami-Dade Product Control

- NOTES:
 1) A36 STEEL: Sy=36KSI MINIMUM
 2) 6005-T5 ALUMINUM: Sy=35KSI MINIMUM

ITEM	DESCRIPTION	QTY	MATERIAL
18	HOOD SUPPORT ANGLE	4	2 X 2 X 1/4 A36 (NOTE1) OR 2 X 2 X 1/4 ALUMINUM (NOTE2)
17	BASE SUPPORT ANGLE	2	2 X 2 X 1/4 A36 (NOTE1) OR 2 X 2 X 1/4 ALUMINUM (NOTE2)



MAT'L	SEE NOTES	
DRAWN	BFS	05/22/14
DESIGNER	BFS	SHEET 10 OF 10
DO NOT SCALE DRAWING TOLERANCES UNLESS OTHERWISE NOTED		
DECIMAL	FRACTIONAL	
.XX=±.063"	≤12"=±1/16"	
.XXX=±.010"	>12" THRU 96"=±1/8"	
.XXXX=±.001"	>96" THRU 144"=±1/4"	
ANGULAR	>144"=±3/8"	
±2'	(NC)=NO INSPECTION REQ'D	

LOREN COOK CO. MANUFACTURERS OF AIR MOVING EQUIPMENT SPRINGFIELD, MISSOURI		
GI/GR GRAVITY VENTILATOR HURRICANE RATED STEEL AND ALUMINUM		
SIZE	DRAWING NO.	REV.
B	SD130708-02	D